
FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, SINGLE POLE (10 THROUGH 100 AMPERES)

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

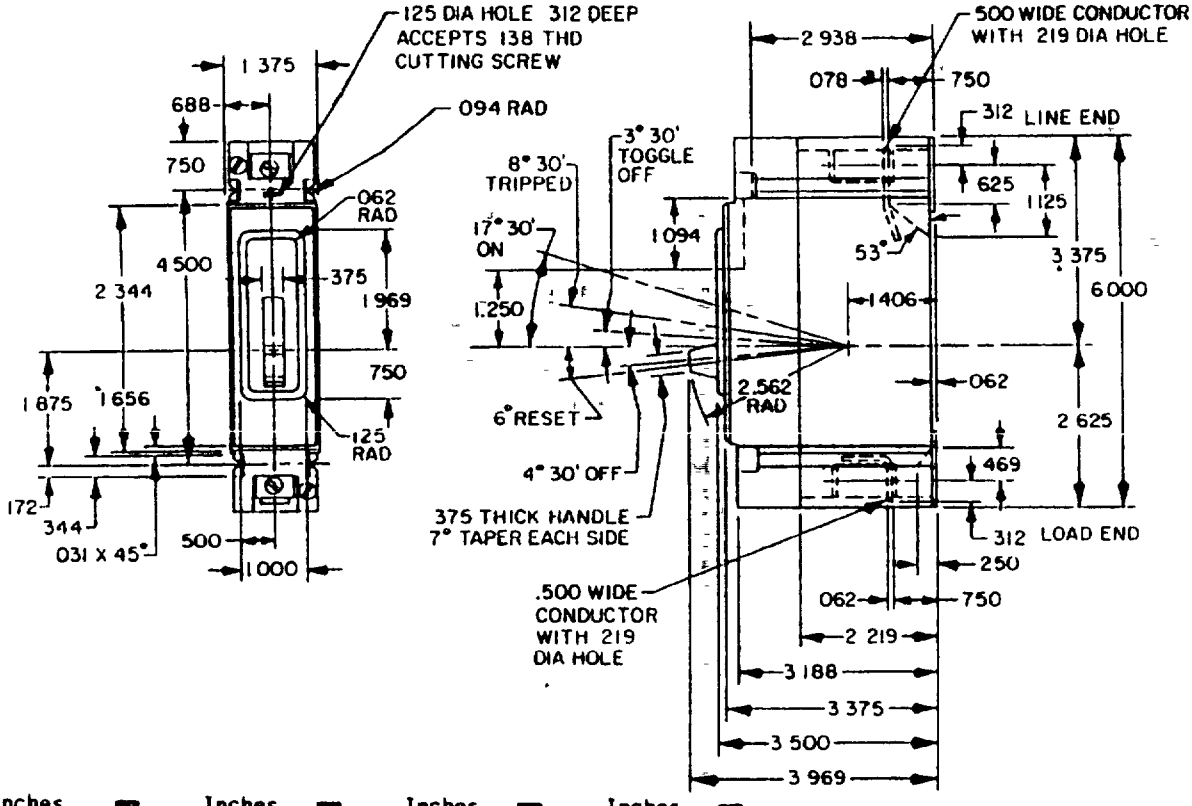

Inches	mm	Inches	mm	Inches	mm	Inches	mm
.031	0.79	.344	8.74	1.125	28.58	2.562	65.07
.062	1.57	.375	9.53	1.250	31.75	2.625	66.68
.078	1.98	.469	11.91	1.375	34.93	2.750	69.85
.094	2.39	.500	12.70	1.406	35.71	2.938	74.63
.125	3.18	.625	15.88	1.656	42.06	3.188	80.98
.138	3.51	.656	16.66	1.875	47.63	3.375	85.73
.172	4.37	.688	17.48	1.969	50.01	3.500	88.90
.188	4.78	.750	19.05	2.062	52.37	3.969	100.81
.219	5.56	1.000	25.40	2.219	56.36	4.500	114.30
.250	6.35	1.094	27.79	2.344	59.54	6.000	152.40
.312	7.92						

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Tolerance is ±.010 (0.25 mm)
4. Line and load terminals shall accept and be suitable for no. 14 thru no.1/0 copper (CU) or aluminum (AL) wire.

FIGURE 1 Dimensions and configuration

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited
Source: https://assist.dla.mil - Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction. See figure 1.

Trip indication: See figure 1.

Common trip: All poles shall make and break simultaneously when operated manually or automatically.

Electrical:

Interrupting current rating: RMS symmetrical.

18,000 amperes at 240 V ac
14,000 amperes at 277 V ac.
14,000 amperes at 480 V ac.

Voltage rating 480 V ac maximum.

Trip current: See table I.

Frequency: 60 hertz.

Calibration. At 40°C.

Enclosure for overload, endurance, and short circuit tests. Westinghouse catalog no SFB, or equivalent.

TABLE I Part numbers and current rating.

Government part number	Current rating
WC375/16-001 1/	10
-002	15
-003	20
-004	25
-005	30
-006	35
-007	40
-008	50
-009	60
-010	70
-011	90
-012	100

1/ Not for new design

TABLE II. Supersession and cross reference.

Government part number	Superseded number CAGE 79500			
WC375/16-001	EHB1010L	EHB1010	EHD1010L	EHD1010
-002	1015L	1015	1015L	1015
-003	1020L	1020	1020L	1020
-004	1025L	1025	1025L	1025
-005	1030L	1030	1030L	1030
-006	1035L	1035	1035L	1035
-007	1040L	1040	1040L	1040
-008	1050L	1050	1050L	1050
-009	1060L	1060	1060L	1060
-010	1070L	1070	1070L	1070
-011	1090L	1090	1090L	1090
-012	1100L	1100	1100L	1100

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

NOTE: Revision letters are not used to denote changes due to the extensiveness of the changes.

Military custodians:

Navy - YD
Air Force - 85

Review activities:

Air Force - 80
DLA - ES

User activity:

Navy - OS, MC

Civil agency coordinating activities

DC GOVT - DCG
GSA - FSS, PBO, PCD
DOT - ACO
HHS - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - OSS

Preparing activity

DLA - ES

(Project 5925-0198-1)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.