INCH-POUND

W-C-375/16B
04 August 2004
SUPERSEDING
W-C-375/16A
11 April 1988

FEDERAL SPECIFICATION SHEET

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, SINGLE POLE (10 THROUGH 100 AMPERES)

The General Services Administration has authorized the use of this federal specification sheet by all federal agencies.

* The complete requirements for procuring circuit breakers described herein shall consist of this document and the latest issue in effect of W-C-375.

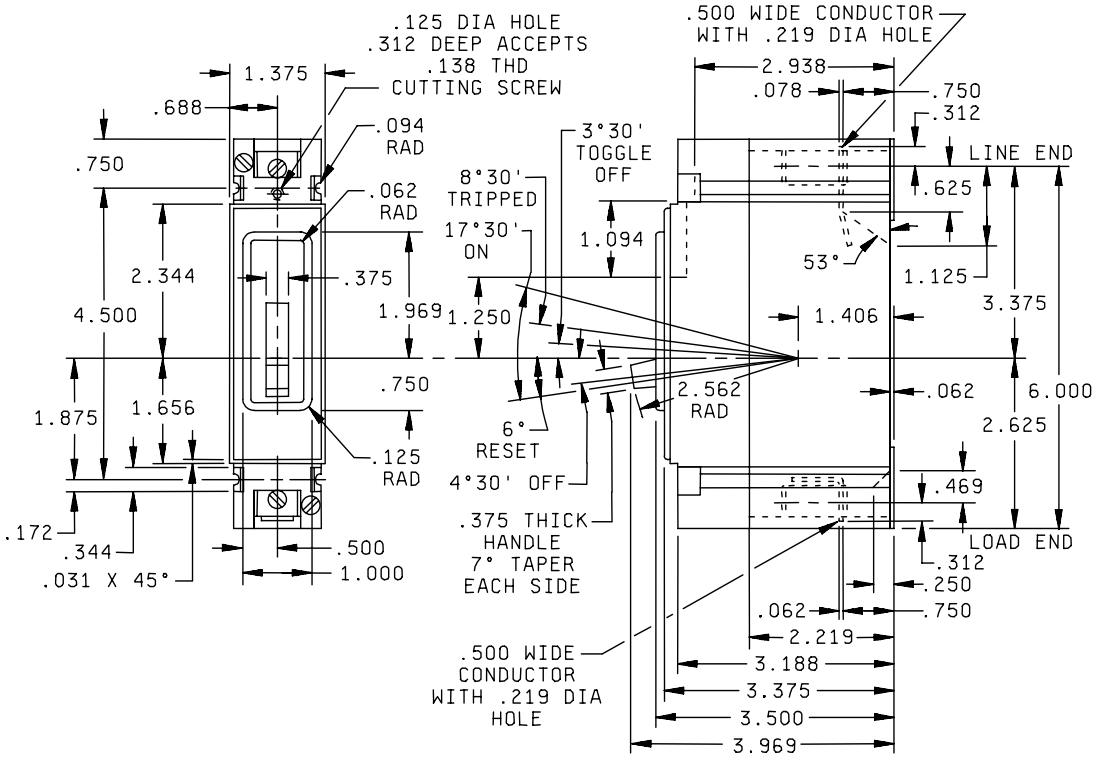


FIGURE. Dimensions and configuration.

* AMSC N/A

FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

Inches	mm	Inches	mm	Inches	mm	Inches	mm
.031	0.79	.344	8.74	1.125	28.58	2.562	65.07
.062	1.57	.375	9.53	1.250	31.75	2.625	66.68
.078	1.98	.469	11.91	1.375	34.93	2.750	69.85
.094	2.39	.500	12.70	1.406	35.71	2.938	74.63
.125	3.18	.625	15.88	1.656	42.06	3.188	80.98
.138	3.51	.656	16.66	1.875	47.63	3.375	85.73
.172	4.37	.688	17.48	1.969	50.01	3.500	88.90
.188	4.78	.750	19.05	2.062	52.37	3.969	100.81
.219	5.56	1.000	25.40	2.219	56.36	4.500	114.30
.250	6.35	1.094	27.79	2.344	59.54	6.000	152.40
.312	7.92						

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
* 3. Tolerance is ±0.01 (0.25 mm) for two-place decimals and ±0.005 (0.13 mm) for three-place decimals.
4. Line and load terminals shall accept and be suitable for no. 14 thru no. 1/0 copper (CU) or aluminum (AL) wire.

FIGURE. Dimensions and configuration - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

* Interface and physical dimensions: See figure 1.

Trip indication: See figure 1.

Common trip - All poles shall make and break simultaneously when operated manually or automatically.

Electrical:

Interrupting current rating: RMS symmetrical.

18,000 amperes at 240 V ac.
14,000 amperes at 277 V ac.
14,000 amperes at 480 V ac.

Voltage rating: 480 V ac maximum.

Trip current - See table I.

Frequency: 60 hertz.

Calibration: At +40°C.

* Enclosure for overload, endurance, and short circuit tests: Cutler-Hammer SFDN100, or equivalent.

Supersession and cross reference: See table II.

TABLE I. Part or Identifying Numbers (PINs) and current rating.

Government PIN	Current rating
WC375/16-001 1/	10
WC375/16-002	15
WC375/16-003	20
WC375/16-004	25
WC375/16-005	30
WC375/16-006	35
WC375/16-007	40
WC375/16-008	50
WC375/16-009	60
WC375/16-010	70
WC375/16-011	90
WC375/16-012	100

1/ Not for new design.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

TABLE II. Supersession and cross reference.

Government part number	Superseded number CAGE 79500			
WC375/16-001	EHB1010L	EHB1010	EHD1010L	EHD1010
WC375/16-002	EHB1015L	EHB1015	EHD1015L	EHD1015
WC375/16-003	EHB1020L	EHB1020	EHD1020L	EHD1020
WC375/16-004	EHB1025L	EHB1025	EHD1025L	EHD1025
WC375/16-005	EHB1030L	EHB1030	EHD1030L	EHD1030
WC375/16-006	EHB1035L	EHB1035	EHD1035L	EHD1035
WC375/16-007	EHB1040L	EHB1040	EHD1040L	EHD1040
WC375/16-008	EHB1050L	EHB1050	EHD1050L	EHD1050
WC375/16-009	EHB1060L	EHB1060	EHD1060L	EHD1060
WC375/16-010	EHB1070L	EHB1070	EHD1070L	EHD1070
WC375/16-011	EHB1090L	EHB1090	EHD1090L	EHD1090
WC375/16-012	EHB1100L	EHB1100	EHD1100L	EHD1100

***** The margins of this specification are marked with asterisks to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

* MILITARY INTERESTS:

Custodians:
Navy - YD
Air Force - 11
DLA - CC

Review Activities:
Navy - MC, OS

CIVIL AGENCY COORDINATING ACTIVITIES:

DC GOVT - DCG
DOI -GES
DOJ - FPI
DOT - ACO
GSA - FSS
HHS - NPPTL
HUD - HSRS
VA - OSS

Preparing activity:
DLA - CC

(Project 5925-0356)

* NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://www.dodssp.daps.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.