
FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, TWO POLE (10 THROUGH 100 AMPERES)

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

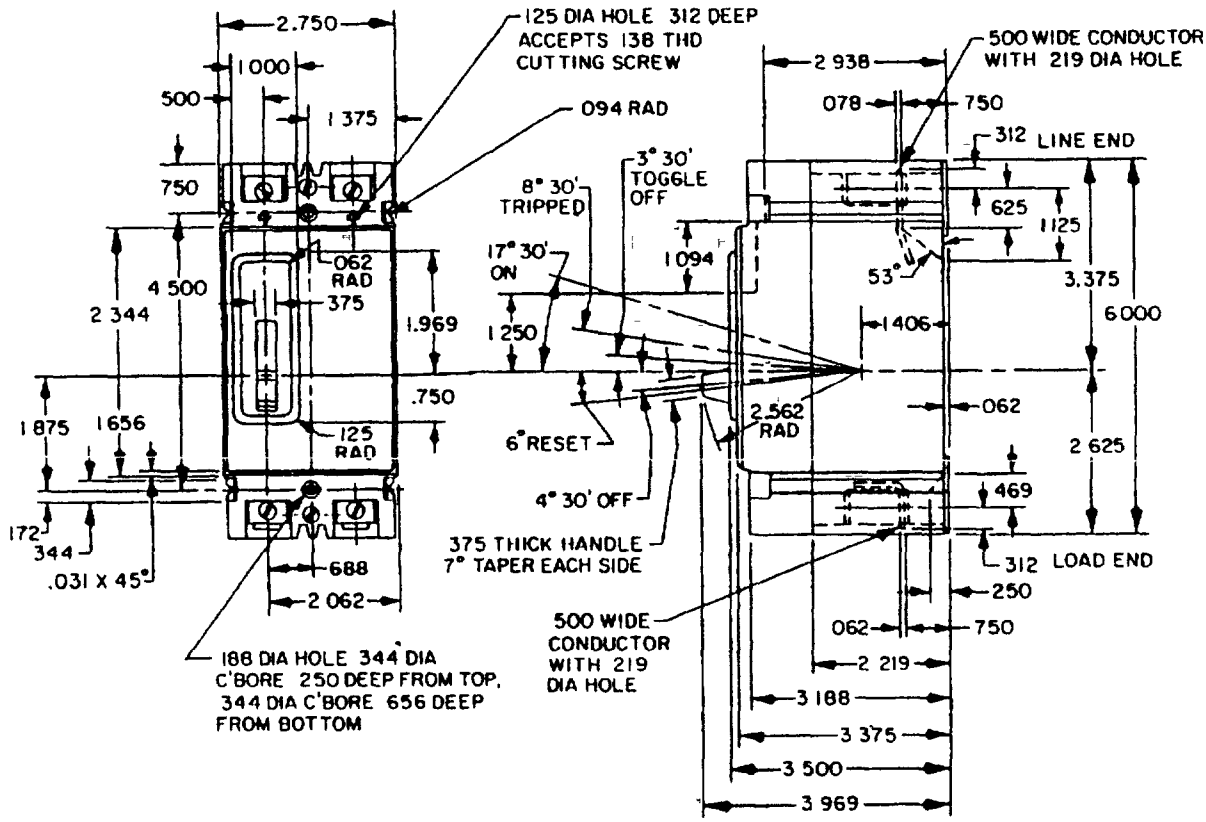

Inches	mm	Inches	mm	Inches	mm	Inches	mm
.031	0.79	.344	8.74	1.125	28.58	2.562	65.07
.062	1.57	.375	9.53	1.250	31.75	2.625	66.68
.078	1.98	.469	11.91	1.375	34.93	2.750	69.85
.094	2.39	.500	12.70	1.406	35.71	2.938	74.63
.125	3.18	.625	15.88	1.656	42.06	3.188	80.98
.138	3.51	.656	16.66	1.875	47.63	3.375	85.73
.172	4.37	.688	17.48	1.969	50.01	3.500	88.90
.188	4.78	.750	19.05	2.062	52.37	3.969	100.81
.219	5.56	1.000	25.40	2.219	56.36	4.500	114.30
.250	6.35	1.094	27.79	2.344	59.54	6.000	152.40
.312	7.92						

NOTES
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Tolerance is ±.010 (0.25 mm)
4. Line and load terminals shall accept and be suitable for no. 14 thru no.1/0 copper (CU) or aluminum (AL) wire.

FIGURE 1 Dimensions and configuration.

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction: See figure 1

Trip indication: See figure 1.

Common trip All poles shall make and break simultaneously when operated manually or automatically

Electrical:

Interrupting current rating. RMS symmetrical.

18,000 amperes at 240 V ac.
14,000 amperes at 277 V ac.
14,000 amperes at 480 V ac.

Voltage rating: 480 V ac maximum.

Trip current: See table I.

Frequency: 60 hertz

Calibration: At 40°C

Enclosure for overload, endurance, and short circuit tests Westinghouse catalog no. SFB, or equivalent

TABLE I. Part numbers and current rating

Government part number		Current rating
WC375/17-001	1/	10
-002		15
-003		20
-004		25
-005		30
-006		35
-007		40
-008		50
-009		60
-010		70
-011		90
-012		100

1/ Not for new design.

TABLE II Supersession and cross reference.

Government part number	Superseded number CAGE 79500			
WC375/17-001	EHB2010L	EHB2010	EHD2010L	EHD2010
-002	2015L	2015	2015L	2015
-003	2020L	2020	2020L	2020
-004	2025L	2025	2025L	2025
-005	2030L	2030	2030L	2030
-006	2035L	2035	2035L	2035
-007	2040L	2040	2040L	2040
-008	2050L	2050	2050L	2050
-009	2060L	2060	2060L	2060
-010	2070L	2070	2070L	2070
-011	2090L	2090	2090L	2090
-012	2100L	2100	2100L	2100

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

NOTE: Revision letters are not used to denote changes due to the extensiveness of the changes.

Military custodians.

Navy - YD
Air Force - 85

Review activities:

Air Force - 80
DLA - ES

User activity:

Navy - OS, MC

Civil agency coordinating activities

DC GOVT - DCG
GSA - FSS, PBO, PCD
DOT - ACO
HHS - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - OSS

Preparing activity:

DLA - ES

(Project 5925-0198-2)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.