W-C-375/18A
April 11, 1988
SUPERSEDING
W-C-375/18
22 July 1975


FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, THREE POLE (10 THROUGH 100 AMPERES)

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

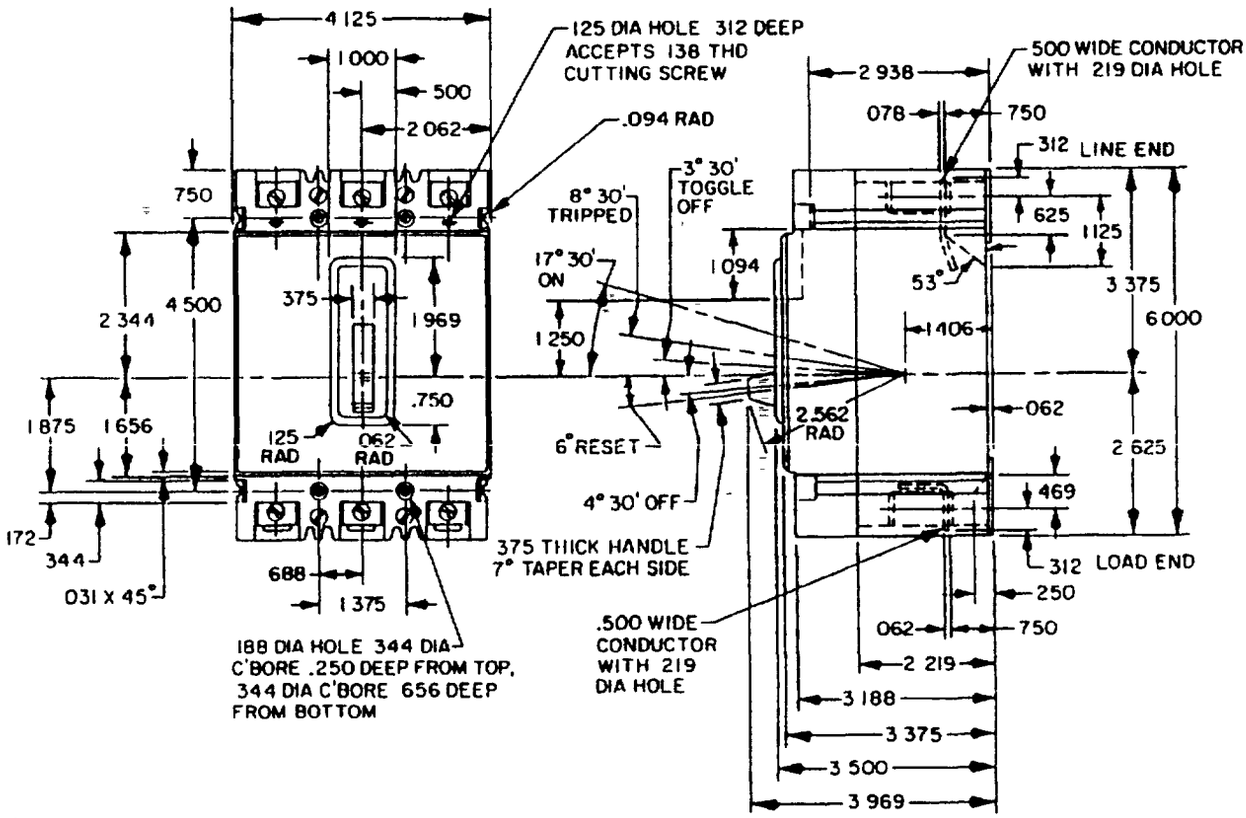

Inches	mm	Inches	mm	Inches	mm	Inches	mm
.031	0.79	.344	8.74	1.125	28.58	2.562	65.07
.062	1.57	.375	9.53	1.250	31.75	2.625	66.68
.078	1.98	.469	11.91	1.375	34.93	2.938	74.63
.094	2.39	.500	12.70	1.406	35.71	3.188	80.98
.125	3.18	.625	15.88	1.656	42.06	3.375	85.73
.138	3.51	.656	16.66	1.875	47.63	3.500	88.90
.172	4.37	.688	17.48	1.969	50.01	3.969	100.81
.188	4.78	.750	19.05	2.062	52.37	4.125	104.78
.219	5.56	1.000	25.40	2.219	56.36	4.500	114.30
.250	6.35	1.094	27.79	2.344	59.54	6.000	152.40
.312	7.92						

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Tolerance is ±.010 (0.25 mm)
4. Line and load terminals shall accept and be suitable for no. 14 thru no.1/0 copper (CU) or aluminum (AL) wire.

FIGURE 1 Dimensions and configuration

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction: See figure 1

Trip indication See figure 1.

Common trip: All poles shall make and break simultaneously when operated manually or automatically.

Electrical:

Interrupting current rating. RMS symmetrical

18,000 amperes at 240 V ac.
14,000 amperes at 277 V ac.
14,000 amperes at 480 V ac.

Voltage rating 480 V ac maximum.

Trip current: See table I.

Frequency 60 hertz

Calibration: At 40°C.

Enclosure for overload, endurance, and short circuit tests: Westinghouse catalog no. SFB, or equivalent.

TABLE I. Part numbers and current rating.

Government part number	Current rating
WC375/18-001 1/	10
-002	15
-003	20
-004	25
-005	30
-006	35
-007	40
-008	50
-009	60
-010	70
-011	90
-012	100

1/ Not for new design.

TABLE II Supersession and cross reference.

Government part number	Superseded number CAGE 79500			
WC375/18-001	EHB3010L	EHB3010	EHD3010L	EHD3010
-002	3015L	3015	3015L	3015
-003	3020L	3020	3020L	3020
-004	3025L	3025	3025L	3025
-005	3030L	3030	3030L	3030
-006	3035L	3035	3035L	3035
-007	3040L	3040	3040L	3040
-008	3050L	3050	3050L	3050
-009	3060L	3060	3060L	3060
-010	3070L	3070	3070L	3070
-011	3090L	3090	3090L	3090
-012	3100L	3100	3100L	3100

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

NOTE: Revision letters are not used to denote changes due to the extensiveness of the changes.

Military custodians:

Navy - YD
Air Force - 85

Review activities

Air Force - 80
DLA - ES

User activity.

Navy - OS, MC

Civil agency coordinating activities·

DC GOVT - DCG
GSA - FSS, PBO, PCD
DOT - ACO
HHS - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - OSS

Preparing activity.

DLA - ES

(Project 5925-0198-3)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.