FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

# CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE III, SERIES TRIP, TWO POLE (10 THRU 100 AMPERES)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for acquiring the circuit breakers described herein shall consist of this specification sheet and the latest issue of W-C-375.

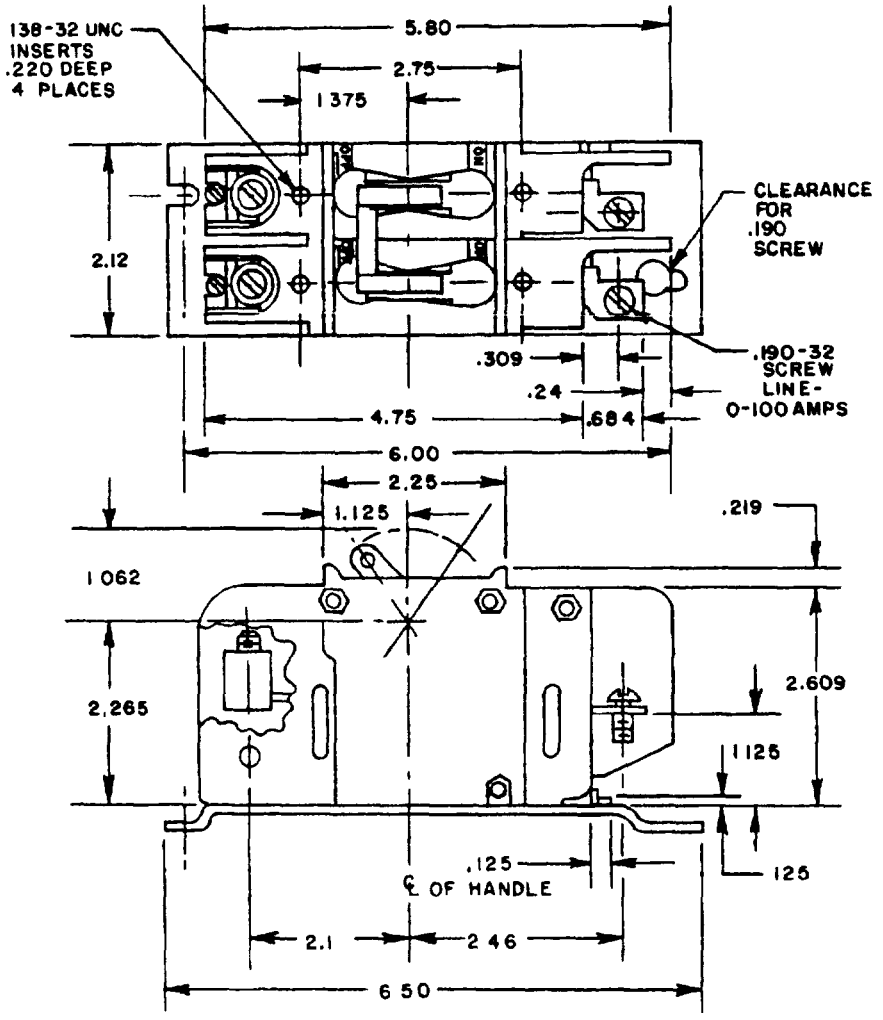



FIGURE 1 Dimensions and configuration of two pole circuit breaker

FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

| INCHES | MM |
|---|---|
| .125 | 3.18 |
| .138 | 3.51 |
| .190 | 4.83 |
| .219 | 5.56 |
| .24 | 6.10 |
| .309 | 7.64 |
| .684 | 17.37 |
| 1.062 | 26.97 |
| 1.125 | 28.58 |
| 2.1 | 53.34 |
| 2.12 | 53.85 |
| 2.25 | 57.15 |
| 2.265 | 57.53 |
| 2.46 | 62.48 |
| 2.609 | 66.27 |
| 4.75 | 120.65 |
| 5.80 | 147.32 |
| 6.00 | 152.40 |
| 6.50 | 165.10 |

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only and are based upon 1 inch = 25.4 mm.
3. Tolerance is ±.010 (.25 mm).
4. OFF position is also the tripped position.

FIGURE 1. Dimensions and configuration of two pole circuit breaker - continued.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS.

Design and construction - See figure 1.

Trip indication - See figure 1.

Electrical

Interrupting current rating - 5,000 amperes.

Voltage rating - 120/240 Vac.

Current rating - See table I.

Frequency - 60 hertz.

Calibration - At 25°C.

Enclosure for overload, endurance, and short circuit tests - Heineman Catalog No. CFOR-W000-U, or equivalent.

TABLE I. Part numbers and current rating.

| Government part number | Current rating |
|---|---|
| WC375/20-001 | 10 |
| -002 | 15 |
| -003 | 20 |
| -004 | 25 |
| -005 | 30 |
| -006 | 35 |
| -007 | 40 |
| -008 | 50 |
| -009 | 60 |
| -010 | 70 |
| -011 | 100 |

TABLE II. Supersession and cross reference.

| Government part number | Superseded number FSCM 74193 |
|---|---|
| WC375/20-001 | 2X0411-10-120/240-60-9 |
| -002 | -15 |
| -003 | -20 |
| -004 | -25 |
| -005 | -30 |
| -006 | -35 |
| -007 | -40 |
| -008 | -50 |
| -009 | -60 |
| -010 | -70 |
| -011 | -100 |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

Custodians:
Navy - YD
Air Force - 85

Review activities:
Air Force - 99
DLA - ES

User activities
Navy - OS, MC

Preparing activity:
DLA - ES

Civil agency coordinating activities
DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HHS - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - DMS

(Project 5925-0137-2)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.