FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE II, SERIES TRIP, TWO POLE (15 THROUGH 125 AMPERES)

This specification is approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of W-C-375.


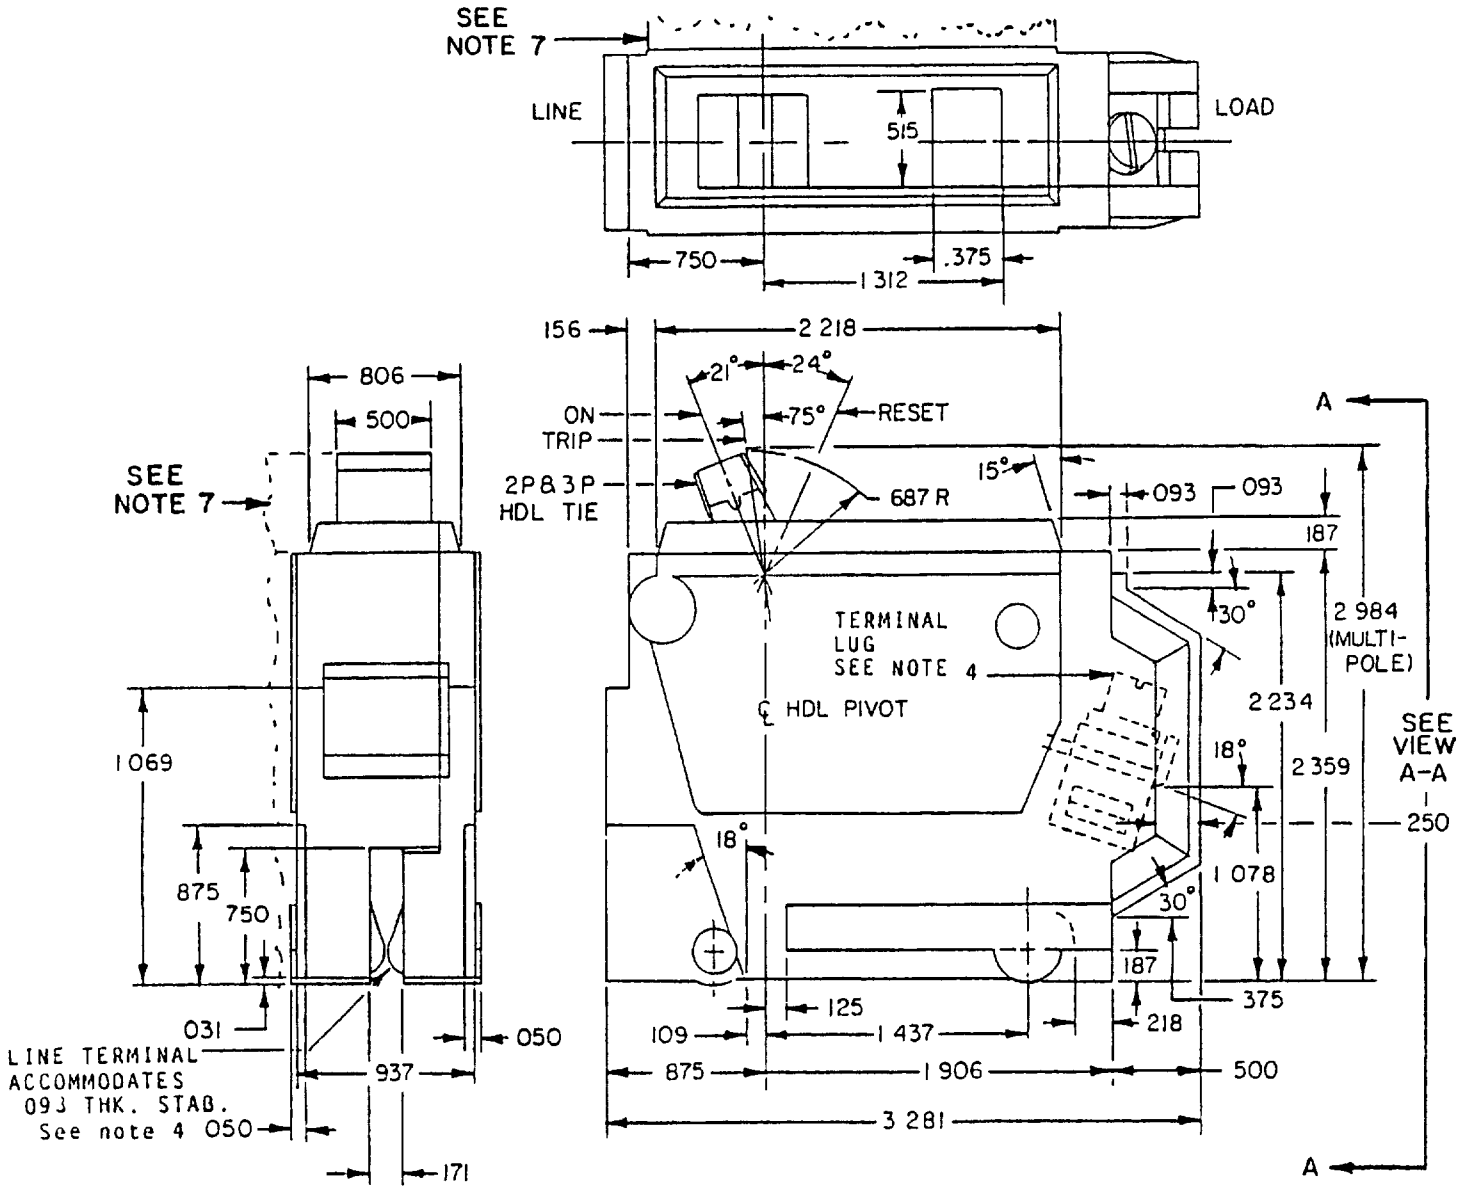


FIGURE 1. Dimensions and configuration of two pole circuit breaker.

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

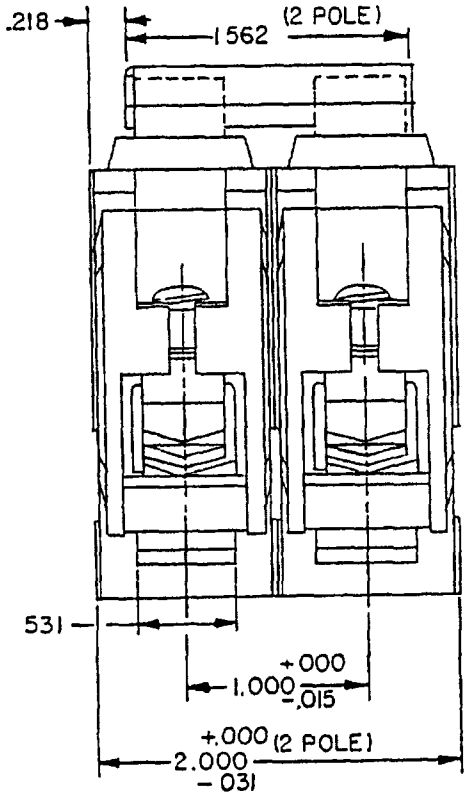

VIEW A-A

Inches	mm
.015	0.38
.031	0.79
.046	1.17
.050	1.27
.078	1.98
.093	2.36
.109	2.77
.125	3.18
.156	3.96
.171	4.34
.187	4.75
.218	5.54
.250	6.35
.375	9.53
.500	12.70
.515	13.08
.531	13.49
.687	17.45
.750	19.05
.806	20.47
.875	22.23
.937	23.80
1.000	25.40
1.069	27.15
1.312	33.32
1.437	36.50
1.562	39.67
1.906	48.41
2.000	50.80
2.218	56.34
2.234	56.74
2.359	59.92
2.968	75.39
2.984	75.79
3.281	83.34

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.02 (0.5 mm) on decimals and ±1° on angles.
4. Load terminal lugs shall be suitable for either aluminum or copper wire size as required by the ampere rating of the breaker.
5. Line terminal lug shall accommodate a .093 thick stab.
6. Recommended for use as main or sub-main breaker only.
7. This circuit breaker consists of more than one breaker of the same type. See view AA for A complete view of one side of breaker unit.

FIGURE 1. Dimensions and configuration of two pole circuit breaker - Continued.

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction. See figure 1.

Trip indication: See figure 1.

Common trip: Both poles shall make and break simultaneously when operated manually or automatically.

Mounting: See figure 1.

Electrical.

Interrupting current rating. RMS symmetrical - 10,000 amperes.

Voltage rating. 120/240 V ac or less.

Current rating See table I.

Frequency: 60 hertz.

Calibration. At 40° ±3°C.

Design to be mounted in GE load centers and panel boards, or equivalent.

TABLE I. Part numbers and current rating.

Government part number	Current rating (amperes)
WC375/22 - 001	15
002	20
003	25
004	30
005	35
006	40
007	45
008	50
009	60
010	70
011	80
012	90
013	100
014	110
015	125 1/

1/ See note 6 of figure 1.

Military Interests:

Custodians

Navy - YD
Air Force - 85
Army - ER

Review activities.

Air Force - 99
DLA - ES
NASA - NA
Army - MI

User activities:

Navy - MC, OS, YD

Civil Agency Coordinating Activities

DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HHS - FEC
HUD-HEP
Interior - BPA
Justice - FPI
Postal - POS
VA - OSS

Preparing activity:

DLA - ES

Project No. 5925-0196-02

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.