W-C-375/3B
February 21, 1996
SUPERSEDING
W-C-375/3A
September 4, 1990

FEDERAL SPECIFICATION SHEET

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, THREE POLE (10 THROUGH 100 AMPERES)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the circuit breakers described herein shall consist of this document and the latest issue of Federal Specification W-C-375.

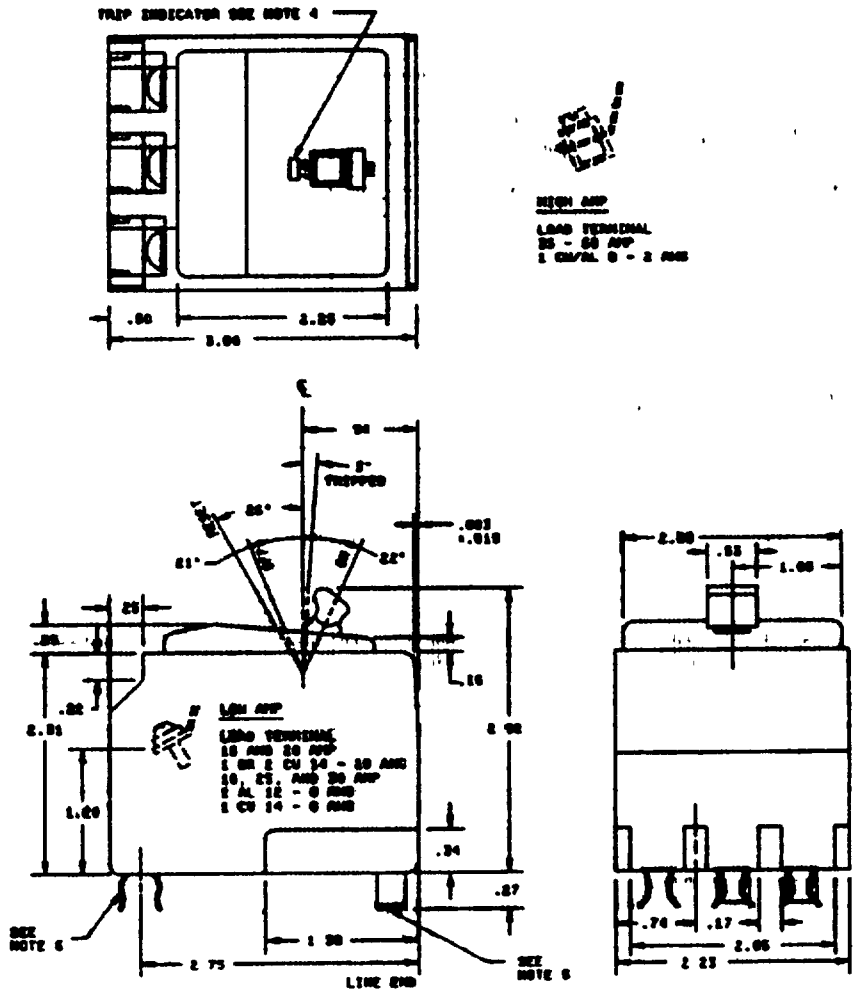



Figure 1. Outline drawing (10 through 60 amperes).

AMSC N/A

FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

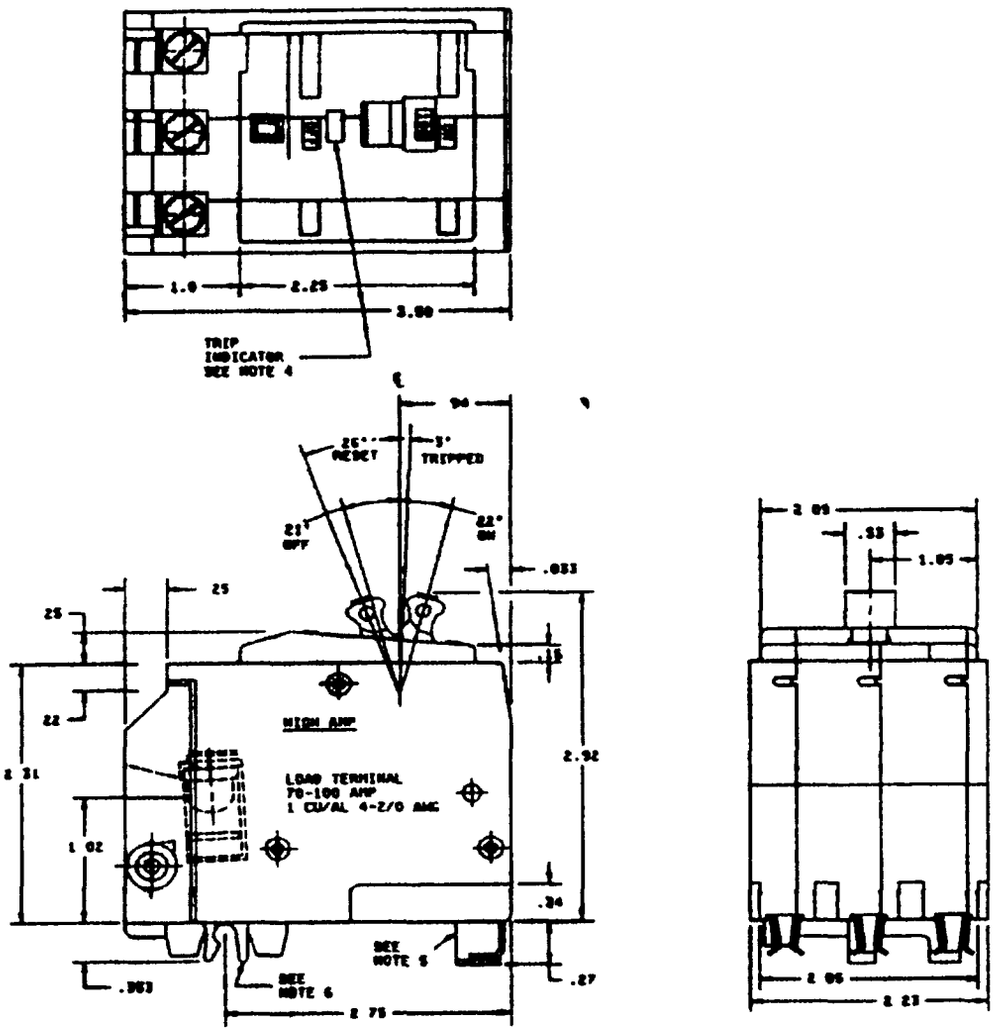

Inches	mm	Inches	mm	Inches	mm	Inches	mm
.015	0.38	.27	6.86	1.00	25.40	2.23	56.64
.033	0.84	.34	8.64	1.02	25.91	2.25	57.15
.16	4.06	.353	8.97	1.05	26.67	2.31	58.67
.17	4.32	.50	12.70	1.20	30.48	2.75	69.85
.22	5.59	.53	13.46	1.38	35.05	2.92	74.17
.25	6.35	.74	18.80	2.05	52.07	3.00	76.20
		.94	23.88	2.09	53.09	3.50	88.90

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.01 (0.25 mm) on decimals and ±1° on angles.
4. Red luminescent trip indicator, visible only when breaker is tripped automatically. Window is dark when breaker is in ON or OFF position.
5. Line terminals shall grip a .250 (6.35 mm) wide and .125 (3.18 mm) thick buss bar.
6. Mounting clip shall grip a .250 (6.35 mm) diameter rail.

Figure 1. Outline drawing (80 through 125 amperes) - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction: See figure 1.

Trip indication: See figure 1.

Common trip: All poles shall make and break simultaneously when operated manually or automatically.

Electrical:

Interrupting current rating: RMS symmetrical; 10,000 amperes.

Voltage rating: 120/240 V ac.

Trip current: See table I.

Frequency: 60 hertz.

Calibration: At +25°C, ±3°C.

Enclosure for overload, endurance, and short circuit tests: Square D load center Catalog No. QO403L60NF/S used for 10 through 60 ampere breakers, and the QO3100BNF/S used for 70 through 100 ampere breakers, or equivalent.

Supersession and cross reference: See table I.

TABLE I. Part or Identifying Numbers (PINs) and current rating.

Government PIN	Current rating	Commercial superseded PIN CAGE 56365
WC375/03-001	15	QO-315
WC375/03-002	20	QO-320
WC375/03-003	25	QO-325
WC375/03-004	30	QO-330
WC375/03-005	35	QO-335
WC375/03-006	40	QO-340
WC375/03-007	45	QO-345
WC375/03-008	50	QO-350
WC375/03-009	60	QO-360
WC375/03-010	70	QO-370
WC375/03-011	80	QO-380
WC375/03-012	90	QO-390
WC375/03-013	100	QO-3100
WC375/03-014	10	QO-310

Source: https://assist.dla.mil -- Downloaded: 202640-26T11:26Z
Check the source to verify that this is the current version before use.

W-C-375/38

MILITARY INTERESTS:

Custodians
Navy - YD
Air Force - 85

Review Activities
Air Force - 99

User Activities
Navy - MC, OS

CIVIL AGENCY COORDINATING ACTIVITY:

GSA/FSS - 7FXE

PREPARING ACTIVITY:

DLA - ES

Project 5925-0260-02

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.