INCH-POUND

W-C-375/3C
04 August 2004
SUPERSEDING
W-C-375/3B
February 21, 1994

FEDERAL SPECIFICATION SHEET

# CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, THREE POLE (10 THROUGH 100 AMPERES)

The General Services Administration has authorized the use of this federal specification sheet by all federal agencies.

* The complete requirements for procuring circuit breakers described herein shall consist of this document and the latest issue in effect of W-C-375.


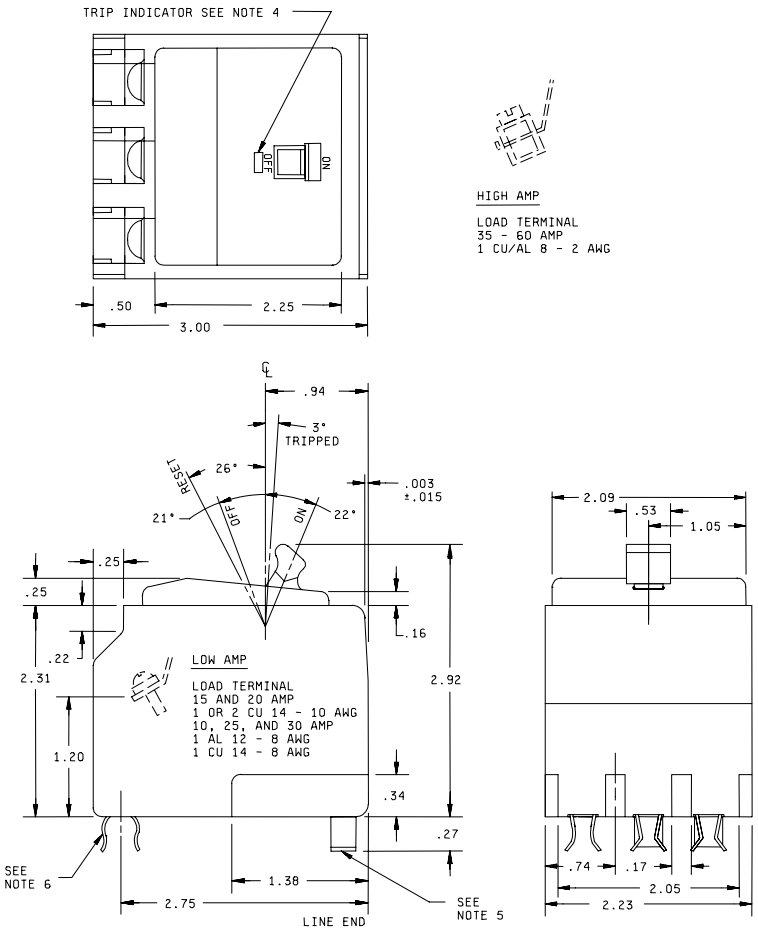



FIGURE 1. Outline drawing (10 through 60 amperes).

* AMSC N/A

FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

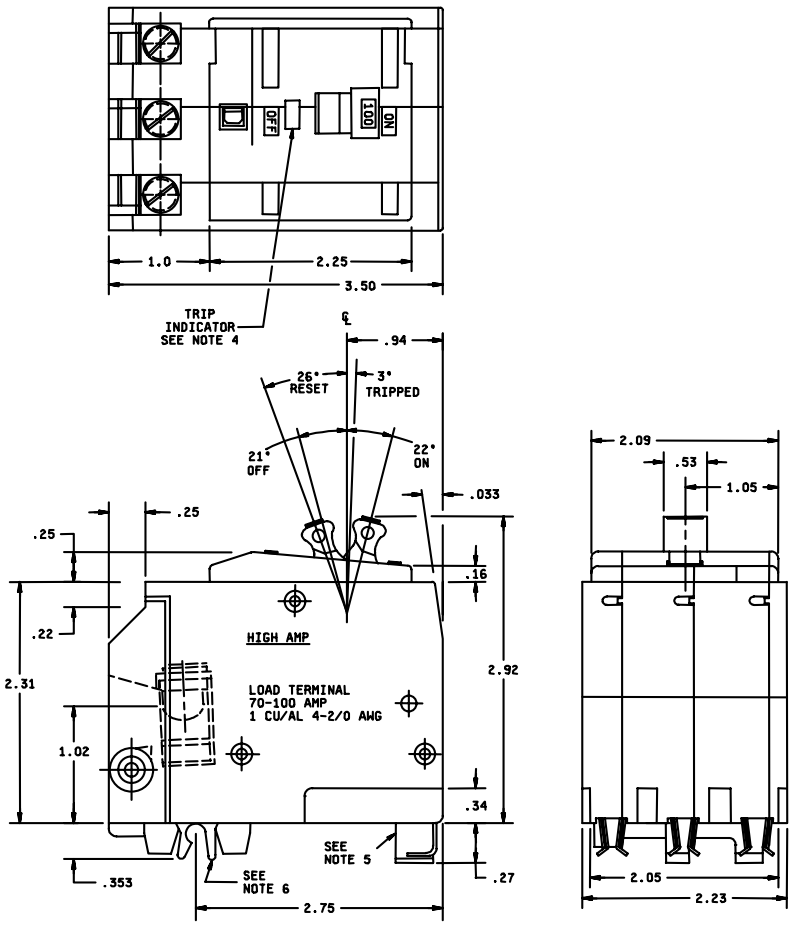


| Inches | mm | Inches | mm | Inches | mm | Inches | mm |
|---|---|---|---|---|---|---|---|
| .005 | 0.38 | .27 | 6.86 | 1.00 | 25.40 | 2.23 | 56.64 |
| .033 | 0.84 | .34 | 8.64 | 1.02 | 25.91 | 2.25 | 57.15 |
| .16 | 4.06 | .353 | 8.97 | 1.05 | 26.67 | 2.31 | 58.67 |
| .17 | 4.32 | .50 | 12.70 | 1.20 | 30.48 | 2.75 | 69.85 |
| .22 | 5.59 | .53 | 13.46 | 1.38 | 35.05 | 2.92 | 74.17 |
| .25 | 6.35 | .74 | 18.80 | 2.05 | 52.07 | 3.00 | 76.20 |
| | | .94 | 23.88 | 2.09 | 53.09 | 3.50 | 88.90 |

NOTES:

1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.01 (0.25 mm) for two-place decimals and ±0.005 * (0.13 mm) for three-place decimals and ±1° on angles.
4. Red luminescent trip indicator - visible only when breaker is tripped automatically. Window is dark when breaker is in ON or OFF position.
5. Line terminals shall grip a .250 (6.35 mm) wide and .125 (3.18 mm) thick buss bar.
6. Mounting clip shall grip a .250 (6.35 mm) diameter rail.

FIGURE 1. Outline drawing (80 through 125 amperes) - Continued.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

* Interface and physical dimensions: See figure 1.

Trip indication: See figure 1.

Common trip: Both poles shall make and break simultaneously when operated manually or automatically.

Electrical:

Interrupting current rating: RMS symmetrical; 10,000 amperes.

Voltage rating: 120/240 V ac.

Trip current: See table I.

Frequency: 60 hertz.

Calibration: At +25°C, ±3°C

* Enclosure for overload, endurance, and short circuit tests: Square D load center Catalog No. QO403L60NF/S used for 10 through 60 ampere breakers, and the QO3100BNF/S used for 70 through 100 ampere breakers, or equivalent.

Supersession and cross reference: See table I.

TABLE I. Part or Identifying Numbers (PINs) and current rating.

| Government PIN | Current rating | Commercial superseded PIN CAGE 56365 |
|---|---|---|
| WC375/03-001 | 15 | QO-315 |
| WC375/03-002 | 20 | QO-320 |
| WC375/03-003 | 25 | QO-325 |
| WC375/03-004 | 30 | QO-330 |
| WC375/03-005 | 35 | QO-335 |
| WC375/03-006 | 40 | QO-340 |
| WC375/03-007 | 45 | QO-345 |
| WC375/03-008 | 50 | QO-350 |
| WC375/03-009 | 60 | QO-360 |
| WC375/03-010 | 70 | QO-370 |
| WC375/03-011 | 80 | QO-380 |
| WC375/03-012 | 90 | QO-390 |
| WC375/03-013 | 100 | QO-3100 |
| WC375/03-014 | 10 | QO-310 |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

* The margins of this specification are marked with asterisks to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

* MILITARY INTERESTS:

Custodians:
Navy - YD
Air Force - 11
DLA - CC

Review Activities:
Navy - MC, OS
Air Force - 99

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - FSS

Preparing activity:
DLA - CC

(Project 5925-0346

* NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://www.dodssp.daps.mil.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.