INCH-POUND


W-C-375/8B
13 December 1991
SUPERSEDING
W-C-375/6A
September 12, 1980

FEDERAL SPECIFICATION SHEET

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, TWO POLE (15 THROUGH 125 AMPERES)

The complete requirements for acquiring the circuit breakers described herein shall consist of this document and the latest issue of Federal Specification W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies

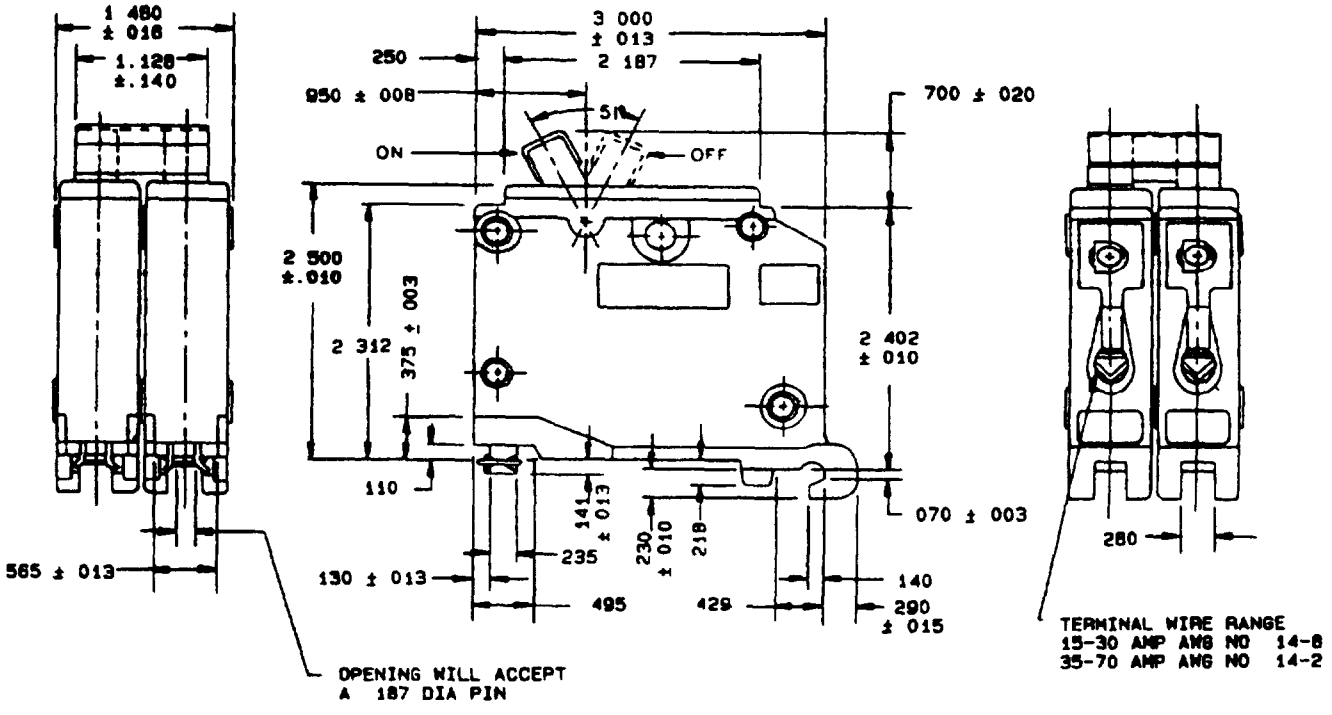


Ⓑ FIGURE 1 Outline drawing for 15-70 amperes

Ⓑ denotes change

AMSC N/A FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 202640-26T11:26Z
Check the source to verify that this is the current version before use.

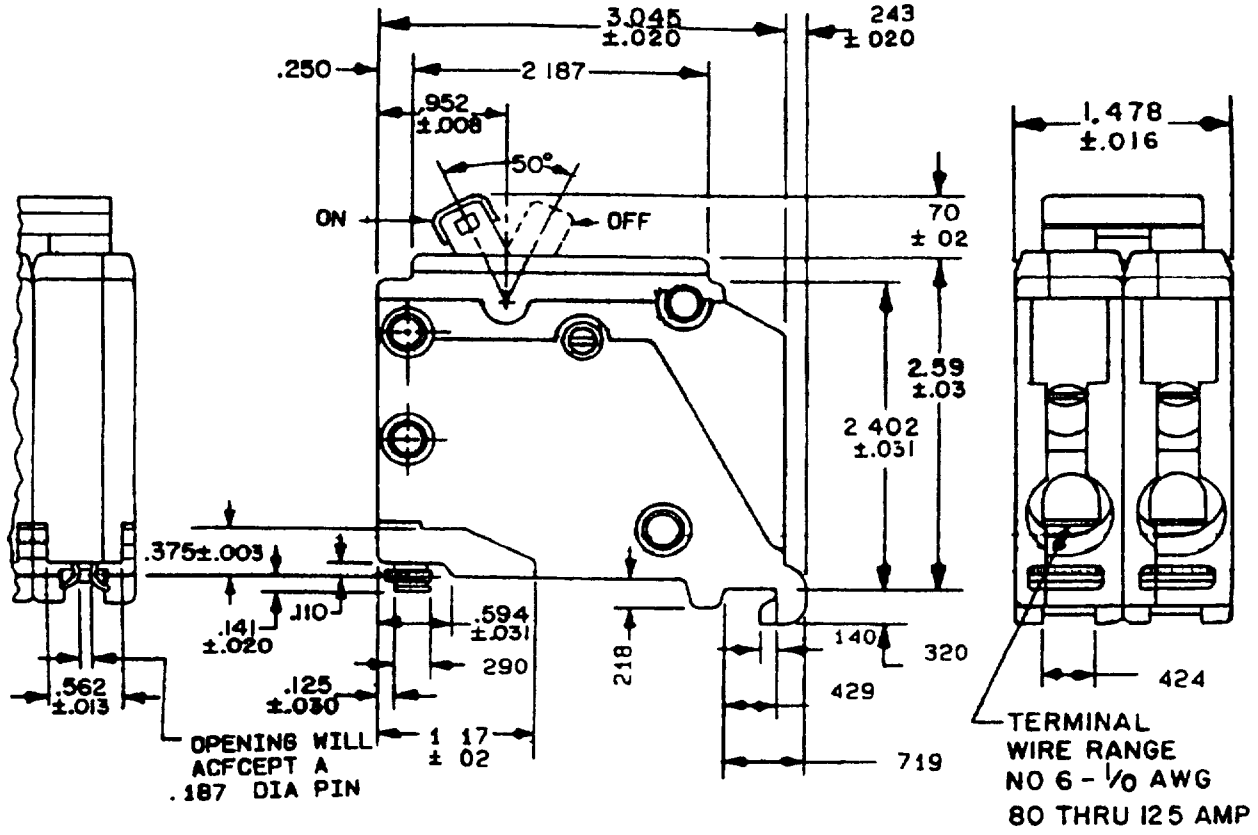

Inches	mm	Inches	mm	Inches	mm
003	.08	.141	3.58	.594	15.09
.008	.20	.187	4 75	.70	17.8
.010	.25	.218	5.54	.700	17.78
.013	.33	230	5.84	.719	18.26
015	.38	235	5.97	.950	24.13
.016	41	.243	6 17	.952	24.18
.02	.5	.250	6 35	1.17	29.7
.020	.51	.280	7.11	1.128	28.65
.03	.8	.290	7.37	1.478	37.54
030	78	320	8.13	1.480	37.59
.031	.79	.375	9.52	2.187	55.55
070	1.78	.424	10.77	2.312	58.72
.110	2.79	.429	10.90	2.402	61.01
.125	3.18	.495	12 57	2.500	63.50
.130	3.30	.562	14.27	2 58	65.8
.140	3.56	.565	14.35	3.000	76.20
				3.045	77.34

NOTES:
1. Dimensions are in inches
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.005 (0.13 mm) on decimals and ±1° on angles.
4. Load terminals shall be suitable for copper (CU) and aluminum (AL) wire.

(B) FIGURE 2 Outline drawing for 80 through 125 amperes

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction: See figures 1 and 2.

Trip indication: See figures 1 and 2.

Common trip: All poles shall make and break simultaneously when operated manually or automatically.

Electrical:

Interrupting current rating: 10,000 amperes.

Voltage rating: 120/240 V ac.

Current rating: See table I.

Frequency: 60 Hertz.

Calibration: At +40°C, ±3°C.

(B) Enclosure for overload, endurance, and short circuit tests: Cutler Hammer catalog number CH2AF/S (15-70 amperes) and CH2BF/S (80-125 amperes).

Supersession and cross reference: See table II.

(B) TABLE I. Part or Identifying Numbers (PINs) and current rating

Government PIN	Current rating	Figure number
WC375/88-001	15	See figure 1
-002	20	See figure 1
-003	25	See figure 1
-004	30	See figure 1
-005	40	See figure 1
-006	50	See figure 1
-007	60	See figure 1
-008	70	See figure 1
-009	80	See figure 2
-010	90	See figure 2
-011	100	See figure 2
-012	125	See figure 2
-013	35	See figure 1
-014	45	See figure 1

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

(B) TABLE II. Supersession and cross reference

Government 1/ PIN	Commercial superseded PIN CAGE 27191
WC375/08-001	CH215
-002	220
-003	225
-004	230
-005	240
-006	250
-007	260
-008	270
-009	280
-010	290
-011	2100
-012	2125
-013	235
-014	245

1/ Replaces CH type with sandalwood handles (5,000 AIC) and red handles (10,000 AIC).

(B) CONCLUDING MATERIAL

Custodians

Navy - YD
Air Force - 85

Review Activities

Air Force - 99
DLA - ES

User Activities

Navy - MC, OS, SH

CIVIL AGENCY COORDINATING ACTIVITIES:

GSA/FSS - 7FXE

PREPARING ACTIVITY

DLA - ES

(Project 5925-0219)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.