MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC,
INSULATED HOUSING (SHIPBOARD USE)
TYPE AQB - A50, A50D, A51, AND NQB - A50

PAGE 2

FIGURE 1: Delete and substitute new FIGURE 1:

PAGE 3/4

FIGURE 2: Delete and substitute new FIGURE 2:

PAGE 5/6

FIGURE 3, Title: Delete "AQB-A50" and substitute "AQB-A50, AQB-A50D, AQB-A51, and NQB-A50".

PAGE 7

REQUIREMENTS: Delete and substitute new REQUIREMENTS section:

"REQUIREMENTS

		Applicability		
		A50	A50D	A51
Voltage and frequency:	500Vac 60 Hz	X		X
	500Vac 400 Hz	X		
	250Vdc	X	X	
Interrupting rating:	12,000 amps dc		X	
	5,000 amps 60 Hz	X		X
	2,500 amps 400 Hz	X		
	2,500 amps dc	X		

Dimensions:	See figures 1 and 2
Handle boot:	See figure 3 and table I
Rated continuous current:	50 amperes
Peak let-through current:	Not applicable
Trip unit:	Non-interchangeable
Trip unit rating:	See table II
Instantaneous calibration:	See table II

AMSC N/A FSC 5925
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

Long time delay calibration:	See table III
Current limiting fuse:	Not applicable
Type of connections:	Back (Removable mounting)
Electric operator:	Not available
Undervoltage trip:	Not available
Shunt trip:	Not available
Auxiliary switch:	Not available
Handle lock:	Group I Figure 1 (MIL-C-17361)
Additional identification:	Front cover (ON-OFF, frame size and ampere rating)
Additional requirements:	Circuit breaker shall have two threaded metal inserts molded in the cover for insertion of the supporting screws. Stud terminals or lug terminals connected to the circuit breaker shall not turn such that they will reduce the electrical clearances. Lug terminals shall be supplied with mounting bases.
Shock test:	Mounting shall be in a vertical position in accordance with fixture 6E of MIL-S-901
Electrical test:	The rate of operation shall be six operations per minute for a total of 6000 close-open operations."

PAGE 8

Table II, Delete and substitute:

"TABLE II. Instantaneous trip calibrations.

Type designation	Trip element rating	Test current amperes	Trip time seconds
AQB-A50 60Hz, 400Hz	10, 15, 20	30X (Element rating)	.01 to .70
	25, 30	600	.01 to 1.30
	35, 40, 50	600	.01 to 3.00
AQB-A50 dc	10, 15, 20	40X (Element rating)	.01 to .40
	25, 30	600	.01 to 1.10
	35, 40, 50	600	.01 to 2.50
AQB-A51 ac	All ratings	20X	.10 to .90
		30X	Less than .30
		40X	Less than .10

* Test each pole individually. Test current shall be preset and maintained within plus or minus 10 percent of specified value until the circuit breaker trips."

Source: https://assist.dla.mil -- Downloaded: 20260-18T10:00Z
Check the source to verify that this is the current version before use.

Table III: Delete and substitute:

"TABLE III. Long time delay trip calibrataions.

AQB-A50, AQB-A50D (all elements) Current Percent element rating	Tripping time Minimum	Maximum
115	60 seconds	No limit
138	200 seconds	60 minutes
200	10 seconds	200 seconds
AQB-A51 (all elements) Current Percent element rating	**Tripping time Minimum**	**Maximum**
115	60 seconds	No limit
138	200 seconds	60 minutes
200	10 seconds	200 seconds
400	4 seconds	16 seconds
800	.8 seconds	4 seconds
1500*	.01 seconds	2 seconds

* Test current shall be through all three phases in series. The wide time bandwidth takes into account that the thermal and magnetic features are working in conjunction with each other."

Preparing activity:
Navy - SH
(Project 5925-N123)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

New FIGURE 1.

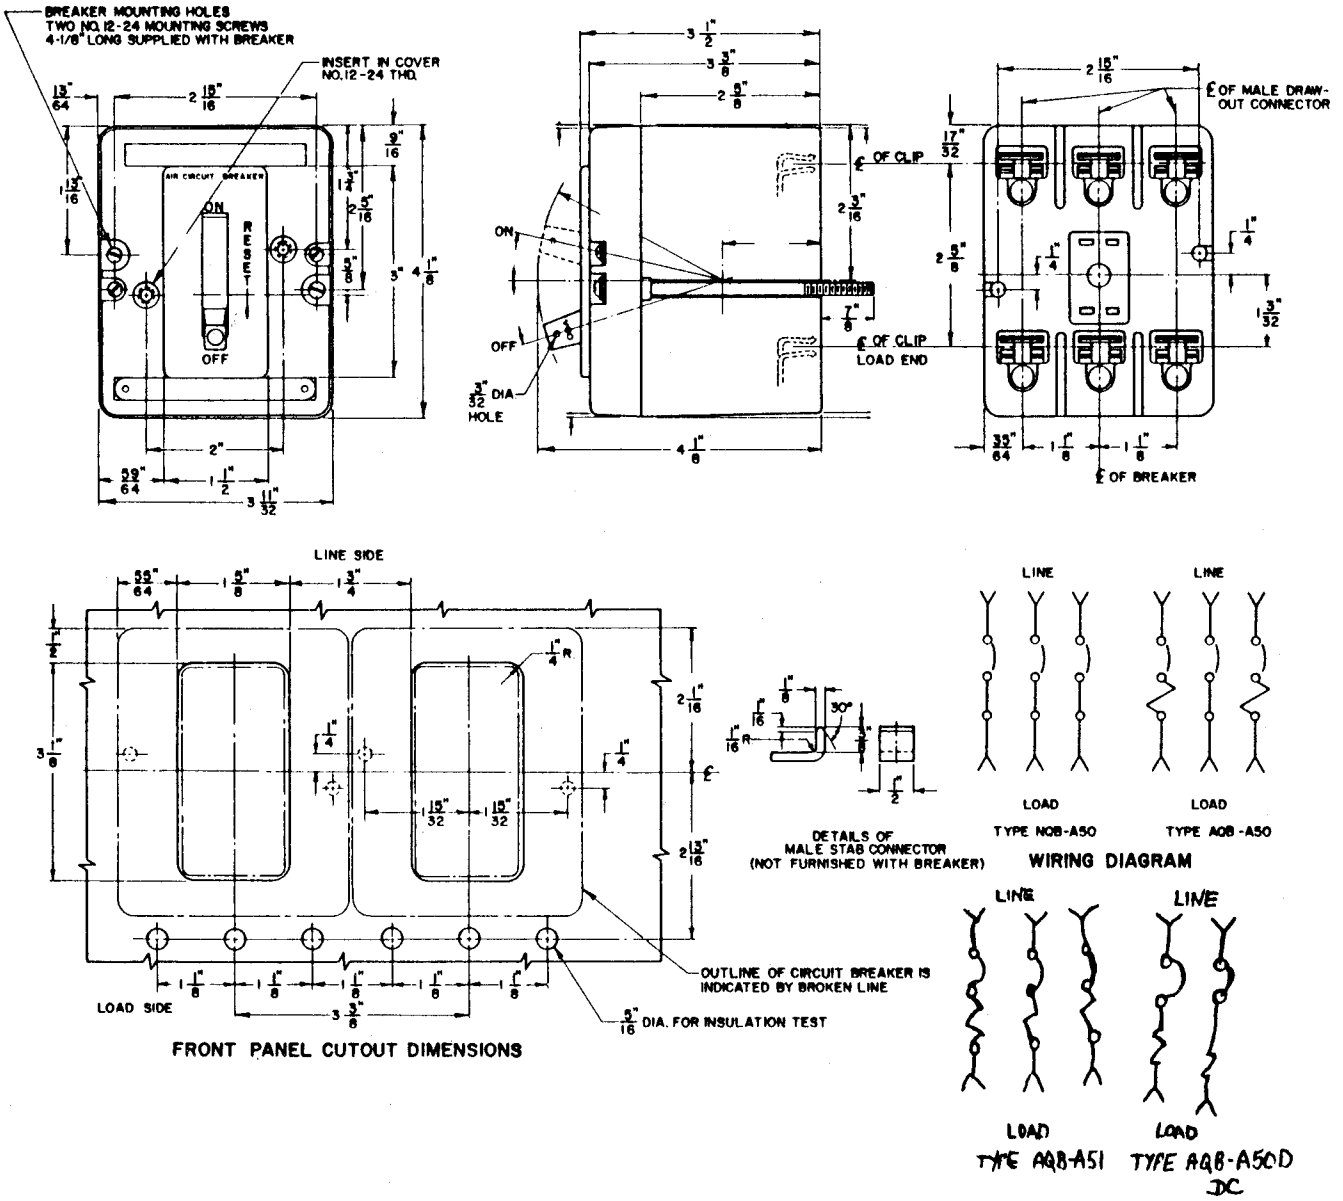


FIGURE 1. Circuit breaker type AQB-A50, A50D, A51 and NQB-A50 outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

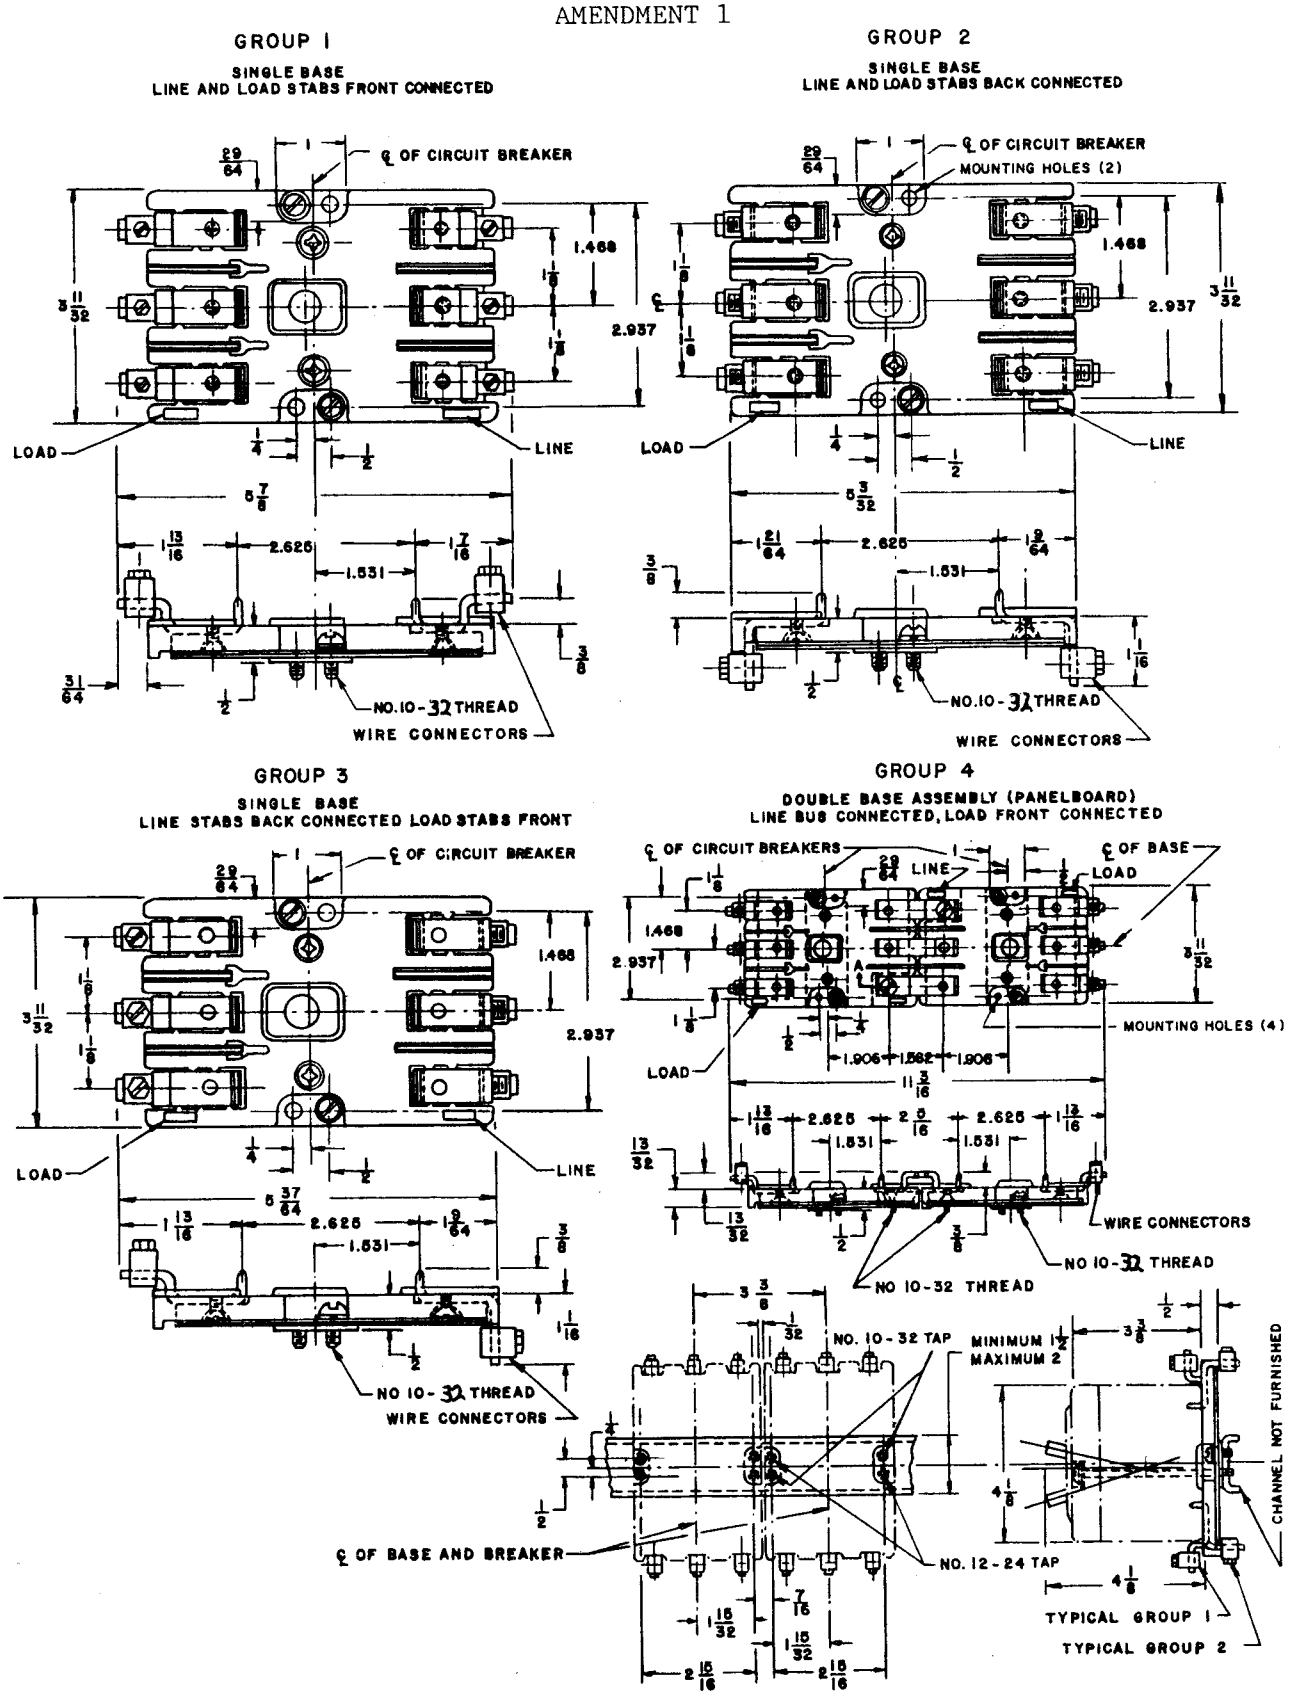


FIGURE 2. Mounting bases for circuit breaker type AQB-A50, AQB-A50D, and AQB-A51outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.