INCH-POUND
MIL-C-17361/2(SH)
10 March 1989

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - A100 AND NQB - A100 (FOR REPLACEMENT ONLY)


This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.


The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.

AMSC N/A FSC 5925
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

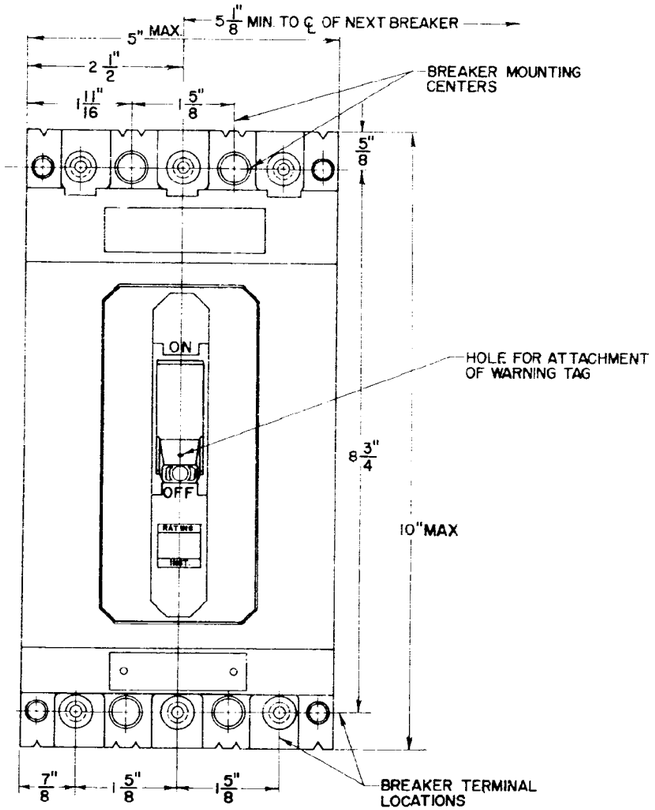

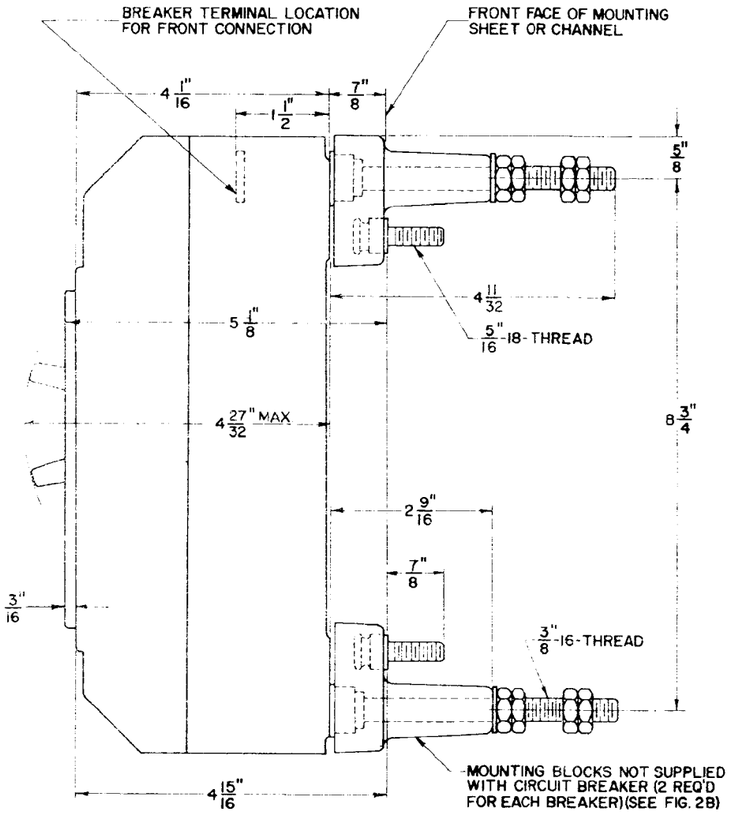



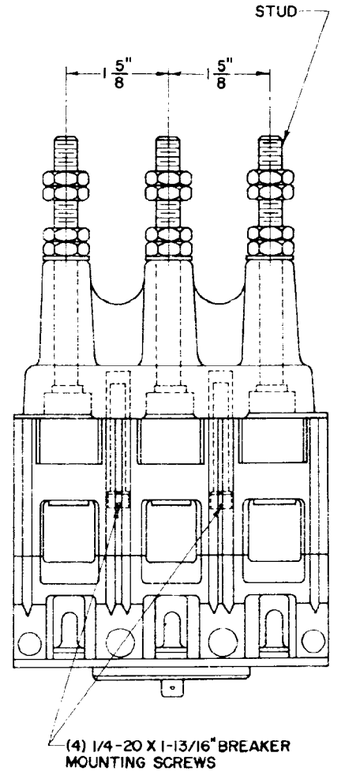


FIGURE 1. Circuit breaker type AQB-A100 and NQB-A100, outline and mounting dimensions.




CIRCUIT BREAKER HANDLE LOCKING DEVICE (NOT SUPPLIED WITH CIRCUIT BREAKER)

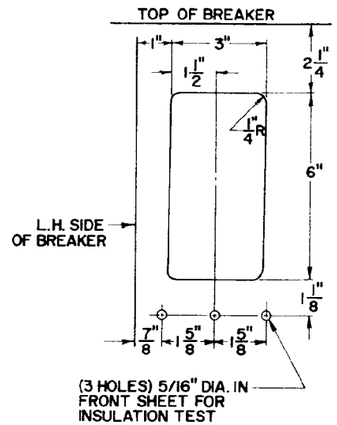


SH 5093

FRONT PANEL CUTOUT DIMENSIONS

2 POLE BRKR SAME AS 3 POLE EXCEPT CENTER POLE OMITTED

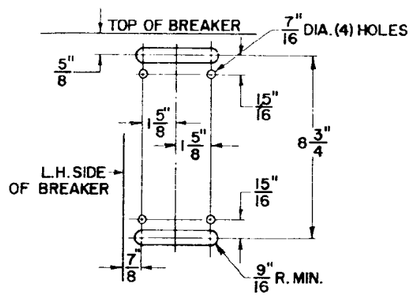


DRILLING FOR MTG. BLOCKS

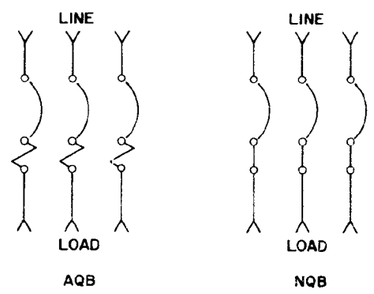


WIRING DIAGRAMS

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

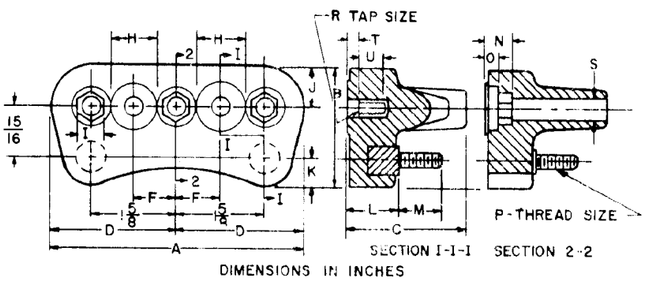

DIMENSIONS IN INCHES


A	B	C	D	F	H	I	J	K	L	M	N	O	P	R	S	T	U
4 21/32	2 9/64	2 9/16	2 21/64	13/16	7/8	.515	45/64	1/2	7/8	7/8	17/32	13/32	5/16-18	1/4-20	25/64	3/16	1/2

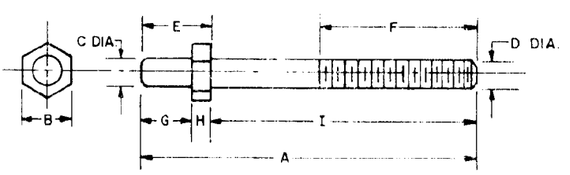

DIMENSIONS IN INCHES

A	B	C	D	E	F (MINIMUM)	G	H	I	THREAD SIZE
4 3/4	1/2	3/8	3/8	15/16	2	11/16	1/4	3 13/16	3/8-16

GROUP 1
DETAILS OF TERMINAL MOUNTING BLOCK & TERMINAL STUD

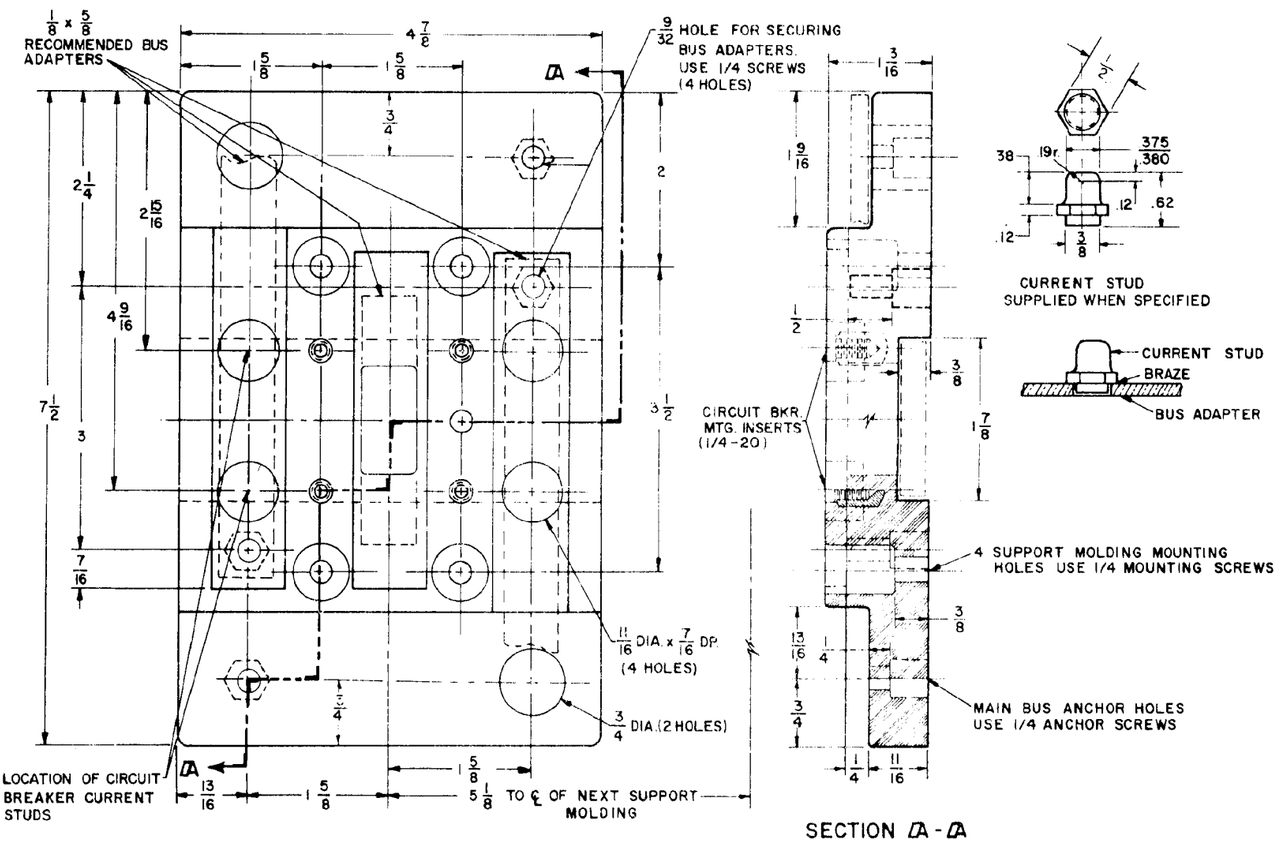

GROUP 2 DETAILS OF MTG. BLOCK FOR LINE END OF TWO AQB-A100 CIRCUIT BREAKERS MOUNTED IN DISTRIBUTION PANEL.

SH 5094

FIGURE 2. Mounting blocks for circuit breaker type AQB-A100 and NQB-A100 outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

REQUIREMENTS :

(NOTE: Type AQB-A100 and NQB-A100 circuit breakers shall be used for replacement only.)

NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Dimensions: See figures 1 and 2.
Rated continuous current: 100 amperes.
Voltage and frequency: 500 Vat, 60 Hz.
500 Vat, 400 Hz.
250 Vdc.
Interrupting rating: 15,000 amperes (60 Hz at).
7,500 amperes (400 Hz at).
10,000 amperes (250 Vdc).
7,400 amperes (355 de).
Peak let-through current:
Trip unit: Interchangeable.
Trip unit rating (amperes): See table I.
Protection: LTD and instantaneous, all 3 poles.
LTD calibration: See table II.
Instantaneous calibration: See table I.
Current limiting fuse: Not applicable.
Type of connections: Front, back (removable mtg.), and combination.
Electric operator: Not available.
Undervoltage trip or shunt trip: Neither available.
Auxiliary switch: Not available.
Handle lock: Group 2. (1 OF MIL-C-17361)
Handle boot: Not available.
Electrical test: The rate of operation shall be 6 operations per minute for a total of 6000 close-open operations.
Temperature rise tests: See table III.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

TABLE I. Instantaneous trip calibrations.

Trip element rating (amps) 1/	Instantaneous trip settings - amperes/maximum time 2/					
	60 Hz ac trip unit		dc trip unit		400 Hz ac trip unit	
	Current (amperes)	Time (seconds)	Current (amperes)	Time (seconds)	Current (amperes)	Time (seconds)
15B	195	0.024	---	---	---	---
15BF	98	.024	---	---	---	---
15BH	---	---	---	---	195	0.028
15BE	---	---	98	0.028	---	---
25B	325	.024	---	---	---	---
25BF	163	.024	---	---	---	---
25BH	---	---	---	---	325	.028
25BE	---	---	163.1	.028	---	---
50B	650	.024	---	---	---	---
50BF	325	.024	---	---	---	---
50BH	---	---	---	---	650	.028
50BE	---	---	325	.028	---	---
75B	975	.024	---	---	---	---
75BF	488	.024	---	---	---	---
75BH	---	---	---	---	975	.025
75BE	---	---	488	.028	---	---
100B	1300	.024	---	---	---	---
100BF	650	.024	---	---	---	---
100BH	---	---	---	---	1300	.028
100BE	---	---	650	.028	---	---
100BG	2000	.024	---	---	---	---

1/ Identification marking of trip units:
Numerals indicate continuous current rating of the specific trip unit.
Letter "B" denotes that the trip units are applicable to circuit breaker type AQB-A100.
Letter "E" denotes calibration for dc applications of type AQB-A100 circuit breaker.
Letter "F" denotes calibration for applications having low inrush currents.
Letter "G" denotes special calibration for use as generator or transformer protection.
Letter "H" denotes calibration for 400 Hz applications.

2/ The tolerance for instantaneous trip shall not exceed plus or minus 10 percent. Time shall be measured at three times pickup current. For qualification testing only, not for routine calibration.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

TABLE II. Tripping characteristics - long time delay.

LTD trip element percent current	Tripping time 60 Hz ac trip element dc trip element	Tripping time 400 Hz ac trip element
135	----	Not less than 1 hour
150	Not less than 1 hour	----
225	Less than 1 hour	Less than 1 hour
600	Between 20 and 32 seconds	Between 35 to 45 seconds

TABLE III. Size of cable and bus bars for temperature rise tests.

Copper rating (amperes)	Cable size		Copper bus size (inch)
	Ac	Dc	Ac and Dc
100	AWG 3	AWG 3	3/4 x 1/8

Preparing activity:
Navy - SH
(Project 5925-N103-02)

☆U.S. GOVERNMENT PRINTING OFFICE: 1989 - 604-033/12317

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:00Z
Check the source to verify that this is the current version before use.