INCH-POUND

MIL-F-43093G(ME)
30 September 1994
SUPERSEDING
MIL-F-43093F(ME)
11 April 1989

MILITARY SPECIFICATION

FUEL SYSTEM SUPPLY POINT: PORTABLE

This specification is approved for use within the USA Belvoir Research, Development, and Engineering Center, Department of the Army, and is available for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers a portable fuel supply system which when combined with three collapsible fabric tanks (in any combination of 3,000, 10,000, or 20,000 gallon capacities); two 350 GPM pumps; and two 350 GPM filter separators, is capable of receiving, dispensing, and storing automotive gasoline, aviation gasoline, jet fuel, or diesel fuel.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications, standards, and handbooks. The following specifications, standards, and handbooks form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these documents are those listed in the issue of the Department of Defense Index of Specifications and Standards (DoDISS) and supplement thereto, cited in the solicitation (see 6.2).

SPECIFICATIONS

FEDERAL

PPP-B-601	-	Boxes, Wood, Cleated-Plywood.
PPP-B-636	-	Boxes, Shipping, Fiberboard.

MILITARY

MIL-V-3	-	Valves, Fittings, and Flanges (Except for Systems Indicated Herein): Packaging of.
MIL-P-116	-	Preservation-Packaging, Methods of.
MIL-T-704	-	Treatment and Painting of Materiel.
MIL-H-775	-	Hose, Hose Assemblies; Rubber, Plastic, Fabric, or Metal (Including Tubing) and Associated Hardware: Packaging of.
MIL-A-8625	-	Anodic Coatings, For Aluminum and Aluminum Alloys.
MIL-C-46168	-	Coating, Alphatic Polyurethane, Chemical Agent Resistant.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: US ARMY BELVOIR RDE CTR, ATTN AMSTA RBE, 10115 GRIDLEY RD STE 228, FT BELVOIR VA 22060-5849 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4930

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

STANDARDS

FEDERAL

FED-STD-595	-	Colors for in Government Procurements.

MILITARY

MIL-STD-105	-	Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129	-	Marking for Shipment and Storage.
MIL-STD-889	-	Dissimilar Metals.
MIL-STD-1186	-	Cushioning, Anchoring, Bracing, Blocking, and Waterproofing; with Appropriate Test Methods.

(Unless otherwise indicated, copies of federal and military specifications, standards, and handbooks are available from: STDZN DCMNT ORDER DESK, BLDG 4D, 700 ROBBINS AVE, PHILADELPHIA PA 19111-5094.)

2.1.2 Other Government documents, drawings, and publications. The following other Government documents, drawings, and publications form a part of this document to the extent specified herein. Unless otherwise specified, the issues are those in effect on the date of the solicitation.

COMPONENT PARTS LIST

MILITARY

CPL 85203	-	Fuel System Supply Point.

(Copies of drawings, publications, and other Government documents required by contractors in connection with specific acquisition functions should be obtained from: US ARMY BELVOIR RDE CTR, ATTN AMSTA RBWH, 10115 GRIDLEY RD STE 228, FT BELVOIR VA 22060-5849.)

2.2 Non-Government publications. The following documents form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DoD adopted are those listed in the issue of the DoDISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DoDISS are the issues of the documents cited in the solicitation (see 6.2).

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

D 1729	-	Visual Evaluation of Color Differences of Opaque Materials.

(Application for copies should be addressed to: AMERCN SCTY FOR TEST & MTRLS, 1916 RACE STRET, PHILADELPHIA PA 19103.)

(Non-Government standards and other publications are normally available from the organizations which prepare or which distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of a conflict between the text of this document and the references cited herein, (except for related associated detail specifications, specification sheets or MS standards), the text of this document takes precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

3.1 Description. The Fuel System Supply Point: Portable (hereafter referred to as fuel supply system) shall consist of hoses, valves, manifolds, nozzles and various other components in quantities specified herein.

3.2 First article. When specified (see 6.2), a sample shall be subjected to first article inspection (see 6.3) in accordance with 4.3.

3.3 Material. Material shall be as specified herein. Materials not specified shall be selected by the contractor and shall be subject to all provisions of this specification.

3.3.1 Material deterioration prevention and control. The fuel supply system shall be fabricated from compatible materials, inherently corrosion resistant or treated to provide protection against the various forms of corrosion and deterioration that may be encountered in any of the applicable operating and storage environments to which the fuel supply system may be exposed.

3.3.1.1 Dissimilar metals. Dissimilar metals shall not be used in intimate contact with each other unless protected against galvanic corrosion. Dissimilar metals and methods of protection are defined and detailed in MIL-STD-889.

3.3.2 Recovered materials. For the purpose of this requirement, recovered materials are those materials which have been collected from solid waste and reprocessed to become a source of raw materials, as distinguished from virgin raw materials. The components, pieces and parts incorporated in the fuel supply system may be newly fabricated from recovered materials to the maximum extent practicable, provided the fuel supply system produced meets all other requirements of this specification. Used, rebuilt or remanufactured components, pieces and parts shall not be incorporated in the fuel supply system.

3.4 Components. The sizes, types, and quantities of components shall be as specified in CPL 85203.

3.5 Special tools and bulk materials. The sizes, types, and quantities of special tools and bulk materials shall be as specified in CPL 85203.

3.6 Associated items. Unless otherwise specified (see 6.2), the associated items specified in CPL 85203 shall not be furnished by the contractor.

3.7 Plastic caps and plugs. Each cam-locking fitting, except those fittings equipped with aluminum dust caps or plugs (see 5.2.1.3) shall be covered with a tight-fitting, fuel-resisting plastic dust cap or plug. The caps for the male fittings shall snap in place and shall not fall off when the fitting is inverted (cap down). The plugs for the female fittings shall be held in place by the cam-locking mechanism. The caps and plugs shall be removable and replaceable without tools and shall provide a positive dust seal when in place.

3.8 Treatment, painting and anodization. The portions of the fuel supply system normally painted internally and externally shall be cleaned, treated, and painted in accordance with MIL-T-704, type F or G, as applicable. Unless otherwise specified (see 6.2) top coat color shall be tan 686 (no. 33446 of FED-STD-595) conforming to MIL-C-46168. The portions of the fuel supply system normally anodized shall be anodized as specified in MIL-A-8625, type II, class I, thickness no less than 0.0004 inch for castings and no less than 0.0007 inch for wrought, and dyed to match color number 33446 of FED-STD-595, unless otherwise specified (see 6.2). Color matching shall be in accordance with ASTM D 1729 for general color match.

3.9 Workmanship. All parts and components of the fuel supply system shall be clean and free from extraneous material. Any necessary rework shall be

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

limited to procedures which will not affect the strength or functioning of parts or components.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements (examinations and tests) as specified herein. Except as otherwise specified in the contract or purchase order and unless disapproved by the Government, the contractor's own or any other facilities suitable for the performance of the inspection requirements specified herein, may be used. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to ensure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of manufacturing operations, is an acceptable practice to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to acceptance of defective material.

4.1.2 Component and material inspection. The contractor is responsible for ensuring that components and materials are manufactured, examined, and tested in accordance with referenced specifications and standards, as applicable.

4.2 Classification of inspection. Inspection requirements specified herein are classified as follows:

a. First article fuel system (see 4.3).
b. Quality conformance inspection (see 4.4).
c. Inspection of packaging (see 4.6).

4.3 First article inspection.

4.3.1 Sampling. From each first article fuel supply system, a random sample of not less than one each component furnished by the contractor shall be selected for examination and test.

4.3.2 Examination. The first article samples selected in accordance with 4.3.1 shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.3.3 Tests. The first article samples selected in accordance with 4.3.1 shall be tested as specified in 4.5.2. Failure of any test shall be cause for rejection.

4.4 Quality conformance inspection.

4.4.1 Sampling. From each fuel supply system offered for delivery, a random sample of not less than one each component furnished by the contractor shall be selected for examination and test.

4.4.2 Examination. Samples selected in accordance with 4.4.1 shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.4.3 Tests. Samples selected in accordance with 4.4.1 shall be tested as specified in 4.5.2. Failure of any test shall be cause for rejection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

4.5 Inspection procedure.

4.5.1 Examination. The fuel supply system shall be examined as specified herein for the following major defects:

101. Material not as specified (see 3.3).
102. Materials not resistant to corrosion and deterioration, or treated to be resistant to corrosion and deterioration of the applicable storage and operating environments (see 3.3.1).
103. Dissimilar metals as defined in MIL-STD-889 are not effectively insulated from each other (see 3.3.1.1).
104. Used, rebuilt or remanufactured components, pieces, or parts incorporated in the fuel system (see 3.3.2).
105. Components missing or not as specified (see 3.4).
106. Special tools and bulk materials missing or not as specified (see 3.5).
107. Associated items not as specified, when applicable (see 3.6).
108. Plastic caps and plugs missing or not as specified (see 3.7).
109. Treatment, painting and anodization not as specified (see 3.8).
110. Workmanship not as specified (see 3.9).

4.5.2 Functional test. The samples shall be assembled together to form a continuous hose and manifold system. Assembly and disassembly of the test samples shall be accomplished by hand without the use of tools. The hose and manifold assembly shall be subjected to a water pressure of 150 pounds per square inch (psi). While under pressure the entire system shall be examined for leaks, imperfections in any hose or fitting, or slippage or pullout of the hose fittings. Each valve and nozzle shall be individually activated at the operating pressure of 50 psi. Inability to assemble the system by hand, evidence of leakage, imperfections in the hose or fittings, slippage or pullout of the hose fittings, or inability to operate any valve or nozzle shall constitute failure of this test.

4.6 Inspection of packaging.

4.6.1 First article pack inspection.

4.6.1.1 Examination. The first article pack of components comprising the fuel system shall be examined for the defects specified in 4.6.2.3. Presence of one or more defects shall be cause for rejection.

4.6.2 Quality conformance inspection of packaging.

4.6.2.1 Unit of product. For the purpose of inspection, a completed pack prepared for shipment shall be considered a unit of product.

4.6.2.2 Sampling. Sampling for examination shall be in accordance with MIL-STD-105.

4.6.2.3 Examination. Samples selected in accordance with 4.6.2.2 shall be examined for the following defects. Presence of one or more defects shall be cause for rejection.

111. Hose and nozzles not preserved in accordance with the referenced document for level A or C (see 5.2.1.1 and 5.2.2.1).
112. Valves and fittings not preserved in accordance with the referenced document for level A or C (see 5.2.1.2 and 5.2.2.2).
113. Fittings and hose assemblies not sealed with caps or plugs as specified for level A or C (see 5.2.1.3 and 5.2.2.3).
114. Gaskets not preserved as specified for level A or C (see 5.2.1.4 and 5.2.2.4).
115. Gaskets not placed together as specified for level A or C (see 5.2.1.4 and 5.2.2.3).
116. Consolidation not as specified for level A or C (see 5.3.1 and 5.3.2).
117. Packing not as specified for level A or C (see 5.3.1 and 5.3.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

118. Marking missing, illegible, incorrect, or incomplete for level A or C (see 5.4).
119. Tools not preserved as specified (see 5.2.1.6).
120. Nuts, screws and washers not preserved as specified (see 5.2.2.3).
121. Associated items not preserved as specified in the level A requirements of the individual component specification or drawing, when applicable (see 5.2.1.7 and 5.2.2.4).

5. PACKAGING

5.1 First article pack. The contractor shall furnish a first article pack for examination within the time frame specified (see 6.2) to prove, prior to starting production packaging that the applied preservation, packing, and marking comply with the packaging requirements of this specification. Examination shall be as specified in section 4 and shall be subject to surveillance and approval by the Government (see 6.4). The first article pack may be accomplished utilizing either the first article fuel system or a production fuel system. If the first article fuel supply system is utilized, any preservation, and packing shall be removed by the contractor at no expense to the Government, when requested by the Government, to facilitate comparison between the first article fuel system and the production fuel system.

5.2 Preservation. Preservation shall be level A or C as specified (see 6.2).

5.2.1 Level A.

5.2.1.1 Hoses and nozzles. Hoses with attached fittings and nozzles shall each be preserved in accordance with the level A requirements of MIL-H-775.

5.2.1.2 Valve and fittings. Valves and fittings shall be preserved in accordance with level A requirements of MIL-V-3.

5.2.1.3 Caps and plugs. The aluminum caps and plugs, specified in CPL 85203 shall be placed at random on the fittings and hose assemblies until exhausted. The remainder of the fittings or hose assemblies shall be sealed with plastic cups or plugs as specified in 3.7.

5.2.1.4 Gaskets. Gaskets shall be individually preserved, in a flat position, in accordance with MIL-P-116, method IC-1 or IC-3. The gaskets shall then be placed in a close-fitting box conforming to PPP-B-636, W6c.

5.2.1.5 Nuts, screws, and washers. Loose nuts, screws, and washers of like size shall be preserved together in accordance with MIL-P-116, method IC-1 or IC-3 and then all placed together in a close-fitting box conforming to PPP-B-636, W6c, style optional.

5.2.1.6 Tools. The preservative application criteria and applicable method(s) of preservation contained in MIL-P-116 shall be used to preserve the tools.

5.2.1.7 Associated items. When applicable, the associated items shall be preserved in accordance with the level A preservation requirements of the individual component specification or drawing.

5.2.2 Level C.

5.2.2.1 Hoses and nozzles. Hoses with attached fittings and nozzles shall be preserved in accordance with the level C requirements of MIL-H-775.

5.2.2.2 Valves and fittings. The valves and fittings shall be preserved in accordance with the level C requirements of MIL-V-3.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

5.2.2.3 Caps, plugs, gaskets, tools, nuts, screws and washers. The caps, plugs, gaskets, tools, nuts, screws and washers shall be preserved as specified for level A, except the boxes shall be domestic class as applicable.

5.2.2.4 Associated items. When applicable, the associated items shall be preserved in accordance with the level C preservation requirements of the individual component specification or drawing.

5.3 Packing. Packing shall be level A or C as specified (see 6.2).

5.3.1 Level A. Preserved and unpreserved components and special tools and bulk materials shall be consolidated together in modified boxes conforming to PPP-B-601, overseas type, style optional as shown in figures 1 and 2. When practical, the boxes shall contain only components of like description. The contents of the boxes shall not exceed the weight and size limitations of the boxes. The components shall be blocked, braced, anchored, or cushioned within the boxes to prevent movement or damage to the contents in accordance with MIL-STD-1186. Box closures and strapping shall be in accordance with the appendix to the applicable box specification. Strapping shall be zinc coated.

5.3.1.1 Associated items. When applicable, the associated items shall be packed as specified in 5.3.1. The storage tanks, pumps, and filter separators shall be packed in accordance with the level A packing requirements of the individual component specification. The storage tanks, pumps, and filter-separators shall be shipped separately from, but at the same time as, the crates containing the other components of the fuel system.

5.3.2 Level C. The components and special tools and bulk materials of the fuel system preserved as specified in 5.2, shall be packed in wooden crates that will prevent damage to the contents during shipment. The crates shall be designed to allow the contents to be secured to the base to provide minimum cube. The appropriate blocking, bracing and anchoring material shall be used to further prevent damage and movement.

5.3.2.1 Associated items. When applicable, the associated items shall be packed as specified in 5.3.2. The storage tanks shall be packed in accordance with the level C requirements of the individual component specification. The pumps and filter-separators shall be packed as specified for level A except, the boxes shall be domestic type. The storage tanks, pumps and filter-separators shall be shipped separately from, but at the same time as, the container with the other components of the fuel system.

5.4 Marking. In addition to any special marking specified in the contract or purchase order (see 6.2), marking for level A and C shall be in accordance with MIL-STD-129.

6. NOTES
(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The fuel supply system is intended to refuel convoys, fill 5- and 55-gallon containers, and perform the following functions:

a. Receive fuel from tank trucks to fill the storage tanks.
b. Pump fuel from the storage tanks to the dispensing points.
c. Bypass the storage tanks and pump directly from the tank trucks to the dispensing points.

6.2 Acquisition requirements. Acquisition documents shall specify the following:

a. Title, number, and date of the specification.
b. Issue of DoDISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

c. Time frame required for submission of the first article fuel systems (see 3.2).
d. When the Government will conduct any or all of the first article examination and tests. When Government will conduct some but not all of the first article examination and tests, the contracting officer should specify which examination and tests will be conducted by the Government and which examination and tests shall be conducted the contractor (see 3.2).
e. When some or all of the associated items will be furnished by the contractor (see 3.6).
f. Color required when other than as specified (see 3.8).
g. When FSSP is anodized other than as specified (see 3.8).
h. Time frame required for submission of first article pack (see 5.1).
i. Level of preservation and packing required (see 5.2 and 5.3).
j. Any special marking required (see 5.4).

6.3 First article. When a first article inspection is required, the item(s) should be a preproduction model. The first article should consist of one or more units. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examinations, approval of the first article test results and disposition of the first articles. Invitation for bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.4 First article pack. Any changes or deviations of production packs from the approved first article pack will be subject to the approval of the contracting officer. Approval of the first article pack will not relieve the contractor of his obligation to preserve, pack, and mark the fuel systems in accordance with this specification.

6.5 Subject term (key word) listing.

Filter-separators
Hoses
Manifolds
Nozzles
Pumps
Tanks, fabric
Valves

6.6 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the may be helpful, but is not mandatory.)


6.1 Intended use. The fuel supply system is intended to refuel convoys, fill 5- and 55-gallon containers, and perform the following functions:

a. Receive fuel from tank trucks to fill the storage tanks.
b. Pump fuel from the storage tanks to the dispensing points.
c. Bypass the storage tanks and pump directly from the tank trucks to the dispensing points.

6.2 Acquisition requirements. Acquisition documents shall specify the following:

a. Title, number, and date of the specification.
b. Issue of DoDISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

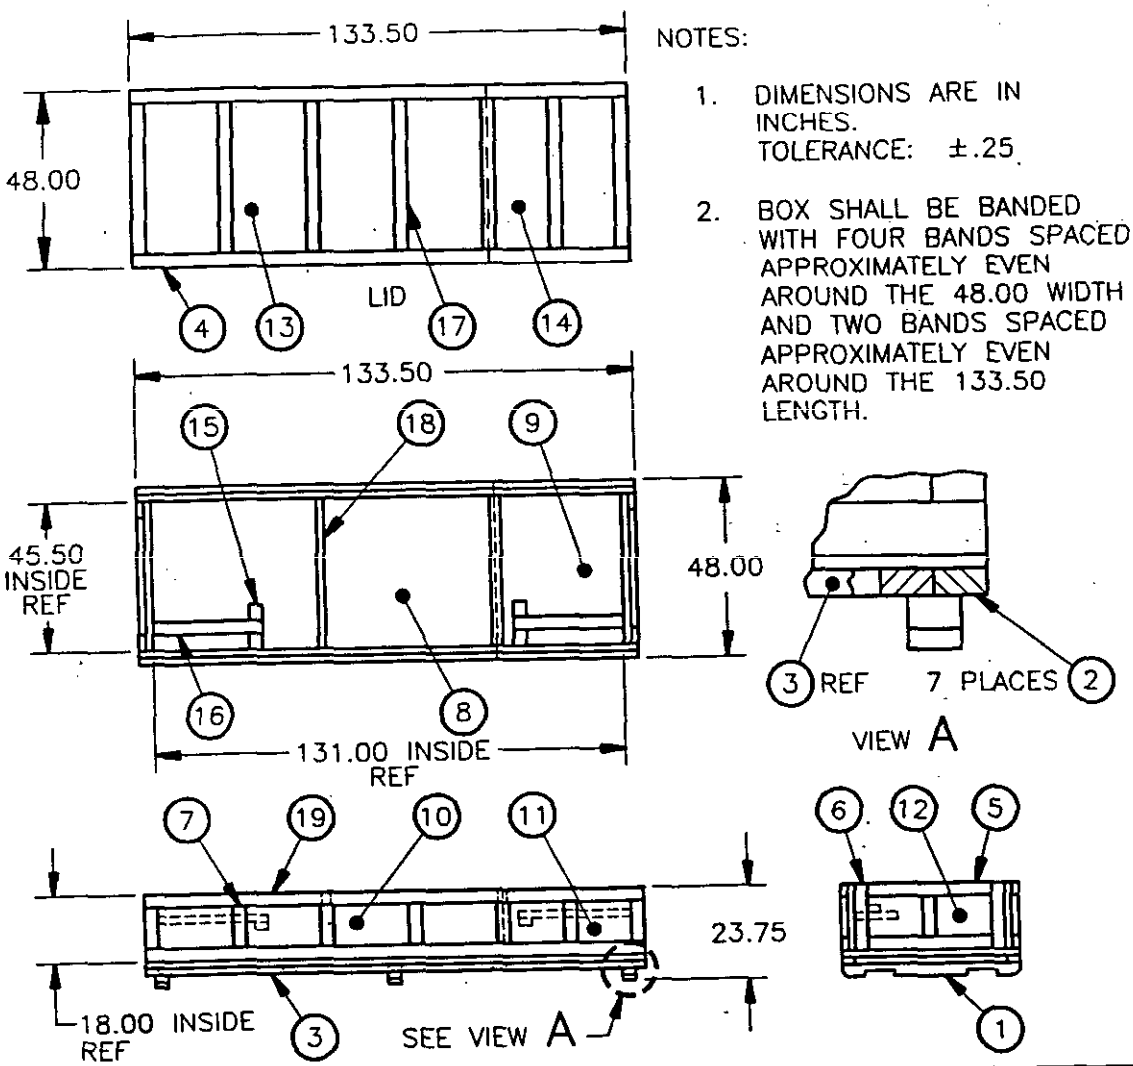

NOTES:

1. DIMENSIONS ARE IN INCHES. TOLERANCE: ±.25
2. BOX SHALL BE BANDED WITH FOUR BANDS SPACED APPROXIMATELY EVEN AROUND THE 48.00 WIDTH AND TWO BANDS SPACED APPROXIMATELY EVEN AROUND THE 133.50 LENGTH.


ITEM NO.	QTY	LUMBER SIZE
1	3	4 X 4 X 48.00
2	7	2 X 4 X 41.00
3	2	2 X 4 X 133.50
4	2	1 X 4 X 133.50
5	4	1 X 4 X 38.50
6	4	1 X 4 X 18.00
7	16	1 X 4 X 11.00
8	1	3/4 X 48.00 X 96.00 PLY
9	1	3/4 X 48.00 X 37.50 PLY
10	2	1/2 X 18.00 X 96.00 PLY

ITEM NO.	QTY	LUMBER SIZE
11	2	1/2 X 18.00 X 37.50 PLY
12	2	1/2 X 18.00 X 45.50 PLY
13	1	1/2 X 48.00 X 96.00 PLY
14	1	1/2 X 48.00 X 37.50 PLY
15	2	2 X 4 X 12.00
16	2	2 X 4 X 29.50
17	7	1 X 4 X 41.00
18	2	2 X 4 X 45.50
19	4	1 X 4 X 133.50

FIGURE 1. Crate, suction hose, FSSP


X-5063


Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

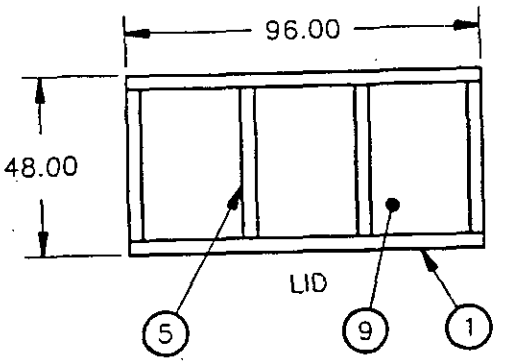


NOTES:

1. DIMENSIONS ARE IN INCHES. TOLERANCE: ±.25
2. BOX SHALL BE BANDED WITH FOUR BANDS SPACED APPROXIMATELY EVEN AROUND THE 48.00 WIDTH AND TWO BANDS SPACED APPROXIMATELY EVEN AROUND THE 96.00 LENGTH.

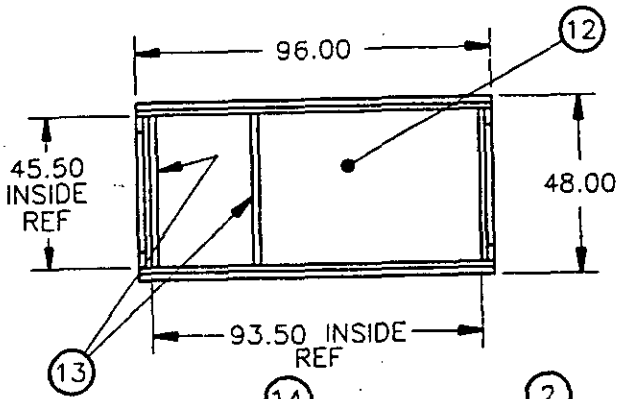

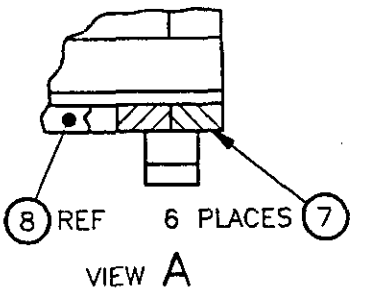

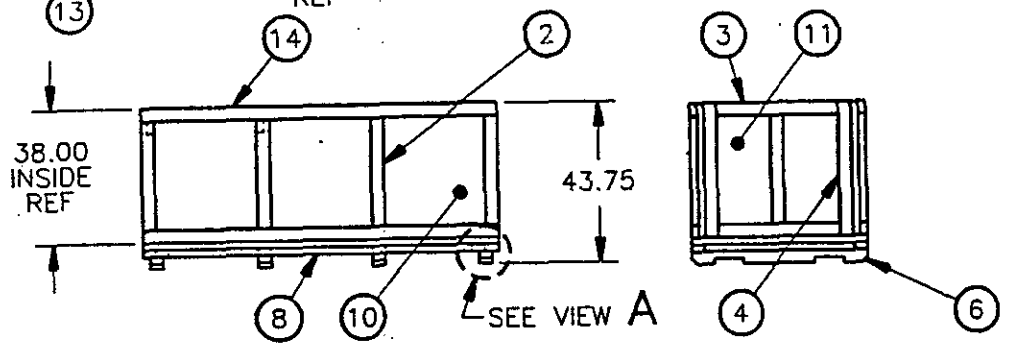

ITEM NO.	QTY	LUMBER SIZE
1	2	1 X 4 X 96.00
2	10	1 X 4 X 31.00
3	4	1 X 4 X 38.50
4	4	1 X 4 X 38.00
5	4	1 X 4 X 41.00
6	4	4 X 4 X 48.00
7	6	2 X 4 X 38.50

ITEM NO.	QTY	LUMBER SIZE
8	2	2 X 4 X 96.00
9	1	1/2 X 48.00 X 96.00 PLY
10	2	1/2 X 38.00 X 96.00 PLY
11	2	1/2 X 45.50 X 38.00 PLY
12	1	3/4 X 48.00 X 96.00 PLY
13	2	2 X 4 X 45.50
14	4	1 X 4 X 96.00

FIGURE 2. Crate, discharge hose/manifold, FSSP

X-5064

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

RECOMMEND A CHANGE:	1. DOCUMENT NUMBER MIL-F-43093G(ME)	2. DOCUMENT DATE (YYMMDD) 940930

3. DOCUMENT TITLE
FUEL SYSTEM SUPPLY POINT: PORTABLE

4. NATURE OF CHANGE (Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME (Last, First, Middle Initial)	b. ORGANIZATION	
c. ADDRESS (Include Zip Code)	d. TELEPHONE (Include Area Code) (1) Commercial (if applicable) (2) DSN	7. DATE SUBMITTED

8. PREPARING ACTIVITY

a. NAME Carolyn B. Johnson	b. TELEPHONE (Include Area Code) (1) Commercial (703) 704-3468 (2) DSN 654-3468
c. ADDRESS (Include Zip Code) US ARMY BELVOIR RDE CTR ATTN AMSTA-RBE 10115 GRIDLEY RD STE 228 FT BELVOIR VA 22060-5849	IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT: DEFNS QLTY & STDZN OFC 5203 LEESBURG PIKE STE 1403 FLS CHURCH VA 22041-3466 Telephone (703) 756-2340 DSN 289-2340

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T20:31Z
Check the source to verify that this is the current version before use.