
COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK, 20 OR 30 AMPERES (A), 250 VOLTS (V) AC, 1 THROUGH 12 POLE, ACCOMMODATES 3AG OR 3AB TYPE FUSE CARTRIDGES

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1 SCOPE This CID covers the general requirements for fuseholder blocks with 1 through 12 poles which accommodates 3AG or 3AB fuse cartridges Fuseholder blocks covered by this CID are intended for commercial/industrial applications

2 CLASSIFICATION This CID uses a classification system which is included in the Part Identification Number (PIN) The PIN shall be AA55518/02- (plus a dash number from table I) Complete PIN example AA55518/02-002 (see 6 1)

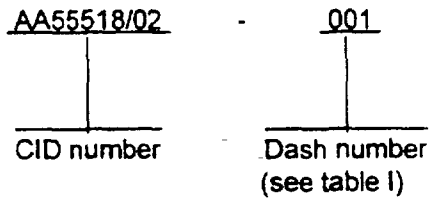

3 SALIENT CHARACTERISTICS

3 1 Design and construction Fuseholder blocks supplied to this CID shall be as specified

3 2 Ampere rating The ampere rating shall be 30 A maximum for AA55518/02-001 through AA55518/02-012 and 20A maximum for AA55518/02-013 through AA55518/02-024


3 3 Voltage rating The voltage rating shall be 250 V ac maximum


3 4 Fuse accommodation This fuseholder accommodates 3AG or 3AB type fuse cartridges with dimensions of 6 4 mm x 31 75 mm (25 inch x 1 25 inch)


Beneficial comments, recommendations, additions, deletions, clarifications, etc , and any data which may improve this document should be sent to Defense Electronics Supply Center, ATTN DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868


DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

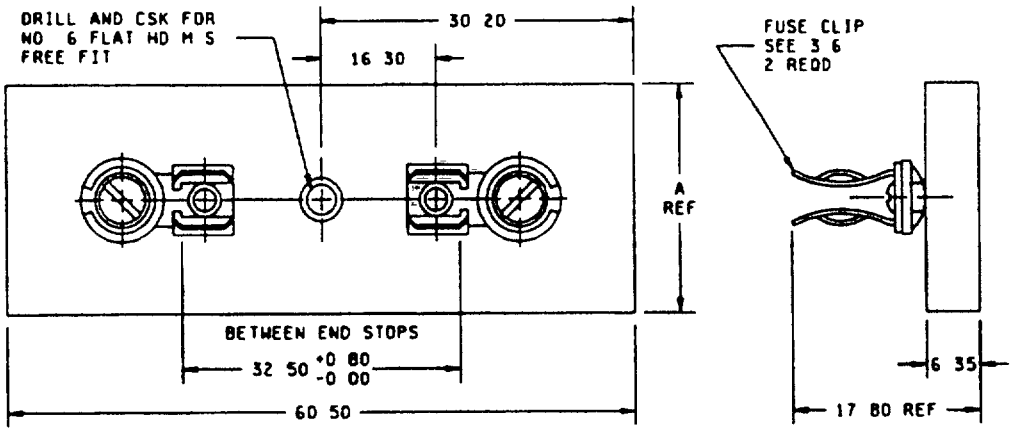

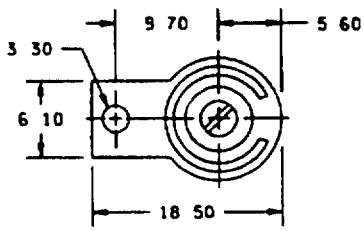

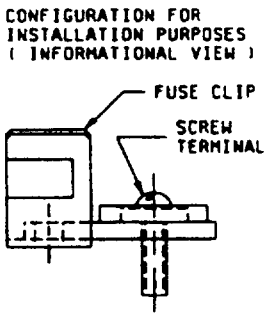



mm	Inches	mm	Inches
0 80	031	9 70	382
1 52	060	16 30	642
3 30	129	17 80	700
5 60	220	18 50	728
6 10	240	30 20	1 190
6 35	250	32 50	1 280
6 40	252	60 50	2 382

NOTES

1 Dimensions are in millimeters

2 Tolerance is ±0 13 mm (005 inch), unless otherwise specified


3 The following notes apply to width A of the fuseholders (see table I)

- a The longitudinal centerline of single pole and outer pairs of fuse clips of multiple pole fuseholders shall be located 9 9 mm (39 inch) from the edge of the fuseholder block
- b The distance between longitudinal centerlines of adjacent pairs of fuse clips shall be 23 1 mm (91 inch)
- c A minimum of two mounting holes shall be provided on multiple pole fuseholders These holes shall be one each centrally located between the fuse clips on the longitudinal centerline of the outer pairs of fuse clips

4 The US government preferred system of measurement is the metric SI system However, this item was originally designed using inch-pound units of measurement In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence

Figure 1 Configuration and dimensions (screw terminals)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

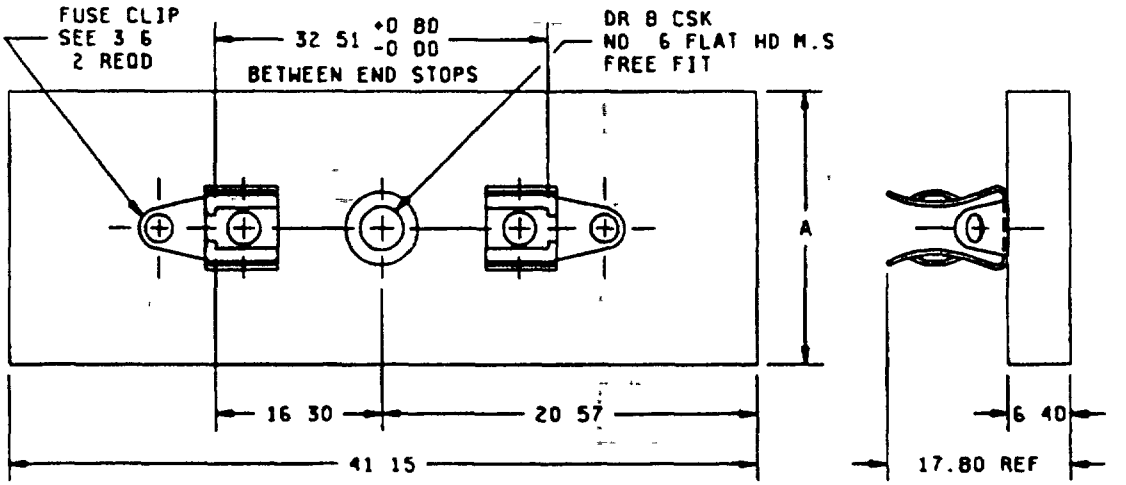

mm	Inches
0 80	030
6 40	250
16 30	642
17.80	700
20 57	810
32 51	1 280
41 15	1 620

NOTES

1 Dimensions are in millimeters

2 Tolerance is ±0 13 mm (005 inch), unless otherwise specified

3 The following notes apply to width A of the fuseholders (see table I)

a The longitudinal centerline of single and outer pairs of fuse clips of multiple pole fuseholders shall be located 9 9 mm (39 inch) from the edge of the fuseholder block

b The distance between longitudinal centerlines of adjacent pairs of fuse clips shall be 23 1 mm (91 inch)

c A minimum of two mounting holes shall be provided on multiple pole fuseholders These holes shall be one each centrally located between the fuse clips on the longitudinal centerline of the outer pairs of fuse clips

4 The US government preferred system of measurement is the metric SI system However, this item was originally designed using inch-pound units of measurement In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence

Figure 2 Configuration and dimensions (solder lug terminal type)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

TABLE I Characteristics

CID dash number AA55518/02-	Number of poles	Figure number	Dimension A
001	1	1	19 8 (78)
002	2		42 9 (1 69)
003	3		65 8 (2 59)
004	4		88 9 (3 50)
005	5		112 0 (4 41)
006	6		134 9 (5 31)
007	7		158 0 (6 22)
008	8		180 0 (7 12)
009	9		204 0 (8 03)
010	10		227 1 (8 94)
011	11		249 9 (9 84)
012	12		273 1 (10 75)
013	1	2	19 8 (78)
014	2		42 9 (1 69)
015	3		65 8 (2 59)
016	4		88 9 (3 50)
017	5		112 0 (4 41)
018	6		134 9 (5 31)
019	8		180 8 (7 12)
020	10		227 1 (8 94)
021	12		273 1 (10 75)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

3 5 Fuseholder base The fuseholder base shall be molded or laminated plastic

3 6 Fuse clips Fuseholder AA55518/02-01 through AA55518/02-012 shall be supplied with CID number AA55507/01-01 fuse clips Fuseholders AA55518/02-013 through AA55518/02-021 shall be supplied with either CID number AA55507/01-09 or CID number AA55507/01-11 fuse clips

3 7 Marking Fuseholder blocks supplied to this CID shall be marked with the manufacturer's standard commercial PIN

4 QUALITY ASSURANCE PROVISIONS Quality assurance provisions shall be as specified in A-A-55518

5 PACKAGING Packaging shall be as specified in A-A-55518

6 NOTES

6 1 PIN The PIN should be used for Government purposes to buy commercial products to this CID See section 2 for PIN format

6 2 CAGE code For ordering purposes, inventory control, and submission of these instruments to DESC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used

6 3 Source of document

Commercial Item Description

A-A-55518 - Fuseholder, Block, General Requirements

A-A-55507/01 - Clip, Electrical, Fuse, 30 and 60 Ampere, For Fuse Diameters 1/4" Thru 13/16"

(Copies of commercial item descriptions are available from the Defense Printing Service Detachment Office, Building 4D (Customer Service), 700 Robbins Avenue, Philadelphia, PA 19111-5094)

6 4 Ordering data Ordering data shall be as specified in A-A-55518

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

6 5 Commercial products As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID (NOTE This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown)

MFGR's CAGE	MFGR's name and address
71400	Bussmann P O Box 14460 St Louis, MO 63178-4460 (314) 527-1253
75915	Littelfuse, Incorporated 800 E Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

6 6 Part number (P/N) supersession data This CID supersedes the following manufacturer's P/Ns as shown This information is being provided to assist in reducing proliferation in the government inventory system

Dash number (see table I) AA55518/02-	MFGR CAGE	MFGR P/N 1/	MFGR CAGE	MFGR P/N 1/
001	71400	FH22AM	75915	356001
002	71400	FH22BM	75915	356002
003	71400	FH22CM	75915	356003
004	71400	FH22EM	75915	356004
005	71400	FH22GM	75915	356005
006	71400	FH22HM	75915	356006
007	—	—	75915	356007
008	71400	FH22KM	75915	356008
009	—	—	75915	356009
010	71400	FH22MM	75915	356010
011	—	—	75915	356011
012	71400	FH22PM	75915	356012
013	71400	FH23AM	—	—
014	71400	FH23BM	—	—
015	71400	FH23CM	—	—
016	71400	FH23EM	—	—
017	71400	FH23GM	—	—
018	71400	FH23HM	—	—
019	71400	FH23KM	—	—
020	71400	FH23MM	—	—
021	71400	FH23PM	—	—

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID PIN shown

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

6 7 Government users To acquire information on obtaining these fuseholder blocks from the Government inventory system, contact Defense Electronics Supply Center, ATTN DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5519, or telephone (513) 296-5106

MILITARY INTERESTS

Custodians
Army - ER
Navy - SH
Air Force - 85

Review Activities
Army - AR, AT, EA, MI
Navy - AS, CG, EC
Air Force - 17, 19, 99

CIVIL AGENCY COORDINATING ACTIVITY

GSA - 7FXE

Preparing Activity

DLA - ES

Project 5920-0534-02

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.