MIL-F-83243A(USAF)
13 March 1973
SUPERSEDING
MIL-F-83243 (USAF)
2 February 1970

MILITARY SPECIFICATION

FILTER-SEPARATORS, LIQUID FUEL FFU-18/E AND FFU-24/E

1. SCOPE

1.1 Scope. This specification covers two configurations of a 600-gpm capacity aircraft liquid fuel filter-separator for installation in the Panero hydrant refueling system.

1.2 Classification. The filter-separators shall be of the following types, as specified (see 6.2):

FFU-18/E - Inline inlet and outlet connections

FFU-24/E - Raised outlet connection.

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issue in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein:

SPECIFICATIONS

Military

MIL-C-104	Crates, Wood; Lumber and Plywood Sheathed, Nailed and Bolted
MIL-P-116	Preservation, Methods of
MIL-P-5315	Packing, Preformed, Hydrocarbon Fuel Resistant
MIL-G-5572	Gasoline, Aviation, Grades 80/87, 100/130, 115/145
MIL-T-5624	Turbine Fuel, Aviation, Grades JP-4 and JP-5
MIL-F-8901	Filter-Separators, Liquid Fuel: and Filter-Coalescer Elements, Fluid Pressure: Inspection Requirements and Test Procedures for
MIL-C-10387	Coupling, Clamp, Pipe, With Bolts and Synthetic Rubber Gasket, for Grooved Pipe and Tube
MIL-P-10388	Pipe Fittings, One or More Ends Grooved
MIL-F-52308	Filter Element, Fluid Pressure

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

STANDARDS

Military

MIL-STD-100	Engineering Drawing Practices
MIL-STD-129	Marking for Shipment and Storage
MIL-STD-130	Identification Marking of U. S. Military Property
MIL-STD-276	Impregnation of Porous Nonferrous Metal Castings
MIL-STD-808	Finishes, Protective, and Codes, for Finishing Schemes for Ground and Ground Support Equipment
MIL-STD-831	Test Reports, Preparation of
MIL-STD-1186	Cushioning, Anchoring, Bracing, Blocking, and Waterproofing, with Appropriate Test Methods

(Copies of specifications, standards, drawings, and publications required by suppliers in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publication. The following document forms a part of this specification to the extent specified herein. Unless otherwise indicated, the issue in effect on date of invitation for bids or request for proposal shall apply.

American National Standards Institute, Incorporated

ANSI B16.5 Steel Pipe Flanges and Flanged Fittings

(Application for copies should be addressed to the American National Standards Institute, Incorporated, 1430 Broadway, New York, New York 10018.)

3. REQUIREMENTS

3.1 Preproduction. This specification makes provisions for preproduction testing.

3.2 Components. The filter-separator shall incorporate the following major components:

Item Name	See Requirement
Housing	3.7.1
Water drain valve	3.7.2
Filter-coalescer elements	3.7.3
Permanent separator stage	3.7.4
Automatic water drain valve	3.7.5
Air eliminator valve	3.7.6
Differential pressure gage	3.7.7
Sampling device	3.7.8
Water level gage	3.7.9.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

3.3 General specification. The requirements of MIL-F-8901 apply as requirements of this specification with the exceptions and additions specified herein. When the two specifications conflict, this specification shall govern.

3.4 Materials. All materials used in the construction of the filter-separator shall be as specified in MIL-F-8901, with the exceptions and additions specified herein.

3.4.1 Metals

3.4.1.1 Impregnation of castings. Aluminum castings may be impregnated in accordance with MIL-STD-276 to prevent minor weeping.

3.4.1.2 Bonding. Metal parts shall be bonded together to prevent the possibility of sparking.

3.4.2 Fungusproof materials. Materials which are not nutrients for fungi shall be used to the greatest practicable extent. Where materials that are nutrients for fungi must be used, such materials shall be treated with a fungicidal agent acceptable to the procuring activity.

3.4.3 Elastomers. Elastomeric materials shall be compatible with fuels conforming to MIL-G-5572 and MIL-T-5624 and suitable for use in temperatures ranging from -40° to +125°F.

3.4.4 Wood. Unless specified herein or approved by the procuring activity, wood shall not be used.

3.5 Design and construction. The general design and construction of the filter-separator shall be as specified in MIL-F-8901. The detailed design configuration shall be as shown on figures 1 and 2.

3.6 Performance. The filter-separator shall meet the performance requirements of MIL-F-8901 at a flow rate of 600 gpm with the exceptions and additions specified herein.

3.6.1 Differential pressure. The differential pressure requirement shall not be exceeded at 100 percent of rated flow in lieu of 115 percent.

3.6.2 Water removal. The water removal capability shall be at fuel flow rates up to 100 percent of the rated flow in lieu of 115 percent. The influent fuel shall contain no more than 3 percent water by volume in lieu of 5 and 10 percent water by volume, respectively.

3.6.3 Solids removal capacity. The filter-separator shall remove a quantity of solids at least equal to 5 grams per gallon-per-minute of its rated flow

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

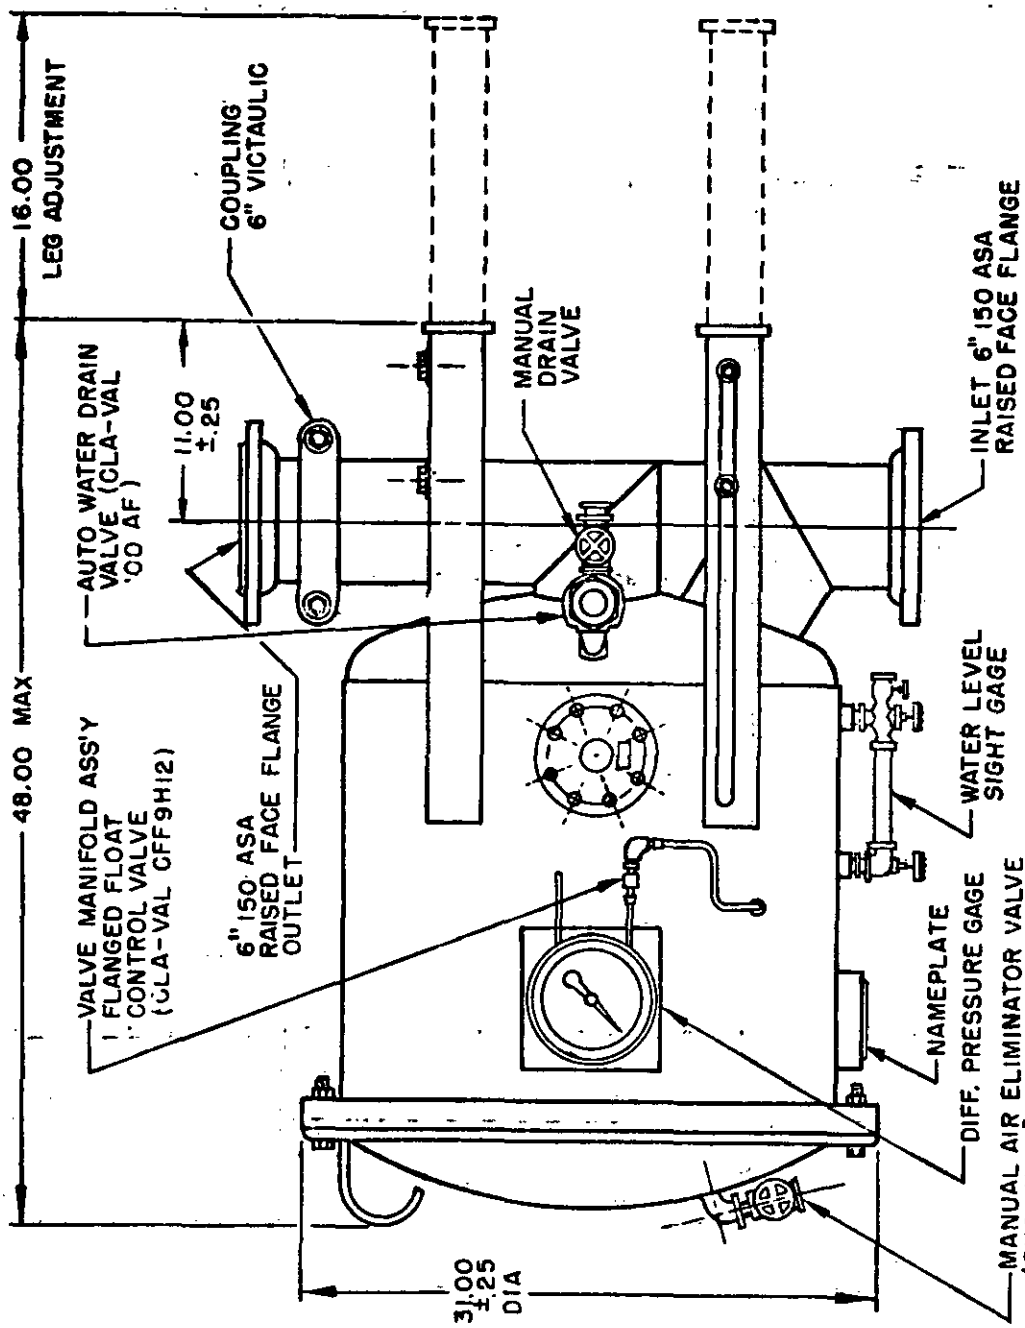


FIGURE 1. Detailed Design Configuration - FFU-18/E

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

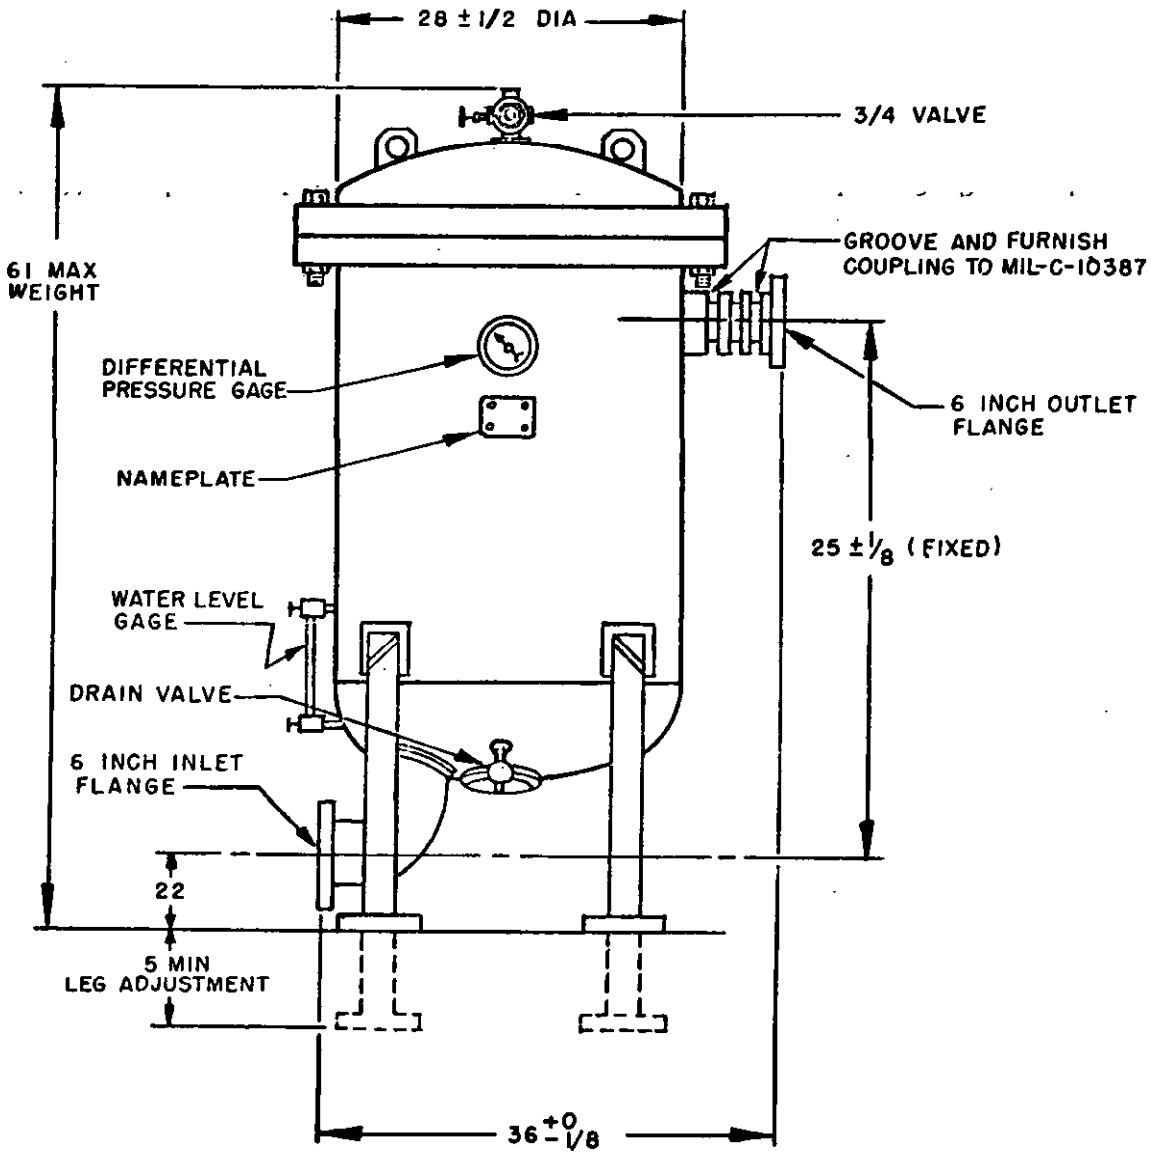


FIGURE 2. Detailed Design Configuration - FFU-24/E

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

capacity in lieu of 10 grams per gallon-per-minute. The solids injection rate shall be 0.072 gram per gallon in lieu of 0.143 gram per gallon.

3.7 Details of components

3.7.1 Housing. The housing shall be as specified in MIL-F-8901. It shall be fabricated from aluminum alloy of the grade and temper to suit the application. The housing shall be designed for a fuel flow rate of 600 gpm using 21 elements in accordance with MIL-F-52308 and 21 canisters in accordance with figure 3. The housing shall be designed for a working pressure of 150 psi. The configurations of the housing shall be as shown on figures 1 and 2.

3.7.1.1 Cover. The housing shall be provided with a cover to permit installation and replacement of elements. The cover shall be provided with two lifting eyes designed with sufficient strength to support the dry weight of the filter-separator. The lifting eyes shall have a minimum inside diameter of 3 inches. The location of the eyes shall permit removal of the cover for installation of elements and for installation of the complete filter-separator in hydrant pits by means of a hoist.

3.7.1.1.1 Cover retention. The filter-separator cover shall be retained by through bolts. The size and number of bolts and nuts used shall be adequate to meet the performance requirements of this specification.

3.7.1.1.2 Cover seal. The cover shall be sealed to the housing with an O-ring seal conforming to MIL-P-5315.

3.7.1.2 Canister retention. Canister retention shall be accomplished utilizing the features shown on figure 3.

3.7.1.3 Inlet and outlet connections. Inlet and outlet connections shall be 6-inch nominal pipe size and located in line (unless otherwise shown) 180° apart on the housing centerline. The type and physical location of the connections shall be as shown on figures 1 and 2. The inlet connection shall be clearly stamped INLET into the pipe, and the outlet connection shall be clearly stamped OUTLET into the pipe.

3.7.1.3.1 Grooved pipe ends and couplings. Grooved pipe ends shall conform to MIL-P-10388. Couplings shall conform to MIL-C-10387.

3.7.1.3.2 Flange pipe ends. Flange ends (see figures 1 and 2) shall conform to ANSI Standard B16.5, class 150. Boltholes of welded flange ends shall straddle the centerlines.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

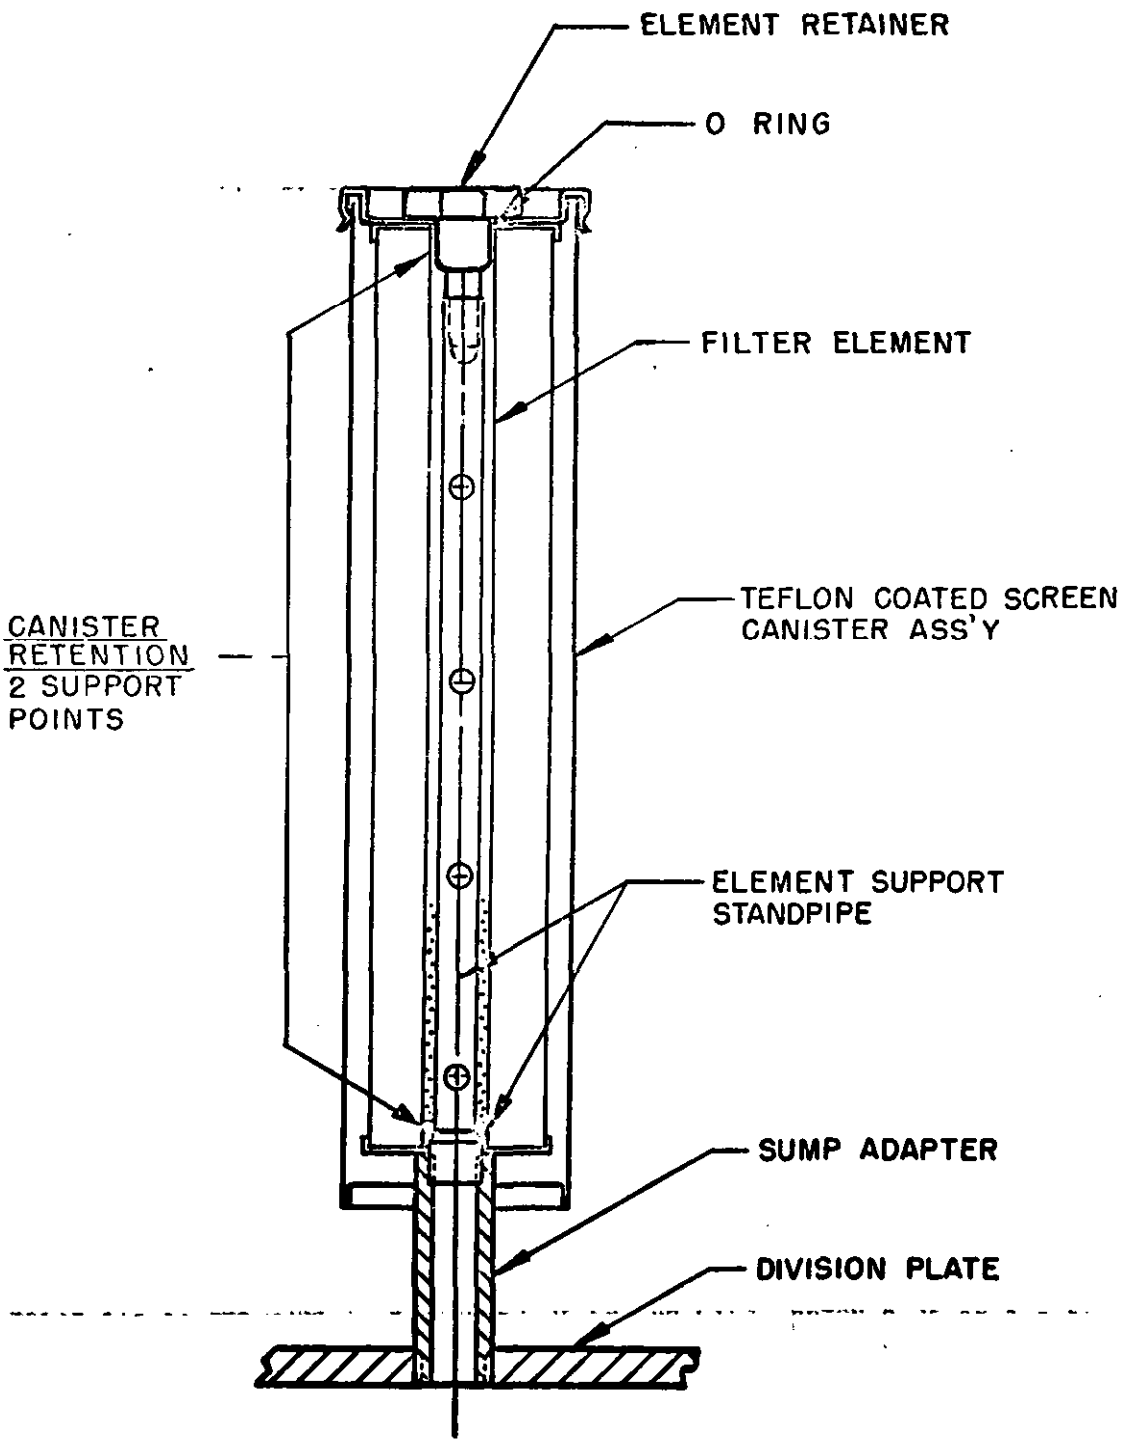


FIGURE 3. Canister Retention

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

3.7.1.4 Adjustable legs. Four adjustable legs shall be provided on the housing. Each leg shall be provided with an adjustable baseplate having a minimum area of 9 square inches. The baseplates shall be capable of being adjusted and locked in place to the heights as shown on figures 1 and 2.

3.7.1.5 Differential pressure gage connection. Gage connection for the differential pressure across the filtration media, including the water separation stage, shall be provided.

3.7.1.6 Water level gage connection. A water level gage connection shall be provided to permit the installation of a water level gage.

3.7.1.7 Water sump. If required to meet the performance requirements of this specification, a separate water sump shall be provided. The location of the sump may be either under the housing or on the side. If the sump is located on the side of the housing, it shall not extend more than 12 inches beyond the outside diameter of the filter-separator.

3.7.1.8 Differential pressure gage mounting provisions. Differential pressure gage mounting provisions shall be provided on the housing 90° to the left and 90° to the right of the inlet connection.

3.7.2 Water drain valve. A 3/4-inch nominal pipe globe valve shall be provided on the filter-separator to permit manual draining of the water from the filter-separator. A 3/4-inch nominal pipe to an external 3/4-11-1/2 NH thread hose connection shall be provided on the outlet of this valve.

3.7.3 Filter-coalescer elements. Twenty-one filter-coalescer elements in accordance with MIL-F-52308 shall be provided with the filter-separator. The elements shall be installed in the separator canisters as shown on figure 3.

3.7.4 Permanent separator stage. The permanent separator stage for the filter-separator shall consist of 21 separator canisters. The 21 canisters shall be provided and shall conform to figure 3.

3.7.5 Automatic water-drain valve. A water drain valve shall be provided to automatically function to discharge the water at a minimum rate of 18 gpm at operational pressures from 30 to 150 psi. The valve shall be provided with a float which will raise at a predetermined water level in the filter-separator and cause water to be discharged. When the water level is lowered or there is no water in the filter-separator, the water valve shall be in the closed position. The outlet of the valve shall be provided with a pipe thread connection. The valve shall be provided with a means to externally check for proper operation without the use of water.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

3.7.6 Air eliminator valve. A manual air eliminator valve shall be provided on the top of the filter-separator to permit the removal of air. It shall consist of a 3/4-inch NPT globe valve. The valve and applicable piping shall not extend beyond the housing height limitation as shown on figures 1 and 2.

3.7.7 Differential pressure gage (bellows type). A bellows-type differential pressure gage shall be supplied. The gage shall be equipped with liquid-filled, ruptureproof bellows and a torque tube. The case shall be at least 6 inches in diameter and shall be of equal construction to that of die cast aluminum, finished with a weather-resistant black epoxy resin enamel. The case shall be provided with a glass cover secured to the bezel with an O-ring seal. The face of the gage shall be provided with white numbers on a black background, or black on white. The housing shall be designed for a system working pressure of 200 psi. The gage shall have a uniform range from 0 to 25 psi with a scale graduation of 1 psi increments. The gage shall be designed for panel mounting with 1/4-18 NPT internal thread connections. The inlet port shall be clearly marked INLET and the outlet port clearly marked OUTLET. The accuracy of the gage shall be ±1/2 percent of the full scale differential pressure.

3.7.7.1 Differential pressure gage valve manifold. To facilitate removal of the differential pressure gage for periodic calibration, a Barton Corporation Model 235 valve manifold, or equal, shall be provided. This manifold shall be connected to the differential pressure gage and so installed on the gage panel as to permit opening and closing of all valves. The manifold shall be made from brass and shall incorporate two block valves and one bypass valve. The gage connections shall be 1/4 inch female NPT. The manifold shall withstand static pressures up to 500 psi without failure. All valves shall be packless type and shall incorporate stainless steel diaphragms. Preformed tubing and tubing fittings shall be provided to facilitate assembly.

3.7.8 Sampling device. A sampling device shall be provided in the outlet piping to permit sampling fuel downstream of the filter-separator. The sampling device shall consist of a 1/4-inch pipe extending approximately 1/4 inch beyond the inner wall. The exterior part of the pipe shall be 1/4-18 NPT external threads, and a Snap-Tite part No. AVEC-4-4F coupler and Snap-Tite part No. AMPE-4 plug, or equal, shall be attached to this end of the pipe. The coupler shall be capable of accepting a Millipore part No. XX 64 037 08 fuel sampling kit or the referenced Snap-Tite plug.

3.7.9 Water level gage. A 1/2-inch, armoured, unbreakable clear plastic water level gage shall be provided for observing the water accumulation in the filter-separator. The gage shall be provided with two shutoff valves and other necessary fittings to permit removal of the sight glass for cleaning and replacement.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

3.8 Part numbering of interchangeable parts. All parts having the same manufacturer's part number shall be functionally and dimensionally interchangeable. The item identification and part number requirements of MIL-STD-100 shall govern the manufacturer's part numbers and changes thereto.

3.9 Finish. The filter-separator shall be finished in accordance with finish No. D-351 of MIL-STD-808.

3.10 Identification of product. The filter-separator shall be identified in accordance with MIL-STD-130.

3.10.1 Manufacturer's part number. The manufacturer's part number and drawing number shall be the same.

3.10.2 Nameplate. A nameplate shall be provided and shall include the element identification and instructions as shown on figure 4. The nameplate shall be permanently attached to the housing adjacent to the differential pressure gage in a position that can be readily viewed by the operator.

3.11 Workmanship. The filter-separator, including all parts and accessories, shall be fabricated and finished in a thoroughly workmanlike manner. Particular attention shall be given to freedom from blemishes, defects, burrs, and sharp edges; accuracy of dimensions; radii of fillets and marking of parts and assemblies; thoroughness of soldering, welding, brazing, painting, wiring, and riveting; alignment of parts; and tightness of assembly screws and bolts.


3.11.1 Cleaning. Components of the filter-separator shall be thoroughly cleaned to remove dirt; excess soldering, brazing, and welding flux; welding slag; loose, spattered, or excess solder; metal chips; and other foreign materials before, during, and after assembly.

3.11.2 Riveting. Riveting operations shall be performed to insure tight and satisfactory heading of rivets.

3.11.3 Gear and lever systems. Gear and lever systems shall be properly aligned and meshed, and shall be operable without interference, tight spots, loose spots, and other irregularities. Where required for accurate adjustments, gear assemblies shall be free of visible backlash.

3.11.4 Clearances and adjustments. All parts such as shafts, pinions, pistons, gears, valves, et cetera, shall have proper clearances and adjustments.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

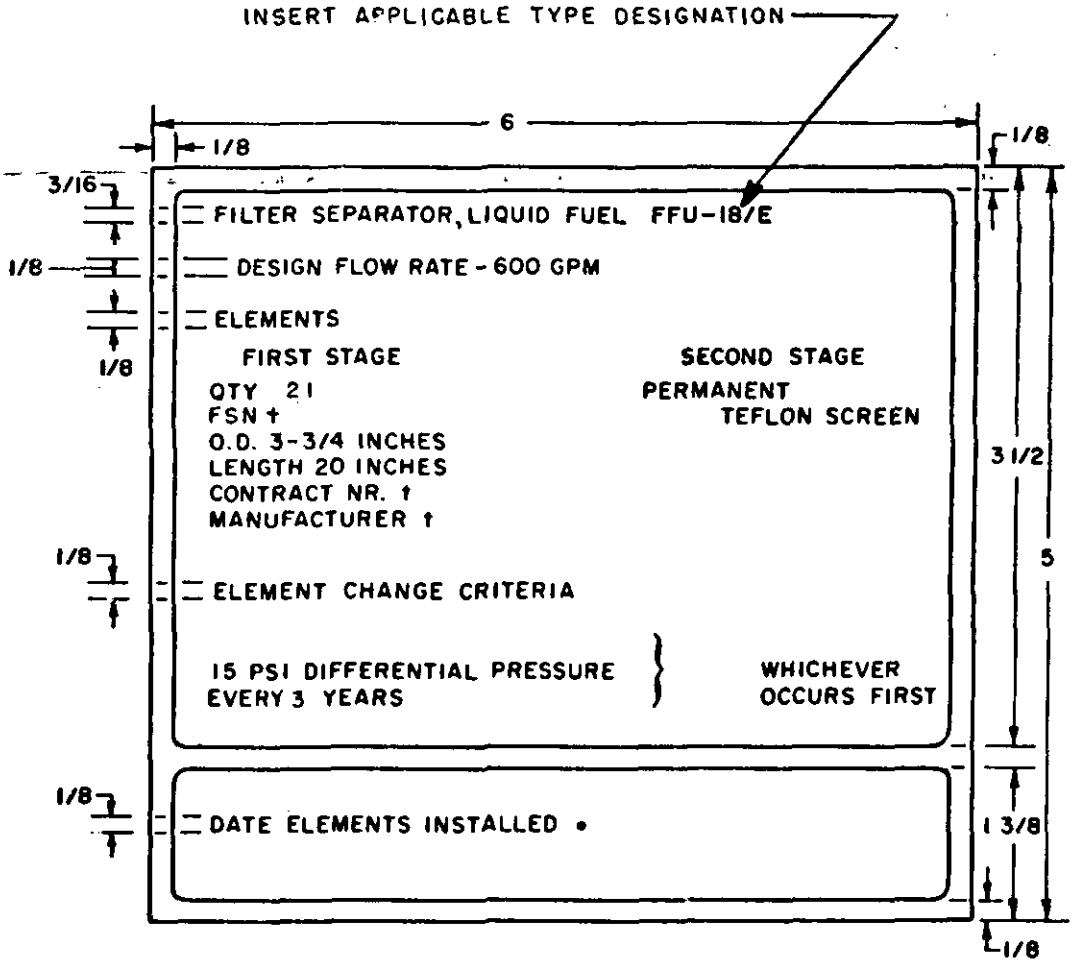

† APPLICABLE INFORMATION PROVIDED BY CONTRACTOR
• PROVIDE APPLICABLE SURFACE TO ALLOW DATA TO BE MARKED BY GOVERNMENT PERSONNEL

NOTES:
1. DIMENSIONS IN INCHES, TOLERANCES ±-1/32
2. ALL LETTERING SHALL BE 3/32 INCH HIGH, UNLESS OTHERWISE NOTED
3. BACKGROUND SHALL BE BLUE
4. MATERIAL - 18 GAGE ALUMINUM (.04)

FIGURE 4. Nameplate

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

3.11.5 Bolted connections. Boltholes shall be accurately punched or drilled and shall have the burrs removed. Washers or lockwashers shall be provided in accordance with good commercial practice, and all bolts, nuts, and screws shall be tight.

3.11.6 Welding. The surfaces of parts to be welded shall be free from rust, scale, paint, grease, and other foreign matter. Welds shall develop strength and transmit stress to the parts connected under proof and service loading without failure.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or order, the supplier may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.2 Classification of tests. The inspection and testing of the filter-separator shall be classified as follows:

a. Preproduction testing . . . . . See 4.3

b. Quality conformance inspection . . . . . See 4.4.

4.3 Preproduction testing (see 6.2)

4.3.1 Test sample. Unless otherwise specified (see 6.2), one of each type filter-separator being procured shall be subjected to the preproduction tests specified in 4.3.3.

4.3.2 Test report. Upon completion of the preproduction tests, a test report shall be prepared in accordance with MIL-STD-831. An authorized Government quality control representative shall countersign all data sheets and the report. The following shall be incorporated as part of an enclosure to the test report:

a. 35-millimeter colored slides - left-front, three-quarter view and right-rear, three-quarter view with a clear background as well as other slides of the filter-separator with test apparatus.

b. A list of all components and items noting the manufacturer's name, part or model number, applicable specification (including the applicable revision

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

and amendment), conformance or nonconformance to the specification (if nonconformance include a statement as to where and the reason for), and metals used in the fabrication of all items that come into contact with the fuel.

c. Brief operating and installation data to enable Government personnel to correctly install and operate the equipment.

d. Engineering data in form of assembly drawings (two sets) showing the following dimensions as a minimum: flange to flange, top to center of flange, base to center of flange, water sump, and overall.

4.3.2.1 Items to accompany test report. One canister and one new element shall be provided with the test report. These items will be retained by the procuring activity.

4.3.3 Preproduction tests. The preproduction tests shall consist of all the tests described under 4.5.

4.4 Quality conformance inspection. The quality conformance inspection shall consist of the individual tests.

4.4.1 Individual tests. Each filter-separator shall be subjected to the following tests as described under 4.5:

a. Examination of product . . . . . See 4.5.1

b. Hydrostatic pressure test. . . . . See 4.5.2

c. Permanent separator stage. . . . . See 4.5.3.

4.5 Test methods

4.5.1 Examination of product. The filter-separator shall be inspected to determine compliance with the requirements specified herein. Particular attention shall be given to materials, workmanship, dimensions, weight, welding, riveting, turning of the baseplates, and marking of the filter-separator. The filter-separator shall be examined to assure protection is provided for devices, components, et cetera, that otherwise could be easily inadvertently damaged. This examination for the preproduction assembly shall be accomplished using a checklist which lists the requirements and the results of the examination after each requirement. The checklist shall be included in the test report.

4.5.2 Hydrostatic pressure. The filter-separator shall be tested in accordance with MIL-F-8901. The hydrostatic test pressure shall be 225 psi.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

4.5.3 Permanent separator stage. Each canister shall be inspected and tested in accordance with MIL-F-8901.

4.5.4 Filter-separator tests. Preproduction filter-separator tests shall be conducted in accordance with MIL-F-8901, with the exceptions and additions specified herein:

4.5.4.1 Differential pressure and media migration. During the differential pressure and media migration tests, the maximum flow rate shall be 100 percent in lieu of 115 percent.

4.5.4.2 Solids injection rate. During the Red iron oxide (dry), Red oxide and water, and Inhibited fuel tests, the solids injection rate shall be 0.071 gram per gallon of fuel circulated in lieu of 0.143 gram per gallon.

4.5.4.3 Water removal. During the water removal tests, the maximum fuel flow input rate shall be 100 percent in lieu of 115 percent. During the second hour, the water injection rate shall be 3 percent in lieu of 5 percent. The third hour tests at 10 percent water injection rate is not applicable.

4.5.4.4 Life test. The life test is not required.

4.5.5 Field installation. Unless otherwise specified (see 6.2), one filter-separator of each type furnished under the contract or order, shall, prior to production approval, be subjected to a field installation test. The filter-separator shall be shipped to the installation site designated by the procuring activity (see 6.2). Upon arrival of the equipment, a simulated or actual installation shall be performed. During this test, clearances shall be checked and assurance obtained that all like filter-separators of the same configuration can be installed with a minimum of difficulty.

4.6 Inspection of preparation for delivery. Preservation, packaging, packing, and marking shall be inspected to determine conformance to the requirements of section 5.

5. PREPARATION FOR DELIVERY

5.1 Preservation and packaging. Preservation and packaging shall be level A, B, or C, as specified (see 6.2).

5.1.1 Levels A and B. The filter-separator (with associated parts) shall be preserved and packaged in accordance with method III of MIL-P-116. All openings shall be plugged or sealed with approved materials to prevent the entry of moisture or other foreign matter.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

5.1.2 Level C. The filter-separator shall be preserved and packaged in a manner that will afford adequate protection against corrosion, deterioration, mechanical and physical damage during shipment from the supply source to the first receiving activity. The supplier may use his own practice providing it fulfills these requirements.

5.2 Packing. Packing shall be level A, B, or C as specified (see 6.2). Insofar as practical, shipping containers shall be uniform in size and shape; of minimum tare, weight, and cube; and shall contain only one filter-separator and associated parts.

5.2.1 Levels A and B. The shipping container shall be type I, class 2, style B wooden crate conforming to MIL-C-104. Blocking and bracing shall be in accordance with MIL-STD-1186.

5.2.2 Level C. Filter-separators which require overpacking for acceptance by the carrier shall be packed in exterior-type shipping containers in a manner that will insure safe delivery at the lowest transportation rate to cited destinations. Containers shall meet Consolidated Freight Rules and Regulations, and rules of other common carriers as applicable to the mode of transportation.

5.3 Shipment marking. In addition to any special markings required by the contract or order (see 6.2), all interior packs and shipping containers shall be marked in accordance with MIL-STD-129. The nomenclature shall be:

FILTER-SEPARATOR, LIQUID FUEL FFU-(insert applicable designation).

6. NOTES

6.1 Intended use. The FFU-18/E and FFU-24/E filter-separators are intended to replace the filter assemblies located in the pits of the Panero refueling system. When used with the Panero system, aircraft can be serviced without using the Type MH-2A hose cart.

6.2 Ordering data. Procurement documents should specify the following:

a. Title, number, and date of this specification

b. Quantity and type of filter-separator to be procured (see 1.2)

c. Location and conditions for preproduction testing (see 4.3)

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

d. Number of test samples if other than specified in 4.3.1

e. When a field installation test is not required (see 4.5.5)

f. Applicable levels of preservation and packaging, and packing required (see 5.1 and 5.2)

g. Special shipment marking (see 5.3).

6.3 Contract administration

6.3.1 The contracting organization should require that a prospective contractor have or can contract for a suitable test system prior to award on any contracts for filtration equipment. A test system is the piping, test equipment apparatus, arrangement of test components, laboratory equipment, laboratory supplies, and techniques used during the evaluation of fuel filtration equipment.

6.3.2 The contracting organization should provide for Government inspection during the preproduction buildup and test in addition to providing Government inspection after production is released.

6.3.3 The contracting organization should, prior to issuance of a potential procurement (IFB/RFP), contact the engineering activity having technical responsibility for the specification to confirm that the latest edition of the specification is being cited.

6.4 Asterisks are not used in this revision to identify changes with respect to the previous issue, due to the extensiveness of the changes.

Custodian:
Air Force - 11

Reviewers:
Air Force - 84
DSA - CS

Preparing activity:
Air Force - 11

Project No. 4330-F130

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

FOLD

4950/TZS
Wright-Patterson AFB, O 45433
OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

POSTAGE AND FEES PAID
DEPARTMENT OF THE AIR FORCE
DoD-318

U.S. MAIL

4950/TZS
Wright-Patterson AFB, Ohio 45433

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

OMB Approval
No. 22-R255

INSTRUCTIONS: The purpose of this form is to solicit beneficial comments which will help achieve procurement of suitable products at reasonable cost and minimum delay, or will otherwise enhance use of the document. DoD contractors, government activities, or manufacturers/vendors who are prospective suppliers of the product are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity.

DOCUMENT IDENTIFIER AND TITLE

NAME OF ORGANIZATION AND ADDRESS

CONTRACT NUMBER

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A. GIVE PARAGRAPH NUMBER AND WORDING.

B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES

2. COMMENTS ON ANY DOCUMENT REQUIREMENT CONSIDERED TOO RIGID

3. IS THE DOCUMENT RESTRICTIVE?

☐ YES ☐ NO *(If "Yes", in what way?)*

4. REMARKS

SUBMITTED BY *(Printed or typed name and address - Optional)*

TELEPHONE NO.

DATE

DD FORM 1 JAN 72 1426

REPLACES EDITION OF 1 JAN 66 WHICH MAY BE USED

C16061

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:42Z
Check the source to verify that this is the current version before use.