
INCH-POUND
MIL-PRF-19207/19N
9 January 2014
SUPERSEDING
MIL-PRF-19207/19M
14 July 2009

PERFORMANCE SPECIFICATION SHEET

FUSEHOLDERS, EXTRACTOR POST TYPE, BLOWN FUSE INDICATING, TYPE FHL30G

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-PRF-19207.

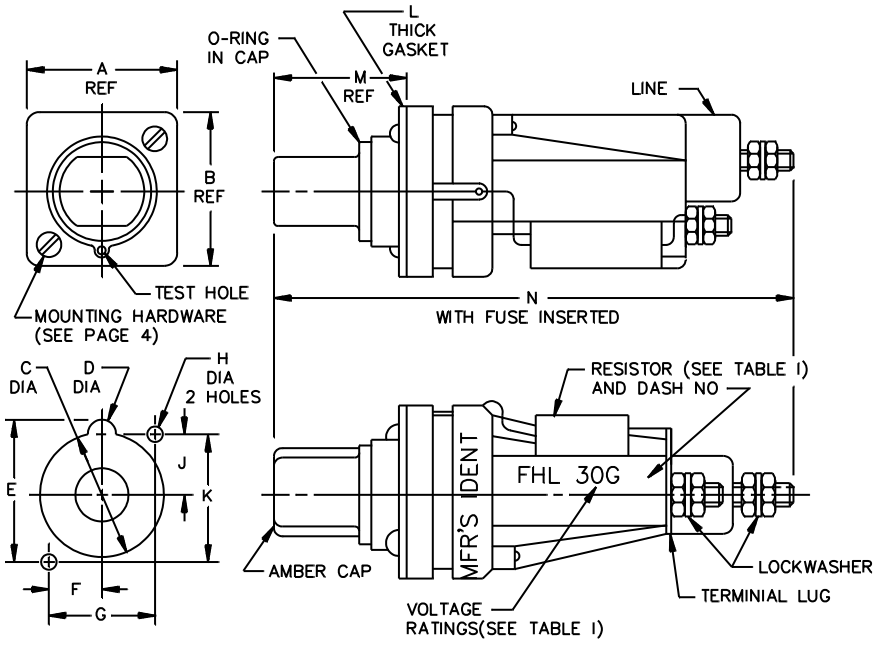

Ltr	Inches		mm		Ltr	Inches		mm	
	Min	Max	Min	Max		Min	Max	Min	Max
A	1.050	1.090	26.67	27.69	H	.151	.161	3.84	4.09
B	1.180	1.220	29.97	30.99	J	.432	.442	10.97	11.23
C	.870	.880	22.10	22.35	K	.870	.880	22.10	22.35
D	.200	.210	5.08	5.33	L	.055	.065	1.34	1.65
E	.969	.979	24.61	24.87	M	.810	.850	20.57	21.59
F	.370	.380	9.40	9.65	N	3.750	4.000	95.25	101.60
G	.745	.755	18.92	19.18					


FIGURE 1. Type FHL30G fuseholder

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:30Z
Check the source to verify that this is the current version before use.

NOTES:

1. Dimensions are in inches. Metric equivalents are given for general information only.
2. Unless otherwise specified, tolerances are .XX ± 0.02 and .XXX ± 0.005.
3. All of the type FHL30G fuseholders submitted for delivery shall have been subjected to the drip-proof test in accordance with MIL-PRF-19207, 4.6.16.2.
4. Mounting hardware: Screws, sealing, panhead, slotted, stainless steel or zinc plated steel, 6-32UNC-2A x 1.125 inches (28.58 mm) long (min) or 6-32UNC-2A x 1.125 inches (28.58 mm) long (min) with sealing washer, 2 each. Mounting hardware and gasket may be provided loose in a plastic bag or installed on the fuseholder
5. Body material: It is recommended that type MAI-60 or GDI-30F of American Society For Testing and Materials (ASTM) ASTM D5948 be considered for meeting the body molding material requirements of this specification.
6. Marking: In addition to other required marking, the manufacturer's identification, the type designation with an appropriate dash number and the voltage rating from table I shall appear on the fuseholder body but the location of each is optional.

FIGURE 1. Type FHL30G fuseholder - Continued.

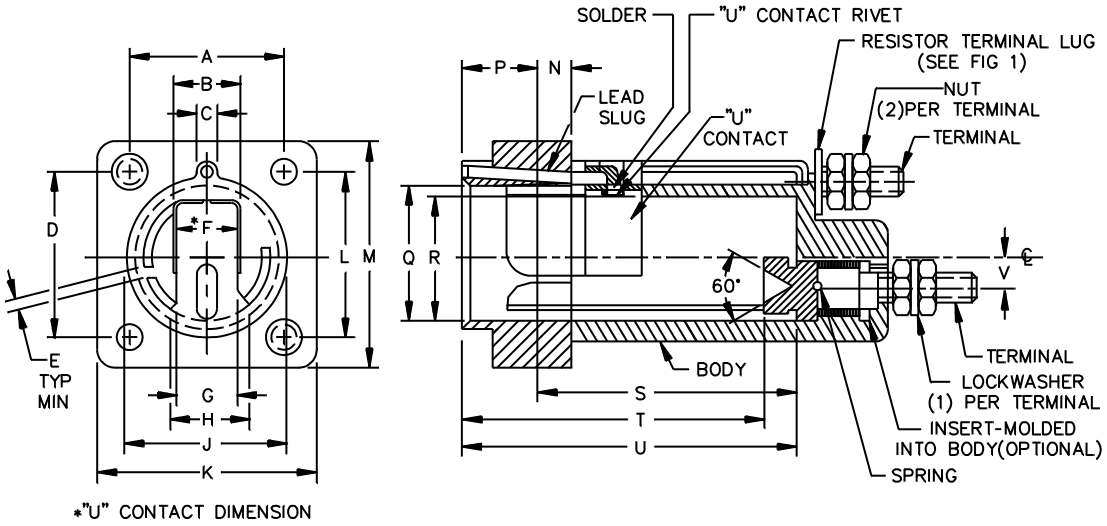

Ltr	Inches		mm		Ltr	Inches		mm	
	Min	Max	Min	Max		Min	Max	Min	Max
A	.745	.755	18.92	19.18	L	.945	.955	24.00	24.26
B	.435	.445	11.05	11.30	M	1.190	1.210	30.23	30.73
C	.188	.198	4.77	5.03	N	.140	.160	3.56	4.06
D	.870	.880	22.10	22.35	P	.385	.425	9.78	10.80
E	.125	---	3.17	---	Q	.695	.705	17.65	17.91
F	.385	.395	9.78	10.03	R	.575	.595	14.61	15.11
G	.360	.370	9.14	9.40	S	1.675	---	42.54	---
H	.435	.445	11.05	11.30	T	1.950	2.050	49.53	52.07
J	.845	.865	21.46	21.97	U	2.105	2.155	53.47	54.74
K	1.065	1.075	27.05	27.31	V	.140	.190	3.56	4.83

FIGURE 2. Body for FHL30G fuseholder.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:30Z
Check the source to verify that this is the current version before use.

NOTES:

1. Dimensions are in inches. Metric equivalents are given for general information only.
2. Unless otherwise specified, tolerances are .XX ± 0.02 and .XXX ± 0.005.
3. All of the type FHL30G fuseholders submitted for delivery shall have been subjected to the drip-proof test in accordance with MIL-PRF-19207, 4.6.16.2.
4. Mounting hardware: Screws, sealing, panhead, slotted, stainless steel or zinc plated steel, 6-32UNC-2A x 1.125 inches (28.58 mm) long (min) or 6-32UNC-2A x 1.125 inches (28.58 mm) long (min) with sealing washer, 2 each. Mounting hardware and gasket may be provided loose in a plastic bag or installed on the fuseholder
5. Body material: It is recommended that type MAI-60 or GDI-30F of American Society For Testing and Materials (ASTM) ASTM D5948 be considered for meeting the body molding material requirements of this specification.
6. Marking: In addition to other required marking, the manufacturer's identification, the type designation with an appropriate dash number and the voltage rating from table I shall appear on the fuseholder body but the location of each is optional.

FIGURE 2. Body for FHL30G fuseholder - Continued.

REQUIREMENTS:

Interface and physical dimensions: See figure 1 and figure 2.

Body material: Body material shall be selected to enable the fuseholder to meet the performance requirements of this specification. Additional information and guidance on body material is specified in the notes of figures 1 and 2.

Fuse accommodation, Ferrule type:

Size: 0.250 inch (6.35 mm) diameter, 1.250 (31.75 mm) inches in length.

Styles: F02 and F03 in accordance with MIL-PRF-15160, and FM09 in accordance with MIL-PRF-23419.

Poles: One.

Rating: 30 amperes (see table I for voltage ratings).

Panel thickness: .125 inch (3.18 mm) maximum.

Indicating: Incandescent lamp, industry No. 1764, with amber color cap.

Terminals: Threaded stud type, No. 8-32UNC-2A thread. Brass, silver, or tin plate.

Enclosure: Drip-proof (see note 4 of figure 1 and 2).

Test fuses:

Temperature rise: F03A125V30A in accordance with MIL-PRF-15160/3.

Short circuit: F03A125V30A in accordance with MIL-PRF-15160/3.

Mechanical shock: Method I in accordance with MIL-PRF-19207.

Terminal strength: 20 pounds.

Torque: Terminals - 15 inch-pounds.

Salt spray (corrosion): Test condition B.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:30Z
Check the source to verify that this is the current version before use.

Mounting hardware:

Mounting plate: A threaded metal insert may be used in lieu of mounting plate.

Part or Identifying Number (PIN): FHL30G (dash number from table I).

Patent notice: The US Government has royalty-free license only under claims 3 through 6, 11, and 12 of US Patent 2,854,549 owned by McGraw Electric Company for the benefit of manufacturers of the items called for in this specification sheet either for the Government or for use in equipment to be delivered to the Government.

TABLE I. Fuseholder marking.

Fuseholder marking		Resistance (ohms)	Resistance specification	Style
PIN dash number	Voltage (volts)			
-001	12-22	Shorting wire in place of resistor		
-002	23-33	330	MIL-PRF-39017/2	-RLR20
-003	34-45	681	MIL-PRF-39007/8	-RWR80
-004	46-60	1,210	MIL-PRF-39007/8	-RWR80
-005	61-80	1,870	MIL-PRF-39007/11	-RWR89
-006	81-90	2,050	MIL-PRF-39007/11	-RWR89

Referenced documents. In addition to MIL-PRF-19207, this document references the following:

ASTM D5948 MIL-PRF-15160 MIL-PRF-15160/3 MIL-PRF-23419

MIL-PRF-39007/8 MIL-PRF-39007/11 MIL-PRF-39017/2

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:30Z
Check the source to verify that this is the current version before use.

Custodians:
Army - CR
Navy - SH
Air force - 85
DLA - CC

Preparing Activity:
DLA - CC

(Project 5920-2012-063)

Review Activities:
Army - AR, AT, CR4, MI
Navy - AS, EC, MC, OS
Air Force - 19, 70, 71, 99

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:30Z
Check the source to verify that this is the current version before use.