
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

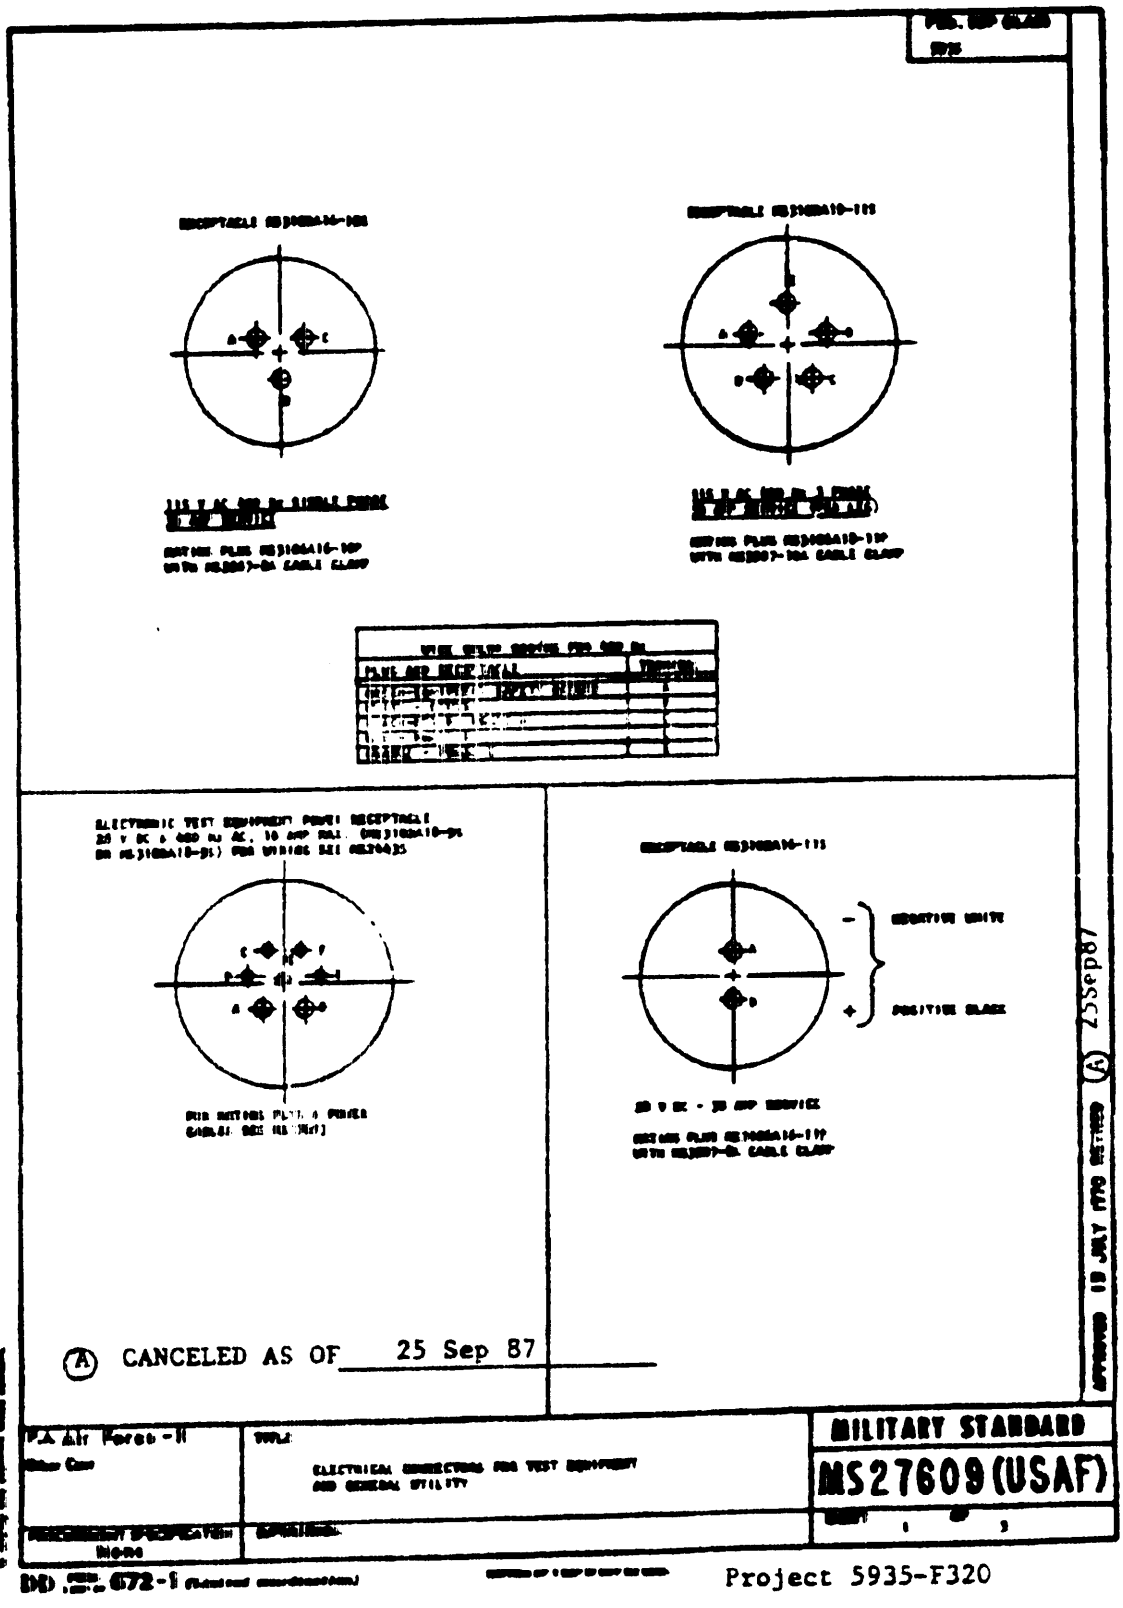


Ⓐ CANCELED AS OF 25 Sep 87


P.A. Air Force - 11	TITLE: ELECTRICAL CONNECTORS FOR TEST EQUIPMENT AND GENERAL UTILITY	MILITARY STANDARD MS27609(USAF)
PROCUREMENT SPECIFICATION: None		

DD FORM 1426-1

Project 5935-F320

Source: https://assist.dla.mil -- Downloaded: 20260-23T16:45Z
Check the source to verify that this is the current version before use.





WIRE COLOR CODING FOR 60 Hz		
RECEPTACLE	TERMINAL	PLUG
WHITE-CENTER SOCKET	C	WHITE-CENTER SOCKET
WHITE-NEUTRAL	N	WHITE-NEUTRAL
BLACK-HOT OR VIOLET 2	2	BLACK-HOT OR VIOLET 2
BLUE-PHASE B	1	RED-PHASE B
YELLOW-PHASE C	3	ORANGE-PHASE C

RECEPTACLE COLOR CODE IS IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE

PLUG COLOR CODE IS IN ACCORDANCE WITH NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION AND AMERICAN NATIONAL STANDARDS INSTITUTE

NOTES:

1. FOR GROUND USE AS PRIMARY POWER INPUT TO PORTABLE POWER TOOLS, SHOP, OFFICE AND TEST EQUIPMENT.
2. NOT FOR USE WITH INSTALLED EQUIPMENT. FOR AIRCRAFT INSTALLATION COMPLY WITH MIL-C-7938 or MIL-W-5088. FOR GROUND INSTALLATION COMPLY WITH NATIONAL ELECTRIC CODE.
3. SAFETY GROUNDING - ALL SAFETY GROUND CONDUCTORS SHALL BE CONCURRENT CARRYING AND SHALL BE CONNECTED AS FOLLOWS
   a. RECEPTACLES - THROUGH THE GROUNDING TERMINAL TO AN EARTH GROUND.
   b. PLUGS - POWER CABLES - THROUGH THE GROUNDING TERMINAL AND ATTACHED TO THE EQUIPMENT FRAME
4. POWER CABLES SHALL NOT EXCEED 8 FEET IN LENGTH AND SHALL CONFORM TO -
   a. MINIMUM SIZE, CLASS RD, MIL-C-3432 OR COMMERCIAL TYPE SJO
   b. OUTDOOR USE, CLASS RD, MIL-C-3432 OR COMMERCIAL TYPE SO.
5. WIRE SIZE OF POWER CABLES SHALL BE AS FOLLOWS: #12 UP TO 20 AMP LOADS; #10 UP TO 30 AMP LOADS.
6. ALTERNATE PLUG FOR AP131H - WHEN APPROVED BY THE PROCURING ACTIVITY, A PLUG CONFORMING TO STYLE 8, MIL-C-5015 HAVING A REPLACEABLE SELF RESTORING GROUNDING BLADE MAY BE USED.
7. THIS IS A DESIGN STANDARD - NOT TO BE USED AS A PART NUMBER.
8. FOR DESIGN FEATURE PURPOSES, THIS STANDARD TAKES PRECEDENCE OVER PROCUREMENT DOCUMENTS SPECIFIED HEREIN.
9. REFERENCED DOCUMENTS SHALL BE OF THE ISSUE IN EFFECT ON DATE OF INVITATIONS FOR BIDS.
10. PLUGS AND HAND END RECEPTACLES FOR 60 Hz SERVICE SHALL BE EQUIPPED WITH HAND GRIP.

APPROVED 18 JULY 1960 REVISED

P.I. Air Force - 8	TITLE	MILITARY STANDARD
Yellow Cover	ELECTRICAL CONNECTORS FOR TEST EQUIPMENT AND GENERAL UTILITY	MS27609(USAF)
PROCUREMENT SPECIFICATION: None	REFERENCE:	SHEET 3 OF

DD FORM 672-1 (Reverse)

Source: https://assist.dla.mil -- Downloaded: 202640-23T16:45Z
Check the source to verify that this is the current version before use.