This military standard is approved for use by all Departments and Agencies of the Department of Defense. Selection for all new engineering and design applications and for repetitive use shall be made from this document.

Reviewer activities: Army - EL, MI, MU; Navy - EC, AS; Air Force - 11, 17, 80, 85; DSA - ES

User activities: Army - MO; Navy - MC, CG, OS; Air Force - 14, 19

DD FORM 1 SEP 63 672 (Coordinated) PREVIOUS EDITIONS OF THIS FORM ARE OBSOLETE.

P.A. Navy - EC
Other Cust Army-EL AF - 11

Procurement Specification MIL-C-22992

International Interest

SUPERSEDES:

TITLE CONNECTOR, RECEPTACLE, ELECTRICAL, WALL MOUNTING, (WITH COUPLING RING) CLASS L (EQUIPMENT RECEPTACLE)

MILITARY STANDARD


MS90558

PAGE 1 OF 3

5935-2059-6

FED. SUP CLASS 5935

CONTACT SIZE	Z DIA	V DIA WIRE SEALING RANGE
4/0	.614/.624	.700/.790
2/0	.520/.530	.530/.655
1/0-1	.471/.481	.457/.585
4	.339/.349	.356/.430
6	.292/.302	.300/.360

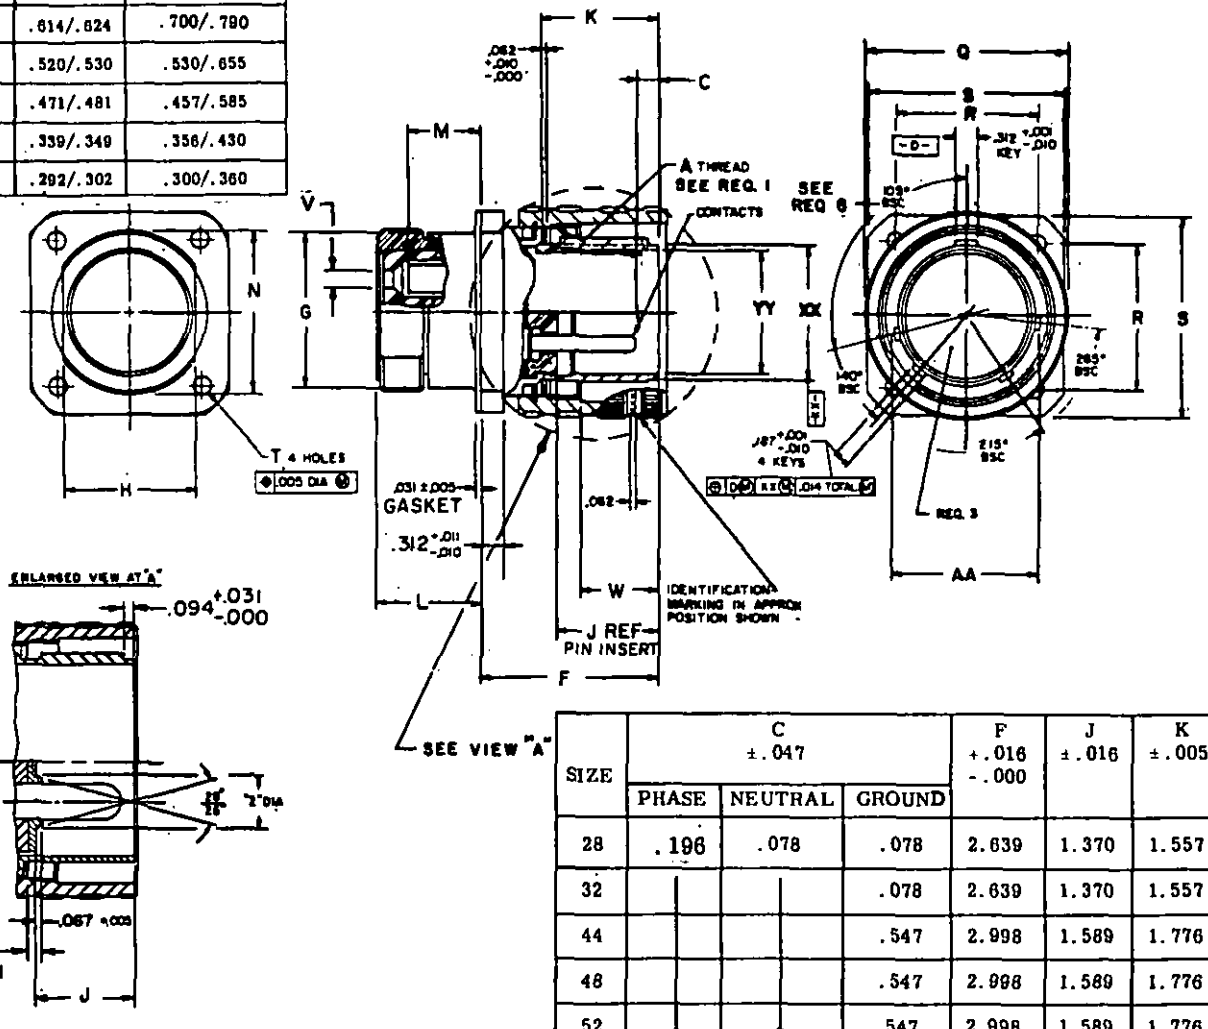

SIZE	C ±.047			F +.016 -.000	J ±.016	K ±.005	W ±.031
	PHASE	NEUTRAL	GROUND				
28	.196	.078	.078	2.639	1.370	1.557	1.062
32			.078	2.639	1.370	1.557	1.062
44			.547	2.998	1.589	1.776	1.281
48			.547	2.998	1.589	1.776	1.281
52			.547	2.998	1.589	1.776	1.281

Ⓓ FOR CHANGES SEE PAGE 3

APPROVED 1-JUNE-1966 REVISED Ⓐ 2 February 1972 Ⓑ 29-JANUARY-1973 Ⓒ 28 Aug 1974 Ⓓ 24 Feb 1976

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T20:39Z
Check the source to verify that this is the current version before use.

This military standard is approved for use by all Departments and Agencies of the Department of Defense. Selection for all new engineering and design applications and for repetitive use shall be made from this document.

Reviewer activities: Army – EL, MI, MU; Navy – EC, AS; Air Force – 11, 17, 80, 85; DSA – ES

User activities: Army – MO; Navy – MC, CG, OS; Air Force – 14, 19

DD FORM 1 SEP 63 672 (Coordinated) PREVIOUS EDITIONS OF THIS FORM ARE OBSOLETE.

Procurement Specification: MIL-C-22992

P-ANAVY-EC; Other Cust: Army-EL AF-11

International Interest

SUPERSEDES:

TITLE: CONNECTOR, RECEPTACLE, ELECTRICAL, WALL MOUNTING, (WITH COUPLING RING) CLASS L, (EQUIPMENT RECEPTACLE)


MILITARY STANDARD

MS90558

PAGE 2 OF 3

SIZE	A THREAD CLASS 2B	G DIA. +.006 -.010	H +.001 -.010	L ±.031	M ±.047	N +.011 -.020	Q DIA. MAX.	R (BSC)	S +.021 -.020	T ±.005	AA DIA. +.006 -.005	XX DIA. +.001 -.010	YY DIA. +.010 -.001
28	2.000-.1428P-.2857L	1.938	1.812	.959	.328	2.000	2.312	1.844	2.375	.177	1.672	1.522	1.370
32	2.250-.1428P-.2857L	2.188	2.062	.959	.328	2.250	2.562	2.062	2.625	.209	1.922	1.772	1.620
44	3.000-.1428P-.2857L	3.062	2.812	1.021	.390	3.125	3.531	2.812	3.375	.281	2.672	2.522	2.296
48	3.250-.1428P-.2857L	3.312	3.062	1.021	.390	3.375	3.781	3.000	3.625	.281	2.891	2.725	2.551
52	3.500-.1428P-.2857L	3.562	3.312	1.021	.390	3.625	4.016	3.156	3.875	.281	3.141	2.975	2.801

NOTES:
1. For design feature purposes, this standard takes precedence over procurement documents referenced herein.
2. Referenced documents shall be of the issue in effect on date of invitations for bid.
3. Dimensions are in inches. Unless otherwise specified tolerance is ±.016.
4. For protective cover see standard MS90564.

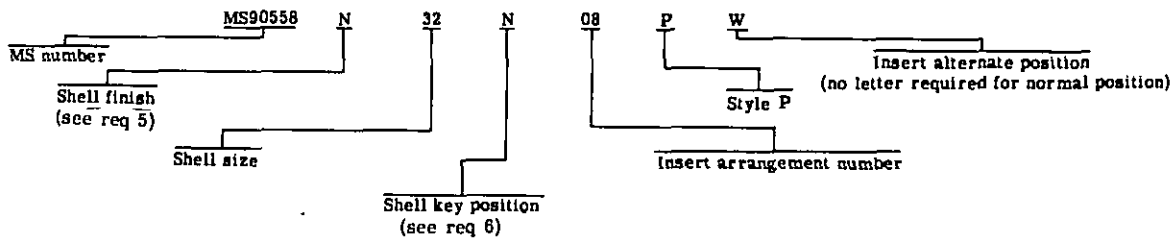

REQUIREMENTS:
1. Mates with plugs shown on standard MS90557.
2. The part number shall include the size, finish, shell key alternate position, insert arrangement number, style (P) and insert alternate position as shown in the example below.
3. Inserts and contacts are removable.
4. For final installation contacts will be assembled in all insert holes.
5. Shell and nut finish shall be designated by the letter C (conductive) or N (non-conditive).
6. Normal key position. For alternate key positions see page 3.
7. For insert arrangements see standards MS90565 thru MS90567, MS14054, MS14055 and MS14057.
8. Covers per MS90564 shall be supplied with connector.

FED. SUP CLASS 5935


APPROVED 1 June 1965 REVISED (D) FOR CHANGES SEE PAGE 3

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T20:39Z
Check the source to verify that this is the current version before use.

This military standard is approved for use by all Departments and Agencies of the Department of Defense. Selection for all new engineering and design applications and for repetitive use shall be made from this document.

Reviewer activities: Army - EL, MI, MU
Navy - EC, AS
Air Force - 11, 17, 80, 85
DSA - ES

User activities: Army - MO
Navy - MC, CG, OS
Air Force - 14, 19

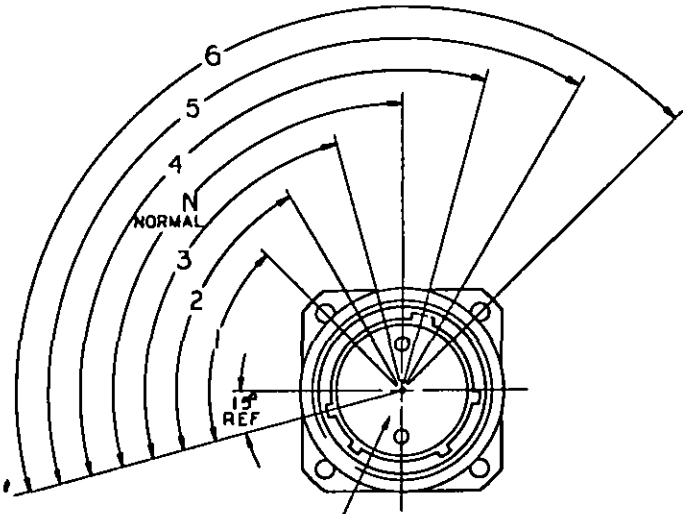

TYPICAL PIN ARRANGEMENT.
NOTE THAT INSERT ARRANGEMENT DOES NOT ROTATE WITH MAIN KEY.

NONGROUNDING ASSEMBLIES: FINISH N

SHELL SIZE	SHELL MAIN KEY POSITIONS DC 2 WIRE 28 V
28	N (105°)
32	
44	
48	
52	

GROUNDING ASSEMBLIES: FINISH C

SHELL SIZE	SHELL MAIN KEY POSITIONS						
	60 Hz & 400 Hz (SEE NOTE 1) (D)						3 ø (SEE NOTE 2)
	1 ø			3 ø			
	2 WIRE		3 WIRE	4 WIRE			3 WIRE
	120 V	240 V	120/240 V	120/208 V	240/416 V	277/480 V	450/480 V
28	4 (120°)	5 (135°)	4 (120°)	4 (120°)	5 (135°)	6 (150°)	
32							
44							1 (60°)
48							
52							

NOTES:
1. Discrimination of 60 Hz & 400 Hz assemblies is accomplished by alternate positioning (D) of inserts. See applicable insert drawing for keying.
2. For Navy ground support equipment use only. Arrangements 44-51, 44-52 and 44-56 are not applicable.
3. Shell main key positions 2 and 3 not used.

APPROVED 1 June 1966 REVISED (D) FOR CHANGES SEE PAGE 3

P.A. NAVY - EC Other Cust ARMY - EL AF - 11	International Interest	TITLE CONNECTOR, RECEPTACLE, ELECTRICAL, WALL MOUNTING, (WITH COUPLING RING) CLASS L, (EQUIPMENT RECEPTACLE)	MILITARY STANDARD MS 90558
Procurement Specification MIL-C-32992		SUPERSEDES:	PAGE 3 OF 3

DD FORM 1 SEP 63 672 (Coordinated) PREVIOUS EDITIONS OF THIS FORM ARE OBSOLETE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T20:39Z
Check the source to verify that this is the current version before use.