INCH-POUND
MIL-PRF-32770
w/AMENDMENT 1
25 September 2026
SUPERSEDING
MIL-PRF-32770
11 June 2024

PERFORMANCE SPECIFICATION

CONDUIT, METAL, FLEXIBLE - FOR LOW FREQUENCY ELECTROMAGNETIC SHIELDING APPLICATIONS

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers flexible metal conduit for low frequency electromagnetic shielding applications (see 6.1). This specification is intended to be a companion document for NAVSEA S9407-AB-HBK-010, Handbook of Shipboard Electromagnetic Shielding Practices.

1.2 Classification. Flexible metal conduit is of the following types, as specified (see 6.2):

a. Type I – Non-jacketed shielding conduit

b. Type II – Rubber-jacketed shielding conduit

1.3 Part or identifying number (PIN). The PIN for qualified conduit acquired in accordance with this specification is created as follows:

M	**32770**	-	**XX**	**X**
Prefix for Military Specification	Specification Number		Size (see code below)	Type (see code below)

Comments, suggestions, or questions on this document should be addressed to Commander, Naval Sea Systems Command, ATTN: SEA 05T, 1333 Isaac Hull Avenue, SE, Stop 5160, Washington Navy Yard, DC 20376-5160 or emailed to CommandStandards@navy.mil, with the subject line "Document Comment". Since contact information can change, you may want to verify the currency of this address information using ASSIST at https://assist.dla.mil.

AMSC N/A FSC 5975

DISTRIBUTION STATEMENT A. Approved for public release: distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

Size	Code
¼	02
⅜	03
½	04
⅝	05
¾	06
1	08
1¼	10
1½	12
2	16
2½	20
3	24

Type	Code
I	No letter
II	R

Examples: PIN M32770-06R is for a ¾-inch, rubber-jacketed conduit.
PIN M32770-03 is for a ⅜-inch, non-jacketed conduit.

2. APPLICABLE PUBLICATIONS

2.1 General. The publications listed in this section are specified in sections 3 and 4 of this specification. This section does not include publications cited in other sections of this specification or recommended for additional information or as examples. While every effort has been made to ensure the completeness of this list, document users are cautioned that they must meet all specified requirements of publications cited in sections 3 and 4 of this specification, whether or not they are listed.

2.2 Government publications.

2.2.1 Specifications, standards, and handbooks. The following specifications, standards, and handbooks form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these publications are those cited in the solicitation or contract.

DEPARTMENT OF DEFENSE SPECIFICATIONS

MIL-PRF-6855 - Rubber, Synthetic, Sheets, Strips, Molded or Extruded Shapes, General Specification for

MIL-PRF-24758 - Conduit Systems, Flexible, Weatherproof

MIL-PRF-46846 - Rubber, Synthetic, Heat - Shrinkable

(Copies of these publications are available online at https://quicksearch.dla.mil.)

2.2.2 Other Government publications. The following other Government publications form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these publications are those cited in the solicitation or contract.

NAVAL SEA SYSTEMS COMMAND (NAVSEA) PUBLICATIONS

S9407-AB-HBK-010 - Handbook of Shipboard Electromagnetic Shielding Practices

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

(Copies of this publication are available online via Model Based Product Support (MBPS) at https://mbps.navsea.cloud.navy.mil/Windchill. To gain access to MBPS, submit a ticket to the ServiceNow Assistance Portal (SNAP), https://snap.navair.navy.mil/mbps (DoD PKI Certificate required). Refer questions, inquiries, or problems to (888) 292-5919. This publication is available for ordering (hard copy) via the Naval Logistics Library (NLL) at https://nll.navsup.navy.mil. For questions regarding the NLL, contact the NLL Customer Service at nllhelpdesk@navy.mil, (866) 817-3130, or (215) 697-2626/DSN 442-2626.)

2.3 Non-Government publications. The following publications form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these publications are those cited in the solicitation or contract.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI/NEMA IM 60000 - Industrial Laminated Thermosetting Products

(Copies of this publication are available online at www.ansi.org.)

AMERICAN WELDING SOCIETY (AWS)

AWS A5.8 - Specification for Filler Metals for Brazing and Braze Welding

(Copies of this publication are available online at www.aws.org.)

ASTM INTERNATIONAL

ASTM A698/A698M - Standard Test Method for Magnetic Shield Efficiency in Attenuating Alternating Magnetic Fields

ASTM A753 - Standard Specification for Wrought Nickel-Iron Soft Magnetic Alloys (UNS K94490, K94840, N14076, N14080)

ASTM D257 - Standard Test Methods for DC Resistance or Conductance of Insulating Materials

(Copies of these publications are available online at www.astm.org.)

SAE INTERNATIONAL

SAE AS23053 - Insulation Sleeving, Electrical, Heat Shrinkable, General Specification for

SAE AMS-QQ-S-763 - Steel, Corrosion Resistant, Bars, Wire, Shapes, and Forgings

(Copies of these publications are available online at www.sae.org.)

2.4 Order of precedence. Unless otherwise noted herein or in the contract, in the event of a conflict between the text of this document and the references cited herein, the text of this document takes precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

3. REQUIREMENTS

3.1 Qualification. Flexible metal conduits furnished under this specification shall be products that are authorized by the qualifying activity for listing on the applicable qualified products list before contract award (see 4.2 and 6.3).

3.2 Design and construction. Type I conduit (figure 1, diagram A) shall consist of metal tubing covered with a wire overbraid. The tubing material shall be an alloy having high magnetic permeability for electromagnetic shielding requirements and shall be corrosion-resistant for environmental requirements. Construction of the tubing shall be in the form of helical or annular convolutes for flexibility. Seams in the tubing shall be hermetically sealed for water tightness and shielding integrity. The outer braid covering shall be of steel wire for mechanical protection of the tubing. Type II conduit (figure 1, diagram B) shall consist of type I conduit that is covered with a jacket of synthetic rubber for electrical insulation and marked on the outside with identification information.

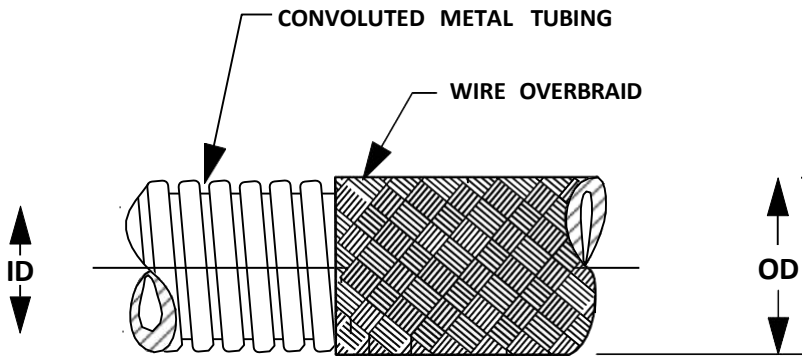


Diagram A. Type I conduit.

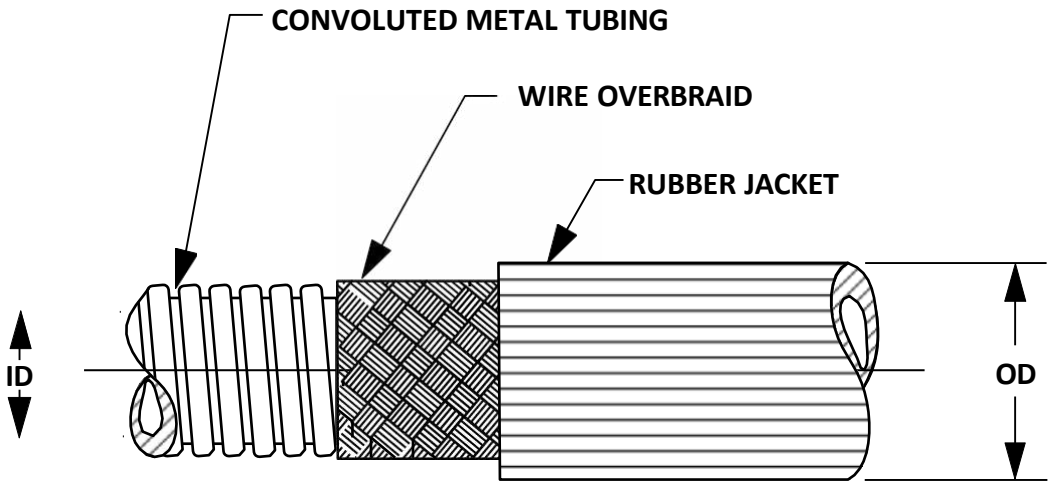


Diagram B. Type II conduit.

FIGURE 1. Conduit configuration.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

3.3 Materials. Materials shall conform to applicable standards and be as specified herein.

3.3.1 Tubing and coupling ring material. Material for the tubing and the coupling ring used for joining lengths of tubing shall be an alloy having high magnetic permeability and corrosion-resistant properties, such as provided by alloy type 4 of ASTM A753. Typical trade names for this alloy include Hipernom, HyMu “80”, and Moly Permalloy.

3.3.2 Annealing of tubing material. All conduit tubing shall be annealed in accordance with standard practice in order to develop magnetic shielding properties necessary to meet the shielding effectiveness requirements of 3.5.3.

3.3.3 Seam interlock material. Seam sealing material, if used for hermetically sealing the tubing convolutions, shall be in accordance with the requirements of AWS A5.8, class BCu-1.

3.3.4 Braid material. Braid for both type I and type II conduit shall be made of stainless steel wire class 304 or 321 in accordance with SAE AMS-QQ-S-763.

3.3.5 Jacket material. The jacket for type II conduit shall be of synthetic rubber (polychloroprene) in accordance with class 2A, grade 60 of MIL-PRF-6855 or equivalent material conforming to MIL-PRF-24758. The material shall have a minimum volume resistivity of 1 × 109 ohm-centimeter as determined by ASTM D257.

3.3.6 Heat-shrinkable tubing. Heat-shrinkable tubing, when used to cover splices in rubber jackets, shall be of polychloroprene in accordance with class 1 of SAE AS23053 or type I, class 1 of MIL-PRF-46846.

3.3.7 Recycled, recovered, environmentally preferable, or biobased materials. Recycled, recovered, environmentally preferable, or biobased materials should be used to the maximum extent possible, provided that the material meets or exceeds the operational and maintenance requirements, and promotes economically advantageous life cycle costs.

3.4 Physical characteristics.

3.4.1 Sizes and dimensions. The nominal sizes, inside diameters (ID), and outside diameters (OD), shall be as specified in table I.

TABLE I. Conduit dimensions (inches).

Conduit size (nominal)	ID (min)	Type I (non-jacketed)	Type II (jacketed)	Minimum bend radius (inside)
		OD (over braid)	OD (over braid)	
¼	0.245	0.42±0.01	0.58±0.04	1¼
⅜	0.370	0.54±0.01	0.70±0.04	2
½	0.495	0.69±0.01	0.85±0.04	2½
⅝	0.620	0.82±0.01	0.98±0.04	3
¾	0.745	0.94±0.01	1.10±0.04	3¾
1	0.995	1.25±0.01	1.41±0.04	5
1¼	1.245	1.50±0.01	1.66±0.04	6¼
1½	1.495	1.75±0.01	1.91±0.04	7½
2	1.995	2.28±0.015	2.44±0.045	10
2½	2.495	2.78±0.015	2.94±0.045	12½
3	2.995	3.28±0.015	3.44±0.045	15

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

3.4.2 Lengths. Conduit shall be furnished in the length or lengths specified (see 6.2).

3.4.3 Seams and joints. Seams in the metal tubing shall be welded or brazed, and there shall be no reduction of the ID or increase of OD due to such welding or brazing. Joints (or splices) in the metal tubing shall be welded or brazed, and there shall be no increase in the OD due to such welding or brazing. The coupling ring used for joining lengths of tubing shall not reduce the ID at the joint more than 0.028 inch (maximum wall thickness of coupling ring inside the tubing shall be 0.014 inch). Material for the coupling ring shall be as specified in 3.3.1. Seams and joints shall meet the requirements for inner surfaces specified in 3.4.4 and for watertightness specified in 3.5.1.

3.4.4 Inner surfaces. The metal tubing shall have smooth inner surfaces free of sharp burrs or edges that could abrade cable insulation. The interior shall be free of particles of organic or metallic material that could contaminate or degrade cable insulation or be potentially corrosive.

3.4.5 Braid. The braid shall be woven from stainless steel wire as specified in 3.3.4. The braid shall be applied with sufficient tension so that there will be no looseness or bunching of the braid on the tubing. The braid shall provide a coverage of at least 90 percent of the tubing, as determined by the method in 4.4.3. Unless otherwise specified (see 6.2), only one layer of braid shall be applied.

3.4.6 Rubber jacket. The rubber jacket for type II conduit shall be of a uniform thickness and free from pitting and shall be applied with sufficient stretch around the circumference of the conduit to maintain a tight fit over the conduit braid. The wall thickness for the rubber jacket shall be 0.080±0.015 inch for all conduit sizes.

3.4.7 Splices. Two lengths of metal tubing shall be spliced (or joined) as specified in 3.4.3. Splices in braid wires shall be neatly made and shall cause no sharp or rough projection on the conduit. As specified (see 6.2), splices in the rubber jacket may be made either by a 3-inch (minimum) overlap, or by means of a butt joint that is covered with a 6-inch (minimum) length of heat-shrinkable polychloroprene tubing (see 3.3.6).

3.4.8 Ends. The ends of each length of conduit shall be cut square, with the ends of the braid wires secured to the tubing by brazing. Each end of the conduit shall be free from sharp edges, burrs, or excess brazing material that would interfere with the attachment of fittings.

3.5 Performance characteristics.

3.5.1 Watertightness. Conduit shall show no evidence of leakage or damage to the tubing when tested as specified in 4.5.1.

3.5.2 Bend radius. When tested as specified in 4.5.2, type I and type II conduit shall withstand bending in an arc of radius equal to that specified in table I and shall show no evidence of internal obstruction or damage, of any kind, to the tubing as a result of the test. Type II conduit shall, in addition, show minimum wrinkling of the rubber jacket on the inside of the bend when bent to the prescribed radius.

3.5.3 Shielding effectiveness. Shielding effectiveness throughout the frequency range of 30 hertz to 30 kilohertz shall be a minimum of 40 decibels for all conduit less than 2 inches in diameter and a minimum of 35 decibels for 2-inch diameter conduit and larger when tested as specified in 4.5.3.

3.6 Marking. The rubber jacket of type II conduit shall be marked with an identifying legend printed with white ink in block character type. The size of this lettering shall be not less than ⅛-inch and not greater than ¼ inch. The legend shall consist of the wording “EMI SHIELDING CONDUIT,” the conduit part number (see 1.3), and the manufacturer’s name. The following is an example of the legend:

EMI SHIELDING CONDUIT – M32770-06R - (manufacturer’s name)

The legend shall be repeated at intervals not exceeding 2 feet. The print shall not be obliterated by the action of petroleum base oil, fuels, hydraulic fluids, or water, and shall remain legible after abrasion caused by normal handling of the conduit.

3.7 Identification characteristics. The manufacturer’s technical data shall be furnished as specified (see 6.2).

3.8 Workmanship. All details of manufacture shall be in accordance with best practice for flexible metal conduit. The conduit shall be free from all defects that would adversely affect its serviceability.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

4. VERIFICATION

4.1 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. Qualification inspection (see 4.2).

b. Conformance inspection (see 4.3).

4.2 Qualification inspection. Qualification inspection shall include the examinations and tests specified in table II, in the order shown.

TABLE II. Qualification inspection.

Inspection	Requirement	Verification
Visual 1/	3.3, 3.4, 3.6, 3.8	4.4.1
Dimensional 1/	3.4.1	4.4.2
Watertightness 1/	3.5.1	4.5.1
Visual 2/	3.3, 3.4, 3.6, 3.7, 3.8	4.4.1
Dimensional 2/	3.4.1	4.4.2
Braid tightness and coverage 2/	3.4.5	4.4.3
Tightness of coverage 2/	3.4.6	4.4.4
Bend radius	3.5.2	4.5.2
Shielding effectiveness	3.5.3	4.5.3

1/ Inspection shall be performed on each length of bare tubing prior to application of braid.

2/ Inspection shall be performed on each length of completed conduit for both type I and type II.

4.2.1 Qualification test sample. In testing for qualification, a test sample consisting of a single length of conduit with ends treated as specified in 3.4.8 shall be prepared for each size and type that is to be qualified. See 4.2.3 for exceptions. The length of the test sample shall be 4 feet for conduit less than 2 inches in diameter, 6 feet for 2-inch and 2½-inch diameter, and 8 feet for 3-inch diameter conduit.

4.2.2 Failure. Failure to meet the requirements specified herein shall be cause for disapproval of or removal of product qualification.

4.2.3 Qualification of similar conduit. Qualification of a manufacturer's type II conduit will automatically constitute qualification of that manufacturer's type I conduit of the same size provided that the construction, manufacturing process, and materials (excluding the rubber jacket) are identical in both cases.

4.3 Conformance inspection. An initial production sample from each production lot shall be tested by the supplier for conformance with specification requirements prior to regular production on a contract. The supplier shall perform a conformance inspection at the time of production on each production lot (see 4.3.1) manufactured under this specification to prove compliance with applicable requirements. Conformance inspection shall include the examinations and tests specified in table III, in the order shown.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

TABLE III. Conformance inspection.

Inspection	Requirement	Verification
Visual 1/	3.3, 3.4, 3.6, 3.8	4.4.1
Visual 2/	3.3, 3.4, 3.6, 3.7, 3.8	4.4.1
1/ Inspection shall be performed on each length of bare tubing prior to application of braid. 2/ Inspection shall be performed on each length of completed conduit for both type I and type II.		

4.3.1 Production lot. Conduit of one size and type and manufactured from the same materials under essentially the same conditions during an identifiable production period shall be considered a production lot. The manufacturer shall assign a lot number to each production lot for identification purposes.

4.4 Examinations. Visual and dimensional examinations shall be made on each length of bare tubing and on the completed conduit specified in 4.4.1, 4.4.2, 4.4.3, and 4.4.4. Any defects or failure to meet the requirements specified in 3.3, 3.4, 3.6, and 3.8 shall be corrected or shall be cause for rejection.

4.4.1 Visual. Convoluted tubing shall be inspected prior to application of braid to verify that there are no gaps, cracks, breaks, or other defects in material, construction, or workmanship. Completed conduit shall be inspected to ensure that there are no defects in material, construction, or workmanship. When specified (see 6.2), verification of materials shall consist of certification that the materials and annealing process listed in table IV were used in fabricating the completed flexible conduit.

TABLE IV. Materials verification.

Material or process	Requirement	Applicable specification(s)
Tubing and coupling ring	3.3.1	ASTM A753, alloy type 4
Annealing	3.3.2	In accordance with standard practice
Seam interlock material	3.3.3	AWS A58, class BCu-1
Braid	3.3.4	SAE AMS-QQ-S-763, class 304 or 321
Jacket	3.3.5	MIL-PRF-6855, class 2A, grade 60
Heat-shrinkable tubing	3.3.6	SAE AS23053, class 1 or MIL-PRF-46846, type I, class 1

4.4.2 Dimensional. Measurements shall be made on the conduit to determine compliance with dimensional requirements. Any dimension that is not within the specified tolerance shall be classified a defect.

4.4.3 Braid coverage. The coverage of the wire braid shall be determined by measuring at three widely separated areas of a length of conduit. The areas measured shall be representative of the entire braid. Figure 2 shows a typical section of braid, with a unit area having dimensions C and D. The uncovered portion of the unit area is shown by dimensions A and B. The percent of braid coverage shall be computed by using the formula below and shall equal a minimum of 90 percent.

$$\text{Percent of braid coverage} = 100(1-AB/CD)$$

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

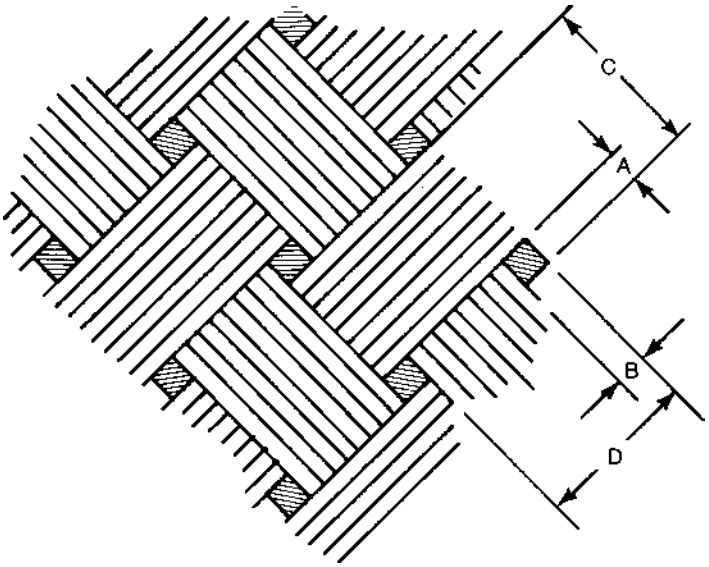


FIGURE 2. Typical braid section.

4.4.4 Tightness of covering. Type I and type II conduit shall be visually inspected to verify that the wire braid has a tight fit over the tubing. Type II conduit shall also be visually inspected to verify that the rubber jacket has a tight fit over the wire braid

4.5 Test methods.

4.5.1 Watertightness. Watertight integrity shall be determined by a pressure test on bare tubing (i.e., conduit without braid and jacket coverings). This test shall be performed on each and every length manufactured under this specification. The tubing ends shall be capped and sealed. The capped tubing shall then be pressurized internally to 15 psig with air and shall be fully immersed in water. There shall be no visible air leakage from the tubing. If any section of the conduit fails to pass this test, that section shall be rejected and any remaining conduit can be deemed acceptable only if it can be demonstrated by test that all of it is in compliance with requirements.

4.5.2 Bend radius. The braid ends shall be brazed to the tubing as specified in 3.4.8. Type II conduit samples shall be tested with their rubber jacket. One end of the sample shall be fastened tangentially to a cylindrical mandrel that is mounted with its axis horizontal (see figure 3, diagram A). The radius of the mandrel shall be as specified in table V. The conduit sample shall hang vertically, and the test load specified in table V shall be attached to its lower end. The mandrel shall be rotated 270 degrees to the position shown on figure 3, diagram B. The conduit shall be in contact with the mandrel over a typical 180-degree sector (see figure 3, diagram B). Failure of the conduit to come within $\frac{1}{16}$ inch of the mandrel at any point along its curvature over the 180-degree sector shall constitute cause for rejection of the sample.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

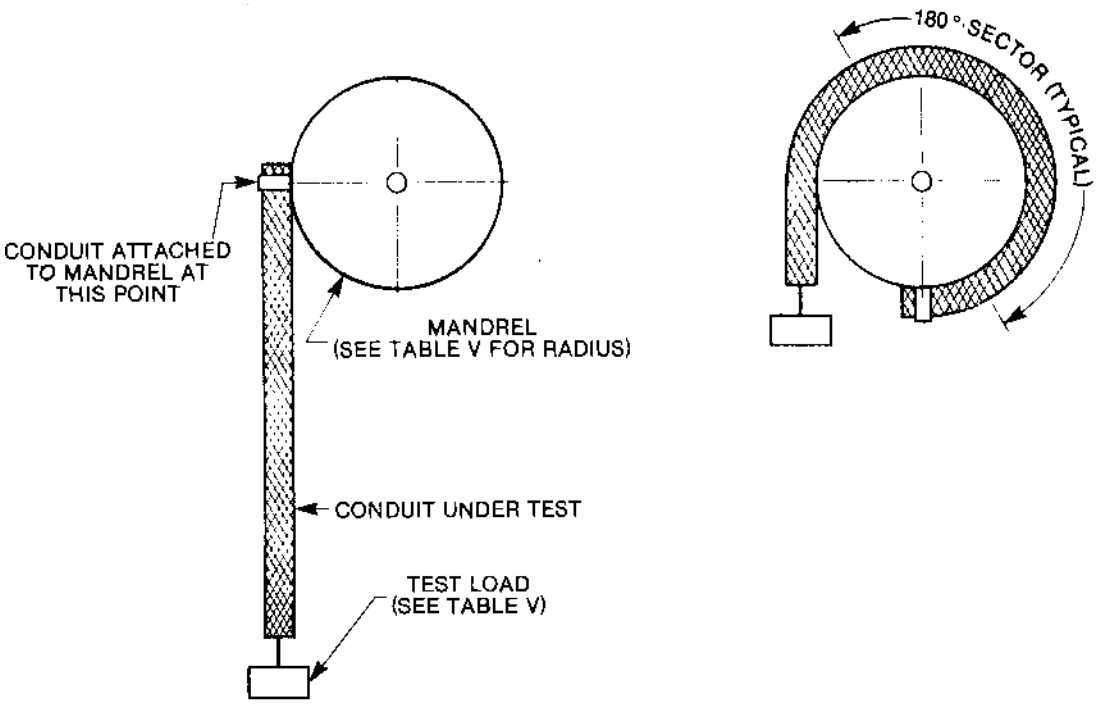


Diagram A. Conduit at start of test. Diagram B. Conduit after 270-degree mandrel rotation.

FIGURE 3. Bend-radius test setup.

TABLE V. Data for bend-radius test.

Conduit test sample		Test load		Mandrel radius (inches)
Size (inches) (nominal ID)	Length (feet)	Type I conduit	Type II conduit	
¼	4	½	½	1¼
⅜	4	½	½	2
½	4	½	½	2½
⅝	4	½	½	3
¾	4	½	½	3¾
1	4	½	1	5
1¼	4	1	1½	6¼
1½	4	1½	2	7½
2	6	2	2	10
2½	6	3	3	12½
3	8	5	5	15

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

4.5.3 Shielding effectiveness. After completion of the bend-radius test of 4.5.2, the sample, with braid ends brazed to the tubing as specified in 3.4.8, shall be subjected to two bend cycles, where one bend cycle entails bending the center section through a 90-degree arc over the mandrel of 4.5.2, straightening it, bending the center section 90 degrees in the opposite direction over the same mandrel and straightening it to complete the cycle. The sample shall then be tested for effectiveness of shielding against a transverse magnetic field having a field intensity of 1 oersted over the frequency range of 30 hertz to 30 kilohertz. The test method shall be in accordance with ASTM A698/A698M, with the following exceptions:

a. The ID of each Helmholtz coil section shall be at least 35 centimeters (13.78 inches).

b. The center section of the conduit shall be symmetrically positioned between coil sections with its axis in the plane of the coils and with its ends extending out straight and beyond the coil sections.

c. The pickup coil shall be designed to fit inside the long tubular shape of the conduit. The coil shall operate over the frequency range of 30 hertz to 30 kilohertz. Figure 4 shows the design of such a coil with typical dimensions suitable for use with conduit as small as ¼ inch.

d. The production lot shielding effectiveness test shall be conducted for at least one frequency. The frequency selected is optional to the supplier but shall be a frequency between 30 and 100 hertz.

Note: Particular care should be taken to maintain the plane of the pickup parallel to the planes of the helmholtz coil sections. Steel end caps may be required on the test sample (particularly on the larger sizes) to preclude flux leakage into the open ends of the conduit.

Any failure of the test sample to meet the shielding effectiveness requirement shall be cause for rejection of the sample.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

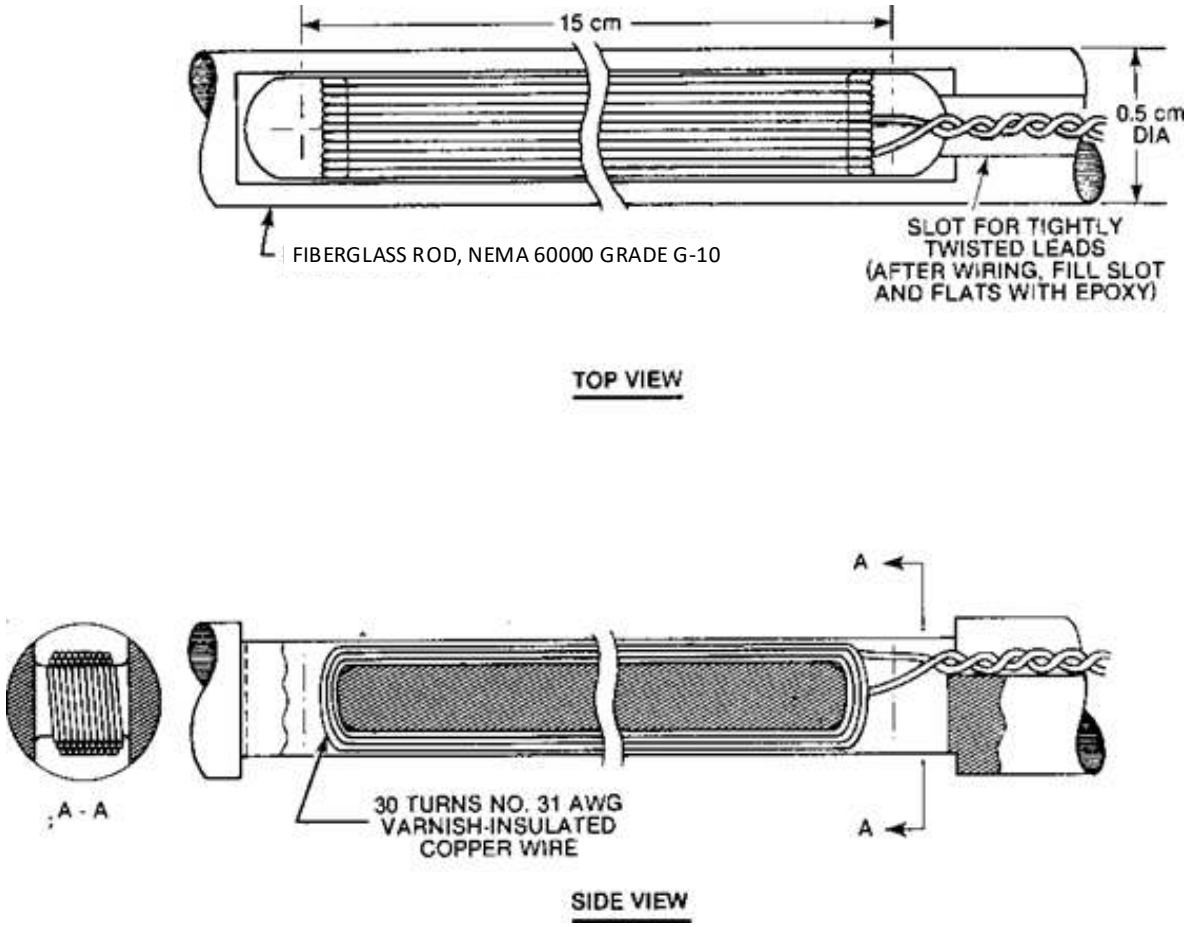


FIGURE 4. Typical pickup coil.

5. PACKAGING

5.1 Packaging. For acquisition purposes, the packaging requirements shall be as specified in the contract or order (see 6.2). When packaging of materiel is to be performed by DoD or in-house contractor personnel, these personnel need to contact the responsible packaging activity to ascertain packaging requirements. Packaging requirements are maintained by the Inventory Control Point's packaging activities within the Military Service or Defense Agency, or within the military service's system commands. Packaging data retrieval is available from the managing Military Department's or Defense Agency's automated packaging files, CD-ROM products, or by contacting the responsible packaging activity.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful but is not mandatory.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

6.1 Intended use. The purpose of this conduit is to shield low-level signal cables from the influence of external magnetic fields. It can also be used, within saturation limits of the conduit material, to reduce magnetic field radiation from power and transmitting cables. Magnetic field interference is an issue unique to submarines where space is limited, preventing interference mitigation by cable separation. Commercially available products are not shielded for low-frequency interference. The primary frequencies of interest are those below 100 kilohertz.

6.1.1 Type I conduit. Type I non-jacketed conduit is used in installations where ground or structureborne currents are minimal along the path of the conduit or where the cable being shielded is not susceptible to interference from current flow along the conduit. (Conduit can become a conductor for ground or structureborne currents through contacts with ground potentials along the length of the conduit.)

6.1.2 Type II conduit. Type II conduit is used for shielding an extremely low-level signal cable that would be susceptible to interference from current flowing along the conduit. The rubber jacket prevents this current flow by electrically insulating the conduit from unintentional ground contacts.

6.1.3 Backwards compatibility. Conduits procured to this specification are form, fit, and function replacement for flexible metal conduits specified in S9407-AB-HBK-010, Revision 2, Change 2. Existing stock of flexible metal conduits manufactured to S9407-AB-HBK-010, Revision 2, Change 2, dated 02 February 2010, is acceptable for use until depleted.

6.2 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of this specification.

b. Type of conduit to be furnished (see 1.2).

c. Conduit size (nominal ID per table I) (see 3.4.1).

d. Length(s), and tolerances, if required (see 3.4.2).

e. Braid layer requirements if other than specified (see 3.4.5).

f. Type of splice in rubber jacket (specify, if necessary, either overlap or butt joint, see 3.4.7).

g. Requirement for manufacturer's technical data including the lot number, PIN, dimensions with tolerances, weight per foot, materials, and marking information (see 3.7).

h. Verification of materials (see 4.4.1).

i. Packaging requirements (see 5.1).

6.3 Qualification. With respect to products requiring qualification, awards will be made only for products which are, at the time of award of contract, qualified for inclusion in Qualified Products List QPL No. 32770 whether or not such products have actually been so listed by that date. The attention of the contractors is called to these requirements, and manufacturers are urged to arrange to have the products that they propose to offer to the Federal Government tested for qualification in order that they may be eligible to be awarded contracts or orders for the products covered by this specification. Information pertaining to qualification of products may be obtained from Commander, Naval Sea Systems Command, ATTN: SEA 05T, 1333 Isaac Hull Avenue, SE, Stop 5160, Washington Navy Yard, DC 20376-5160 or emailed to CommandStandards@navy.mil. An online listing of products qualified to this specification may be found in the Qualified Products Database (QPD) at https://assist.dla.mil.

6.4 Subject term (key word) listing.

Cable Shielding
Magnetic Field Shielding
Submarine Magnetic Shielding

6.5 Amendment notations. The margins of this specification are marked with vertical lines to indicate modifications generated by this amendment. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.

CONCLUDING MATERIAL

Custodians:
Army – AV
Navy – SH
Air Force – 99
DLA – GS

Review activities:
Army – CR, MI
Navy – AS, CG, YD
Air Force – 03, 11, 19, 84, 85
DLA – GS6

Civil agency:
GSA – FAS

Preparing activity:
Navy – SH
(Project 5975-2026-005)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using ASSIST at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-21T07:43Z
Check the source to verify that this is the current version before use.