INCH-POUND

MIL-F-11712F
26 September 1990
SUPERSEDING
MIL-F-11712E
18 September 1973

MILITARY SPECIFICATION

FLOODLIGHTS, ELECTRIC: UTILITY TYPE, PORCELAIN-COVERED STEEL OR ALUMINUM, BRACKET-MOUNTED, WEATHERPROOF, WITH OR WITHOUT LENS

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers circular and elliptical-shaped floodlights with aluminum or porcelain-covered steel reflectors, which are bracket-mounted and weatherproof, and are provided with or without a convex lens.

1.2 Classification. Floodlights covered by this specification shall be of the following types, reflector materials, inner auxiliary reflector options, and lens options, as specified (see 6.2).

1.2.1 Floodlight type. The type of floodlight shall be designated as follows:

I	- Wide beam, 200- to 300-watt, circular.
II	- Narrow beam, 500-watt, circular.
III	- Elliptical, 300- to 500-watt.
IV	- Elliptical, 750- to 1,500-watt.
V	- Wide beam, 750- to 1,000-watt, circular.

1.2.2 Reflector material. The reflector material shall be designated as follows:

S	- Steel reflector (see 3.4 and 3.4.1).
A	- Aluminum reflector (see 3.4 and 3.4.2).

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: USA Belvoir Research, Development, and Engineering Center, ATTN: STRBE-TSE, Fort Belvoir, VA 22060-5606 by using the self-addressed Standardization Document Improvement proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 6230
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

4.4 Characters. Mode 1 operation shall use three generic character types: data

1.2.3 Inner auxiliary reflector option. The option of an inner auxiliary reflector shall be designated as follows:

Y	- Inner auxiliary reflector included with elliptical/reflector (see 3.4 and 3.4.3).
N	- Inner auxiliary reflector not included with elliptical reflector.
NA	- Inner auxiliary reflector not applicable.

1.2.4 Lens option. The option of a lens shall be designated as follows:

D	- Diffusing lens included (see 3.5).
S	- Spreading lens included (see 3.5).
N	- Lens not included.
NA	- Lens not applicable.

1.3 Part or identifying number (PIN). A specification-based PIN shall be included to identify the floodlight type, reflector material, inner auxiliary reflector option, and lens option for floodlights (see 6.2 and 6.6).

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and standards form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these documents are those listed in the issue of the Department of Defense Index of Specifications and Standards (DODISS) and supplement thereto, cited in the solicitation (see 6.2).

SPECIFICATIONS

FEDERAL

W-C-596	- Connector, Plug, Receptacle and Cable Outlet, Electrical Power General Specification For.
QQ-A-250/2	- Aluminum Alloy 3003, Plate and Sheet.
QQ-A-601	- Aluminum Alloy Sand Castings.
QQ-P-416	- Plating, Cadmium (Electrodeposited).
PPP-B-601	- Boxes, Wood, Cleated-Plywood.
PPP-B-636	- Boxes, Shipping, Fiberboard.

MILITARY

MIL-P-116	- Preservation, Methods of.
MIL-P-514	- Plates, Identification, Instruction and Marking, Blank.
MIL-T-704	- Treatment and Painting of Materiel.
MIL-F-3222	- Packaging of Floodlights and Lanterns.
MIL-C-3432	- Cable, (Power and Special Purpose) and Wire, Electrical (300 and 600 Volts).
MIL-A-8625	- Anodic Coatings, for Aluminum and Aluminum Alloys.

Source: https://assist.dla.mil -- Downloaded: 202610-17T21:53Z
Check the source to verify that this is the current version before use.

STANDARDS

FEDERAL

FED-STD-595	- Colors.

MILITARY

MIL-STD-105	- Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129	- Marking for Shipment and Storage.
MIL-STD-130	- Identification Marking of US Military Property.
MIL-STD-889	- Dissimilar Metals.

(Unless otherwise indicated, copies of federal and military specifications, standards, and handbooks are available from the Standardization Documents Order Desk, Building 4D, 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

2.1.2 Other Government drawings. The following Government drawings form a part of this document to the extent specified herein. Unless otherwise specified, the issues are those in effect on the date of the solicitation..

DRAWING

ME

TA13208E4159	- Floodlight, Electric.

(Copies of drawings required by contractors in connection with specific acquisition functions should be obtained from the USA Belvoir Research, Development, and Engineering Center, ATTN: STRBE-FG, Fort Belvoir, VA 22060-5606.)

2.2 Non-Government publications. The following document(s) form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DoD adopted are those listed in the issue of the DODISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issues of the documents cited in the solicitation (see 6.2).

AMERICAN SOCIETY FOR TESTING AND MATERIALS

ASTM A 27	- Steel Castings, Carbon, for General Application.
ASTM A 148	- Steel Castings, High Strength, for Structural Purposes.
ASTM A 424	- Steel Sheets for Porcelain Enameling.
ASTM B 633	- Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel.

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

SOCIETY OF AUTOMOTIVE ENGINEERS (SAE)

SAE J964 - Test Procedure for Determining Reflectivity of Rear View Mirrors.

(Application for copies should be addressed to the Society of Automotive Engineers, Incorporated, 400 Commonwealth Drive, Warrendale, PA 15096.)

UNDERWRITERS LABORATORIES, INC. (UL)

UL 57 - Fixtures, Electrical Lighting.
UL 153 - Lamps, Portable, Electric.

(Application for copies should be addressed to the Underwriters Laboratories, Inc., Publications Stock, 333 Pfingsten Road, Northbrook, IL 60062.)

(Non-Government standards and other publications are normally available from the organizations that prepare or distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of a conflict between the text of this specification and the references cited herein, the text of this specification shall take precedence. Nothing in this specification, however, shall supersede applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 Description. The floodlights shall consist of a reflector, hood, lampholder, and an adjustable mounting bracket. The floodlights shall comply with all the requirements of UL 57 and UL 153 for Electric Lighting Fixtures and Electric Portable Lamps. The floodlights shall be in accordance with TA13208E4159 and as specified herein. The power source shall be 108-120 Volt, 60 Hertz (Hz).

3.1.1 Drawings. The drawing forming a part of this specification is an end product drawing. No deviation from the prescribed dimensions or tolerances is permissible without prior approval of the contracting officer. Any data (e.g., shop drawings, layouts, flow sheets, processing procedures, etc.) prepared by the supplier or obtained from a vendor to support fabrication and manufacture of the production item shall be made available, upon request, for inspection by the contracting officer or his designated representative.

3.2 First article. Unless otherwise specified (see 6.2), a sample shall be subjected to first article inspection (see 6.4) in accordance with 4.3.

3.3 Materials. Materials shall be as specified herein and on the applicable drawings. Materials not specified shall be selected by the contractor and shall be subject to all provisions of this specification (see 4.1.2).

3.3.1 Material deterioration prevention and control. The floodlights shall be fabricated from compatible materials, inherently corrosion resistant or treated to provide protection against the various forms of corrosion and deterioration that may be encountered in any of the applicable operating and storage environments to which the floodlights may be exposed.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

3.3.1.1 Dissimilar metals. Dissimilar metals shall not be used in intimate contact with each other unless protected against galvanic corrosion. Dissimilar metals and methods of protection are defined and detailed in MIL-STD-889.

3.3.1.2 Identification of materials and finishes. The contractor shall identify the specific material, material finish or treatment for use with component and subcomponent, and shall make information available upon request to the contracting officer or designated representative.

3.3.2 Recovered materials. For the purpose of this requirement, recovered materials are those materials which have been collected from solid waste and reprocessed to become a source of raw materials, as distinguished from virgin raw materials. The components, pieces and parts incorporated in the floodlights may be newly fabricated from recovered materials to the maximum extent practicable, provided the floodlights produced meet all other requirements of this specification. Used, rebuilt or remanufactured components, pieces and parts shall not be incorporated in the floodlights.

3.4 Reflectors. Reflectors for floodlight types I, II, III, and IV shall be either porcelain-enameled steel or anodized aluminum, and the type V shall be anodized aluminum. All aluminum components shall be anodized conforming to MIL-A-8625, type II, to a minimum thickness of 0.0004 inch (0.01 mm) for aluminum castings and 0.0007 inch (0.02 mm) for aluminum wrought alloys.

3.4.1 Steel reflectors. Steel reflectors shall be made of enameling steel sheets conforming to ASTM A 424, grade B (drawing quality) and shall be not less than 0.024 inch (0.60 mm) thick. The reflectors shall be completely covered by fused porcelain enamel having a glazed surface leaving no exposed metal. Thickness of the porcelain enamel on any surface shall be not less than 0.016 inch (0.40 mm) and not more than 0.025 inch (0.625 mm). The reflectors shall be white and shall match color no. 17875 of FED-STD-595. Enameled surfaces shall be free from chipping, pinholes, and other irregularities. When tested in accordance with 4.5.2.2, the inner, or reflecting surface, shall have a reflection factor of not less than 80 percent, measured in accordance with SAE J964.

3.4.2 Aluminum reflectors. Aluminum reflectors shall be made of aluminum sheets conforming to QQ-A-250/2, 0-temper and shall be not less than 0.040 inch (1.0 mm) thick. When tested as specified in 4.5.2.2, the reflecting surface shall have a reflection factor of not less than 70 percent, measured in accordance with SAE J964.

3.4.3 Inner auxiliary reflectors. When specified (see 1.2 and 6.2), the elliptical reflectors shall be equipped with an anodized aluminum inner reflector that can be securely positioned behind the lamp.

3.5 Lens. When specified (see 1.2 and 6.2), types I and II floodlights shall be equipped with a clear, colorless, heat-resisting convex lens. The lens shall be diffusing or spreading, as specified (see 6.2). The lens shall be secured to the reflector by a split-type steel clamping ring equipped with a sealing gasket, or a lens retaining ring with threaded lugs and screw to hold the lens firmly in place and to permit easy removal of the lens.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

3.6 Electrical cable. The electrical cable shall be as specified in tables I, II, and III as applicable, and shall conform to MIL-C-3432, type CO-03HLF (3/14) 0580, or C13208E9930, as applicable.

3.7 Detailed requirements.

3.7.1 Type I. Type I floodlights shall be 10 to 12 inches (254 to 305 mm) in diameter, shall have a horizontal beam spread of 100 degrees ±25 degrees and a vertical beam spread of 100 degrees ±25 degrees. They shall be constructed in accordance with figure 5 (see 6.5), table I (except that type I floodlights need not be weatherproof),and as specified herein.

3.7.2 Type II. Type II floodlights shall be 12 to 14 inches (305 to 356 mm) in diameter, shall have a beam spread of 35 degrees ±10 degrees by 35 degrees ±10 degrees, and shall be constructed in accordance with figure 5 (see 6.5), table I and as specified herein.

TABLE I. Requirements for types I and II floodlights.

Hood	- Shall be weatherproof; shall house lamp-holder. Shall be provided with weatherproof bushing for the entrance of the wiring connection. Shall provide a means of locking the reflector in any desired horizontal position. Shall be constructed of steel conforming to ASTM A 27 and ASTM A 148 or aluminum conforming to QQ-A-601, alloy 712.0, F-temper. Shall be internally grounded.
Lampholder	- Shall be mogul screw shell porcelain type rated at 1,500 watts, 250 volts with adapter for medium-screw-base 200-, 300- and 500-watt lamps.
Mounting bracket	- When tested as specified in 4.5.2.1, shall permit horizontal and vertical adjustment and locking capabilities. Shall be suitable for mounting on a 4.50-inch (114 mm) crossarm, a 4-inch (102 mm) outlet box, or any flat surface, and shall be equipped with a pipe clamp for mounting on pipes ranging from 1 to 2 inches (25.4 to 51 mm) in diameter (standard trade designation). Shall be either of steel conforming to ASTM A 27 and ASTM A 148 or aluminum conforming to QQ-A-601, alloy 712.0, F-temper.
Cable	- Shall be not less than 6 feet (1829 mm) long, permanently attached to the flood-light, and shall be equipped with an attachment plug cap conforming to W-C-596, series D-27, weatherproof.

Source: https://assist.dla.mil -- Downloaded: 202610-17T21:53Z
Check the source to verify that this is the current version before use.

3.7 3 Types III and IV. Types III and IV floodlights shall be elliptical and shall conform to table II and figures 1 through 4 (see 6.5), except that modifications in nondimensional features are permitted. Lenses are not required.

TABLE II. Requirements for types III and IV floodlights.

Hood	- Shall be weatherproof, shall support the lampholder and provide means of locking the reflector in any desired horizontal position. Shall be marked with vertical adjustment degree marking at 5-degree intervals for 15 degrees above and 30 degrees below horizontal. Each 15-degree division shall be marked with Arabic numerals cast integrally or otherwise marked permanently. Shall be constructed of steel conforming to ASTM A 27 and ASTM A 148 or aluminum conforming to QQ-A-601, alloy 712.0, F-temper. Shall provide a weatherproof bushing for the entrance of wiring connections and shall be internally grounded.
Lampholder	- Shall be mogul screw shell, porcelain type, rated at 1,500 watts, 600 volts.
Mounting bracket	- When tested as specified in 4.5.2.1, shall permit adjustment and locking capabilities. Shall permit open wiring type suitable for mounting on a 4.25-inch (108 mm) crossarm, or any flat surface, and shall be equipped with a pipe clamp for mounting on pipes ranging from 1- to 2-inches (25.4- to 51-mm) diameter (standard trade designation). Mounting holes shall accommodate 0.375- by 3-inch (9.52-mm by 76-mm) drive lag screw, and a lag screw will be furnished for each mounting hole. Shall be either of steel conforming to ASTM A 27 and ASTM A 148 or aluminum conforming to QQ-A-601, alloy 712.0, F-temper.
Cable	- Shall be not less than 26 inches (660 mm) long and permanently attached to the floodlight.

Source: https://assist.dla.mil -- Downloaded: 202610-17T21:53Z
Check the source to verify that this is the current version before use.

3.7.4 Type V. Type V shall be in accordance with TA13208E4159, with table III, and as specified herein.

TABLE III. Requirements for type V floodlights.

Hood	-	Shall be weatherproof, shall support the lampholder and provide means for locking the reflector in a desired horizontal position. Shall be constructed of aluminum conforming to QQ-A-601, alloy 712.0, F-temper, and shall provide weatherproof bushing for the entrance of wire connections.
Lampholder	-	Shall be mogul screw, porcelain type, rated at 1,500 watts, 600 volts.
Mounting bracket	-	When tested as specified in 4.5.2.1, shall permit adjustment and locking capabilities. Shall be in accordance with drawings C13208E4153, C13208E4156, B13208E4157, and C13208E4159.
Cable	-	Shall be in accordance with drawing C13208E9930.

3.8 Weatherproofness. When tested as specified in 4.5.2.3, the floodlight shall not fail to operate, have water penetration, or water damage to the electrical connection box.

3.9 Treatment and painting. All ferrous metal parts normally painted shall be cadmium plated in accordance with QQ-P-416, type II, class 1; or zinc plated in accordance with ASTM B 633. After plating, the metal parts shall be treated, and painted in accordance with MIL-T-704, type A except that the finish shall match color no. 17178 of FED-STD-595. Nonpermissible galvanic couples (dissimilar metals) as defined in MIL-STD-889 shall be insulated as specified in MIL-T-704.

3.10 Identification markings. The floodlight shall be identified in accordance with MIL-STD-130. The marking shall be applied to the floodlight on plates conforming to MIL-P-514, type I, style 3, composition C of type I, grade A, class 1 material. Plates shall be attached by screws, bolts or rivets in a conspicuous, protected location.

3.11 Workmanship. The floodlight shall be free from defects in the porcelain enamel finish or discoloration of the reflector surface. There shall be no fissures or chips in the porcelain lampholders, no loose electrical connections, or any other flaws that might impair the operation or use of the floodlights. All surfaces shall be smooth with no sharp protrusions or edges.

3.11.1 Metal fabrication. Metal used in fabrication shall be free from kinks and sharp bends. The straightening of material shall be done by methods that will not cause damage to the material. Corners shall be square and true. Flame-cutting, using tips suitable for the thickness of the steel, may be employed instead of shearing and sawing. All bends shall be made with controlled means to

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

ensure uniformity of size and shape. Precautions shall be taken to avoid overheating. Heated steel shall be allowed to cool slowly. External surfaces shall be free from burrs, sharp edges, and corners, except when sharp edges or corners are required or where they are not detrimental to safety.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements (examinations and tests) as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to ensure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of manufacturing operations, is an acceptable practice to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to acceptance of defective material.

4.1.2 Component and material inspection. The contractor is responsible for ensuring that components and materials are manufactured, examined and tested in accordance with referenced specifications and standards as applicable.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.3).

b. Quality conformance inspection (see 4.4).

c. Inspection of packaging (see 4.6).

4.3 First article inspection.

4.3.1 First article examination. The first article floodlight shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.3.2 First article tests. The first article floodlight shall be tested as specified in 4.5.2. Failure of any test shall be cause for rejection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sampling for examination and tests shall be in accordance with MIL-STD-105. For the purpose of this specification, a lot shall consist of all floodlights presented for inspection at one time. The sample unit shall be one floodlight.

4.4.2 Examination. Samples selected in accordance with 4.4.1 shall be examined as specified in 4.5.1.

4.4.3 Tests.

4.4.3.1 Individual. The sample floodlights that have successfully passed the examination of 4.4.2 shall be tested as specified in 4.5.2.1. The inspection level shall be level II.

4.4.3.2 Samples. Samples selected in accordance with 4.4.1, and which have passed the individual test specified in 4.4.3.1, shall be tested as specified in 4.5.2.2 and 4.5.2.3. The inspection level shall be S-3.

4.5 Inspection procedure.

4.5.1 Examination. The floodlights shall be examined as specified herein for the defects listed in table IV.

TABLE IV. Examination schedule

Number	Defect	Requirement paragraph
Major		
101.	Components not as specified.	3.1
102.	Floodlights not in compliance with UL 57 and UL 153.	3.1
103.	Power source not as specified.	3.1
104.	Configuration not as specified.	3.1.1
105.	Materials not as specified.	3.3
106.	Materials not resistant to corrosion and deterioration, or treated to be resistant to corrosion and deterioration for the applicable storage and operating environments.	3.3.1
107.	Dissimilar metals as defined in MIL-STD-889 are not effectively insulated from each other.	3.3.1.1
108.	Contractor does not have documentation available for identification of material, material finishes, or treatment.	3.3.1.2
109.	Used, rebuilt or remanufactured components, pieces, or parts incorporated in the floodlight.	3.3.2
110.	Reflectors not as specified.	3.4
111.	Steel reflectors not as specified.	3.4.1

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

TABLE IV. Examination schedule (Continued).

Number	Defect	Requirement paragraph
Major		
112.	Aluminum reflectors not as specified.	3.4.2
113.	Inner auxiliary reflectors not as specified.	3.4.3
114.	Lens not as specified.	3.5
115.	Electrical cable not as specified.	3.6
116.	Construction requirements not as specified.	3.7, 3.7.1, 3.7.2, 3.7.3, 3.7.4
117.	Beam spread not as specified.	3.7.1, 3.7.2
118.	Components not as specified.	Table I, II, III
119.	Workmanship not as specified.	3.11
120.	Metal fabrication not as specified.	3.11.1
Minor		
201.	Treatment and painting not as specified.	3.9
202.	Identification marking missing, incomplete, incorrect, or illegible.	3.10

4.5.2 Tests.

4.5.2.1 Operating test. The floodlights shall be connected to a power source and operated. Floodlights shall have a lamp of applicable wattage inserted for this test; the supplier shall furnish the lamp. Short circuits, open circuits, or arcing shall constitute failure of this test. Mounting brackets shall be tested for correct operation. Mounting brackets shall be traversed from minimum to maximum range of adjustment and locked in each extreme position. Failure to traverse through the range of adjustment or failure to lock in either position shall constitute failure of this test.

4.5.2.2 Reflective efficiency test. The reflective efficiency of the reflectors shall be determined by the test procedure for determining reflectivity of rear view mirrors, SAE J964. Aluminum reflectors having a reflection factor less than 70 percent, or steel reflectors having a reflection factor less than 80 percent shall constitute failure of this test.

4.5.2.3 Weatherproof test. Except type I (3.7.1), the floodlight shall be subjected to a simulated rainfall of 4 inches (102 mm) ±1 inch (25 mm) per hour by a water spray of small droplets, not fine mist, for a period of not less than 2 hours. The temperature of the water shall be not less than 40 ^{0}F (4 ^{0}C) and the drops shall impinge on the floodlight at any angle between 30 and 60 degrees from the vertical. The ambient temperature of the air at the floodlight height shall be 77 ^{0}F ±5 ^{0}F (22 to 28 ^{0}C). The reflector opening shall be not less than 35 degrees above the horizontal. The floodlight shall be turned on for not less than 30 seconds, and then turned off every 10 minutes during the test. Failure to operate, evidence of water penetration, or water damage in the electrical connection box shall constitute failure of this test.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

4.6 Inspection of packaging. The preservation, packing, packaging, and marking shall be examined and tested to determine compliance with MIL-F-3222.

5. PACKAGING

5.1 Preservation. Preservation shall be level A or C as specified (see 6.2).

5.1.1 Level A. Each floodlight, with accessories, repair parts, tools, and technical publications, shall be preserved in accordance with the level A requirements of MIL-F-3222.

5.1.2 Level C. Each complete floodlight, with accessories, repair parts, tools, and technical publications, shall be placed together in a box conforming to PPP-B-636, class domestic, grade as appropriate for the size and weight of the contents. Technical publications shall be preserved in accordance with method IC-1 or IC-3 of MIL-P-116. Cushioning shall be provided to prevent movement and damage from shock and vibration. The box shall be closed in accordance with the requirements of the box specification.

5.2 Packing. Packing shall be level A, B, or C as specified (see 6.2).

5.2.1 Level A or B. Complete floodlights, preserved as specified in 5.1, shall be packed in accordance with the level A or B requirements of MIL-F-3222, except the shipping container shall be style 1 of PPP-B-601. Strapping for level A shall be finish B and strapping for level B shall be finish A.

5.2.2 Level C. Complete floodlights shall be packed in containers conforming to PPP-B-636, class domestic, variety single-walled or double-walled, grade as appropriate for weight and size of contents. Containers shall be closed in accordance with the box specification.

5.3 Marking. Marking shall be in accordance with MIL-STD-129.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful but is not mandatory.)

6.1 Intended use. The floodlights are intended for use in illuminating recreational and industrial areas and for military utility lighting.

6.2 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of the specification.
b. Floodlight type, reflector material, inner auxiliary reflector option, and lens option required (see 1.2).
c. Part or identifying number (PIN) required (see 1.3 and 6.6).
d. Issue of DODISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).
e. When a first article is not required (see 3.2).
f. Level of preservation and level of packing required (see 5.1 and 5.2).


Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

6.3 Technical manuals. When this specification is cited in a contract, a contract exhibit must be prepared to fully describe statement of work criteria and delivery instructions, and cite this specification. The technical manuals must be acquired by separate Contract Line Item Number (CLIN) in the contract. The contracting officer should include requirements for such data as technical publications, instructional materials, illustrated parts lists, and supplier's maintenance and operation manual to be furnished with each floodlight.

6.4 First article. When a first article inspection is required, the item(s) should be a preproduction model. The first article should consist of one or more units. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examinations, approval of the first article test results and disposition of the first articles. Invitation for bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.5 Information figures. Figures 1 through 5 show types of floodlights and components that have been found acceptable; however, the figures are included for illustration only and are not intended to preclude the furnishing of other floodlights and components that conform to this specification.

6.6 Part or identifying number (PIN). The PIN to be used for floodlights acquired to this specification is created as follows:

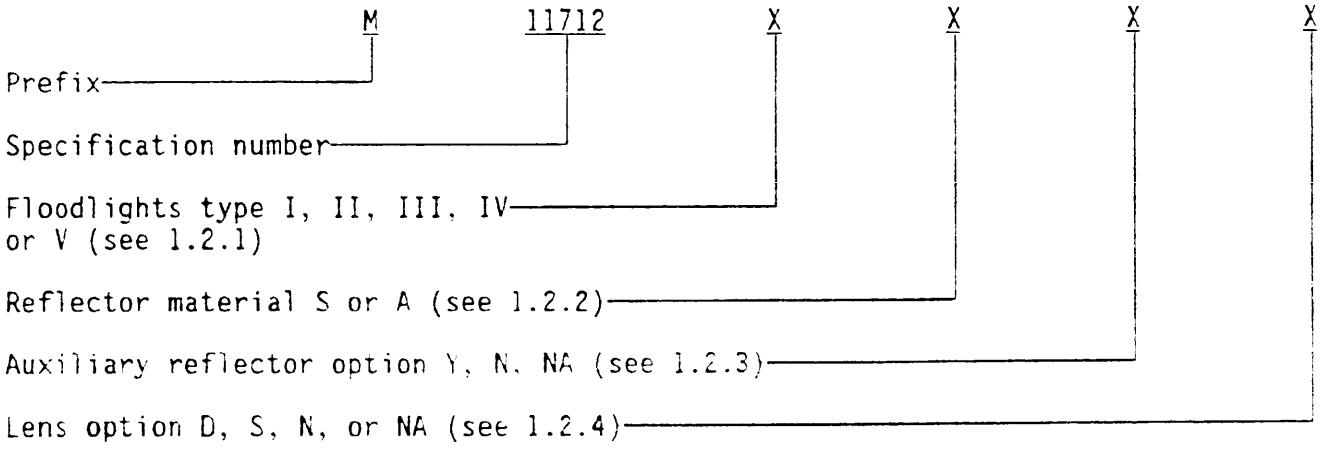

6.7 Subject term (key word) listing.

Floodlights, bracket-mounted
Floodlights, electric
Floodlights, utility type
Floodlights, weatherproof

6.8 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Source: https://assist.dla.mil -- Downloaded: 202610-17T21:53Z
Check the source to verify that this is the current version before use.

Custodians:
Army - ME
Air Force - 99


Review activity:
Air Force - 82
DLA - GS

User:
Navy - YD

Preparing activity:
Army - ME

Project 6230-0311


Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

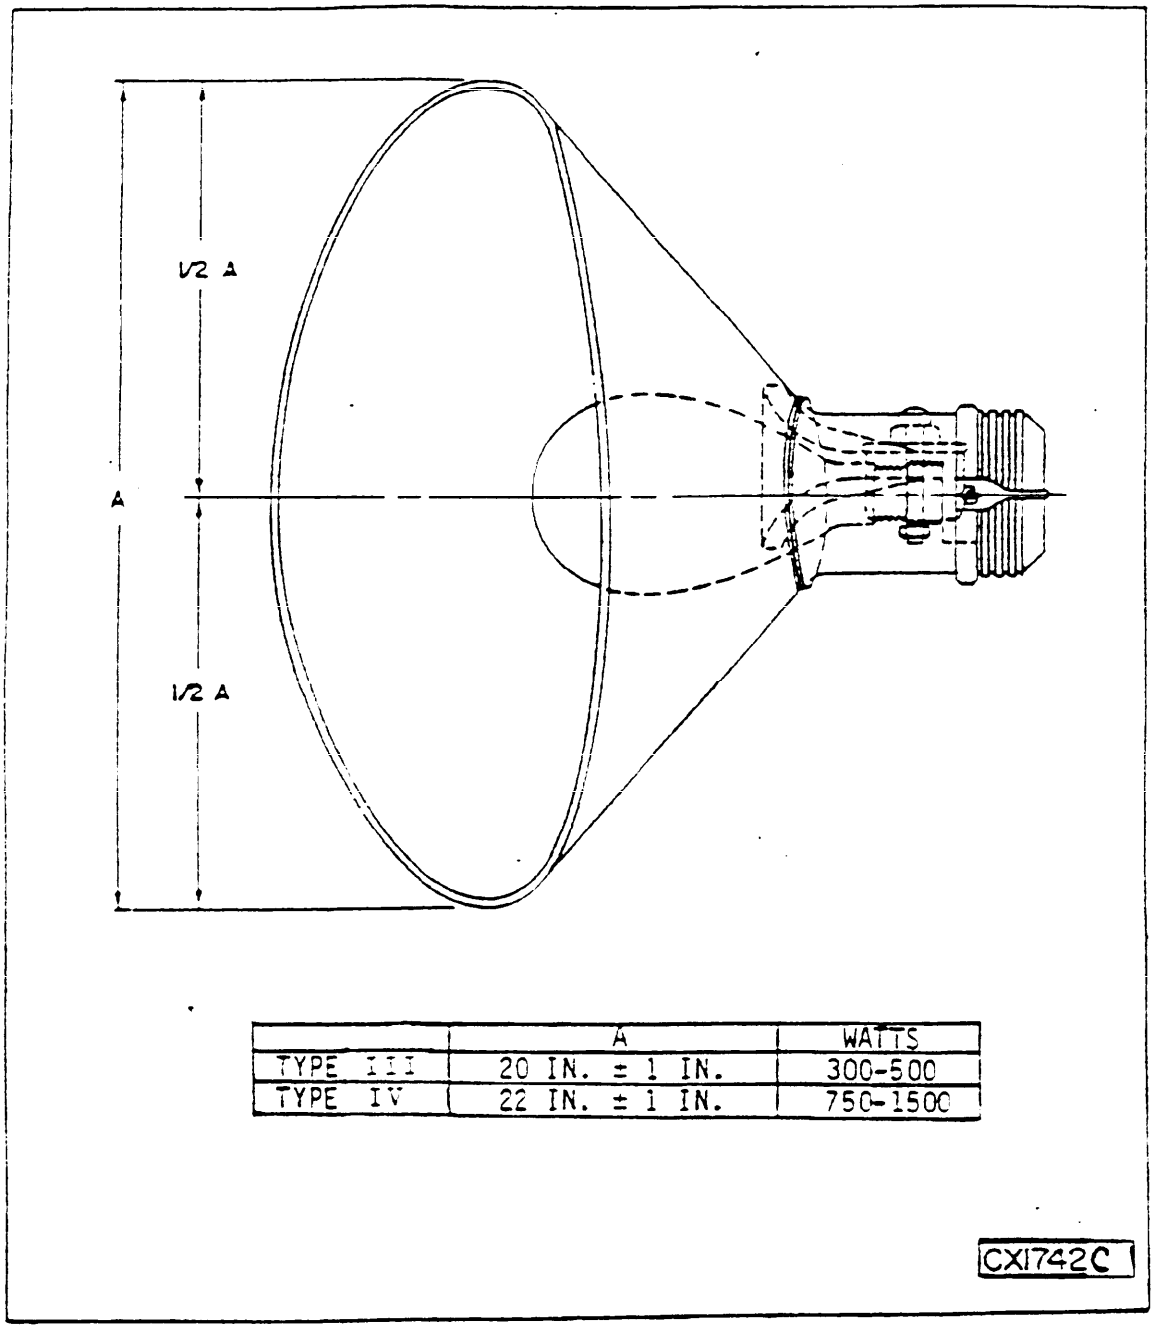

	A	WATTS
TYPE III	20 IN. ± 1 IN.	300-500
TYPE IV	22 IN. ± 1 IN.	750-1500

FIGURE 1. Floodlight - standard open type, wide-angle, 300-500 watt; 750-1500 watt.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

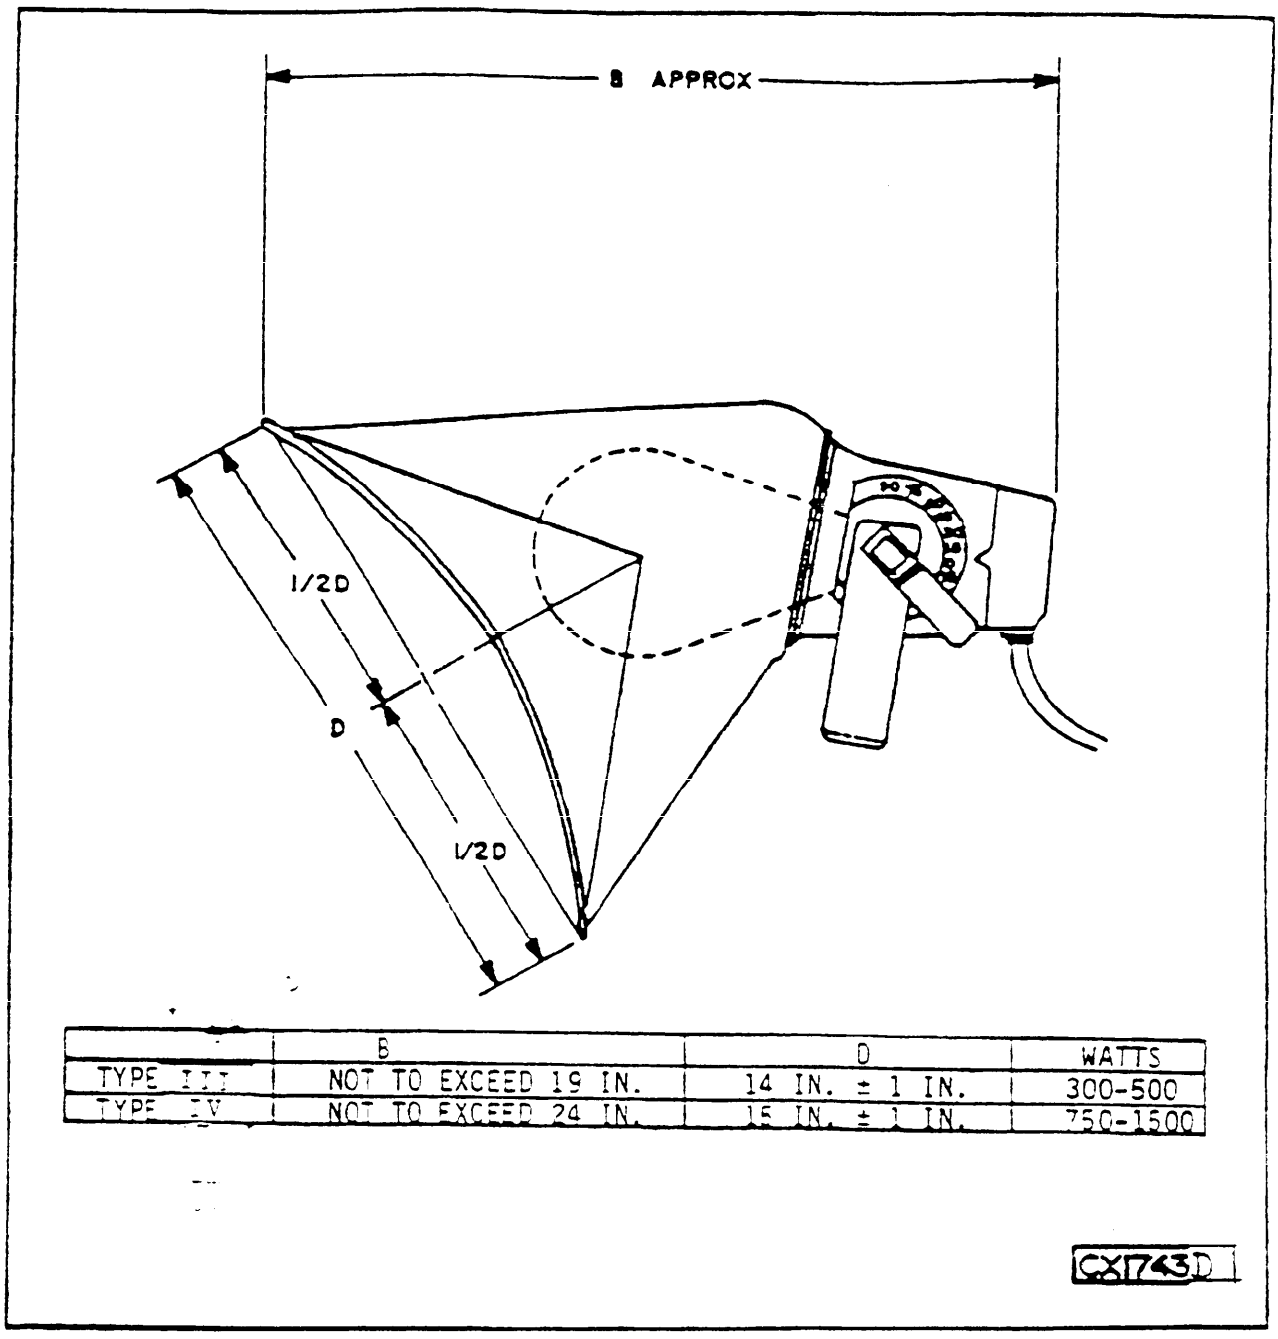

	B	D	WATTS
TYPE III	NOT TO EXCEED 19 IN.	14 IN. ± 1 IN.	300-500
TYPE IV	NOT TO EXCEED 24 IN.	15 IN. ± 1 IN.	750-1500

FIGURE 2. Floodlight - standard open type, wide-angle, 300-500 watt; 750-1500 watt.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.


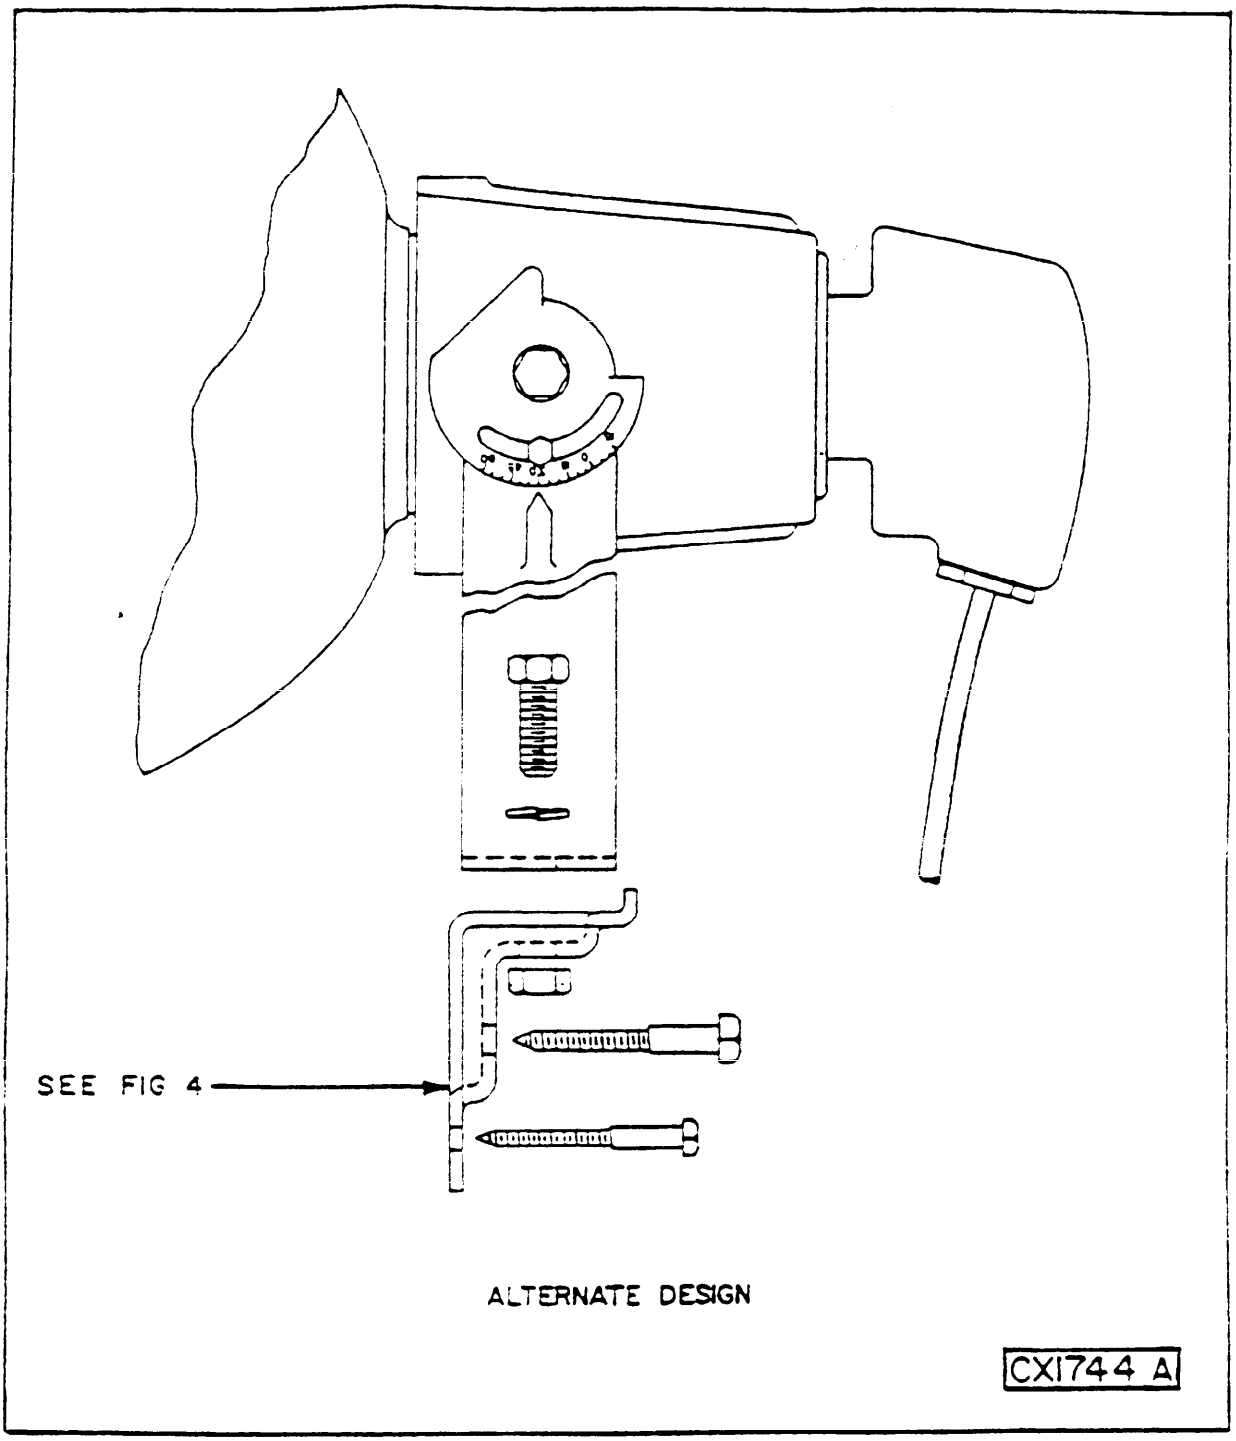


FIGURE 3. Floodlight - standard open type, wide-angle, 300-500 watt; 750-1500 watt.

Source: https://assist.dla.mil -- Downloaded: 202610-17T21:53Z
Check the source to verify that this is the current version before use.

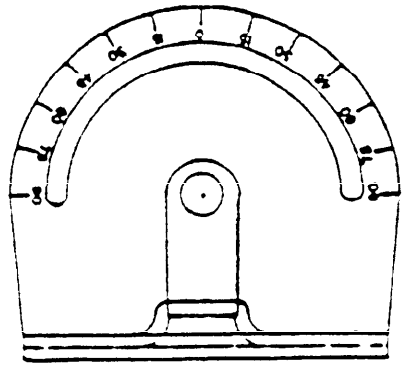


(View taken from figure 3, rotated 180 °)

CX1745A

FIGURE 4. Floodlight - standard open type, wide-angle, 300-500 watt; 750-1500 watt.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

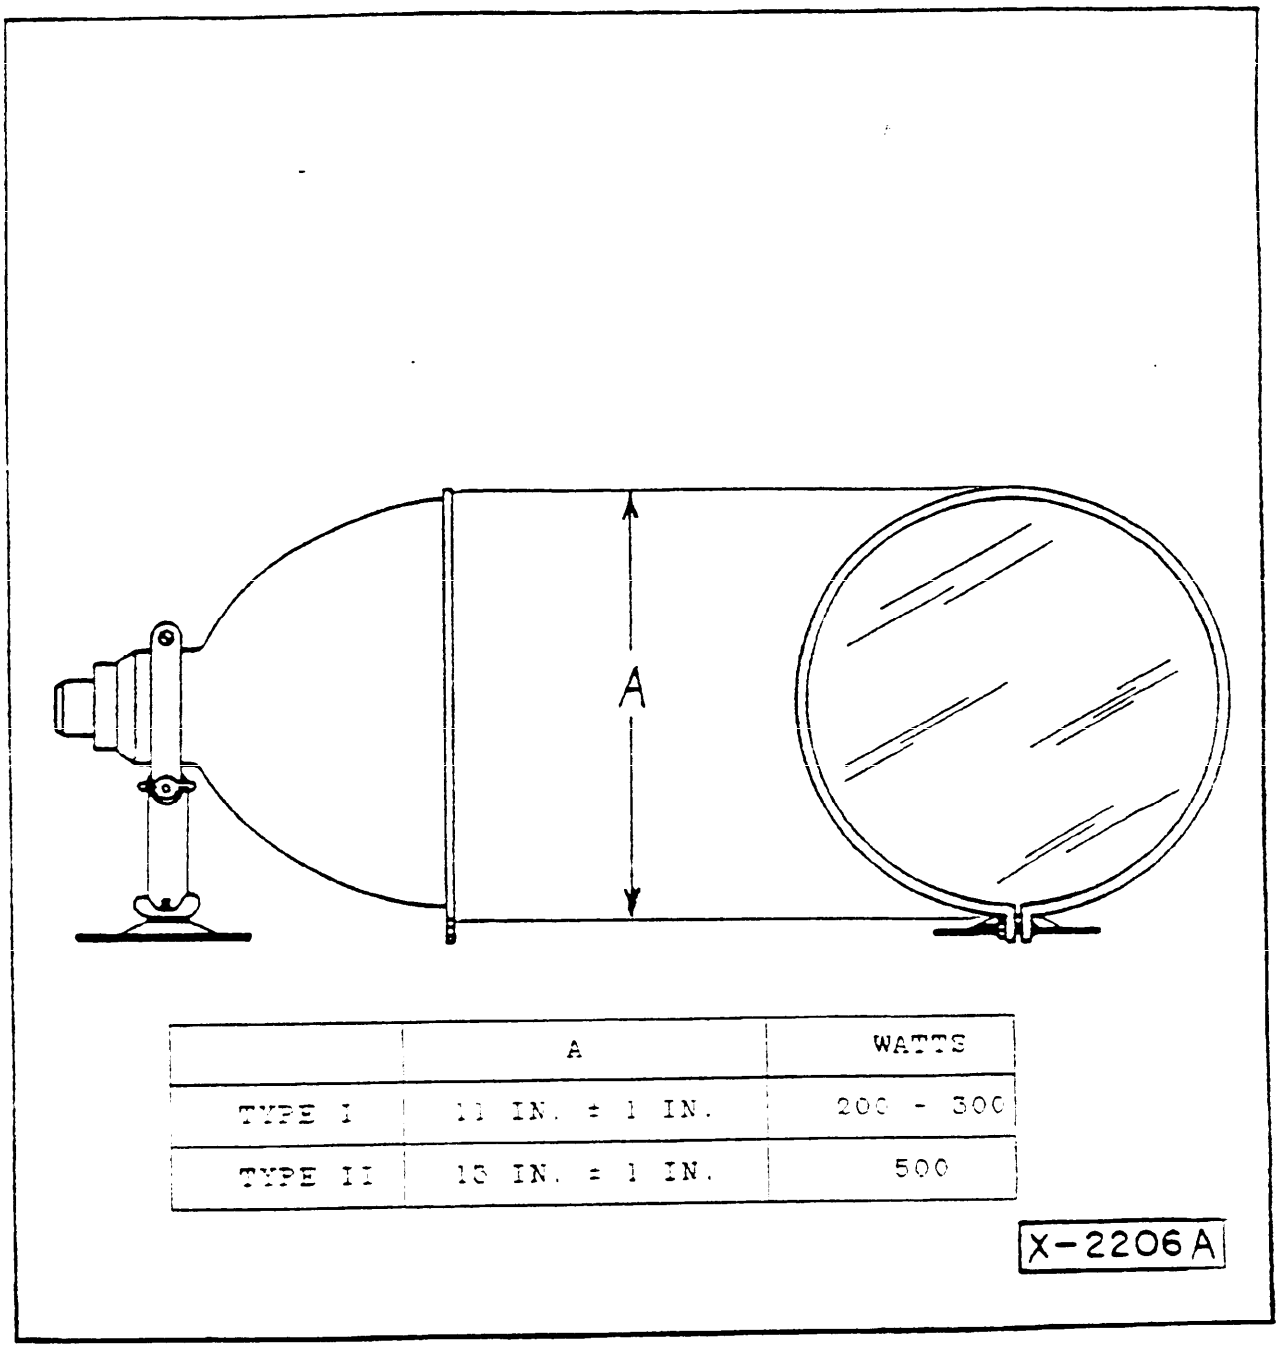

	A	WATTS
TYPE I	11 IN. ± 1 IN.	200 - 300
TYPE II	16 IN. ± 1 IN.	500

FIGURE 5. Floodlight, electrical.

Source: https://assist.dla.mil -- Downloaded: 202610-17T21:53Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	1. DOCUMENT NUMBER	2. DOCUMENT DATE (YYMMDD)
	MIL-F-11712F	900926

3. DOCUMENT TITLE: Floodlights, Electric: Utioity Type, Porcelain-Covered Steel or Aluminum, Bracket-Mounted, Weatherproof, with or without Lens

4. NATURE OF CHANGE (*Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.*)

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME (Last, First, Middle Initial)	b. ORGANIZATION
c. ADDRESS (Include Zip Code)	d. TELEPHONE (Include Area Code) (1) Commercial (2) AUTOVON (If applicable)

7. DATE SUBMITTED (YYMMDD)

8. PREPARING ACTIVITY

a. NAME	b. TELEPHONE (Include Area Code) (1) Commercial	(2) AUTOVON
	(703) 664-5717	354-5717

c. ADDRESS (Include Zip Code)
US Army Belvoir RDE Center
ATTN: STRBE-TSE

IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT:
Defense Quality and Standardization Office
5203 Leesburg Pike, Suite 1403, Falls Church, VA 22041-3466

Source: https://assist.dla.mil -- Downloaded: 2025-10-17 12:15:32Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T21:53Z
Check the source to verify that this is the current version before use.