MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, REMOTE CONTROL, AC, THERMAL, TRIP-FREE SERIES TRIP, SINGLE POLE, AUXILIARY CONTACTS (5 TO 25 AMPERES)

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of MIL-C-83383.

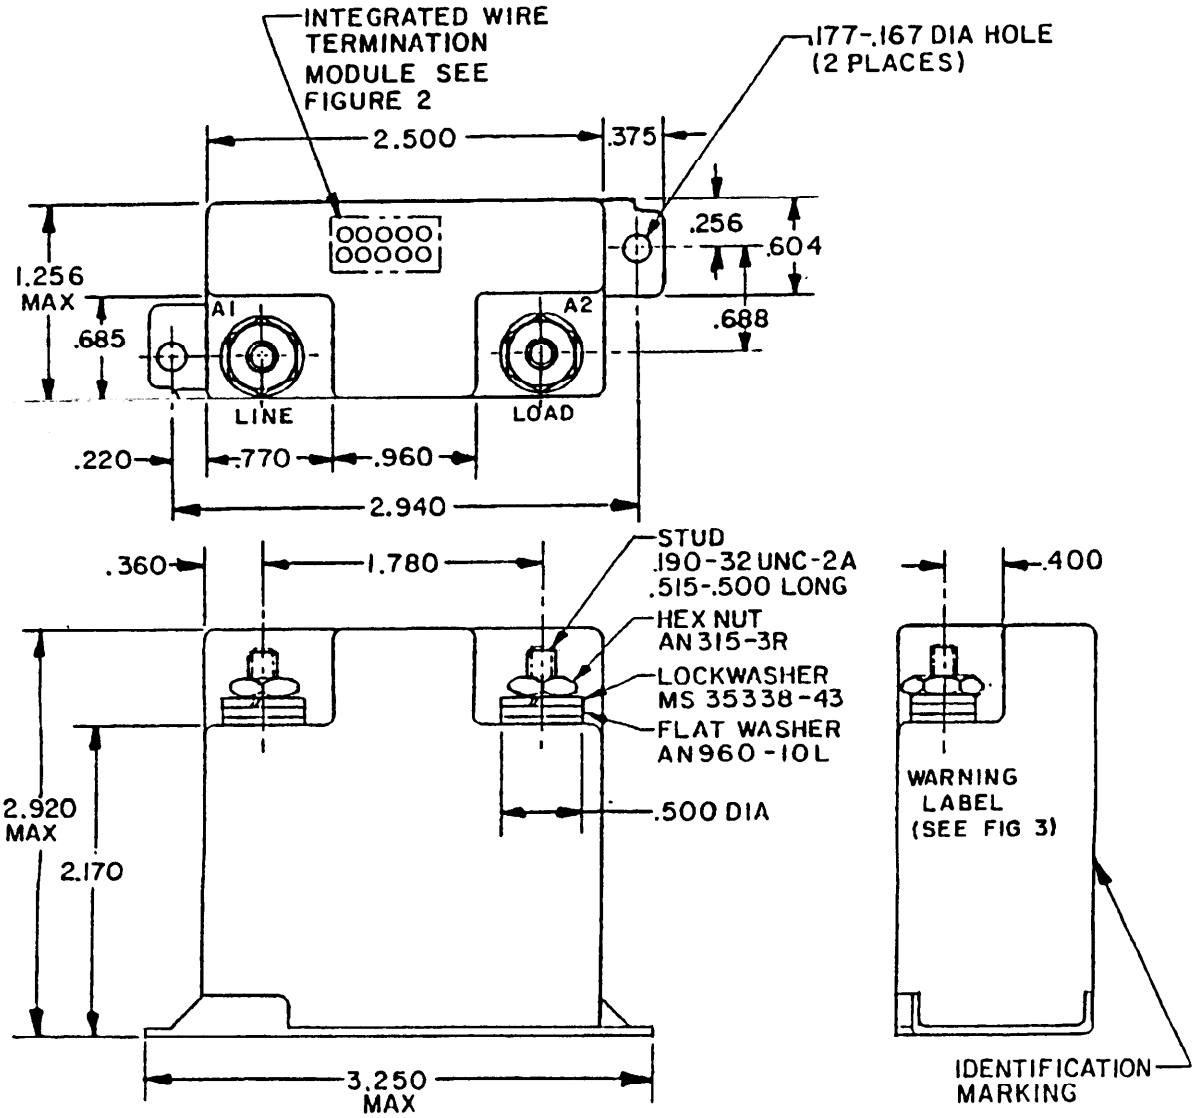


FIGURE 1. Dimensions and configuration.


Ⓐ denotes changes

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

Inches	mm	Inches	mm	Inches	mm
.167	4.24	.515	13.08	1.780	45.21
.177	4.49	.604	15.34	2.170	55.12
.220	5.59	.685	17.40	2.500	63.50
.256	6.50	.688	17.47	2.920	74.17
.360	9.14	.770	19.56	2.940	74.67
.375	9.53	.960	24.38	3.250	82.55
.500	12.70	1.256	31.90		

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerance is ±.015 (0.38 mm).

FIGURE 1. Dimensions and configuration - Continued.

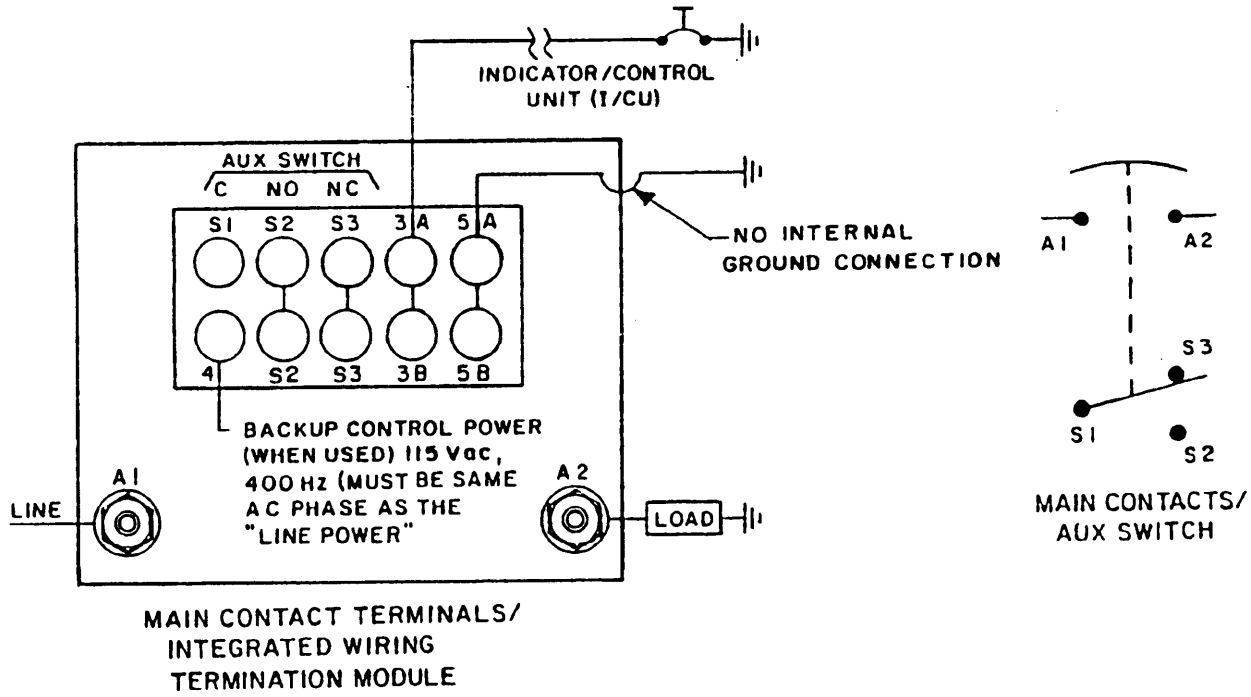

NOTE: Integrated wire termination (IWT) module shall accept pin contacts P/N M39029/1-100 or M39029/1-101.

FIGURE 2. Wiring diagrams/terminal designations.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

TABLE I. Dash numbers and characteristics.

Dash number	Current rating (amperes)	Tripping times from -54°C ±5°C to 71°C ±5°C (time in seconds)					
		Percent rated current					
		200		400		1000	
		Min	Max	Min	Max	Min	Max
01	5.0	10	70	2	13	0.3	2.5
02	7.5	"	"	"	"	"	"
03	10.0	"	"	"	"	"	"
04	15.0	"	"	"	"	"	"
05	20.0	"	"	"	"	"	"
06	25.0	"	"	"	"	"	"

REQUIREMENTS:

Dimensions and configuration: See figure 1.

Weight: 0.735 pound (334 grams), maximum.

Trip indication: I/CU only, see figure 3.

Terminals: See figures 1 and 2.

Auxiliary contacts: SPDT - 5 amperes resistive, 3 amperes inductive, 1 ampere lamp load at 28 V dc, 115 V ac, 60/400 Hz.

Voltage rating: 115 V ac, 400 Hz.

Current ratings: See table I.

Tripping times: See table I.

Calibration: At -54°C with 160 percent overload; must trip within 1 hour.

Response time: 50 milliseconds.

Power requirements and response time at minimum voltage:

Standby current drain and actuation current:

Test voltage: 115 ±2 V ac, 400 Hz to IWT module then 115 ±2 V ac, 400 Hz to line terminal. Actuating current 10 amperes rms maximum.

Maximum operating time at minimum voltage:

Test voltage: 104 V ac, 400 Hz rms maximum.

Overload cycling: 10 cycles per minute.

Endurance:

Electrical: 50,000 cycles resistive or inductive or motor load or lamp load.

Salt spray (corrosion): In accordance with MIL-STD-202, method 101, condition B.

Interrupting capacities:

A - 3,600 amperes.
B - 3,600 amperes.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

Other marking:

Current rating: See figure 1.
Line and load terminals: See figure 1.
Integrated wire termination module: See figure 2.


Part number: M83383/07- (dash number from table I) (e.g., M83383/07-01).

Indicator/Control Unit (I/CU): In order to maintain compatability between the RCCB and the I/CU, the following must be observed when making an I/CU selection.

a. The I/CU must be a 1/2 ampere rated circuit breaker (MS22073-1/2 or MS26574-1/2 or equivalent).

b. The line impedance (terminal 3 to I/CU) plus the I/CU impedance must not exceed 7.5 ohms.

c. The I/CU must respond to a decreasing current pulse of $I^2t \leq 2$ throughout the temperature range.

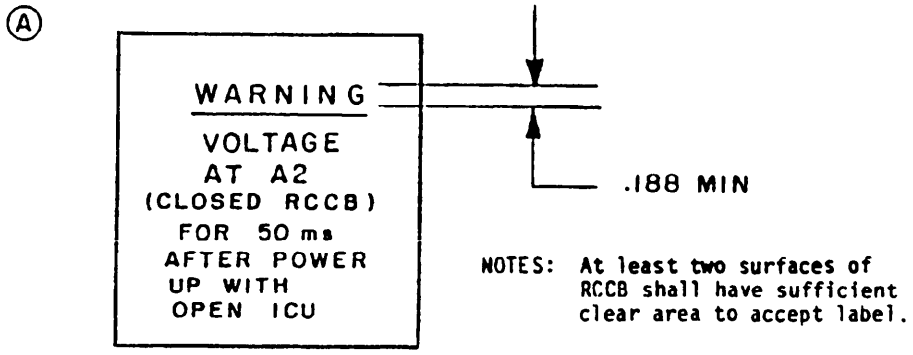

Pressure sensitive label, 1.5 square inches minimum, red background with white letters. The following note shall accompany label. "This label shall be placed on or adjacent to the RCCB on a surface most visible to maintenance personnel."

FIGURE 3. Warning label.

CAUTION TO USERS:

Coordination between devices supplied by different manufacturers should be verified by the user.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

CONCLUDING MATERIAL

Custodians:
Army - ER
Navy - AS
Air Force - 85

Review activities:
Army - ME
Air Force - 99
DLA - ES

User activities:
Army - AT, AV, MI

Preparing activity:
Air Force - 85

Agent:
DLA - ES

(Project 5925-0195-01)

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.