MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, REMOTE CONTROL, AC-DC, THERMAL, TRIP-FREE SERIES TRIP, SINGLE POLE, AUXILIARY CONTACTS (5 TO 100 AMPERES)

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of MIL-C-83383.

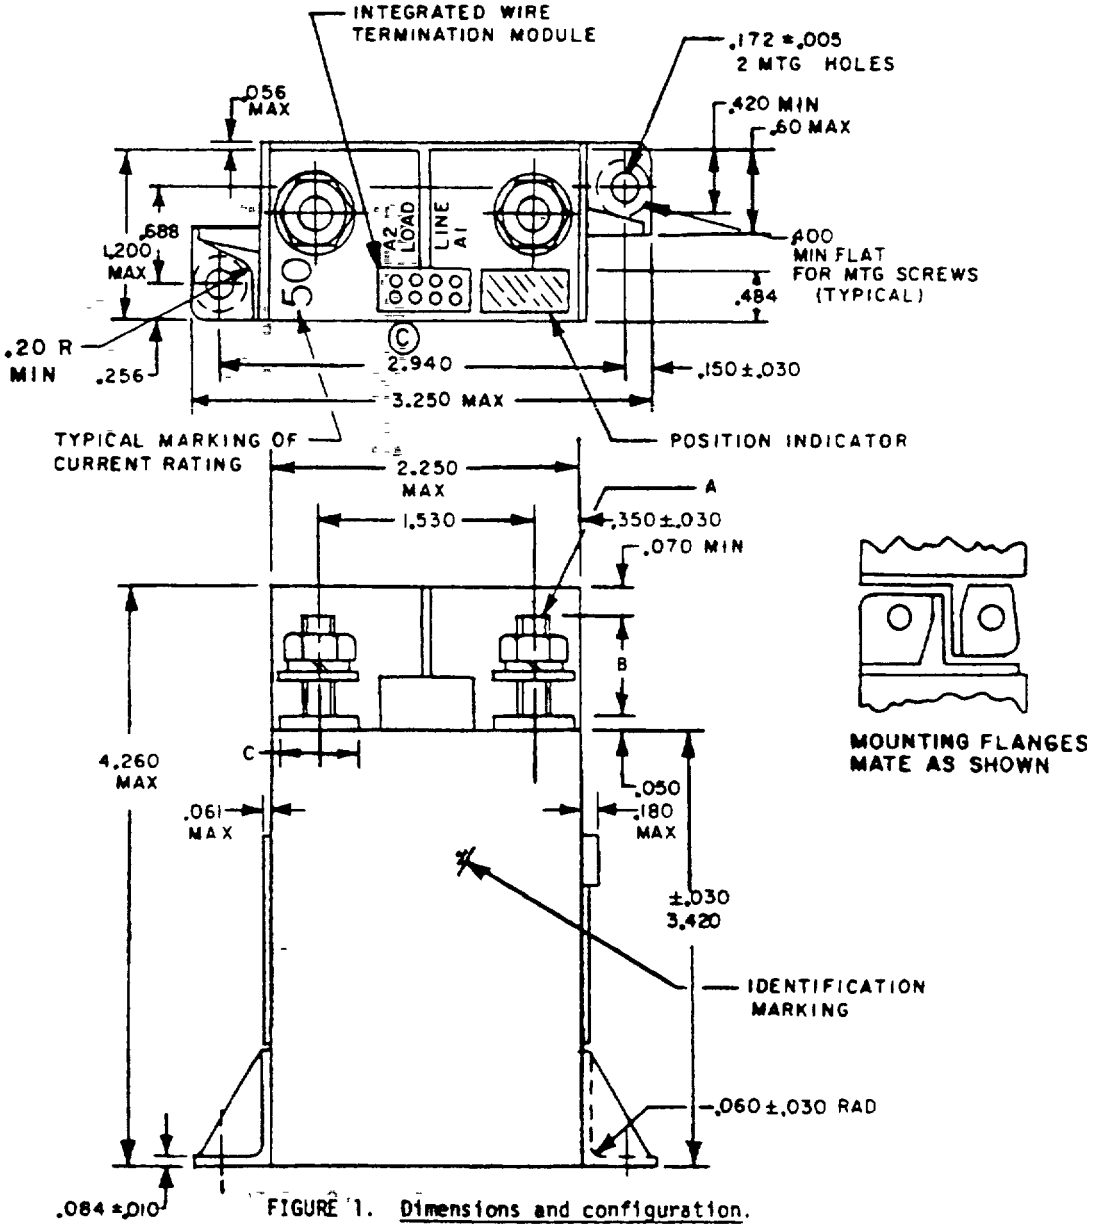


FIGURE 1. Dimensions and configuration.

© denotes changes

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.
Source: https://assist.dla.mil - Downloaded: 2026-0-23107:332
Check the source to verify that this is the current version before use.


Current rating amperes	A	B ± 015 - 000	C	Nut	Lockwasher	Flat washer
5 to 25	190-32UNC-2A	500	500	AN315-3R	MS35338-43	AN960-10L
35 to 100	250-28UNF-2A	610	610	AN315-4R	MS35338-44	AN960-416

Inches	mm	Inches	mm	Inches	mm
.005	0.13	.172	4.37	.500	12.70
.010	0.25	.180	4 57	.60	15.2
.030	0.76	.190	4.83	.610	15 49
.050	1.27	.20	5.1	.688	17.48
.056	1 42	.250	6.35	1.200	30.48
.060	1.52	.256	6.50	1.530	38.86
.061	1.55	.350	8 89	2.250	57.15
070	1.78	.400	10 16	2.940	74.68
.084	2.13	.420	10.67	3.250	82.55
.150	3.81	.484	12.29	3.420	86.87
				4.260	108.20

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerance is ±.015 (0.38 mm)


FIGURE 1. Dimensions and configuration - Continued

Source: https://assist.dla.mil -- Downloaded: 202640-23T07:53Z
Check the source to verify that this is the current version before use.

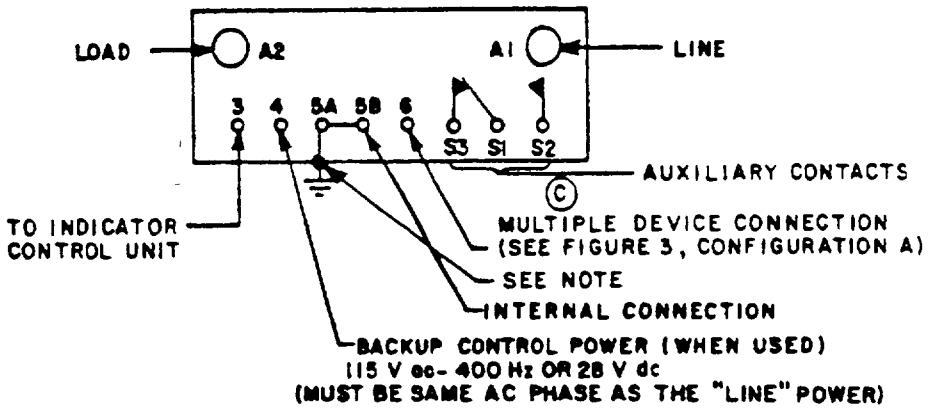

NOTE: Terminals 5A and 5B shall be internally grounded to the mounting leg(s).

FIGURE 2 Schematic

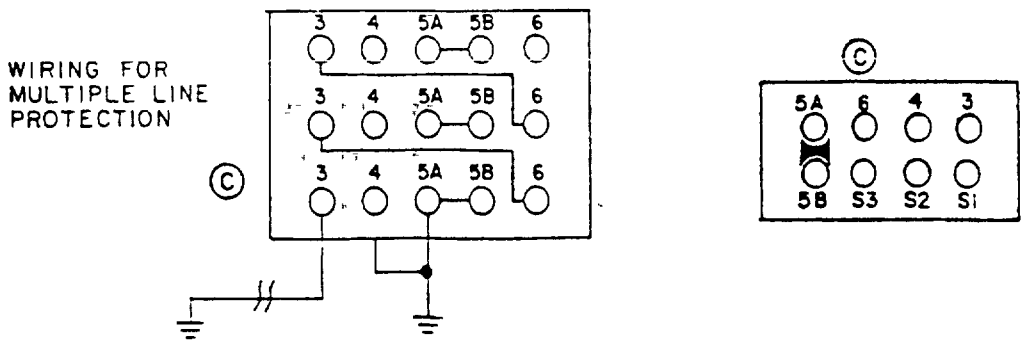

CONFIGURATION A CONFIGURATION B

NOTE: Integrated wire termination (IWT) module shall accept pin contacts P/N M39029/1-100 or -101.

FIGURE 3 Integrated wire termination module

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

TABLE I. Dash numbers and characteristics.

Dash number	Current rating (amperes)	Tripping times from -54°C ±5°C to 71°C ±5°C (time in seconds)					
		Percent rated current					
		200		400		1000	
		Min	Max	Min	Max	Min	Max
01	5.0	7	40	1.2	6.4	.3	1.2
02	7.5	11	40	2.4	6.8	.33	1.1
03	10.0	12	42	2.8	8.5	.42	1.05
04	15.0	13	45	1.7	8.3	.35	1.2
05	20.0	14	46	2.9	7.6	.4	1.15
06	25.0	15	50	2.6	8.7	.4	1.3
07	35.0	16	55	2.8	8.3	.35	1.3
08	40.0	16	55	2.9	9.2	.36	1.3
09	50.0	13	55	2.9	10	.4	1.25
10	60.0	13	60	2.6	13	.26	1.8
11	75.0	13	60	2.5	13	.26	1.8
12	80.0	14	60	2.7	12.5	.3	2
13	100.0	17	63	3.5	13	.35	1.9

REQUIREMENTS.

Dimensions and configuration. See figure 1.

Weight

5 to 25 amperes 0.735 pound (334 grams), maximum.

35 to 50 amperes: 0.750 pound (341 grams), maximum.

60 to 100 amperes: 0.766 pound (348 grams), maximum.

Trip indication: See figure 1.

Terminals: See figures 1 and 2.

Auxiliary contact terminals.

Contact capacity at 28 V dc and 115 V ac, 400 Hz shall be 3 amperes resistive, 1.5 amperes inductive, and 0.5 ampere lamp load.

Voltage rating 28 V dc or 115 V ac, 400 Hz.

Current ratings: See table I.

Tripping times: See table I.

Response time: 12 milliseconds.

Power requirements and response time at minimum voltage.

Standby current drain and actuation current:

Test voltage 28 ±0.5 V dc to IWT module, then 115 ±2 V ac, 400 Hz to line terminal. Actuating current, 3.5 amperes dc and 11 amperes ac rms maximum

Maximum operating time at minimum voltage:

Test voltage. 18 V dc then 104 V ac rms 400 Hz, maximum.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

Endurance:

Electrical:

5 to 25 amperes: 50,000 cycles resistive or inductive or motor load or lamp load.

35 to 50 amperes: 50,000 cycles resistive or inductive or motor load or 25,000 cycles lamp load.

60 to 100 amperes: 50,000 cycles resistive or inductive load or 25,000 cycles motor load.

Interrupting capacities:

A - 3,600 amperes.

B - 3,600 amperes.

C - 3,600 amperes.

D - 3,600 amperes.

Other marking:

Current rating: See figure 1.

Line and load terminals: See figure 1.

Integrated wire termination module. See figure 3.

Position indication See figure 1. Indication is provided by a lens over "open" and "closed" on red and green background.

Part number: M83383/02- (dash number from table I) (e.g., M83383/02-01).

Indicator/Control Unit (I/CU): In order to maintain compatability between the RCCB and the I/CU, the following must be observed when making an I/CU selection:

a. The I/CU must be a 1/2 ampere rated circuit breaker (MS22073-1/2 or MS26574-1/2, or equivalent).

b. The line impedance (terminal 3 to I/CU) plus the I/CU impedance must not exceed 7.5 ohms.

c. The I/CU must respond to a decreasing current pulse of $I^2t \leq 2$ throughout the temperature range.

CAUTION TO USERS:

Coordination between devices supplied by different manufacturers should be verified by the user.

Custodians:
Army - ER
Navy - AS
Air Force - 85

Review activities:
Army - ME
Air Force - 99
DLA - ES

User activities:
Army - AT, AV, MI

Preparing activity:
Air Force - 85

Agent:
DLA - ES

(Project 5925-0197-2)

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.