MILITARY SPECIFICATION SHEET

Ⓒ CIRCUIT BREAKERS, REMOTE CONTROL, AC-DC, THERMAL, TRIP-FREE, SERIES TRIP, TRIPLE POLE, AUXILIARY CONTACTS (5 TO 100 AMPERES)

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of MIL-C-83383.

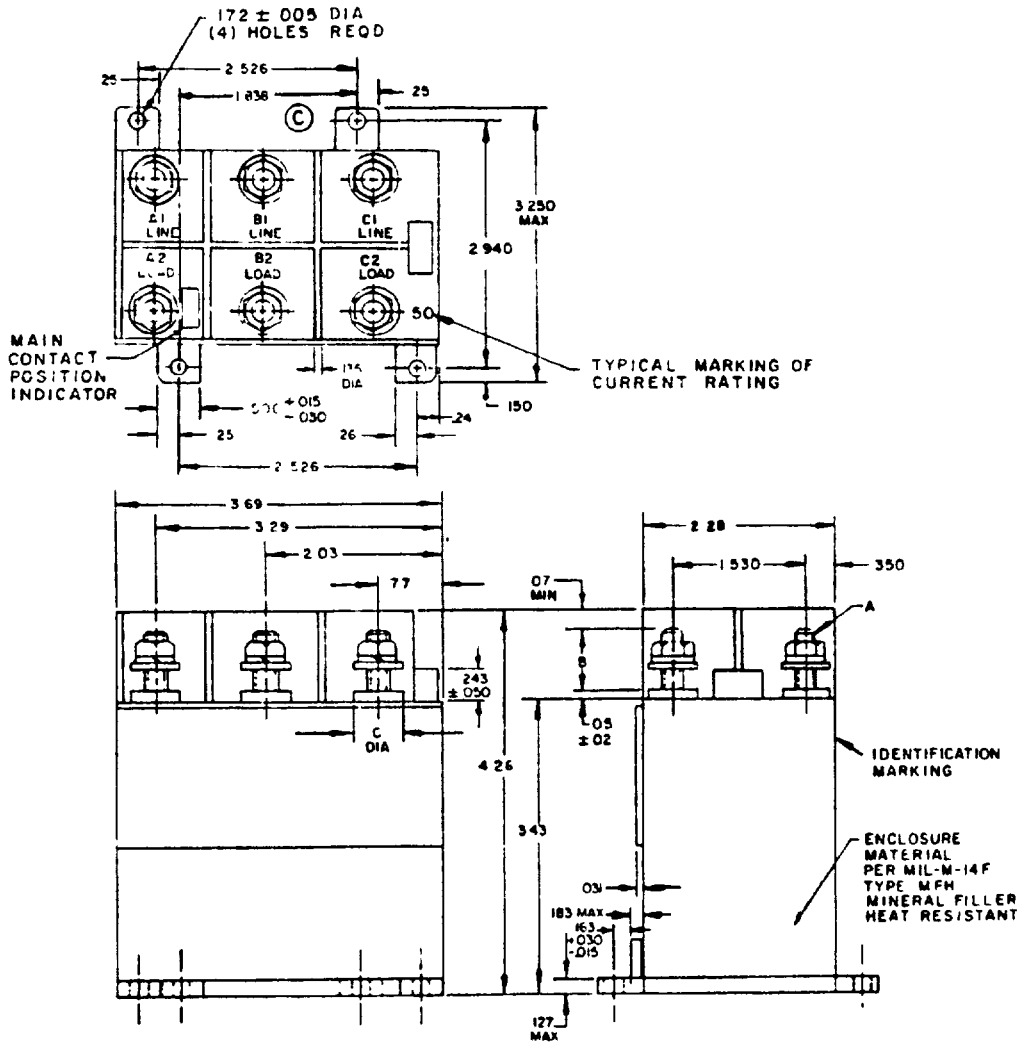


FIGURE 1. Dimensions and configuration.

Ⓒ denotes changes

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

FSC 5925


Current rating (amperes)	A	B ± 030	C	Nut	Lockwasher	Flat washer
5 to 25	.190-32UNC-2A	.500	500	AN315-3R	MS35338-43	AN960-10L
35 to 100	250-28UNF-2A	.610	600	AN315-4R	MS35338-44	AN960-416

INCHES	MM	INCHES	MM	INCHES	MM	INCHES	MM
015	38	127	3.23	.500	12 70	2 526	64 16
02	5	163	4 14	600	15 24	2 940	74 68
030	76	172	4 37	610	15 49	3 250	82 55
031	79	183	4 65	77	19 6	3 29	83 6
050	1 27	24	6 1	1 530	38 86	3 43	87 1
07	1 8	243	6 17	1 838	46.69	3 69	93 7
135	3 43	25	6 4	2 03	51 6	4 26	108 2
150	3 81	350	8 89	2 28	57 9		

NOTES
1 Dimensions are in inches
2 Metric equivalents are given for general information only and are based upon 1 00 inch = 25 4 mm
3 Unless otherwise specified, tolerance is ± 030 (76 mm) on two place decimals and ± 015 (38 mm) on three place decimals


FIGURE 1. Dimensions and configuration - Continued.

Source: https://assist.dla.mil -- Downloaded: 202610-23T07:53Z
Check the source to verify that this is the current version before use.

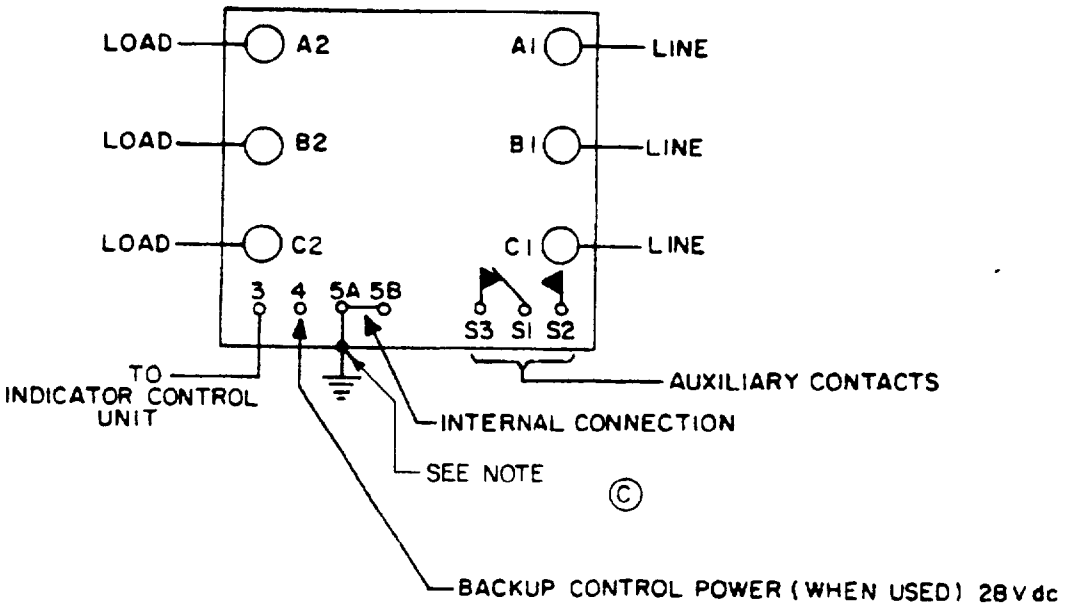

NOTE Terminals 5A and 5B shall be internally grounded to the mounting leg(s).

FIGURE 2. Schematic.



NOTE Integrated wire termination (IWT) module shall accept pin contacts P/N M39029/1-100 or -101.

FIGURE 3. Integrated wire termination module.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

TABLE I. Dash numbers and characteristics.

Dash number	Current rating (amperes)	Tripping times from -54°C ±5°C to 71°C ±5°C (time in seconds)					
		Percent rated current					
		200		400		1000	
		Min	Max	Min	Max	Min	Max
01	5.0	7	80	1.2	10	.3	1.2
02	7.5	11	"	2.4	13	.33	1.1
03	10.0	12	"	2.8	11	.42	1.3
04	15.0	13	"	1.7	10	.35	1.2
05	20.0	14	"	2.9	9.6	.4	1.15
06	25.0	15	"	2.6	10	.4	1.3
07	35.0	16	"	2.8	11	35	1.3
08	40.0	16	"	2.6	10	.36	1.3
09	50.0	13	"	2.9	10	.4	1.25
10	60.0	13	"	2.4	16	.26	1.8
11	75.0	13	"	2.5	16	.26	1.8
12	80.0	14	"	2.7	12.5	.3	2
13	100.0	17	63	3.5	13	.35	1.9

REQUIREMENTS

Dimensions and configuration. See figure 1.

Weight 2.250 pound (1,022 grams), maximum.

Trip indication: See figure 1.

Terminals See figures 1 and 2.

Auxiliary contact terminals

Contact capacity at 28 V dc and 115 V ac, 400 Hz shall be 3 amperes resistive, 1.5 amperes inductive, and 0.5 ampere lamp load.

Voltage rating. 115/200 V ac, 400 Hz.

Current ratings. See table I.

Tripping times: See table I.

Ⓒ Response time 12 milliseconds.

Ⓒ Power requirements and response time at minimum voltage

Standby current drain and actuation current.

Test voltage 28 ±0.5 V dc to IWT module, then 200 ±2 V line to line, 400 Hz, 3 phase grounded neutral to the line terminals. Actuating current, 3.5 amperes dc and 11 amperes ac rms maximum.

Maximum operating time at minimum voltage.

Test voltage 181 V ac rms maximum line-to-line, 3 phase.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T07:53Z
Check the source to verify that this is the current version before use.

Endurance

Electrical

5 to 25 amperes· 50,000 cycles resistive or inductive or motor load or lamp load.

35 to 50 amperes· 50,000 cycles resistive or inductive or motor load or 25,000 cycles lamp load.

60 to 100 amperes 50,000 cycles resistive or inductive load or 25,000 cycles motor load

Interrupting capacities

G - 3,600 amperes, single phase and 2,160 amperes, three phase.

H - 3,600 amperes, single phase and 2,160 amperes, three phase.

Other marking

Current rating See figure 1.

Line and load terminals· See figure 1.

Integrated wire termination module See figure 3.

Position indication. See figure 1. Indication is provided by a lens over "open" and "closed" on red and green background.

Part number. M83383/04- (dash number from table I) (e.g , M83383/04-01).

Indicator/Control Unit (I/CU). In order to maintain compatability between the RCCB and the I/CU, the following must be observed when making an I/CU selection·

a. The I/CU must be a 1/2 ampere rated circuit breaker (MS22073-1/2 or MS26574-1/2, or equivalent).

b. The line impedance (terminal 3 to I/CU) plus the I/CU impedance must not exceed 7.5 ohms.

c. The I/CU must respond to a decreasing current pulse of $I^2t \leq 2$ throughout the temperature range

© CAUTION TO USERS

Coordination between devices supplied by different manufacturers should be verified by the user.

Custodians·
Army - ER
Navy - AS
Air Force - 85

Preparing activity·
Air Force - 85

(Project 5925-0150-4)

Review activities
Army - ME
Air Force - 99
DLA - ES

User activities
Army - AT, AV, MI

Agent
DLA - ES

Source: https://assist.dla.mil -- Downloaded: 202640-23T07:53Z
Check the source to verify that this is the current version before use.