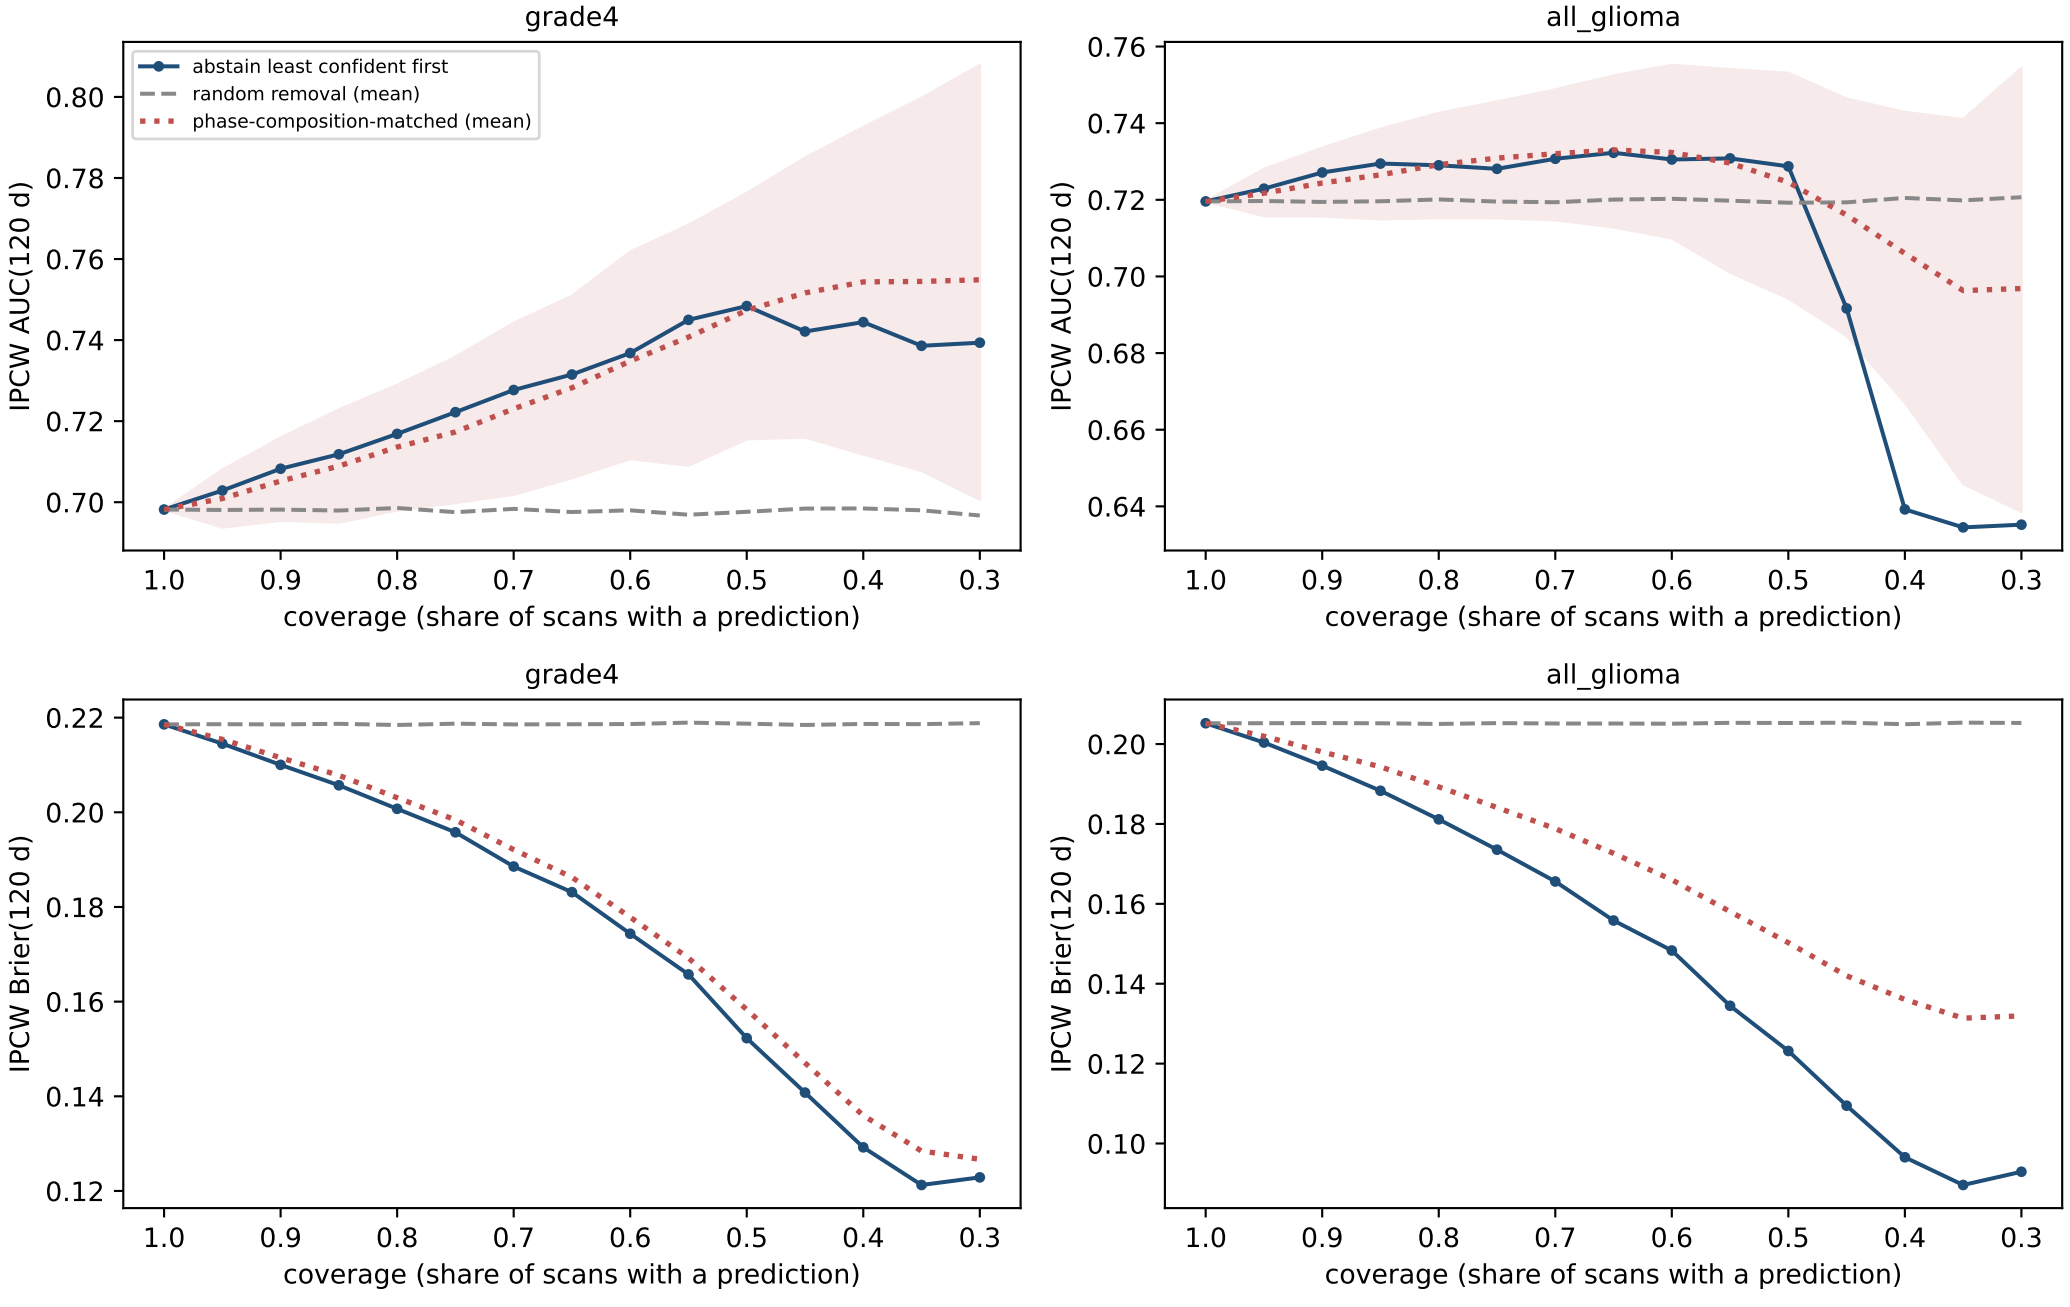
grade4
all_glioma
abstain least confident first
random removal (mean)
phase-composition-matched (mean)
IPCW AUC(120 d)
IPCW Brier(120 d)
coverage (share of scans with a prediction)
1.0
0.9
0.8
0.7
0.6
0.5
0.4
0.3