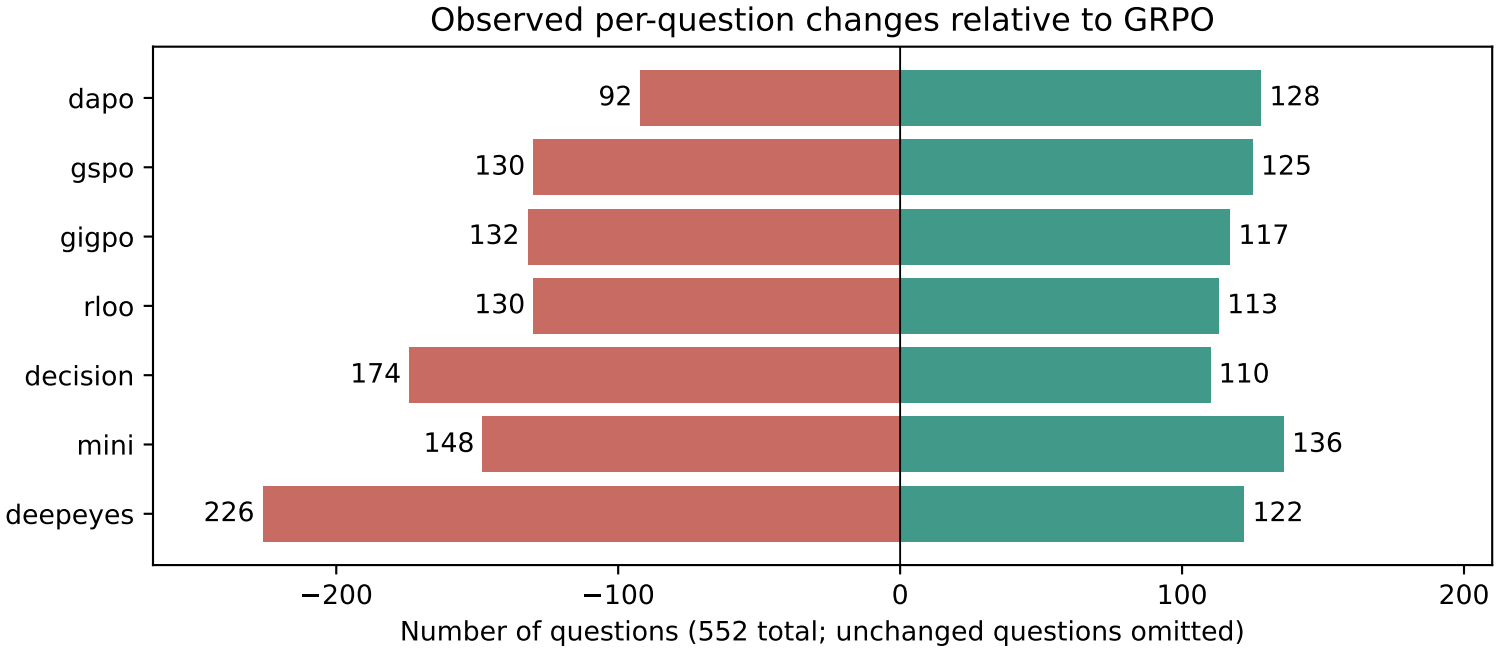

Fixed E1 samples; not counterfactual changes. External/RLOO configurations differ.