


Oscilloscope Signal Capture

File: current.wav

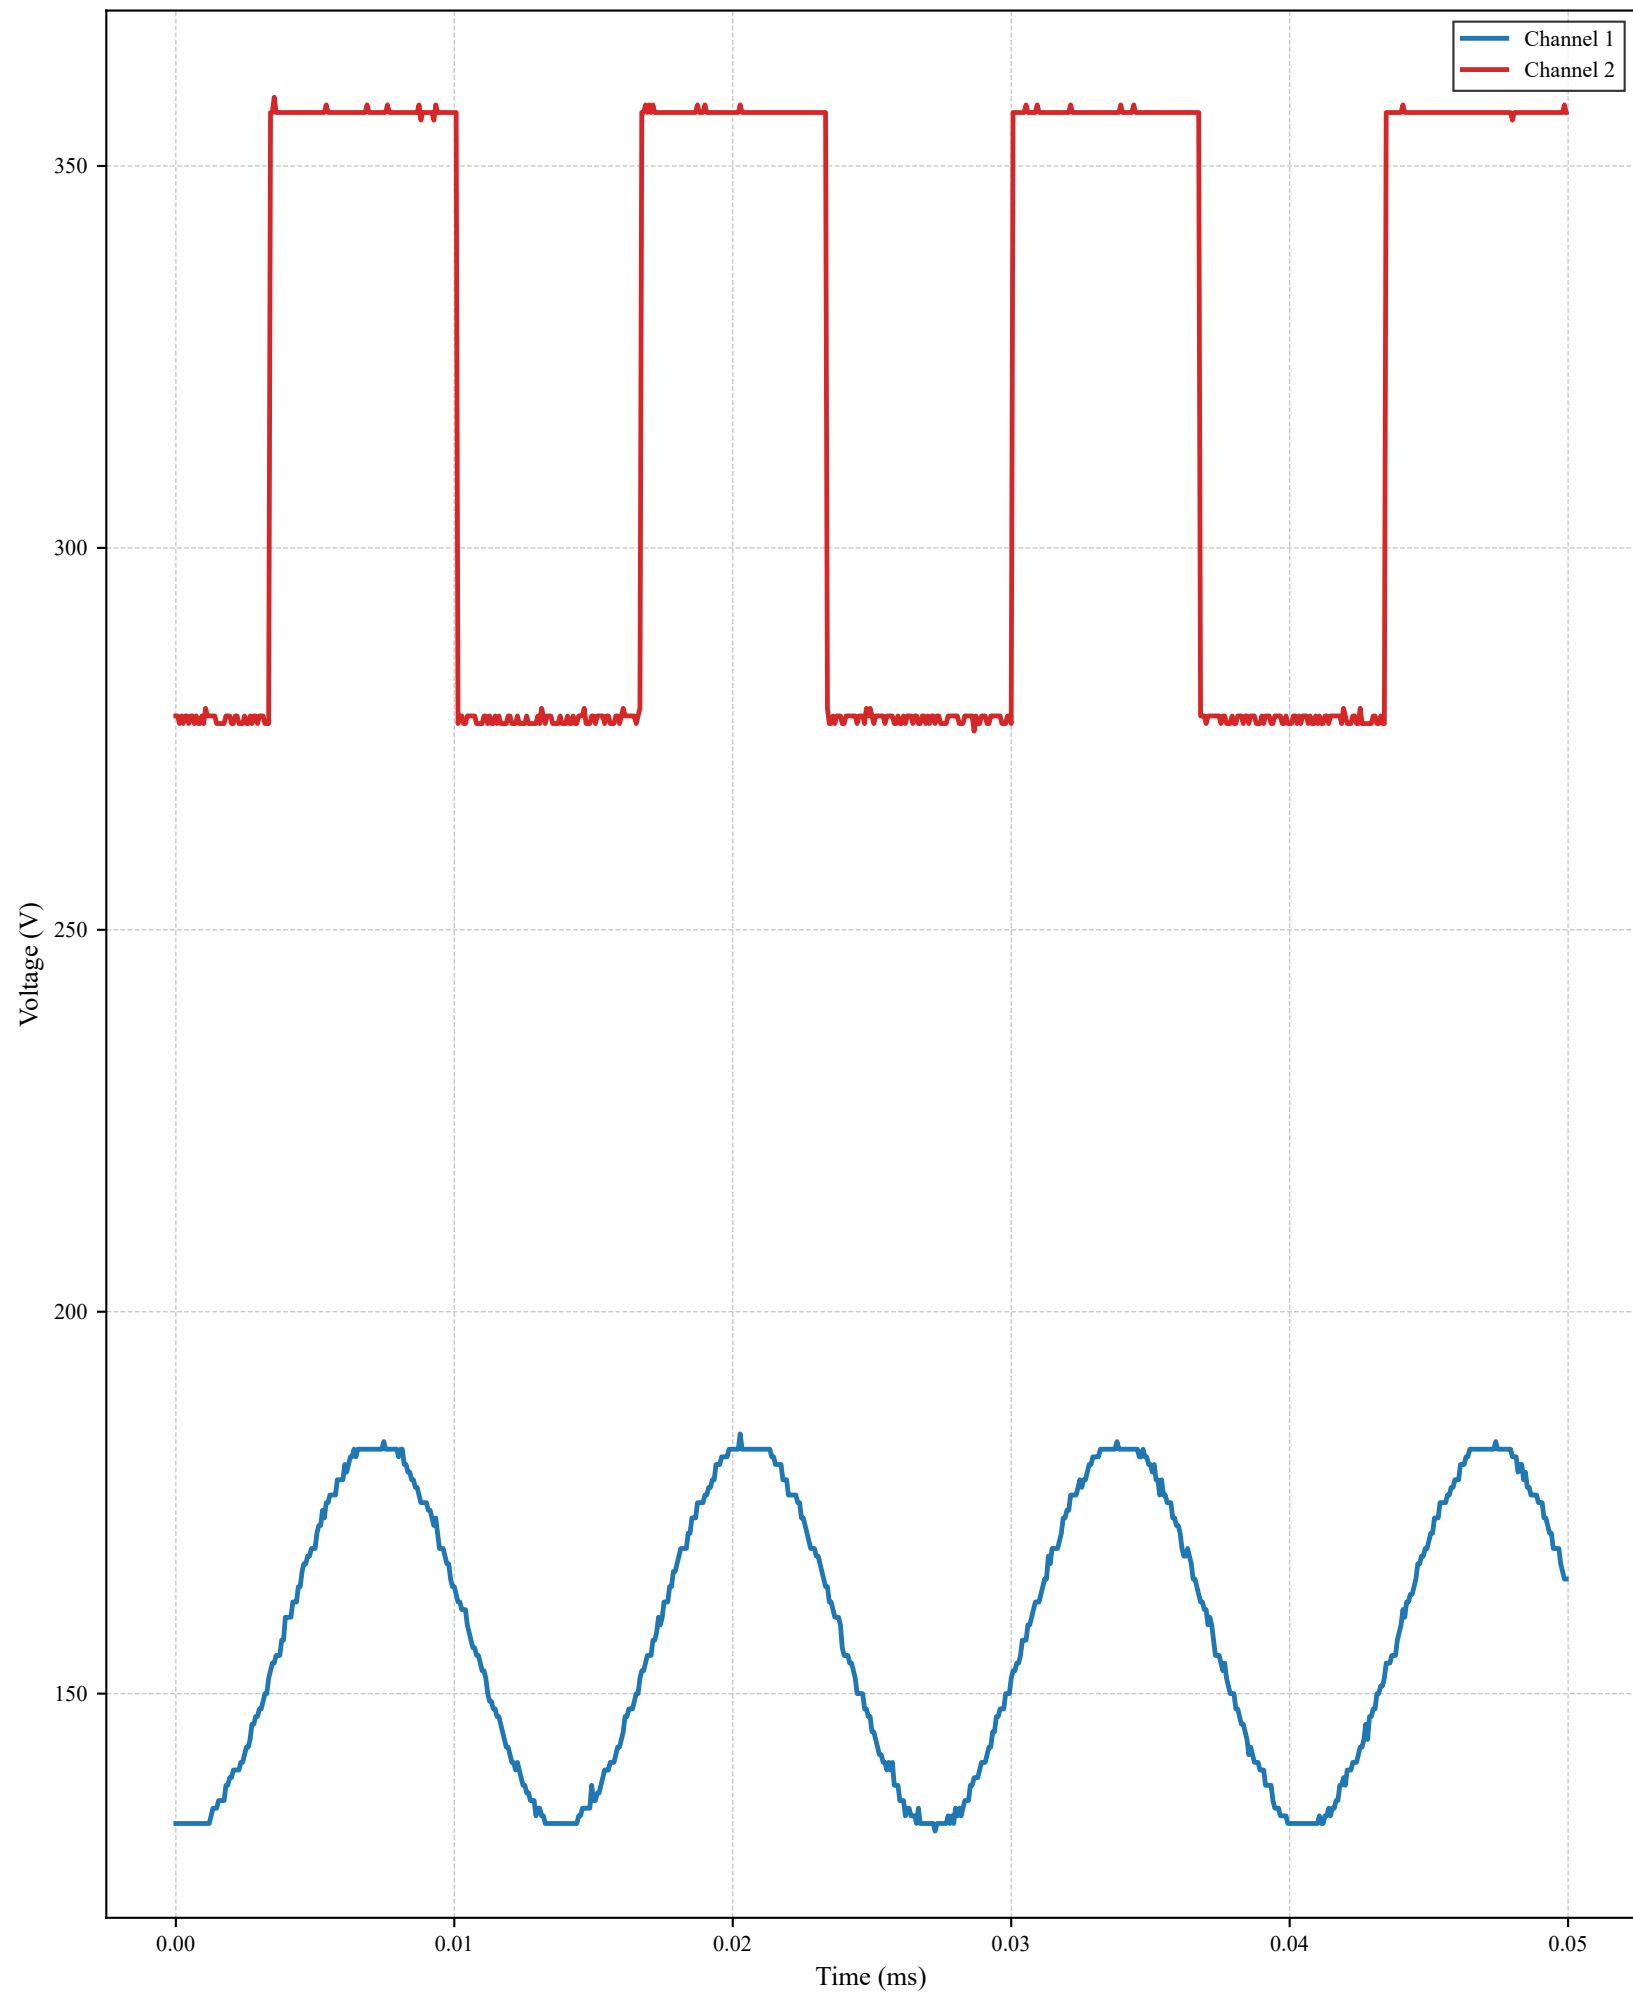

FNIRSI 1014D OSCILLOSCOPE SIGNAL REPORT

File: current.wav
Generated: 2026-03-15 01:32:01

OSCILLOSCOPE CONFIGURATION

CH1 : 2.5 V/div (Probe x1) DC
CH2 : 2.5 V/div (Probe x1) DC

Time / div : 5 mS
Sampling rate : 15.00 kHz
Total capture time : 50000.00 μ s

AUTOMATIC SIGNAL MEASUREMENTS

Parameter	Channel 1	Channel 2
Vmax	1.166 V	3.935 V
Vmin	-1.312 V	-0.09668 V
Vavg	-0.073 V	1.919 V
Vrms	0.8574 V	2.721 V
Vpp	2.478 V	4.032 V
Vp	1.312 V	3.935 V
Freq	50.02 Hz	49.98 Hz
Cycle	19.99 mS	20.01 mS
Time+	9.995 mS	10.01 mS
Time-	9.995 mS	10.01 mS

Automatically generated by Oscilloscope Analyzer