02 / DISTRIBUTION RESTORATION

The timing of recovery changes the energy shortfall

Three invented step schedules, all ending at 100% restoration

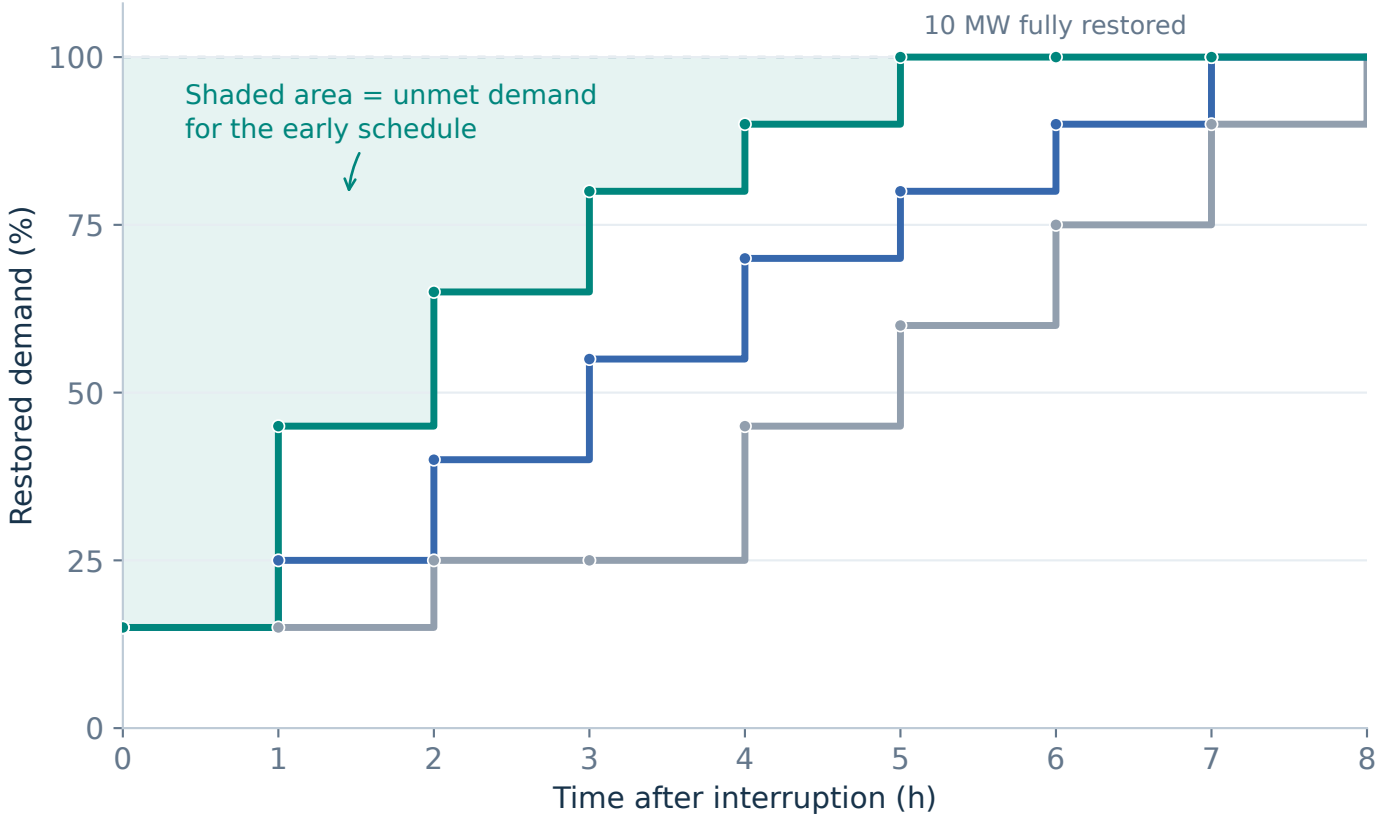

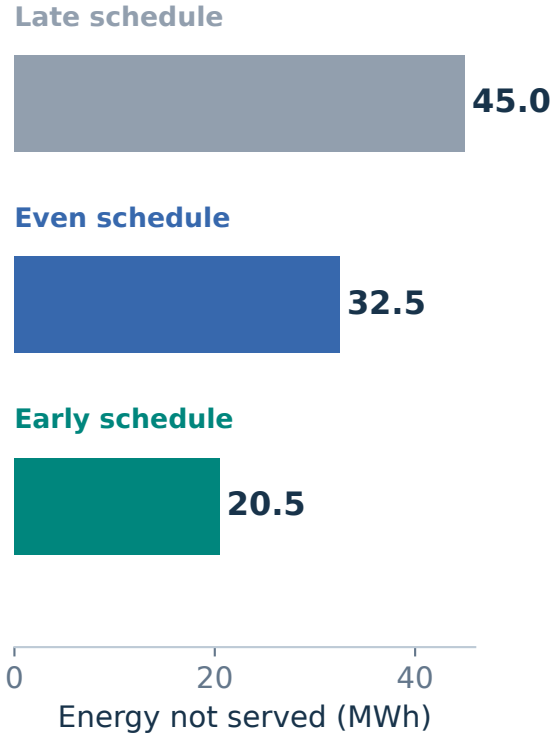

AREA HAS A PHYSICAL MEANING

$$E_{NS} = D\sum_{k}(1 - R_k)\,\Delta t_k \quad | \quad \text{D = 10 MW; horizon = 8 h; post-step values}$$

Synthetic teaching data. No feeder topology, power-flow, routing, uncertainty or optimization is modelled.
The graphic explains integration of unmet demand; it does not establish the benefit of any technology.