


Location: Demo Cold Storage - Freezer Room
Device Type: Temperature Sensor
Device Name: Freezer Unit 01 (Sample)
Dev EUI: 0000000000000001
Period: 2026-08-16 00:00 - 2026-08-22 23:59
Samples: 1008

Approved	Reviewed	Prepared
----------	----------	----------

- Alert: above -15.0 °C (> -15°C): 10 (3%)
- Warning: -18.0 °C to -15.0 °C (-18°C - -15°C): 6 (2%)

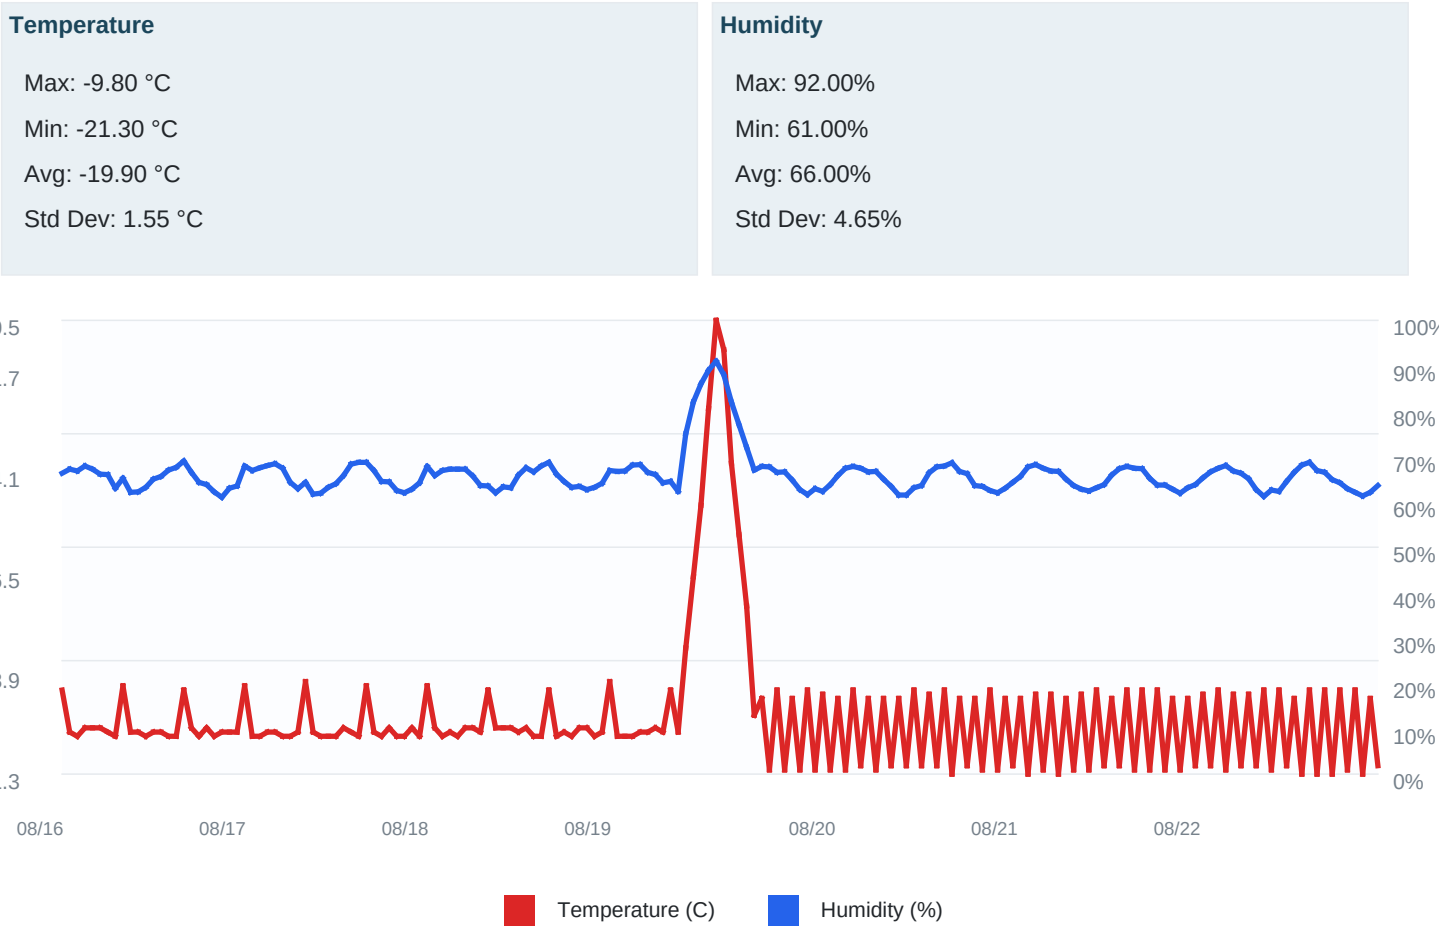

Date / Time	Temperati	Humidity Comment	Date / Time	Temperati	Humidity Comment	Date / Time	Temperati	Humidity Comments
26/08/16 00:00	-19.30 °C	66.30%	06:00	-20.30 °C	66.00%	12:00	-20.30 °C	65.00%
00:30	-19.50 °C	65.80%	06:30	-19.50 °C	64.10%	12:30	-19.30 °C	65.10%
01:00	-20.30 °C	67.20%	07:00	-20.40 °C	63.00%	13:00	-20.30 °C	65.60%
01:30	-21.20 °C	66.90%	07:30	-21.20 °C	63.60%	13:30	-21.30 °C	66.90%
02:00	-20.40 °C	66.80%	08:00	-19.20 °C	65.20%	14:00	-20.40 °C	67.00%
02:30	-19.40 °C	67.60%	08:30	-19.50 °C	62.10%	14:30	-19.30 °C	68.40%
03:00	-20.20 °C	67.90%	09:00	-20.30 °C	62.10%	15:00	-20.40 °C	67.60%
03:30	-21.10 °C	68.30%	09:30	-21.10 °C	61.20%	15:30	-21.10 °C	68.90%
04:00	-20.20 °C	67.20%	10:00	-20.30 °C	62.20%	16:00	-19.30 °C	69.00%
04:30	-19.50 °C	67.10%	10:30	-19.50 °C	62.20%	16:30	-19.40 °C	67.70%
05:00	-20.20 °C	66.10%	11:00	-20.40 °C	63.20%	17:00	-20.20 °C	66.50%
05:30	-21.10 °C	66.70%	11:30	-21.30 °C	63.90%	17:30	-21.10 °C	65.60%

Date / Time				Temperature	Humidity	Comments	Date / Time				Temperature	Humidity	Comments	Date / Time				Temperature	Humidity	Comments
18:00				-20.40 °C	64.30%		16:30				-19.30 °C	66.50%		15:00				-20.40 °C	67.90%	
18:30				-19.30 °C	64.50%		17:00				-20.30 °C	66.90%		15:30				-21.10 °C	67.00%	
19:00				-20.20 °C	63.80%		17:30				-21.30 °C	65.30%		16:00				-19.30 °C	68.70%	
19:30				-21.10 °C	62.30%		18:00				-20.40 °C	64.50%		16:30				-19.40 °C	66.70%	
20:00				-20.40 °C	62.20%		18:30				-19.40 °C	64.20%		17:00				-20.40 °C	66.10%	
20:30				-19.40 °C	62.90%		19:00				-20.20 °C	64.40%		17:30				-21.10 °C	64.80%	
21:00				-20.30 °C	61.00%		19:30				-21.20 °C	62.40%		18:00				-20.30 °C	64.50%	
21:30				-21.30 °C	62.00%		20:00				-20.40 °C	62.50%		18:30				-19.30 °C	64.70%	
22:00				-20.30 °C	63.00%		20:30				-19.30 °C	62.50%		19:00				-20.40 °C	63.20%	
22:30				-19.30 °C	62.90%		21:00				-20.40 °C	62.00%		19:30				-21.30 °C	62.00%	
23:00				-20.30 °C	63.50%		21:30				-21.30 °C	62.80%		20:00				-20.20 °C	63.40%	
23:30				-21.20 °C	65.10%		22:00				-20.20 °C	62.80%		20:30				-19.30 °C	62.00%	
26/08/17 00:00				-19.20 °C	67.90%		22:30				-19.30 °C	63.10%		21:00				-20.20 °C	62.70%	
00:30				-19.50 °C	65.30%		23:00				-20.40 °C	64.20%		21:30				-21.20 °C	61.80%	
01:00				-20.40 °C	66.90%		23:30				-21.20 °C	63.60%		22:00				-20.40 °C	63.20%	
01:30				-21.30 °C	68.00%		26/08/18 00:00				-19.20 °C	67.80%		22:30				-19.40 °C	62.30%	
02:00				-20.40 °C	67.50%		00:30				-19.30 °C	65.70%		23:00				-20.30 °C	64.10%	
02:30				-19.30 °C	66.90%		01:00				-20.20 °C	65.80%		23:30				-21.30 °C	63.60%	
03:00				-20.30 °C	68.00%		01:30				-21.10 °C	66.60%		26/08/19 00:00				-19.10 °C	66.90%	
03:30				-21.30 °C	67.40%		02:00				-20.40 °C	66.90%		00:30				-19.40 °C	66.00%	
04:00				-20.30 °C	68.40%		02:30				-19.30 °C	68.90%		01:00				-20.40 °C	66.70%	
04:30				-19.40 °C	67.50%		03:00				-20.30 °C	67.20%		01:30				-21.10 °C	66.50%	
05:00				-20.40 °C	67.40%		03:30				-21.10 °C	67.70%		02:00				-20.40 °C	66.80%	
05:30				-21.30 °C	66.50%		04:00				-20.40 °C	67.20%		02:30				-19.50 °C	68.30%	
06:00				-20.40 °C	64.30%		04:30				-19.30 °C	66.60%		03:00				-20.40 °C	68.10%	
06:30				-19.50 °C	63.60%		05:00				-20.20 °C	67.20%		03:30				-21.20 °C	67.30%	
07:00				-20.30 °C	62.90%		05:30				-21.10 °C	65.70%		04:00				-20.30 °C	68.20%	
07:30				-21.10 °C	63.00%		06:00				-20.20 °C	65.70%		04:30				-19.50 °C	67.20%	
08:00				-19.10 °C	64.30%		06:30				-19.40 °C	64.60%		05:00				-20.30 °C	66.50%	
08:30				-19.30 °C	63.10%		07:00				-20.30 °C	63.60%		05:30				-21.30 °C	65.80%	
09:00				-20.30 °C	61.70%	1	07:30				-21.20 °C	62.50%		06:00				-20.20 °C	66.00%	
09:30				-21.30 °C	61.40%		08:00				-19.30 °C	63.50%		06:30				-19.30 °C	64.50%	
10:00				-20.40 °C	61.90%		08:30				-19.40 °C	61.10%		07:00				-20.30 °C	64.20%	
10:30				-19.50 °C	63.80%		09:00				-20.20 °C	62.00%		07:30				-21.20 °C	62.60%	
11:00				-20.40 °C	63.20%		09:30				-21.30 °C	61.10%		08:00				-19.30 °C	64.50%	
11:30				-21.30 °C	64.20%		10:00				-20.20 °C	63.30%		08:30				-19.40 °C	62.20%	
12:00				-20.40 °C	64.00%		10:30				-19.30 °C	62.30%		09:00				-20.30 °C	62.30%	
12:30				-19.30 °C	66.10%		11:00				-20.20 °C	63.10%		09:30				-21.20 °C	61.60%	
13:00				-20.20 °C	65.80%		11:30				-21.30 °C	65.10%		10:00				-18.30 °C	75.00%	
13:30				-21.10 °C	67.40%		12:00				-20.30 °C	65.90%		10:10				-17.40 °C	79.00%	
14:00				-20.30 °C	68.30%		12:30				-19.50 °C	64.90%		10:20				-16.60 °C	82.00%	
14:30				-19.30 °C	68.30%		13:00				-20.20 °C	67.50%		10:30				-15.80 °C	84.00%	
15:00				-20.40 °C	68.70%		13:30				-21.10 °C	66.20%		10:40				-14.90 °C	86.00%	
15:30				-21.20 °C	66.90%		14:00				-20.40 °C	66.60%		10:50				-13.80 °C	88.00%	
16:00				-19.20 °C	68.70%		14:30				-19.30 °C	67.30%		11:00				-12.60 °C	89.00%	

Freezer Temperature Report (SAMPLE)

2026-08-16 00:00 - 2026-08-22 23:59 | Freezer Unit 01 (Sample) | Demo Cold Storage - Freezer Room

Date / Time Temperature Humidity Comments				Date / Time Temperature Humidity Comments				Date / Time Temperature Humidity Comments			
11:10	-11.50 °C	90.00%		06:30	-19.50 °C	65.00%		05:00	-20.20 °C	67.10%	
11:20	-10.50 °C	91.00%		07:00	-20.30 °C	62.80%		05:30	-21.30 °C	66.70%	
11:30	-9.80 °C	92.00%	2	07:30	-21.10 °C	63.40%		06:00	-20.40 °C	65.60%	
11:40	-11.20 °C	88.00%		08:00	-19.10 °C	65.20%		06:30	-19.50 °C	65.00%	
11:50	-12.60 °C	85.00%		08:30	-19.50 °C	61.50%		07:00	-20.20 °C	64.20%	
12:00	-13.90 °C	82.00%		09:00	-20.30 °C	62.70%		07:30	-21.20 °C	63.60%	
12:10	-14.80 °C	79.00%		09:30	-21.10 °C	61.50%		08:00	-19.20 °C	63.50%	
12:20	-15.60 °C	77.00%		10:00	-20.40 °C	62.80%		08:30	-19.40 °C	62.80%	
12:30	-16.40 °C	74.00%		10:30	-19.30 °C	63.10%		09:00	-20.30 °C	62.70%	
12:40	-17.30 °C	72.00%		11:00	-20.30 °C	63.90%		09:30	-21.20 °C	62.40%	
13:00	-18.80 °C	69.00%		11:30	-21.10 °C	63.60%		10:00	-20.40 °C	63.40%	
13:30	-19.90 °C	67.00%		12:00	-20.40 °C	65.00%		10:30	-19.30 °C	63.10%	
14:00	-20.20 °C	68.20%		12:30	-19.40 °C	66.40%		11:00	-20.30 °C	64.00%	
14:30	-19.50 °C	67.80%		13:00	-20.20 °C	66.50%		11:30	-21.10 °C	63.80%	
15:00	-20.30 °C	67.20%		13:30	-21.10 °C	67.70%		12:00	-20.30 °C	65.90%	
15:30	-21.20 °C	67.70%		14:00	-20.20 °C	66.80%		12:30	-19.50 °C	65.90%	
16:00	-19.10 °C	70.20%		14:30	-19.30 °C	67.90%		13:00	-20.20 °C	66.60%	
16:30	-19.30 °C	66.50%		15:00	-20.30 °C	68.50%		13:30	-21.10 °C	67.30%	
17:00	-20.20 °C	65.80%		15:30	-21.30 °C	68.60%		14:00	-20.30 °C	67.90%	
17:30	-21.20 °C	66.60%		16:00	-19.10 °C	69.80%		14:30	-19.30 °C	67.80%	
18:00	-20.40 °C	64.40%		16:30	-19.50 °C	66.70%		15:00	-20.20 °C	68.80%	
18:30	-19.50 °C	64.80%		17:00	-20.40 °C	66.20%		15:30	-21.20 °C	67.40%	
19:00	-20.20 °C	63.60%		17:30	-21.10 °C	66.20%		16:00	-19.20 °C	70.50%	
19:30	-21.20 °C	62.70%		18:00	-20.20 °C	65.60%		16:30	-19.30 °C	67.30%	3
20:00	-20.30 °C	62.90%		18:30	-19.50 °C	63.60%		17:00	-20.30 °C	67.40%	
20:30	-19.30 °C	61.60%		19:00	-20.20 °C	63.50%		17:30	-21.20 °C	65.20%	
21:00	-20.40 °C	61.00%		19:30	-21.20 °C	63.40%		18:00	-20.40 °C	65.90%	
21:30	-21.20 °C	62.90%		20:00	-20.30 °C	61.90%		18:30	-19.30 °C	63.70%	
22:00	-20.40 °C	62.10%		20:30	-19.30 °C	62.50%		19:00	-20.20 °C	64.20%	
22:30	-19.40 °C	62.30%		21:00	-20.40 °C	61.80%		19:30	-21.20 °C	63.70%	
23:00	-20.40 °C	62.80%		21:30	-21.20 °C	62.00%		20:00	-20.40 °C	62.70%	
23:30	-21.20 °C	63.80%		22:00	-20.40 °C	62.70%		20:30	-19.50 °C	62.80%	
26/08/20 00:00	-19.20 °C	66.90%		22:30	-19.50 °C	63.00%		21:00	-20.30 °C	62.40%	
00:30	-19.50 °C	65.80%		23:00	-20.40 °C	63.60%		21:30	-21.20 °C	61.90%	
01:00	-20.40 °C	66.60%		23:30	-21.10 °C	64.30%		22:00	-20.30 °C	62.00%	
01:30	-21.20 °C	67.40%		26/08/21 00:00	-19.20 °C	67.50%		22:30	-19.50 °C	63.10%	
02:00	-20.40 °C	68.40%		00:30	-19.50 °C	65.60%		23:00	-20.30 °C	64.30%	
02:30	-19.30 °C	67.80%		01:00	-20.30 °C	66.00%		23:30	-21.10 °C	63.80%	
03:00	-20.40 °C	67.10%		01:30	-21.30 °C	67.70%		26/08/22 00:00	-19.10 °C	67.80%	
03:30	-21.10 °C	67.40%		02:00	-20.20 °C	67.90%		00:30	-19.40 °C	65.30%	
04:00	-20.40 °C	67.90%		02:30	-19.40 °C	68.20%		01:00	-20.30 °C	65.70%	
04:30	-19.50 °C	66.60%		03:00	-20.30 °C	67.30%		01:30	-21.10 °C	66.60%	
05:00	-20.20 °C	66.20%		03:30	-21.20 °C	67.40%		02:00	-20.40 °C	68.10%	
05:30	-21.20 °C	66.70%		04:00	-20.40 °C	67.10%		02:30	-19.30 °C	67.40%	
06:00	-20.30 °C	65.40%		04:30	-19.40 °C	66.80%		03:00	-20.30 °C	68.20%	

Date / Time	Temperature	Humidity	Comments
03:30	-21.20 °C	68.00%	
04:00	-20.20 °C	67.30%	
04:30	-19.40 °C	66.80%	
05:00	-20.20 °C	66.50%	
05:30	-21.10 °C	66.30%	
06:00	-20.40 °C	64.40%	
06:30	-19.40 °C	65.10%	
07:00	-20.40 °C	64.40%	
07:30	-21.10 °C	62.70%	
08:00	-19.30 °C	63.50%	
08:30	-19.30 °C	61.20%	
09:00	-20.40 °C	61.30%	
09:30	-21.20 °C	62.60%	
10:00	-20.30 °C	61.70%	
10:30	-19.30 °C	62.30%	
11:00	-20.20 °C	64.30%	
11:30	-21.10 °C	64.50%	
12:00	-20.30 °C	64.30%	
12:30	-19.50 °C	66.50%	
13:00	-20.20 °C	66.20%	
13:30	-21.30 °C	68.10%	
14:00	-20.30 °C	67.20%	
14:30	-19.30 °C	68.70%	
15:00	-20.20 °C	67.60%	
15:30	-21.30 °C	66.90%	
16:00	-19.10 °C	69.00%	
16:30	-19.30 °C	66.50%	
17:00	-20.40 °C	65.90%	
17:30	-21.30 °C	64.90%	
18:00	-20.20 °C	64.70%	
18:30	-19.30 °C	64.20%	
19:00	-20.30 °C	62.80%	
19:30	-21.20 °C	62.90%	
20:00	-20.40 °C	62.80%	
20:30	-19.30 °C	62.10%	
21:00	-20.20 °C	61.40%	
21:30	-21.30 °C	61.30%	
22:00	-20.30 °C	62.40%	
22:30	-19.50 °C	62.10%	
23:00	-20.30 °C	62.80%	
23:30	-21.10 °C	63.60%	

Freezer Temperature Report (SAMPLE)

2026-08-16 00:00 - 2026-08-22 23:59 | Freezer Unit 01 (Sample) | Demo Cold Storage - Freezer Room

Report Notes

1. 2026-08-17 09:00 - Facility Staff: Routine temperature check - Manual verification with handheld probe: -20.3 °C. Sensor agrees within 0.3 °C. Humidity 62% - within normal range. Unit operating normally.
2. 2026-08-19 11:30 - Facility Staff: Door left ajar - corrected - Freezer door found ajar following the morning delivery. Internal temperature rose to -9.8 °C and humidity to 92% as ambient air entered. Door closed at 11:30; temperature returned below -18 °C by 12:50. Stored product inspected - no loss.
3. 2026-08-21 16:30 - Facility Staff: Weekly cleaning completed - Evaporator and door seals cleaned. Unit returned to service; operating normally.