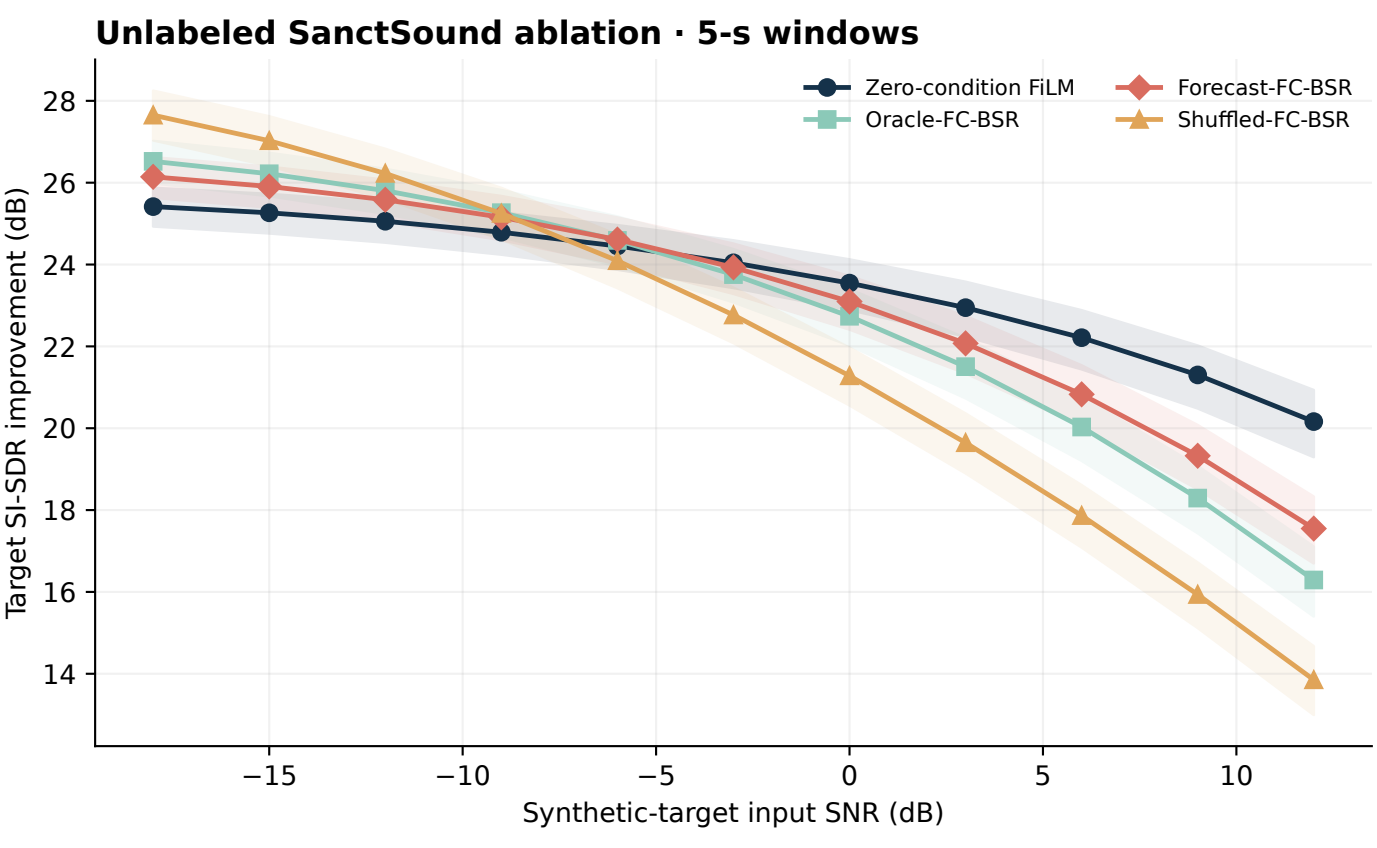
Unlabeled SanctSound ablation · 5-s windows
Zero-condition FiLM
Oracle-FC-BSR
Forecast-FC-BSR
Shuffled-FC-BSR
Target SI-SDR improvement (dB)
28
26
24
22
20
18
16
14
−15
−10
−5
0
5
10
Synthetic-target input SNR (dB)