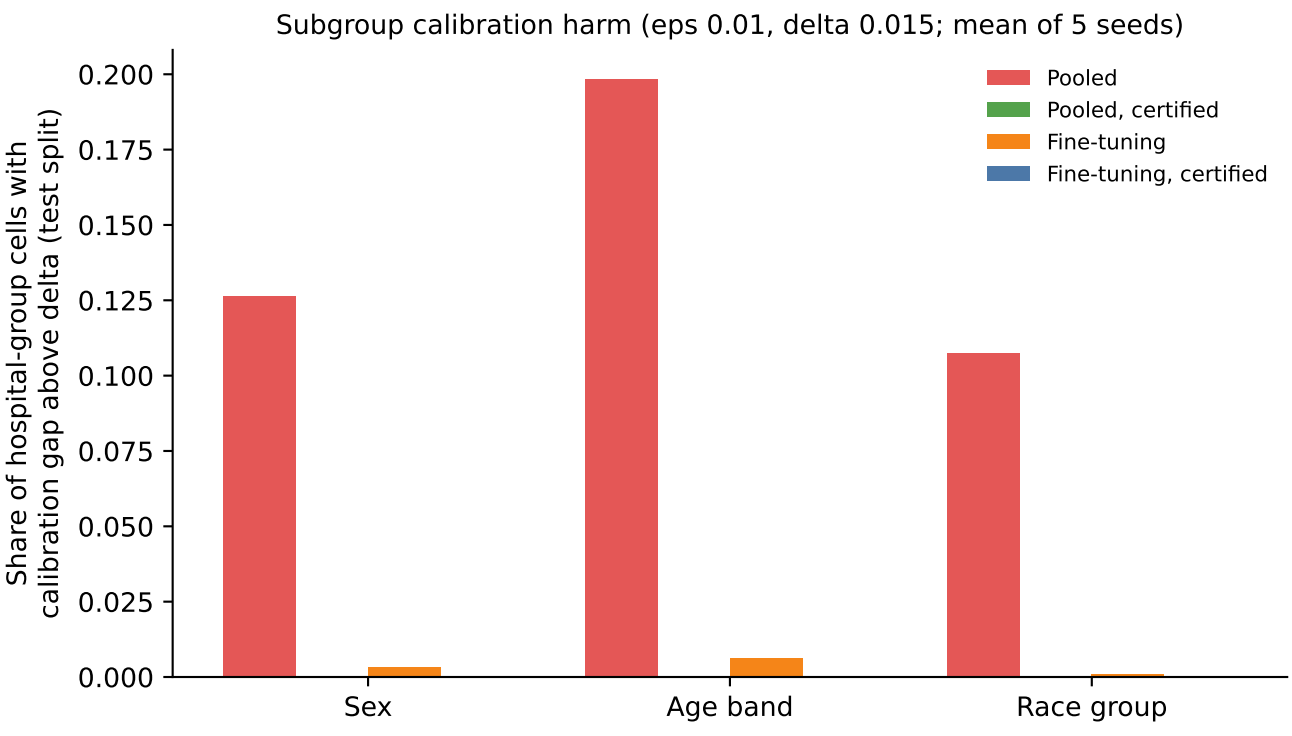
Subgroup calibration harm (eps 0.01, delta 0.015; mean of 5 seeds)
Share of hospital-group cells with calibration gap above delta (test split)
0.200
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
Pooled
Pooled, certified
Fine-tuning
Fine-tuning, certified
Sex
Age band
Race group