



Predicted versus official-condition measured reversal 95% intervals use crossed candidate x cancer bootstrap

Dual stream | signed wtrs

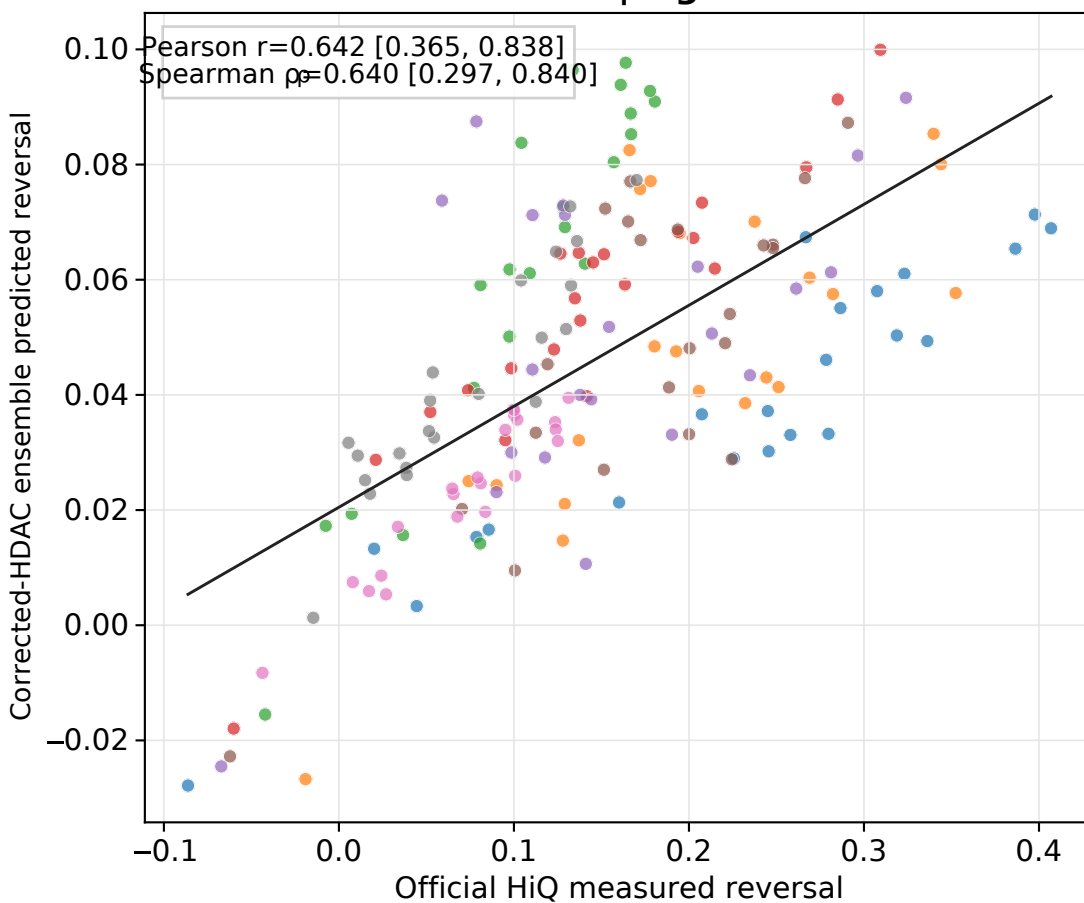


Fingerprint MLP | signed wtrs

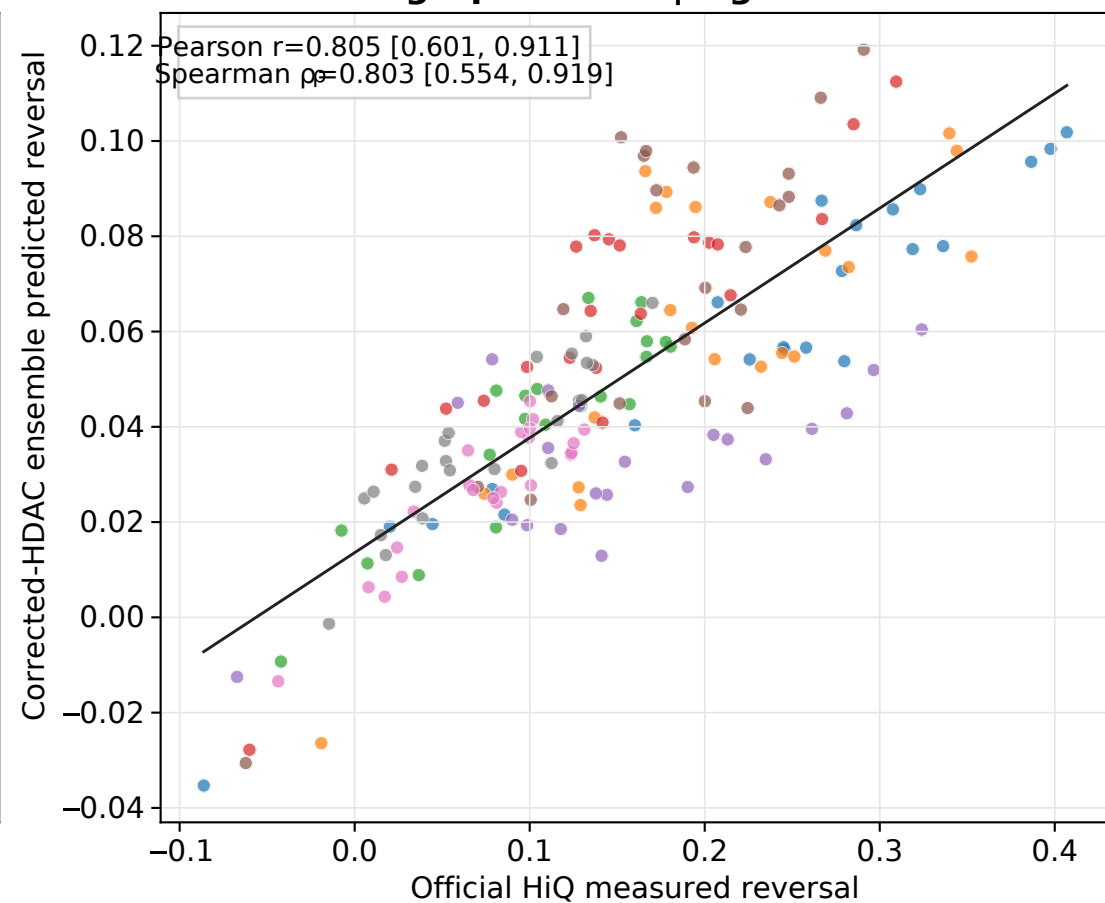

Compound

- Mocetinostat
- NCH-51
- TC-H-106
- Belinostat
- PCI-24781
- Panobinostat
- Entinostat
- Vorinostat

Dual stream | spearman reversal

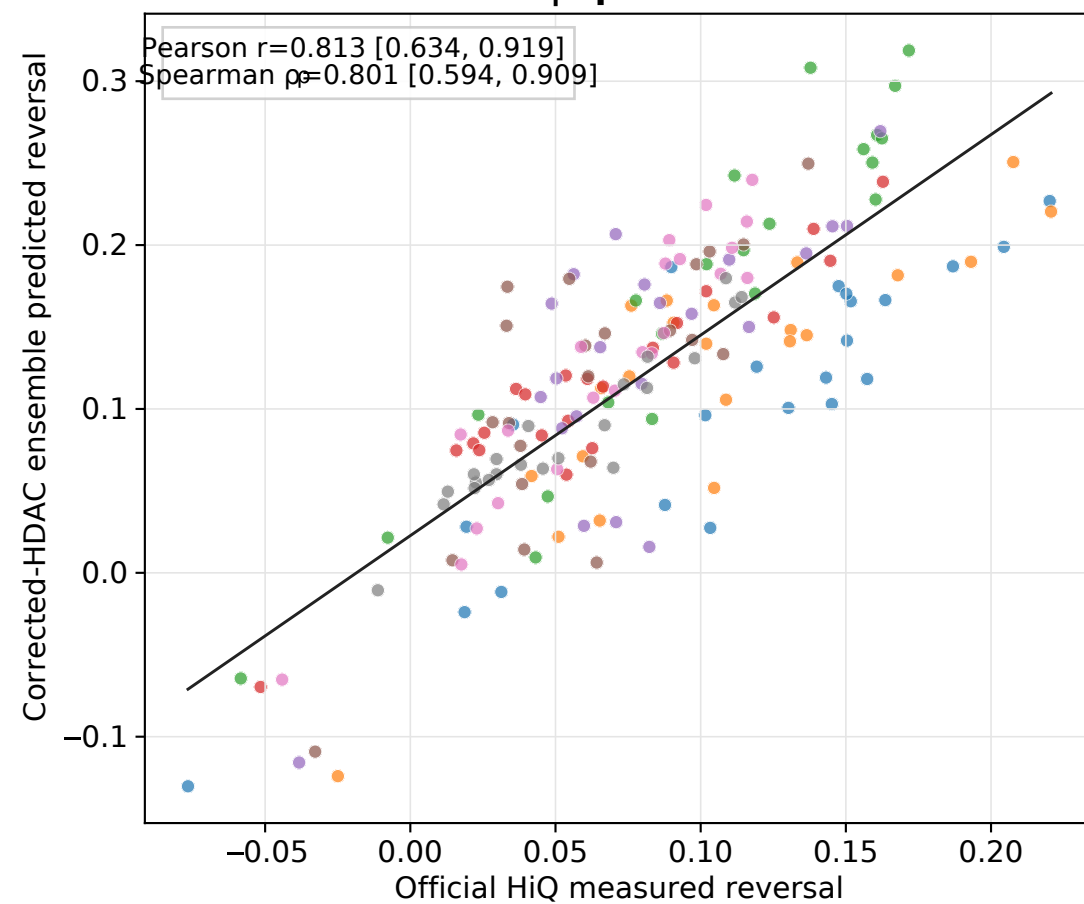

Fingerprint MLP | spearman reversal

