

TT191005 – OPENweb - Controller Preset with Selection

Note

This Support Knowledge Base article KB is the result of a support request.

It is not part of the official documentation of DEOS AG and does not claim to be complete.

The article is intended to support the solution of a similar problem.

If you have any questions, comments or additions, please contact DEOS AG Support.

Title

OPENweb - Controller Preset with Selection (TT191005)

Object

OPENweb

Reference version

8

Date

10.2019

Author

EK

Goal

Use OPENweb to preset selective HTML pages in controller

Content:

W Tools - Offline parameterization

Program Server Function selection Help


Check default value mode **Group parameterization mode** Number OK 0 Number of errors 0

DDC101	DI1	(0)	UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
01: DCS.Open	DI2	(0)	UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
AHU	DI3	(0)	UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
AHU			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Analog			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Controller			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Convert			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Counter			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Delay On/Off			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Delay On/Off			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Digital			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Enthalpy			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Events			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Graphi			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Macro			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Macro			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Modbu			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)
Modbu			UI1	0	UI2	0	UI3	0	0	(0)	(1)	(0)	(0)


Apply parameters
Set default values
Overwrite data points in the controller

TT191005 – OPENweb - Controller Preset with Selection


1. If you want to set all the “Input” to the default values assigned in FUP, the easiest way is to do a “Preset” in the controller via browser access. But sometimes you may only want to set a few pages to default values, then you can do it in OPENweb
2. Please refer to TT180808 to setup OPENweb and controller. Start OPENweb control panel, click on “Extras”, “Tools”

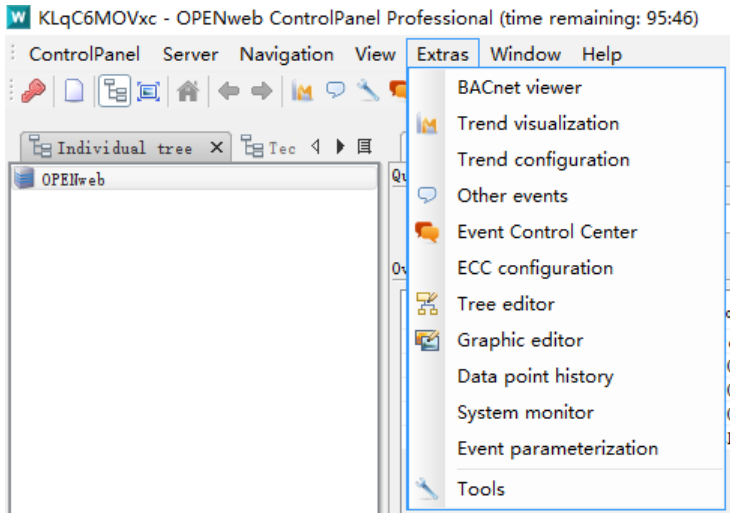


3. In “OPENweb Tools”, click on “Program”, “Offline parameteration”

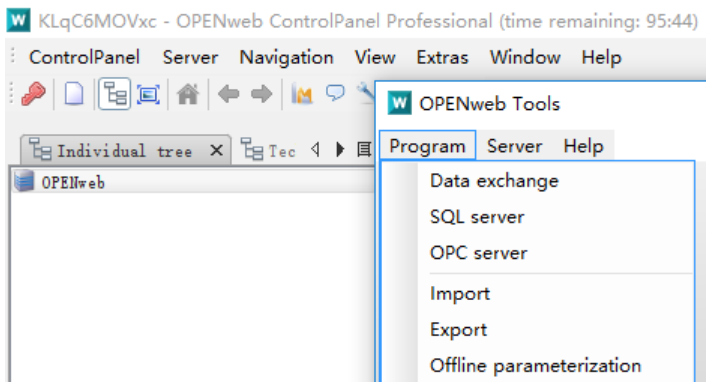


4. Click on “Function selection”, “Editing a controller group”

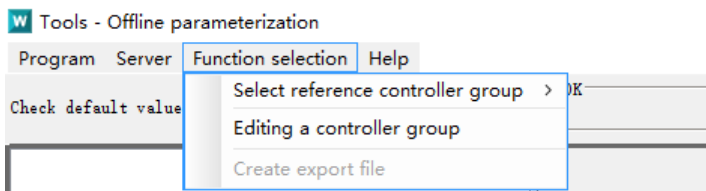


5. Select the controller and click “OK”

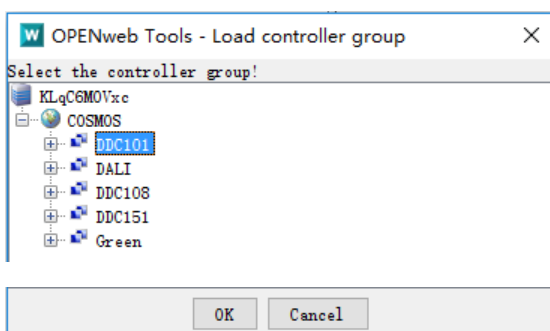


6. Click on “Group parameterization mode”

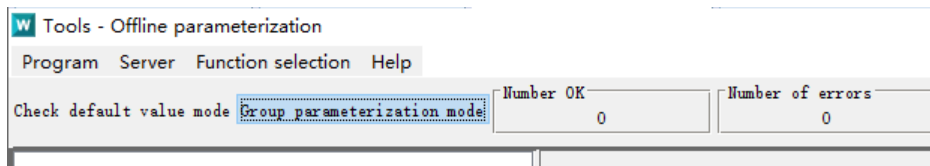


7. Select the HTML page that you want to set default value

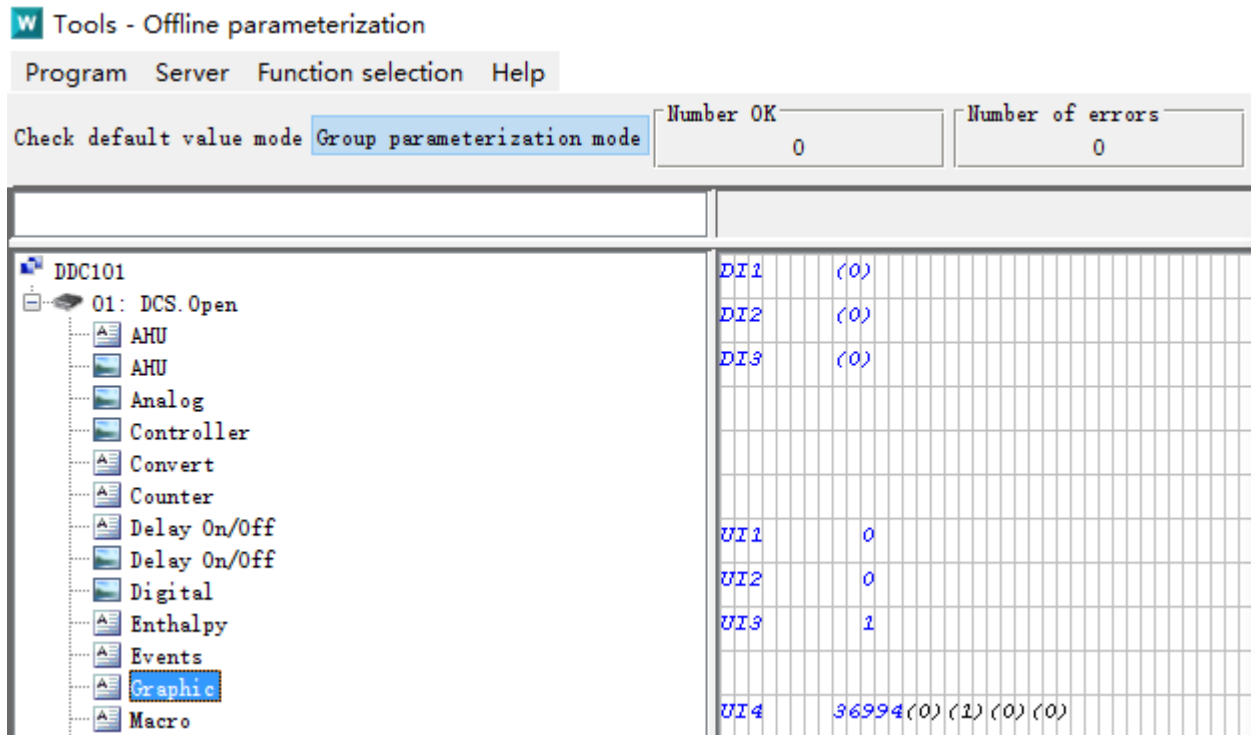


8. Right click and click on “Set default values”

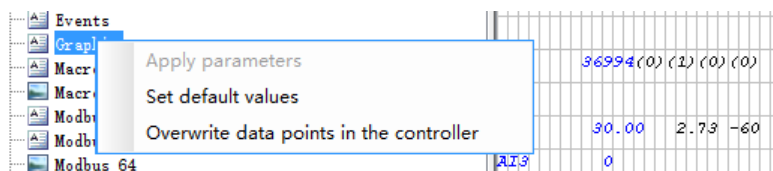


9. Right click on the page again and select “Apply parameters”

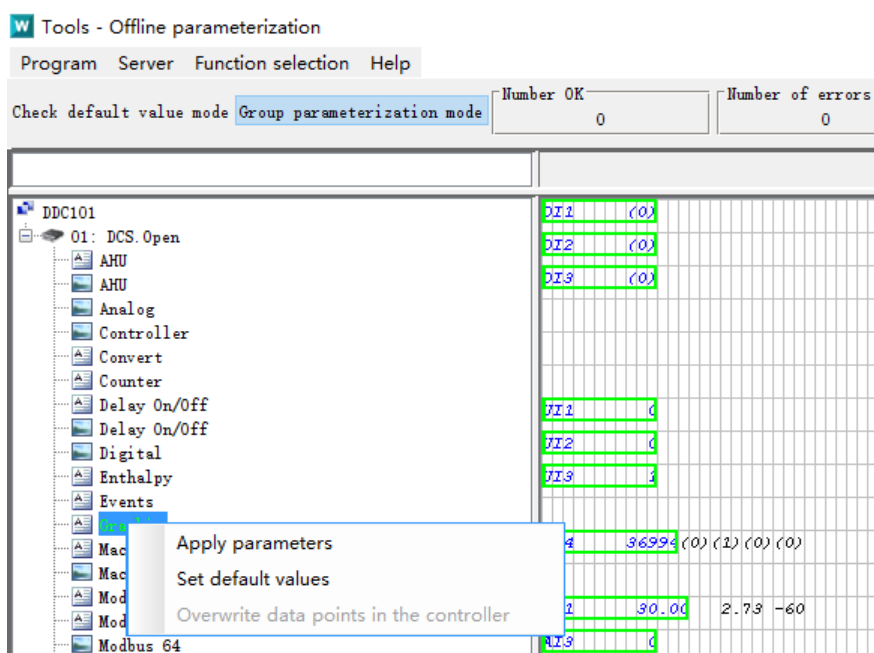

10. Now you can see all the “Input” are set to default values. Right click on the page again and select “Overwrite data points in the controller”

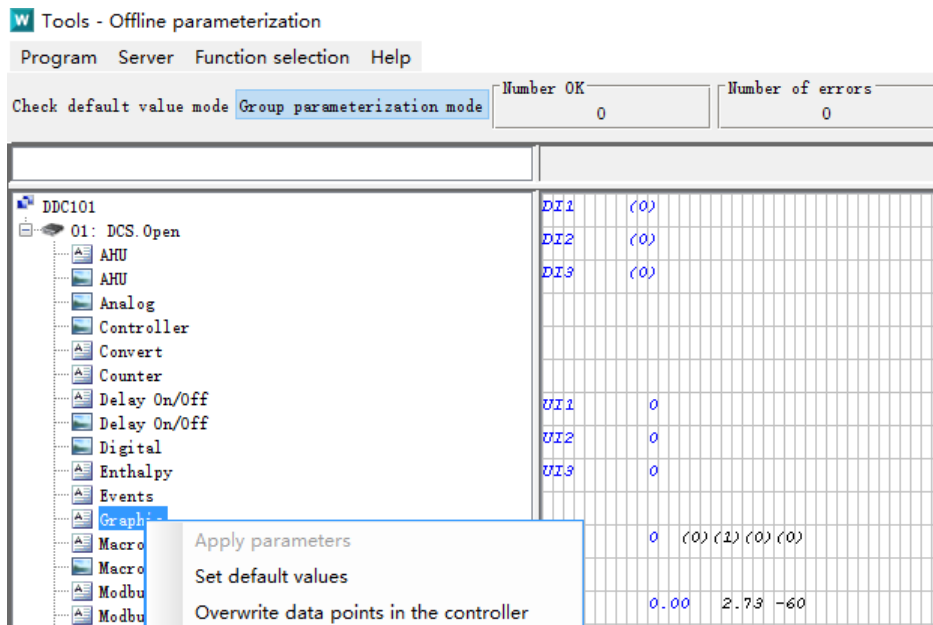

11. Click “Yes” to update the controller. Done!

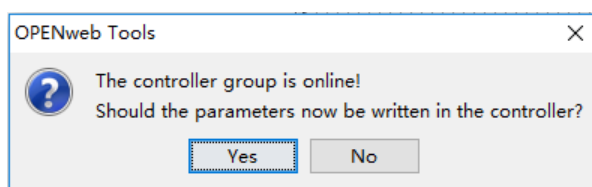

12. You can do a lot more functions using “Offline parameterization”, please refer to the OPENweb manual for details