


	1	2	3	4	5	6	7	8	9	10	11																																																																																																						
A	<table><tr><td>Label</td><td>A21.A10.A80.1</td><td>A21.A10.A80.1</td><td>A21.A10.A80.1</td><td>A21.A10.A80.1</td></tr><tr><td>Nominal diameter</td><td></td><td></td><td></td><td></td></tr><tr><td>Nominal pressure</td><td></td><td></td><td></td><td></td></tr><tr><td>Pipe spec</td><td></td><td></td><td></td><td></td></tr><tr><td>Medium</td><td>None</td><td>None</td><td>None</td><td>None</td></tr><tr><td>Volume flow</td><td>/ / m³/h</td><td>/ / m³/h</td><td>/ / m³/h</td><td>/ / m³/h</td></tr><tr><td>Operating temperature</td><td>/ / °C</td><td>/ / °C</td><td>/ / °C</td><td>/ / °C</td></tr><tr><td>Operating pressure</td><td>/ / bar</td><td>/ / bar</td><td>/ / bar</td><td>/ / bar</td></tr></table>											Label	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1	Nominal diameter					Nominal pressure					Pipe spec					Medium	None	None	None	None	Volume flow	/ / m³/h	/ / m³/h	/ / m³/h	/ / m³/h	Operating temperature	/ / °C	/ / °C	/ / °C	/ / °C	Operating pressure	/ / bar	/ / bar	/ / bar	/ / bar																																																														
Label	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1																																																																																																													
Nominal diameter																																																																																																																	
Nominal pressure																																																																																																																	
Pipe spec																																																																																																																	
Medium	None	None	None	None																																																																																																													
Volume flow	/ / m³/h	/ / m³/h	/ / m³/h	/ / m³/h																																																																																																													
Operating temperature	/ / °C	/ / °C	/ / °C	/ / °C																																																																																																													
Operating pressure	/ / bar	/ / bar	/ / bar	/ / bar																																																																																																													
B																																																																																																																	
C																																																																																																																	
D																																																																																																																	
E																																																																																																																	
F																																																																																																																	
G																																																																																																																	
H	<table><tr><td>Name</td><td>P008</td><td>W003</td></tr><tr><td>Description</td><td>Rotary pump</td><td>Plate-type heat ex</td></tr><tr><td>Process data 1</td><td>/ / bar</td><td>/ / bar</td></tr><tr><td>Process data 2</td><td>/ / °C</td><td>/ / °C</td></tr><tr><td>Process data 3</td><td></td><td></td></tr><tr><td>Design data 1</td><td>/ m³/h</td><td>m²</td></tr><tr><td>Design data 2</td><td>No actuator</td><td>/ / m³/h</td></tr><tr><td>Design data 3</td><td>m</td><td>KW</td></tr><tr><td>Design data 4</td><td></td><td>°C</td></tr></table> <table><tr><td colspan="4">Project-No.: SO1</td><td colspan="2" rowspan="2">SIEMENS</td><td colspan="4">Customer:</td></tr><tr><td colspan="4">Project: Base project IDB</td><td colspan="4">Order number:</td></tr><tr><td colspan="4">P&ID diagram in relation to EN 10628, DIN A2</td><td colspan="4">Draw. no. engineer:</td><td colspan="4">Draw. no. customer:</td></tr><tr><td colspan="2"></td><td colspan="2"></td><td>Date</td><td colspan="2">21.02.2018</td><td colspan="2"></td><td colspan="2">Unit: #A10.A21.A10</td></tr><tr><td colspan="2"></td><td colspan="2"></td><td>Name</td><td colspan="2">@SETUP</td><td colspan="2">Origin:</td><td colspan="2">Location:</td></tr><tr><td colspan="2"></td><td colspan="2"></td><td>Checked</td><td colspan="2"></td><td colspan="2">Replacement for:</td><td colspan="2">Sheet: 002</td></tr><tr><td colspan="2">Ind. Change</td><td colspan="2">Date</td><td colspan="2">Name</td><td colspan="2">Standard</td><td colspan="2">Replaced by:</td><td colspan="2">From: 2</td></tr></table>											Name	P008	W003	Description	Rotary pump	Plate-type heat ex	Process data 1	/ / bar	/ / bar	Process data 2	/ / °C	/ / °C	Process data 3			Design data 1	/ m³/h	m²	Design data 2	No actuator	/ / m³/h	Design data 3	m	KW	Design data 4		°C	Project-No.: SO1				SIEMENS		Customer:				Project: Base project IDB				Order number:				P&ID diagram in relation to EN 10628, DIN A2				Draw. no. engineer:				Draw. no. customer:								Date	21.02.2018				Unit: #A10.A21.A10						Name	@SETUP		Origin:		Location:						Checked			Replacement for:		Sheet: 002		Ind. Change		Date		Name		Standard		Replaced by:		From: 2	
Name	P008	W003																																																																																																															
Description	Rotary pump	Plate-type heat ex																																																																																																															
Process data 1	/ / bar	/ / bar																																																																																																															
Process data 2	/ / °C	/ / °C																																																																																																															
Process data 3																																																																																																																	
Design data 1	/ m³/h	m²																																																																																																															
Design data 2	No actuator	/ / m³/h																																																																																																															
Design data 3	m	KW																																																																																																															
Design data 4		°C																																																																																																															
Project-No.: SO1				SIEMENS		Customer:																																																																																																											
Project: Base project IDB						Order number:																																																																																																											
P&ID diagram in relation to EN 10628, DIN A2				Draw. no. engineer:				Draw. no. customer:																																																																																																									
				Date	21.02.2018				Unit: #A10.A21.A10																																																																																																								
				Name	@SETUP		Origin:		Location:																																																																																																								
				Checked			Replacement for:		Sheet: 002																																																																																																								
Ind. Change		Date		Name		Standard		Replaced by:		From: 2																																																																																																							
	1	2	3	4	5	6	7	8	9	10	11																																																																																																						

	1	2	3	4	5	6	7	8	9	10	11																																																																																																	
A	<table><tr><td>Label</td><td>A21.A10.A80.1</td><td>A21.A10.A80.1</td><td>A21.A10.A80.1</td><td>A21.A10.A80.1</td></tr><tr><td>Nominal diameter</td><td></td><td></td><td></td><td></td></tr><tr><td>Nominal pressure</td><td></td><td></td><td></td><td></td></tr><tr><td>Pipe spec</td><td></td><td></td><td></td><td></td></tr><tr><td>Medium</td><td>None</td><td>None</td><td>None</td><td>None</td></tr><tr><td>Volume flow</td><td>/ / m³/h</td><td>/ / m³/h</td><td>/ / m³/h</td><td>/ / m³/h</td></tr><tr><td>Operating temperature</td><td>/ / °C</td><td>/ / °C</td><td>/ / °C</td><td>/ / °C</td></tr><tr><td>Operating pressure</td><td>/ / bar</td><td>/ / bar</td><td>/ / bar</td><td>/ / bar</td></tr></table>											Label	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1	Nominal diameter					Nominal pressure					Pipe spec					Medium	None	None	None	None	Volume flow	/ / m³/h	/ / m³/h	/ / m³/h	/ / m³/h	Operating temperature	/ / °C	/ / °C	/ / °C	/ / °C	Operating pressure	/ / bar	/ / bar	/ / bar	/ / bar																																																									
Label	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1	A21.A10.A80.1																																																																																																								
Nominal diameter																																																																																																												
Nominal pressure																																																																																																												
Pipe spec																																																																																																												
Medium	None	None	None	None																																																																																																								
Volume flow	/ / m³/h	/ / m³/h	/ / m³/h	/ / m³/h																																																																																																								
Operating temperature	/ / °C	/ / °C	/ / °C	/ / °C																																																																																																								
Operating pressure	/ / bar	/ / bar	/ / bar	/ / bar																																																																																																								
B																																																																																																												
C																																																																																																												
D																																																																																																												
E																																																																																																												
F																																																																																																												
G																																																																																																												
H	<table><tr><td>Name</td><td>P008</td><td>W003</td></tr><tr><td>Description</td><td>Rotary pump</td><td>Plate-type heat ex</td></tr><tr><td>Process data 1</td><td>/ / bar</td><td>/ / bar</td></tr><tr><td>Process data 2</td><td>/ / °C</td><td>/ / °C</td></tr><tr><td>Process data 3</td><td></td><td></td></tr><tr><td>Design data 1</td><td>/ m³/h</td><td>m²</td></tr><tr><td>Design data 2</td><td>No actuator</td><td>/ / m³/h</td></tr><tr><td>Design data 3</td><td>m</td><td>KW</td></tr><tr><td>Design data 4</td><td></td><td>°C</td></tr></table> <table><tr><td colspan="4">Project-No.: SO1</td><td colspan="2" rowspan="2">SIEMENS</td><td colspan="2">Customer:</td></tr><tr><td colspan="4">Project: Base project IDB</td><td colspan="2">Order number:</td></tr><tr><td colspan="4">P&ID diagram in relation to EN 10628, DIN A2</td><td colspan="2"></td><td colspan="2">Draw. no. engineer:</td></tr><tr><td colspan="4"></td><td colspan="2"></td><td colspan="2">Draw. no. customer:</td></tr><tr><td></td><td></td><td></td><td></td><td>Date</td><td>21.02.2018</td><td colspan="2">Unit: #A10.A21.A10</td></tr><tr><td></td><td></td><td></td><td></td><td>Name</td><td>@SETUP</td><td colspan="2">Origin:</td></tr><tr><td></td><td></td><td></td><td></td><td>Checked</td><td></td><td colspan="2">Replacement for:</td></tr><tr><td>Ind.</td><td>Change</td><td>Date</td><td>Name</td><td>Standard</td><td></td><td>Replaced by:</td><td>Sheet: 002</td></tr><tr><td></td><td></td><td></td><td></td><td></td><td></td><td>From:</td><td>2</td></tr></table>											Name	P008	W003	Description	Rotary pump	Plate-type heat ex	Process data 1	/ / bar	/ / bar	Process data 2	/ / °C	/ / °C	Process data 3			Design data 1	/ m³/h	m²	Design data 2	No actuator	/ / m³/h	Design data 3	m	KW	Design data 4		°C	Project-No.: SO1				SIEMENS		Customer:		Project: Base project IDB				Order number:		P&ID diagram in relation to EN 10628, DIN A2						Draw. no. engineer:								Draw. no. customer:						Date	21.02.2018	Unit: #A10.A21.A10						Name	@SETUP	Origin:						Checked		Replacement for:		Ind.	Change	Date	Name	Standard		Replaced by:	Sheet: 002							From:	2
Name	P008	W003																																																																																																										
Description	Rotary pump	Plate-type heat ex																																																																																																										
Process data 1	/ / bar	/ / bar																																																																																																										
Process data 2	/ / °C	/ / °C																																																																																																										
Process data 3																																																																																																												
Design data 1	/ m³/h	m²																																																																																																										
Design data 2	No actuator	/ / m³/h																																																																																																										
Design data 3	m	KW																																																																																																										
Design data 4		°C																																																																																																										
Project-No.: SO1				SIEMENS		Customer:																																																																																																						
Project: Base project IDB						Order number:																																																																																																						
P&ID diagram in relation to EN 10628, DIN A2						Draw. no. engineer:																																																																																																						
						Draw. no. customer:																																																																																																						
				Date	21.02.2018	Unit: #A10.A21.A10																																																																																																						
				Name	@SETUP	Origin:																																																																																																						
				Checked		Replacement for:																																																																																																						
Ind.	Change	Date	Name	Standard		Replaced by:	Sheet: 002																																																																																																					
						From:	2																																																																																																					
	1	2	3	4	5	6	7	8	9	10	11																																																																																																	

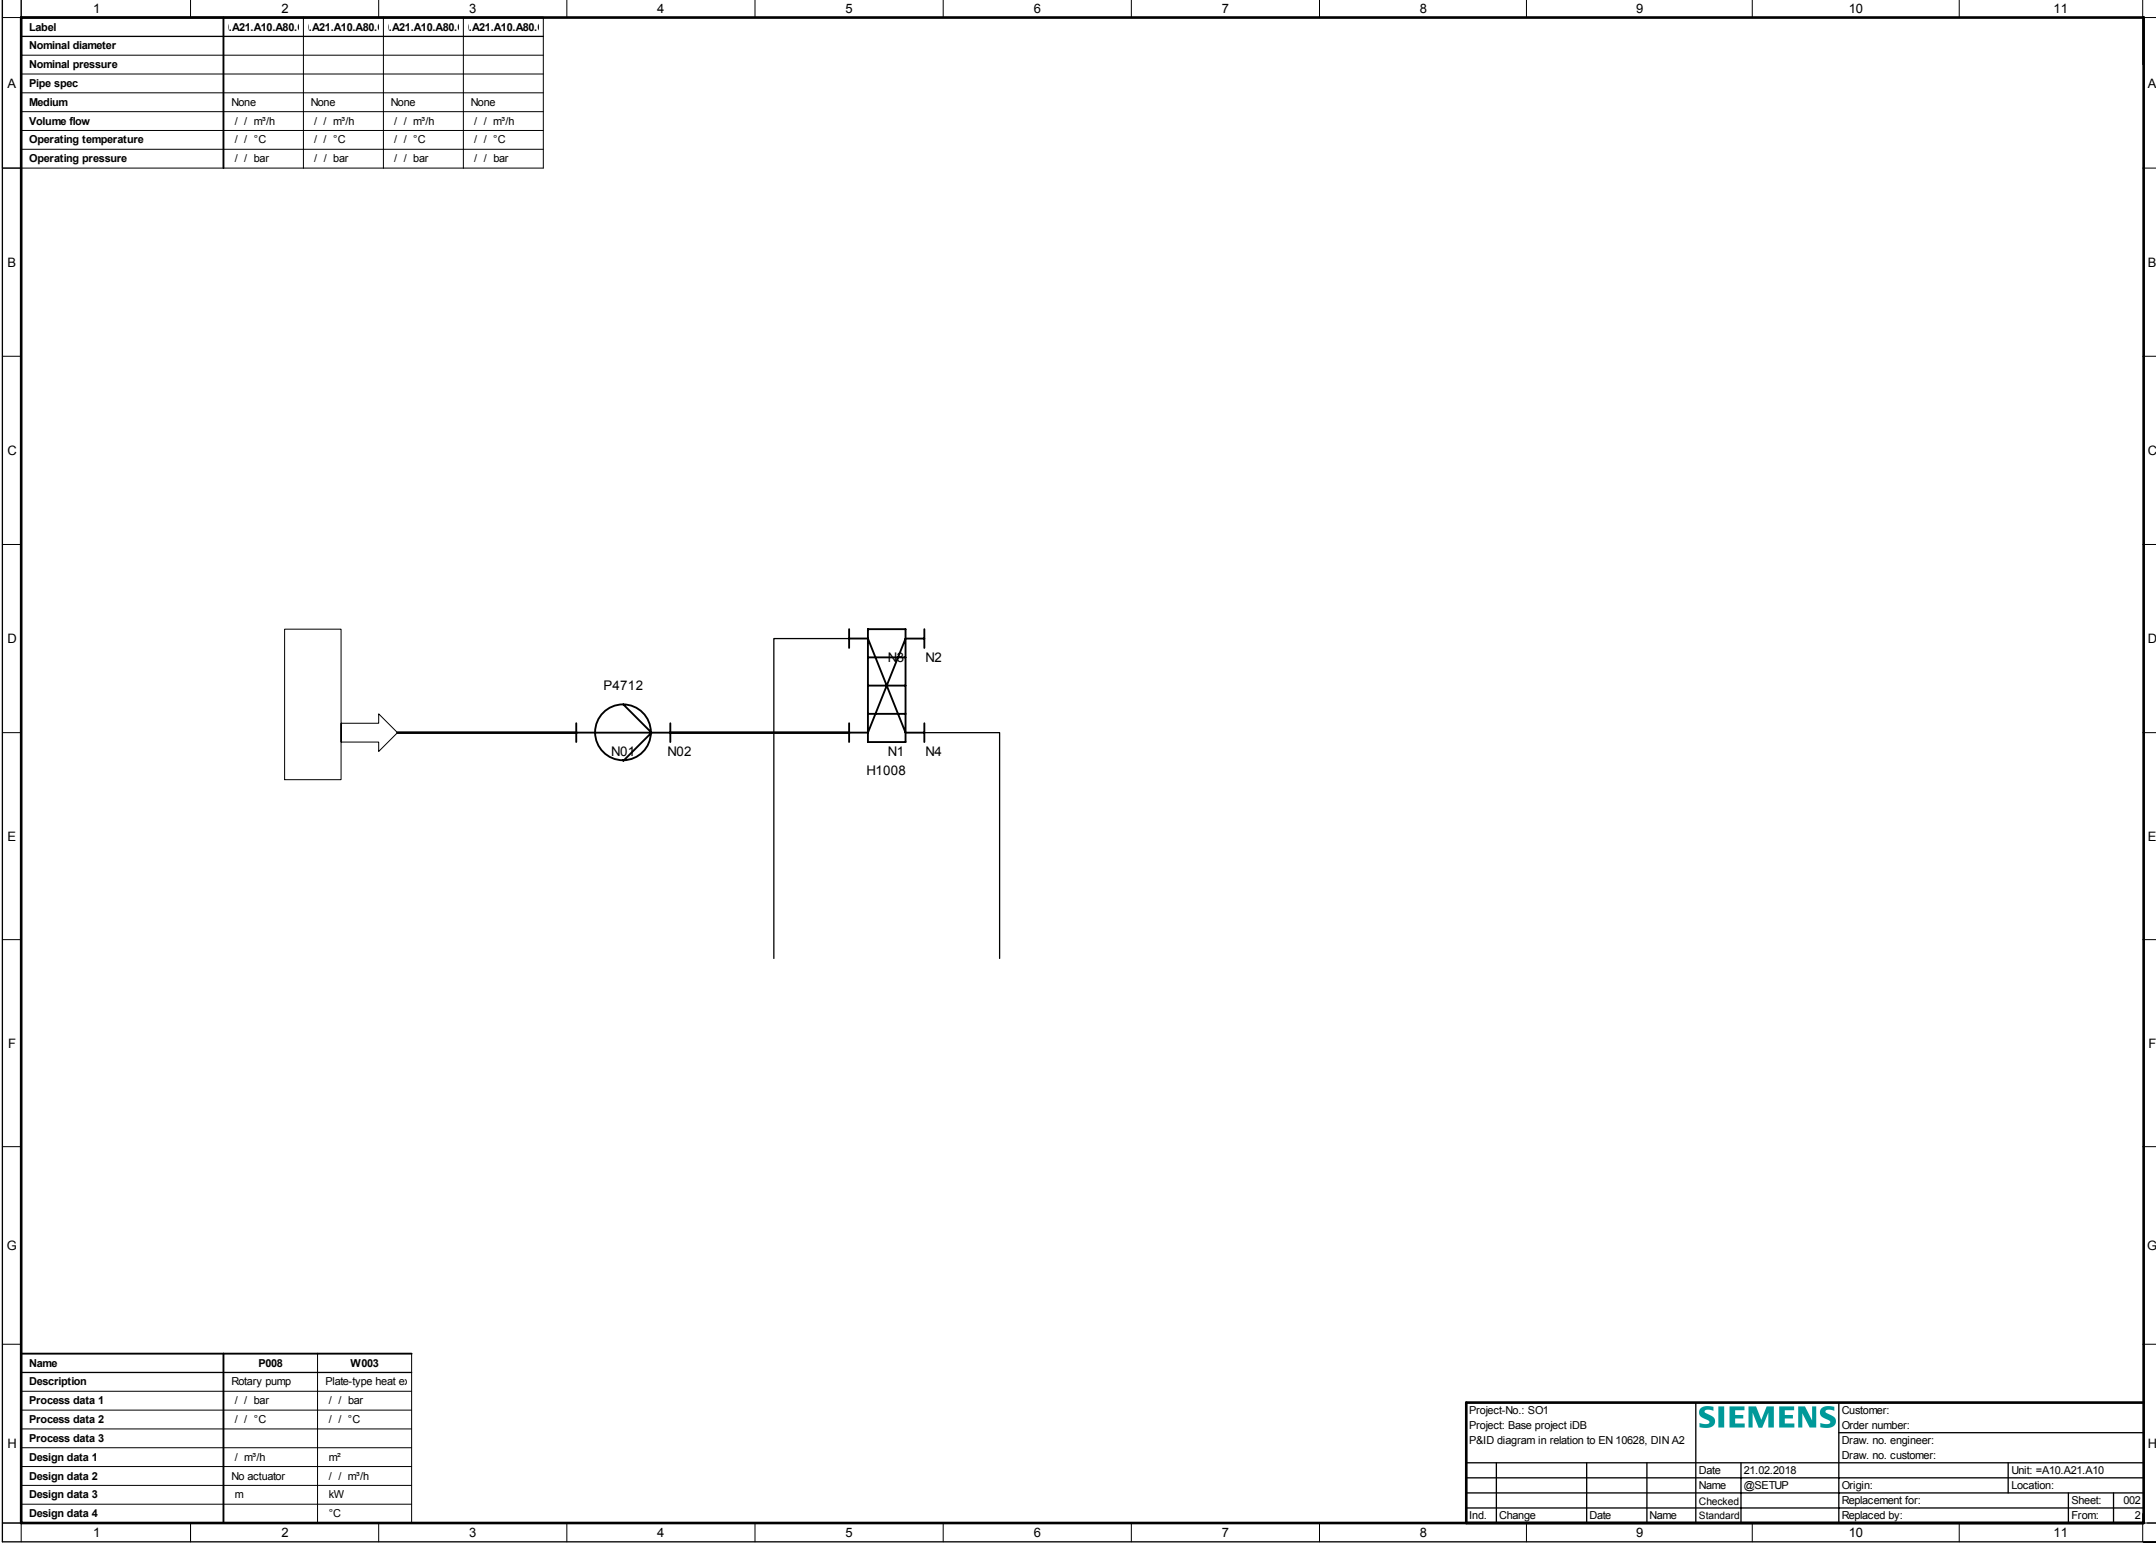

	1	2	3	4	5	6	7	8	9	10	11
A											
B											
C											
D											
E											
F											
G											
H											

Label	A21.A10.A80.	A21.A10.A80.	A21.A10.A80.	A21.A10.A80.
Nominal diameter				
Nominal pressure				
Pipe spec				
Medium	None	None	None	None
Volume flow	/ / m³/h	/ / m³/h	/ / m³/h	/ / m³/h
Operating temperature	/ / °C	/ / °C	/ / °C	/ / °C
Operating pressure	/ / bar	/ / bar	/ / bar	/ / bar

The diagram illustrates a process flow starting from a tank on the left, passing through a pump (P4712) and a control valve (N1 H1008) before reaching a final destination. The flow is indicated by a large arrow pointing right. The pump is labeled P4712 and the control valve is labeled N1 H1008. The diagram also includes various process data and design data tables.

Name	P008	W003
Description	Rotary pump	Plate-type heat ex
Process data 1	/ / bar	/ / bar
Process data 2	/ / °C	/ / °C
Process data 3		
Design data 1	/ m³/h	m²
Design data 2	No actuator	/ / m³/h
Design data 3	m	KW
Design data 4		°C

Project-No.: SO1				SIEMENS		Customer:	
Project: Base project IDB						Order number:	
P&ID diagram in relation to EN 10628, DIN A2						Draw. no. engineer:	
						Draw. no. customer:	
				Date	21.02.2018	Unit: #A10.A21.A10	
				Name	@SETUP	Origin:	
				Checked		Replacement for:	
				Standard		Replaced by:	
Ind.	Change	Date	Name	Standard		Sheet	002
						From:	2

	1	2	3	4	5	6	7	8	9	10	11
A											
B											
C											
D											
E											
F											
G											
H											

Label	A21.A10.A80.	A21.A10.A80.	A21.A10.A80.	A21.A10.A80.
Nominal diameter				
Nominal pressure				
Pipe spec				
Medium	None	None	None	None
Volume flow	/ / m³/h	/ / m³/h	/ / m³/h	/ / m³/h
Operating temperature	/ / °C	/ / °C	/ / °C	/ / °C
Operating pressure	/ / bar	/ / bar	/ / bar	/ / bar

The diagram illustrates a process flow starting from a tank on the left, passing through a pump (P4712) and a control valve (N1 H1008) before reaching a final destination. The flow is indicated by a large arrow pointing right. The pump is labeled P4712 and the control valve is labeled N1 H1008. The diagram also includes various process data and design data tables.

Name	P008	W003
Description	Rotary pump	Plate-type heat ex
Process data 1	/ / bar	/ / bar
Process data 2	/ / °C	/ / °C
Process data 3		
Design data 1	/ m³/h	m²
Design data 2	No actuator	/ / m³/h
Design data 3	m	KW
Design data 4		°C

Project-No.: SO1				SIEMENS		Customer:	
Project: Base project IDB						Order number:	
P&ID diagram in relation to EN 10628, DIN A2						Draw. no. engineer:	
						Draw. no. customer:	
				Date	21.02.2018	Unit: #A10.A21.A10	
				Name	@SETUP	Origin:	
				Checked		Replacement for:	
				Standard		Replaced by:	
Ind.	Change	Date	Name	Standard		Sheet	002
						From:	2