



Sniff-locked PSTH examples -- single strongest and single weakest overall phase-locking units

Strongest: Unit 278 (2022-06-24)
pooled_MRL=0.247

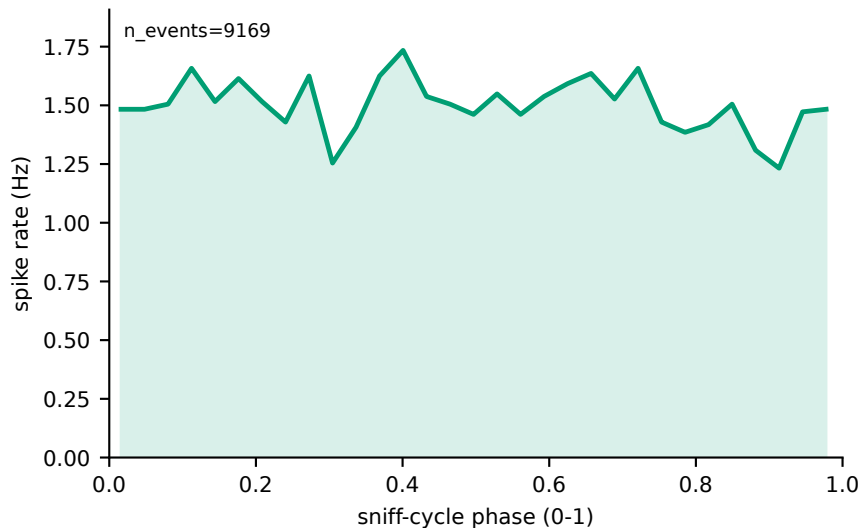

Weakest: Unit 82 (2021-12-15)
pooled_MRL=0.000

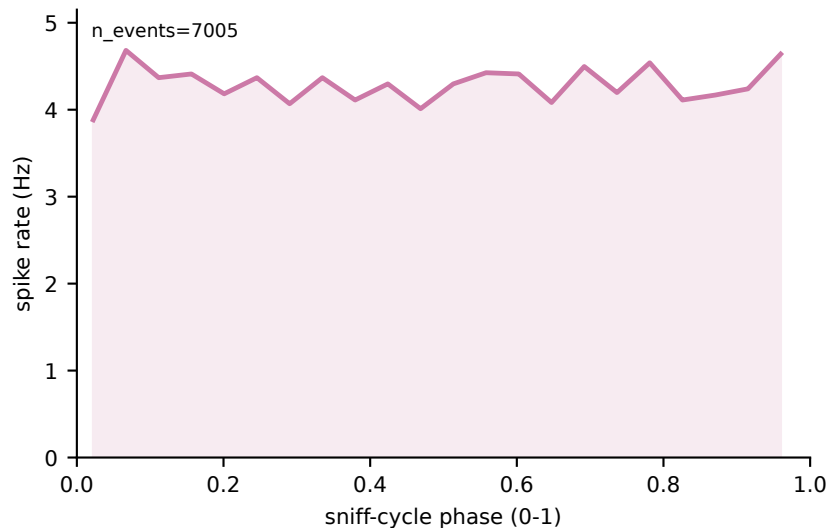

Selection basis: MRL computed on all valid-sniff spikes pooled across ethanol + control conditions (condition-agnostic); the single strongest- and single weakest-overall phase-locking units across ALL experiments (2 units total, not one pair per experiment or per condition; OD-4).