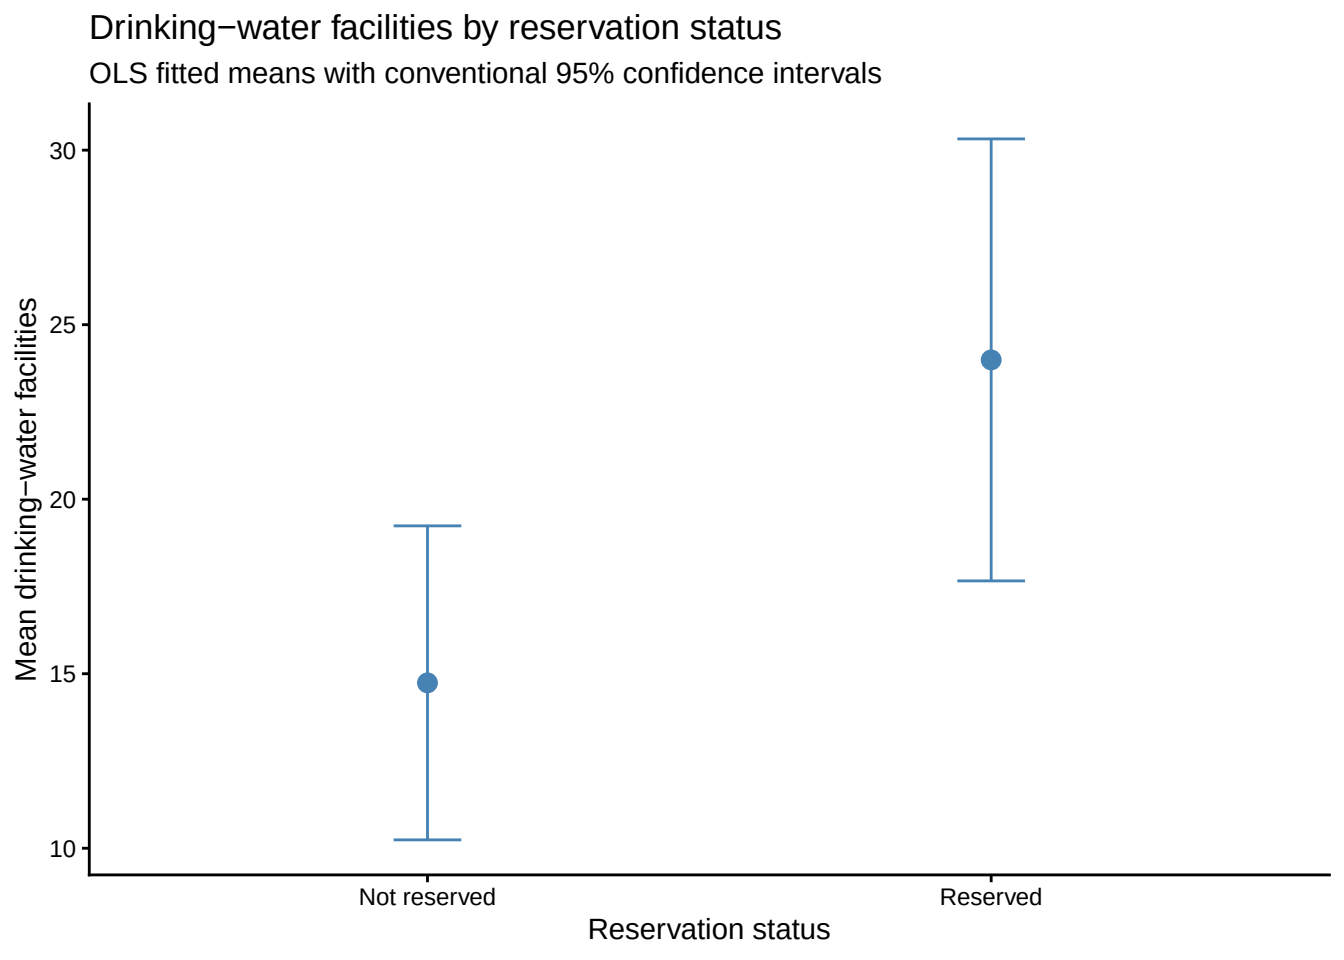
Drinking−water facilities by reservation status
OLS fitted means with conventional 95% confidence intervals
Mean drinking−water facilities
30
25
20
15
10
Not reserved
Reserved
Reservation status