


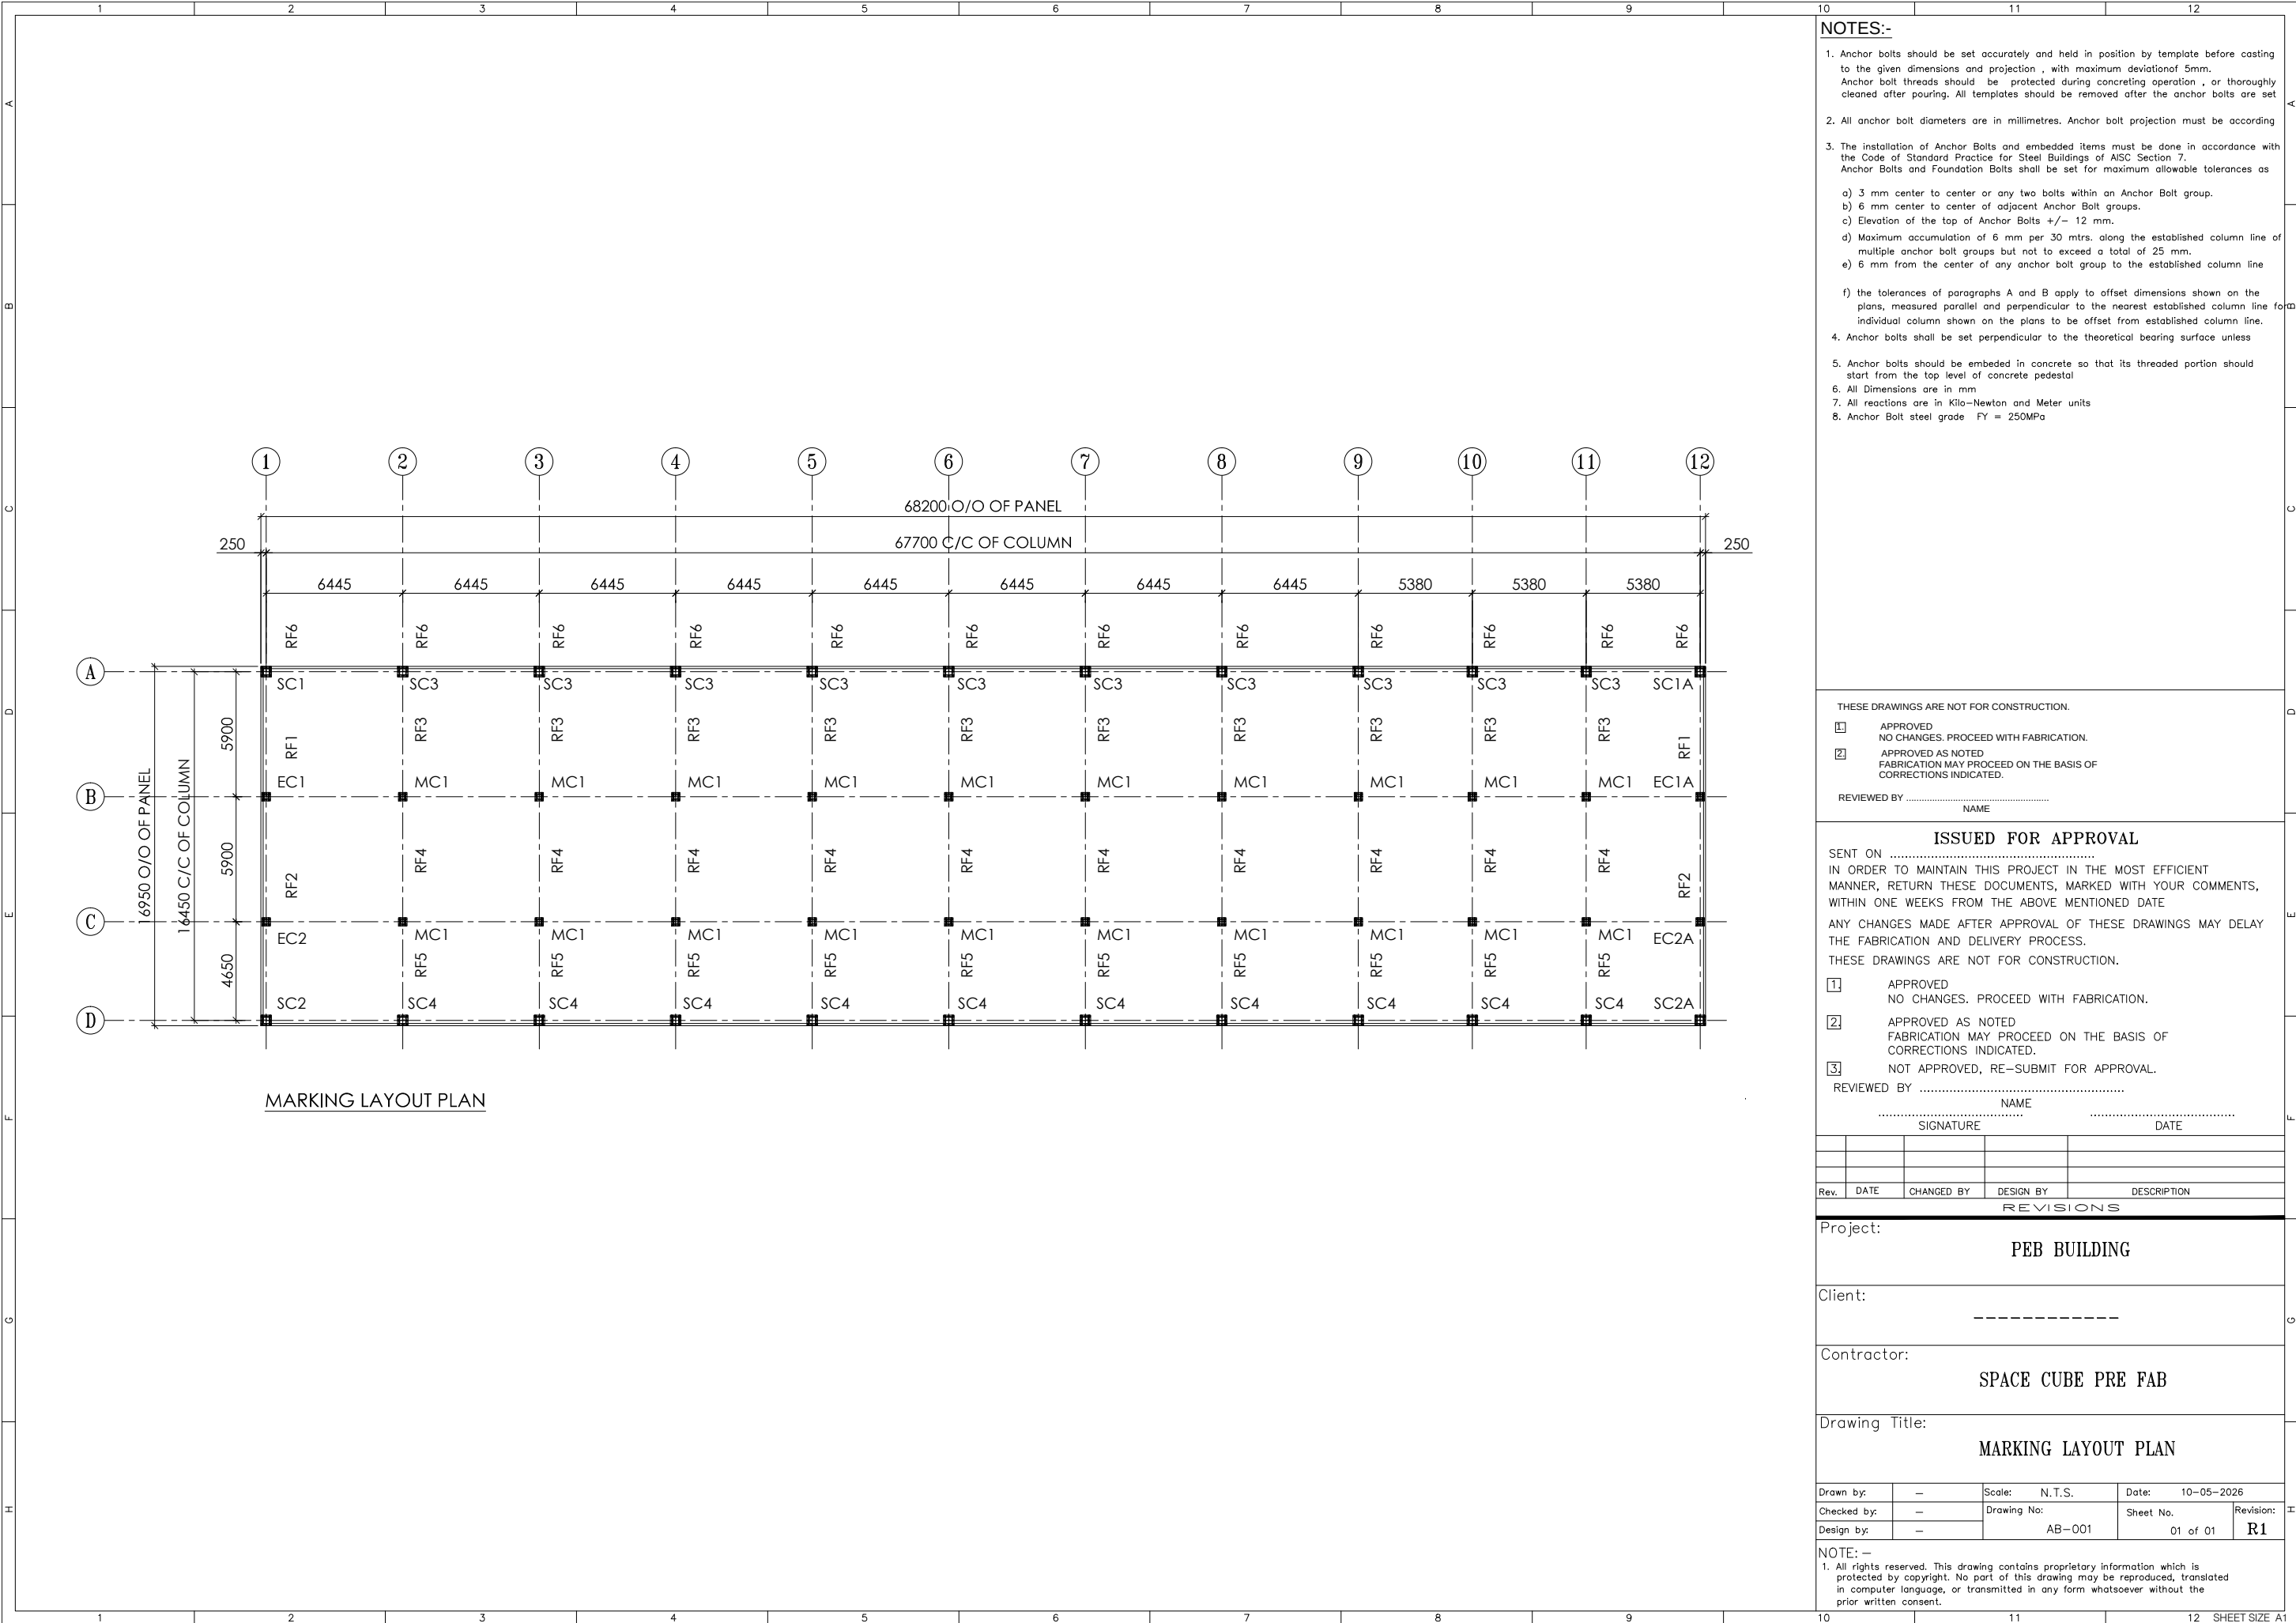

- NOTES:-**
- Anchor bolts should be set accurately and held in position by template before casting to the given dimensions and projection , with maximum deviation of 5mm. Anchor bolt threads should be protected during concreting operation , or thoroughly cleaned after pouring. All templates should be removed after the anchor bolts are set
 - All anchor bolt diameters are in millimetres. Anchor bolt projection must be according
 - The installation of Anchor Bolts and embedded items must be done in accordance with the Code of Standard Practice for Steel Buildings of AISC Section 7. Anchor Bolts and Foundation Bolts shall be set for maximum allowable tolerances as
 - 3 mm center to center or any two bolts within an Anchor Bolt group.
 - 6 mm center to center of adjacent Anchor Bolt groups.
 - Elevation of the top of Anchor Bolts +/- 12 mm.
 - Maximum accumulation of 6 mm per 30 mtrs. along the established column line of multiple anchor bolt groups but not to exceed a total of 25 mm.
 - 6 mm from the center of any anchor bolt group to the established column line
 - the tolerances of paragraphs A and B apply to offset dimensions shown on the plans, measured parallel and perpendicular to the nearest established column line for individual column shown on the plans to be offset from established column line.
 - Anchor bolts shall be set perpendicular to the theoretical bearing surface unless
 - Anchor bolts should be embedded in concrete so that its threaded portion should start from the top level of concrete pedestal
 - All Dimensions are in mm
 - All reactions are in Kilo-Newton and Meter units
 - Anchor Bolt steel grade FY = 250MPa

THESE DRAWINGS ARE NOT FOR CONSTRUCTION.

1. APPROVED
NO CHANGES. PROCEED WITH FABRICATION.

2. APPROVED AS NOTED
FABRICATION MAY PROCEED ON THE BASIS OF
CORRECTIONS INDICATED.

REVIEWED BY _____
NAME

ISSUED FOR APPROVAL

SENT ON _____
IN ORDER TO MAINTAIN THIS PROJECT IN THE MOST EFFICIENT
MANNER, RETURN THESE DOCUMENTS, MARKED WITH YOUR COMMENTS,
WITHIN ONE WEEKS FROM THE ABOVE MENTIONED DATE

ANY CHANGES MADE AFTER APPROVAL OF THESE DRAWINGS MAY DELAY
THE FABRICATION AND DELIVERY PROCESS.

THESE DRAWINGS ARE NOT FOR CONSTRUCTION.

1. APPROVED
NO CHANGES. PROCEED WITH FABRICATION.

2. APPROVED AS NOTED
FABRICATION MAY PROCEED ON THE BASIS OF
CORRECTIONS INDICATED.

3. NOT APPROVED, RE-SUBMIT FOR APPROVAL.

REVIEWED BY _____
NAME
SIGNATURE DATE


Rev.	DATE	CHANGED BY	DESIGN BY	DESCRIPTION

Project:					
PEB BUILDING					
Client:					

Contractor:					
SPACE CUBE PRE FAB					
Drawing Title:					
MARKING LAYOUT PLAN					
Drawn by:	—	Scale:	N.T.S.	Date:	10-05-2026
Checked by:	—	Drawing No:		Sheet No.	
Design by:	—		AB-001	01 of 01	R1

NOTE: —

1. All rights reserved. This drawing contains proprietary information which is protected by copyright. No part of this drawing may be reproduced, translated in computer language, or transmitted in any form whatsoever without the prior written consent.

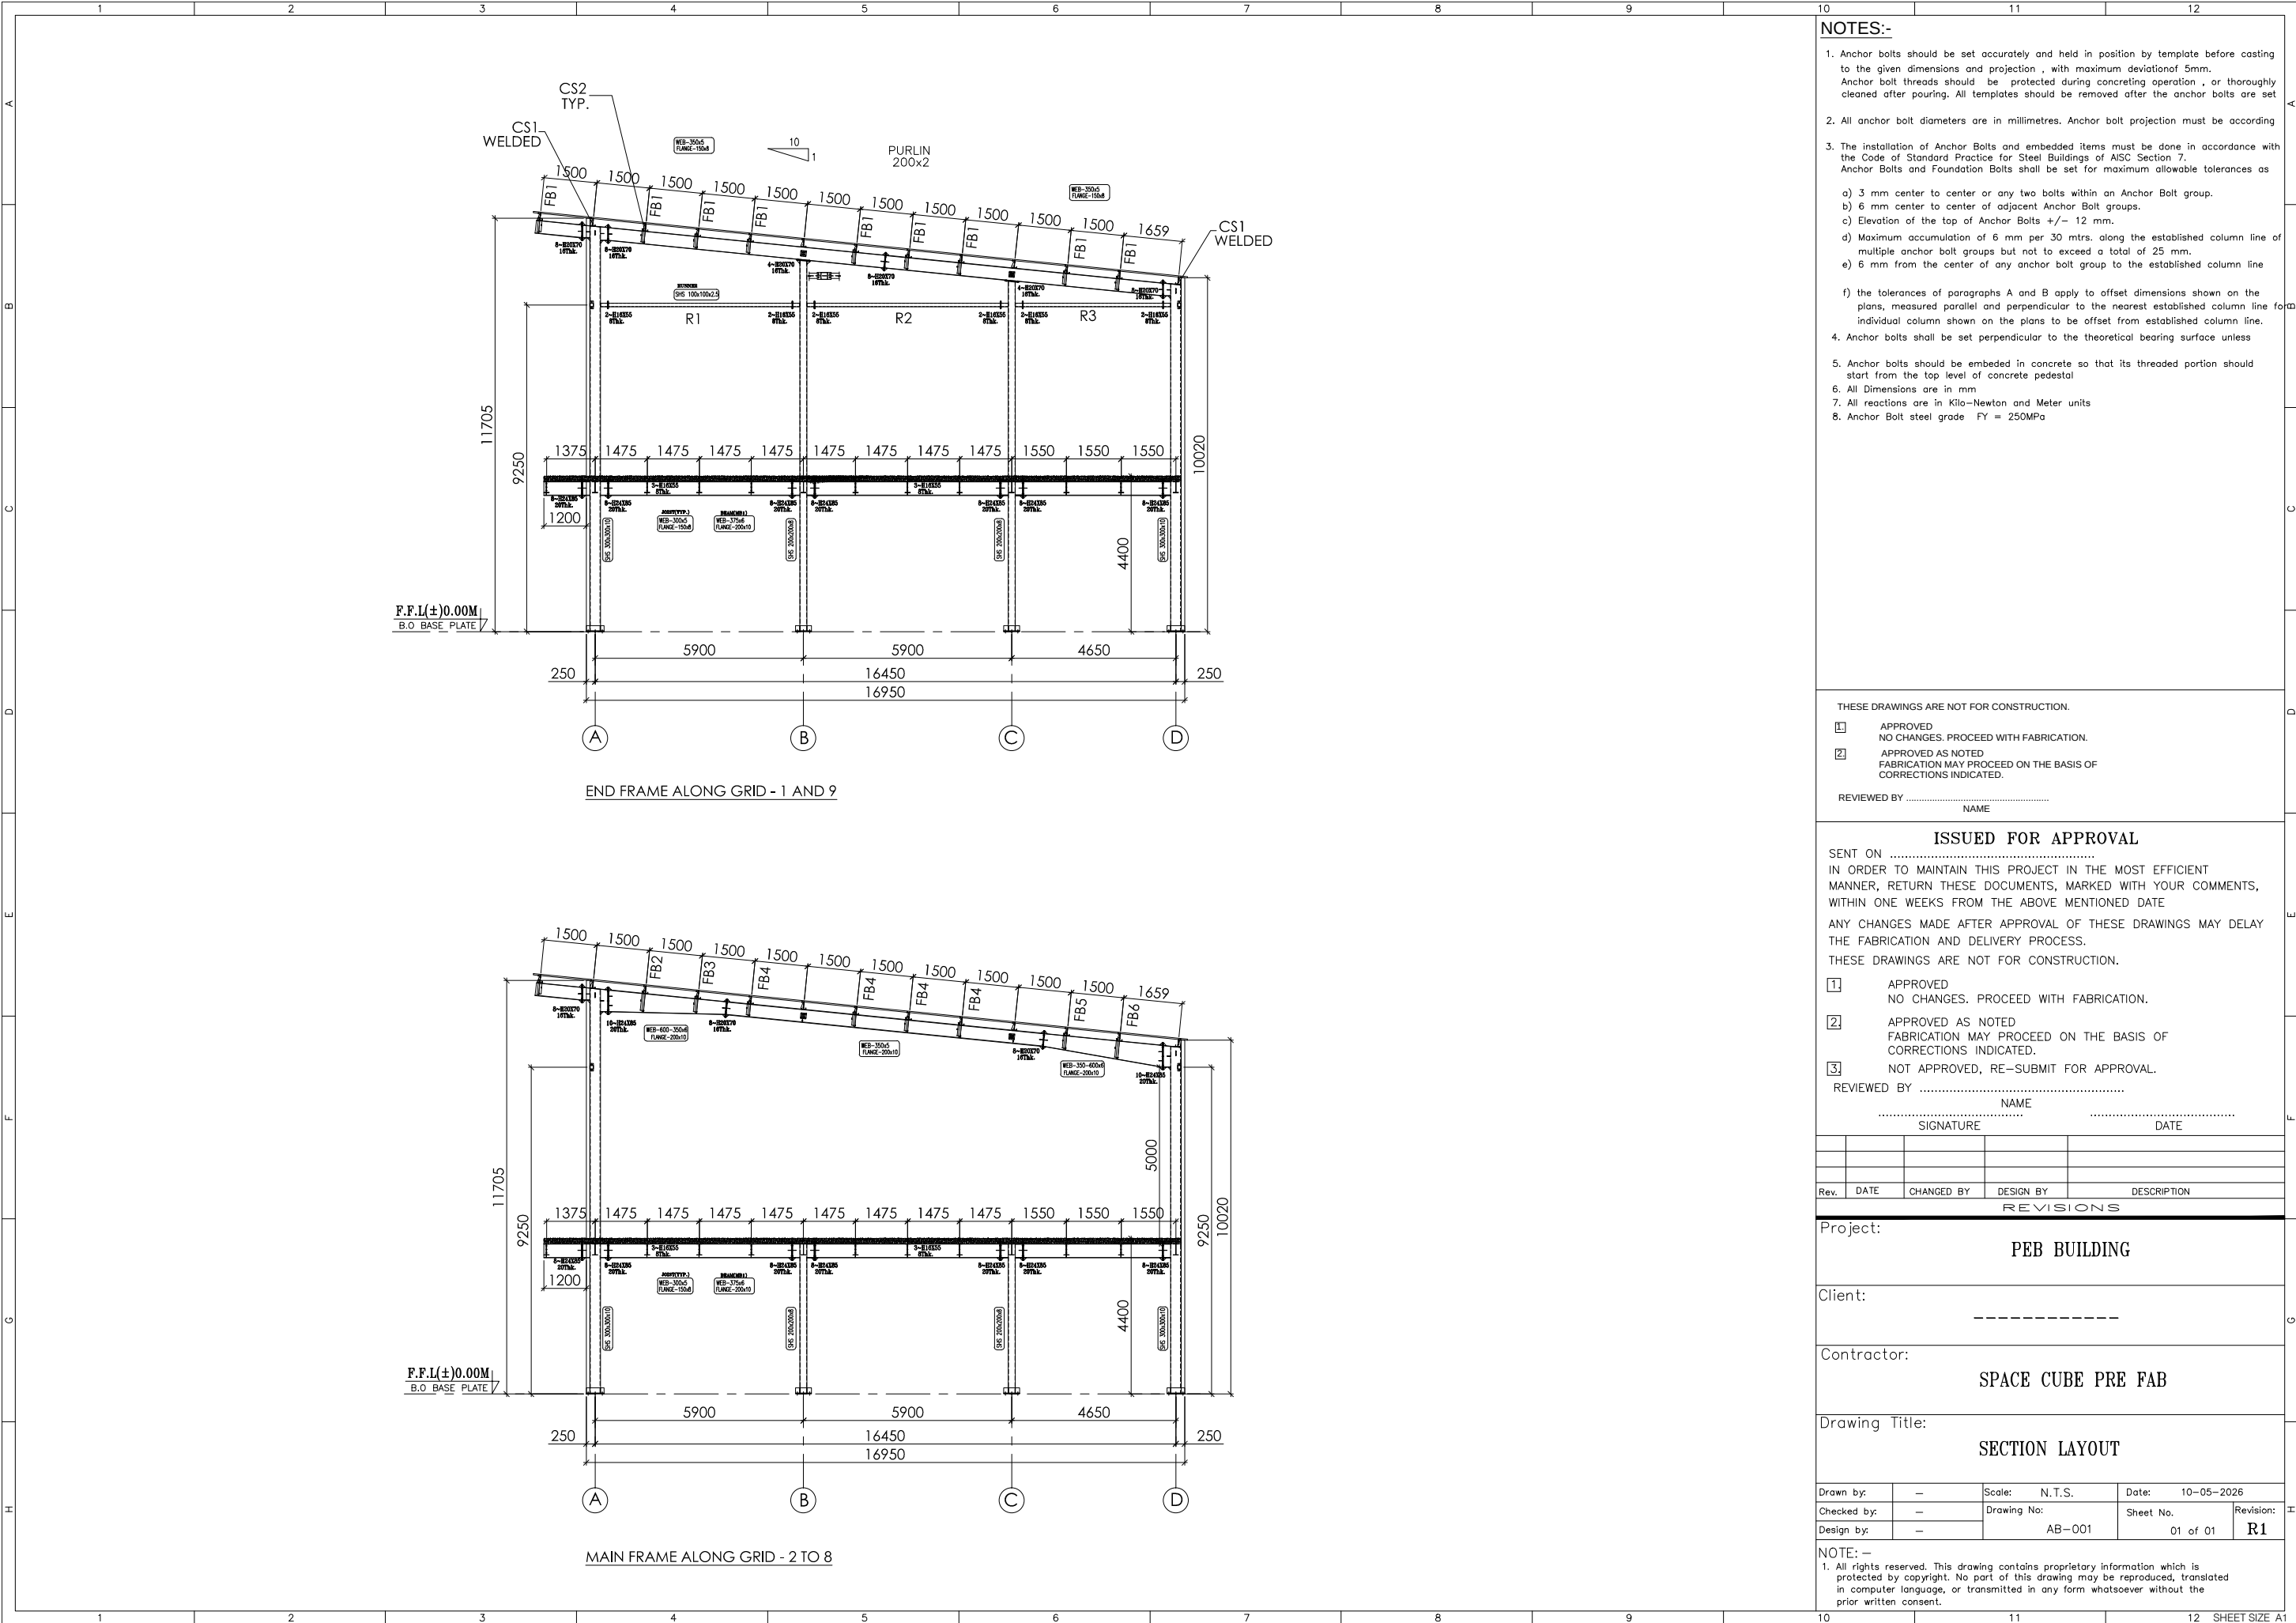

- NOTES:-**
- Anchor bolts should be set accurately and held in position by template before casting to the given dimensions and projection , with maximum deviation of 5mm. Anchor bolt threads should be protected during concreting operation , or thoroughly cleaned after pouring. All templates should be removed after the anchor bolts are set
 - All anchor bolt diameters are in millimetres. Anchor bolt projection must be according
 - The installation of Anchor Bolts and embedded items must be done in accordance with the Code of Standard Practice for Steel Buildings of AISC Section 7. Anchor Bolts and Foundation Bolts shall be set for maximum allowable tolerances as
 - 3 mm center to center or any two bolts within an Anchor Bolt group.
 - 6 mm center to center of adjacent Anchor Bolt groups.
 - Elevation of the top of Anchor Bolts +/- 12 mm.
 - Maximum accumulation of 6 mm per 30 mtrs. along the established column line of multiple anchor bolt groups but not to exceed a total of 25 mm.
 - 6 mm from the center of any anchor bolt group to the established column line
 - the tolerances of paragraphs A and B apply to offset dimensions shown on the plans, measured parallel and perpendicular to the nearest established column line for individual column shown on the plans to be offset from established column line.
 - Anchor bolts shall be set perpendicular to the theoretical bearing surface unless
 - Anchor bolts should be embedded in concrete so that its threaded portion should start from the top level of concrete pedestal
 - All Dimensions are in mm
 - All reactions are in Kilo-Newton and Meter units
 - Anchor Bolt steel grade FY = 250MPa

THESE DRAWINGS ARE NOT FOR CONSTRUCTION.

[1] APPROVED
NO CHANGES. PROCEED WITH FABRICATION.

[2] APPROVED AS NOTED
FABRICATION MAY PROCEED ON THE BASIS OF
CORRECTIONS INDICATED.

REVIEWED BY
NAME

ISSUED FOR APPROVAL

SENT ON
IN ORDER TO MAINTAIN THIS PROJECT IN THE MOST EFFICIENT
MANNER, RETURN THESE DOCUMENTS, MARKED WITH YOUR COMMENTS,
WITHIN ONE WEEKS FROM THE ABOVE MENTIONED DATE
ANY CHANGES MADE AFTER APPROVAL OF THESE DRAWINGS MAY DELAY
THE FABRICATION AND DELIVERY PROCESS.
THESE DRAWINGS ARE NOT FOR CONSTRUCTION.


- [1] APPROVED
NO CHANGES. PROCEED WITH FABRICATION.
- [2] APPROVED AS NOTED
FABRICATION MAY PROCEED ON THE BASIS OF
CORRECTIONS INDICATED.
- [3] NOT APPROVED, RE-SUBMIT FOR APPROVAL.

REVIEWED BY
NAME
SIGNATURE DATE


Rev.	DATE	CHANGED BY	DESIGN BY	DESCRIPTION
REVISIONS				

Project:	PEB BUILDING			
Client:	-----			
Contractor:	SPACE CUBE PRE FAB			
Drawing Title:	SECTION LAYOUT			
Drawn by:	—	Scale:	N.T.S.	Date: 10-05-2026
Checked by:	—	Drawing No:	Sheet No.	Revision:
Design by:	—	AB-001	01 of 01	R1

NOTE: —
1. All rights reserved. This drawing contains proprietary information which is protected by copyright. No part of this drawing may be reproduced, translated in computer language, or transmitted in any form whatsoever without the prior written consent.

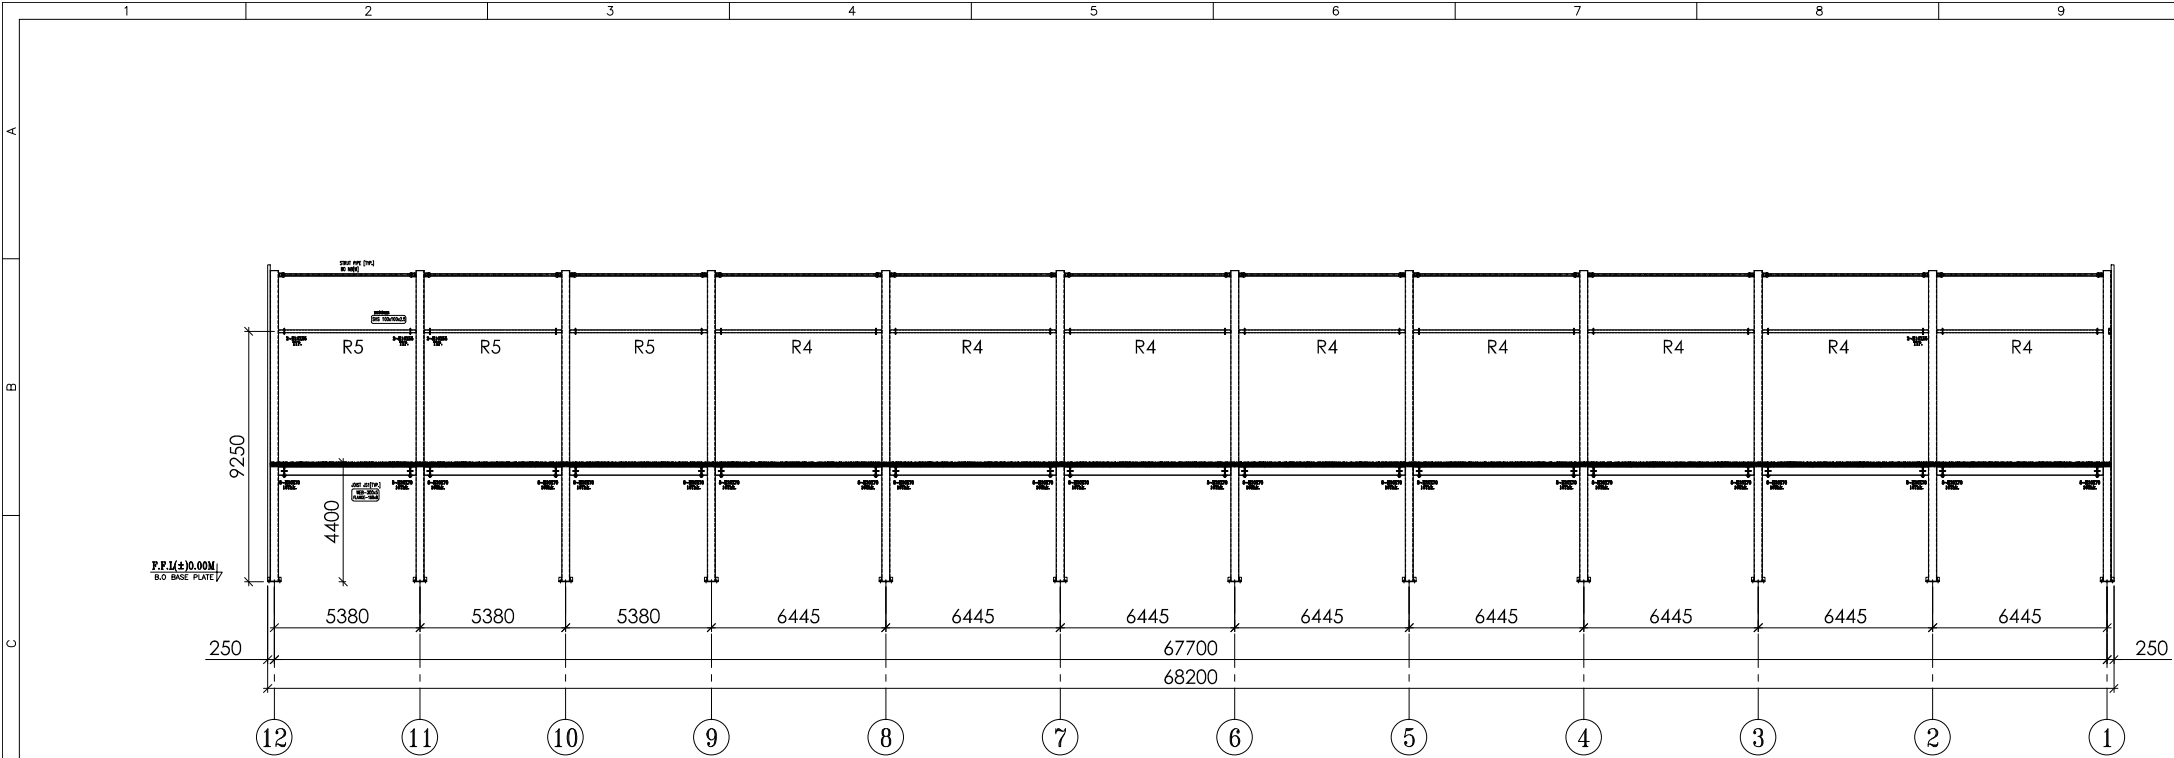

SIDE WALL FRAMING ALONG GRID - A

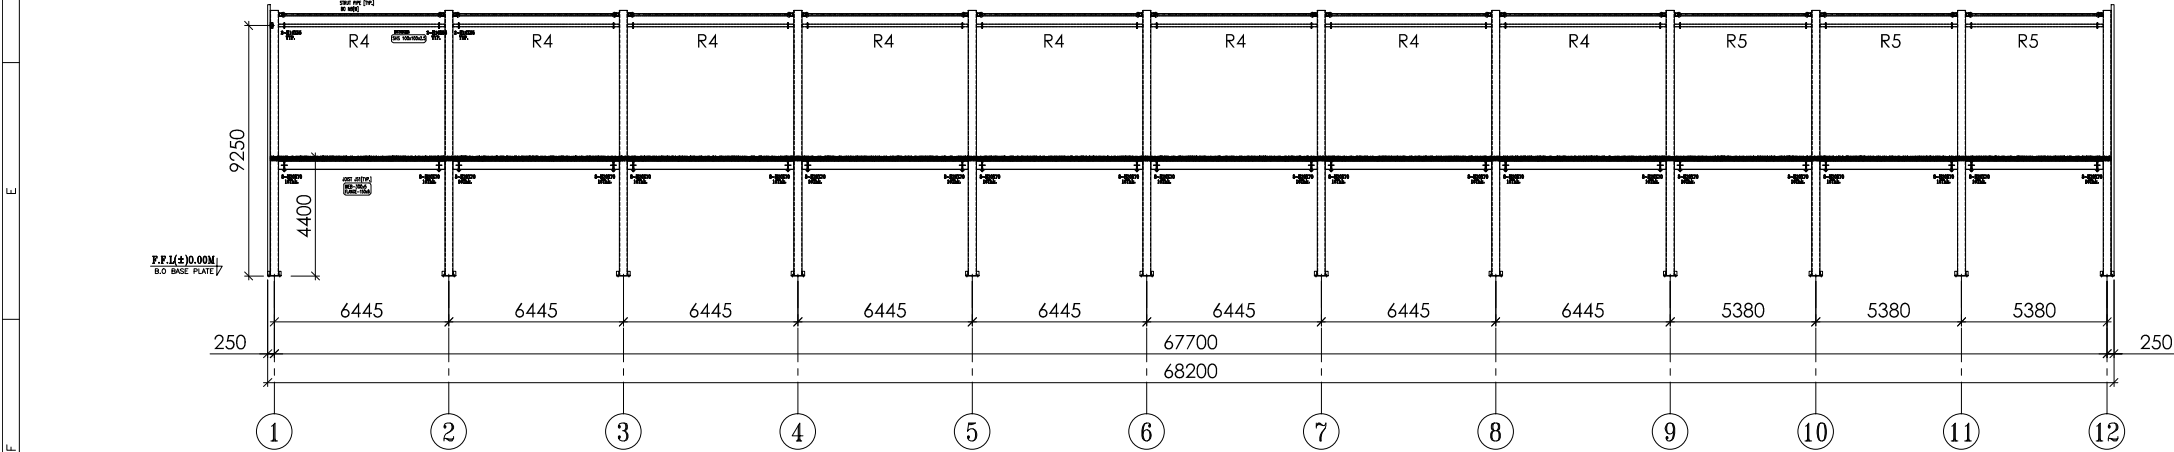

SIDE WALL FRAMING ALONG GRID - D

- NOTES:-**
- Anchor bolts should be set accurately and held in position by template before casting to the given dimensions and projection , with maximum deviation of 5mm. Anchor bolt threads should be protected during concreting operation , or thoroughly cleaned after pouring. All templates should be removed after the anchor bolts are set
 - All anchor bolt diameters are in millimetres. Anchor bolt projection must be according
 - The installation of Anchor Bolts and embedded items must be done in accordance with the Code of Standard Practice for Steel Buildings of AISC Section 7. Anchor Bolts and Foundation Bolts shall be set for maximum allowable tolerances as
 - 3 mm center to center or any two bolts within an Anchor Bolt group.
 - 6 mm center to center of adjacent Anchor Bolt groups.
 - Elevation of the top of Anchor Bolts +/- 12 mm.
 - Maximum accumulation of 6 mm per 30 mtrs. along the established column line of multiple anchor bolt groups but not to exceed a total of 25 mm.
 - 6 mm from the center of any anchor bolt group to the established column line
 - the tolerances of paragraphs A and B apply to offset dimensions shown on the plans, measured parallel and perpendicular to the nearest established column line for individual column shown on the plans to be offset from established column line.
 - Anchor bolts shall be set perpendicular to the theoretical bearing surface unless
 - Anchor bolts should be embedded in concrete so that its threaded portion should start from the top level of concrete pedestal
 - All Dimensions are in mm
 - All reactions are in Kilo-Newton and Meter units
 - Anchor Bolt steel grade FY = 250MPa

THESE DRAWINGS ARE NOT FOR CONSTRUCTION.

1. APPROVED
NO CHANGES. PROCEED WITH FABRICATION.
2. APPROVED AS NOTED
FABRICATION MAY PROCEED ON THE BASIS OF
CORRECTIONS INDICATED.

REVIEWED BY _____
NAME

ISSUED FOR APPROVAL

SENT ON _____
IN ORDER TO MAINTAIN THIS PROJECT IN THE MOST EFFICIENT
MANNER, RETURN THESE DOCUMENTS, MARKED WITH YOUR COMMENTS,
WITHIN ONE WEEKS FROM THE ABOVE MENTIONED DATE
ANY CHANGES MADE AFTER APPROVAL OF THESE DRAWINGS MAY DELAY
THE FABRICATION AND DELIVERY PROCESS.
THESE DRAWINGS ARE NOT FOR CONSTRUCTION.

1. APPROVED
NO CHANGES. PROCEED WITH FABRICATION.
2. APPROVED AS NOTED
FABRICATION MAY PROCEED ON THE BASIS OF
CORRECTIONS INDICATED.
3. NOT APPROVED, RE-SUBMIT FOR APPROVAL.

REVIEWED BY _____
NAME
SIGNATURE DATE

Rev.	DATE	CHANGED BY	DESIGN BY	DESCRIPTION
REVISIONS				

Project: PEB BUILDING

Client: -----

Contractor: SPACE CUBE PRE FAB

Drawing Title: SIDE FRAME

Drawn by:	—	Scale:	N.T.S.	Date:	10-05-2026
Checked by:	—	Drawing No:	AB-001	Sheet No.	01 of 01
Design by:	—				R1

NOTE: —
1. All rights reserved. This drawing contains proprietary information which is protected by copyright. No part of this drawing may be reproduced, translated in computer language, or transmitted in any form whatsoever without the prior written consent.