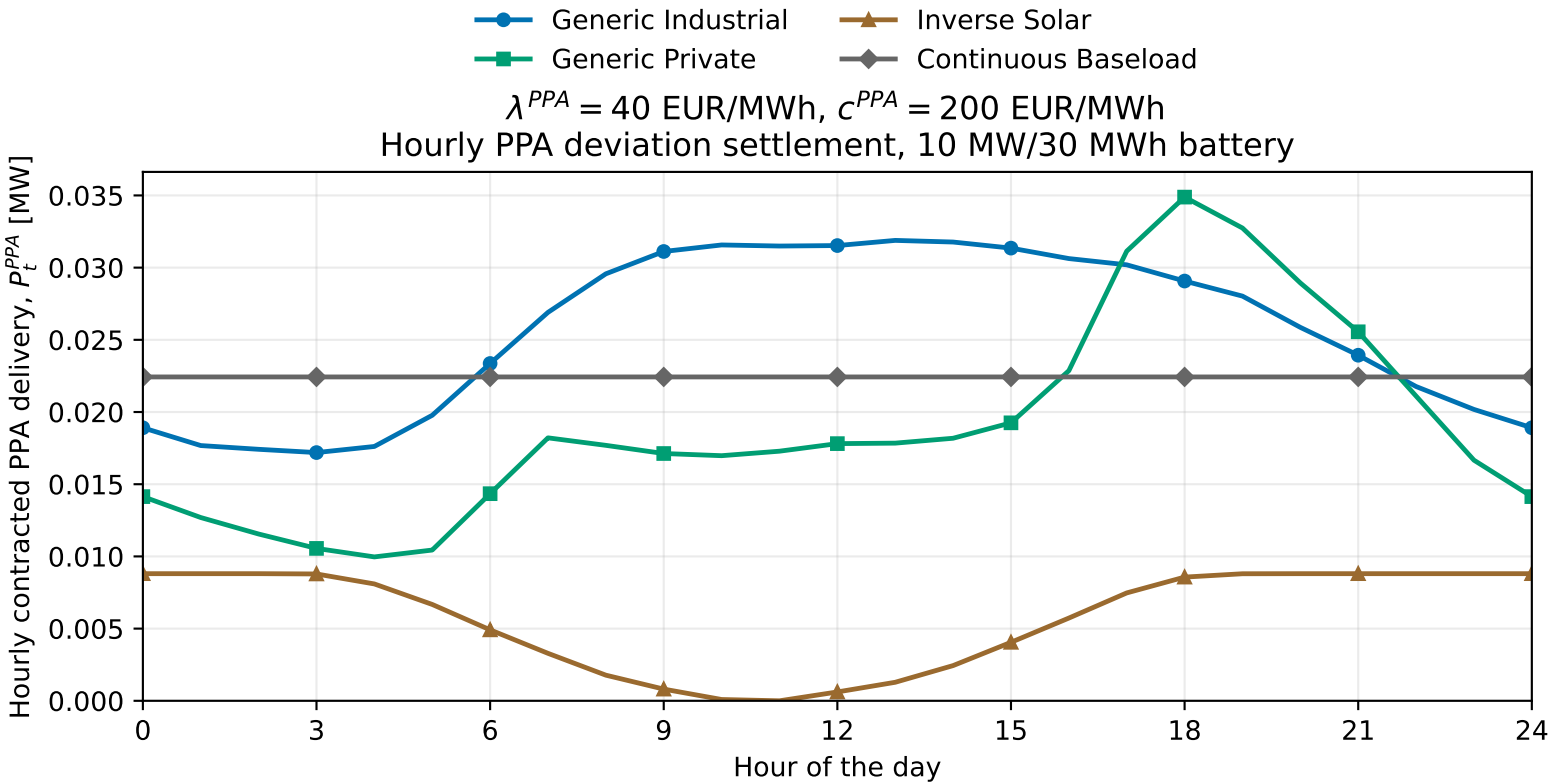
Generic Industrial
Generic Private
Inverse Solar
Continuous Baseload
$\lambda^{PPA} = 40$ EUR/MWh, $c^{PPA} = 200$ EUR/MWh
Hourly PPA deviation settlement, 10 MW/30 MWh battery
Hourly contracted PPA delivery, P_t^{PPA} [MW]
0.035
0.030
0.025
0.020
0.015
0.010
0.005
0.000
0
3
6
9
12
15
18
21
24
Hour of the day