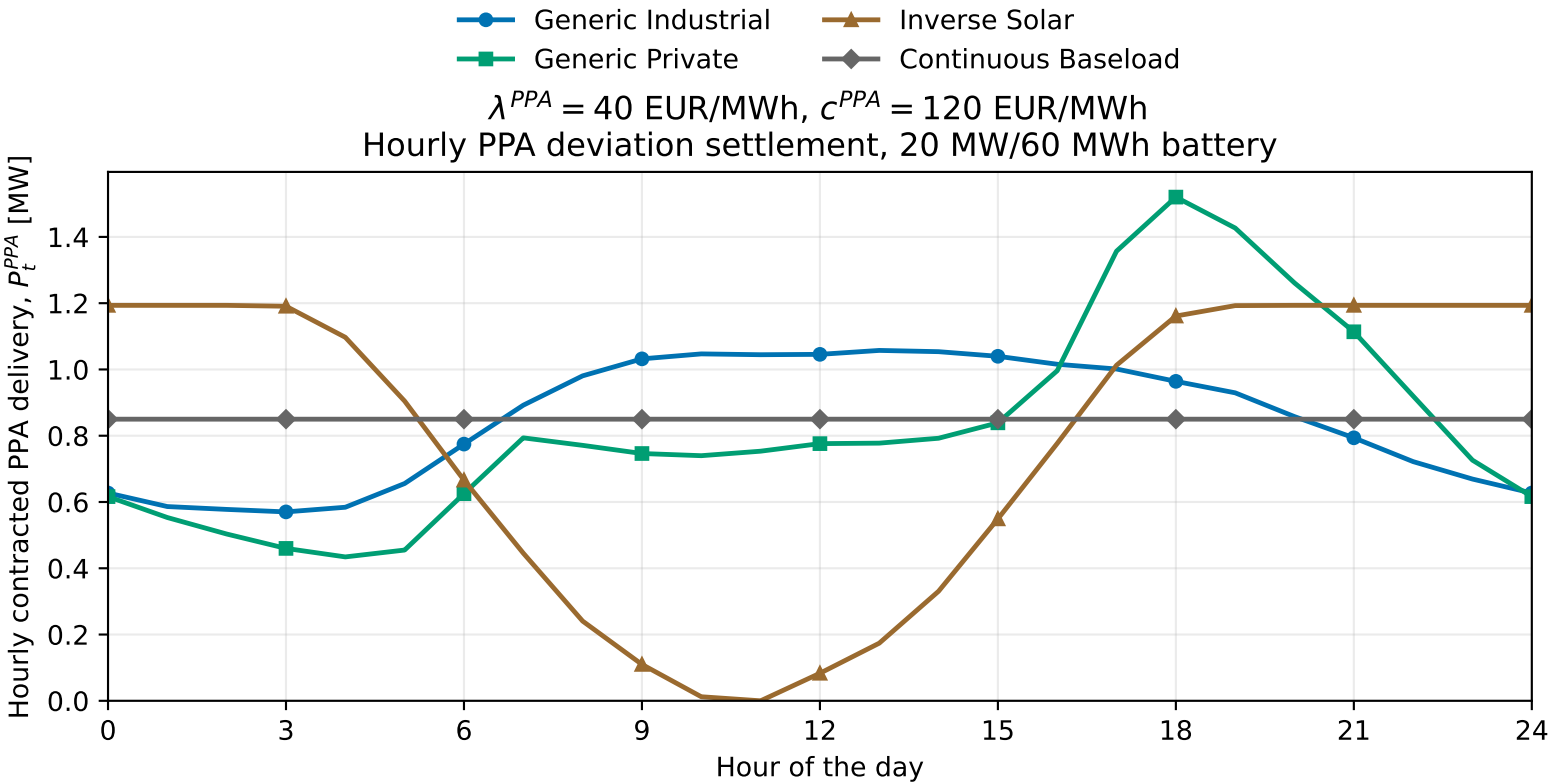
Generic Industrial
Generic Private
Inverse Solar
Continuous Baseload
$\lambda^{PPA} = 40$ EUR/MWh, $c^{PPA} = 120$ EUR/MWh
Hourly PPA deviation settlement, 20 MW/60 MWh battery
Hourly contracted PPA delivery, P_t^{PPA} [MW]
0.0
0.2
0.4
0.6
0.8
1.0
1.2
1.4
0
3
6
9
12
15
18
21
24
Hour of the day