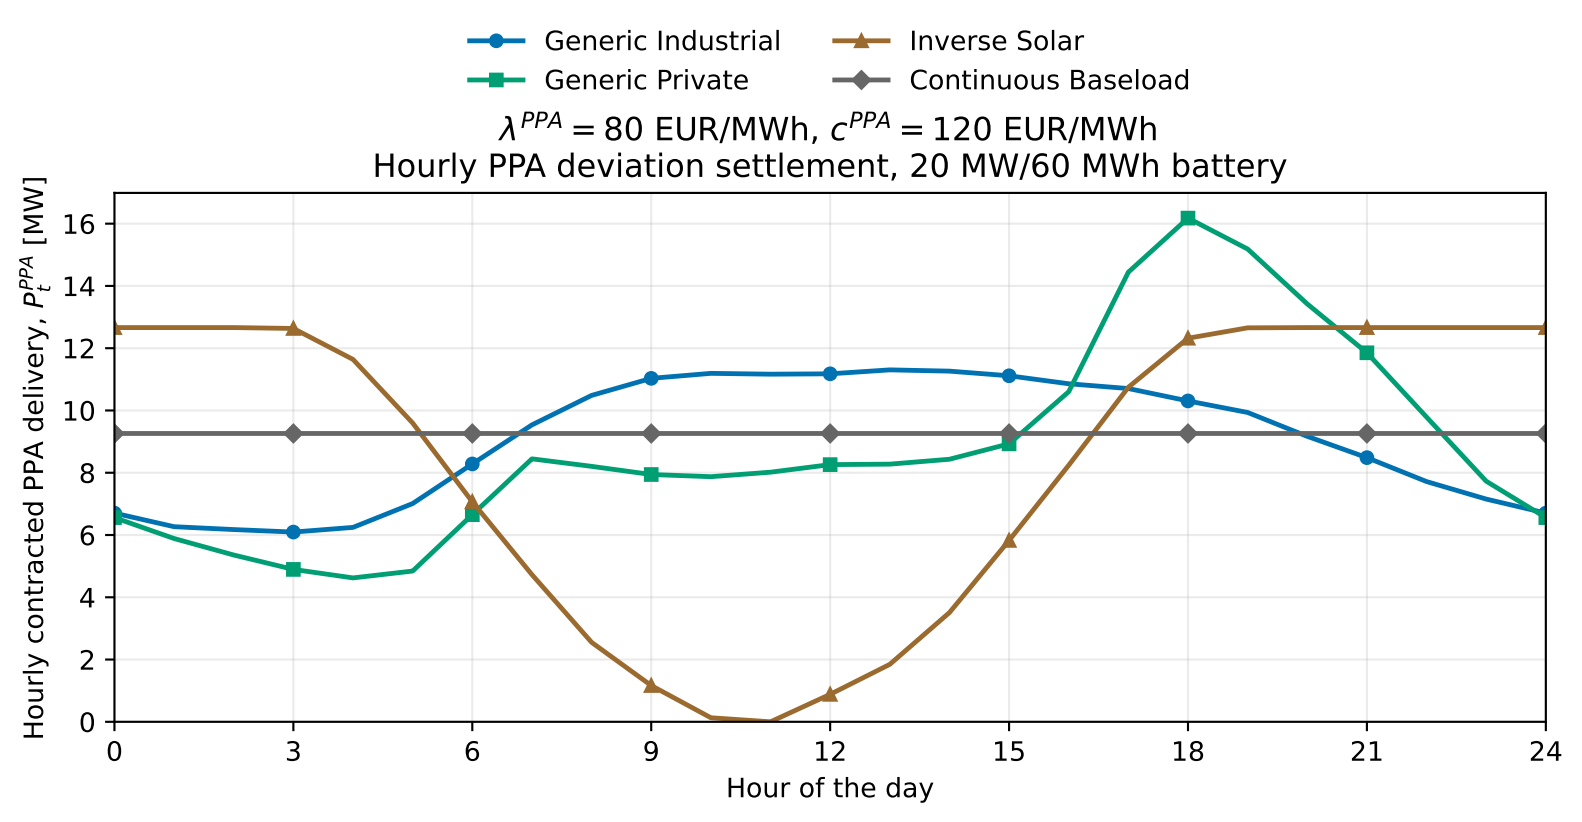
Generic Industrial
Generic Private
Inverse Solar
Continuous Baseload
$\lambda^{PPA} = 80$ EUR/MWh, $c^{PPA} = 120$ EUR/MWh
Hourly PPA deviation settlement, 20 MW/60 MWh battery
Hourly contracted PPA delivery, P_t^{PPA} [MW]
0
2
4
6
8
10
12
14
16
0
3
6
9
12
15
18
21
24
Hour of the day