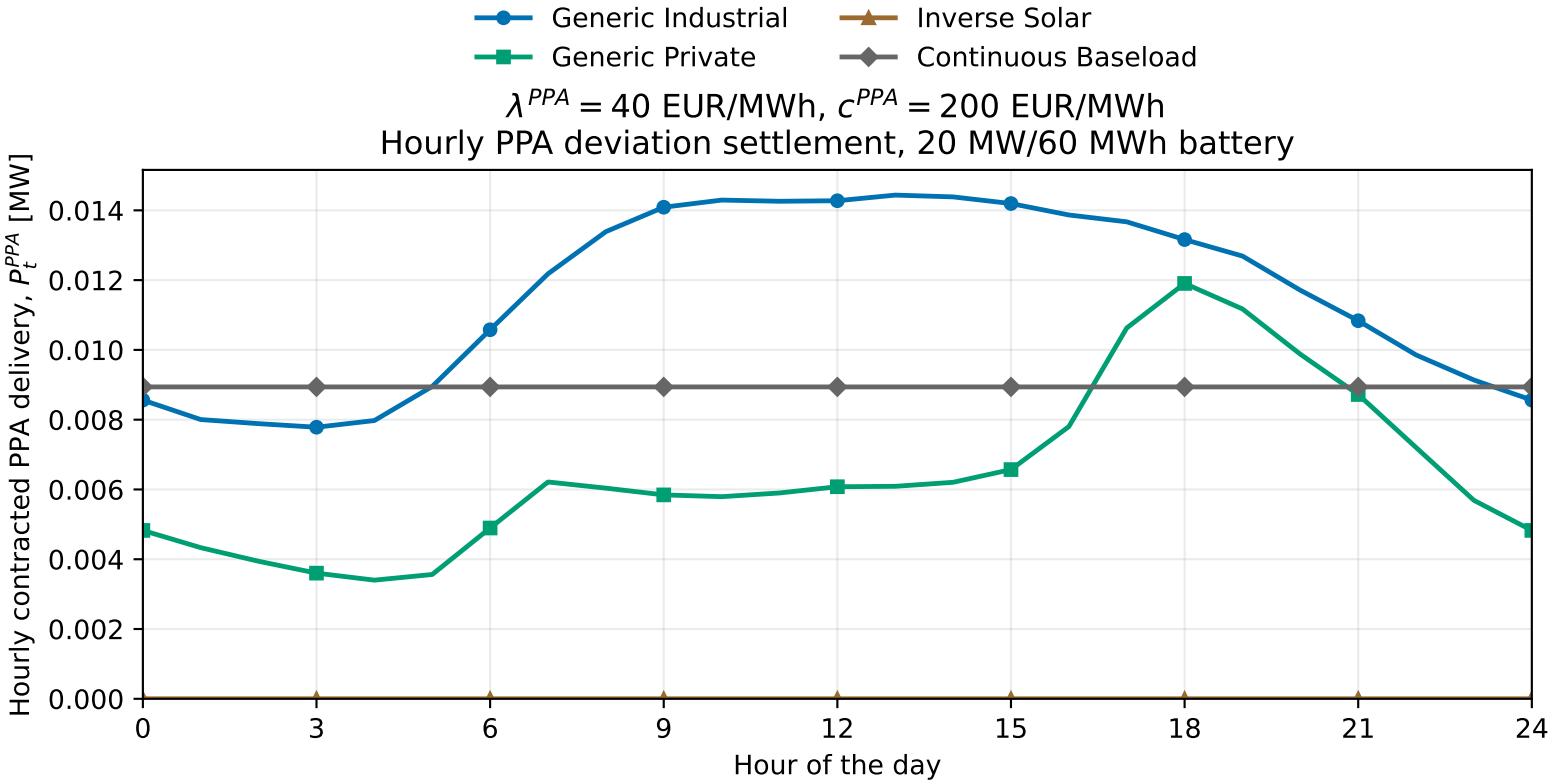
Generic Industrial
Generic Private
Inverse Solar
Continuous Baseload
$\lambda^{PPA} = 40$ EUR/MWh, $c^{PPA} = 200$ EUR/MWh
Hourly PPA deviation settlement, 20 MW/60 MWh battery
Hourly contracted PPA delivery, P_t^{PPA} [MW]
0.014
0.012
0.010
0.008
0.006
0.004
0.002
0.000
0
3
6
9
12
15
18
21
24
Hour of the day