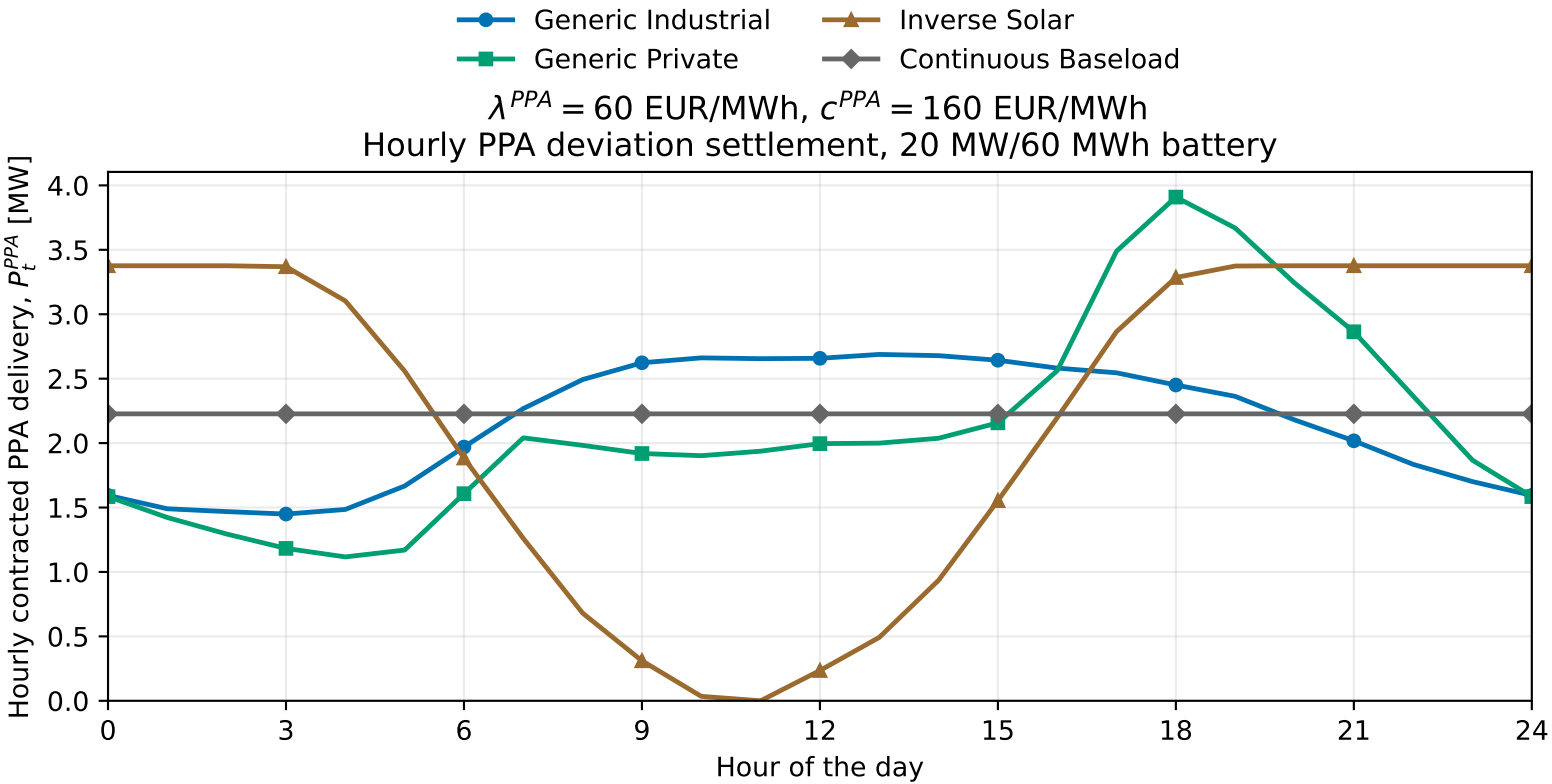
Generic Industrial
Generic Private
Inverse Solar
Continuous Baseload
$\lambda^{PPA} = 60$ EUR/MWh, $c^{PPA} = 160$ EUR/MWh
Hourly PPA deviation settlement, 20 MW/60 MWh battery
Hourly contracted PPA delivery, P_t^{PPA} [MW]
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
4.0
0
3
6
9
12
15
18
21
24
Hour of the day