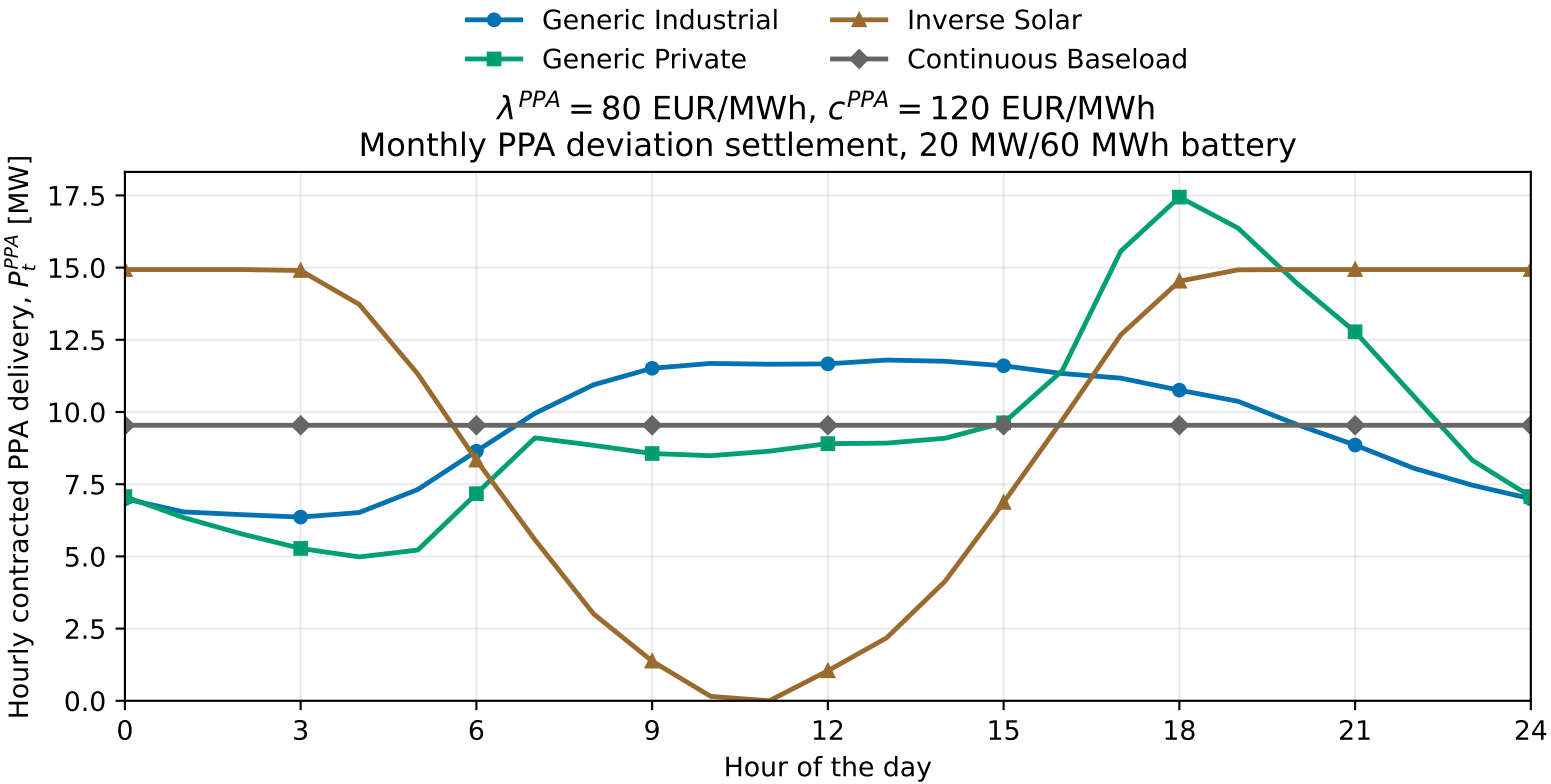
Generic Industrial
Generic Private
Inverse Solar
Continuous Baseload
$\lambda^{PPA} = 80$ EUR/MWh, $c^{PPA} = 120$ EUR/MWh
Monthly PPA deviation settlement, 20 MW/60 MWh battery
Hourly contracted PPA delivery, $P_t^{PPA}$ [MW]
0.0
2.5
5.0
7.5
10.0
12.5
15.0
17.5
0
3
6
9
12
15
18
21
24
Hour of the day