



STILT PLAN

Applicable on Tower(s) - 1, 4, 5, 11, 12, 20, 21, 25, &amp; 27

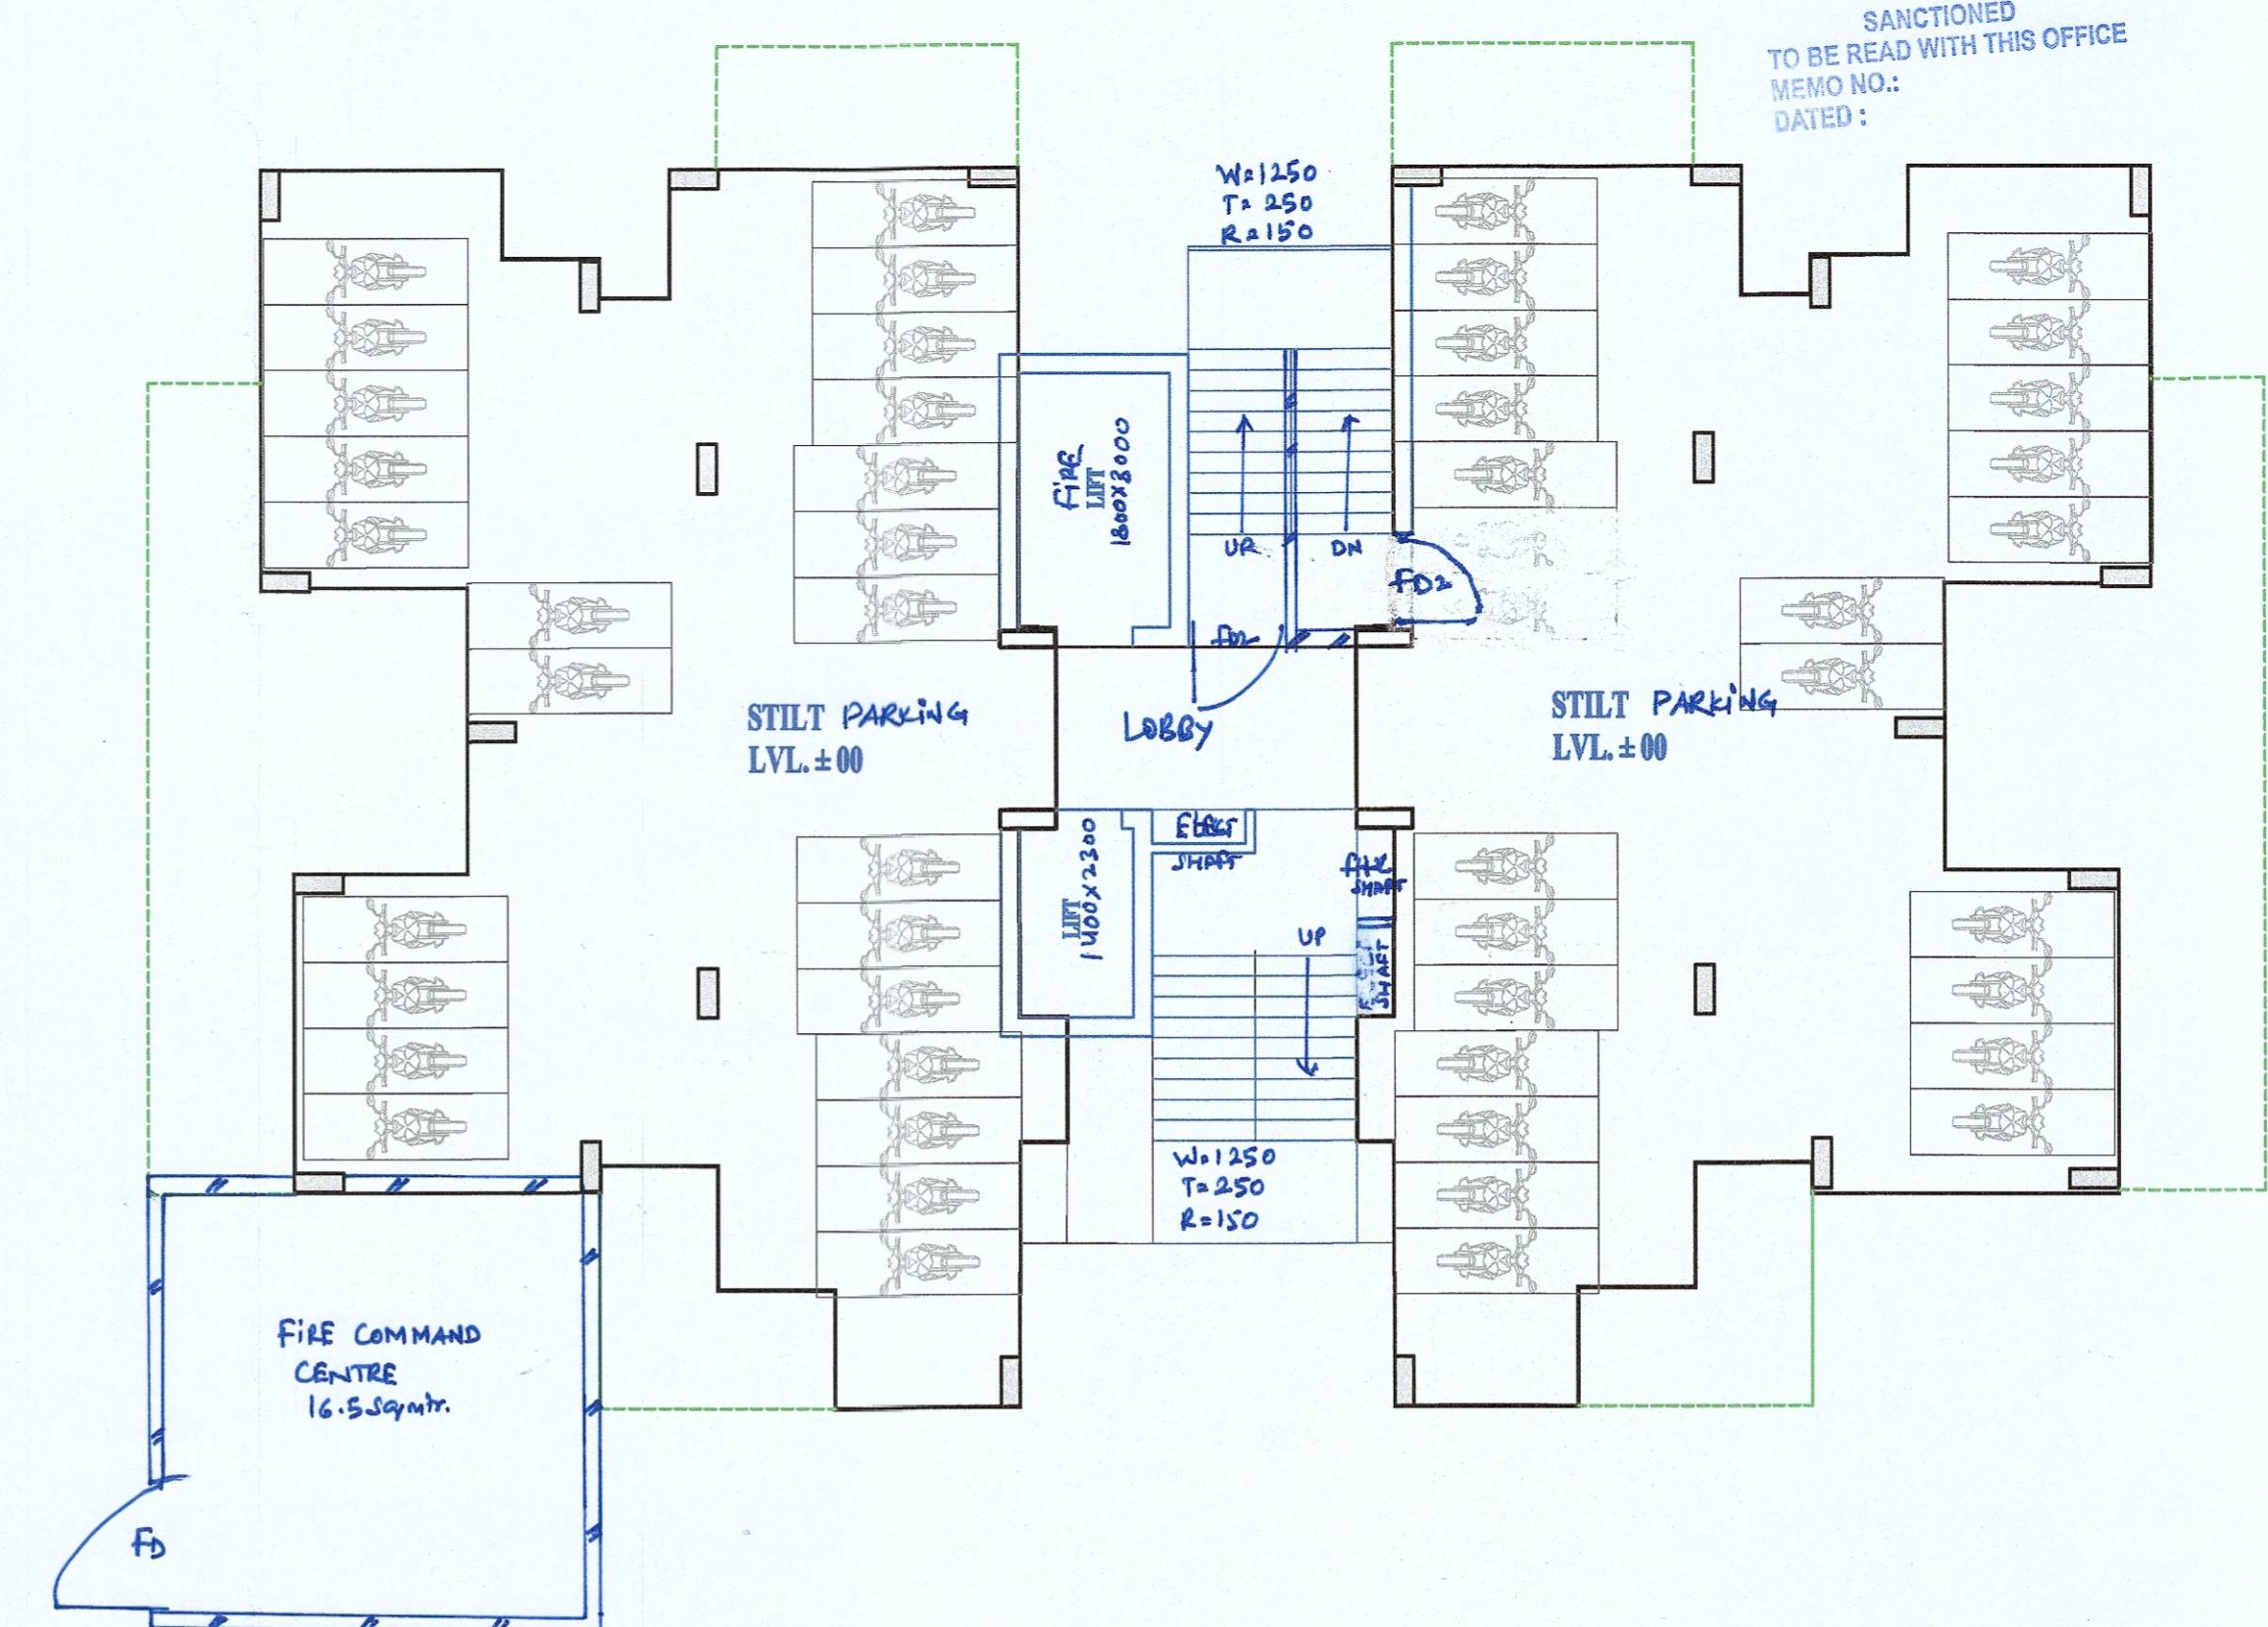

STILT PLAN

Applicable on Tower - 28

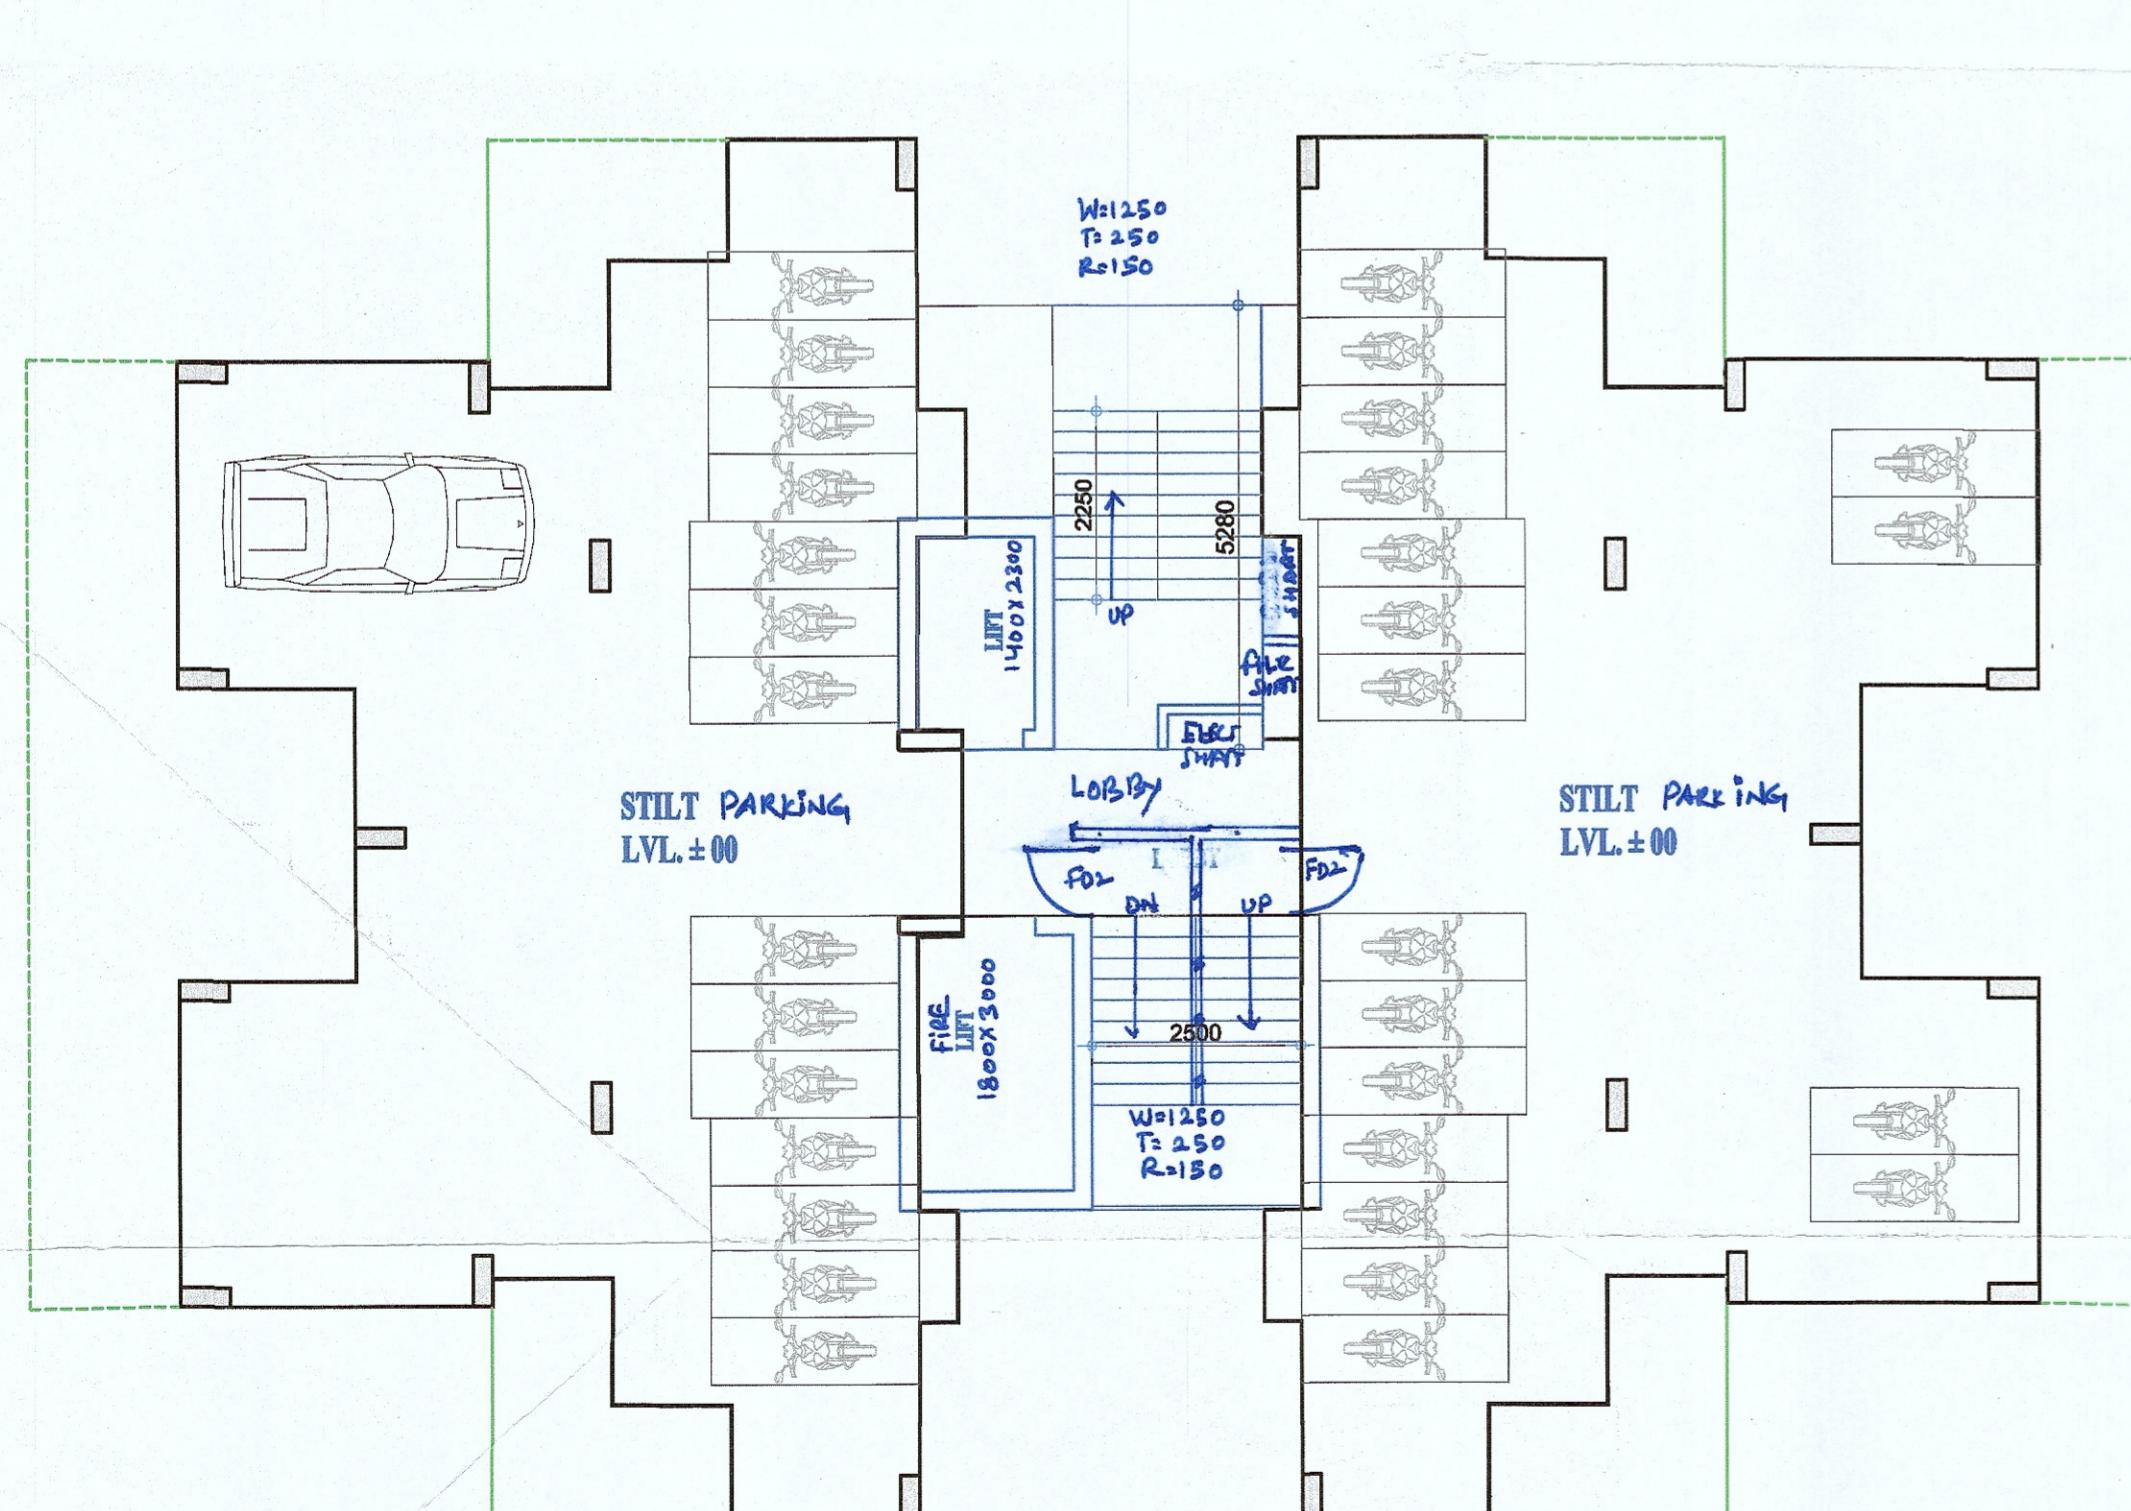

STILT PLAN

Applicable on Tower(s) - 2, 3, 6, 7, 8, 9, 10, 13 to 19, 22, 23, 24 &amp; 26

SYMBOL	DESCRIPTION
—	SOIL PIPE LINE
—	WASTE PIPE LINE
●	FLOOR DRAIN 90x90mm WITH GRATING
●	FLOOR TRAP 80x90mm WITH 125mm GRATING
■	FIRE HOSE CABINET
—	SPRINKLER LINE
—	COLD WATER SUPPLY LINE
—	FIRE LINE
—	AIR RELEASE VALVE

(1) - 100 Ø SOIL / VENT. PIPE  
(2) - 100 Ø WASTE WATER / VENT. PIPE  
(3) - 75 Ø ANTI-SYMPHONAGE PIPE  
(4) - COLD WATER DOWNTAKE PIPE  
(5) - 100 Ø RAIN WATER PIPE  
(6) - 150 Ø RAIN WATER PIPE  
(7) - FLUSH WATER DOWNTAKE PIPE  
(8) - 50Ø FLUSHING TANK RISER  
(9) - DOMESTIC TANK RISER  
(10) - HOT WATER PIPE  
(11) - HOT WATER SUPPLY RETURN

STILT PLAN

Applicable on Tower - 29

STILT PLAN, Tower - 1 to 29	
For ADORE PROPINFRA LLP	
Project Manager	Architect
M/s. ADORE PROPINFRA LLP.	M/s. ADORE PROPINFRA LLP.
GROUP - HOUSING, SECTOR - 104, FARIDABAD, HARYANA.	
Planners Club	Master planning Housing planning Project Management
PROPOSED BUILDING PLAN OF AFFORDABLE GROUP HOUSING SCHEME, AREA MEASURING 9.0375 Ac.	
(License No. 262 of 2023) FALLING IN SECTOR- 104, FARIDABAD M/s. ADORE PROPINFRA LLP.	

S.T.P. (F) S.T.P. (HQ) C.O. (H)  
Member Member Chairman  
B.P.A.C. Secretary B.P.A.C. B.P.A.C.

AD JD ATP  
Consultant Architect DTP (HQ) ATP (HQ)

Checked and found ok for Public Health (Internal) Service only subject to comments in forwarding letter No. 712-70....Dt. 26/3/2024

GURPREET KHEPARI AD (HQ)