


Terminal active - power deviation (device electrical output)
3? - G fault at bus 21, cleared after 0.100s at t=0.300s by tripping line 21 - - 22



Terminal reactive - power deviation (device electrical output)
3? - G fault at bus 21, cleared after 0.100s at t=0.300s by tripping line 21 - - 22

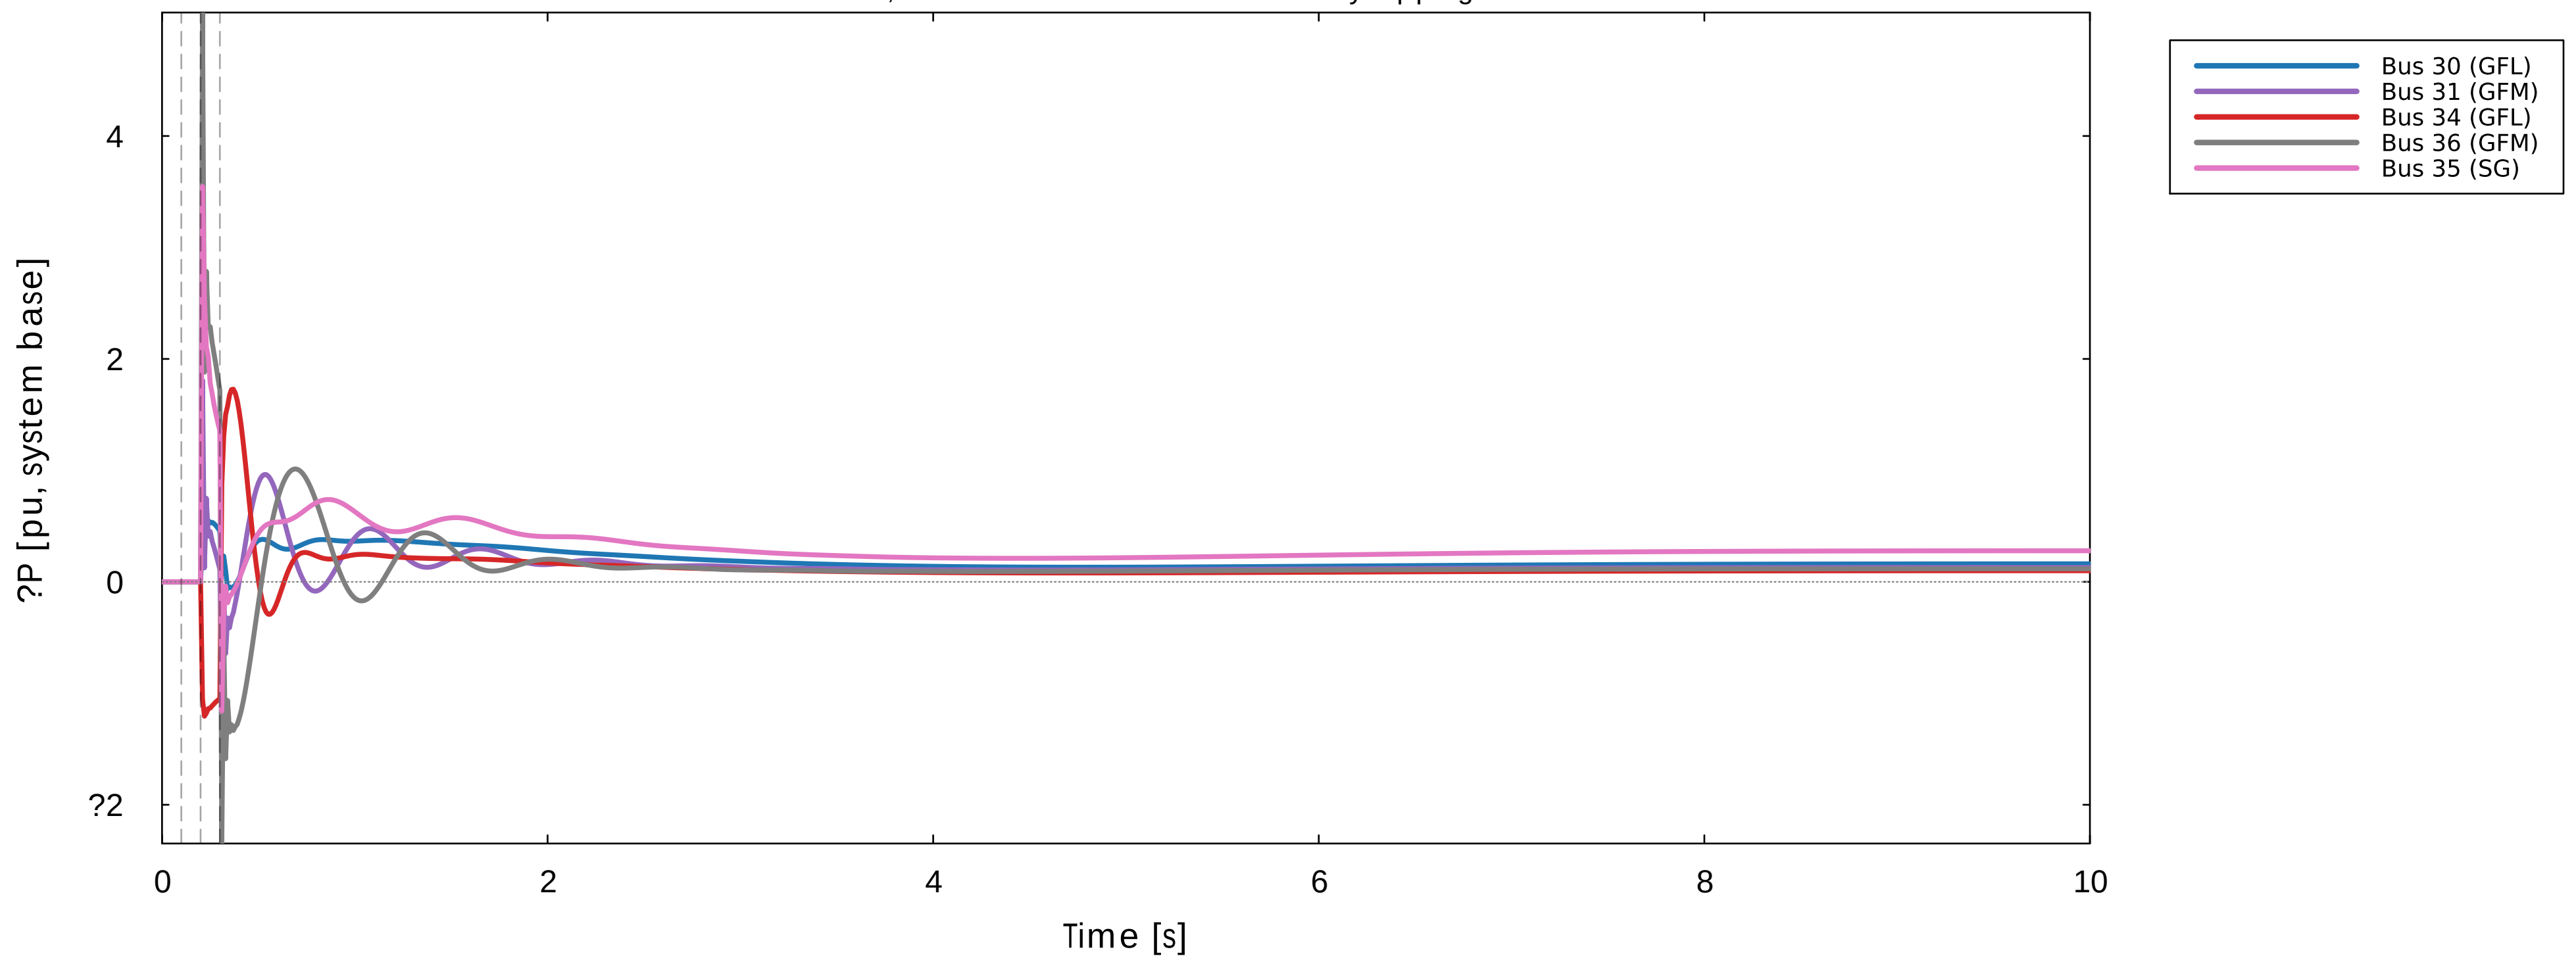