




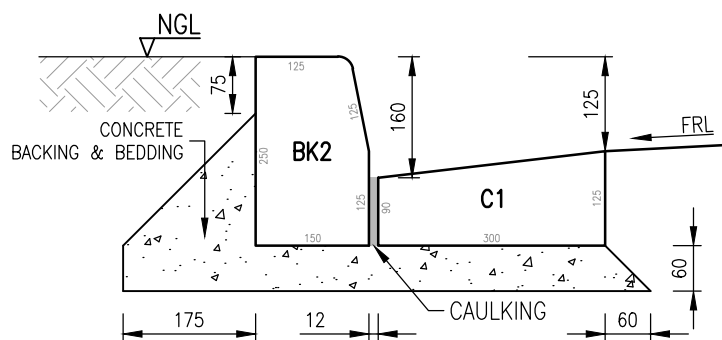


BK2 BARRIER KERB & C1 CHANNEL

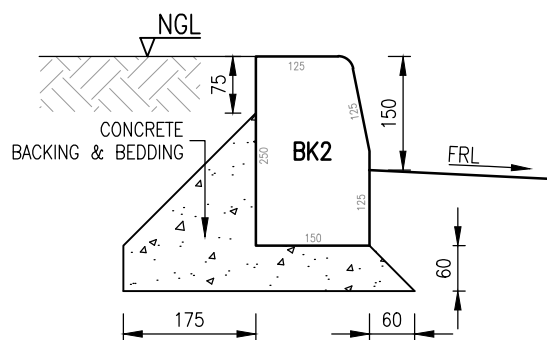


BK2 BARRIER KERB ONLY

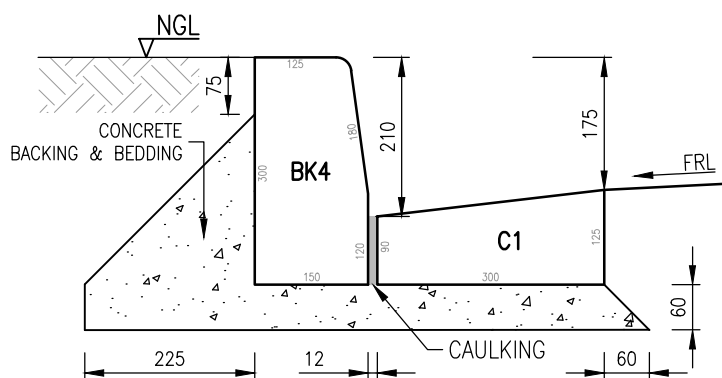

BK4 BARRIER KERB & C1 CHANNEL

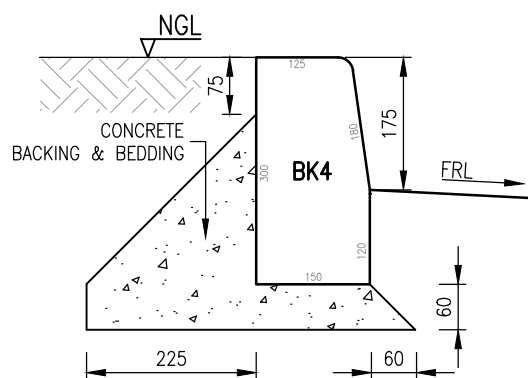

BK4 BARRIER KERB ONLY

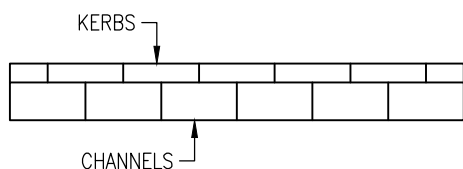

STAGGERING OF KERBS AND CHANNELS

NOTES:

1. ALL UNITS MUST BE LAID WITH CLASS 20/20 CONCRETE BEDDING/BACKING,
2. UNLESS SHOWN OTHERWISE, ON SUBGRADE/SUBBASE COMPACTED TO THE REQUIRED SPECIFICATIONS.
3. CHANNELS SHALL BE INFALL. NO OUTFALL CHANNELS PERMITTED.
4. KERBS AND CHANNELS SHALL CONFORM TO SANS 927.
5. ALL RADII < 20m SHALL BE BUILT WITH 300/330mm LONG ELEMENTS.
6. ALL PRECAST UNITS LAID LONGITUDINALLY NEXT TO ONE ANOTHER SHALL BE STAGGERED.
7. ALL KERB JOINTS TO BE WATER SPRAYED BEFORE CAULKING.
8. CAULKING BETWEEN KERBS TO HAVE A CEMENT:SAND RATIO OF 1:3.
9. EXPANSION JOINTS ON KERBING:
 - SHALL BE 10mm WIDE, SPACED AT 10m c/c.
 - FILLED WITH FOAMED POLYSTYRENE (OR EQUIVALENT APPROVED)
 - SEALED WITH 20mm X 10mm SILICONE SEALANT (OR EQUIVALENT APPROVED)
10. REFER TO DRAWING RD1.10 FOR REMOVABLE BARRIER KERBS.

NGL: NATURAL GROUND LEVEL
FRL: FINISHED ROAD LEVEL
FSL: FINISHED SURFACE LEVEL



CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

CITY OF CAPE TOWN
URBAN MOBILITY

TITLE

BARRIER KERBS AND CHANNELS

STANDARDS AND GUIDELINES DETAILS

SCALE

1:10

PAPER

A4

DRAWING No.

RD1.1

REV

C