

Electrical routes / printable review set

Default model export - circuit plans, heights, equipment coordinates and route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Read the plan, then trace the same ID in 3D

296 connected installed-study equipment / 343 unique routes / 23 drawing scopes. Hidden alternatives and non-electrical furniture are excluded. Shared feeders and trunks repeat as context on circuit sheets; quantities are owned once in the route index.

Print and measure

Use A3 landscape at 100%, with no fit-to-page. The line below must measure 100 mm. Plans and height projections have separate stated scales. Never scale from a resized copy.

Coordinate basis

X: axis 1 toward sanctuary. Y: height above nave finished floor. Z: centre between D/E; negative toward B, positive toward H. Grid is a model transcription, not a measured floor plan or installation set-out.

Route reading

Solid: power/feed. Dashed: loudspeaker audio. Dotted: microphone. Circle: equipment. Square: enclosure. Projection crossings are not junctions. Overlapping vertical paths require the route-vertex CSV and 3D review.

Length basis

Route length = sum of 3D segment lengths. No spare, termination or installation allowances. Audio home run = branch plus its own upstream path; do not add shared bundle lengths again. This is not a conductor/cable take-off.

Stop before physical work

Cable sizes, protection, supply/earthing/fault level, product data, supports, containment and fire stopping, control channels, life-safety functions and commissioning approval are pending. Do not drill timber or close concealed works from these sheets.

Sheet index / circuit lookup

- E-001 Distribution and feeders
- E-002 L3 / Sanctuary
- E-003 L1 / Central seating
- E-004 L2 / Outer seating
- E-005 L8 / Wings / choir & ministers
- E-006 LA / Roof uplight
- E-007 LD / Chandeliers & sconces
- E-008 L4 / Circulation & verandas
- E-009 L9 / Front stage & central door
- E-010 L5 / Steps & paths
- E-011 E1 / Exit signs
- E-012 L6 / Facade & towers
- E-013 L7 / Festival exterior (strings & tower floods)
- E-014 F1 / Ceiling fans
- E-015 F5 / Wing wall fans / held review
- E-016 F2 / Wall fans
- E-017 F4 / Entrance circulators (trial)
- E-018 V1 / Exhaust ventilation
- E-019 A1 / Main & delay loudspeakers
- E-020 A5 / Rear fill (crowded feasts)
- E-021 A2 / Veranda fill
- E-022 A3 / Courtyard
- E-023 Microphones

After circuit sheets: equipment naming schedule, unique route index and the same nine-stage 3D coordination sequence. PDF bookmarks jump to each sheet.

Engineering baseline: feedback and wing speech clarity remain below targets; some seats miss the lighting brief. Fan performance, concealment, emergency design and installation access remain unverified. See docs/engineering/baseline.md and issues.md.

Companion files: drawing-index.json, model-snapshot.json, route-vertices.csv, equipment-coordinates.csv and manifest.json. Hashes bind this print set to its source files. Saved browser layouts are a different configuration.



100 mm print calibration

Distribution and feeders

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION




COORDINATES / X, Y, Z (m)

| ID                 | X      | Y     | Z      | Branch |
|--------------------|--------|-------|--------|--------|
| Related enclosures |        |       |        |        |
| DB1                | 48.895 | 1.750 | -1.550 |        |
| DB2                | 2.730  | 1.500 | -3.300 |        |
| LC1                | 48.895 | 1.850 | -0.550 |        |
| FC1                | 48.895 | 1.950 | 0.400  |        |
| AV1                | 49.275 | 0.950 | 1.400  |        |

0 equipment / 4 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

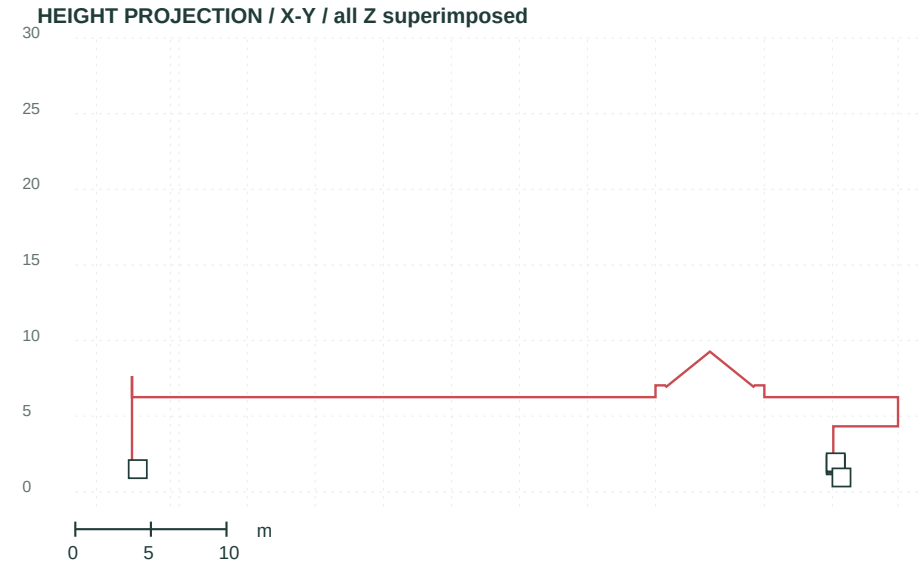


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L3 / Sanctuary

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

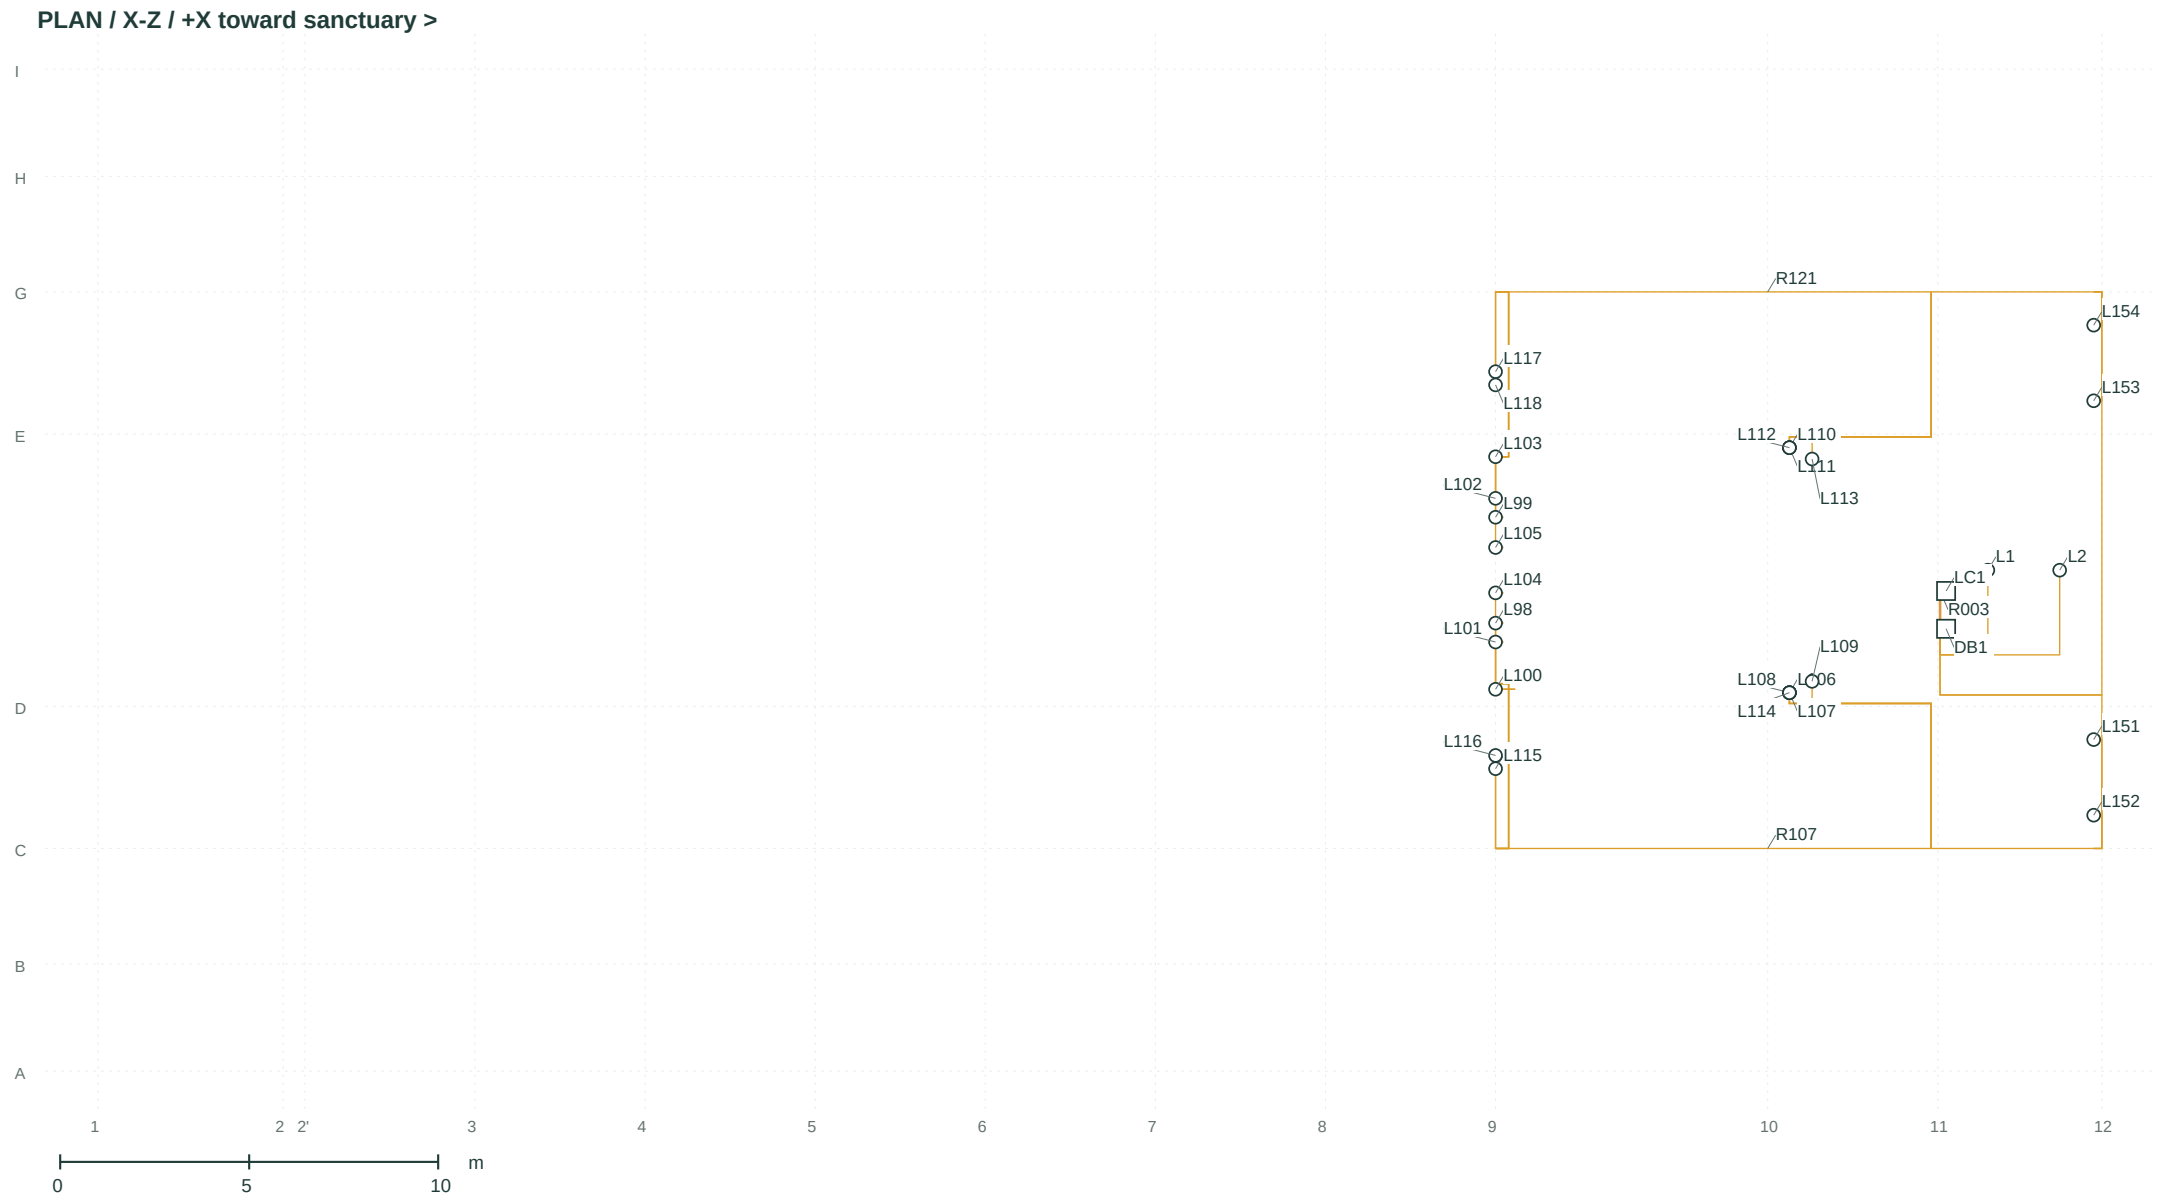


| COORDINATES / X, Y, Z (m) |        |       |        |        |
|---------------------------|--------|-------|--------|--------|
| ID                        | X      | Y     | Z      | Branch |
| L1                        | 50.000 | 4.140 | 0.000  | R005   |
| L2                        | 51.900 | 4.140 | 0.000  | R006   |
| L98                       | 36.975 | 8.585 | -1.400 | R108   |
| L99                       | 36.975 | 8.585 | 1.400  | R122   |
| L100                      | 36.975 | 8.585 | -3.150 | R109   |
| L101                      | 36.975 | 8.585 | -1.900 | R110   |
| L102                      | 36.975 | 8.585 | 1.900  | R123   |
| L103                      | 36.975 | 8.585 | 3.000  | R124   |
| L104                      | 36.975 | 8.585 | -0.600 | R111   |
| L105                      | 36.975 | 8.585 | 0.600  | R125   |
| L106                      | 44.750 | 7.600 | -3.240 | R112   |
| L107                      | 44.750 | 6.700 | -3.240 | R113   |
| L108                      | 44.750 | 5.400 | -3.240 | R114   |
| L109                      | 45.350 | 8.420 | -2.940 | R115   |
| L110                      | 44.750 | 7.600 | 3.240  | R126   |
| L111                      | 44.750 | 6.700 | 3.240  | R127   |
| L112                      | 44.750 | 5.400 | 3.240  | R128   |
| L113                      | 45.350 | 8.420 | 2.940  | R129   |
| L114                      | 44.750 | 4.900 | -3.240 | R116   |
| L115                      | 36.975 | 6.655 | -5.250 | R117   |
| L116                      | 36.975 | 6.655 | -4.900 | R118   |
| L117                      | 36.975 | 6.655 | 5.250  | R130   |
| L118                      | 36.975 | 6.655 | 4.900  | R131   |
| L151                      | 52.800 | 2.300 | -4.480 | R119   |
| L152                      | 52.800 | 2.300 | -6.480 | R120   |
| L153                      | 52.800 | 2.300 | 4.480  | R132   |
| L154                      | 52.800 | 2.300 | 6.480  | R133   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

27 equipment / 30 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

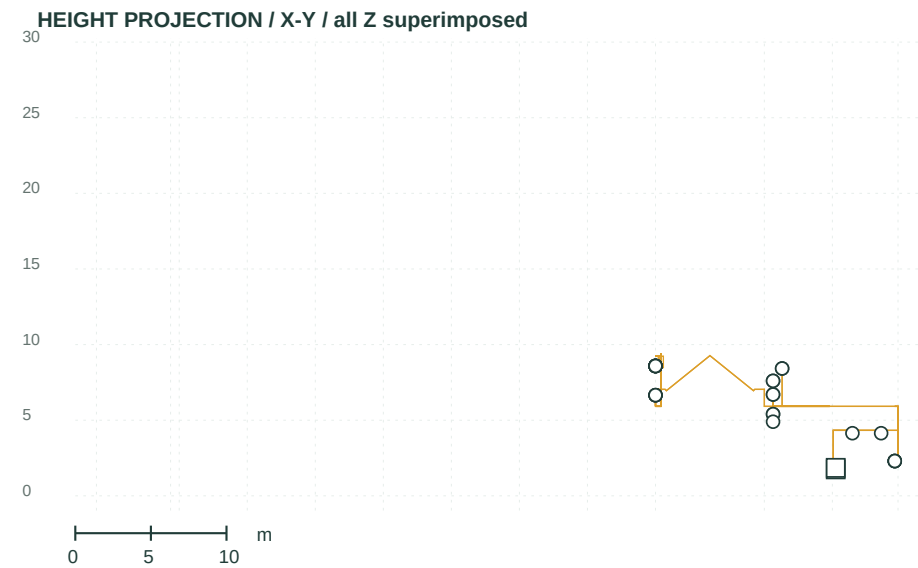



PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L1 / Central seating

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

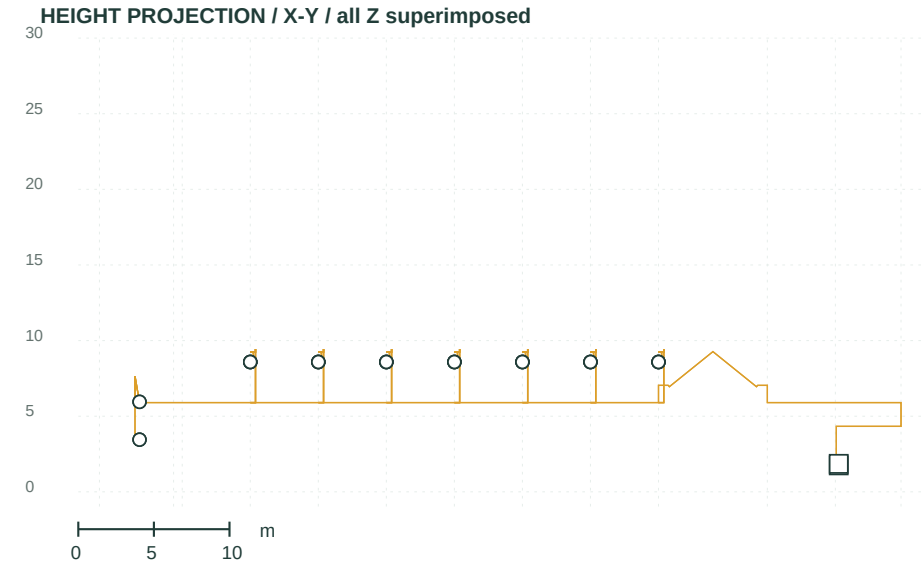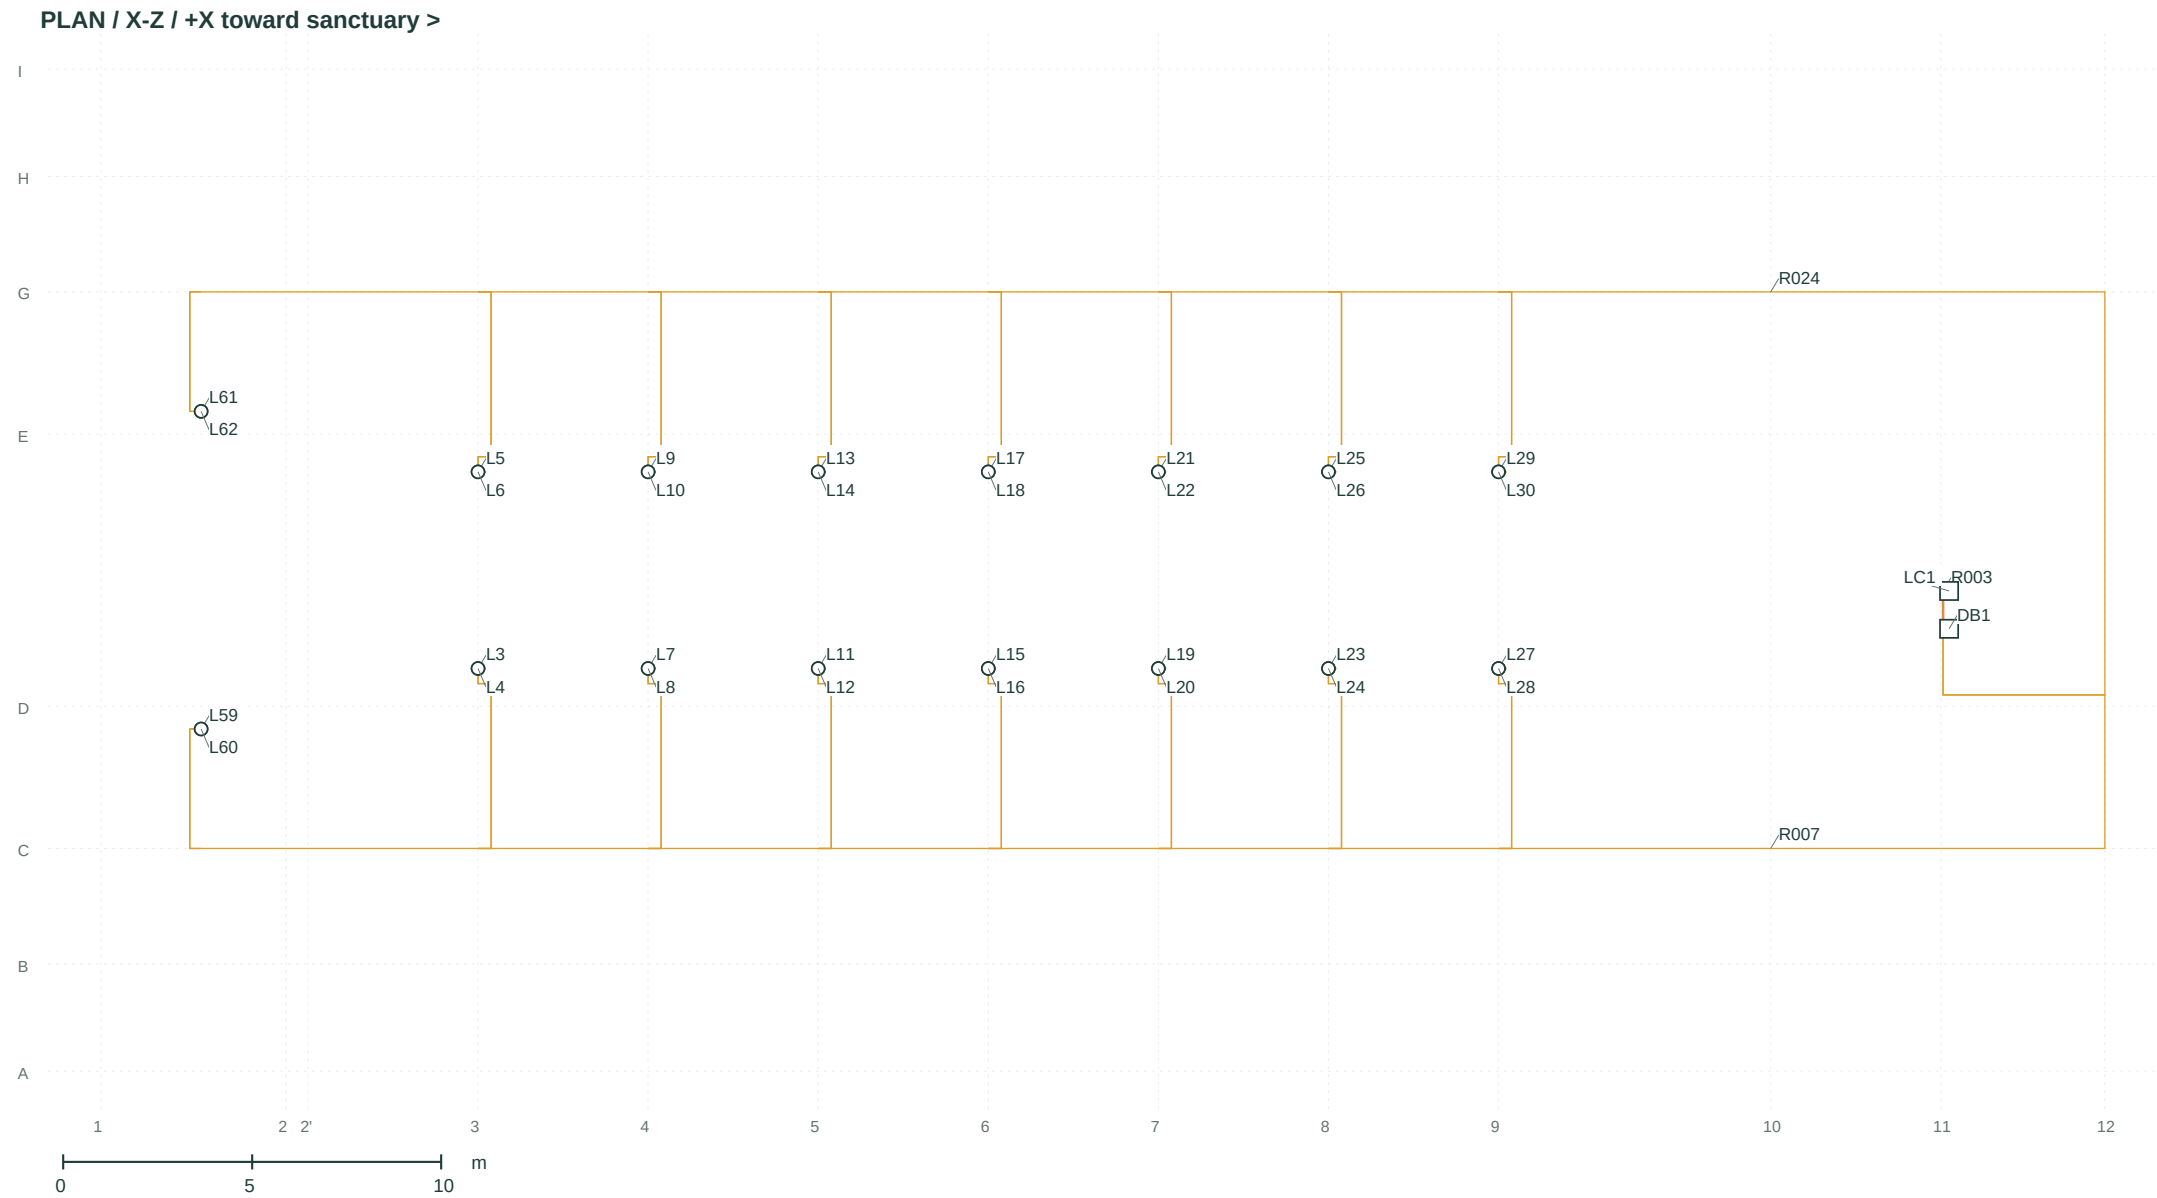

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

| COORDINATES / X, Y, Z (m) |        |       |        |        |
|---------------------------|--------|-------|--------|--------|
| ID                        | X      | Y     | Z      | Branch |
| L3                        | 9.975  | 8.585 | -2.600 | R008   |
| L4                        | 9.975  | 8.585 | -2.600 | R009   |
| L5                        | 9.975  | 8.585 | 2.600  | R025   |
| L6                        | 9.975  | 8.585 | 2.600  | R026   |
| L7                        | 14.475 | 8.585 | -2.600 | R010   |
| L8                        | 14.475 | 8.585 | -2.600 | R011   |
| L9                        | 14.475 | 8.585 | 2.600  | R027   |
| L10                       | 14.475 | 8.585 | 2.600  | R028   |
| L11                       | 18.975 | 8.585 | -2.600 | R012   |
| L12                       | 18.975 | 8.585 | -2.600 | R013   |
| L13                       | 18.975 | 8.585 | 2.600  | R029   |
| L14                       | 18.975 | 8.585 | 2.600  | R030   |
| L15                       | 23.475 | 8.585 | -2.600 | R014   |
| L16                       | 23.475 | 8.585 | -2.600 | R015   |
| L17                       | 23.475 | 8.585 | 2.600  | R031   |
| L18                       | 23.475 | 8.585 | 2.600  | R032   |
| L19                       | 27.975 | 8.585 | -2.600 | R016   |
| L20                       | 27.975 | 8.585 | -2.600 | R017   |
| L21                       | 27.975 | 8.585 | 2.600  | R033   |
| L22                       | 27.975 | 8.585 | 2.600  | R034   |
| L23                       | 32.475 | 8.585 | -2.600 | R018   |
| L24                       | 32.475 | 8.585 | -2.600 | R019   |
| L25                       | 32.475 | 8.585 | 2.600  | R035   |
| L26                       | 32.475 | 8.585 | 2.600  | R036   |
| L27                       | 36.975 | 8.585 | -2.600 | R020   |
| L28                       | 36.975 | 8.585 | -2.600 | R021   |
| L29                       | 36.975 | 8.585 | 2.600  | R037   |
| L30                       | 36.975 | 8.585 | 2.600  | R038   |
| L59                       | 2.650  | 3.450 | -4.200 | R022   |
| L60                       | 2.650  | 5.950 | -4.200 | R023   |
| L61                       | 2.650  | 3.450 | 4.200  | R039   |
| L62                       | 2.650  | 5.950 | 4.200  | R040   |

| Related enclosures |        |       |        |
|--------------------|--------|-------|--------|
| DB1                | 48.895 | 1.750 | -1.550 |
| LC1                | 48.895 | 1.850 | -0.550 |



32 equipment / 35 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

L2 / Outer seating

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

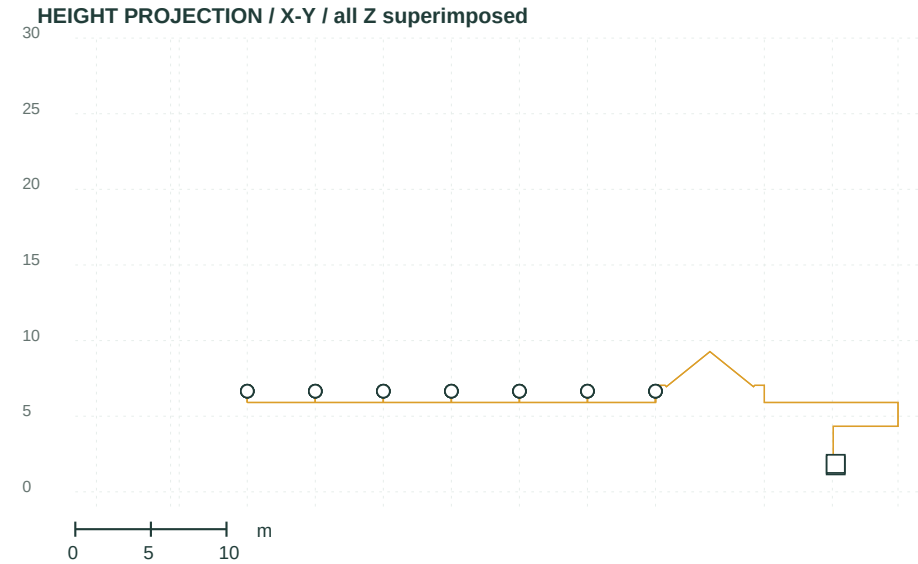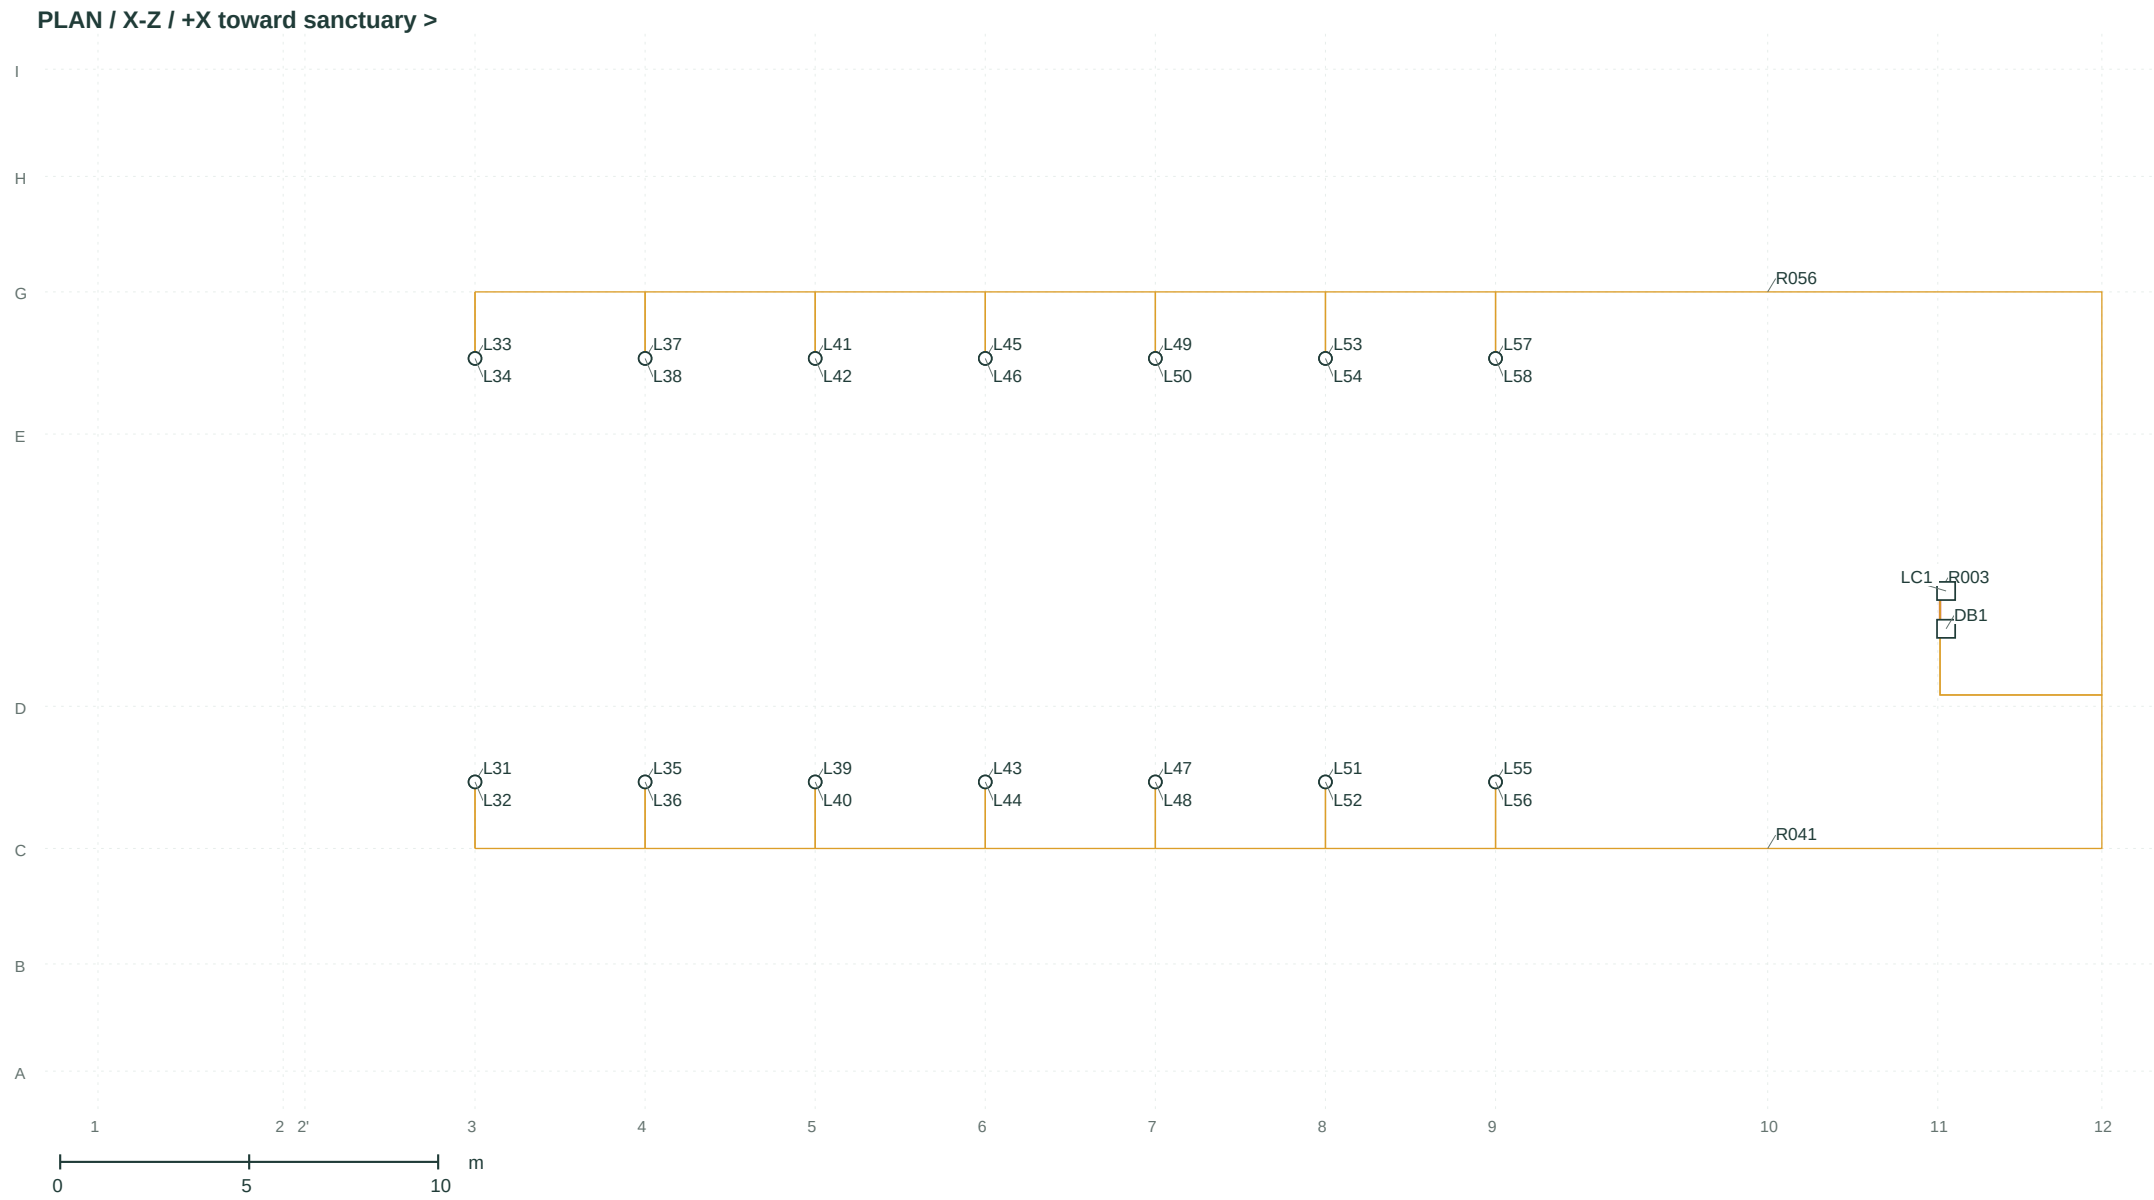

| COORDINATES / X, Y, Z (m) |        |       |        |        |
|---------------------------|--------|-------|--------|--------|
| ID                        | X      | Y     | Z      | Branch |
| L31                       | 9.975  | 6.655 | -5.600 | R042   |
| L32                       | 9.975  | 6.655 | -5.600 | R043   |
| L33                       | 9.975  | 6.655 | 5.600  | R057   |
| L34                       | 9.975  | 6.655 | 5.600  | R058   |
| L35                       | 14.475 | 6.655 | -5.600 | R044   |
| L36                       | 14.475 | 6.655 | -5.600 | R045   |
| L37                       | 14.475 | 6.655 | 5.600  | R059   |
| L38                       | 14.475 | 6.655 | 5.600  | R060   |
| L39                       | 18.975 | 6.655 | -5.600 | R046   |
| L40                       | 18.975 | 6.655 | -5.600 | R047   |
| L41                       | 18.975 | 6.655 | 5.600  | R061   |
| L42                       | 18.975 | 6.655 | 5.600  | R062   |
| L43                       | 23.475 | 6.655 | -5.600 | R048   |
| L44                       | 23.475 | 6.655 | -5.600 | R049   |
| L45                       | 23.475 | 6.655 | 5.600  | R063   |
| L46                       | 23.475 | 6.655 | 5.600  | R064   |
| L47                       | 27.975 | 6.655 | -5.600 | R050   |
| L48                       | 27.975 | 6.655 | -5.600 | R051   |
| L49                       | 27.975 | 6.655 | 5.600  | R065   |
| L50                       | 27.975 | 6.655 | 5.600  | R066   |
| L51                       | 32.475 | 6.655 | -5.600 | R052   |
| L52                       | 32.475 | 6.655 | -5.600 | R053   |
| L53                       | 32.475 | 6.655 | 5.600  | R067   |
| L54                       | 32.475 | 6.655 | 5.600  | R068   |
| L55                       | 36.975 | 6.655 | -5.600 | R054   |
| L56                       | 36.975 | 6.655 | -5.600 | R055   |
| L57                       | 36.975 | 6.655 | 5.600  | R069   |
| L58                       | 36.975 | 6.655 | 5.600  | R070   |

| Related enclosures |        |       |        |
|--------------------|--------|-------|--------|
| DB1                | 48.895 | 1.750 | -1.550 |
| LC1                | 48.895 | 1.850 | -0.550 |

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L8 / Wings / choir & ministers

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

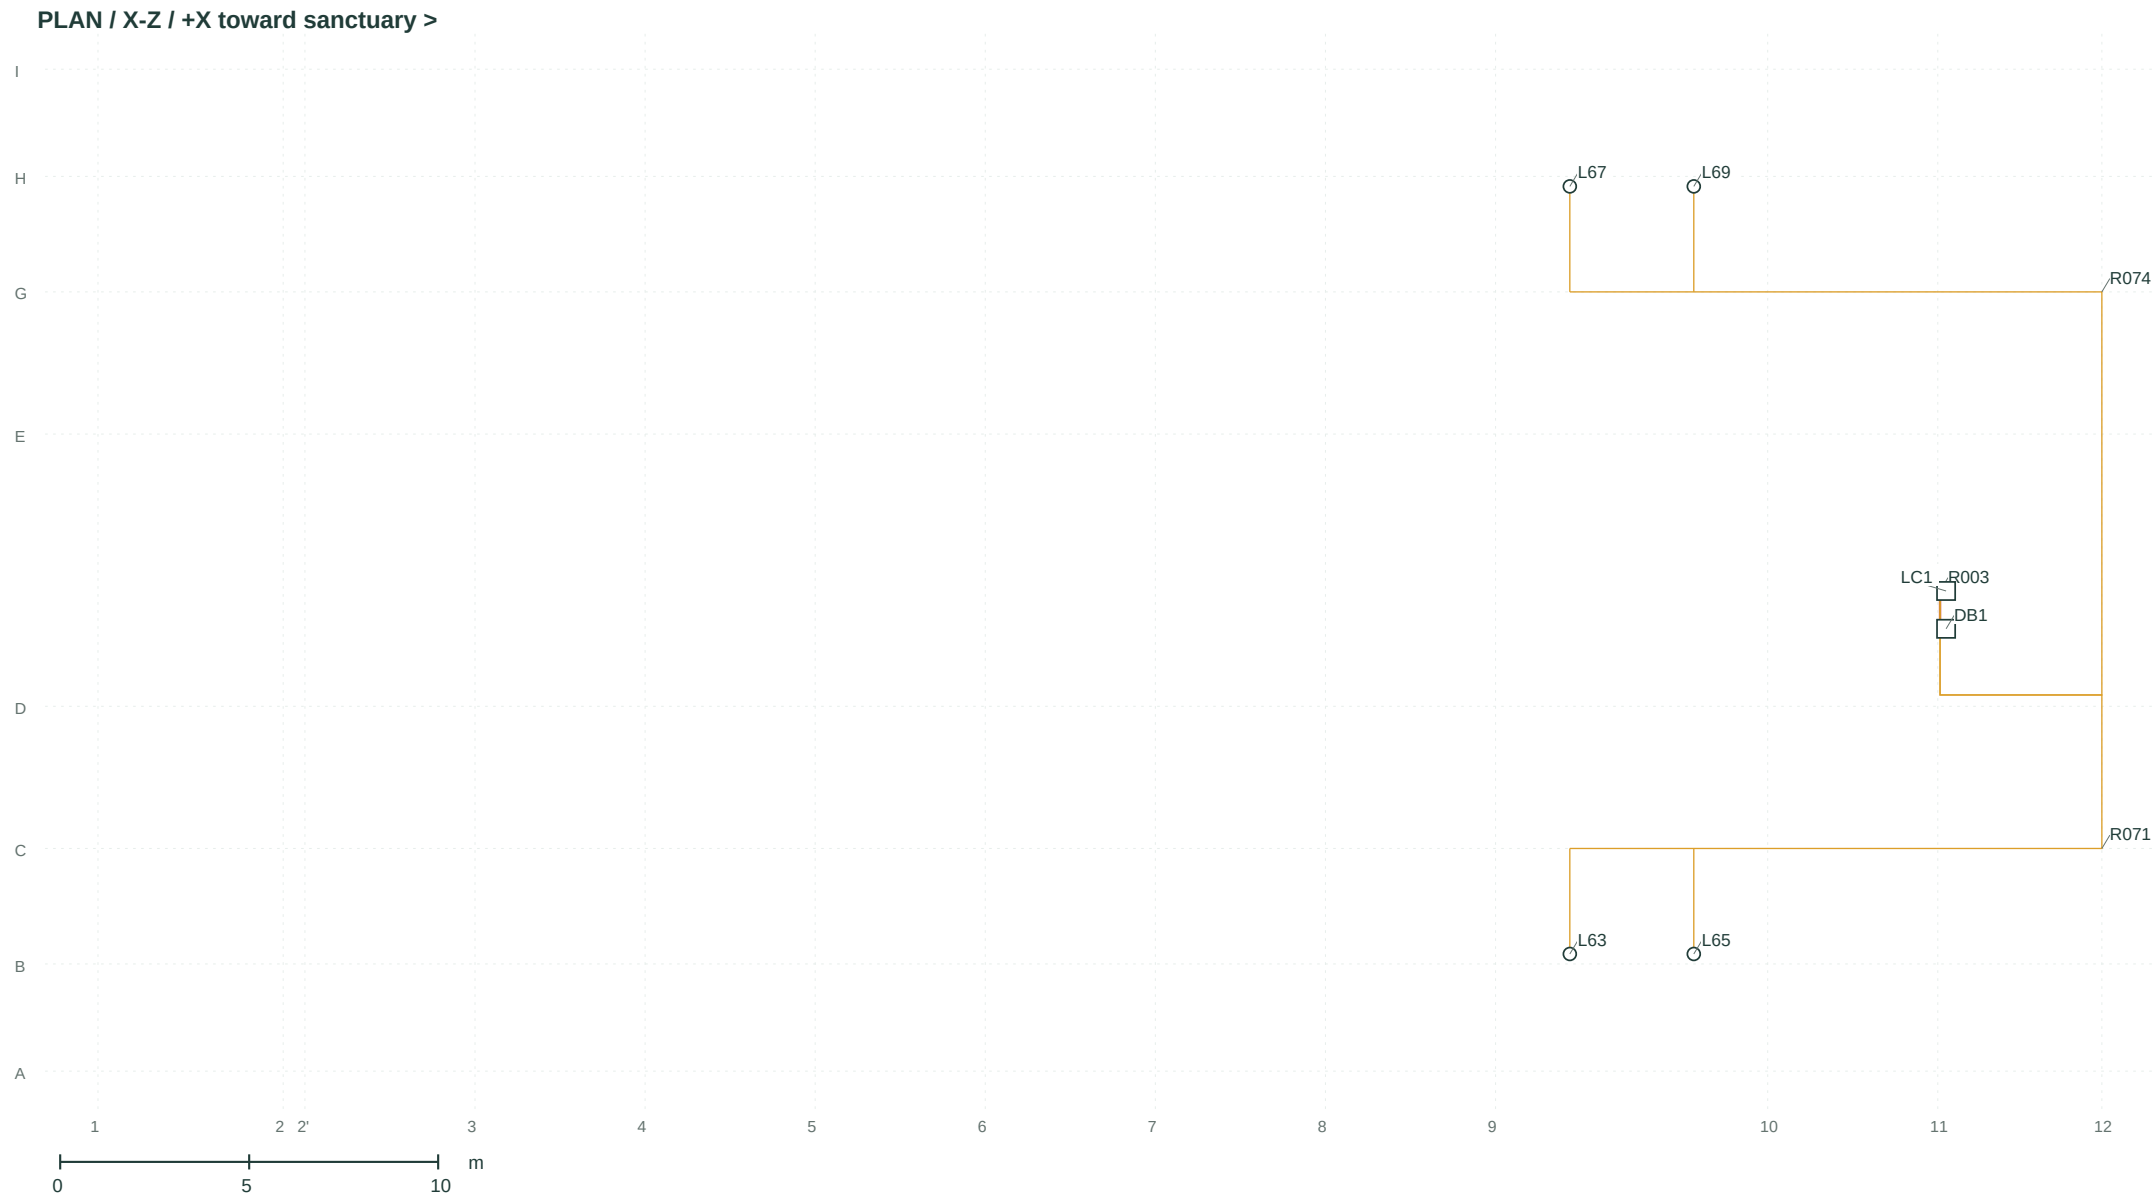

COORDINATES / X, Y, Z (m)


| ID  | X      | Y     | Z       | Branch |
|-----|--------|-------|---------|--------|
| L63 | 38.940 | 3.800 | -10.150 | R072   |
| L65 | 42.220 | 3.800 | -10.150 | R073   |
| L67 | 38.940 | 3.800 | 10.150  | R075   |
| L69 | 42.220 | 3.800 | 10.150  | R076   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

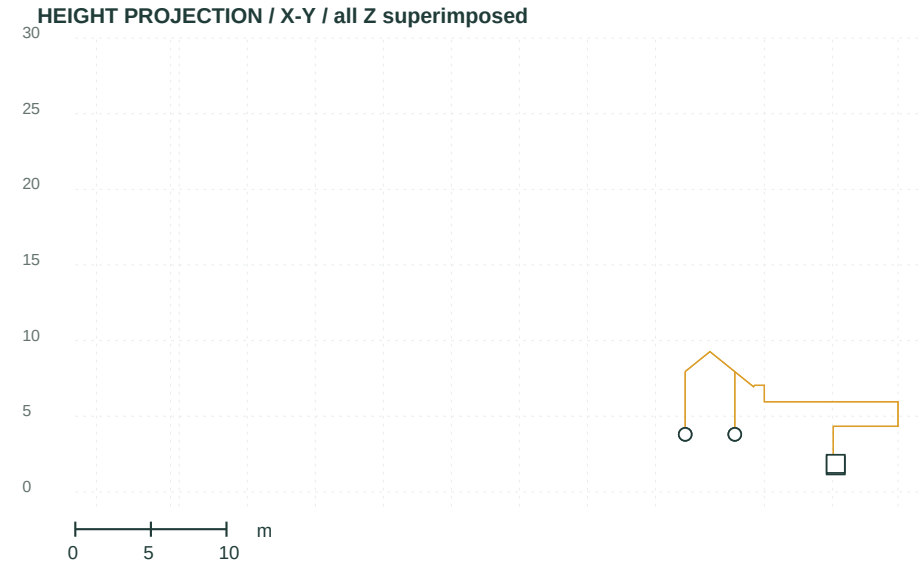



PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

LA / Roof uplight

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

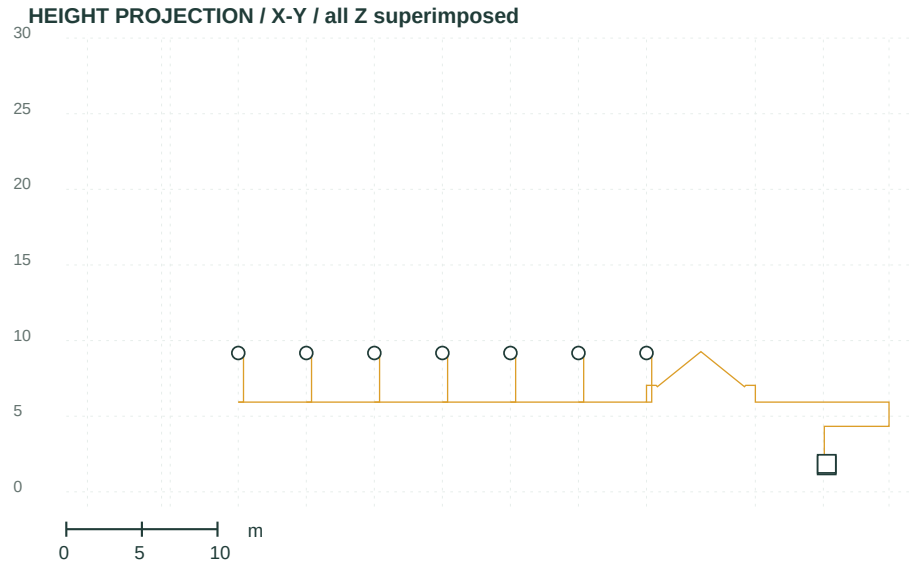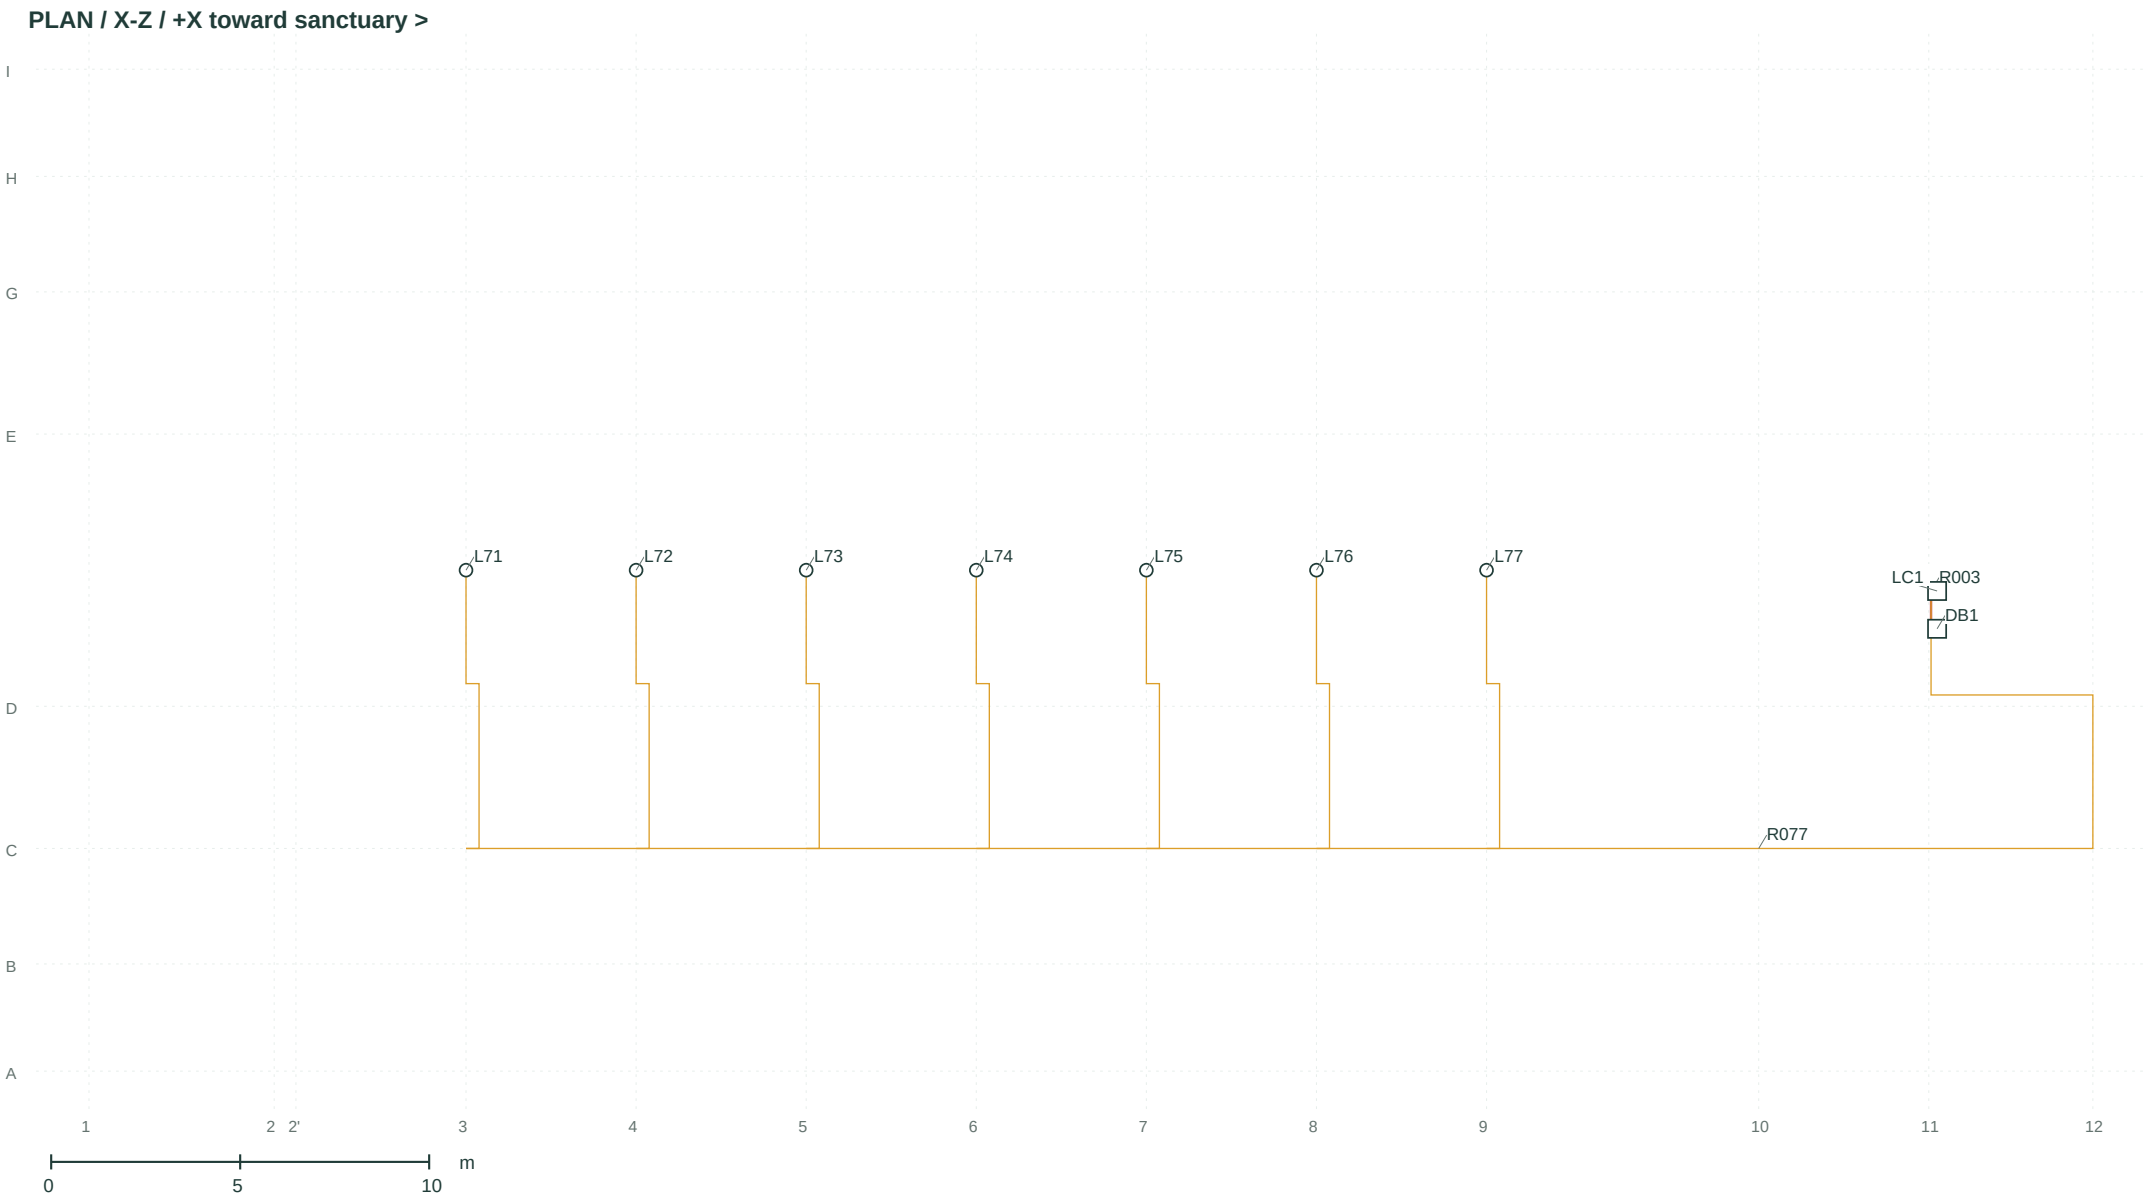

COORDINATES / X, Y, Z (m)

| ID  | X      | Y     | Z     | Branch |
|-----|--------|-------|-------|--------|
| L71 | 9.975  | 9.180 | 0.000 | R078   |
| L72 | 14.475 | 9.180 | 0.000 | R079   |
| L73 | 18.975 | 9.180 | 0.000 | R080   |
| L74 | 23.475 | 9.180 | 0.000 | R081   |
| L75 | 27.975 | 9.180 | 0.000 | R082   |
| L76 | 32.475 | 9.180 | 0.000 | R083   |
| L77 | 36.975 | 9.180 | 0.000 | R084   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

7 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

LD / Chandeliers & sconces

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

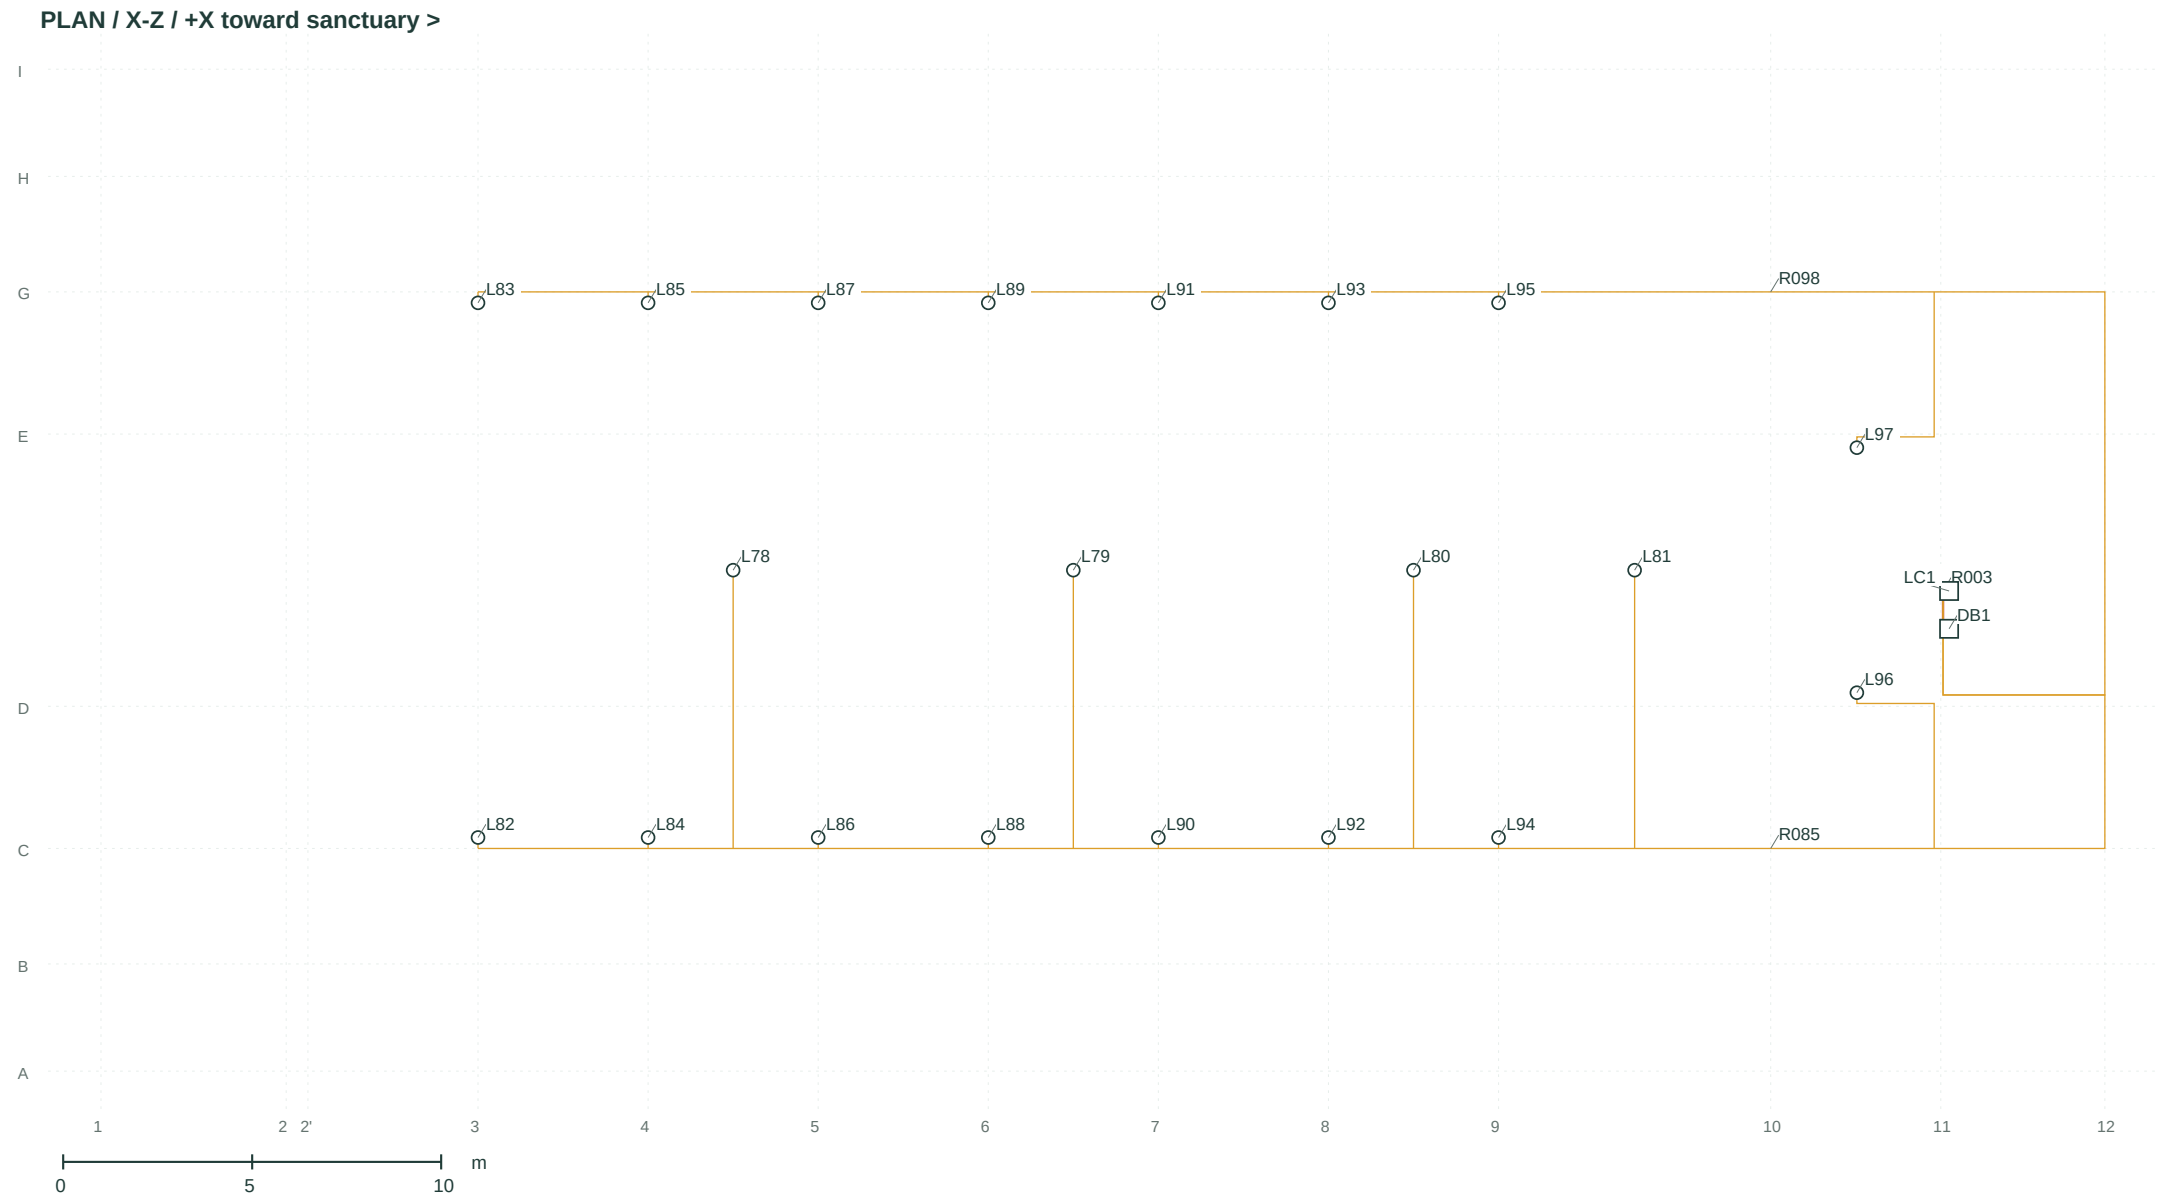

COORDINATES / X, Y, Z (m)


| ID  | X      | Y     | Z      | Branch |
|-----|--------|-------|--------|--------|
| L78 | 16.725 | 6.300 | 0.000  | R086   |
| L79 | 25.725 | 6.300 | 0.000  | R087   |
| L80 | 34.725 | 6.300 | 0.000  | R088   |
| L81 | 40.575 | 9.200 | 0.000  | R089   |
| L82 | 9.975  | 4.600 | -7.070 | R090   |
| L83 | 9.975  | 4.600 | 7.070  | R099   |
| L84 | 14.475 | 4.600 | -7.070 | R091   |
| L85 | 14.475 | 4.600 | 7.070  | R100   |
| L86 | 18.975 | 4.600 | -7.070 | R092   |
| L87 | 18.975 | 4.600 | 7.070  | R101   |
| L88 | 23.475 | 4.600 | -7.070 | R093   |
| L89 | 23.475 | 4.600 | 7.070  | R102   |
| L90 | 27.975 | 4.600 | -7.070 | R094   |
| L91 | 27.975 | 4.600 | 7.070  | R103   |
| L92 | 32.475 | 4.600 | -7.070 | R095   |
| L93 | 32.475 | 4.600 | 7.070  | R104   |
| L94 | 36.975 | 4.600 | -7.070 | R096   |
| L95 | 36.975 | 4.600 | 7.070  | R105   |
| L96 | 46.455 | 4.300 | -3.240 | R097   |
| L97 | 46.455 | 4.300 | 3.240  | R106   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

20 equipment / 23 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

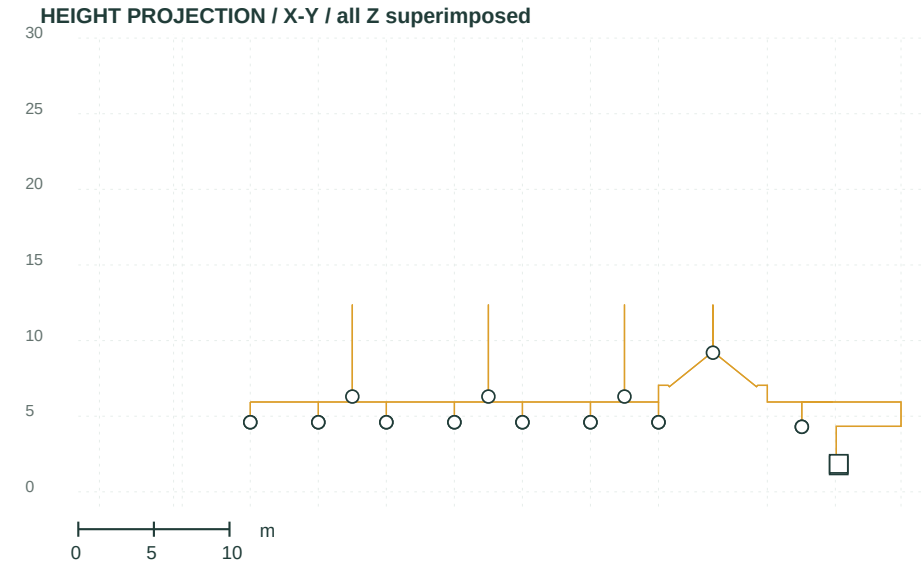


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L4 / Circulation & verandas

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

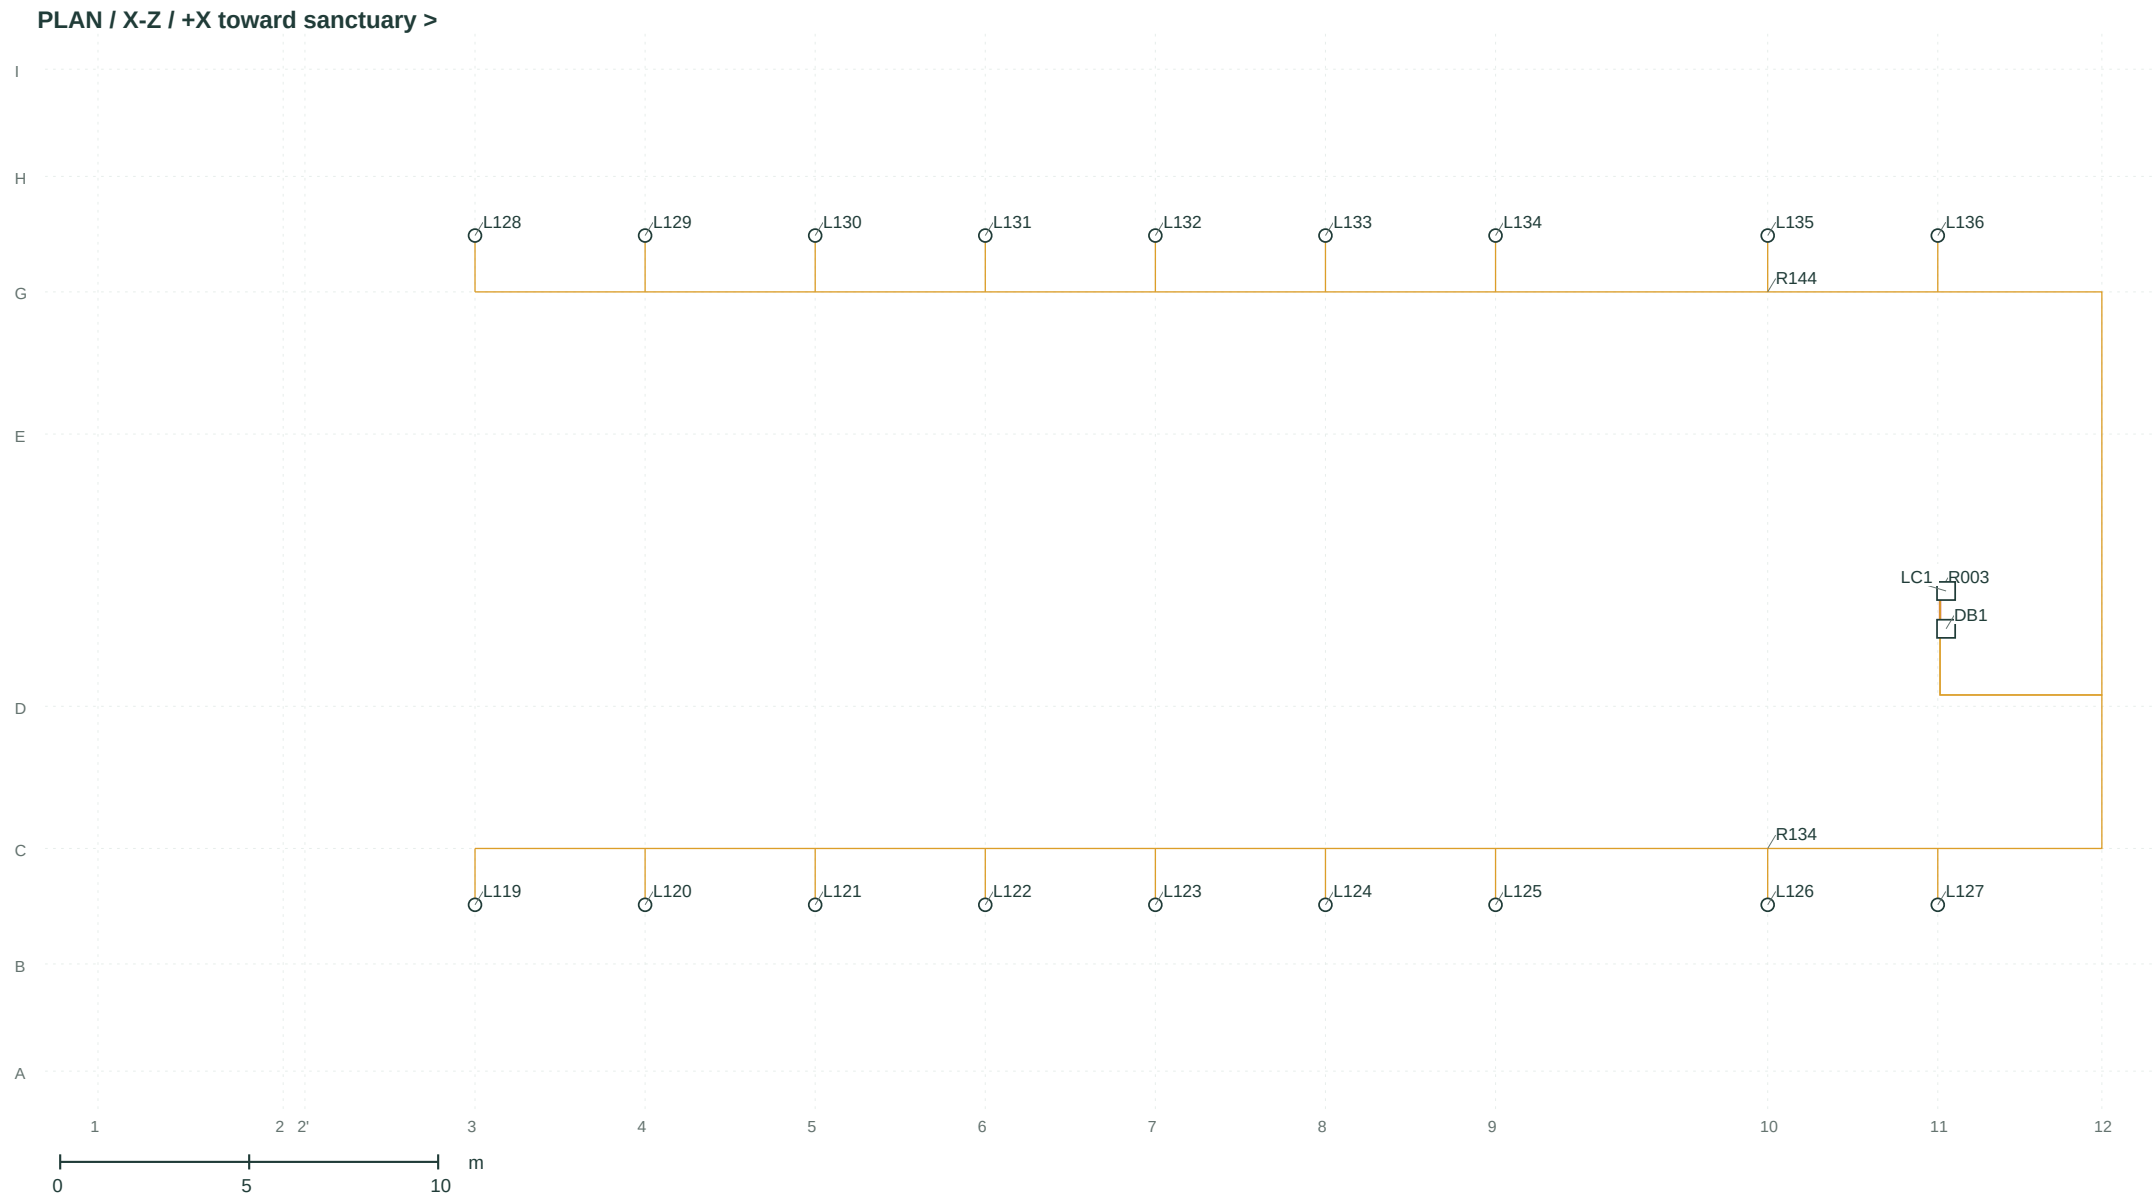

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z      | Branch |
|------|--------|-------|--------|--------|
| L119 | 9.975  | 4.550 | -8.850 | R135   |
| L120 | 14.475 | 4.550 | -8.850 | R136   |
| L121 | 18.975 | 4.550 | -8.850 | R137   |
| L122 | 23.475 | 4.550 | -8.850 | R138   |
| L123 | 27.975 | 4.550 | -8.850 | R139   |
| L124 | 32.475 | 4.550 | -8.850 | R140   |
| L125 | 36.975 | 4.550 | -8.850 | R141   |
| L126 | 44.175 | 4.550 | -8.850 | R142   |
| L127 | 48.675 | 4.550 | -8.850 | R143   |
| L128 | 9.975  | 4.550 | 8.850  | R145   |
| L129 | 14.475 | 4.550 | 8.850  | R146   |
| L130 | 18.975 | 4.550 | 8.850  | R147   |
| L131 | 23.475 | 4.550 | 8.850  | R148   |
| L132 | 27.975 | 4.550 | 8.850  | R149   |
| L133 | 32.475 | 4.550 | 8.850  | R150   |
| L134 | 36.975 | 4.550 | 8.850  | R151   |
| L135 | 44.175 | 4.550 | 8.850  | R152   |
| L136 | 48.675 | 4.550 | 8.850  | R153   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

18 equipment / 21 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

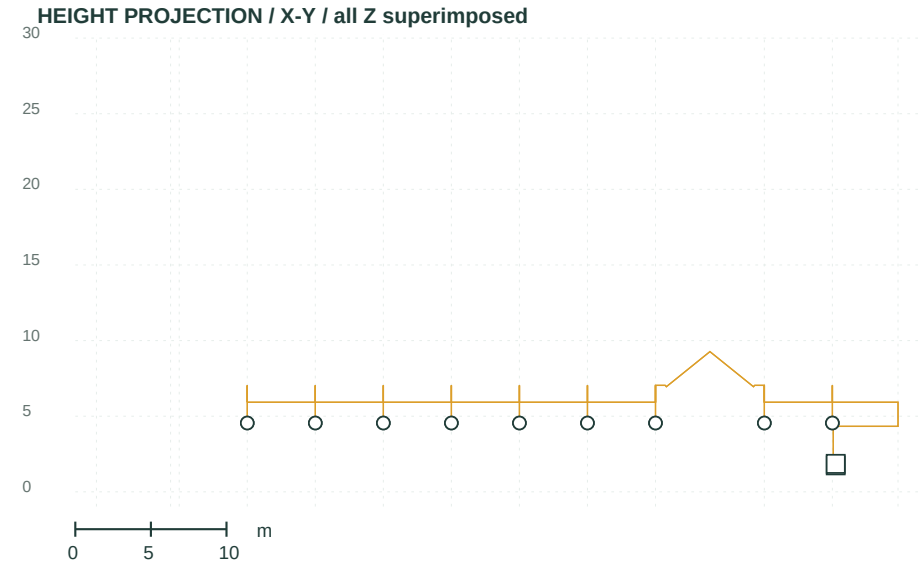

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L9 / Front stage & central door

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION



COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z       | Branch |
|------|--------|-------|---------|--------|
| L137 | 2.200  | 3.000 | -2.400  | R155   |
| L138 | 2.200  | 3.000 | 2.400   | R159   |
| L182 | -0.075 | 8.400 | -11.853 | R156   |
| L183 | -0.075 | 8.400 | -8.453  | R157   |
| L189 | -0.075 | 8.400 | 8.453   | R160   |
| L190 | -0.075 | 8.400 | 11.853  | R161   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| DB2 | 2.730  | 1.500 | -3.300 |

6 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

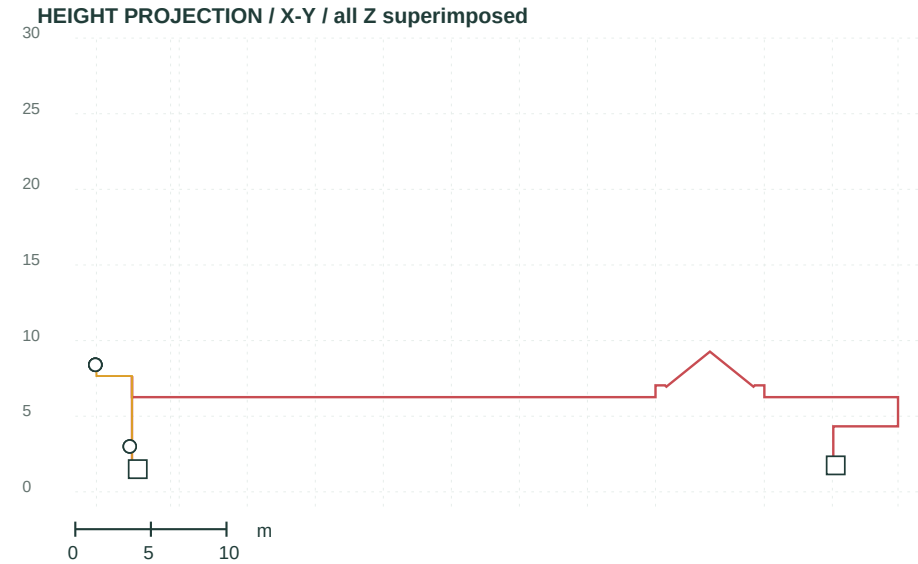


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L5 / Steps & paths

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

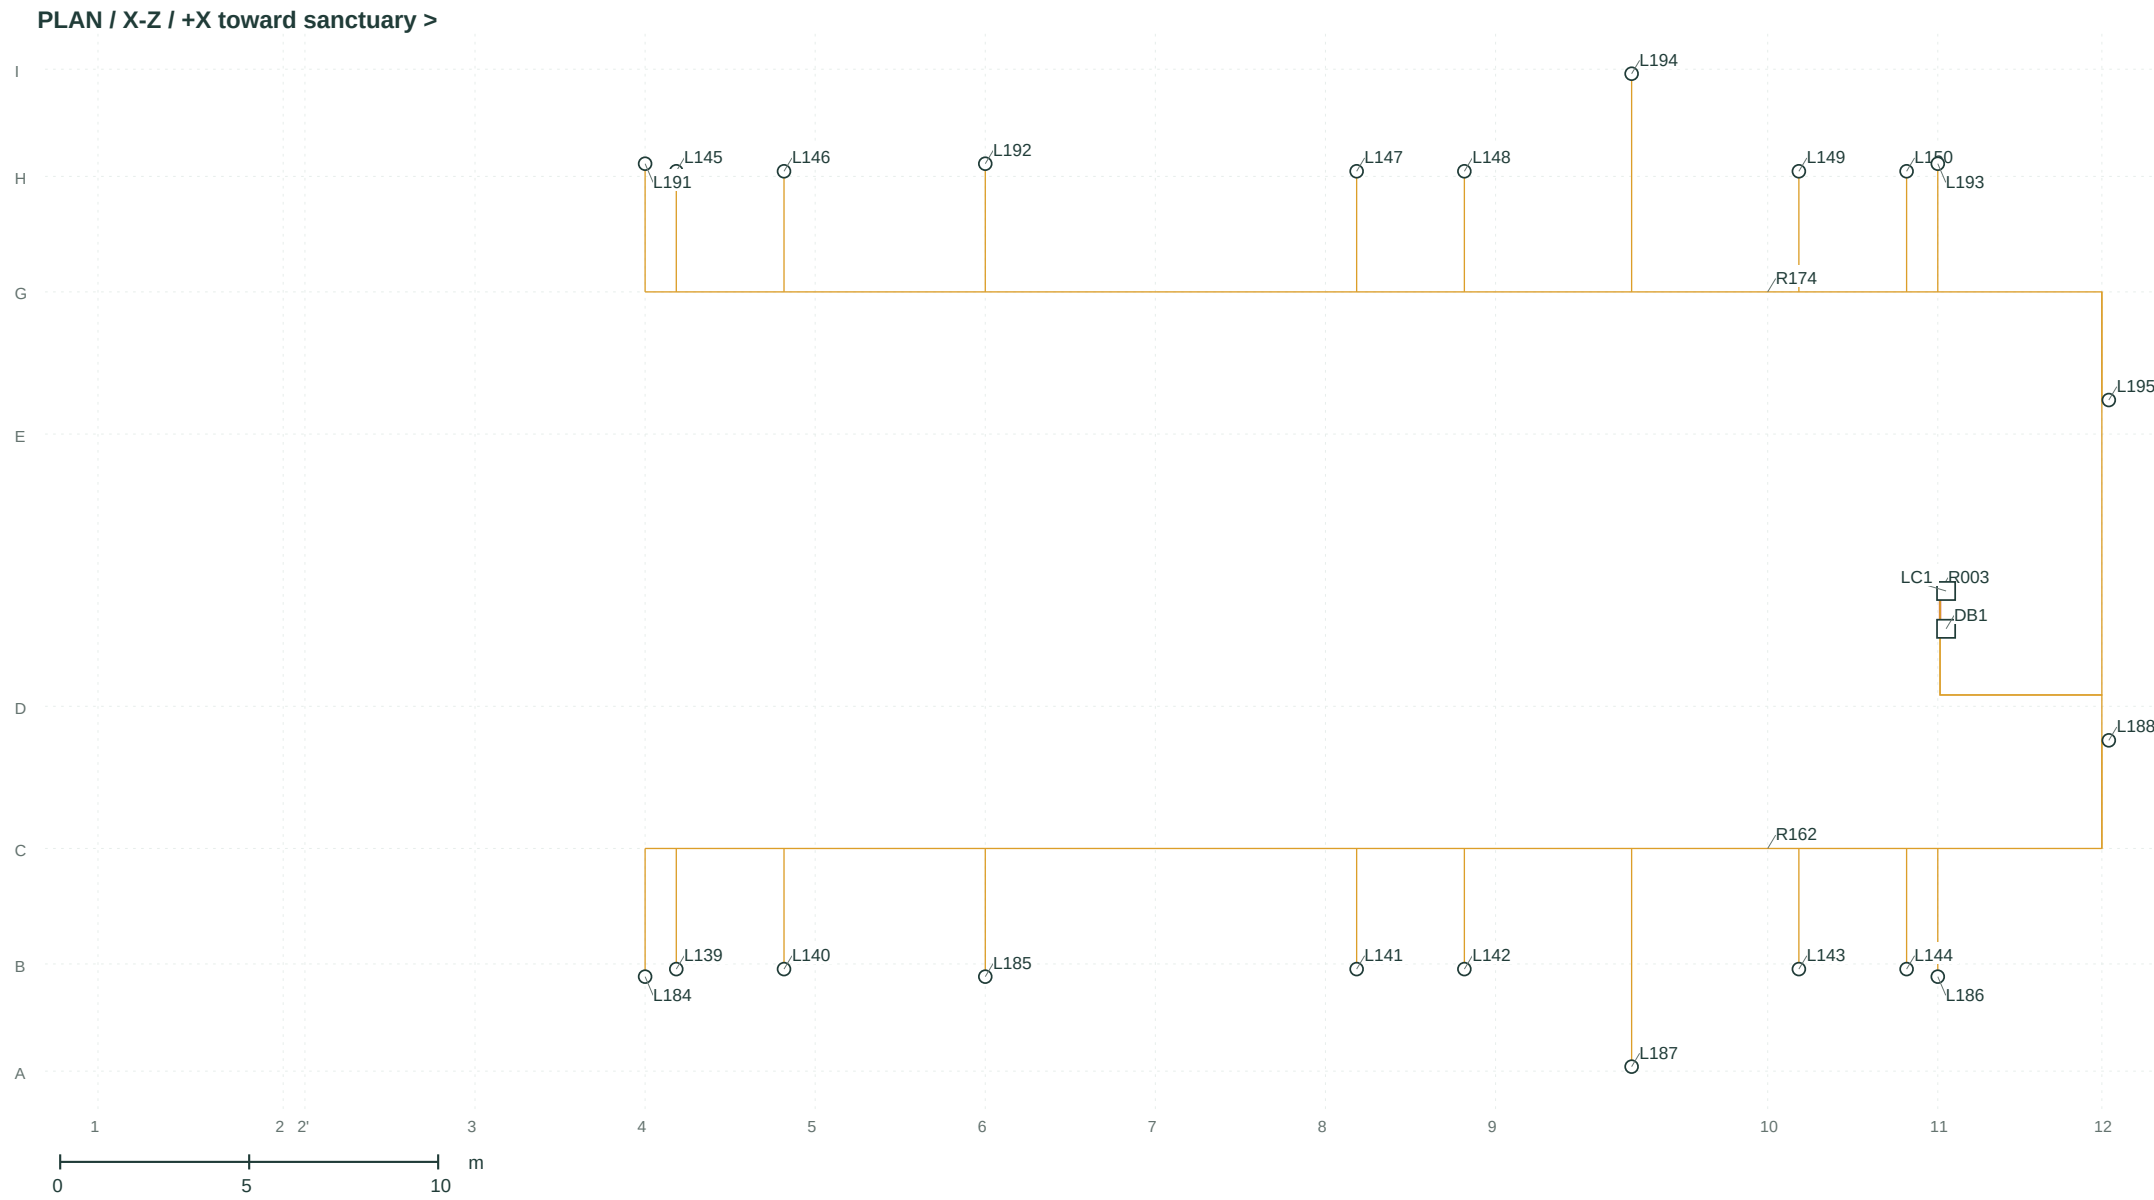

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z       | Branch |
|------|--------|-------|---------|--------|
| L139 | 15.300 | 2.600 | -10.550 | R163   |
| L140 | 18.150 | 2.600 | -10.550 | R164   |
| L141 | 33.300 | 2.600 | -10.550 | R165   |
| L142 | 36.150 | 2.600 | -10.550 | R166   |
| L143 | 45.000 | 2.600 | -10.550 | R167   |
| L144 | 47.850 | 2.600 | -10.550 | R168   |
| L145 | 15.300 | 2.600 | 10.550  | R175   |
| L146 | 18.150 | 2.600 | 10.550  | R176   |
| L147 | 33.300 | 2.600 | 10.550  | R177   |
| L148 | 36.150 | 2.600 | 10.550  | R178   |
| L149 | 45.000 | 2.600 | 10.550  | R179   |
| L150 | 47.850 | 2.600 | 10.550  | R180   |
| L184 | 14.475 | 5.900 | -10.750 | R169   |
| L185 | 23.475 | 5.900 | -10.750 | R170   |
| L186 | 48.675 | 5.900 | -10.750 | R171   |
| L187 | 40.575 | 6.200 | -13.130 | R172   |
| L188 | 53.200 | 5.200 | -4.500  | R173   |
| L191 | 14.475 | 5.900 | 10.750  | R181   |
| L192 | 23.475 | 5.900 | 10.750  | R182   |
| L193 | 48.675 | 5.900 | 10.750  | R183   |
| L194 | 40.575 | 6.200 | 13.130  | R184   |
| L195 | 53.200 | 5.200 | 4.500   | R185   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

22 equipment / 25 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

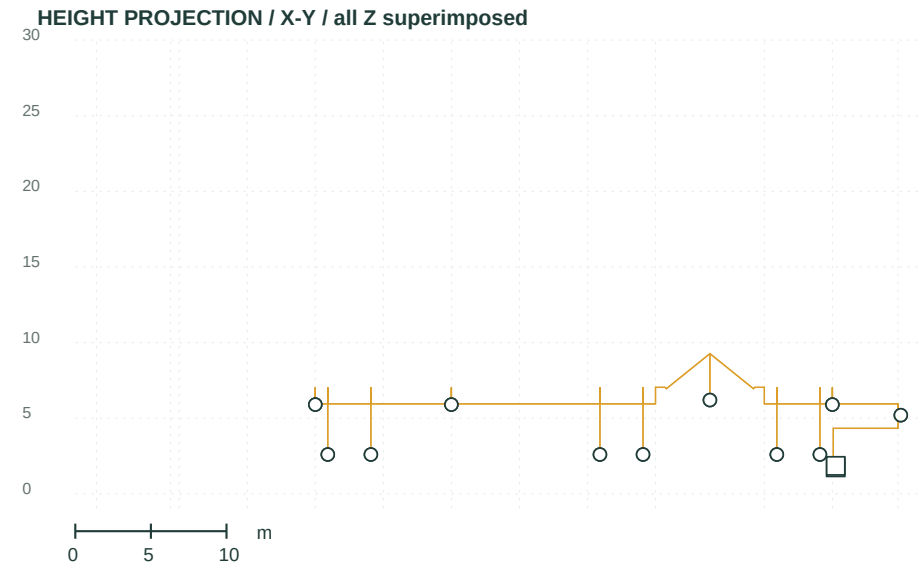


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

E1 / Exit signs

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

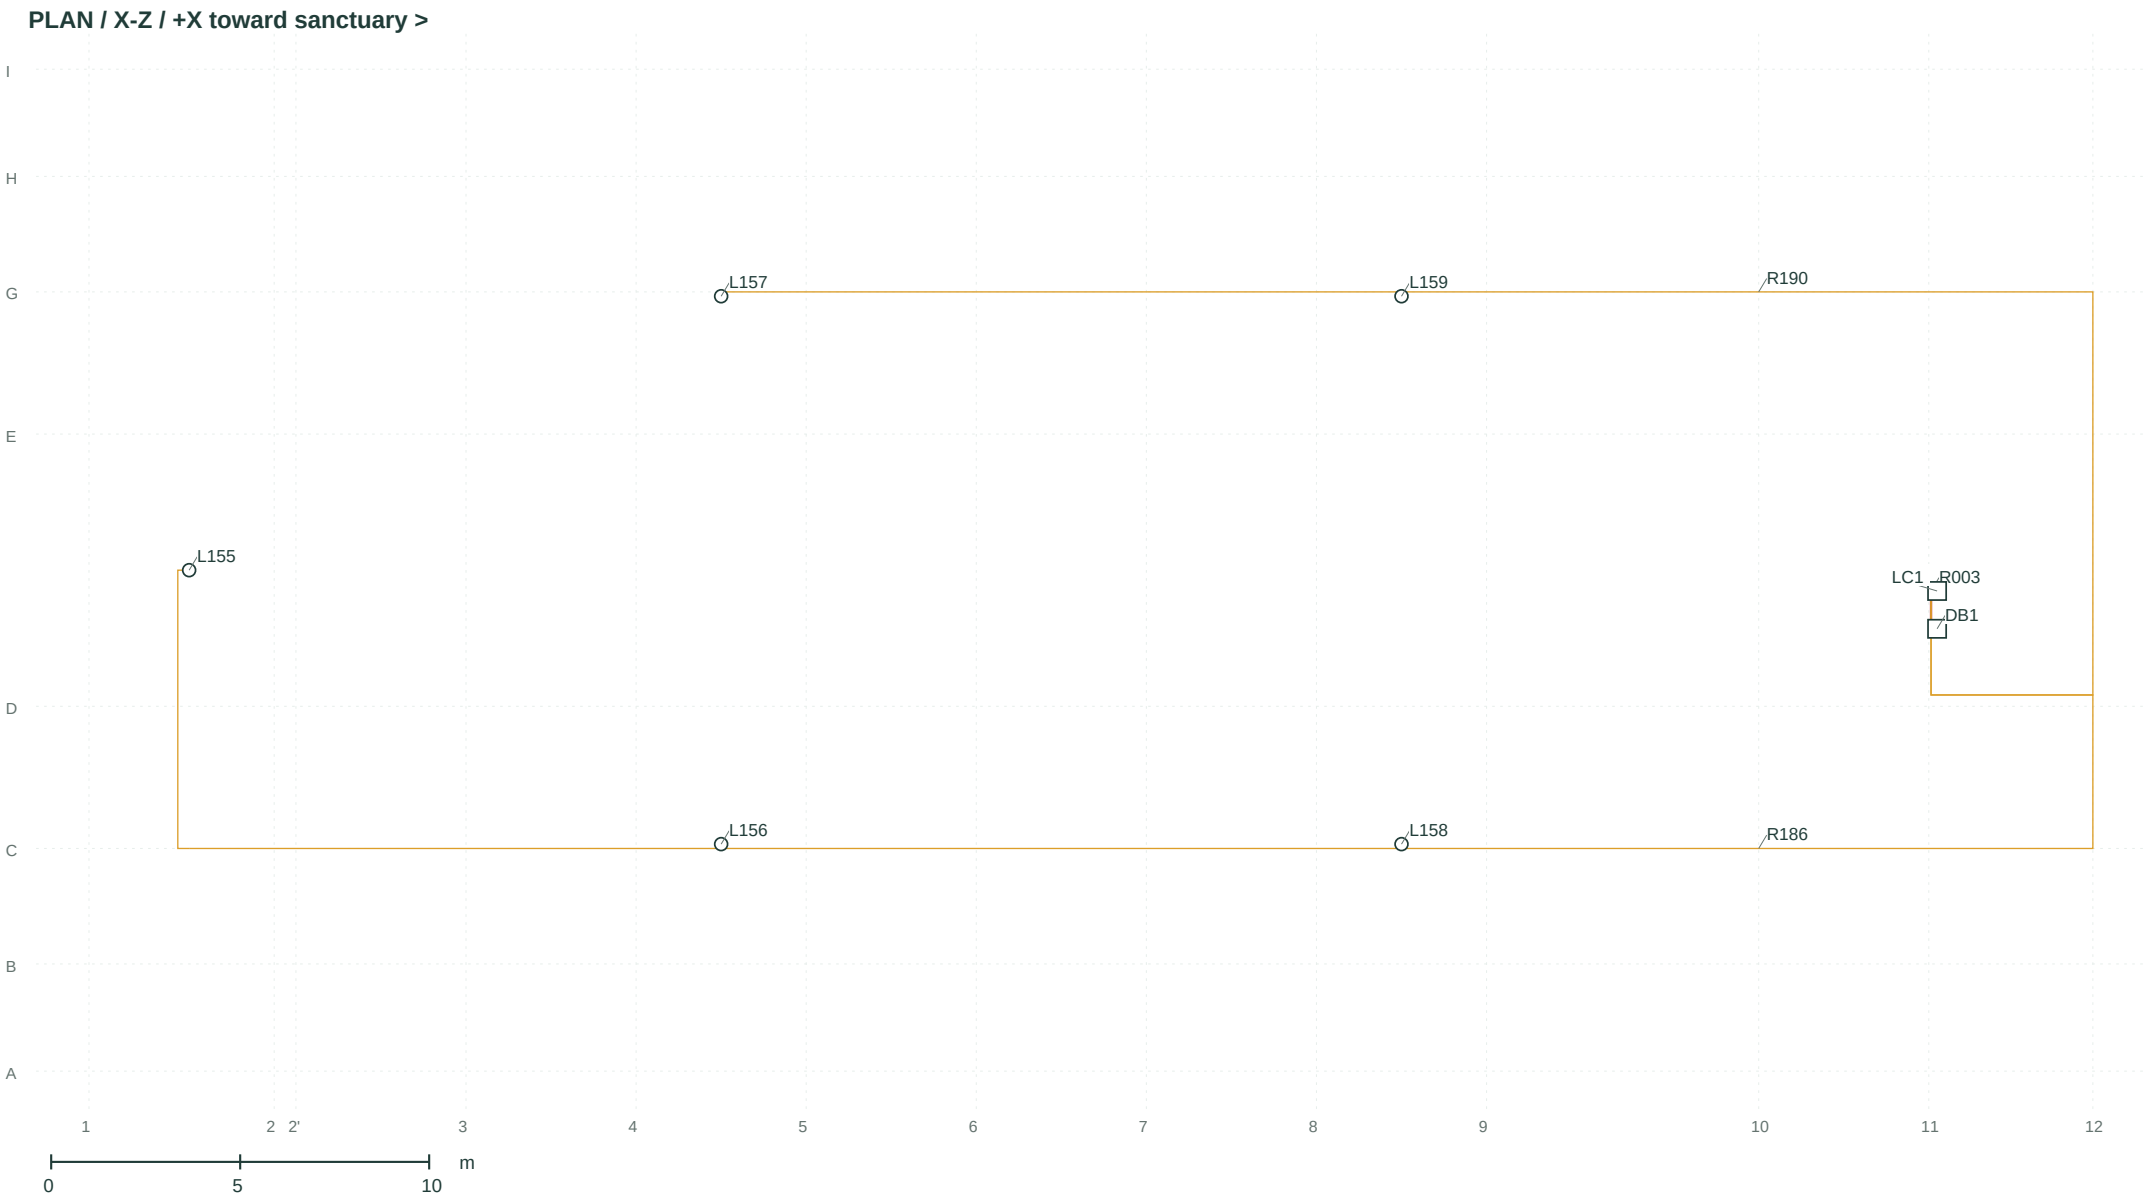

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z      | Branch |
|------|--------|-------|--------|--------|
| L155 | 2.650  | 6.950 | 0.000  | R187   |
| L156 | 16.725 | 4.600 | -7.245 | R188   |
| L157 | 16.725 | 4.600 | 7.245  | R191   |
| L158 | 34.725 | 4.600 | -7.245 | R189   |
| L159 | 34.725 | 4.600 | 7.245  | R192   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| LC1 | 48.895 | 1.850 | -0.550 |

5 equipment / 8 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

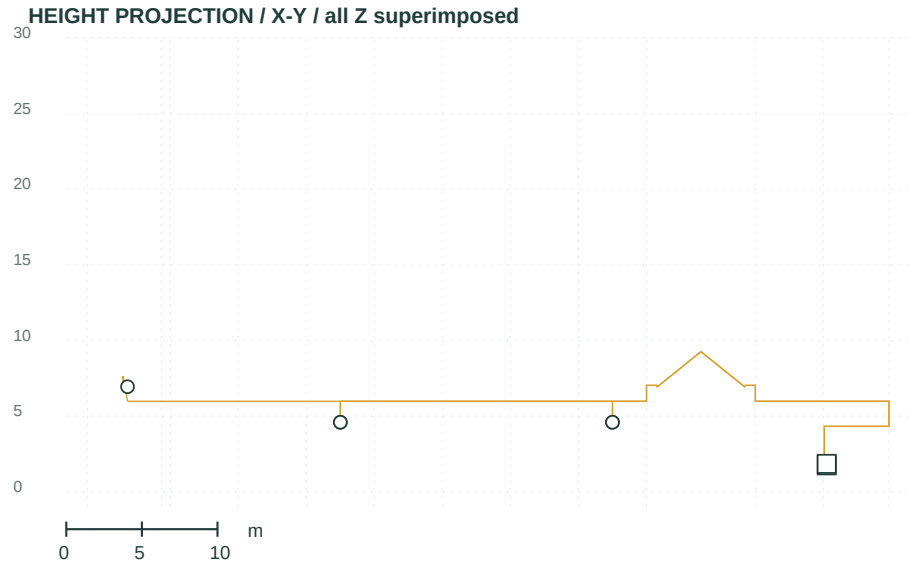

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L6 / Facade & towers

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION




| COORDINATES / X, Y, Z (m) |        |        |         |        |
|---------------------------|--------|--------|---------|--------|
| ID                        | X      | Y      | Z       | Branch |
| L160                      | -0.125 | 8.400  | -10.853 | R194   |
| L161                      | -0.125 | 8.400  | -10.153 | R195   |
| L162                      | -0.035 | 15.880 | -10.153 | R196   |
| L163                      | 0.065  | 23.200 | -10.153 | R197   |
| L164                      | 0.350  | 29.260 | -10.153 | R198   |
| L165                      | 2.450  | 23.200 | -10.153 | R199   |
| L166                      | 3.050  | 8.400  | -12.738 | R200   |
| L167                      | 2.450  | 8.400  | -12.738 | R201   |
| L168                      | 2.450  | 15.880 | -12.613 | R202   |
| L169                      | 2.450  | 23.200 | -12.513 | R203   |
| L170                      | -0.075 | 8.400  | -7.900  | R204   |
| L171                      | -0.125 | 8.400  | 10.853  | R208   |
| L172                      | -0.125 | 8.400  | 10.153  | R209   |
| L173                      | -0.035 | 15.880 | 10.153  | R210   |
| L174                      | 0.065  | 23.200 | 10.153  | R211   |
| L175                      | 0.350  | 29.260 | 10.153  | R212   |
| L176                      | 2.450  | 23.200 | 10.153  | R213   |
| L177                      | 3.050  | 8.400  | 12.738  | R214   |
| L178                      | 2.450  | 8.400  | 12.738  | R215   |
| L179                      | 2.450  | 15.880 | 12.613  | R216   |
| L180                      | 2.450  | 23.200 | 12.513  | R217   |
| L181                      | -0.075 | 8.400  | 7.900   | R218   |
| L222                      | -0.075 | 8.400  | -7.750  | R205   |
| L223                      | -0.035 | 15.880 | -7.900  | R206   |
| L224                      | -0.075 | 8.400  | 7.750   | R219   |
| L225                      | -0.035 | 15.880 | 7.900   | R220   |

| Related enclosures |        |       |        |
|--------------------|--------|-------|--------|
| DB1                | 48.895 | 1.750 | -1.550 |
| DB2                | 2.730  | 1.500 | -3.300 |

26 equipment / 29 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

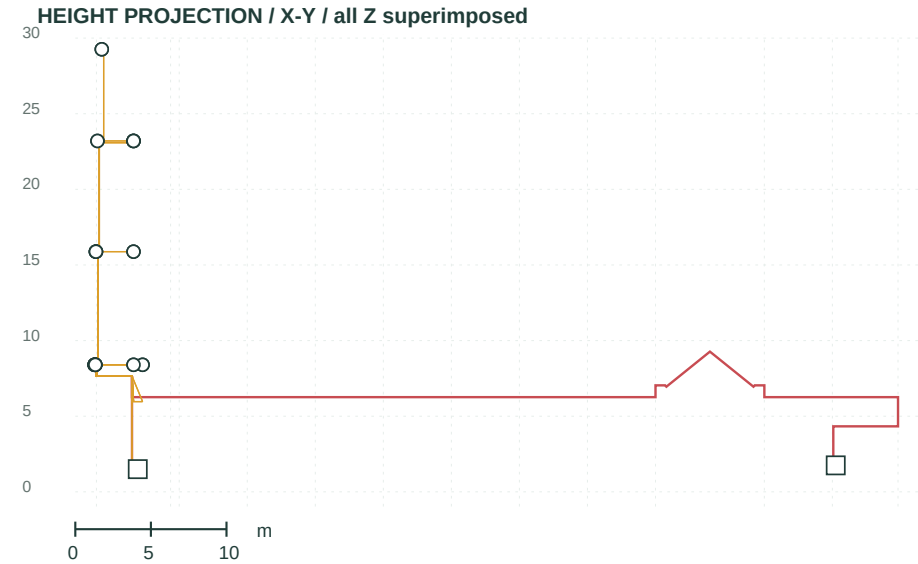


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L7 / Festival exterior (strings & tower floods)

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

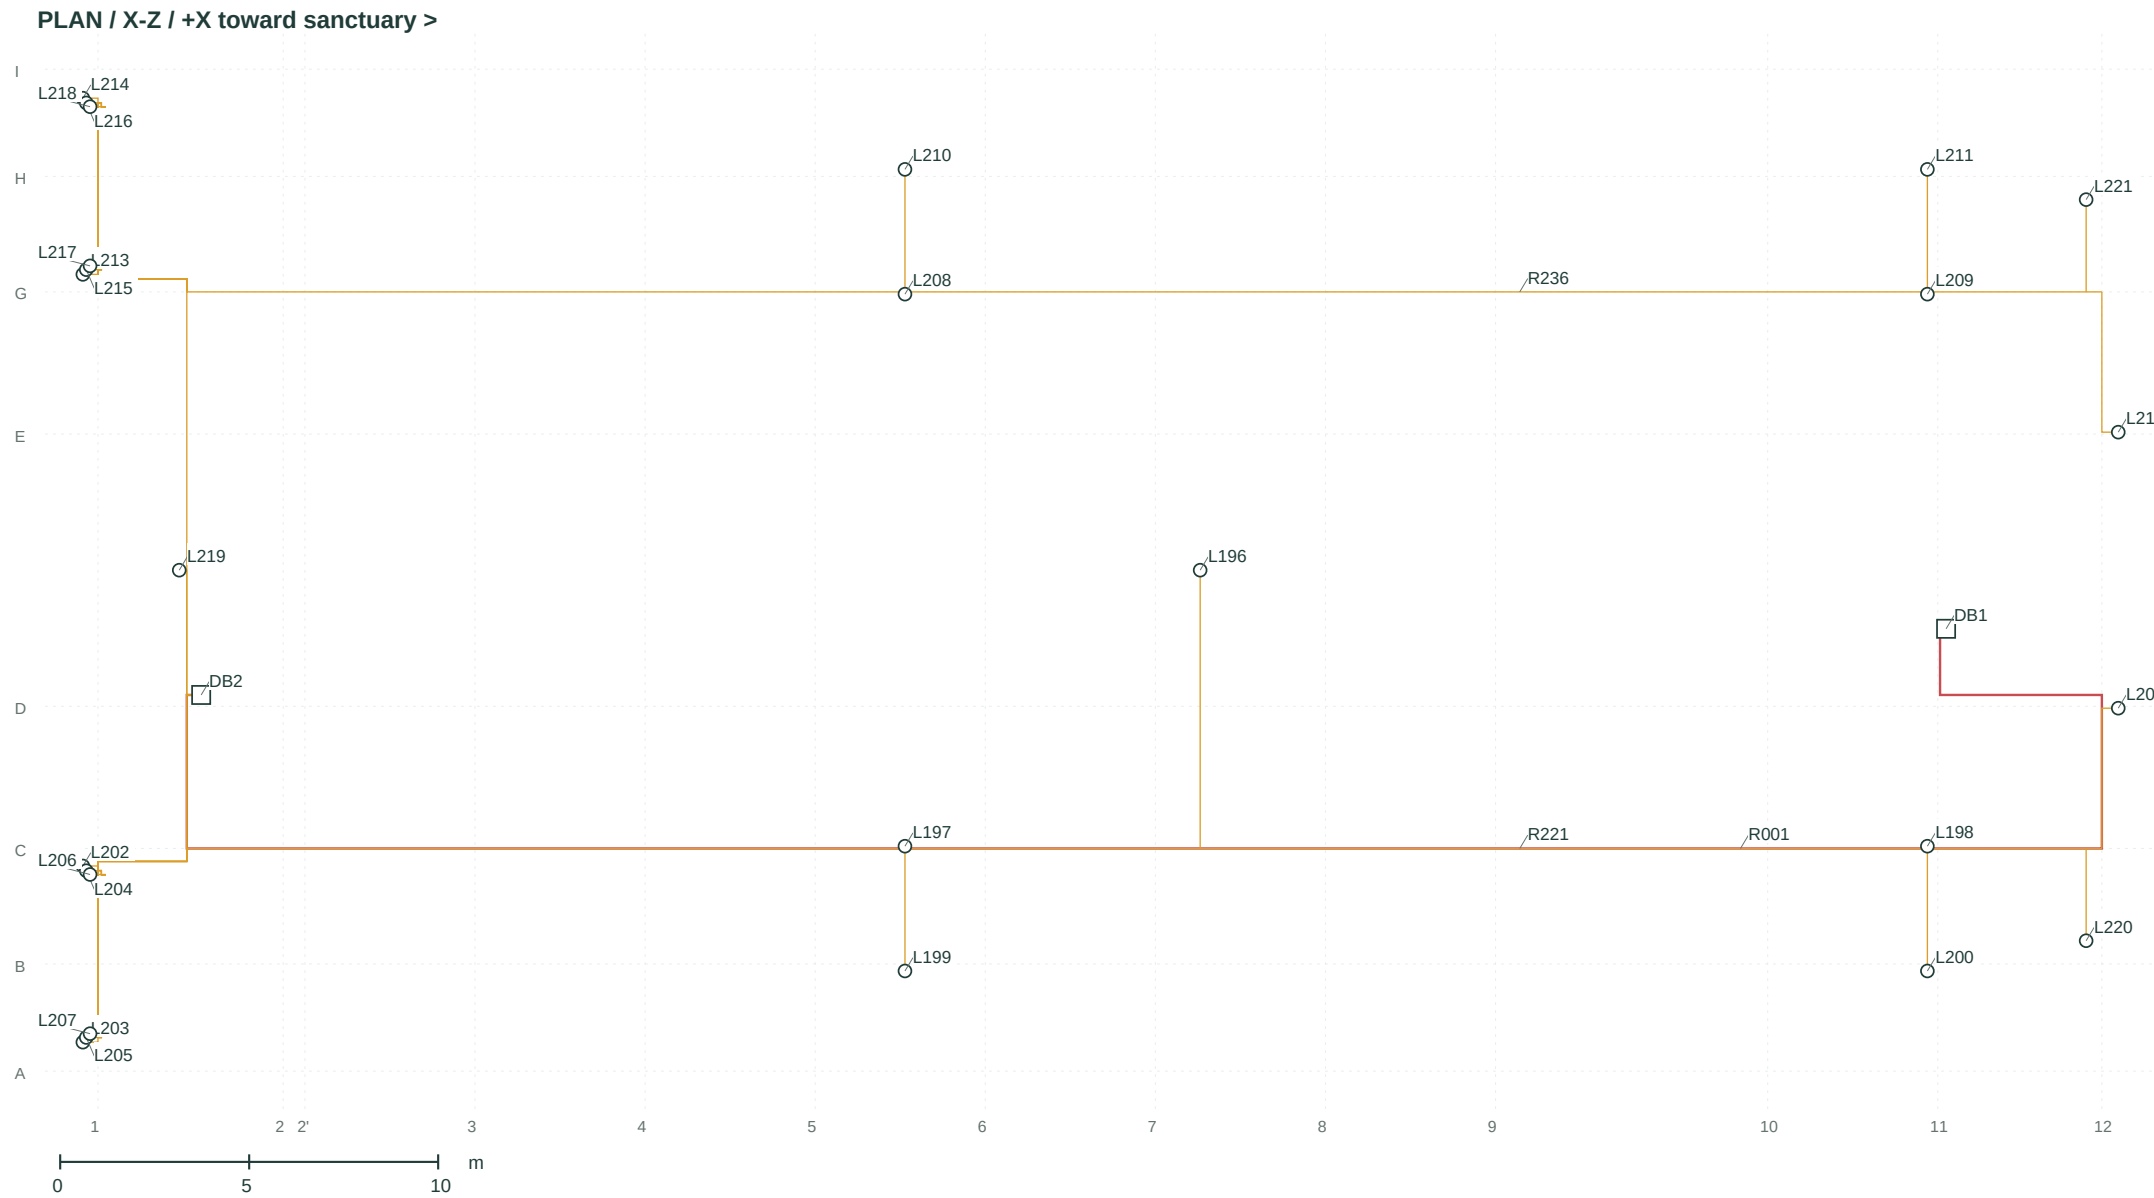

COORDINATES / X, Y, Z (m)


| ID   | X      | Y      | Z       | Branch |
|------|--------|--------|---------|--------|
| L196 | 29.160 | 12.690 | 0.000   | R222   |
| L197 | 21.350 | 7.320  | -7.300  | R223   |
| L198 | 48.400 | 7.320  | -7.300  | R224   |
| L199 | 21.350 | 6.470  | -10.600 | R225   |
| L200 | 48.400 | 6.470  | -10.600 | R226   |
| L201 | 53.450 | 10.000 | -3.650  | R227   |
| L202 | -0.400 | 4.195  | -7.823  | R228   |
| L203 | -0.400 | 4.195  | -12.483 | R229   |
| L204 | -0.310 | 12.115 | -7.948  | R230   |
| L205 | -0.310 | 12.115 | -12.358 | R231   |
| L206 | -0.210 | 19.490 | -8.048  | R232   |
| L207 | -0.210 | 19.490 | -12.258 | R233   |
| L208 | 21.350 | 7.320  | 7.300   | R237   |
| L209 | 48.400 | 7.320  | 7.300   | R238   |
| L210 | 21.350 | 6.470  | 10.600  | R239   |
| L211 | 48.400 | 6.470  | 10.600  | R240   |
| L212 | 53.450 | 10.000 | 3.650   | R241   |
| L213 | -0.400 | 4.195  | 7.823   | R242   |
| L214 | -0.400 | 4.195  | 12.483  | R243   |
| L215 | -0.310 | 12.115 | 7.948   | R244   |
| L216 | -0.310 | 12.115 | 12.358  | R245   |
| L217 | -0.210 | 19.490 | 8.048   | R246   |
| L218 | -0.210 | 19.490 | 12.258  | R247   |
| L219 | 2.150  | 8.500  | 0.000   | R234   |
| L220 | 52.600 | 6.550  | -9.800  | R235   |
| L221 | 52.600 | 6.550  | 9.800   | R248   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| DB2 | 2.730  | 1.500 | -3.300 |

26 equipment / 29 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

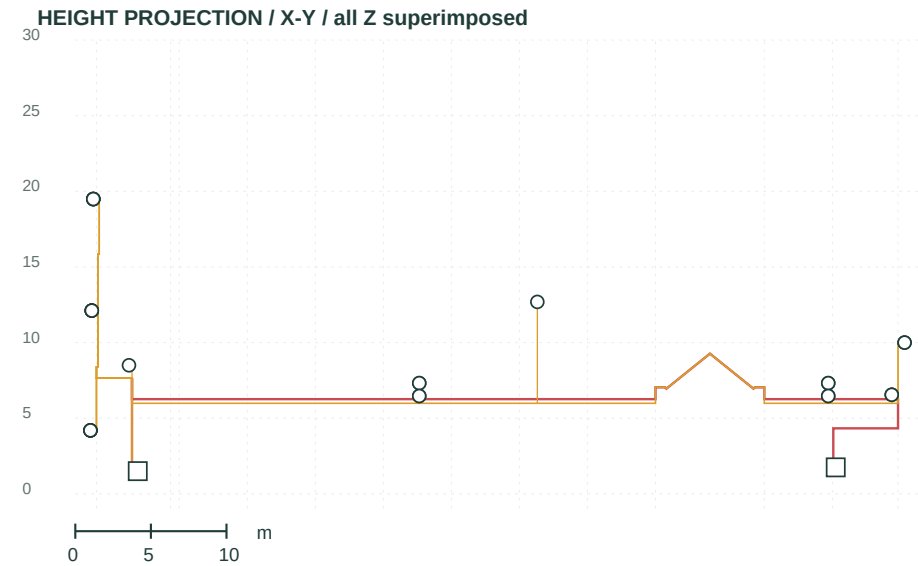


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F1 / Ceiling fans

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres


DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

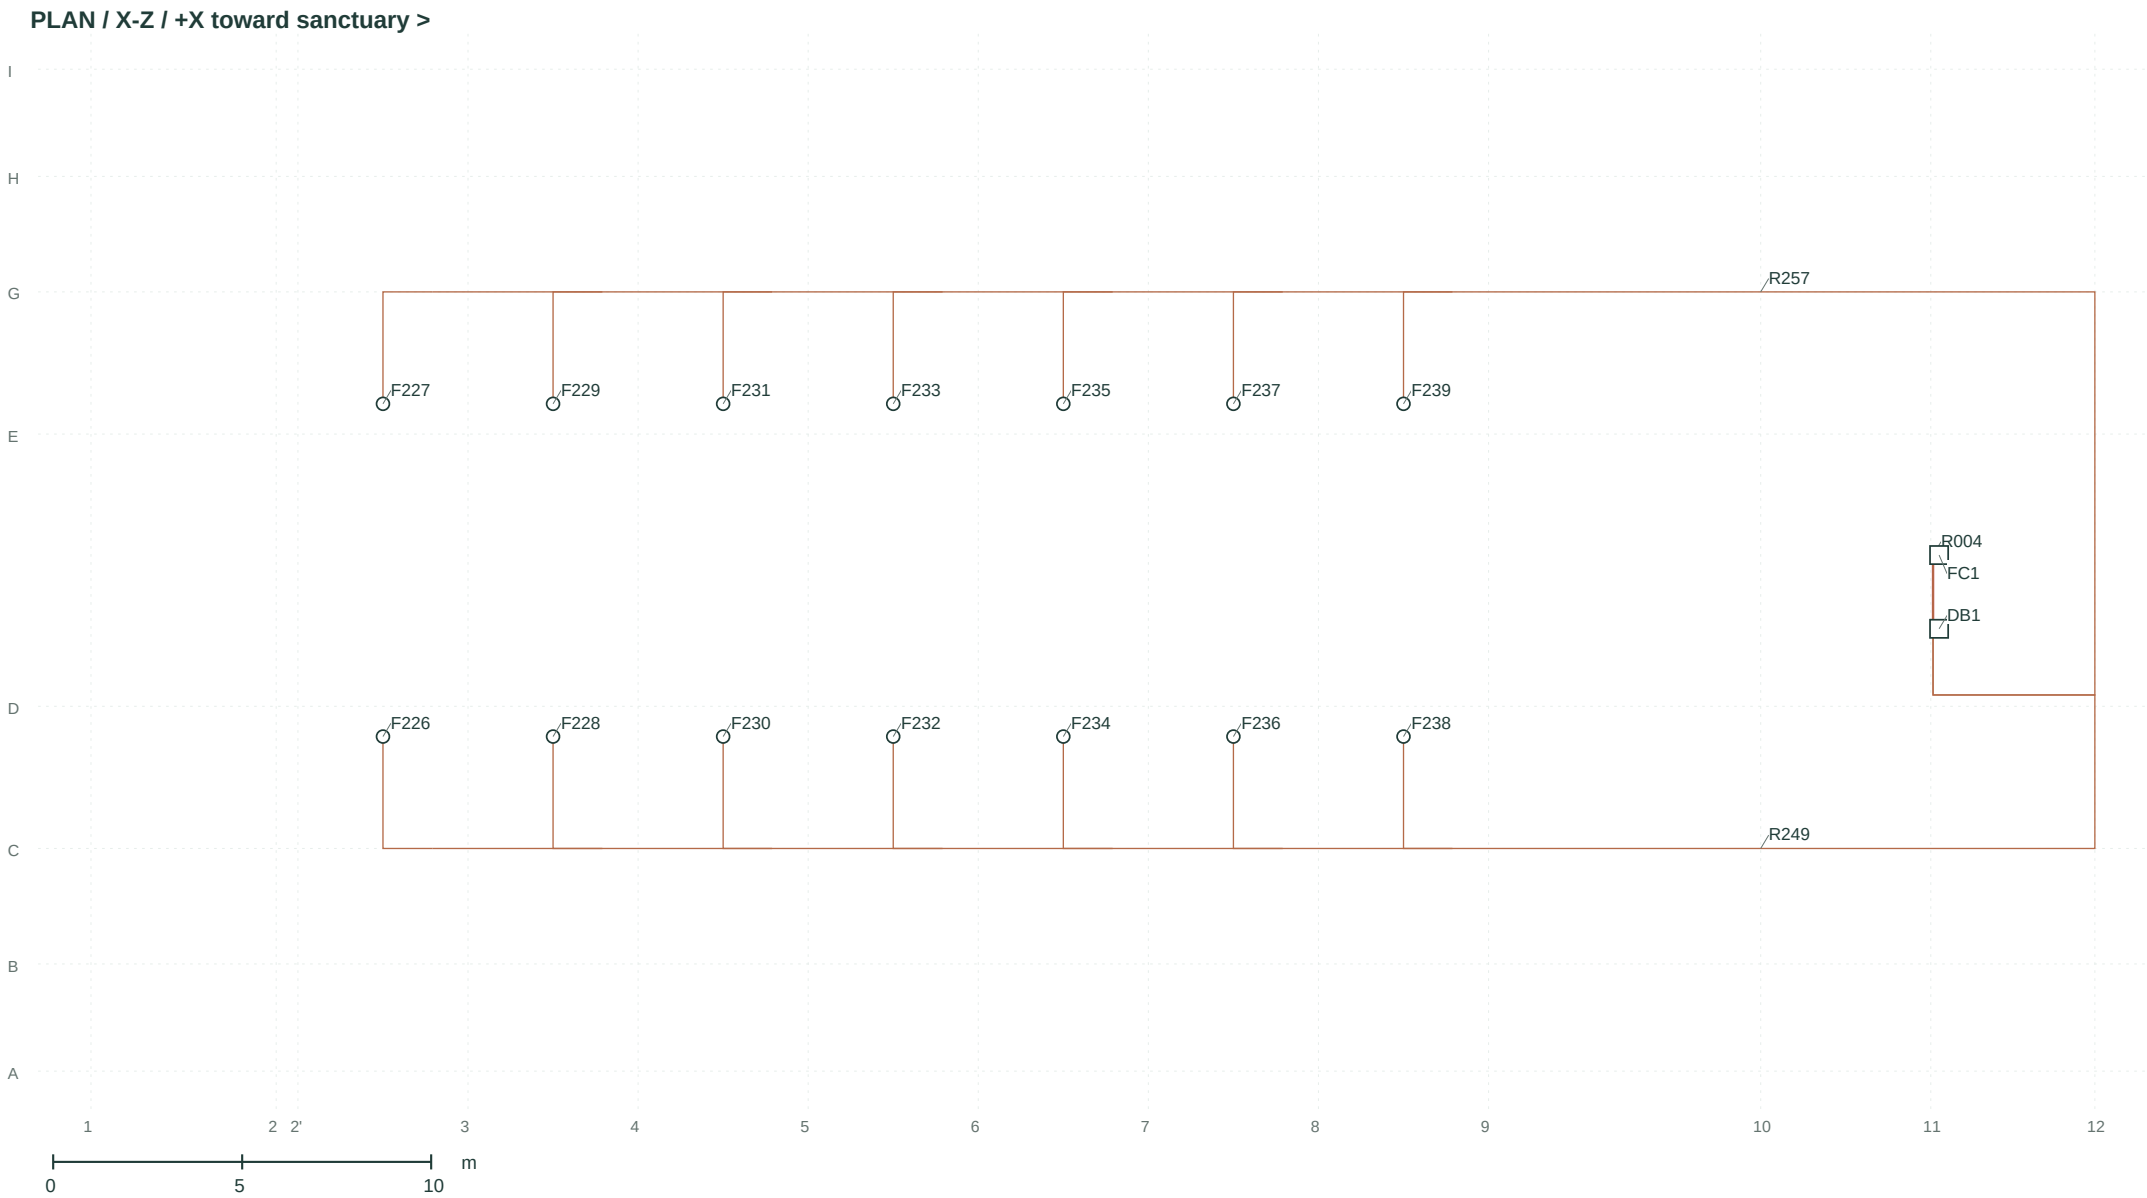

| COORDINATES / X, Y, Z (m) |        |       |        |        |
|---------------------------|--------|-------|--------|--------|
| ID                        | X      | Y     | Z      | Branch |
| F226                      | 7.725  | 3.900 | -4.400 | R250   |
| F227                      | 7.725  | 3.900 | 4.400  | R258   |
| F228                      | 12.225 | 3.900 | -4.400 | R251   |
| F229                      | 12.225 | 3.900 | 4.400  | R259   |
| F230                      | 16.725 | 3.900 | -4.400 | R252   |
| F231                      | 16.725 | 3.900 | 4.400  | R260   |
| F232                      | 21.225 | 3.900 | -4.400 | R253   |
| F233                      | 21.225 | 3.900 | 4.400  | R261   |
| F234                      | 25.725 | 3.900 | -4.400 | R254   |
| F235                      | 25.725 | 3.900 | 4.400  | R262   |
| F236                      | 30.225 | 3.900 | -4.400 | R255   |
| F237                      | 30.225 | 3.900 | 4.400  | R263   |
| F238                      | 34.725 | 3.900 | -4.400 | R256   |
| F239                      | 34.725 | 3.900 | 4.400  | R264   |
| Related enclosures        |        |       |        |        |
| DB1                       | 48.895 | 1.750 | -1.550 |        |
| FC1                       | 48.895 | 1.950 | 0.400  |        |

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

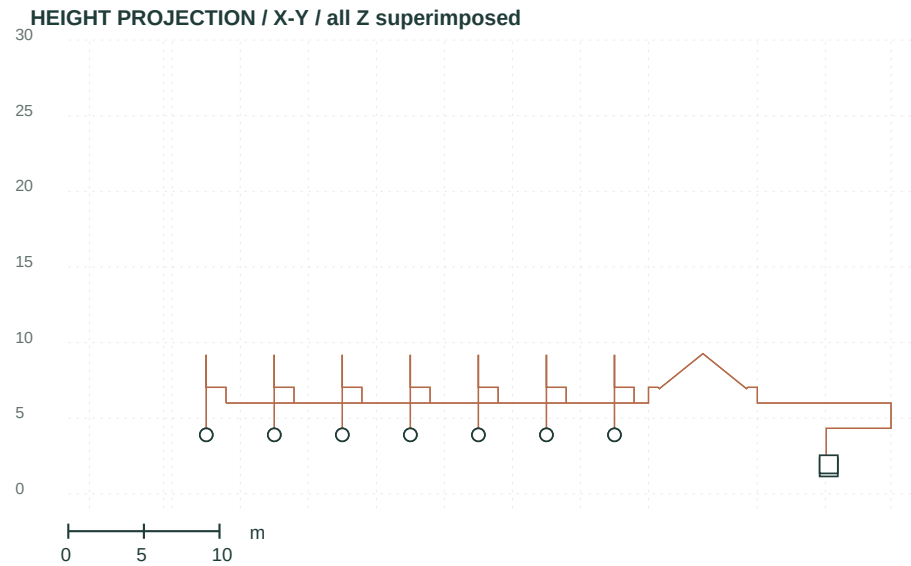



PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F5 / Wing wall fans / held review

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

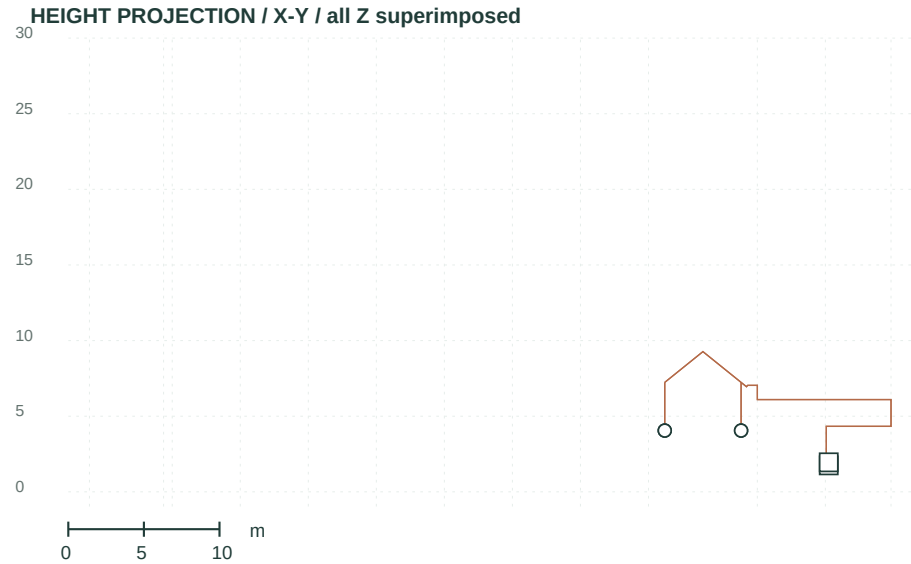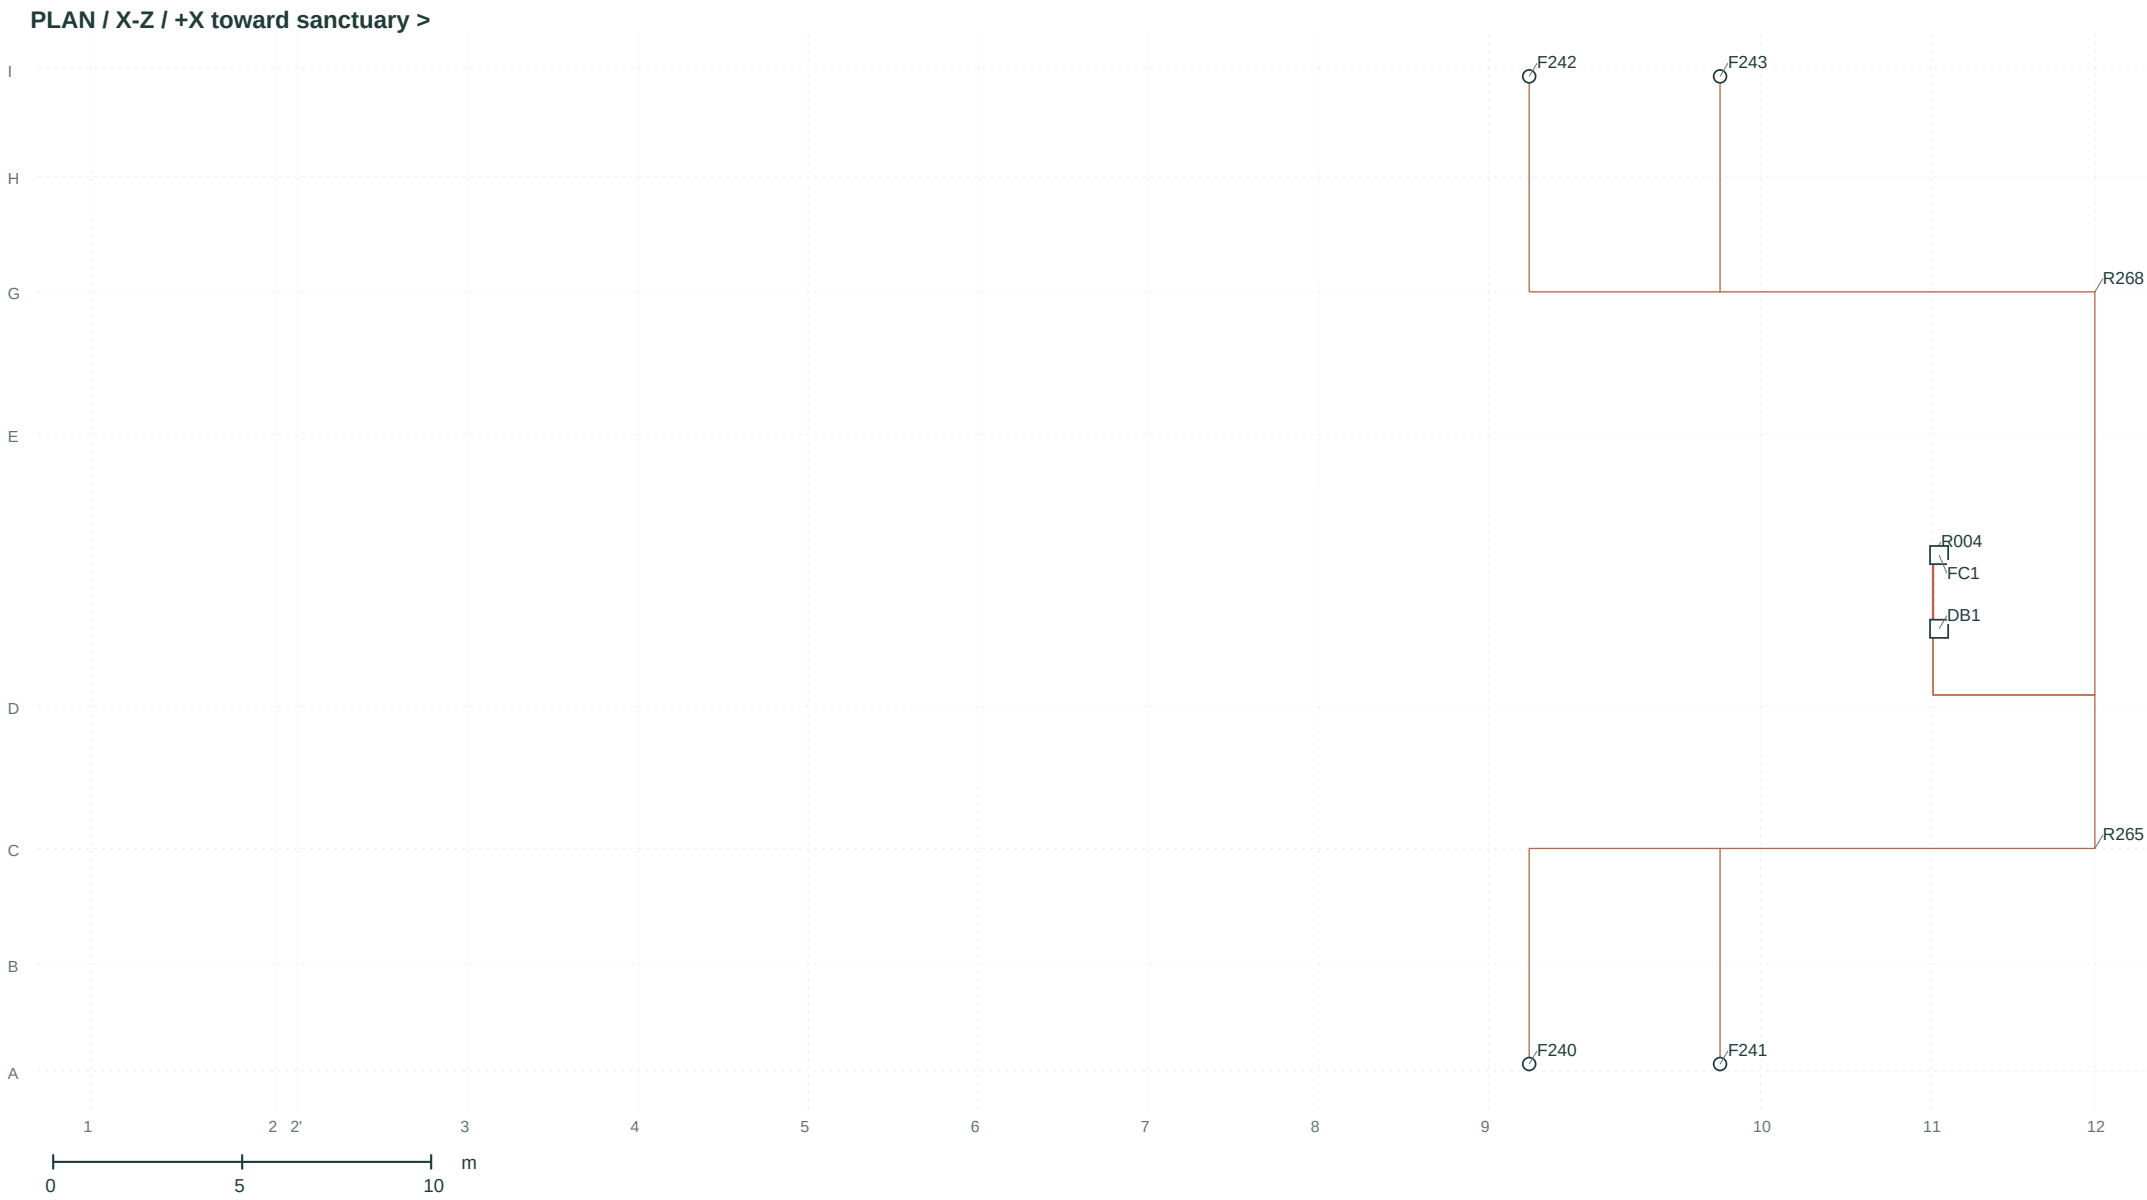

COORDINATES / X, Y, Z (m)

| ID   | X      | Y     | Z       | Branch |
|------|--------|-------|---------|--------|
| F240 | 38.050 | 4.050 | -13.060 | R266   |
| F241 | 43.100 | 4.050 | -13.060 | R267   |
| F242 | 38.050 | 4.050 | 13.060  | R269   |
| F243 | 43.100 | 4.050 | 13.060  | R270   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| FC1 | 48.895 | 1.950 | 0.400  |

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F2 / Wall fans

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

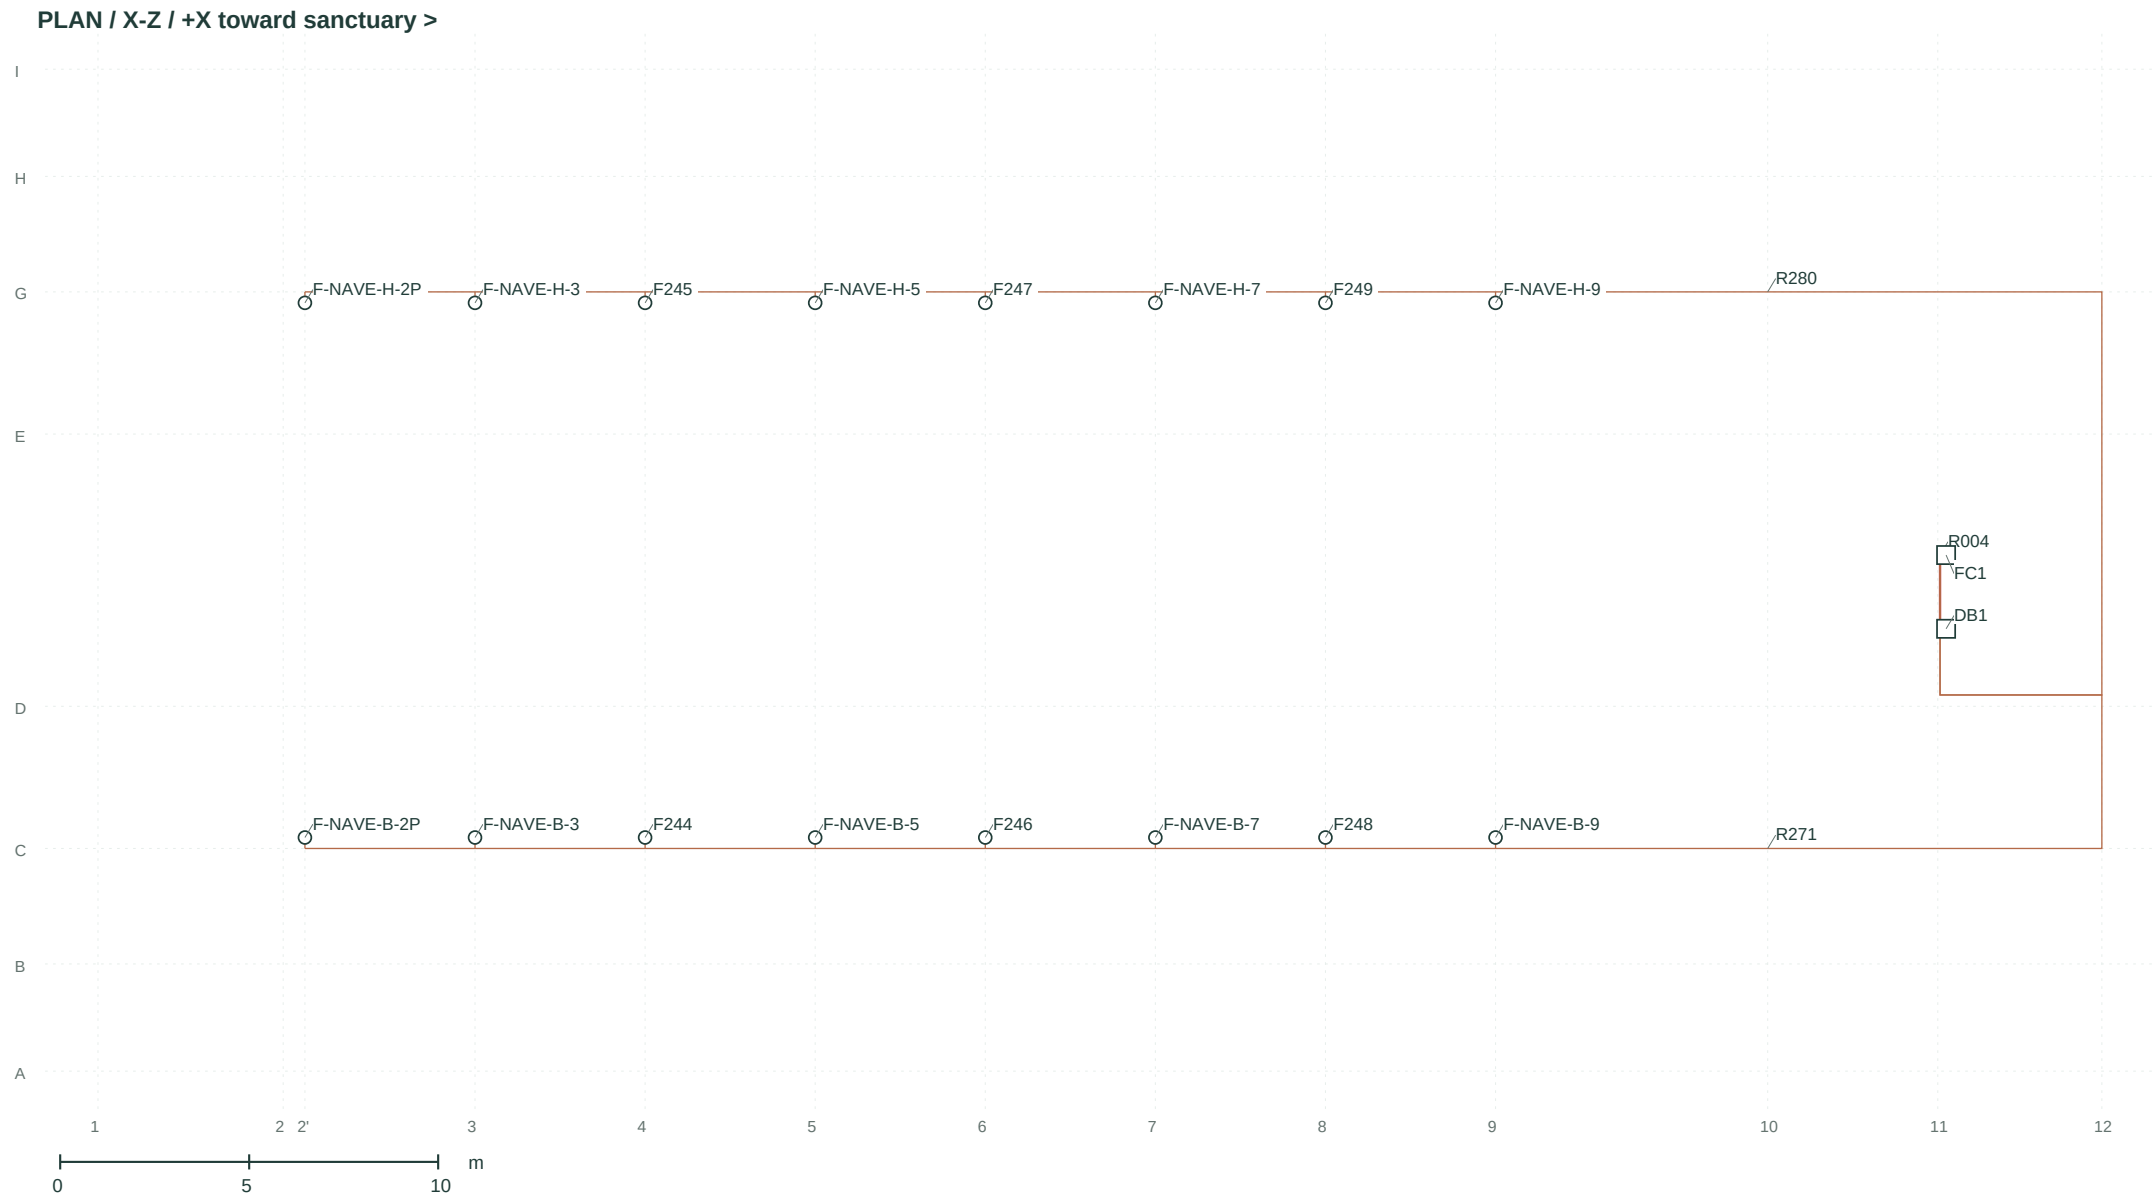

COORDINATES / X, Y, Z (m)


| ID          | X      | Y     | Z      | Branch |
|-------------|--------|-------|--------|--------|
| F244        | 14.475 | 5.550 | -7.070 | R272   |
| F245        | 14.475 | 5.550 | 7.070  | R281   |
| F246        | 23.475 | 5.550 | -7.070 | R273   |
| F247        | 23.475 | 5.550 | 7.070  | R282   |
| F248        | 32.475 | 5.550 | -7.070 | R274   |
| F249        | 32.475 | 5.550 | 7.070  | R283   |
| F-NAVE-B-2P | 5.475  | 5.550 | -7.070 | R275   |
| F-NAVE-H-2P | 5.475  | 5.550 | 7.070  | R284   |
| F-NAVE-B-3  | 9.975  | 5.550 | -7.070 | R276   |
| F-NAVE-H-3  | 9.975  | 5.550 | 7.070  | R285   |
| F-NAVE-B-5  | 18.975 | 5.550 | -7.070 | R277   |
| F-NAVE-H-5  | 18.975 | 5.550 | 7.070  | R286   |
| F-NAVE-B-7  | 27.975 | 5.550 | -7.070 | R278   |
| F-NAVE-H-7  | 27.975 | 5.550 | 7.070  | R287   |
| F-NAVE-B-9  | 36.975 | 5.550 | -7.070 | R279   |
| F-NAVE-H-9  | 36.975 | 5.550 | 7.070  | R288   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| FC1 | 48.895 | 1.950 | 0.400  |

16 equipment / 19 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

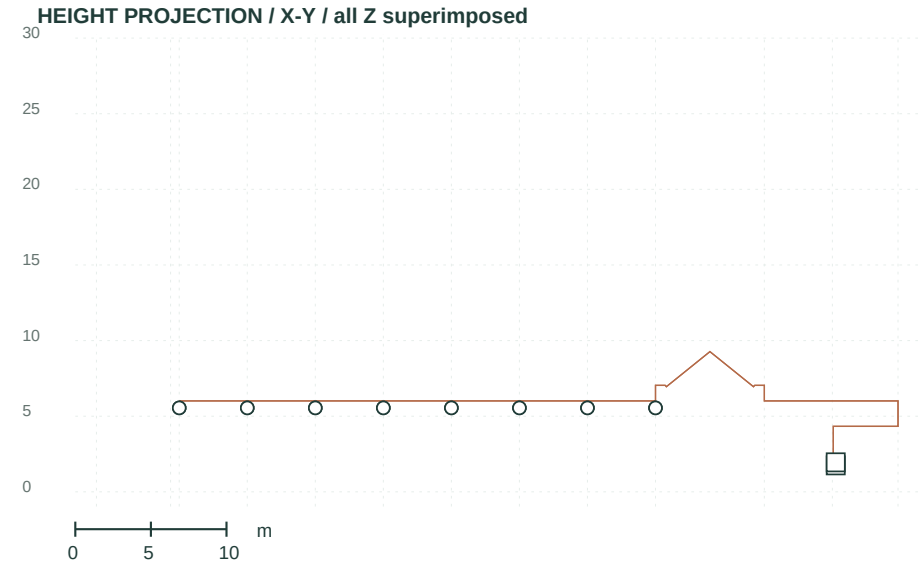

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F4 / Entrance circulators (trial)

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION



COORDINATES / X, Y, Z (m)


| ID   | X     | Y     | Z      | Branch |
|------|-------|-------|--------|--------|
| F250 | 2.655 | 6.000 | -3.050 | R290   |
| F251 | 2.655 | 6.000 | 3.050  | R292   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| DB2 | 2.730  | 1.500 | -3.300 |

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

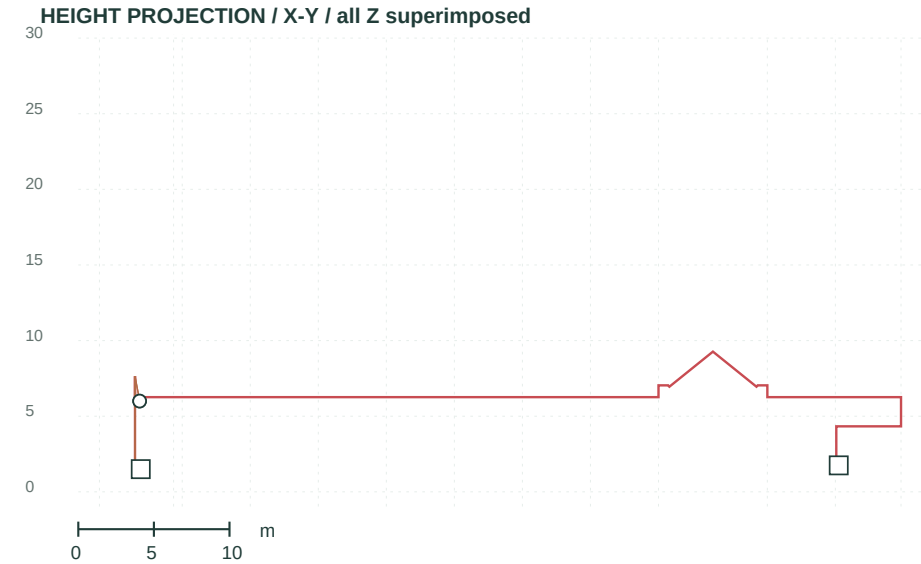


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

V1 / Exhaust ventilation

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

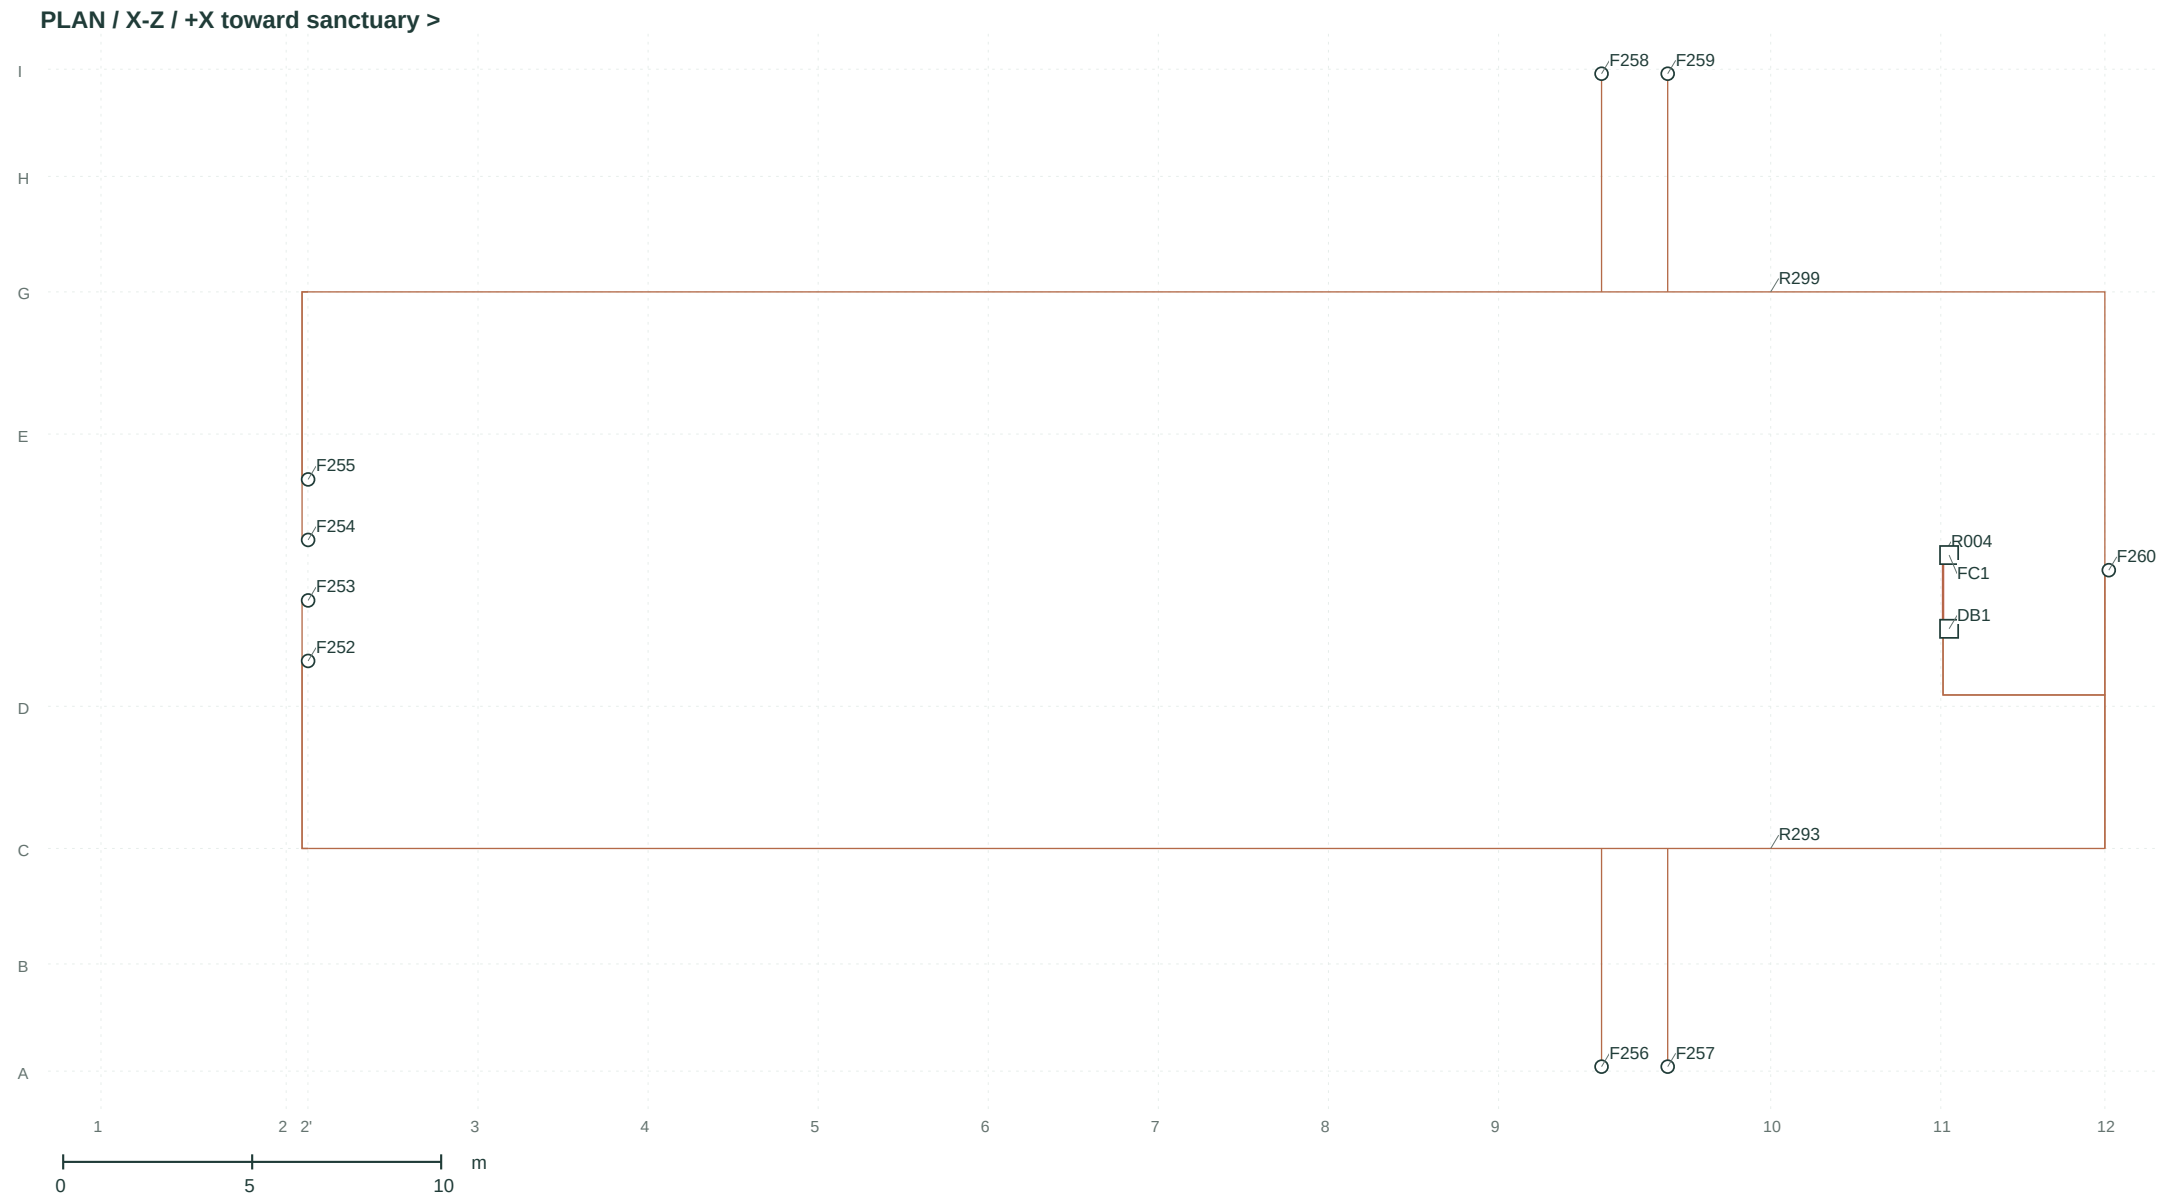

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z       | Branch |
|------|--------|-------|---------|--------|
| F252 | 5.480  | 9.400 | -2.400  | R294   |
| F253 | 5.480  | 9.400 | -0.800  | R295   |
| F254 | 5.480  | 9.400 | 0.800   | R300   |
| F255 | 5.480  | 9.400 | 2.400   | R301   |
| F256 | 39.700 | 7.600 | -13.130 | R296   |
| F257 | 41.450 | 7.600 | -13.130 | R297   |
| F258 | 39.700 | 7.600 | 13.130  | R302   |
| F259 | 41.450 | 7.600 | 13.130  | R303   |
| F260 | 53.120 | 3.300 | 0.000   | R298   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| FC1 | 48.895 | 1.950 | 0.400  |

9 equipment / 12 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

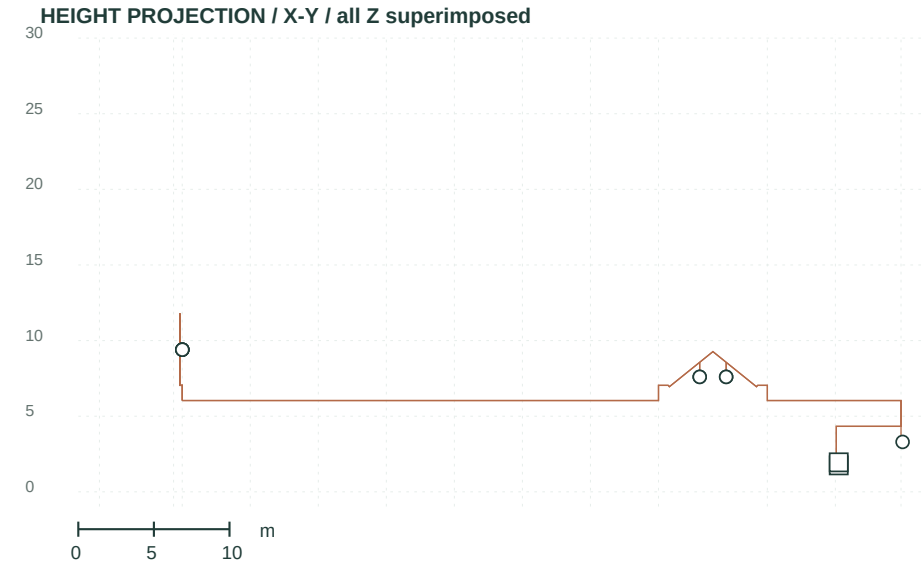


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

A1 / Main & delay loudspeakers

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

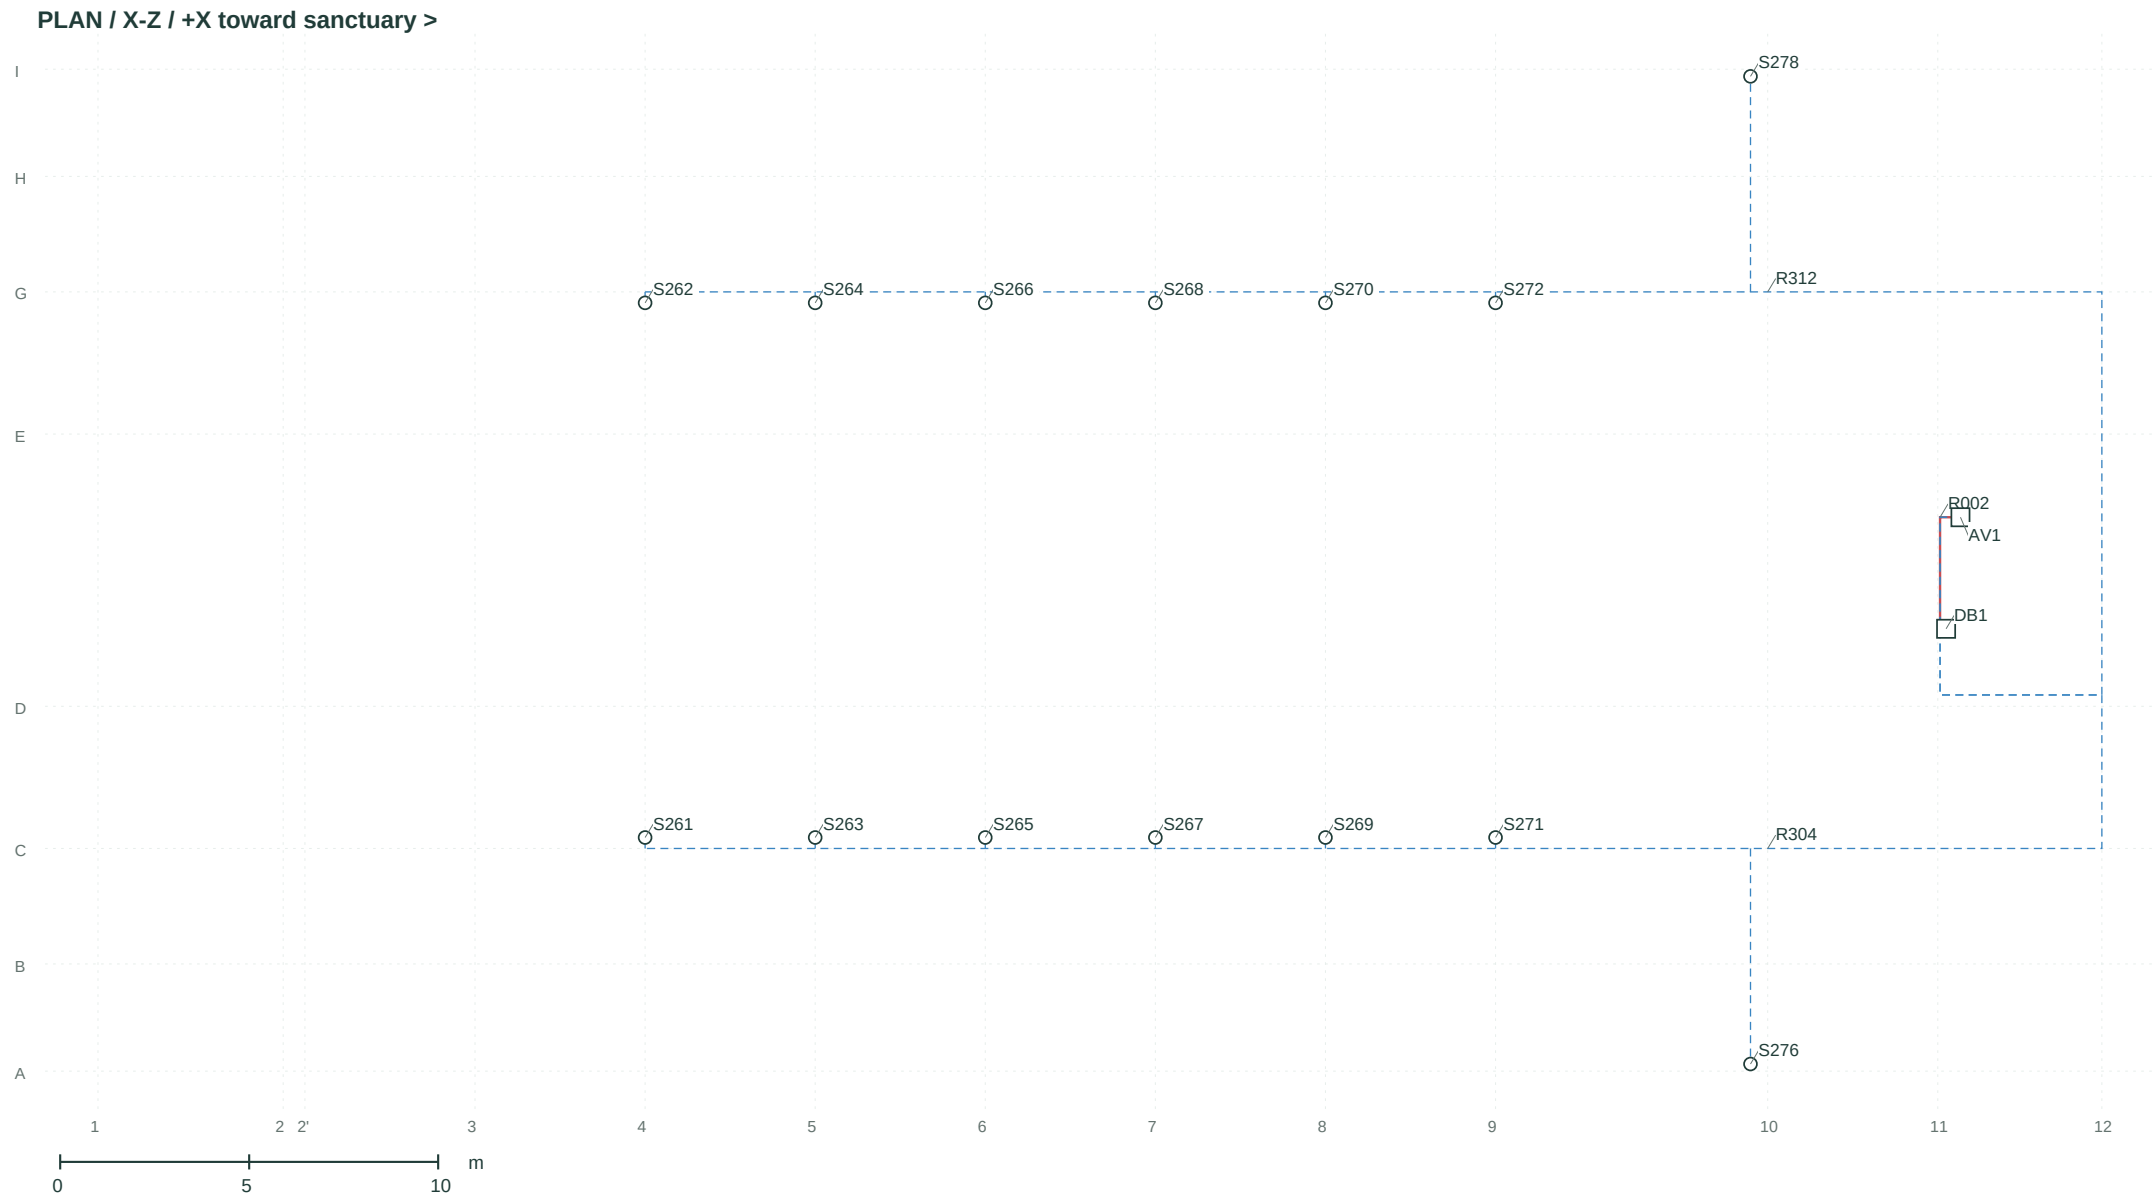

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z       | Branch |
|------|--------|-------|---------|--------|
| S261 | 14.475 | 3.450 | -7.070  | R305   |
| S262 | 14.475 | 3.450 | 7.070   | R313   |
| S263 | 18.975 | 3.450 | -7.070  | R306   |
| S264 | 18.975 | 3.450 | 7.070   | R314   |
| S265 | 23.475 | 3.450 | -7.070  | R307   |
| S266 | 23.475 | 3.450 | 7.070   | R315   |
| S267 | 27.975 | 3.450 | -7.070  | R308   |
| S268 | 27.975 | 3.450 | 7.070   | R316   |
| S269 | 32.475 | 3.450 | -7.070  | R309   |
| S270 | 32.475 | 3.450 | 7.070   | R317   |
| S271 | 36.975 | 3.450 | -7.070  | R310   |
| S272 | 36.975 | 3.450 | 7.070   | R318   |
| S276 | 43.720 | 4.850 | -13.060 | R311   |
| S278 | 43.720 | 4.850 | 13.060  | R319   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| AV1 | 49.275 | 0.950 | 1.400  |

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

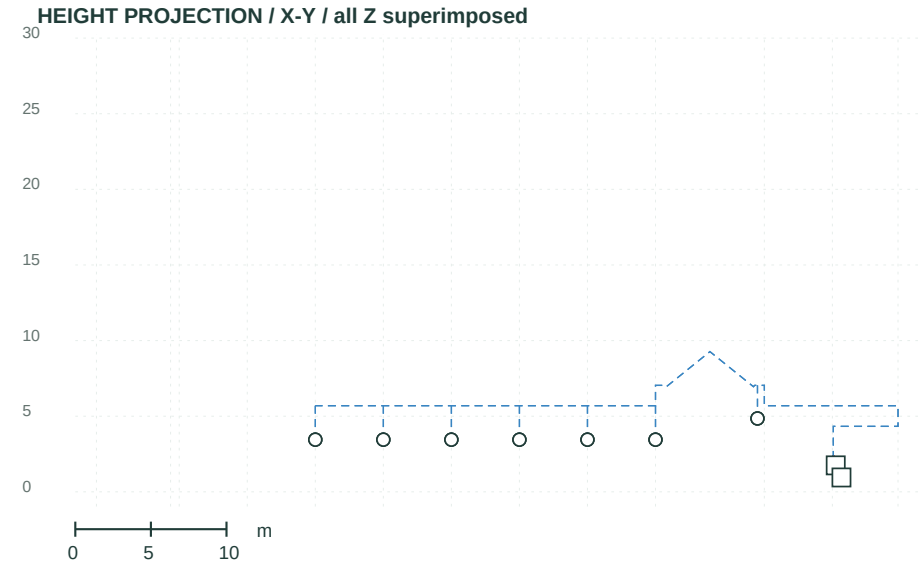


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

A5 / Rear fill (crowded feasts)

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

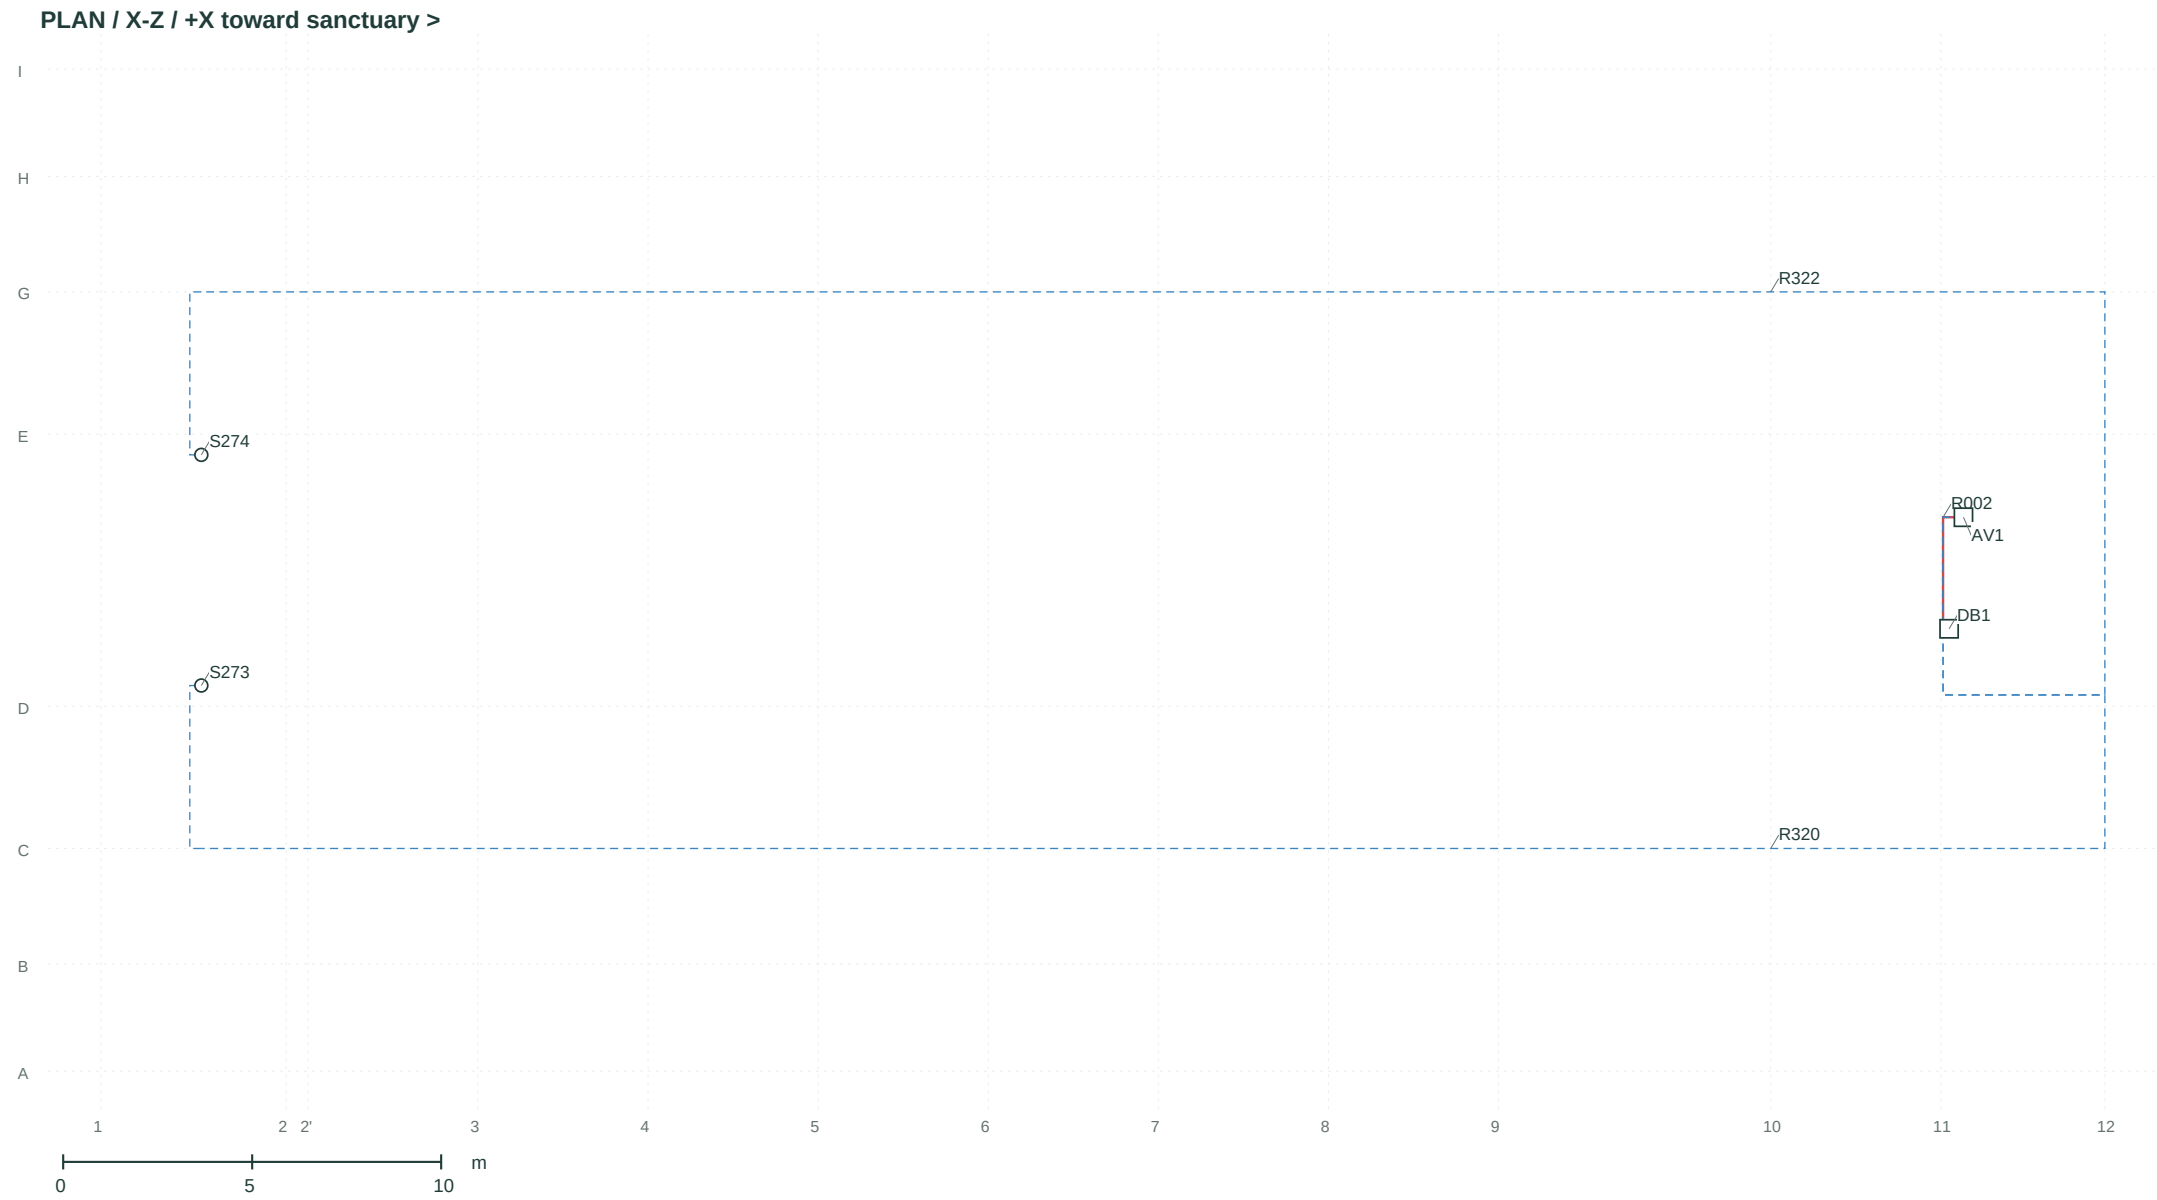

COORDINATES / X, Y, Z (m)


| ID   | X     | Y     | Z      | Branch |
|------|-------|-------|--------|--------|
| S273 | 2.655 | 3.600 | -3.050 | R321   |
| S274 | 2.655 | 3.600 | 3.050  | R323   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| AV1 | 49.275 | 0.950 | 1.400  |

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

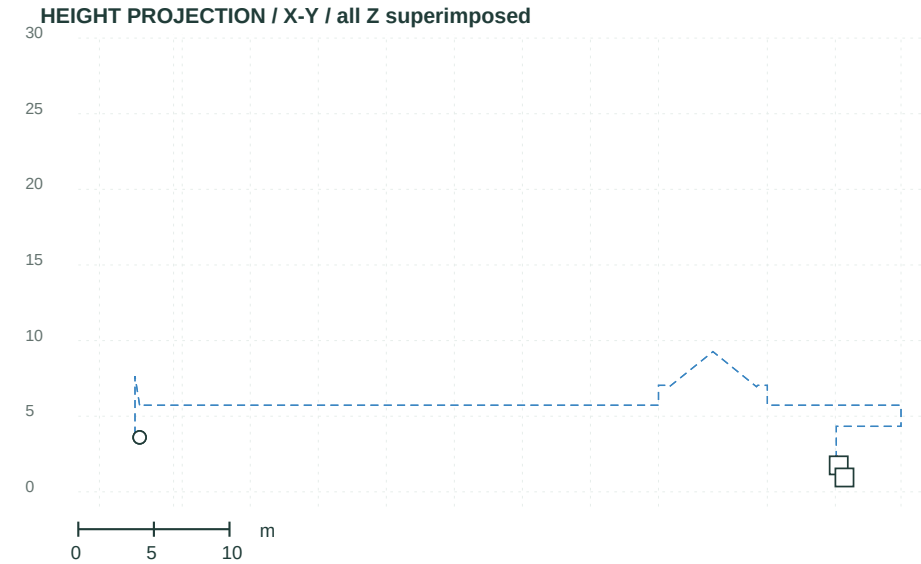


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

A2 / Veranda fill

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

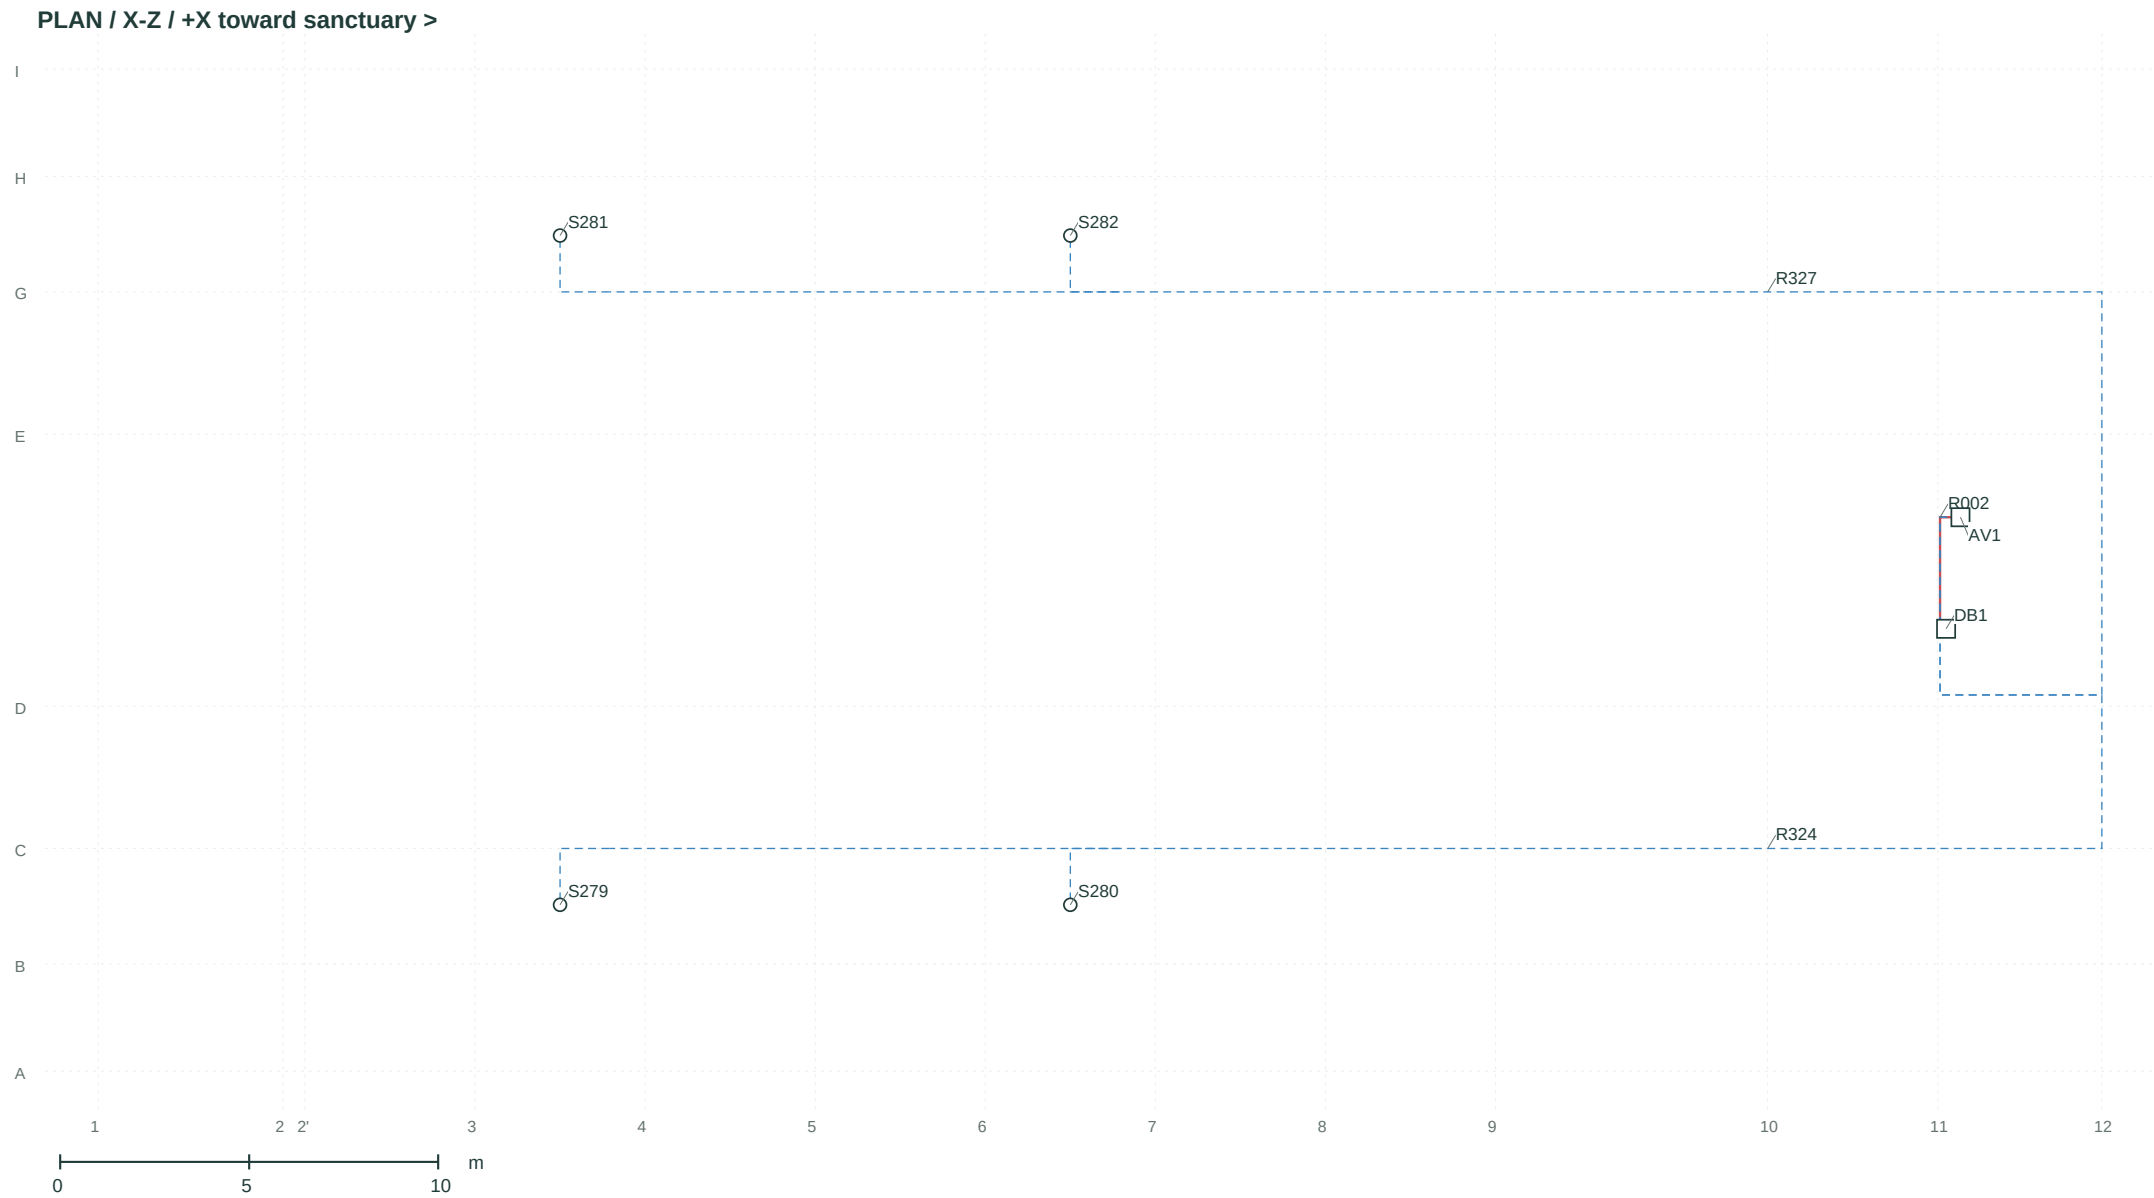

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z      | Branch |
|------|--------|-------|--------|--------|
| S279 | 12.225 | 3.900 | -8.850 | R325   |
| S280 | 25.725 | 3.900 | -8.850 | R326   |
| S281 | 12.225 | 3.900 | 8.850  | R328   |
| S282 | 25.725 | 3.900 | 8.850  | R329   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| AV1 | 49.275 | 0.950 | 1.400  |


4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

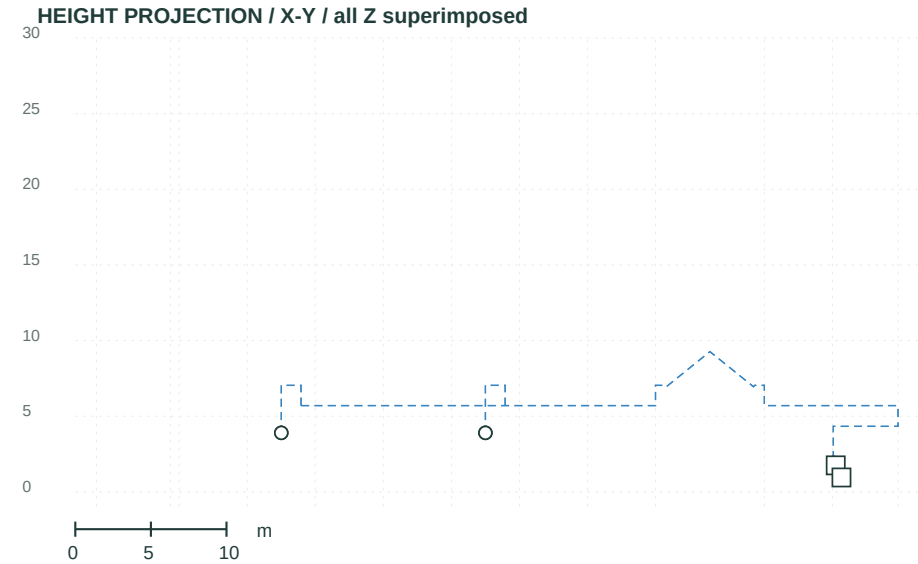

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

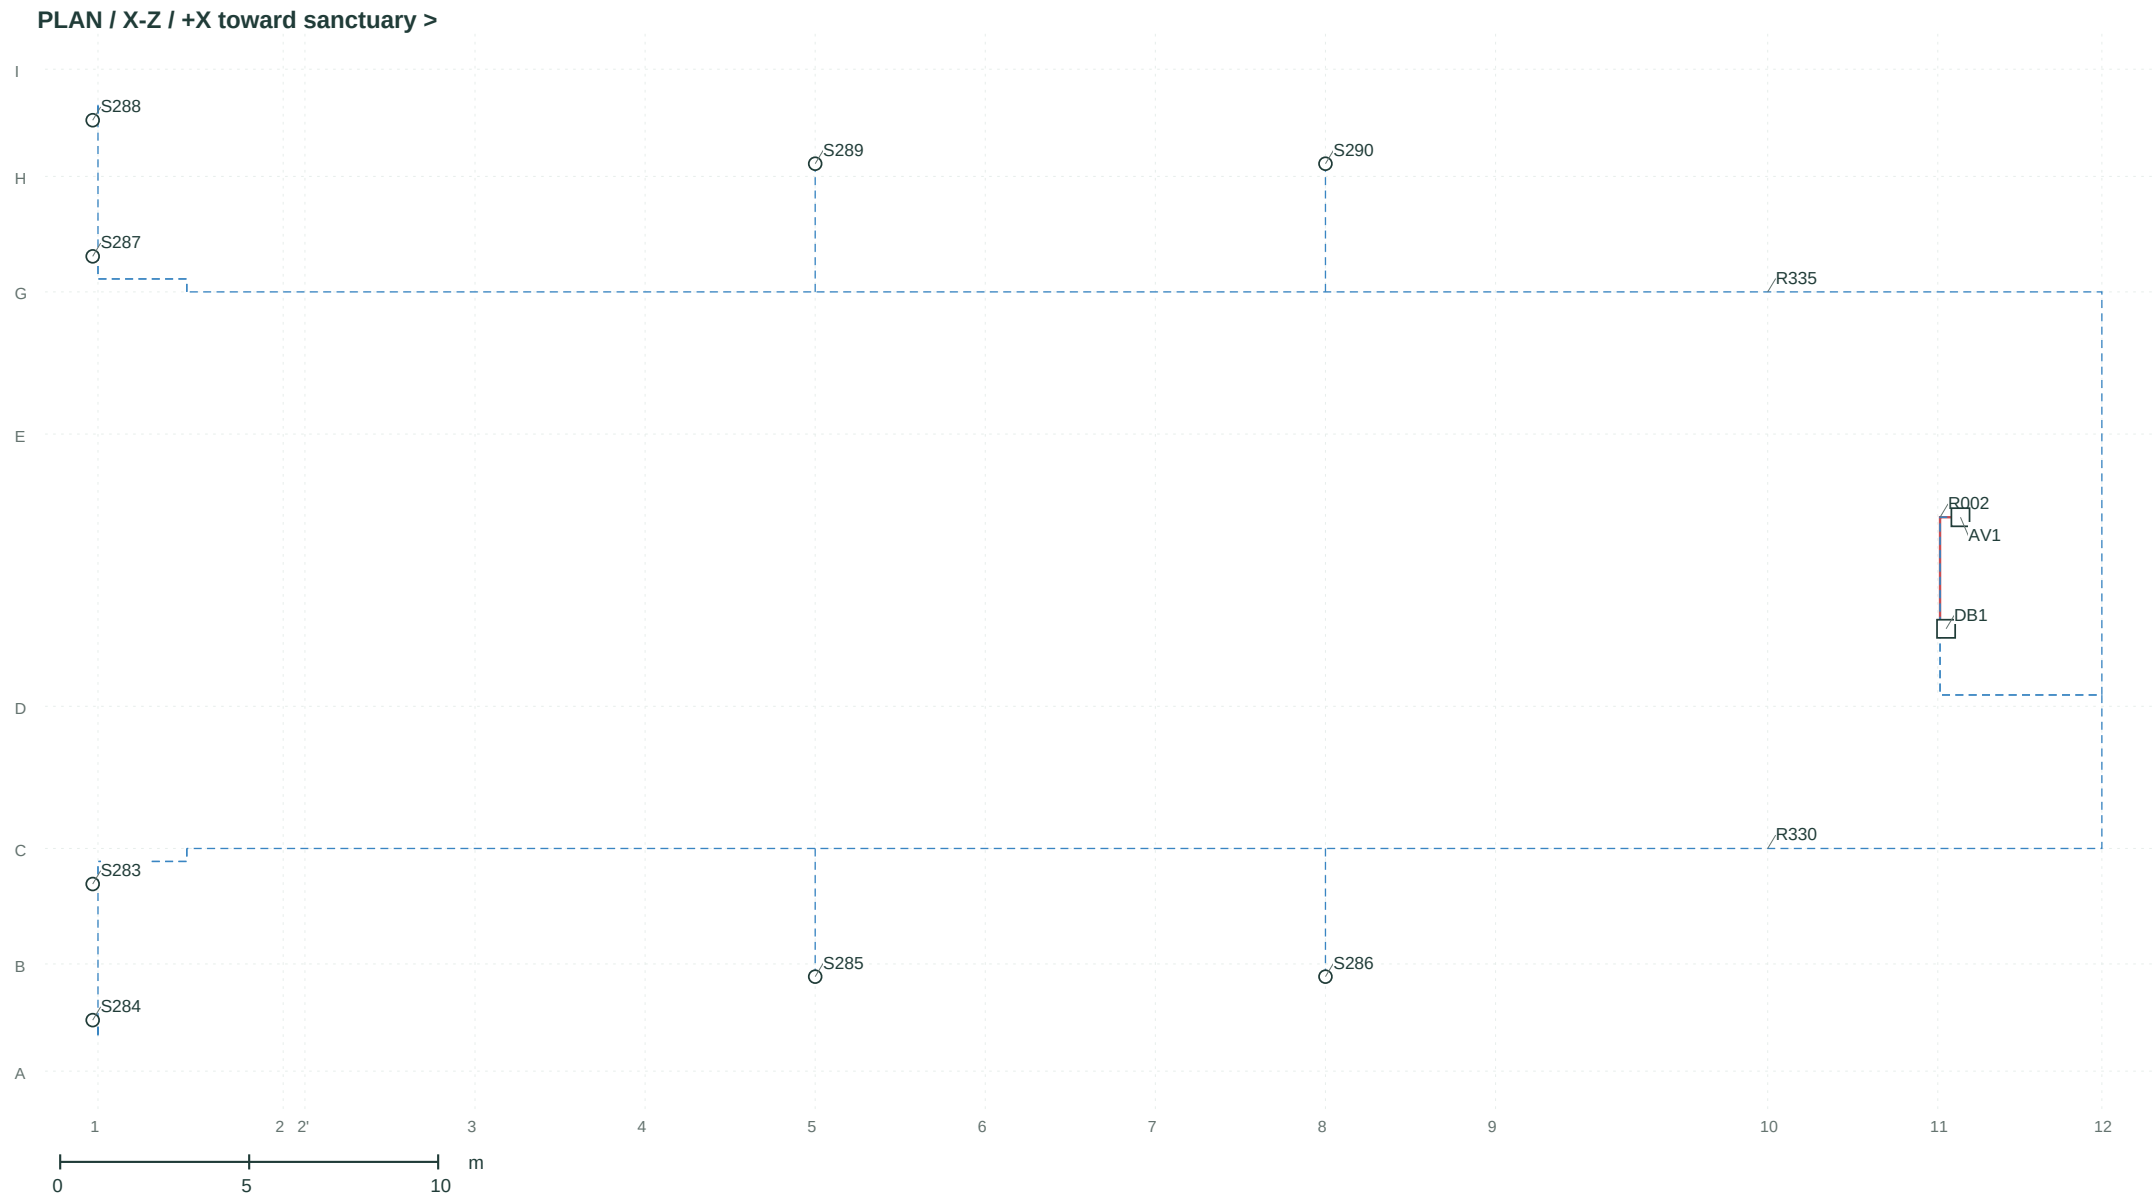

COORDINATES / X, Y, Z (m)


| ID   | X      | Y     | Z       | Branch |
|------|--------|-------|---------|--------|
| S283 | -0.140 | 6.200 | -8.300  | R331   |
| S284 | -0.140 | 6.200 | -11.900 | R332   |
| S285 | 18.975 | 5.600 | -10.750 | R333   |
| S286 | 32.475 | 5.600 | -10.750 | R334   |
| S287 | -0.140 | 6.200 | 8.300   | R336   |
| S288 | -0.140 | 6.200 | 11.900  | R337   |
| S289 | 18.975 | 5.600 | 10.750  | R338   |
| S290 | 32.475 | 5.600 | 10.750  | R339   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| AV1 | 49.275 | 0.950 | 1.400  |

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

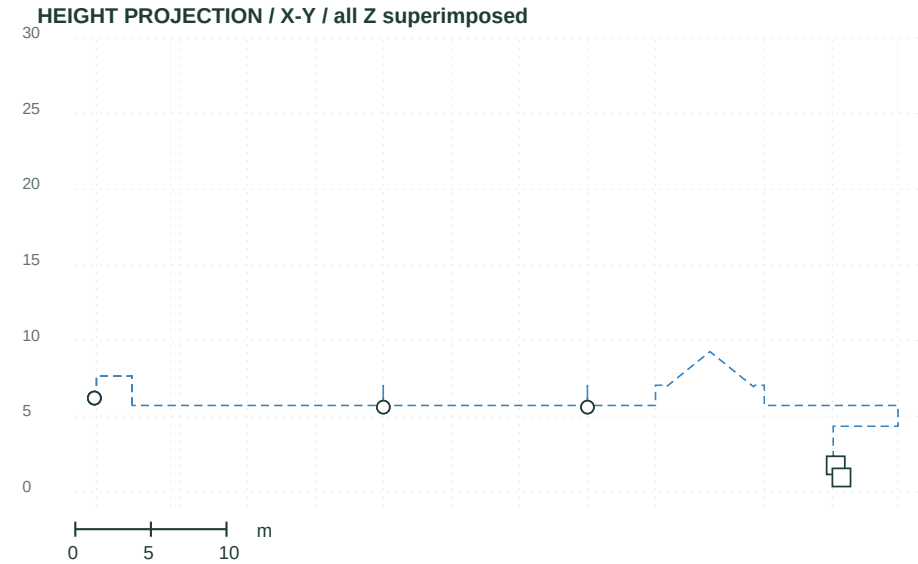

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Microphones


Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >



HEIGHT PROJECTION / X-Y / all Z superimposed

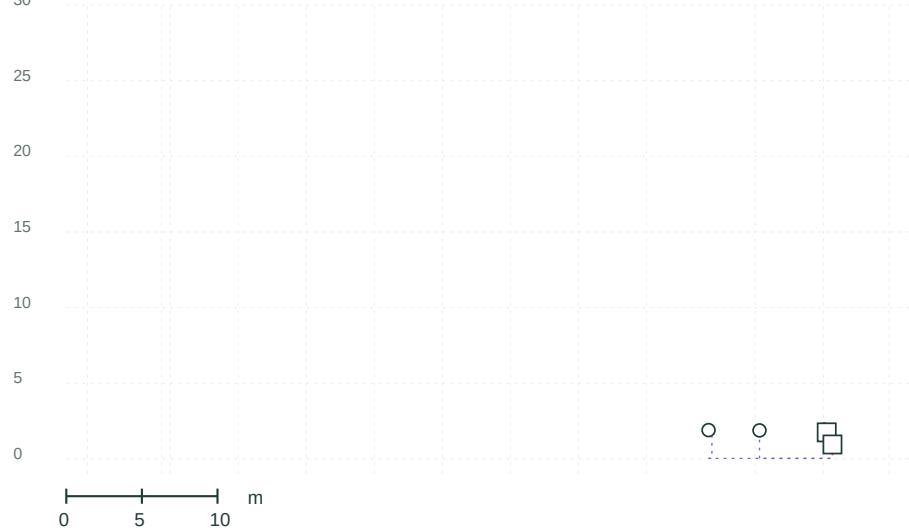

COORDINATES / X, Y, Z (m)

| ID   | X      | Y     | Z      | Branch |
|------|--------|-------|--------|--------|
| S291 | 41.080 | 1.900 | -2.620 | R341   |
| S292 | 44.450 | 1.880 | 0.450  | R343   |

Related enclosures

|     |        |       |        |
|-----|--------|-------|--------|
| DB1 | 48.895 | 1.750 | -1.550 |
| AV1 | 49.275 | 0.950 | 1.400  |

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID  | Circuit | Board | Provisional category                  | Model equipment name                      |
|-----|---------|-------|---------------------------------------|-------------------------------------------|
| L1  | L3      | DB1   | Service-room LED panel / 600 x 600 mm | Service-room ceiling panel / 50.0 m       |
| L2  | L3      | DB1   | Service-room LED panel / 600 x 600 mm | Service-room ceiling panel / 51.9 m       |
| L3  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 3 / B central        |
| L4  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 3 / B central / twin |
| L5  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 3 / H central        |
| L6  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 3 / H central / twin |
| L7  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 4 / B central        |
| L8  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 4 / B central / twin |
| L9  | L1      | DB1   | LED projector / medium 36             | Reading light / axis 4 / H central        |
| L10 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 4 / H central / twin |
| L11 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 5 / B central        |
| L12 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 5 / B central / twin |
| L13 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 5 / H central        |
| L14 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 5 / H central / twin |
| L15 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 6 / B central        |
| L16 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 6 / B central / twin |
| L17 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 6 / H central        |
| L18 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 6 / H central / twin |
| L19 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 7 / B central        |
| L20 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 7 / B central / twin |
| L21 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 7 / H central        |
| L22 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 7 / H central / twin |
| L23 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 8 / B central        |
| L24 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 8 / B central / twin |
| L25 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 8 / H central        |
| L26 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 8 / H central / twin |
| L27 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 9 / B central        |
| L28 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 9 / B central / twin |
| L29 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 9 / H central        |
| L30 | L1      | DB1   | LED projector / medium 36             | Reading light / axis 9 / H central / twin |
| L31 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 3 / B outer          |
| L32 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 3 / B outer / twin   |
| L33 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 3 / H outer          |
| L34 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 3 / H outer / twin   |
| L35 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 4 / B outer          |
| L36 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 4 / B outer / twin   |
| L37 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 4 / H outer          |
| L38 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 4 / H outer / twin   |
| L39 | L2      | DB1   | LED projector / medium 36             | Reading light / axis 5 / B outer          |

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID  | Circuit | Board | Provisional category                             | Model equipment name                     |
|-----|---------|-------|--------------------------------------------------|------------------------------------------|
| L40 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 5 / B outer / twin  |
| L41 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 5 / H outer         |
| L42 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 5 / H outer / twin  |
| L43 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 6 / B outer         |
| L44 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 6 / B outer / twin  |
| L45 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 6 / H outer         |
| L46 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 6 / H outer / twin  |
| L47 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 7 / B outer         |
| L48 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 7 / B outer / twin  |
| L49 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 7 / H outer         |
| L50 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 7 / H outer / twin  |
| L51 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 8 / B outer         |
| L52 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 8 / B outer / twin  |
| L53 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 8 / H outer         |
| L54 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 8 / H outer / twin  |
| L55 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 9 / B outer         |
| L56 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 9 / B outer / twin  |
| L57 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 9 / H outer         |
| L58 | L2      | DB1   | LED projector / medium 36                        | Reading light / axis 9 / H outer / twin  |
| L59 | L1      | DB1   | LED projector / medium 36                        | Rear rows light / entrance facade / B    |
| L60 | L1      | DB1   | LED projector / medium 36                        | Rear centre light / entrance facade / B  |
| L61 | L1      | DB1   | LED projector / medium 36                        | Rear rows light / entrance facade / H    |
| L62 | L1      | DB1   | LED projector / medium 36                        | Rear centre light / entrance facade / H  |
| L63 | L8      | DB1   | Small brass chandelier + reading optic / concept | Wing light / B / front block / back rows |
| L65 | L8      | DB1   | Small brass chandelier + reading optic / concept | Wing light / B / rear block / back rows  |
| L67 | L8      | DB1   | Small brass chandelier + reading optic / concept | Wing light / H / front block / back rows |
| L69 | L8      | DB1   | Small brass chandelier + reading optic / concept | Wing light / H / rear block / back rows  |
| L71 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 3                    |
| L72 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 4                    |
| L73 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 5                    |
| L74 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 6                    |
| L75 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 7                    |
| L76 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 8                    |
| L77 | LA      | DB1   | Roof uplight / wide flood                        | Roof uplight / axis 9                    |
| L78 | LD      | DB1   | Brass candle chandelier / 8 lamps                | Chandelier / bay 4-5                     |
| L79 | LD      | DB1   | Brass candle chandelier / 8 lamps                | Chandelier / bay 6-7                     |
| L80 | LD      | DB1   | Brass candle chandelier / 8 lamps                | Chandelier / bay 8-9                     |
| L81 | LD      | DB1   | Grand chandelier / 12 lamps                      | Grand chandelier / crossing 9-10         |
| L82 | LD      | DB1   | Brass candle sconce / 2 lamps                    | Sconce / axis 3 / B                      |

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID   | Circuit | Board | Provisional category          | Model equipment name         |
|------|---------|-------|-------------------------------|------------------------------|
| L83  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 3 / H          |
| L84  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 4 / B          |
| L85  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 4 / H          |
| L86  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 5 / B          |
| L87  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 5 / H          |
| L88  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 6 / B          |
| L89  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 6 / H          |
| L90  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 7 / B          |
| L91  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 7 / H          |
| L92  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 8 / B          |
| L93  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 8 / H          |
| L94  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 9 / B          |
| L95  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / axis 9 / H          |
| L96  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / sanctuary pier / B  |
| L97  | LD      | DB1   | Brass candle sconce / 2 lamps | Sconce / sanctuary pier / H  |
| L98  | L3      | DB1   | LED projector / narrow 24     | Altar key light / B          |
| L99  | L3      | DB1   | LED projector / narrow 24     | Altar key light / H          |
| L100 | L3      | DB1   | Accent spotlight / 15         | Ambo key light               |
| L101 | L3      | DB1   | LED projector / medium 36     | Sanctuary step fill / B      |
| L102 | L3      | DB1   | LED projector / medium 36     | Sanctuary step fill / H      |
| L103 | L3      | DB1   | Accent spotlight / 15         | Presider chair light         |
| L104 | L3      | DB1   | LED projector / medium 36     | Sanctuary frame wash / B     |
| L105 | L3      | DB1   | LED projector / medium 36     | Sanctuary frame wash / H     |
| L106 | L3      | DB1   | Accent spotlight / 15         | Crucifix accent / B          |
| L107 | L3      | DB1   | LED projector / medium 36     | Reredos wash / B             |
| L108 | L3      | DB1   | LED projector / medium 36     | Reredos base wash / B        |
| L109 | L3      | DB1   | Roof uplight / wide flood     | Sanctuary vault uplight / B  |
| L110 | L3      | DB1   | Accent spotlight / 15         | Crucifix accent / H          |
| L111 | L3      | DB1   | LED projector / medium 36     | Reredos wash / H             |
| L112 | L3      | DB1   | LED projector / medium 36     | Reredos base wash / H        |
| L113 | L3      | DB1   | Roof uplight / wide flood     | Sanctuary vault uplight / H  |
| L114 | L3      | DB1   | Accent spotlight / 15         | Tabernacle accent            |
| L115 | L3      | DB1   | Accent spotlight / 15         | Statue accent / B            |
| L116 | L3      | DB1   | LED projector / medium 36     | Shrine wash / B              |
| L117 | L3      | DB1   | Accent spotlight / 15         | Statue accent / H            |
| L118 | L3      | DB1   | LED projector / medium 36     | Shrine wash / H              |
| L119 | L4      | DB1   | Pendant lantern / opal        | Veranda lantern / B / axis 3 |
| L120 | L4      | DB1   | Pendant lantern / opal        | Veranda lantern / B / axis 4 |
| L121 | L4      | DB1   | Pendant lantern / opal        | Veranda lantern / B / axis 5 |

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID   | Circuit | Board | Provisional category              | Model equipment name                   |
|------|---------|-------|-----------------------------------|----------------------------------------|
| L122 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / B / axis 6           |
| L123 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / B / axis 7           |
| L124 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / B / axis 8           |
| L125 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / B / axis 9           |
| L126 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / B / axis 10          |
| L127 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / B / axis 11          |
| L128 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 3           |
| L129 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 4           |
| L130 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 5           |
| L131 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 6           |
| L132 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 7           |
| L133 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 8           |
| L134 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 9           |
| L135 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 10          |
| L136 | L4      | DB1   | Pendant lantern / opal            | Veranda lantern / H / axis 11          |
| L137 | L9      | DB2   | Wall lantern                      | Central front door lantern / B         |
| L138 | L9      | DB2   | Wall lantern                      | Central front door lantern / H         |
| L139 | L5      | DB1   | Wall lantern                      | Side door lantern / B / 16.725 / front |
| L140 | L5      | DB1   | Wall lantern                      | Side door lantern / B / 16.725 / rear  |
| L141 | L5      | DB1   | Wall lantern                      | Side door lantern / B / 34.725 / front |
| L142 | L5      | DB1   | Wall lantern                      | Side door lantern / B / 34.725 / rear  |
| L143 | L5      | DB1   | Wall lantern                      | Side door lantern / B / 46.425 / front |
| L144 | L5      | DB1   | Wall lantern                      | Side door lantern / B / 46.425 / rear  |
| L145 | L5      | DB1   | Wall lantern                      | Side door lantern / H / 16.725 / front |
| L146 | L5      | DB1   | Wall lantern                      | Side door lantern / H / 16.725 / rear  |
| L147 | L5      | DB1   | Wall lantern                      | Side door lantern / H / 34.725 / front |
| L148 | L5      | DB1   | Wall lantern                      | Side door lantern / H / 34.725 / rear  |
| L149 | L5      | DB1   | Wall lantern                      | Side door lantern / H / 46.425 / front |
| L150 | L5      | DB1   | Wall lantern                      | Side door lantern / H / 46.425 / rear  |
| L151 | L3      | DB1   | Wall lantern                      | Service door lantern / B / front       |
| L152 | L3      | DB1   | Wall lantern                      | Service door lantern / B / rear        |
| L153 | L3      | DB1   | Wall lantern                      | Service door lantern / H / front       |
| L154 | L3      | DB1   | Wall lantern                      | Service door lantern / H / rear        |
| L155 | E1      | DB1   | Exit sign (maintained)            | Exit sign / main doors                 |
| L156 | E1      | DB1   | Exit sign (maintained)            | Exit sign / side door 16.7 / B         |
| L157 | E1      | DB1   | Exit sign (maintained)            | Exit sign / side door 16.7 / H         |
| L158 | E1      | DB1   | Exit sign (maintained)            | Exit sign / side door 34.7 / B         |
| L159 | E1      | DB1   | Exit sign (maintained)            | Exit sign / side door 34.7 / H         |
| L160 | L6      | DB2   | Tower floodlight / projecting arm | Tower lower front wash / B             |

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

| ID   | Circuit | Board | Provisional category              | Model equipment name                      |
|------|---------|-------|-----------------------------------|-------------------------------------------|
| L161 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 2 flood / B                   |
| L162 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 3 flood / B                   |
| L163 | L6      | DB2   | Tower floodlight / projecting arm | Belfry front wash / B                     |
| L164 | L6      | DB2   | Tower floodlight / projecting arm | Dome front wash / B                       |
| L165 | L6      | DB2   | Roof uplight / wide flood         | Belfry glow / B                           |
| L166 | L6      | DB2   | Tower floodlight / projecting arm | Tower lower side wash / B                 |
| L167 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 2 side wash / B               |
| L168 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 3 side wash / B               |
| L169 | L6      | DB2   | Tower floodlight / projecting arm | Belfry side wash / B                      |
| L170 | L6      | DB2   | Facade floodlight                 | Facade wash / B                           |
| L171 | L6      | DB2   | Tower floodlight / projecting arm | Tower lower front wash / H                |
| L172 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 2 flood / H                   |
| L173 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 3 flood / H                   |
| L174 | L6      | DB2   | Tower floodlight / projecting arm | Belfry front wash / H                     |
| L175 | L6      | DB2   | Tower floodlight / projecting arm | Dome front wash / H                       |
| L176 | L6      | DB2   | Roof uplight / wide flood         | Belfry glow / H                           |
| L177 | L6      | DB2   | Tower floodlight / projecting arm | Tower lower side wash / H                 |
| L178 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 2 side wash / H               |
| L179 | L6      | DB2   | Tower floodlight / projecting arm | Tower stage 3 side wash / H               |
| L180 | L6      | DB2   | Tower floodlight / projecting arm | Belfry side wash / H                      |
| L181 | L6      | DB2   | Facade floodlight                 | Facade wash / H                           |
| L182 | L9      | DB2   | Facade floodlight                 | Stage flood / tower B / outer             |
| L183 | L9      | DB2   | Facade floodlight                 | Stage flood / tower B / inner             |
| L184 | L5      | DB1   | LED projector / medium 36         | Path light / axis 4 / B                   |
| L185 | L5      | DB1   | LED projector / medium 36         | Path light / axis 6 / B                   |
| L186 | L5      | DB1   | LED projector / medium 36         | Path light / axis 11 / B                  |
| L187 | L5      | DB1   | LED projector / medium 36         | Path light / wing gable B                 |
| L188 | L5      | DB1   | LED projector / medium 36         | Path light / rear / B                     |
| L189 | L9      | DB2   | Facade floodlight                 | Stage flood / tower H / inner             |
| L190 | L9      | DB2   | Facade floodlight                 | Stage flood / tower H / outer             |
| L191 | L5      | DB1   | LED projector / medium 36         | Path light / axis 4 / H                   |
| L192 | L5      | DB1   | LED projector / medium 36         | Path light / axis 6 / H                   |
| L193 | L5      | DB1   | LED projector / medium 36         | Path light / axis 11 / H                  |
| L194 | L5      | DB1   | LED projector / medium 36         | Path light / wing gable H                 |
| L195 | L5      | DB1   | LED projector / medium 36         | Path light / rear / H                     |
| L196 | L7      | DB2   | Festival bulb string (outdoor)    | Festival lights / roof ridge              |
| L197 | L7      | DB2   | Festival bulb string (outdoor)    | Festival lights / main eave B / nave      |
| L198 | L7      | DB2   | Festival bulb string (outdoor)    | Festival lights / main eave B / sanctuary |
| L199 | L7      | DB2   | Festival bulb string (outdoor)    | Festival lights / veranda eave B / nave   |

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID   | Circuit | Board | Provisional category           | Model equipment name                               |
|------|---------|-------|--------------------------------|----------------------------------------------------|
| L200 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / veranda eave B / sanctuary       |
| L201 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / rear gable B                     |
| L202 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower B / stage 1 / inner corner |
| L203 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower B / stage 1 / outer corner |
| L204 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower B / stage 2 / inner corner |
| L205 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower B / stage 2 / outer corner |
| L206 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower B / stage 3 / inner corner |
| L207 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower B / stage 3 / outer corner |
| L208 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / main eave H / nave               |
| L209 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / main eave H / sanctuary          |
| L210 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / veranda eave H / nave            |
| L211 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / veranda eave H / sanctuary       |
| L212 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / rear gable H                     |
| L213 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower H / stage 1 / inner corner |
| L214 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower H / stage 1 / outer corner |
| L215 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower H / stage 2 / inner corner |
| L216 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower H / stage 2 / outer corner |
| L217 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower H / stage 3 / inner corner |
| L218 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / tower H / stage 3 / outer corner |
| L219 | L7      | DB2   | Festival bulb string (outdoor) | Festival lights / front terrace between the towers |
| L220 | L7      | DB2   | Facade floodlight              | Festival flood / rear gable B                      |
| L221 | L7      | DB2   | Facade floodlight              | Festival flood / rear gable H                      |
| L222 | L6      | DB2   | Facade floodlight              | Central gable flood / B                            |
| L223 | L6      | DB2   | Facade floodlight              | Central crown wash / B                             |
| L224 | L6      | DB2   | Facade floodlight              | Central gable flood / H                            |
| L225 | L6      | DB2   | Facade floodlight              | Central crown wash / H                             |
| F226 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 2'-3 / B aisle                   |
| F227 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 2'-3 / H aisle                   |
| F228 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 3-4 / B aisle                    |
| F229 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 3-4 / H aisle                    |
| F230 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 4-5 / B aisle                    |
| F231 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 4-5 / H aisle                    |
| F232 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 5-6 / B aisle                    |
| F233 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 5-6 / H aisle                    |
| F234 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 6-7 / B aisle                    |
| F235 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 6-7 / H aisle                    |
| F236 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 7-8 / B aisle                    |
| F237 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 7-8 / H aisle                    |
| F238 | F1      | DB1   | Ceiling fan / 1.42 m (56")     | Ceiling fan / bay 8-9 / B aisle                    |

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID   | Circuit | Board | Provisional category                             | Model equipment name                      |
|------|---------|-------|--------------------------------------------------|-------------------------------------------|
| F239 | F1      | DB1   | Ceiling fan / 1.42 m (56")                       | Ceiling fan / bay 8-9 / H aisle           |
| F240 | F5      | DB1   | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing B / 1 / held review       |
| F241 | F5      | DB1   | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing B / 2 / held review       |
| F242 | F5      | DB1   | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing H / 1 / held review       |
| F243 | F5      | DB1   | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing H / 2 / held review       |
| F244 | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 4 / B                     |
| F245 | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 4 / H                     |
| F246 | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 6 / B                     |
| F247 | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 6 / H                     |
| F248 | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 8 / B                     |
| F249 | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 8 / H                     |
| F250 | F4      | DB2   | Large wall circulator / 90 cm                    | Entrance circulator / B                   |
| F251 | F4      | DB2   | Large wall circulator / 90 cm                    | Entrance circulator / H                   |
| F252 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / front gable / B outer       |
| F253 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / front gable / B inner       |
| F254 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / front gable / H inner       |
| F255 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / front gable / H outer       |
| F256 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / wing gable B / front        |
| F257 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / wing gable B / rear         |
| F258 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / wing gable H / front        |
| F259 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / wing gable H / rear         |
| F260 | V1      | DB1   | Exhaust (ventilation) fan / 50 cm                | Exhaust fan / service room                |
| S261 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 4 / B                 |
| S262 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 4 / H                 |
| S263 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 5 / B                 |
| S264 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 5 / H                 |
| S265 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 6 / B                 |
| S266 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 6 / H                 |
| S267 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 7 / B                 |
| S268 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 7 / H                 |
| S269 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 8 / B                 |
| S270 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 8 / H                 |
| S271 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 9 / B                 |
| S272 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / axis 9 / H                 |
| S273 | A5      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / entrance hall / B          |
| S274 | A5      | DB1   | Slim wall column / 0.6 m, wall colour            | Wall speaker / entrance hall / H          |
| S276 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wing speaker / B / toward entrance / held |
| S278 | A1      | DB1   | Slim wall column / 0.6 m, wall colour            | Wing speaker / H / toward entrance / held |
| S279 | A2      | DB1   | Pendant loudspeaker / 6"                         | Veranda fill / B / 12.2                   |

Equipment naming schedule

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID          | Circuit | Board | Provisional category                             | Model equipment name             |
|-------------|---------|-------|--------------------------------------------------|----------------------------------|
| S280        | A2      | DB1   | Pendant loudspeaker / 6"                         | Veranda fill / B / 25.7          |
| S281        | A2      | DB1   | Pendant loudspeaker / 6"                         | Veranda fill / H / 12.2          |
| S282        | A2      | DB1   | Pendant loudspeaker / 6"                         | Veranda fill / H / 25.7          |
| S283        | A3      | DB1   | Outdoor horn / 30 W                              | Courtyard horn / B               |
| S284        | A3      | DB1   | Outdoor horn / 30 W                              | Tower horn / B / outer           |
| S285        | A3      | DB1   | Outdoor horn / 30 W                              | Side courtyard horn / axis 5 / B |
| S286        | A3      | DB1   | Outdoor horn / 30 W                              | Side courtyard horn / axis 8 / B |
| S287        | A3      | DB1   | Outdoor horn / 30 W                              | Courtyard horn / H               |
| S288        | A3      | DB1   | Outdoor horn / 30 W                              | Tower horn / H / outer           |
| S289        | A3      | DB1   | Outdoor horn / 30 W                              | Side courtyard horn / axis 5 / H |
| S290        | A3      | DB1   | Outdoor horn / 30 W                              | Side courtyard horn / axis 8 / H |
| S291        | MIC     | DB1   | Gooseneck microphone (cardioid)                  | Ambo microphone                  |
| S292        | MIC     | DB1   | Gooseneck microphone (cardioid)                  | Altar microphone                 |
| F-NAVE-B-2P | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 2' / B           |
| F-NAVE-H-2P | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 2' / H           |
| F-NAVE-B-3  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 3 / B            |
| F-NAVE-H-3  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 3 / H            |
| F-NAVE-B-5  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 5 / B            |
| F-NAVE-H-5  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 5 / H            |
| F-NAVE-B-7  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 7 / B            |
| F-NAVE-H-7  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 7 / H            |
| F-NAVE-B-9  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 9 / B            |
| F-NAVE-H-9  | F2      | DB1   | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 9 / H            |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID          | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|--------------------------|------|--------------|---------------------|---------|------------------|
| R001 | feeder:DB2               | DB1  | DB2-FEED     | Shared context      | 80.68   | -                |
| R002 | feeder:AV1               | DB1  | AV1-SUPPLY   | Shared context      | 5.79    | -                |
| R003 | feeder:LC1               | DB1  | LC1-SUPPLY   | Shared context      | 2.56    | -                |
| R004 | feeder:FC1               | DB1  | FC1-SUPPLY   | Shared context      | 3.41    | -                |
| R005 | local:L1                 | LC1  | L3           | L1                  | 8.03    | -                |
| R006 | local:L2                 | LC1  | L3           | L2                  | 9.93    | -                |
| R007 | trunk:LC1:L1:light:-1    | LC1  | L1           | Shared context      | 69.66   | -                |
| R008 | drop:LC1:L1:light:-1:L3  | LC1  | L1           | L3                  | 8.73    | -                |
| R009 | drop:LC1:L1:light:-1:L4  | LC1  | L1           | L4                  | 8.73    | -                |
| R010 | drop:LC1:L1:light:-1:L7  | LC1  | L1           | L7                  | 8.73    | -                |
| R011 | drop:LC1:L1:light:-1:L8  | LC1  | L1           | L8                  | 8.73    | -                |
| R012 | drop:LC1:L1:light:-1:L11 | LC1  | L1           | L11                 | 8.73    | -                |
| R013 | drop:LC1:L1:light:-1:L12 | LC1  | L1           | L12                 | 8.73    | -                |
| R014 | drop:LC1:L1:light:-1:L15 | LC1  | L1           | L15                 | 8.73    | -                |
| R015 | drop:LC1:L1:light:-1:L16 | LC1  | L1           | L16                 | 8.73    | -                |
| R016 | drop:LC1:L1:light:-1:L19 | LC1  | L1           | L19                 | 8.73    | -                |
| R017 | drop:LC1:L1:light:-1:L20 | LC1  | L1           | L20                 | 8.73    | -                |
| R018 | drop:LC1:L1:light:-1:L23 | LC1  | L1           | L23                 | 8.73    | -                |
| R019 | drop:LC1:L1:light:-1:L24 | LC1  | L1           | L24                 | 8.73    | -                |
| R020 | drop:LC1:L1:light:-1:L27 | LC1  | L1           | L27                 | 8.73    | -                |
| R021 | drop:LC1:L1:light:-1:L28 | LC1  | L1           | L28                 | 8.73    | -                |
| R022 | drop:LC1:L1:light:-1:L59 | LC1  | L1           | L59                 | 9.44    | -                |
| R023 | drop:LC1:L1:light:-1:L60 | LC1  | L1           | L60                 | 6.94    | -                |
| R024 | trunk:LC1:L1:light:1     | LC1  | L1           | Shared context      | 76.26   | -                |
| R025 | drop:LC1:L1:light:1:L5   | LC1  | L1           | L5                  | 8.73    | -                |
| R026 | drop:LC1:L1:light:1:L6   | LC1  | L1           | L6                  | 8.73    | -                |
| R027 | drop:LC1:L1:light:1:L9   | LC1  | L1           | L9                  | 8.73    | -                |
| R028 | drop:LC1:L1:light:1:L10  | LC1  | L1           | L10                 | 8.73    | -                |
| R029 | drop:LC1:L1:light:1:L13  | LC1  | L1           | L13                 | 8.73    | -                |
| R030 | drop:LC1:L1:light:1:L14  | LC1  | L1           | L14                 | 8.73    | -                |
| R031 | drop:LC1:L1:light:1:L17  | LC1  | L1           | L17                 | 8.73    | -                |
| R032 | drop:LC1:L1:light:1:L18  | LC1  | L1           | L18                 | 8.73    | -                |
| R033 | drop:LC1:L1:light:1:L21  | LC1  | L1           | L21                 | 8.73    | -                |
| R034 | drop:LC1:L1:light:1:L22  | LC1  | L1           | L22                 | 8.73    | -                |
| R035 | drop:LC1:L1:light:1:L25  | LC1  | L1           | L25                 | 8.73    | -                |
| R036 | drop:LC1:L1:light:1:L26  | LC1  | L1           | L26                 | 8.73    | -                |
| R037 | drop:LC1:L1:light:1:L29  | LC1  | L1           | L29                 | 8.73    | -                |
| R038 | drop:LC1:L1:light:1:L30  | LC1  | L1           | L30                 | 8.73    | -                |
| R039 | drop:LC1:L1:light:1:L61  | LC1  | L1           | L61                 | 9.44    | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID          | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|--------------------------|------|--------------|---------------------|---------|------------------|
| R040 | drop:LC1:L1:light:1:L62  | LC1  | L1           | L62                 | 6.94    | -                |
| R041 | trunk:LC1:L2:light:-1    | LC1  | L2           | Shared context      | 62.33   | -                |
| R042 | drop:LC1:L2:light:-1:L31 | LC1  | L2           | L31                 | 3.73    | -                |
| R043 | drop:LC1:L2:light:-1:L32 | LC1  | L2           | L32                 | 3.73    | -                |
| R044 | drop:LC1:L2:light:-1:L35 | LC1  | L2           | L35                 | 3.73    | -                |
| R045 | drop:LC1:L2:light:-1:L36 | LC1  | L2           | L36                 | 3.73    | -                |
| R046 | drop:LC1:L2:light:-1:L39 | LC1  | L2           | L39                 | 3.73    | -                |
| R047 | drop:LC1:L2:light:-1:L40 | LC1  | L2           | L40                 | 3.73    | -                |
| R048 | drop:LC1:L2:light:-1:L43 | LC1  | L2           | L43                 | 3.73    | -                |
| R049 | drop:LC1:L2:light:-1:L44 | LC1  | L2           | L44                 | 3.73    | -                |
| R050 | drop:LC1:L2:light:-1:L47 | LC1  | L2           | L47                 | 3.73    | -                |
| R051 | drop:LC1:L2:light:-1:L48 | LC1  | L2           | L48                 | 3.73    | -                |
| R052 | drop:LC1:L2:light:-1:L51 | LC1  | L2           | L51                 | 3.73    | -                |
| R053 | drop:LC1:L2:light:-1:L52 | LC1  | L2           | L52                 | 3.73    | -                |
| R054 | drop:LC1:L2:light:-1:L55 | LC1  | L2           | L55                 | 3.73    | -                |
| R055 | drop:LC1:L2:light:-1:L56 | LC1  | L2           | L56                 | 3.73    | -                |
| R056 | trunk:LC1:L2:light:1     | LC1  | L2           | Shared context      | 68.93   | -                |
| R057 | drop:LC1:L2:light:1:L33  | LC1  | L2           | L33                 | 3.73    | -                |
| R058 | drop:LC1:L2:light:1:L34  | LC1  | L2           | L34                 | 3.73    | -                |
| R059 | drop:LC1:L2:light:1:L37  | LC1  | L2           | L37                 | 3.73    | -                |
| R060 | drop:LC1:L2:light:1:L38  | LC1  | L2           | L38                 | 3.73    | -                |
| R061 | drop:LC1:L2:light:1:L41  | LC1  | L2           | L41                 | 3.73    | -                |
| R062 | drop:LC1:L2:light:1:L42  | LC1  | L2           | L42                 | 3.73    | -                |
| R063 | drop:LC1:L2:light:1:L45  | LC1  | L2           | L45                 | 3.73    | -                |
| R064 | drop:LC1:L2:light:1:L46  | LC1  | L2           | L46                 | 3.73    | -                |
| R065 | drop:LC1:L2:light:1:L49  | LC1  | L2           | L49                 | 3.73    | -                |
| R066 | drop:LC1:L2:light:1:L50  | LC1  | L2           | L50                 | 3.73    | -                |
| R067 | drop:LC1:L2:light:1:L53  | LC1  | L2           | L53                 | 3.73    | -                |
| R068 | drop:LC1:L2:light:1:L54  | LC1  | L2           | L54                 | 3.73    | -                |
| R069 | drop:LC1:L2:light:1:L57  | LC1  | L2           | L57                 | 3.73    | -                |
| R070 | drop:LC1:L2:light:1:L58  | LC1  | L2           | L58                 | 3.73    | -                |
| R071 | trunk:LC1:L8:light:-1    | LC1  | L8           | Shared context      | 31.84   | -                |
| R072 | drop:LC1:L8:light:-1:L63 | LC1  | L8           | L63                 | 6.94    | -                |
| R073 | drop:LC1:L8:light:-1:L65 | LC1  | L8           | L65                 | 6.94    | -                |
| R074 | trunk:LC1:L8:light:1     | LC1  | L8           | Shared context      | 38.44   | -                |
| R075 | drop:LC1:L8:light:1:L67  | LC1  | L8           | L67                 | 6.94    | -                |
| R076 | drop:LC1:L8:light:1:L69  | LC1  | L8           | L69                 | 6.94    | -                |
| R077 | trunk:LC1:LA:light:-1    | LC1  | LA           | Shared context      | 62.31   | -                |
| R078 | drop:LC1:LA:light:-1:L71 | LC1  | LA           | L71                 | 10.20   | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID           | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|---------------------------|------|--------------|---------------------|---------|------------------|
| R079 | drop:LC1:LA:light:-1:L72  | LC1  | LA           | L72                 | 10.20   | -                |
| R080 | drop:LC1:LA:light:-1:L73  | LC1  | LA           | L73                 | 10.20   | -                |
| R081 | drop:LC1:LA:light:-1:L74  | LC1  | LA           | L74                 | 10.20   | -                |
| R082 | drop:LC1:LA:light:-1:L75  | LC1  | LA           | L75                 | 10.20   | -                |
| R083 | drop:LC1:LA:light:-1:L76  | LC1  | LA           | L76                 | 10.20   | -                |
| R084 | drop:LC1:LA:light:-1:L77  | LC1  | LA           | L77                 | 10.20   | -                |
| R085 | trunk:LC1:LD:light:-1     | LC1  | LD           | Shared context      | 62.30   | -                |
| R086 | drop:LC1:LD:light:-1:L78  | LC1  | LD           | L78                 | 16.28   | -                |
| R087 | drop:LC1:LD:light:-1:L79  | LC1  | LD           | L79                 | 16.28   | -                |
| R088 | drop:LC1:LD:light:-1:L80  | LC1  | LD           | L80                 | 16.28   | -                |
| R089 | drop:LC1:LD:light:-1:L81  | LC1  | LD           | L81                 | 11.56   | -                |
| R090 | drop:LC1:LD:light:-1:L82  | LC1  | LD           | L82                 | 1.63    | -                |
| R091 | drop:LC1:LD:light:-1:L84  | LC1  | LD           | L84                 | 1.63    | -                |
| R092 | drop:LC1:LD:light:-1:L86  | LC1  | LD           | L86                 | 1.63    | -                |
| R093 | drop:LC1:LD:light:-1:L88  | LC1  | LD           | L88                 | 1.63    | -                |
| R094 | drop:LC1:LD:light:-1:L90  | LC1  | LD           | L90                 | 1.63    | -                |
| R095 | drop:LC1:LD:light:-1:L92  | LC1  | LD           | L92                 | 1.63    | -                |
| R096 | drop:LC1:LD:light:-1:L94  | LC1  | LD           | L94                 | 1.63    | -                |
| R097 | drop:LC1:LD:light:-1:L96  | LC1  | LD           | L96                 | 7.81    | -                |
| R098 | trunk:LC1:LD:light:1      | LC1  | LD           | Shared context      | 68.90   | -                |
| R099 | drop:LC1:LD:light:1:L83   | LC1  | LD           | L83                 | 1.63    | -                |
| R100 | drop:LC1:LD:light:1:L85   | LC1  | LD           | L85                 | 1.63    | -                |
| R101 | drop:LC1:LD:light:1:L87   | LC1  | LD           | L87                 | 1.63    | -                |
| R102 | drop:LC1:LD:light:1:L89   | LC1  | LD           | L89                 | 1.63    | -                |
| R103 | drop:LC1:LD:light:1:L91   | LC1  | LD           | L91                 | 1.63    | -                |
| R104 | drop:LC1:LD:light:1:L93   | LC1  | LD           | L93                 | 1.63    | -                |
| R105 | drop:LC1:LD:light:1:L95   | LC1  | LD           | L95                 | 1.63    | -                |
| R106 | drop:LC1:LD:light:1:L97   | LC1  | LD           | L97                 | 7.81    | -                |
| R107 | trunk:LC1:L3:light:-1     | LC1  | L3           | Shared context      | 35.32   | -                |
| R108 | drop:LC1:L3:light:-1:L98  | LC1  | L3           | L98                 | 9.91    | -                |
| R109 | drop:LC1:L3:light:-1:L100 | LC1  | L3           | L100                | 9.19    | -                |
| R110 | drop:LC1:L3:light:-1:L101 | LC1  | L3           | L101                | 9.41    | -                |
| R111 | drop:LC1:L3:light:-1:L104 | LC1  | L3           | L104                | 10.71   | -                |
| R112 | drop:LC1:L3:light:-1:L106 | LC1  | L3           | L106                | 9.55    | -                |
| R113 | drop:LC1:L3:light:-1:L107 | LC1  | L3           | L107                | 8.65    | -                |
| R114 | drop:LC1:L3:light:-1:L108 | LC1  | L3           | L108                | 8.39    | -                |
| R115 | drop:LC1:L3:light:-1:L109 | LC1  | L3           | L109                | 10.07   | -                |
| R116 | drop:LC1:L3:light:-1:L114 | LC1  | L3           | L114                | 8.89    | -                |
| R117 | drop:LC1:L3:light:-1:L115 | LC1  | L3           | L115                | 4.07    | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID           | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|---------------------------|------|--------------|---------------------|---------|------------------|
| R118 | drop:LC1:L3:light:-1:L116 | LC1  | L3           | L116                | 4.42    | -                |
| R119 | drop:LC1:L3:light:-1:L151 | LC1  | L3           | L151                | 6.93    | -                |
| R120 | drop:LC1:L3:light:-1:L152 | LC1  | L3           | L152                | 4.93    | -                |
| R121 | trunk:LC1:L3:light:1      | LC1  | L3           | Shared context      | 41.92   | -                |
| R122 | drop:LC1:L3:light:1:L99   | LC1  | L3           | L99                 | 9.91    | -                |
| R123 | drop:LC1:L3:light:1:L102  | LC1  | L3           | L102                | 9.41    | -                |
| R124 | drop:LC1:L3:light:1:L103  | LC1  | L3           | L103                | 8.31    | -                |
| R125 | drop:LC1:L3:light:1:L105  | LC1  | L3           | L105                | 10.71   | -                |
| R126 | drop:LC1:L3:light:1:L110  | LC1  | L3           | L110                | 9.55    | -                |
| R127 | drop:LC1:L3:light:1:L111  | LC1  | L3           | L111                | 8.65    | -                |
| R128 | drop:LC1:L3:light:1:L112  | LC1  | L3           | L112                | 8.39    | -                |
| R129 | drop:LC1:L3:light:1:L113  | LC1  | L3           | L113                | 10.07   | -                |
| R130 | drop:LC1:L3:light:1:L117  | LC1  | L3           | L117                | 4.07    | -                |
| R131 | drop:LC1:L3:light:1:L118  | LC1  | L3           | L118                | 4.42    | -                |
| R132 | drop:LC1:L3:light:1:L153  | LC1  | L3           | L153                | 6.93    | -                |
| R133 | drop:LC1:L3:light:1:L154  | LC1  | L3           | L154                | 4.93    | -                |
| R134 | trunk:LC1:L4:light:-1     | LC1  | L4           | Shared context      | 62.31   | -                |
| R135 | drop:LC1:L4:light:-1:L119 | LC1  | L4           | L119                | 4.76    | -                |
| R136 | drop:LC1:L4:light:-1:L120 | LC1  | L4           | L120                | 4.76    | -                |
| R137 | drop:LC1:L4:light:-1:L121 | LC1  | L4           | L121                | 4.76    | -                |
| R138 | drop:LC1:L4:light:-1:L122 | LC1  | L4           | L122                | 4.76    | -                |
| R139 | drop:LC1:L4:light:-1:L123 | LC1  | L4           | L123                | 4.76    | -                |
| R140 | drop:LC1:L4:light:-1:L124 | LC1  | L4           | L124                | 4.76    | -                |
| R141 | drop:LC1:L4:light:-1:L125 | LC1  | L4           | L125                | 4.76    | -                |
| R142 | drop:LC1:L4:light:-1:L126 | LC1  | L4           | L126                | 4.76    | -                |
| R143 | drop:LC1:L4:light:-1:L127 | LC1  | L4           | L127                | 4.76    | -                |
| R144 | trunk:LC1:L4:light:1      | LC1  | L4           | Shared context      | 68.91   | -                |
| R145 | drop:LC1:L4:light:1:L128  | LC1  | L4           | L128                | 4.76    | -                |
| R146 | drop:LC1:L4:light:1:L129  | LC1  | L4           | L129                | 4.76    | -                |
| R147 | drop:LC1:L4:light:1:L130  | LC1  | L4           | L130                | 4.76    | -                |
| R148 | drop:LC1:L4:light:1:L131  | LC1  | L4           | L131                | 4.76    | -                |
| R149 | drop:LC1:L4:light:1:L132  | LC1  | L4           | L132                | 4.76    | -                |
| R150 | drop:LC1:L4:light:1:L133  | LC1  | L4           | L133                | 4.76    | -                |
| R151 | drop:LC1:L4:light:1:L134  | LC1  | L4           | L134                | 4.76    | -                |
| R152 | drop:LC1:L4:light:1:L135  | LC1  | L4           | L135                | 4.76    | -                |
| R153 | drop:LC1:L4:light:1:L136  | LC1  | L4           | L136                | 4.76    | -                |
| R154 | trunk:DB2:L9:light:-1     | DB2  | L9           | Shared context      | 12.27   | -                |
| R155 | drop:DB2:L9:light:-1:L137 | DB2  | L9           | L137                | 11.44   | -                |
| R156 | drop:DB2:L9:light:-1:L182 | DB2  | L9           | L182                | 10.55   | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID           | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|---------------------------|------|--------------|---------------------|---------|------------------|
| R157 | drop:DB2:L9:light:-1:L183 | DB2  | L9           | L183                | 6.13    | -                |
| R158 | trunk:DB2:L9:light:1      | DB2  | L9           | Shared context      | 18.87   | -                |
| R159 | drop:DB2:L9:light:1:L138  | DB2  | L9           | L138                | 11.44   | -                |
| R160 | drop:DB2:L9:light:1:L189  | DB2  | L9           | L189                | 6.13    | -                |
| R161 | drop:DB2:L9:light:1:L190  | DB2  | L9           | L190                | 10.55   | -                |
| R162 | trunk:LC1:L5:light:-1     | LC1  | L5           | Shared context      | 57.79   | -                |
| R163 | drop:LC1:L5:light:-1:L139 | LC1  | L5           | L139                | 8.08    | -                |
| R164 | drop:LC1:L5:light:-1:L140 | LC1  | L5           | L140                | 8.08    | -                |
| R165 | drop:LC1:L5:light:-1:L141 | LC1  | L5           | L141                | 8.08    | -                |
| R166 | drop:LC1:L5:light:-1:L142 | LC1  | L5           | L142                | 8.08    | -                |
| R167 | drop:LC1:L5:light:-1:L143 | LC1  | L5           | L143                | 8.08    | -                |
| R168 | drop:LC1:L5:light:-1:L144 | LC1  | L5           | L144                | 8.08    | -                |
| R169 | drop:LC1:L5:light:-1:L184 | LC1  | L5           | L184                | 4.98    | -                |
| R170 | drop:LC1:L5:light:-1:L185 | LC1  | L5           | L185                | 4.98    | -                |
| R171 | drop:LC1:L5:light:-1:L186 | LC1  | L5           | L186                | 4.98    | -                |
| R172 | drop:LC1:L5:light:-1:L187 | LC1  | L5           | L187                | 9.08    | -                |
| R173 | drop:LC1:L5:light:-1:L188 | LC1  | L5           | L188                | 3.79    | -                |
| R174 | trunk:LC1:L5:light:1      | LC1  | L5           | Shared context      | 64.39   | -                |
| R175 | drop:LC1:L5:light:1:L145  | LC1  | L5           | L145                | 8.08    | -                |
| R176 | drop:LC1:L5:light:1:L146  | LC1  | L5           | L146                | 8.08    | -                |
| R177 | drop:LC1:L5:light:1:L147  | LC1  | L5           | L147                | 8.08    | -                |
| R178 | drop:LC1:L5:light:1:L148  | LC1  | L5           | L148                | 8.08    | -                |
| R179 | drop:LC1:L5:light:1:L149  | LC1  | L5           | L149                | 8.08    | -                |
| R180 | drop:LC1:L5:light:1:L150  | LC1  | L5           | L150                | 8.08    | -                |
| R181 | drop:LC1:L5:light:1:L191  | LC1  | L5           | L191                | 4.98    | -                |
| R182 | drop:LC1:L5:light:1:L192  | LC1  | L5           | L192                | 4.98    | -                |
| R183 | drop:LC1:L5:light:1:L193  | LC1  | L5           | L193                | 4.98    | -                |
| R184 | drop:LC1:L5:light:1:L194  | LC1  | L5           | L194                | 9.08    | -                |
| R185 | drop:LC1:L5:light:1:L195  | LC1  | L5           | L195                | 3.79    | -                |
| R186 | trunk:LC1:E1:light:-1     | LC1  | E1           | Shared context      | 69.58   | -                |
| R187 | drop:LC1:E1:light:-1:L155 | LC1  | E1           | L155                | 10.05   | -                |
| R188 | drop:LC1:E1:light:-1:L156 | LC1  | E1           | L156                | 1.50    | -                |
| R189 | drop:LC1:E1:light:-1:L158 | LC1  | E1           | L158                | 1.50    | -                |
| R190 | trunk:LC1:E1:light:1      | LC1  | E1           | Shared context      | 62.10   | -                |
| R191 | drop:LC1:E1:light:1:L157  | LC1  | E1           | L157                | 1.50    | -                |
| R192 | drop:LC1:E1:light:1:L159  | LC1  | E1           | L159                | 1.50    | -                |
| R193 | trunk:DB2:L6:light:-1     | DB2  | L6           | Shared context      | 12.98   | -                |
| R194 | drop:DB2:L6:light:-1:L160 | DB2  | L6           | L160                | 11.60   | -                |
| R195 | drop:DB2:L6:light:-1:L161 | DB2  | L6           | L161                | 12.30   | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID           | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|---------------------------|------|--------------|---------------------|---------|------------------|
| R196 | drop:DB2:L6:light:-1:L162 | DB2  | L6           | L162                | 19.89   | -                |
| R197 | drop:DB2:L6:light:-1:L163 | DB2  | L6           | L163                | 27.68   | -                |
| R198 | drop:DB2:L6:light:-1:L164 | DB2  | L6           | L164                | 33.46   | -                |
| R199 | drop:DB2:L6:light:-1:L165 | DB2  | L6           | L165                | 29.39   | -                |
| R200 | drop:DB2:L6:light:-1:L166 | DB2  | L6           | L166                | 13.60   | -                |
| R201 | drop:DB2:L6:light:-1:L167 | DB2  | L6           | L167                | 12.87   | -                |
| R202 | drop:DB2:L6:light:-1:L168 | DB2  | L6           | L168                | 20.42   | -                |
| R203 | drop:DB2:L6:light:-1:L169 | DB2  | L6           | L169                | 28.19   | -                |
| R204 | drop:DB2:L6:light:-1:L170 | DB2  | L6           | L170                | 5.92    | -                |
| R205 | drop:DB2:L6:light:-1:L222 | DB2  | L6           | L222                | 6.07    | -                |
| R206 | drop:DB2:L6:light:-1:L223 | DB2  | L6           | L223                | 13.76   | -                |
| R207 | trunk:DB2:L6:light:1      | DB2  | L6           | Shared context      | 19.58   | -                |
| R208 | drop:DB2:L6:light:1:L171  | DB2  | L6           | L171                | 11.60   | -                |
| R209 | drop:DB2:L6:light:1:L172  | DB2  | L6           | L172                | 12.30   | -                |
| R210 | drop:DB2:L6:light:1:L173  | DB2  | L6           | L173                | 19.89   | -                |
| R211 | drop:DB2:L6:light:1:L174  | DB2  | L6           | L174                | 27.68   | -                |
| R212 | drop:DB2:L6:light:1:L175  | DB2  | L6           | L175                | 33.46   | -                |
| R213 | drop:DB2:L6:light:1:L176  | DB2  | L6           | L176                | 29.39   | -                |
| R214 | drop:DB2:L6:light:1:L177  | DB2  | L6           | L177                | 13.60   | -                |
| R215 | drop:DB2:L6:light:1:L178  | DB2  | L6           | L178                | 12.87   | -                |
| R216 | drop:DB2:L6:light:1:L179  | DB2  | L6           | L179                | 20.42   | -                |
| R217 | drop:DB2:L6:light:1:L180  | DB2  | L6           | L180                | 28.19   | -                |
| R218 | drop:DB2:L6:light:1:L181  | DB2  | L6           | L181                | 5.92    | -                |
| R219 | drop:DB2:L6:light:1:L224  | DB2  | L6           | L224                | 6.07    | -                |
| R220 | drop:DB2:L6:light:1:L225  | DB2  | L6           | L225                | 13.76   | -                |
| R221 | trunk:DB2:L7:light:-1     | DB2  | L7           | Shared context      | 66.76   | -                |
| R222 | drop:DB2:L7:light:-1:L196 | DB2  | L7           | L196                | 10.46   | -                |
| R223 | drop:DB2:L7:light:-1:L197 | DB2  | L7           | L197                | 1.37    | -                |
| R224 | drop:DB2:L7:light:-1:L198 | DB2  | L7           | L198                | 1.37    | -                |
| R225 | drop:DB2:L7:light:-1:L199 | DB2  | L7           | L199                | 4.67    | -                |
| R226 | drop:DB2:L7:light:-1:L200 | DB2  | L7           | L200                | 4.67    | -                |
| R227 | drop:DB2:L7:light:-1:L201 | DB2  | L7           | L201                | 8.16    | -                |
| R228 | drop:DB2:L7:light:-1:L202 | DB2  | L7           | L202                | 8.58    | -                |
| R229 | drop:DB2:L7:light:-1:L203 | DB2  | L7           | L203                | 13.00   | -                |
| R230 | drop:DB2:L7:light:-1:L204 | DB2  | L7           | L204                | 9.80    | -                |
| R231 | drop:DB2:L7:light:-1:L205 | DB2  | L7           | L205                | 14.22   | -                |
| R232 | drop:DB2:L7:light:-1:L206 | DB2  | L7           | L206                | 17.38   | -                |
| R233 | drop:DB2:L7:light:-1:L207 | DB2  | L7           | L207                | 21.80   | -                |
| R234 | drop:DB2:L7:light:-1:L219 | DB2  | L7           | L219                | 10.08   | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID           | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|---------------------------|------|--------------|---------------------|---------|------------------|
| R235 | drop:DB2:L7:light:-1:L220 | DB2  | L7           | L220                | 3.75    | -                |
| R236 | trunk:DB2:L7:light:1      | DB2  | L7           | Shared context      | 73.36   | -                |
| R237 | drop:DB2:L7:light:1:L208  | DB2  | L7           | L208                | 1.37    | -                |
| R238 | drop:DB2:L7:light:1:L209  | DB2  | L7           | L209                | 1.37    | -                |
| R239 | drop:DB2:L7:light:1:L210  | DB2  | L7           | L210                | 4.67    | -                |
| R240 | drop:DB2:L7:light:1:L211  | DB2  | L7           | L211                | 4.67    | -                |
| R241 | drop:DB2:L7:light:1:L212  | DB2  | L7           | L212                | 8.16    | -                |
| R242 | drop:DB2:L7:light:1:L213  | DB2  | L7           | L213                | 8.58    | -                |
| R243 | drop:DB2:L7:light:1:L214  | DB2  | L7           | L214                | 13.00   | -                |
| R244 | drop:DB2:L7:light:1:L215  | DB2  | L7           | L215                | 9.80    | -                |
| R245 | drop:DB2:L7:light:1:L216  | DB2  | L7           | L216                | 14.22   | -                |
| R246 | drop:DB2:L7:light:1:L217  | DB2  | L7           | L217                | 17.38   | -                |
| R247 | drop:DB2:L7:light:1:L218  | DB2  | L7           | L218                | 21.80   | -                |
| R248 | drop:DB2:L7:light:1:L221  | DB2  | L7           | L221                | 3.75    | -                |
| R249 | trunk:FC1:F1:fan:-1       | FC1  | F1           | Shared context      | 64.03   | -                |
| R250 | drop:FC1:F1:fan:-1:F226   | FC1  | F1           | F226                | 11.29   | -                |
| R251 | drop:FC1:F1:fan:-1:F228   | FC1  | F1           | F228                | 11.29   | -                |
| R252 | drop:FC1:F1:fan:-1:F230   | FC1  | F1           | F230                | 11.28   | -                |
| R253 | drop:FC1:F1:fan:-1:F232   | FC1  | F1           | F232                | 11.29   | -                |
| R254 | drop:FC1:F1:fan:-1:F234   | FC1  | F1           | F234                | 11.29   | -                |
| R255 | drop:FC1:F1:fan:-1:F236   | FC1  | F1           | F236                | 11.29   | -                |
| R256 | drop:FC1:F1:fan:-1:F238   | FC1  | F1           | F238                | 11.28   | -                |
| R257 | trunk:FC1:F1:fan:1        | FC1  | F1           | Shared context      | 70.63   | -                |
| R258 | drop:FC1:F1:fan:1:F227    | FC1  | F1           | F227                | 11.29   | -                |
| R259 | drop:FC1:F1:fan:1:F229    | FC1  | F1           | F229                | 11.29   | -                |
| R260 | drop:FC1:F1:fan:1:F231    | FC1  | F1           | F231                | 11.28   | -                |
| R261 | drop:FC1:F1:fan:1:F233    | FC1  | F1           | F233                | 11.29   | -                |
| R262 | drop:FC1:F1:fan:1:F235    | FC1  | F1           | F235                | 11.29   | -                |
| R263 | drop:FC1:F1:fan:1:F237    | FC1  | F1           | F237                | 11.29   | -                |
| R264 | drop:FC1:F1:fan:1:F239    | FC1  | F1           | F239                | 11.28   | -                |
| R265 | trunk:FC1:F5:fan:-1       | FC1  | F5           | Shared context      | 33.83   | -                |
| R266 | drop:FC1:F5:fan:-1:F240   | FC1  | F5           | F240                | 9.26    | -                |
| R267 | drop:FC1:F5:fan:-1:F241   | FC1  | F5           | F241                | 9.26    | -                |
| R268 | trunk:FC1:F5:fan:1        | FC1  | F5           | Shared context      | 40.43   | -                |
| R269 | drop:FC1:F5:fan:1:F242    | FC1  | F5           | F242                | 9.26    | -                |
| R270 | drop:FC1:F5:fan:1:F243    | FC1  | F5           | F243                | 9.26    | -                |
| R271 | trunk:FC1:F2:fan:-1       | FC1  | F2           | Shared context      | 67.58   | -                |
| R272 | drop:FC1:F2:fan:-1:F244   | FC1  | F2           | F244                | 0.75    | -                |
| R273 | drop:FC1:F2:fan:-1:F246   | FC1  | F2           | F246                | 0.75    | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID                | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|--------------------------------|------|--------------|---------------------|---------|------------------|
| R274 | drop:FC1:F2:fan:-1:F248        | FC1  | F2           | F248                | 0.75    | -                |
| R275 | drop:FC1:F2:fan:-1:F-NAVE-B-2P | FC1  | F2           | F-NAVE-B-2P         | 0.75    | -                |
| R276 | drop:FC1:F2:fan:-1:F-NAVE-B-3  | FC1  | F2           | F-NAVE-B-3          | 0.75    | -                |
| R277 | drop:FC1:F2:fan:-1:F-NAVE-B-5  | FC1  | F2           | F-NAVE-B-5          | 0.75    | -                |
| R278 | drop:FC1:F2:fan:-1:F-NAVE-B-7  | FC1  | F2           | F-NAVE-B-7          | 0.75    | -                |
| R279 | drop:FC1:F2:fan:-1:F-NAVE-B-9  | FC1  | F2           | F-NAVE-B-9          | 0.75    | -                |
| R280 | trunk:FC1:F2:fan:1             | FC1  | F2           | Shared context      | 74.18   | -                |
| R281 | drop:FC1:F2:fan:1:F245         | FC1  | F2           | F245                | 0.75    | -                |
| R282 | drop:FC1:F2:fan:1:F247         | FC1  | F2           | F247                | 0.75    | -                |
| R283 | drop:FC1:F2:fan:1:F249         | FC1  | F2           | F249                | 0.75    | -                |
| R284 | drop:FC1:F2:fan:1:F-NAVE-H-2P  | FC1  | F2           | F-NAVE-H-2P         | 0.75    | -                |
| R285 | drop:FC1:F2:fan:1:F-NAVE-H-3   | FC1  | F2           | F-NAVE-H-3          | 0.75    | -                |
| R286 | drop:FC1:F2:fan:1:F-NAVE-H-5   | FC1  | F2           | F-NAVE-H-5          | 0.75    | -                |
| R287 | drop:FC1:F2:fan:1:F-NAVE-H-7   | FC1  | F2           | F-NAVE-H-7          | 0.75    | -                |
| R288 | drop:FC1:F2:fan:1:F-NAVE-H-9   | FC1  | F2           | F-NAVE-H-9          | 0.75    | -                |
| R289 | trunk:DB2:F4:fan:-1            | DB2  | F4           | Shared context      | 12.52   | -                |
| R290 | drop:DB2:F4:fan:-1:F250        | DB2  | F4           | F250                | 7.92    | -                |
| R291 | trunk:DB2:F4:fan:1             | DB2  | F4           | Shared context      | 19.12   | -                |
| R292 | drop:DB2:F4:fan:1:F251         | DB2  | F4           | F251                | 7.92    | -                |
| R293 | trunk:FC1:V1:fan:-1            | FC1  | V1           | Shared context      | 67.55   | -                |
| R294 | drop:FC1:V1:fan:-1:F252        | FC1  | V1           | F252                | 8.69    | -                |
| R295 | drop:FC1:V1:fan:-1:F253        | FC1  | V1           | F253                | 11.83   | -                |
| R296 | drop:FC1:V1:fan:-1:F256        | FC1  | V1           | F256                | 6.97    | -                |
| R297 | drop:FC1:V1:fan:-1:F257        | FC1  | V1           | F257                | 6.97    | -                |
| R298 | drop:FC1:V1:fan:-1:F260        | FC1  | V1           | F260                | 10.20   | -                |
| R299 | trunk:FC1:V1:fan:1             | FC1  | V1           | Shared context      | 74.15   | -                |
| R300 | drop:FC1:V1:fan:1:F254         | FC1  | V1           | F254                | 11.83   | -                |
| R301 | drop:FC1:V1:fan:1:F255         | FC1  | V1           | F255                | 8.69    | -                |
| R302 | drop:FC1:V1:fan:1:F258         | FC1  | V1           | F258                | 6.97    | -                |
| R303 | drop:FC1:V1:fan:1:F259         | FC1  | V1           | F259                | 6.97    | -                |
| R304 | trunk:AV1:A1:audio:-1          | AV1  | A1           | Shared context      | 61.27   | -                |
| R305 | drop:AV1:A1:audio:-1:S261      | AV1  | A1           | S261                | 2.53    | 63.81            |
| R306 | drop:AV1:A1:audio:-1:S263      | AV1  | A1           | S263                | 2.53    | 59.31            |
| R307 | drop:AV1:A1:audio:-1:S265      | AV1  | A1           | S265                | 2.53    | 54.81            |
| R308 | drop:AV1:A1:audio:-1:S267      | AV1  | A1           | S267                | 2.53    | 50.31            |
| R309 | drop:AV1:A1:audio:-1:S269      | AV1  | A1           | S269                | 2.53    | 45.81            |
| R310 | drop:AV1:A1:audio:-1:S271      | AV1  | A1           | S271                | 2.53    | 41.31            |
| R311 | drop:AV1:A1:audio:-1:S276      | AV1  | A1           | S276                | 8.04    | 37.01            |
| R312 | trunk:AV1:A1:audio:1           | AV1  | A1           | Shared context      | 67.87   | -                |

Unique route index

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref  | Stable route ID           | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|------|---------------------------|------|--------------|---------------------|---------|------------------|
| R313 | drop:AV1:A1:audio:1:S262  | AV1  | A1           | S262                | 2.53    | 70.41            |
| R314 | drop:AV1:A1:audio:1:S264  | AV1  | A1           | S264                | 2.53    | 65.91            |
| R315 | drop:AV1:A1:audio:1:S266  | AV1  | A1           | S266                | 2.53    | 61.41            |
| R316 | drop:AV1:A1:audio:1:S268  | AV1  | A1           | S268                | 2.53    | 56.91            |
| R317 | drop:AV1:A1:audio:1:S270  | AV1  | A1           | S270                | 2.53    | 52.41            |
| R318 | drop:AV1:A1:audio:1:S272  | AV1  | A1           | S272                | 2.53    | 47.91            |
| R319 | drop:AV1:A1:audio:1:S278  | AV1  | A1           | S278                | 8.04    | 43.61            |
| R320 | trunk:AV1:A5:audio:-1     | AV1  | A5           | Shared context      | 73.06   | -                |
| R321 | drop:AV1:A5:audio:-1:S273 | AV1  | A5           | S273                | 10.61   | 83.68            |
| R322 | trunk:AV1:A5:audio:1      | AV1  | A5           | Shared context      | 79.66   | -                |
| R323 | drop:AV1:A5:audio:1:S274  | AV1  | A5           | S274                | 10.61   | 90.28            |
| R324 | trunk:AV1:A2:audio:-1     | AV1  | A2           | Shared context      | 62.21   | -                |
| R325 | drop:AV1:A2:audio:-1:S279 | AV1  | A2           | S279                | 6.94    | 69.15            |
| R326 | drop:AV1:A2:audio:-1:S280 | AV1  | A2           | S280                | 6.94    | 55.65            |
| R327 | trunk:AV1:A2:audio:1      | AV1  | A2           | Shared context      | 68.81   | -                |
| R328 | drop:AV1:A2:audio:1:S281  | AV1  | A2           | S281                | 6.94    | 75.75            |
| R329 | drop:AV1:A2:audio:1:S282  | AV1  | A2           | S282                | 6.94    | 62.25            |
| R330 | trunk:AV1:A3:audio:-1     | AV1  | A3           | Shared context      | 73.38   | -                |
| R331 | drop:AV1:A3:audio:-1:S283 | AV1  | A3           | S283                | 6.82    | 80.20            |
| R332 | drop:AV1:A3:audio:-1:S284 | AV1  | A3           | S284                | 11.35   | 84.73            |
| R333 | drop:AV1:A3:audio:-1:S285 | AV1  | A3           | S285                | 5.52    | 62.28            |
| R334 | drop:AV1:A3:audio:-1:S286 | AV1  | A3           | S286                | 5.52    | 48.78            |
| R335 | trunk:AV1:A3:audio:1      | AV1  | A3           | Shared context      | 79.98   | -                |
| R336 | drop:AV1:A3:audio:1:S287  | AV1  | A3           | S287                | 6.82    | 86.80            |
| R337 | drop:AV1:A3:audio:1:S288  | AV1  | A3           | S288                | 11.35   | 91.33            |
| R338 | drop:AV1:A3:audio:1:S289  | AV1  | A3           | S289                | 5.52    | 68.88            |
| R339 | drop:AV1:A3:audio:1:S290  | AV1  | A3           | S290                | 5.52    | 55.38            |
| R340 | trunk:AV1:MIC:mic:-1      | AV1  | MIC          | Shared context      | 11.91   | -                |
| R341 | drop:AV1:MIC:mic:-1:S291  | AV1  | MIC          | S291                | 3.58    | 15.49            |
| R342 | trunk:AV1:MIC:mic:1       | AV1  | MIC          | Shared context      | 5.74    | -                |
| R343 | drop:AV1:MIC:mic:1:S292   | AV1  | MIC          | S292                | 2.80    | 8.54             |

3D installation planning sequence

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

01 / Survey and coordinate

3D layer: all / building

Check grid, floor datum, equipment positions and all concealed routes against the measured building. Use the circuit sheets to record corrections.

HOLD / responsible specialist release required

Survey and coordinated light, sound, air, access and concealment review must precede physical setting-out. This default layout still has unmet targets.

02 / Boards and feeder paths

3D layer: distribution / systems

Review DB-1 to DB-2, LC-1, FC-1 and AV-1 paths. Confirm enclosure access and the proposed supply/control separation.

HOLD / responsible specialist release required

Electrical designer: supply, phases, earthing, fault level, protection, cable sizes, board capacity and final single-line diagram are pending. Do not energize from this model.

03 / Coordinate concealed containment

3D layer: all / systems

Review all shared corridors and individual branches together. Select each run for its vertices and height; compare with structure and finished surfaces before closing any cover.

HOLD / responsible specialist release required

Containment size, power/signal separation, fixings, fire stopping, access panels and penetrations require coordinated approval. Coloured routes are enlarged display lines, not cable diameters.

3D installation planning sequence

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

04 / Lighting routes and fittings

3D layer: lighting / systems

Review each light circuit and its LC-1 or DB-2 supply. Check chandelier support, aim, driver access, fan-blade interaction and labels against the matching paper sheet.

HOLD / responsible specialist release required

Selected-product photometry, support design, control channels, dimming compatibility and installation details remain pending. Review current per-seat lighting failures in the matching calculation report.

05 / Sound and microphone connections

3D layer: sound / systems

Trace speaker and microphone lines to AV-1 separately from rack mains. Review polarity, intended zones, furniture/floor interfaces and service access.

HOLD / responsible specialist release required

Amplifier topology, impedance/line voltage, connectors, shielding and separation are pending. Passive speaker ratings are not mains loads; feedback and wing clarity targets remain unmet.

06 / Fans and ventilation

3D layer: air / systems

Review FC-1 and DB-2 routes, motor control compatibility and air paths with the lighting and sound systems. Keep the central processional view clear of visible fans and supports.

HOLD / responsible specialist release required

Current geometry is a study, not an accepted fan installation. Mounting, guards/clearance, duty points, make-up air, noise, concealment and maintenance access need specialist approval.

3D installation planning sequence

DESIGN DEVELOPMENT  
NOT FOR CONSTRUCTION

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

07 / Exit signs and required safety functions

3D layer: exit / systems

Identify E1 separately from discretionary light scenes. Coordinate the required emergency system, operating labels and test access with the responsible designer.

HOLD / responsible specialist release required

Emergency supply, duration, coverage and failure behavior are not established by the simulator. No scene or walkthrough step authorizes isolation of required safety functions.

08 / Powered decoration and interfaces

3D layer: decoration / systems

Review decorative loads and concealed feeds, heat dissipation, isolation and replacement access without obstructing worship or other systems.

HOLD / responsible specialist release required

Final products, loads, supports, material/fire compatibility and control interfaces need approval. Empty stages may occur in edited layouts.

09 / Inspect, test and hand over

3D layer: all / building

After approved installation, the responsible team must record electrical verification, manual/scene and failure tests, light/sound/air measurements, as-built IDs and maintenance instructions.

HOLD / responsible specialist release required

No commissioning or construction approval is recorded here. Progress through these review steps does not release a hold or mark any work installed.