Electrical routes / printable review set

Default model export - circuit plans, heights, equipment coordinates and route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Read the plan, then trace the same ID in 3D

390 connected installed-study equipment / 449 unique routes / 31 drawing scopes. Hidden alternatives and non-electrical furniture are excluded. Shared feeders and trunks repeat as context on circuit sheets; quantities are owned once in the route index.

Print and measure

Use A3 landscape at 100%, with no fit-to-page. The line below must measure 100 mm. Plans and height projections have separate stated scales. Never scale from a resized copy.

Coordinate basis

X: axis 1 toward sanctuary. Y: height above nave finished floor. Z: centre between D/E; negative toward B, positive toward H. Grid is a model transcription, not a measured floor plan or installation set-out.

Setting out from the grid

Each equipment point and route vertex is also given from its nearest grid axis: 5+1.20/D-0.35 h+2.40 = 1.20 m past axis 5 toward the sanctuary, 0.35 m from axis D toward B, 2.40 m above nave floor +0.000. On the dais (+0.80) or side floors (+0.16), subtract the local floor level. Check the axes on site first.

Route reading

Solid: power/feed. Dashed: loudspeaker audio. Dotted: microphone. Circle: equipment. Square: enclosure. Projection crossings are not junctions. Overlapping vertical paths require the route-vertex CSV and 3D review.

Length basis

Route length = sum of 3D segment lengths. No spare, termination or installation allowances. Audio home run = branch plus its own upstream path; do not add shared bundle lengths again. This is not a conductor/cable take-off.

Stop before physical work

Cable sizes, protection, supply/earthing/fault level, product data, supports, containment and fire stopping, control channels, life-safety functions and commissioning approval are pending. Do not drill timber or close concealed works from these sheets.

100 mm print calibration

Sheet index / circuit lookup

E-001 Distribution and feeders
E-002 L3 / Sanctuary
E-003 L2 / Nave / 4 rear bays (2'-6)
E-004 L1 / Nave / 3 front bays (6-9)
E-005 LA / Roof uplight
E-006 L4 / Circulation & verandas
E-007 L9 / Front stage & central door
E-008 L5 / Steps & paths
E-009 E1 / Exit signs
E-010 L6 / Facade & towers
E-011 L7 / Festival exterior (strings & tower floods)
E-012 F1 / Ceiling fans
E-013 F5 / Wing wall fans / held review
E-014 F2 / Wall fans
E-015 F4 / Entrance circulators (trial)
E-016 V1 / Exhaust / front gable
E-017 V2 / Exhaust / wing gables
E-018 V3 / Exhaust / service room
E-019 A1 / Main & delay loudspeakers
E-020 A5 / Rear fill (crowded feasts)
E-021 A2 / Veranda fill
E-022 A3 / Courtyard
E-023 Microphones
E-024 P1 / Sockets / side B (sanctuary + nave)
E-025 P3 / Event power / tower B
E-026 P2 / Sockets / side H (sanctuary + nave)
E-027 P4 / Event power / tower H
E-028 L10 / Facade statues & candles
E-029 LS / Stations of the Cross candles
E-030 L8 / Wings / choir & ministers
E-031 LD / Column up/down lights

After circuit sheets: TW-01 tower fronts with riser clearances, equipment naming schedule (EQ), unique route index (RI), installation note key (IM), route set-out schedule (RS) and the same nine-stage 3D coordination sequence (SQ). PDF bookmarks jump to each sheet.

Engineering baseline: feedback and wing speech clarity remain below targets; some seats miss the lighting brief. Fan performance, concealment, emergency design and installation access remain unverified. See docs/engineering/baseline.md and issues.md.

Companion files: drawing-index.json, model-snapshot.json, route-vertices.csv, equipment-coordinates.csv and manifest.json. Hashes bind this print set to its source files. Saved browser layouts are a different configuration.

THACH BI CHURCH

Distribution and feeders


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-001


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

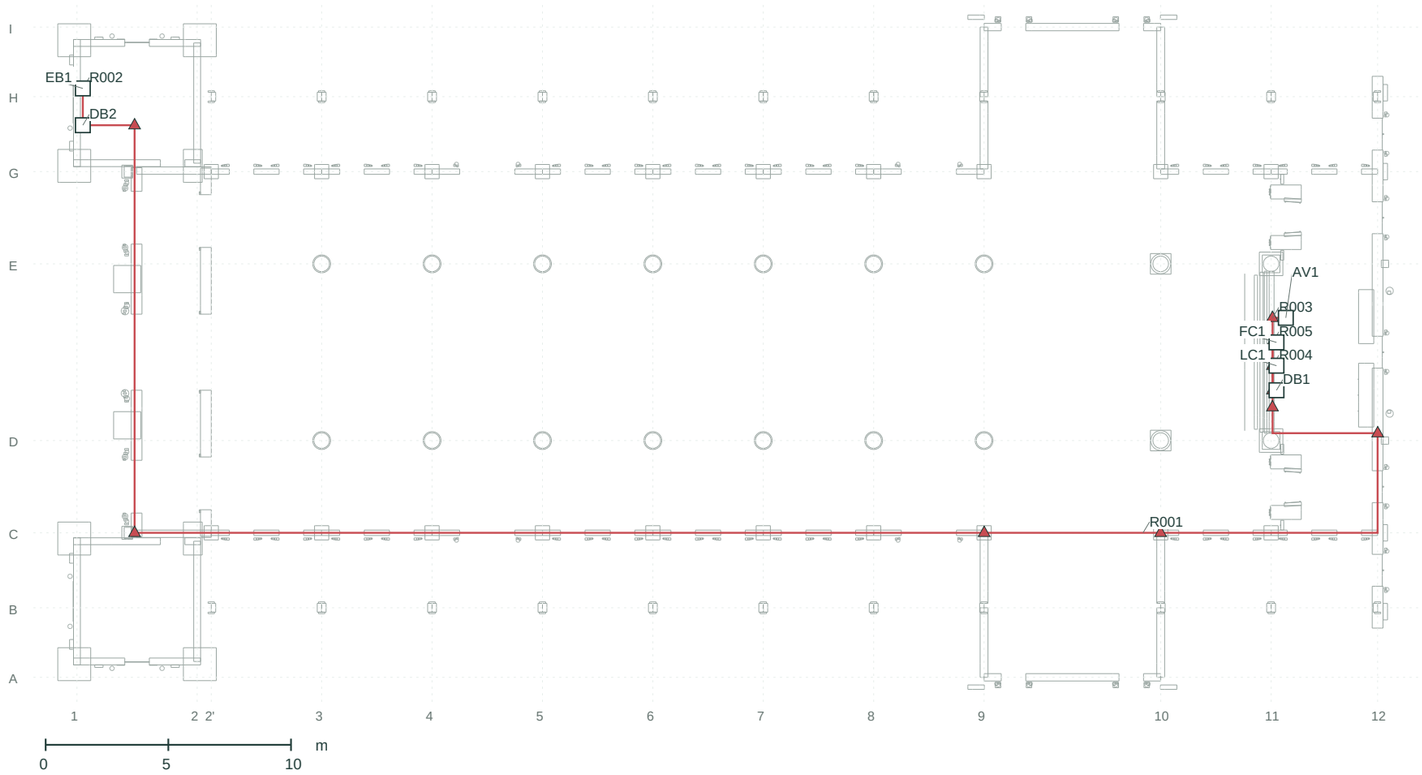

HEIGHT PROJECTION / X-Y / all Z superimposed

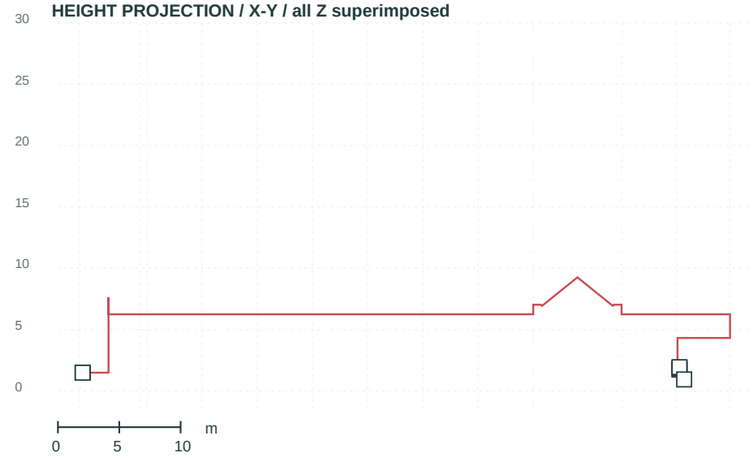

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
Related enclosures					
DB1	48.895	1.750	-1.550	11+0.22/D+2.05	
DB2	0.240	1.500	9.250	1+0.24/H-1.16	
EB1	0.240	1.500	10.750	1+0.24/H+0.34	
LC1	48.895	1.850	-0.550	11+0.22/D+3.05	
FC1	48.895	1.950	0.400	11+0.22/E-3.20	
AV1	49.275	0.950	1.400	11+0.60/E-2.20	

0 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I21, I26 (key on sheet IM-01).

THACH BI CHURCH

L3 / Sanctuary


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-002


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

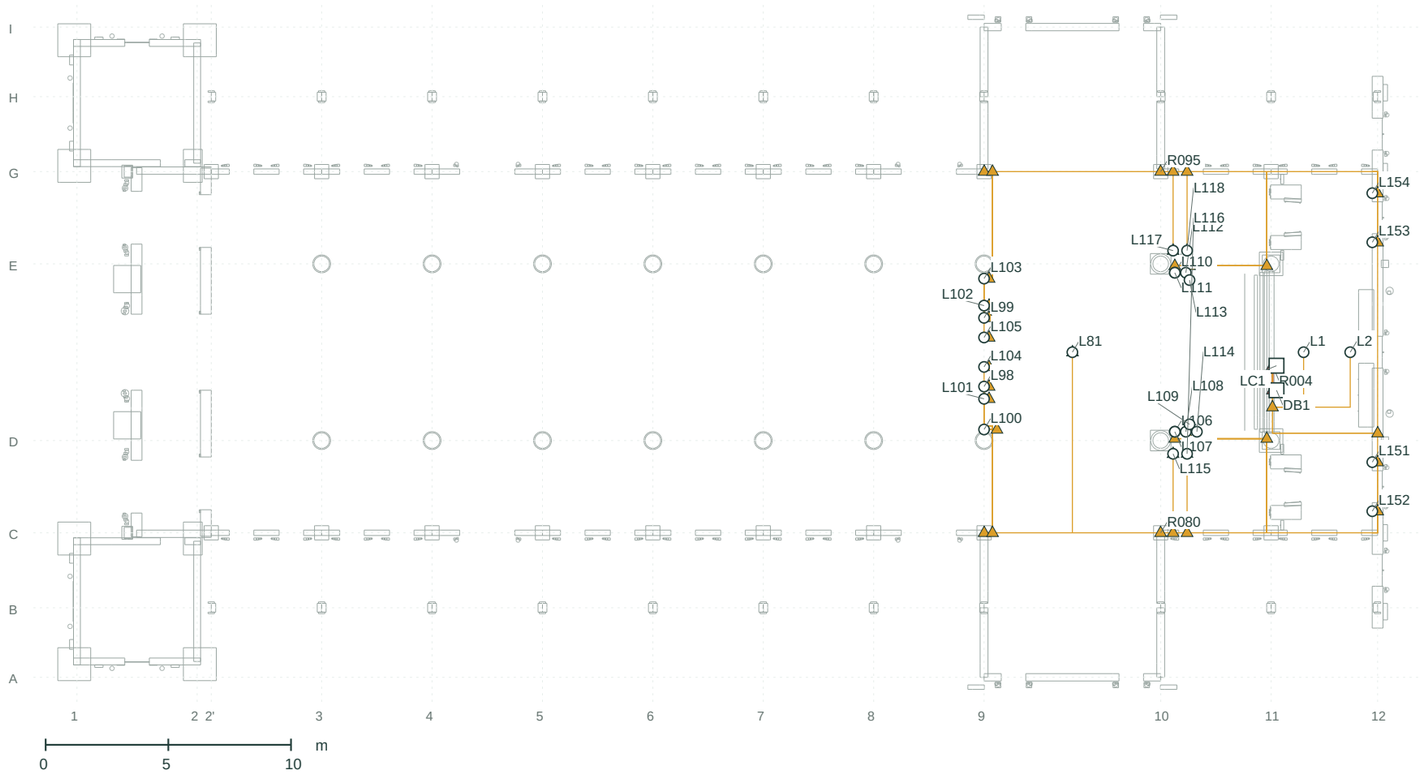

HEIGHT PROJECTION / X-Y / all Z superimposed

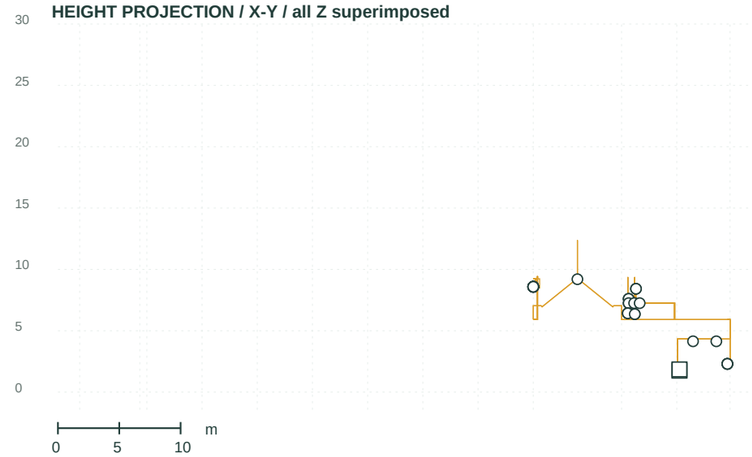

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I01, I02, I03, I06, I14, I17, I25, I27 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L1	50.000	4.140	0.000	11+1.33/D+3.60	R006
L2	51.900	4.140	0.000	12-1.12/D+3.60	R007
L81	40.575	9.200	0.000	9+3.60/D+3.60	R081
L98	36.975	8.585	-1.400	9+0.00/D+2.20	R082
L99	36.975	8.585	1.400	9+0.00/E-2.20	R096
L100	36.975	8.585	-3.150	9+0.00/D+0.45	R083
L101	36.975	8.585	-1.900	9+0.00/D+1.70	R084
L102	36.975	8.585	1.900	9+0.00/E-1.70	R097
L103	36.975	8.585	3.000	9+0.00/E-0.60	R098
L104	36.975	8.585	-0.600	9+0.00/D+3.00	R085
L105	36.975	8.585	0.600	9+0.00/E-3.00	R099
L106	44.750	7.600	-3.240	10+0.58/D+0.36	R086
L107	44.750	7.250	-3.240	10+0.58/D+0.36	R087
L108	45.200	7.250	-3.240	10+1.03/D+0.36	R088
L109	45.350	8.420	-2.940	10+1.18/D+0.66	R089
L110	44.750	7.600	3.240	10+0.58/E-0.36	R100
L111	44.750	7.250	3.240	10+0.58/E-0.36	R101
L112	45.200	7.250	3.240	10+1.03/E-0.36	R102
L113	45.350	8.420	2.940	10+1.18/E-0.66	R103
L114	45.650	7.250	-3.240	10+1.48/D+0.36	R090
L115	44.680	6.424	-4.140	10+0.51/D-0.54	R091
L116	45.250	6.356	-4.140	10+1.08/D-0.54	R092
L117	44.680	6.424	4.140	10+0.51/E+0.54	R104
L118	45.250	6.356	4.140	10+1.08/E+0.54	R105
L151	52.800	2.300	-4.480	12-0.22/D-0.88	R093
L152	52.800	2.300	-6.480	12-0.22/C+0.88	R094
L153	52.800	2.300	4.480	12-0.22/E+0.88	R106
L154	52.800	2.300	6.480	12-0.22/G-0.88	R107

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

Source commit 10e5ce1806 + file hashes in manifest | Routing 2026-10-18-concealed-2

MODEL TRANSCRIPTION / DERIVED. Metres; displayed decimals are not survey accuracy. Review before installation.

A3 / sheet 03

Print 100% / no fit-to-page

THACH BI CHURCH

L2 / Nave / 4 rear bays (2'-6)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-003


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

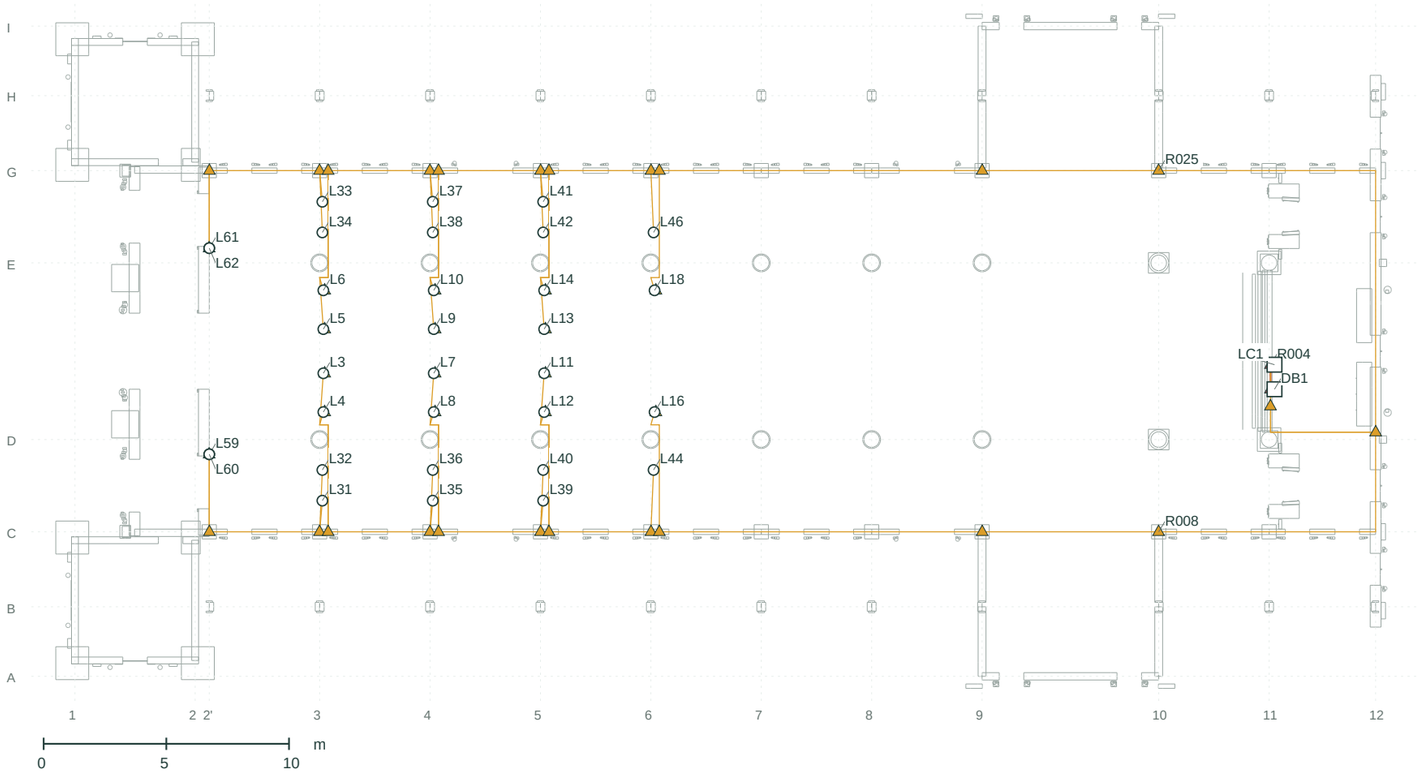

HEIGHT PROJECTION / X-Y / all Z superimposed

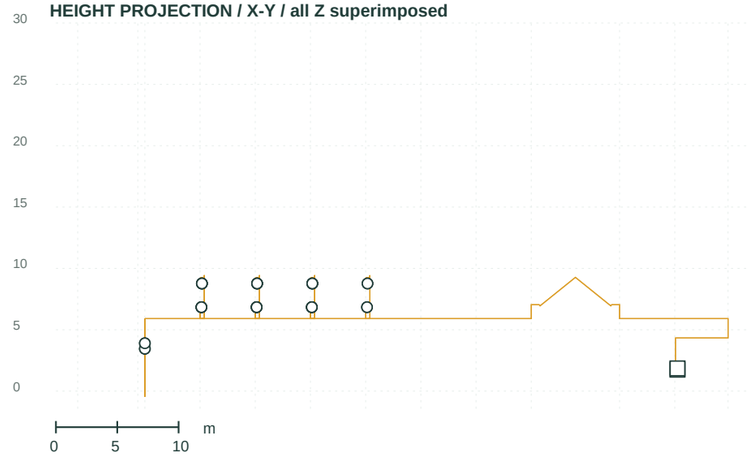

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I02, I14, I16, I25 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L3	10.125	8.770	-0.900	3+0.15/D+2.70	R009
L4	10.125	8.770	-2.480	3+0.15/D+1.12	R010
L5	10.125	8.770	0.900	3+0.15/E-2.70	R026
L6	10.125	8.770	2.480	3+0.15/E-1.12	R027
L7	14.625	8.770	-0.900	4+0.15/D+2.70	R011
L8	14.625	8.770	-2.480	4+0.15/D+1.12	R012
L9	14.625	8.770	0.900	4+0.15/E-2.70	R028
L10	14.625	8.770	2.480	4+0.15/E-1.12	R029
L11	19.125	8.770	-0.900	5+0.15/D+2.70	R013
L12	19.125	8.770	-2.480	5+0.15/D+1.12	R014
L13	19.125	8.770	0.900	5+0.15/E-2.70	R030
L14	19.125	8.770	2.480	5+0.15/E-1.12	R031
L16	23.625	8.770	-2.480	6+0.15/D+1.12	R015
L18	23.625	8.770	2.480	6+0.15/E-1.12	R032
L31	10.085	6.840	-6.090	3+0.11/C+1.27	R016
L32	10.085	6.840	-4.840	3+0.11/D-1.24	R017
L33	10.085	6.840	6.090	3+0.11/G-1.27	R033
L34	10.085	6.840	4.840	3+0.11/E+1.24	R034
L35	14.585	6.840	-6.090	4+0.11/C+1.27	R018
L36	14.585	6.840	-4.840	4+0.11/D-1.24	R019
L37	14.585	6.840	6.090	4+0.11/G-1.27	R035
L38	14.585	6.840	4.840	4+0.11/E+1.24	R036
L39	19.085	6.840	-6.090	5+0.11/C+1.27	R020
L40	19.085	6.840	-4.840	5+0.11/D-1.24	R021
L41	19.085	6.840	6.090	5+0.11/G-1.27	R037
L42	19.085	6.840	4.840	5+0.11/E+1.24	R038
L44	23.585	6.840	-4.840	6+0.11/D-1.24	R022
L46	23.585	6.840	4.840	6+0.11/E+1.24	R039
L59	5.475	3.450	-4.200	2'+0.00/D-0.60	R023
L60	5.475	3.900	-4.200	2'+0.00/D-0.60	R024
L61	5.475	3.450	4.200	2'+0.00/E+0.60	R040
L62	5.475	3.900	4.200	2'+0.00/E+0.60	R041

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

32 equipment / 35 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

Source commit 10e5ce1806 + file hashes in manifest | Routing 2026-10-18-concealed-2

MODEL TRANSCRIPTION / DERIVED. Metres; displayed decimals are not survey accuracy. Review before installation.

A3 / sheet 04

Print 100% / no fit-to-page

THACH BI CHURCH

L1 / Nave / 3 front bays (6-9)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-004


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

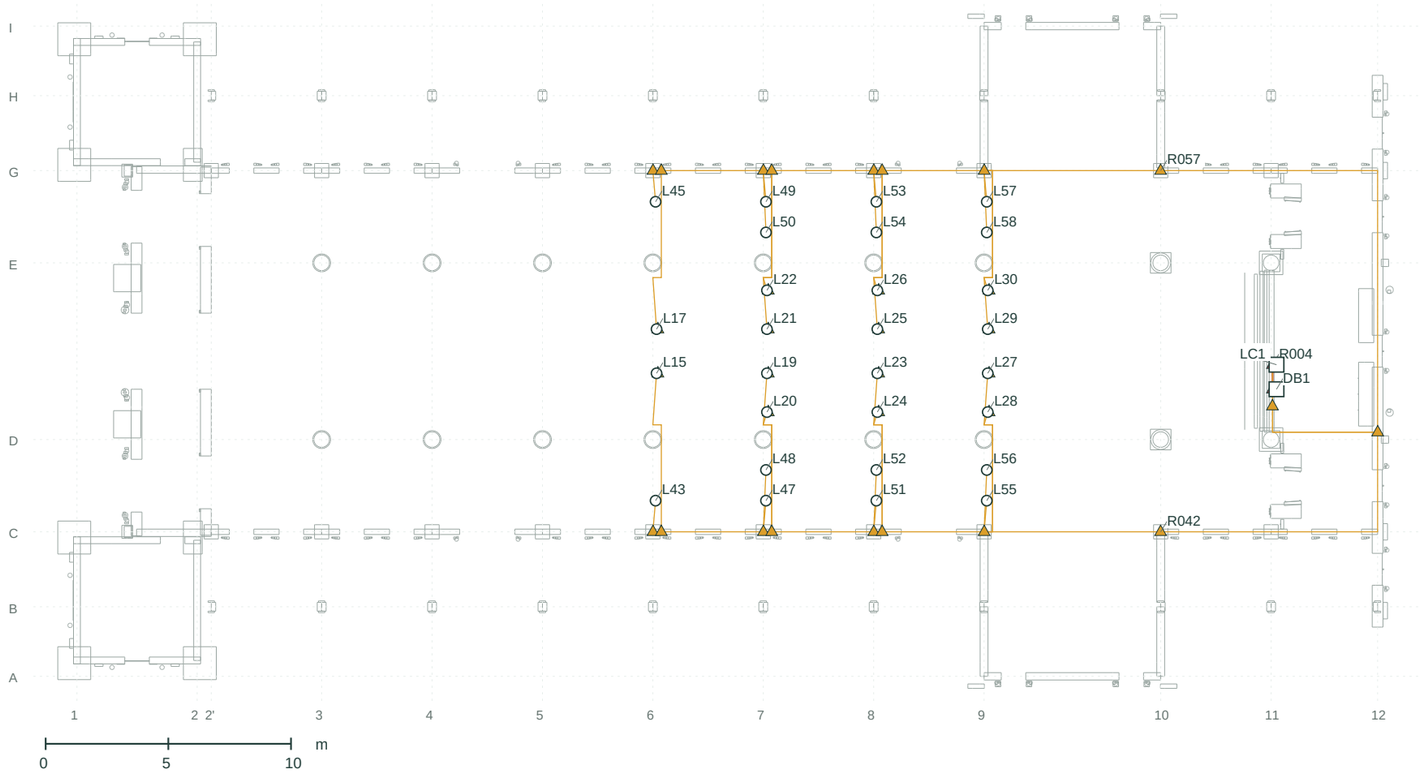

HEIGHT PROJECTION / X-Y / all Z superimposed

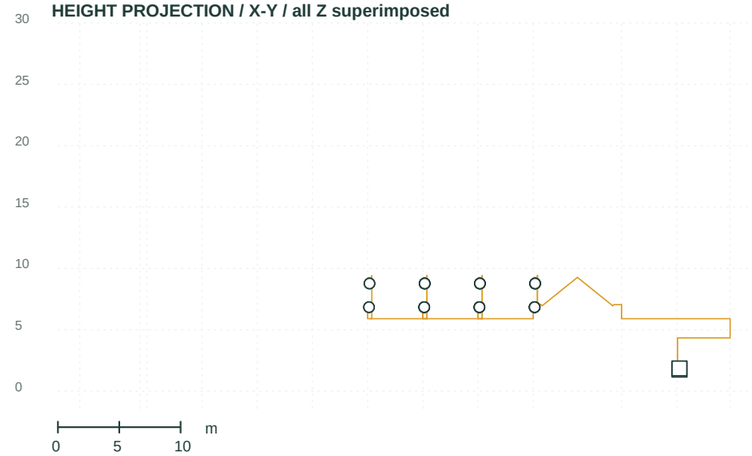

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I02, I14, I25 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L15	23.625	8.770	-0.900	6+0.15/D+2.70	R043
L17	23.625	8.770	0.900	6+0.15/E-2.70	R058
L19	28.125	8.770	-0.900	7+0.15/D+2.70	R044
L20	28.125	8.770	-2.480	7+0.15/D+1.12	R045
L21	28.125	8.770	0.900	7+0.15/E-2.70	R059
L22	28.125	8.770	2.480	7+0.15/E-1.12	R060
L23	32.625	8.770	-0.900	8+0.15/D+2.70	R046
L24	32.625	8.770	-2.480	8+0.15/D+1.12	R047
L25	32.625	8.770	0.900	8+0.15/E-2.70	R061
L26	32.625	8.770	2.480	8+0.15/E-1.12	R062
L27	37.125	8.770	-0.900	9+0.15/D+2.70	R048
L28	37.125	8.770	-2.480	9+0.15/D+1.12	R049
L29	37.125	8.770	0.900	9+0.15/E-2.70	R063
L30	37.125	8.770	2.480	9+0.15/E-1.12	R064
L43	23.585	6.840	-6.090	6+0.11/C+1.27	R050
L45	23.585	6.840	6.090	6+0.11/G-1.27	R065
L47	28.085	6.840	-6.090	7+0.11/C+1.27	R051
L48	28.085	6.840	-4.840	7+0.11/D-1.24	R052
L49	28.085	6.840	6.090	7+0.11/G-1.27	R066
L50	28.085	6.840	4.840	7+0.11/E+1.24	R067
L51	32.585	6.840	-6.090	8+0.11/C+1.27	R053
L52	32.585	6.840	-4.840	8+0.11/D-1.24	R054
L53	32.585	6.840	6.090	8+0.11/G-1.27	R068
L54	32.585	6.840	4.840	8+0.11/E+1.24	R069
L55	37.085	6.840	-6.090	9+0.11/C+1.27	R055
L56	37.085	6.840	-4.840	9+0.11/D-1.24	R056
L57	37.085	6.840	6.090	9+0.11/G-1.27	R070
L58	37.085	6.840	4.840	9+0.11/E+1.24	R071

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

Source commit 10e5ce1806 + file hashes in manifest | Routing 2026-10-18-concealed-2

MODEL TRANSCRIPTION / DERIVED. Metres; displayed decimals are not survey accuracy. Review before installation.

A3 / sheet 05

Print 100% / no fit-to-page

THACH BI CHURCH

LA / Roof uplight


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-005


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

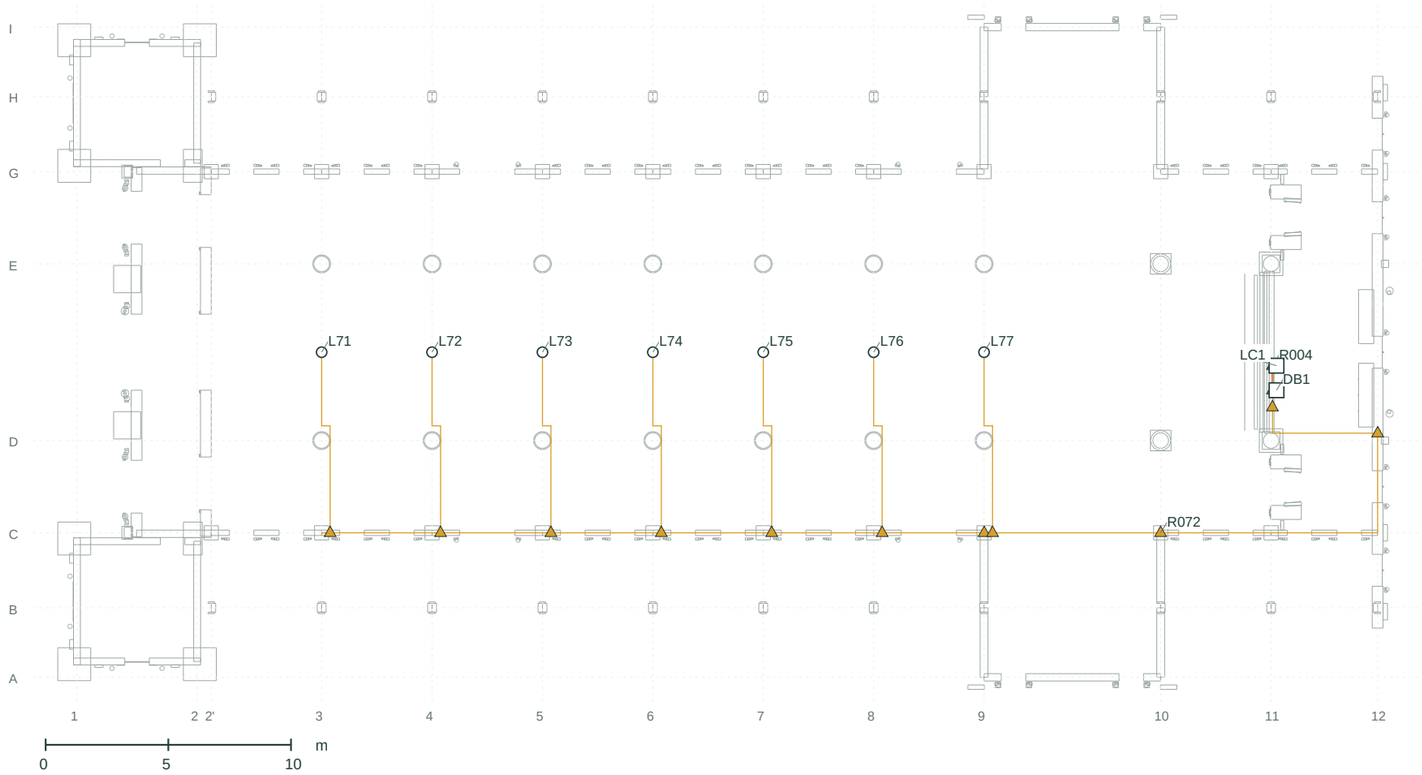

HEIGHT PROJECTION / X-Y / all Z superimposed

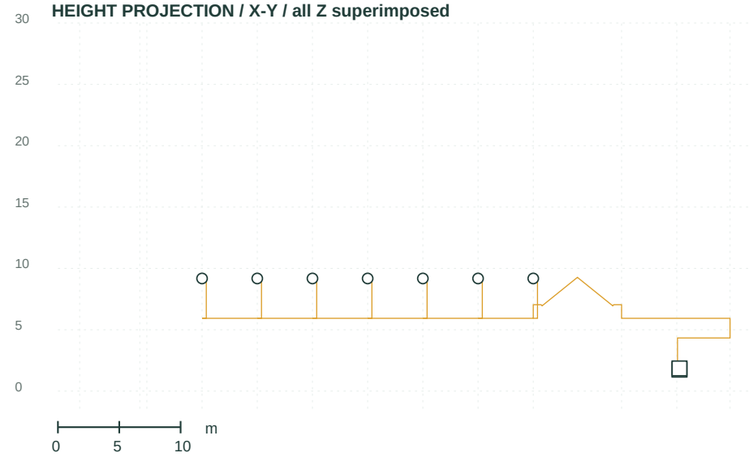

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L71	9.975	9.180	0.000	3+0.00/D+3.60	R073
L72	14.475	9.180	0.000	4+0.00/D+3.60	R074
L73	18.975	9.180	0.000	5+0.00/D+3.60	R075
L74	23.475	9.180	0.000	6+0.00/D+3.60	R076
L75	27.975	9.180	0.000	7+0.00/D+3.60	R077
L76	32.475	9.180	0.000	8+0.00/D+3.60	R078
L77	36.975	9.180	0.000	9+0.00/D+3.60	R079

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

7 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I02, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

L4 / Circulation & verandas


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-006-1


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

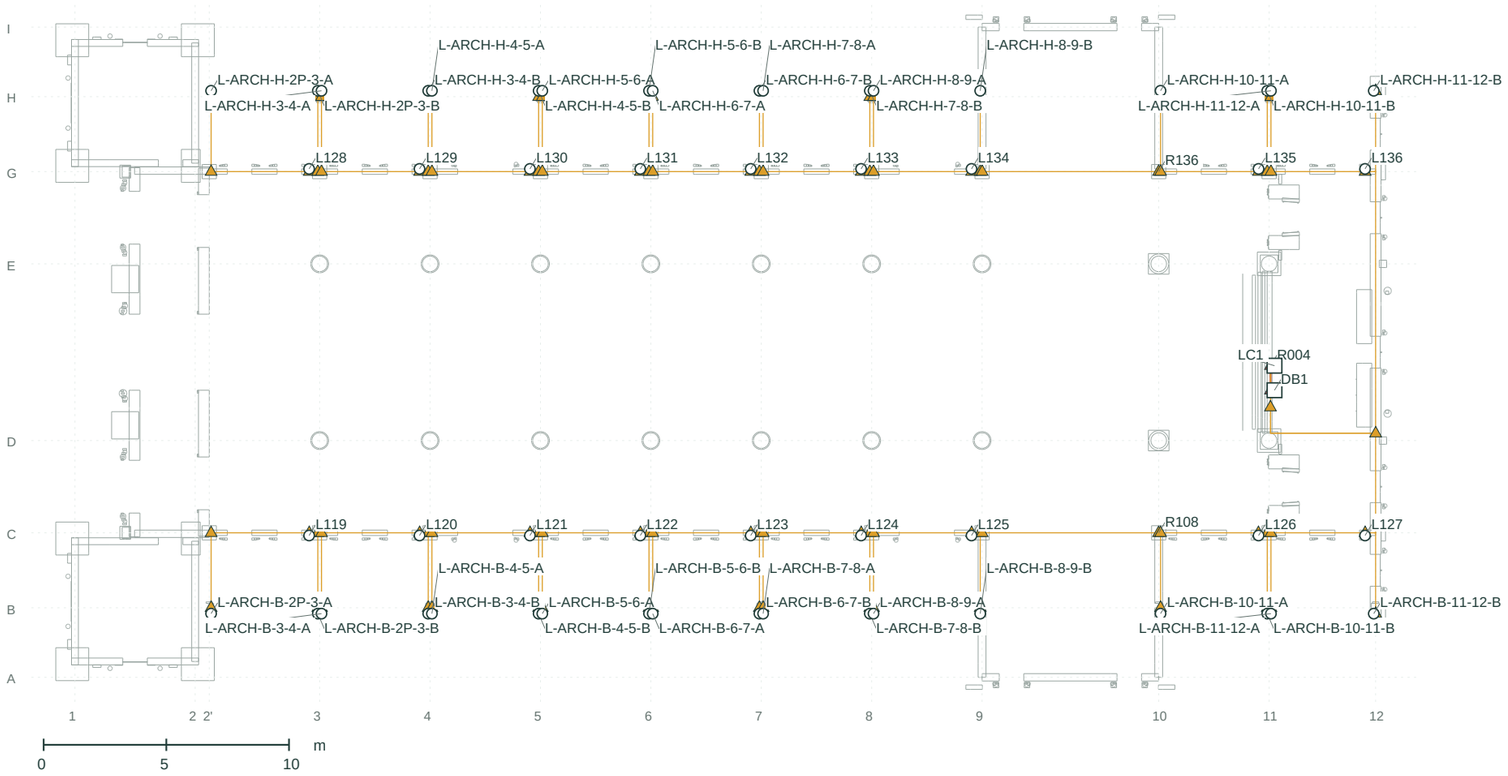

HEIGHT PROJECTION / X-Y / all Z superimposed

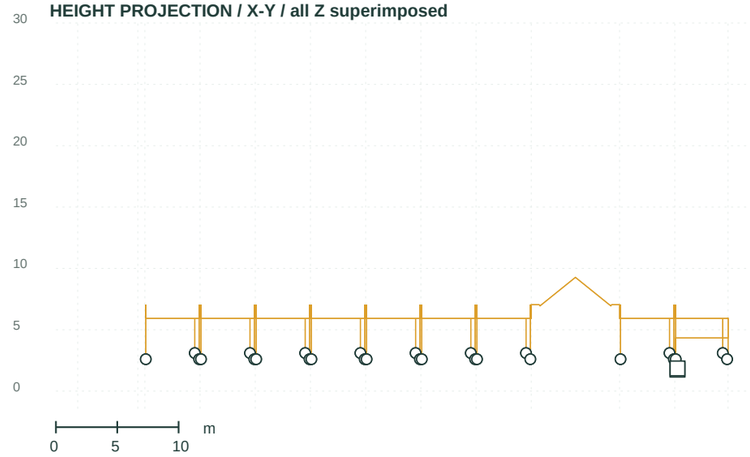

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I17, I25 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L119	9.545	3.100	-7.470	3-0.43/C-0.11	R109
L120	14.045	3.100	-7.470	4-0.43/C-0.11	R110
L121	18.545	3.100	-7.470	5-0.43/C-0.11	R111
L122	23.045	3.100	-7.470	6-0.43/C-0.11	R112
L123	27.545	3.100	-7.470	7-0.43/C-0.11	R113
L124	32.045	3.100	-7.470	8-0.43/C-0.11	R114
L125	36.545	3.100	-7.470	9-0.43/C-0.11	R115
L126	48.245	3.100	-7.470	11-0.43/C-0.11	R116
L127	52.586	3.100	-7.470	12-0.43/C-0.11	R117
L128	9.545	3.100	7.470	3-0.43/G+0.11	R137
L129	14.045	3.100	7.470	4-0.43/G+0.11	R138
L130	18.545	3.100	7.470	5-0.43/G+0.11	R139
L131	23.045	3.100	7.470	6-0.43/G+0.11	R140
L132	27.545	3.100	7.470	7-0.43/G+0.11	R141
L133	32.045	3.100	7.470	8-0.43/G+0.11	R142
L134	36.545	3.100	7.470	9-0.43/G+0.11	R143
L135	48.245	3.100	7.470	11-0.43/G+0.11	R144
L136	52.586	3.100	7.470	12-0.43/G+0.11	R145
L-ARCH-B-2P-3-A	5.550	2.600	-10.654	2'+0.08/B-0.24	R118
L-ARCH-B-2P-3-B	9.900	2.600	-10.654	3-0.07/B-0.24	R119
L-ARCH-B-3-4-A	10.050	2.600	-10.654	3+0.07/B-0.24	R120
L-ARCH-B-3-4-B	14.400	2.600	-10.654	4-0.07/B-0.24	R121
L-ARCH-B-4-5-A	14.550	2.600	-10.654	4+0.07/B-0.24	R122
L-ARCH-B-4-5-B	18.900	2.600	-10.654	5-0.07/B-0.24	R123
L-ARCH-B-5-6-A	19.050	2.600	-10.654	5+0.07/B-0.24	R124
L-ARCH-B-5-6-B	23.400	2.600	-10.654	6-0.07/B-0.24	R125
L-ARCH-B-6-7-A	23.550	2.600	-10.654	6+0.07/B-0.24	R126
L-ARCH-B-6-7-B	27.900	2.600	-10.654	7-0.07/B-0.24	R127
L-ARCH-B-7-8-A	28.050	2.600	-10.654	7+0.07/B-0.24	R128
L-ARCH-B-7-8-B	32.400	2.600	-10.654	8-0.08/B-0.24	R129
L-ARCH-B-8-9-A	32.550	2.600	-10.654	8+0.08/B-0.24	R130
L-ARCH-B-8-9-B	36.900	2.600	-10.654	9-0.08/B-0.24	R131

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

54 equipment / 57 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

L4 / Circulation & verandas


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-006-2


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

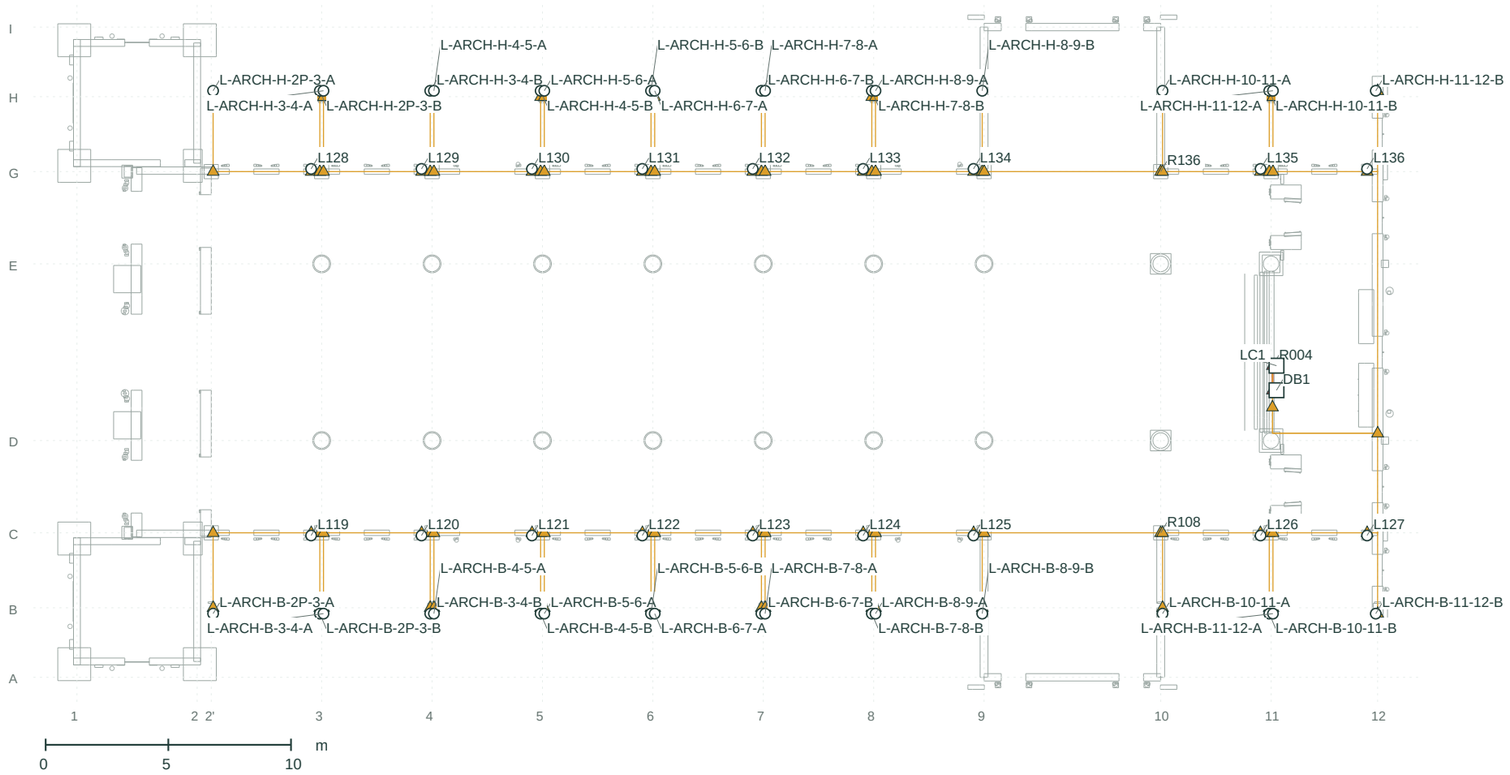

HEIGHT PROJECTION / X-Y / all Z superimposed

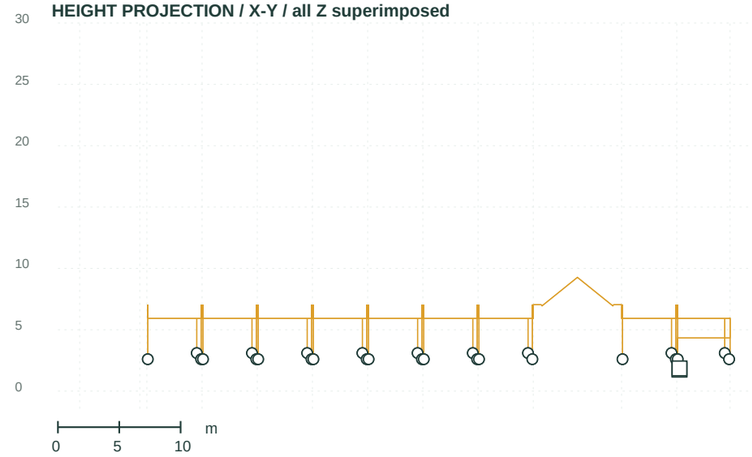

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I17, I25 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L-ARCH-B-10-11-A	44.250	2.600	-10.654	10+0.08/B-0.24	R132
L-ARCH-B-10-11-B	48.600	2.600	-10.654	11-0.08/B-0.24	R133
L-ARCH-B-11-12-A	48.750	2.600	-10.654	11+0.08/B-0.24	R134
L-ARCH-B-11-12-B	52.941	2.600	-10.654	12-0.08/B-0.24	R135
L-ARCH-H-2P-3-A	5.550	2.600	10.654	2'+0.08/H+0.24	R146
L-ARCH-H-2P-3-B	9.900	2.600	10.654	3-0.07/H+0.24	R147
L-ARCH-H-3-4-A	10.050	2.600	10.654	3+0.07/H+0.24	R148
L-ARCH-H-3-4-B	14.400	2.600	10.654	4-0.07/H+0.24	R149
L-ARCH-H-4-5-A	14.550	2.600	10.654	4+0.07/H+0.24	R150
L-ARCH-H-4-5-B	18.900	2.600	10.654	5-0.07/H+0.24	R151
L-ARCH-H-5-6-A	19.050	2.600	10.654	5+0.07/H+0.24	R152
L-ARCH-H-5-6-B	23.400	2.600	10.654	6-0.07/H+0.24	R153
L-ARCH-H-6-7-A	23.550	2.600	10.654	6+0.07/H+0.24	R154
L-ARCH-H-6-7-B	27.900	2.600	10.654	7-0.07/H+0.24	R155
L-ARCH-H-7-8-A	28.050	2.600	10.654	7+0.07/H+0.24	R156
L-ARCH-H-7-8-B	32.400	2.600	10.654	8-0.08/H+0.24	R157
L-ARCH-H-8-9-A	32.550	2.600	10.654	8+0.08/H+0.24	R158
L-ARCH-H-8-9-B	36.900	2.600	10.654	9-0.08/H+0.24	R159
L-ARCH-H-10-11-A	44.250	2.600	10.654	10+0.08/H+0.24	R160
L-ARCH-H-10-11-B	48.600	2.600	10.654	11-0.08/H+0.24	R161
L-ARCH-H-11-12-A	48.750	2.600	10.654	11+0.08/H+0.24	R162
L-ARCH-H-11-12-B	52.941	2.600	10.654	12-0.08/H+0.24	R163

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

54 equipment / 57 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

L9 / Front stage & central door


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-007


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

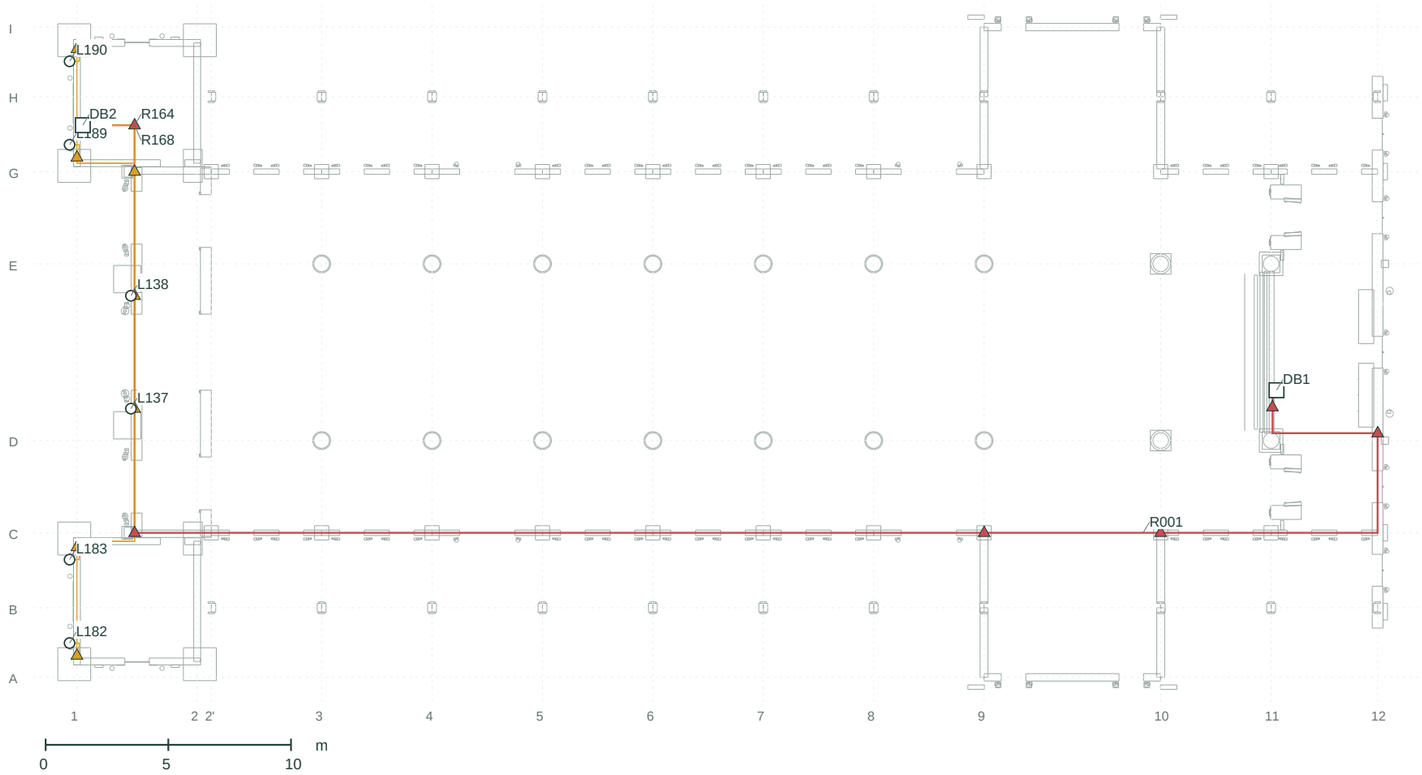

HEIGHT PROJECTION / X-Y / all Z superimposed

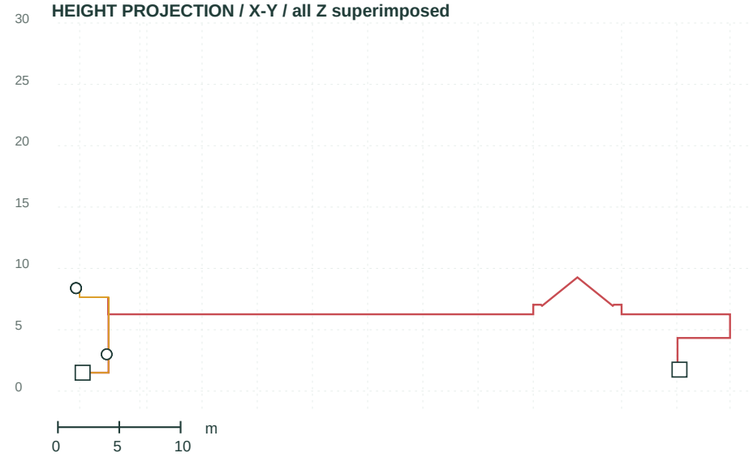

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L137	2.200	3.000	-2.300	1+2.20/D+1.30	R165
L138	2.200	3.000	2.300	1+2.20/E-1.30	R169
L182	-0.300	8.390	-11.853	1-0.30/A+1.40	R166
L183	-0.300	8.390	-8.453	1-0.30/C-1.09	R167
L189	-0.300	8.390	8.453	1-0.30/G+1.09	R170
L190	-0.300	8.390	11.853	1-0.30/I-1.40	R171

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16

6 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I22, I25, I26 (key on sheet IM-01).

THACH BI CHURCH

L5 / Steps & paths


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-008


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

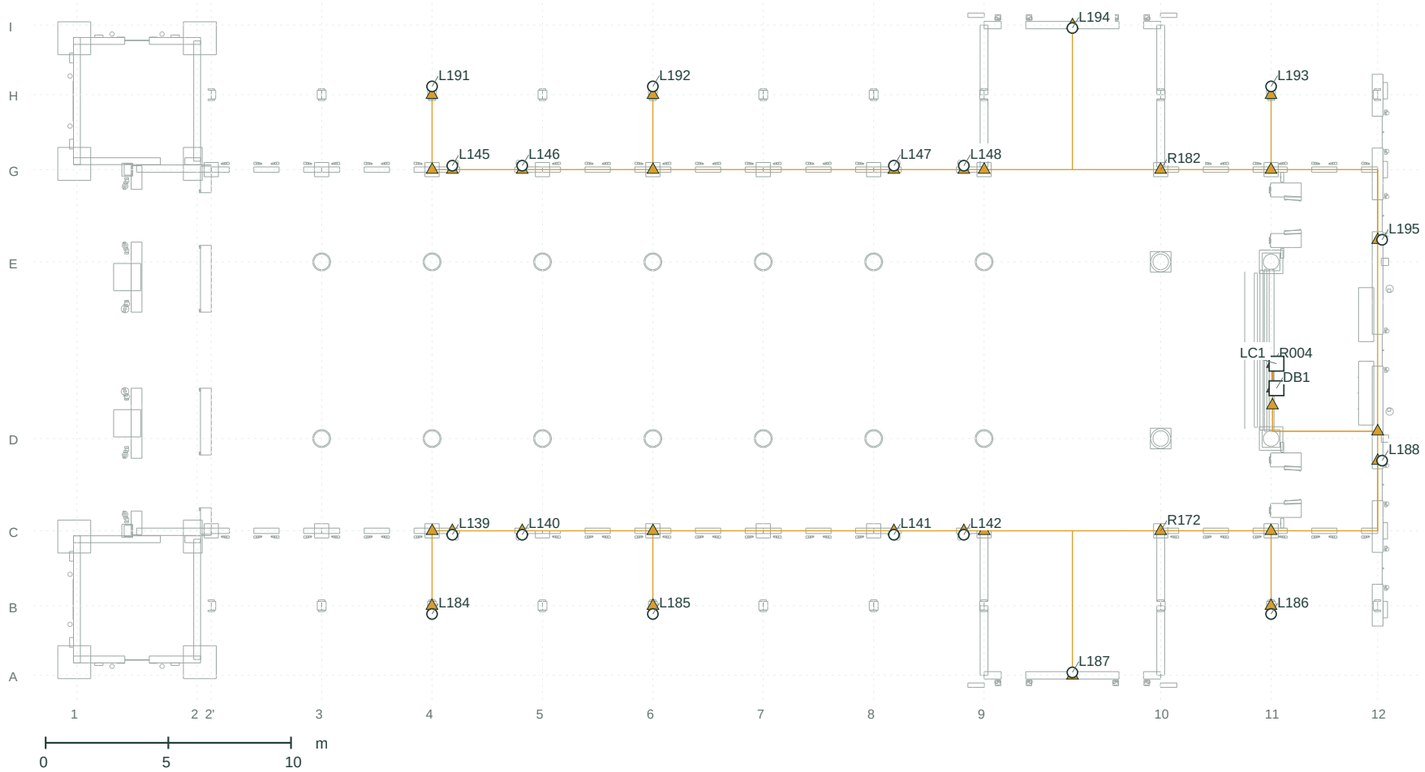

HEIGHT PROJECTION / X-Y / all Z superimposed

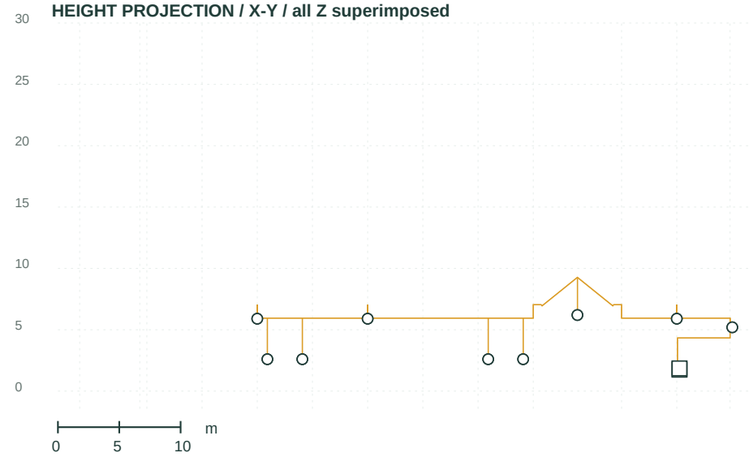

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L139	15.300	2.600	-7.520	4+0.83/C-0.16	R173
L140	18.150	2.600	-7.520	5-0.82/C-0.16	R174
L141	33.300	2.600	-7.520	8+0.83/C-0.16	R175
L142	36.150	2.600	-7.520	9-0.83/C-0.16	R176
L145	15.300	2.600	7.520	4+0.83/G+0.16	R183
L146	18.150	2.600	7.520	5-0.82/G+0.16	R184
L147	33.300	2.600	7.520	8+0.83/G+0.16	R185
L148	36.150	2.600	7.520	9-0.83/G+0.16	R186
L184	14.475	5.900	-10.750	4+0.00/B-0.34	R177
L185	23.475	5.900	-10.750	6+0.00/B-0.34	R178
L186	48.675	5.900	-10.750	11+0.00/B-0.34	R179
L187	40.575	6.200	-13.130	9+3.60/A+0.12	R180
L188	53.200	5.200	-4.500	12+0.18/D-0.90	R181
L191	14.475	5.900	10.750	4+0.00/H+0.34	R187
L192	23.475	5.900	10.750	6+0.00/H+0.34	R188
L193	48.675	5.900	10.750	11+0.00/H+0.34	R189
L194	40.575	6.200	13.130	9+3.60/I-0.12	R190
L195	53.200	5.200	4.500	12+0.18/E+0.90	R191

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

18 equipment / 21 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I17, I25 (key on sheet IM-01).

THACH BI CHURCH

E1 / Exit signs


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-009


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

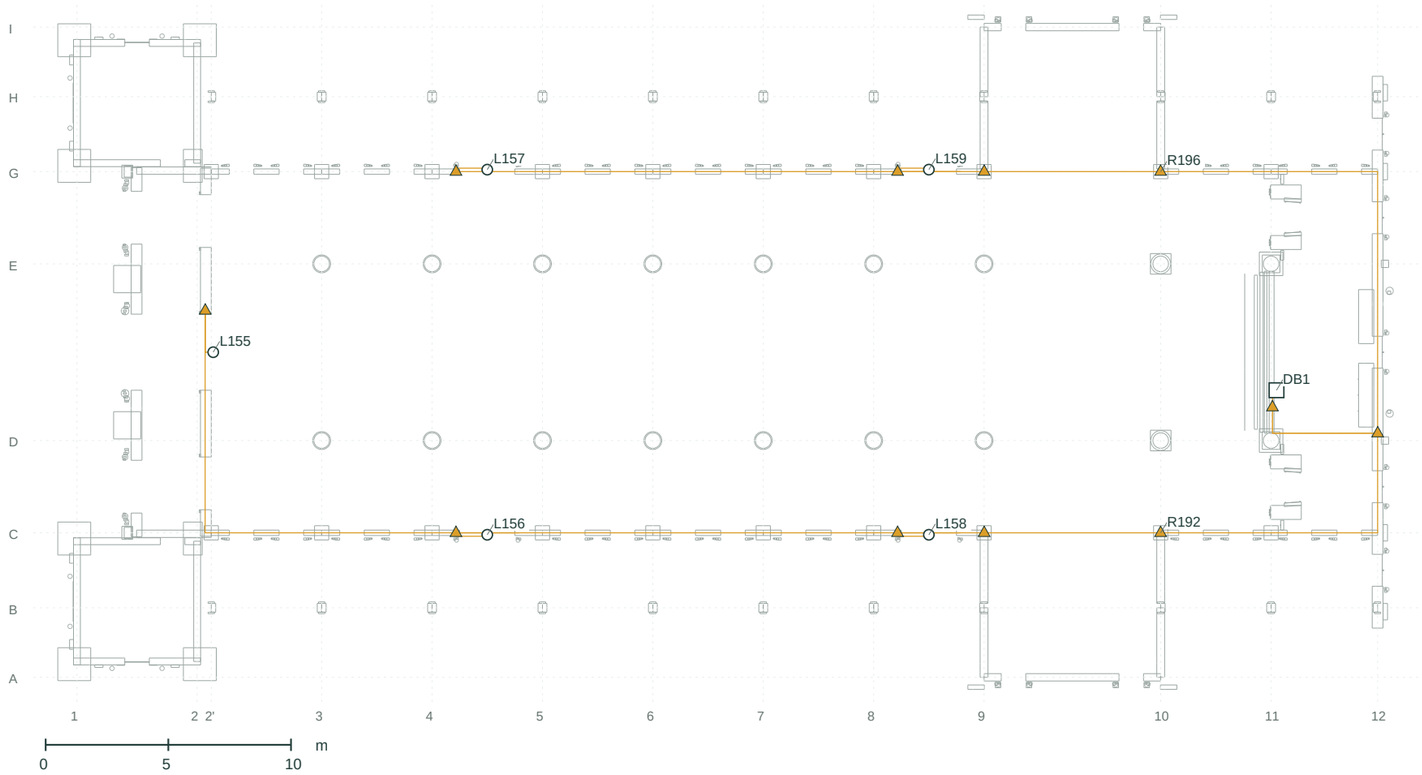

HEIGHT PROJECTION / X-Y / all Z superimposed

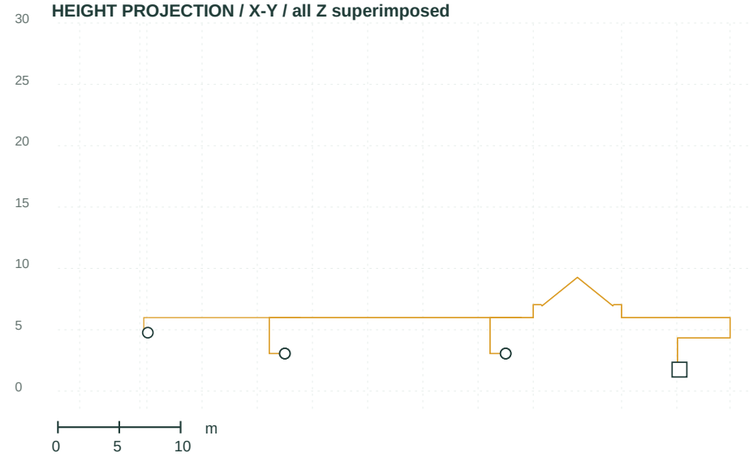

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L155	5.555	4.762	0.000	2'+0.08/D+3.60	R193
L156	16.725	3.061	-7.440	4+2.25/C-0.08	R194
L157	16.725	3.061	7.440	4+2.25/G+0.08	R197
L158	34.725	3.061	-7.440	8+2.25/C-0.08	R195
L159	34.725	3.061	7.440	8+2.25/G+0.08	R198

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05	

5 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I13, I24, I25 (key on sheet IM-01).

THACH BI CHURCH

L6 / Facade & towers


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-010


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

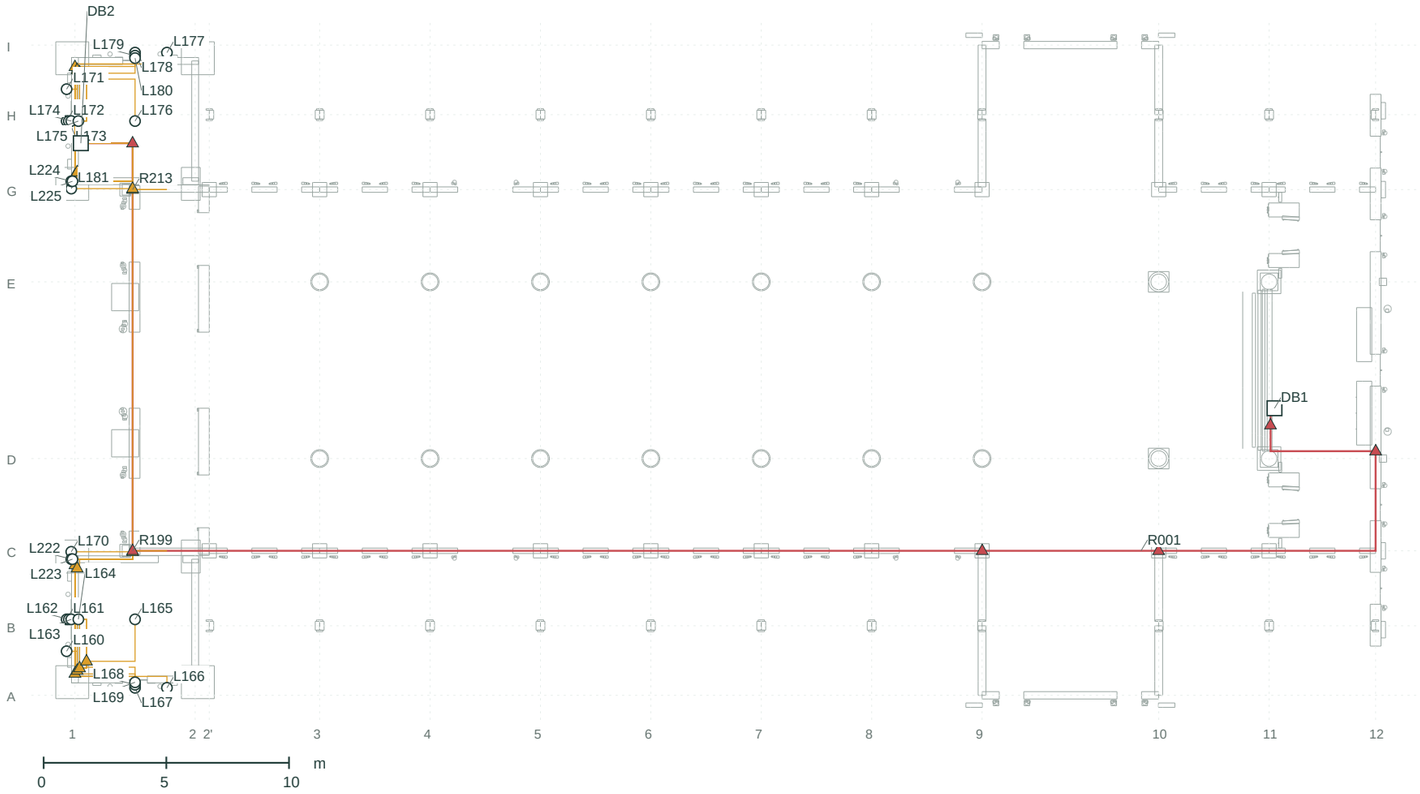

HEIGHT PROJECTION / X-Y / all Z superimposed

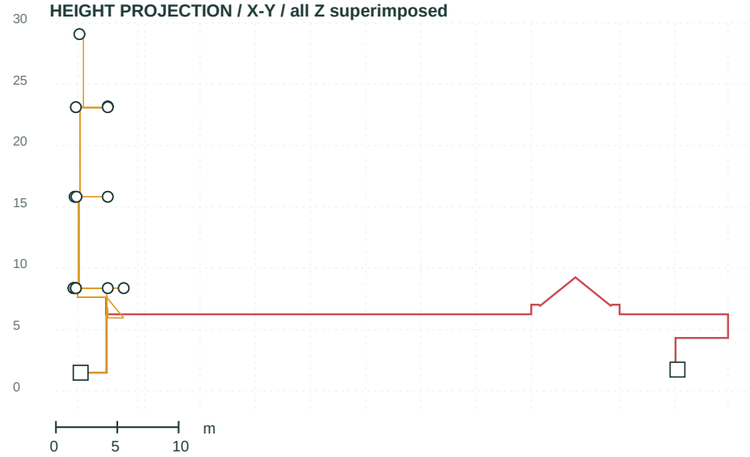

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I22, I23, I25, I26 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L160	-0.340	8.390	-11.453	1-0.34/B-1.04	R200
L161	-0.340	8.390	-10.153	1-0.34/B+0.26	R201
L162	-0.250	15.840	-10.153	1-0.25/B+0.26	R202
L163	-0.150	23.140	-10.153	1-0.15/B+0.26	R203
L164	0.140	29.090	-10.153	1+0.14/B+0.26	R204
L165	2.450	23.200	-10.153	1+2.45/B+0.26	R205
L166	3.750	8.390	-12.943	2-1.15/A+0.31	R206
L167	2.450	8.390	-12.943	1+2.45/A+0.31	R207
L168	2.450	15.840	-12.818	1+2.45/A+0.43	R208
L169	2.450	23.140	-12.718	1+2.45/A+0.53	R209
L170	-0.150	8.390	-7.400	1-0.15/C-0.04	R210
L171	-0.340	8.390	11.453	1-0.34/H+1.04	R214
L172	-0.340	8.390	10.153	1-0.34/H-0.26	R215
L173	-0.250	15.840	10.153	1-0.25/H-0.26	R216
L174	-0.150	23.140	10.153	1-0.15/H-0.26	R217
L175	0.140	29.090	10.153	1+0.14/H-0.26	R218
L176	2.450	23.200	10.153	1+2.45/H-0.26	R219
L177	3.750	8.390	12.943	2-1.15/I-0.31	R220
L178	2.450	8.390	12.943	1+2.45/I-0.31	R221
L179	2.450	15.840	12.818	1+2.45/I-0.43	R222
L180	2.450	23.140	12.718	1+2.45/I-0.53	R223
L181	-0.150	8.390	7.400	1-0.15/G+0.04	R224
L222	-0.150	8.390	-7.700	1-0.15/C-0.34	R211
L223	-0.100	15.840	-7.700	1-0.10/C-0.34	R212
L224	-0.150	8.390	7.700	1-0.15/G+0.34	R225
L225	-0.100	15.840	7.700	1-0.10/G+0.34	R226

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16

26 equipment / 29 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

L7 / Festival exterior (strings & tower floods)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-011


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

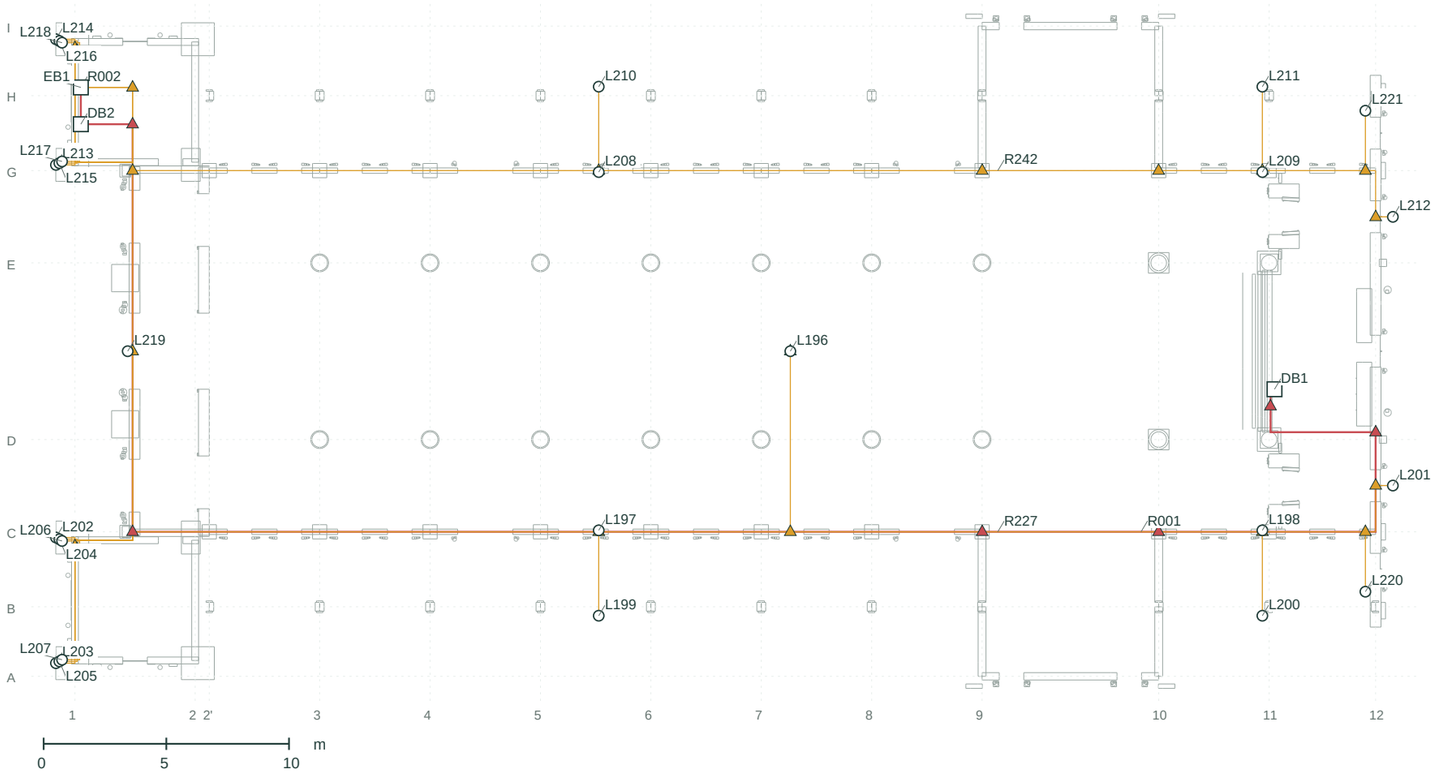

HEIGHT PROJECTION / X-Y / all Z superimposed

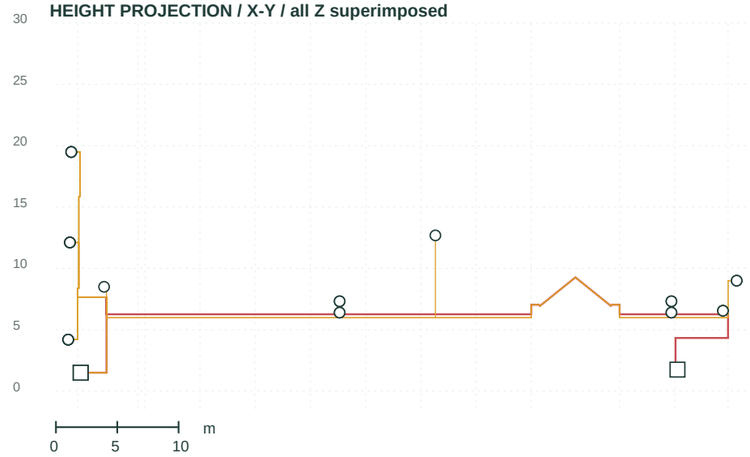

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I09, I17, I21, I22, I25, I26 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L196	29.160	12.690	0.000	7+1.18/D+3.60	R228
L197	21.350	7.320	-7.300	6-2.12/C+0.06	R229
L198	48.400	7.320	-7.300	11-0.27/C+0.06	R230
L199	21.350	6.400	-10.780	6-2.12/B-0.37	R231
L200	48.400	6.400	-10.780	11-0.27/B-0.37	R232
L201	53.720	9.000	-5.475	12+0.70/D-1.87	R233
L202	-0.775	4.195	-7.593	1-0.77/C-0.23	R234
L203	-0.775	4.195	-12.713	1-0.77/A+0.54	R235
L204	-0.635	12.115	-7.663	1-0.64/C-0.30	R236
L205	-0.635	12.115	-12.643	1-0.64/A+0.61	R237
L206	-0.525	19.490	-7.733	1-0.53/C-0.37	R238
L207	-0.525	19.490	-12.573	1-0.53/A+0.68	R239
L208	21.350	7.320	7.300	6-2.12/G-0.06	R243
L209	48.400	7.320	7.300	11-0.27/G-0.06	R244
L210	21.350	6.400	10.780	6-2.12/H+0.37	R245
L211	48.400	6.400	10.780	11-0.27/H+0.37	R246
L212	53.720	9.000	5.475	12+0.70/E+1.87	R247
L213	-0.775	4.195	7.593	1-0.77/G+0.23	R248
L214	-0.775	4.195	12.713	1-0.77/I-0.54	R249
L215	-0.635	12.115	7.663	1-0.64/G+0.30	R250
L216	-0.635	12.115	12.643	1-0.64/I-0.61	R251
L217	-0.525	19.490	7.733	1-0.53/G+0.37	R252
L218	-0.525	19.490	12.573	1-0.53/I-0.68	R253
L219	2.150	8.500	0.000	1+2.15/D+3.60	R240
L220	52.600	6.550	-9.800	12-0.42/B+0.61	R241
L221	52.600	6.550	9.800	12-0.42/H-0.61	R254

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16
EB1	0.240	1.500	10.750	1+0.24/H+0.34

26 equipment / 30 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

F1 / Ceiling fans


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-012


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

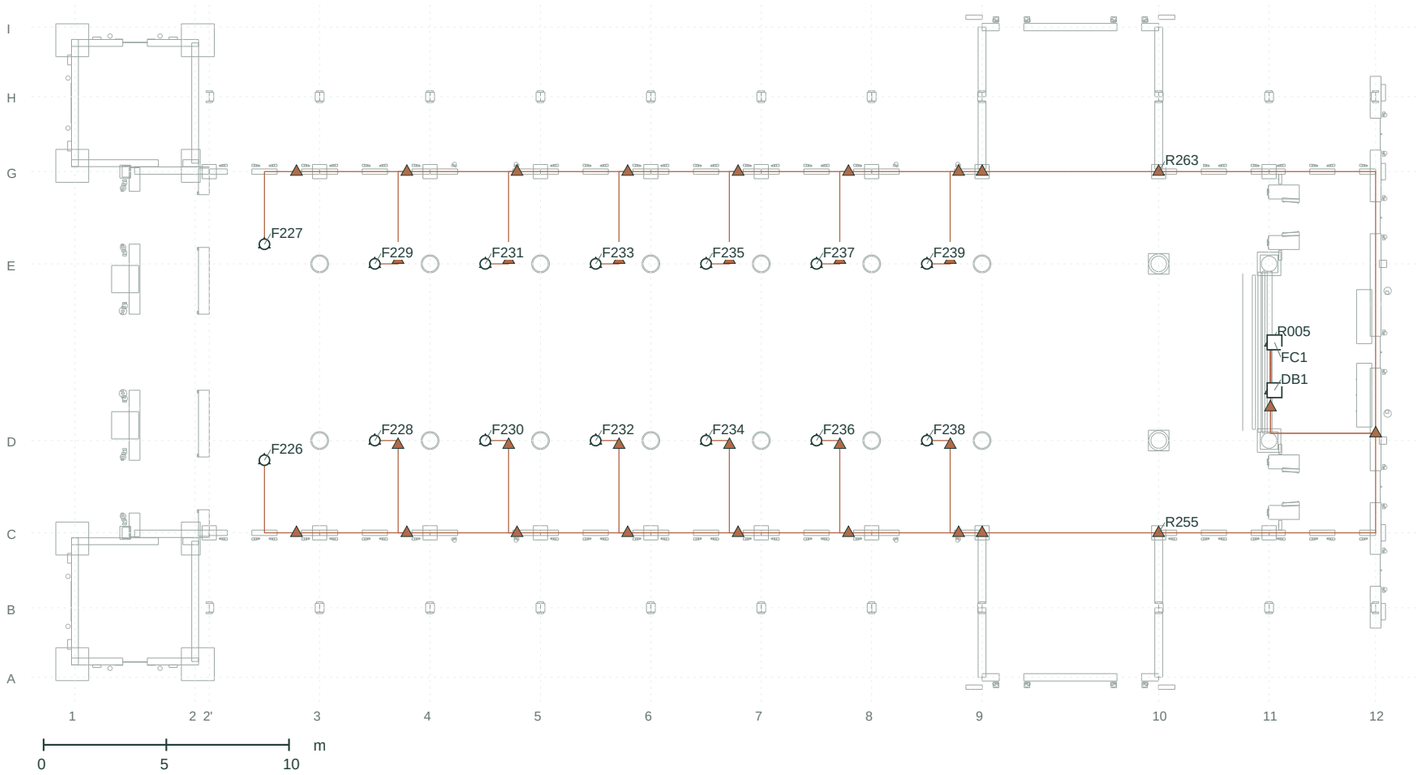

HEIGHT PROJECTION / X-Y / all Z superimposed

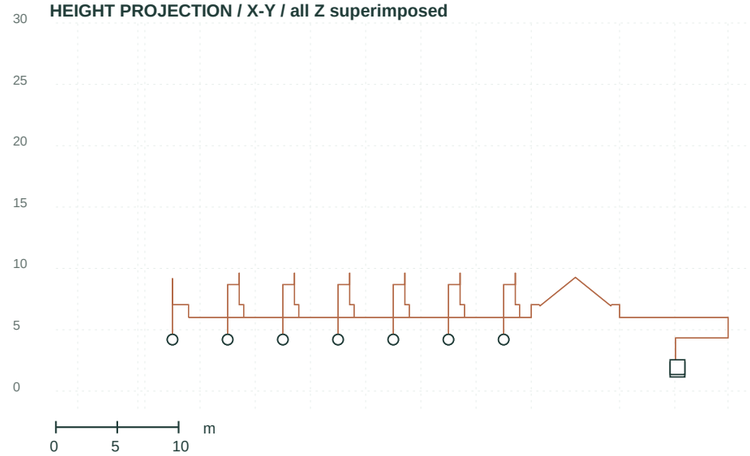

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F226	7.725	4.200	-4.400	2'+2.25/D-0.80	R256
F227	7.725	4.200	4.400	2'+2.25/E+0.80	R264
F228	12.225	4.200	-3.600	3+2.25/D+0.00	R257
F229	12.225	4.200	3.600	3+2.25/E+0.00	R265
F230	16.725	4.200	-3.600	4+2.25/D+0.00	R258
F231	16.725	4.200	3.600	4+2.25/E+0.00	R266
F232	21.225	4.200	-3.600	5+2.25/D+0.00	R259
F233	21.225	4.200	3.600	5+2.25/E+0.00	R267
F234	25.725	4.200	-3.600	6+2.25/D+0.00	R260
F235	25.725	4.200	3.600	6+2.25/E+0.00	R268
F236	30.225	4.200	-3.600	7+2.25/D+0.00	R261
F237	30.225	4.200	3.600	7+2.25/E+0.00	R269
F238	34.725	4.200	-3.600	8+2.25/D+0.00	R262
F239	34.725	4.200	3.600	8+2.25/E+0.00	R270

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
FC1	48.895	1.950	0.400	11+0.22/E-3.20

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I03, I04, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

F5 / Wing wall fans / held review


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-013


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

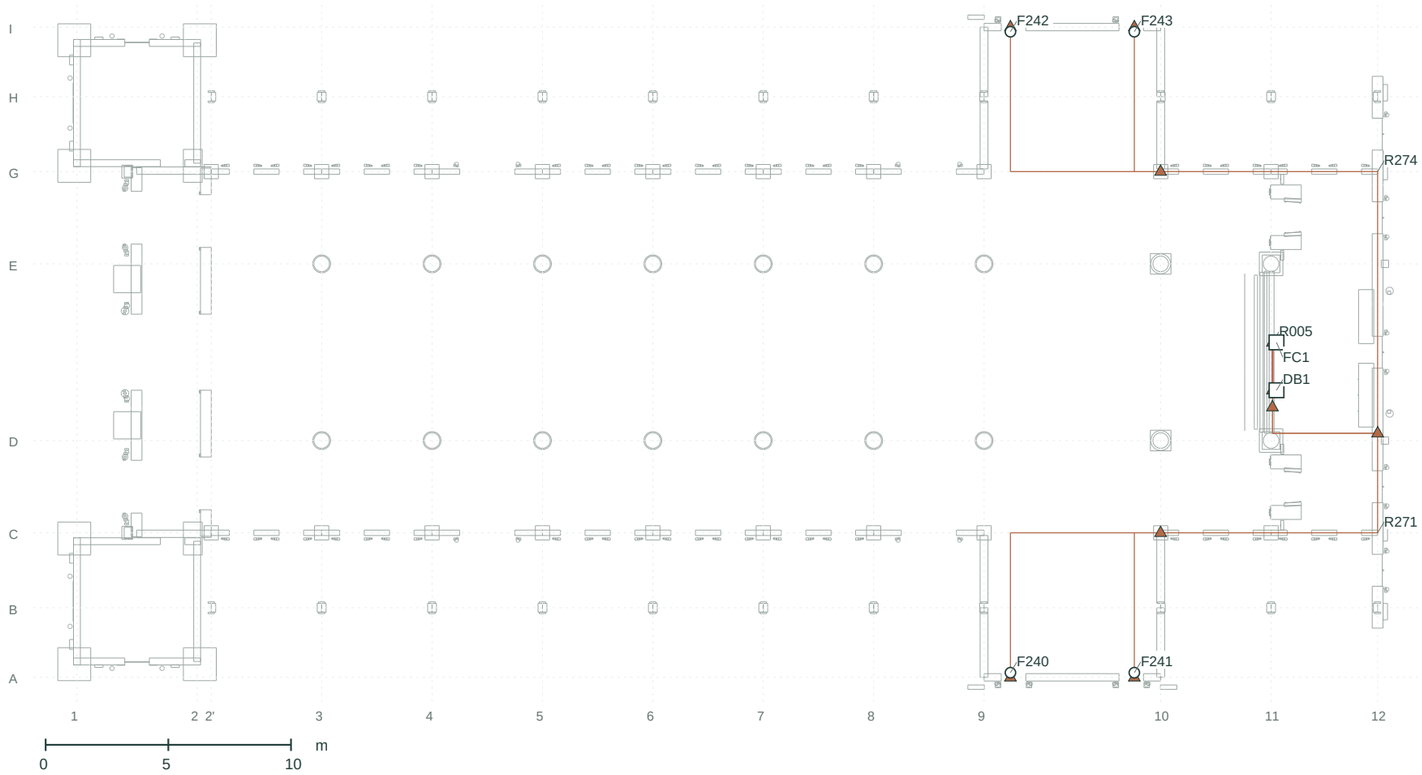

HEIGHT PROJECTION / X-Y / all Z superimposed

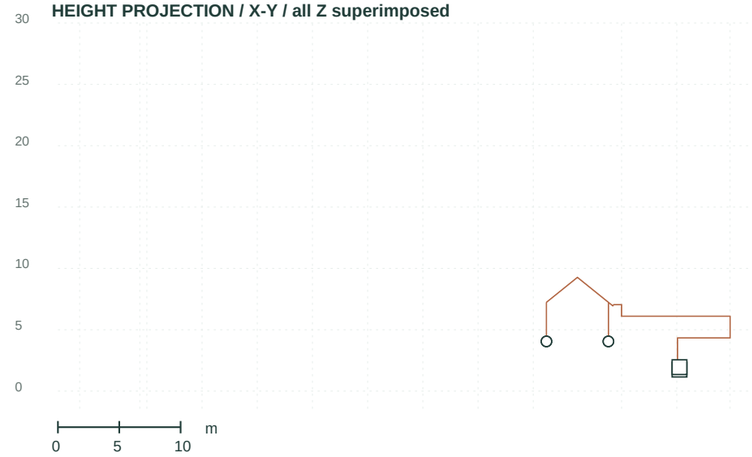

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F240	38.050	4.050	-13.060	9+1.07/A+0.19	R272
F241	43.100	4.050	-13.060	10-1.07/A+0.19	R273
F242	38.050	4.050	13.060	9+1.07/I-0.19	R275
F243	43.100	4.050	13.060	10-1.07/I-0.19	R276

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
FC1	48.895	1.950	0.400	11+0.22/E-3.20

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I11, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

F2 / Wall fans


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-014


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

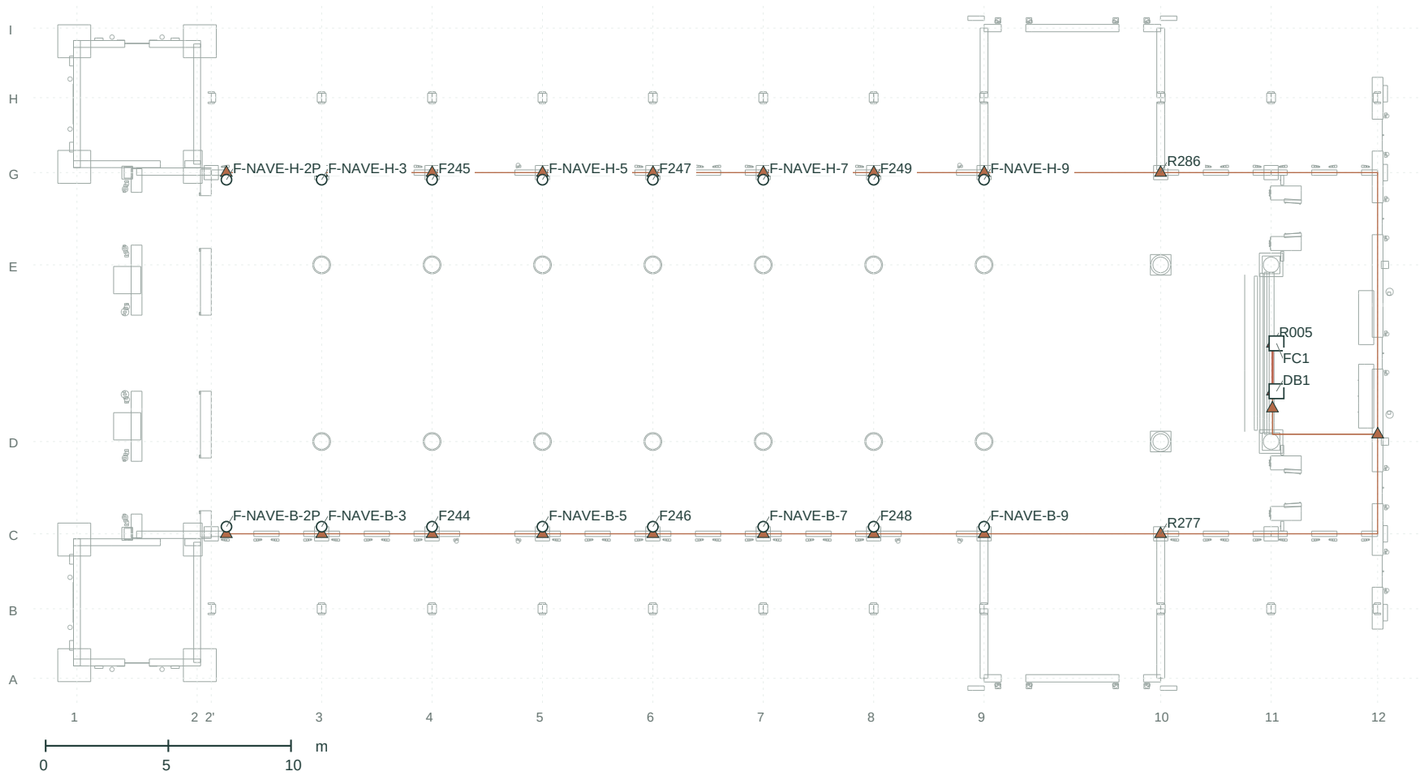

HEIGHT PROJECTION / X-Y / all Z superimposed

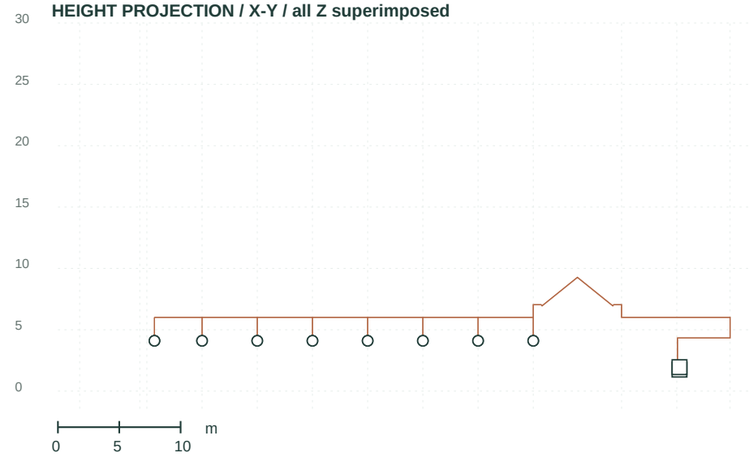

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F244	14.475	4.100	-7.070	4+0.00/C+0.29	R278
F245	14.475	4.100	7.070	4+0.00/G-0.29	R287
F246	23.475	4.100	-7.070	6+0.00/C+0.29	R279
F247	23.475	4.100	7.070	6+0.00/G-0.29	R288
F248	32.475	4.100	-7.070	8+0.00/C+0.29	R280
F249	32.475	4.100	7.070	8+0.00/G-0.29	R289
F-NAVE-B-2P	6.095	4.100	-7.070	2'+0.62/C+0.29	R281
F-NAVE-H-2P	6.095	4.100	7.070	2'+0.62/G-0.29	R290
F-NAVE-B-3	9.975	4.100	-7.070	3+0.00/C+0.29	R282
F-NAVE-H-3	9.975	4.100	7.070	3+0.00/G-0.29	R291
F-NAVE-B-5	18.975	4.100	-7.070	5+0.00/C+0.29	R283
F-NAVE-H-5	18.975	4.100	7.070	5+0.00/G-0.29	R292
F-NAVE-B-7	27.975	4.100	-7.070	7+0.00/C+0.29	R284
F-NAVE-H-7	27.975	4.100	7.070	7+0.00/G-0.29	R293
F-NAVE-B-9	36.975	4.100	-7.070	9+0.00/C+0.29	R285
F-NAVE-H-9	36.975	4.100	7.070	9+0.00/G-0.29	R294

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
FC1	48.895	1.950	0.400	11+0.22/E-3.20

16 equipment / 19 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

F4 / Entrance circulators (trial)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-015

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

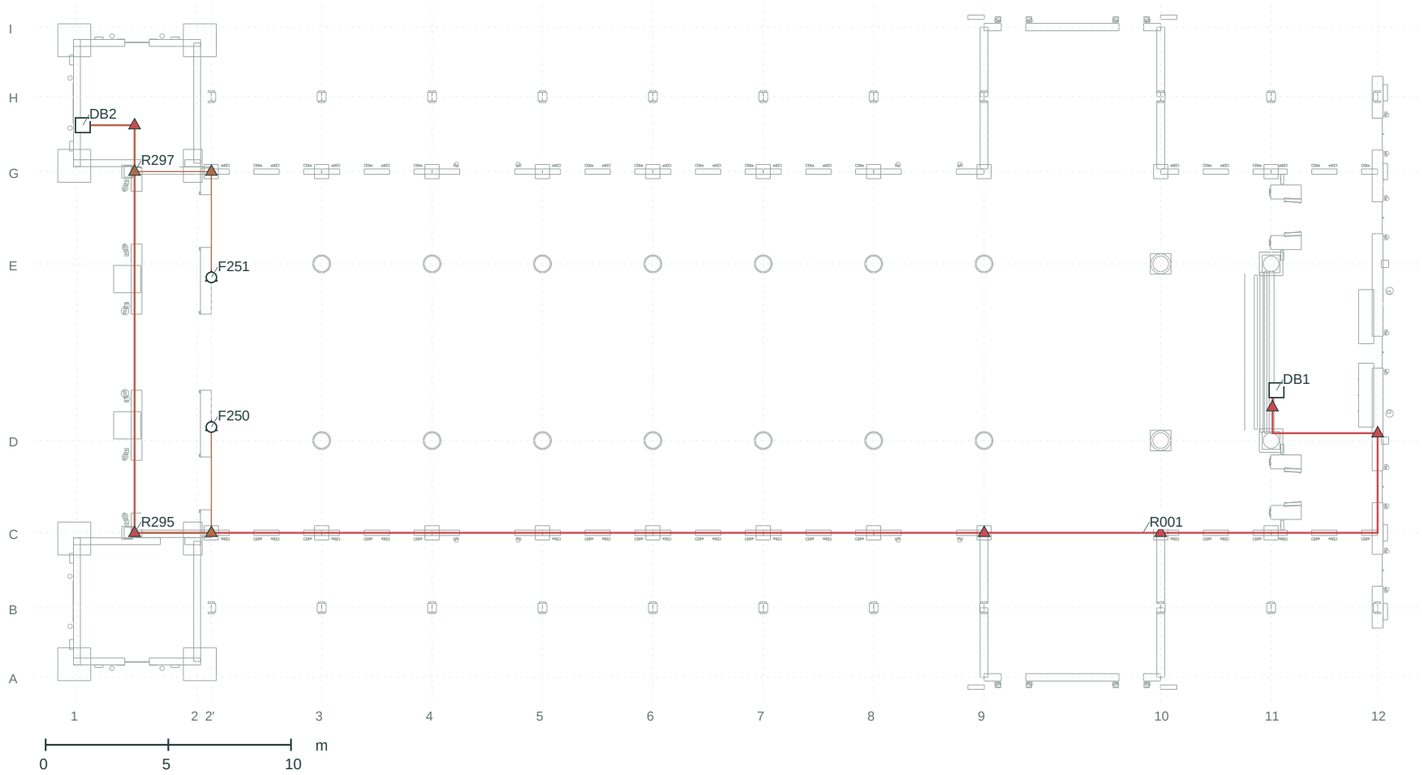

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F250	5.480	6.000	-3.050	2'+0.00/D+0.55	R296
F251	5.480	6.000	3.050	2'+0.00/E-0.55	R298

Related enclosures


DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

HEIGHT PROJECTION / X-Y / all Z superimposed

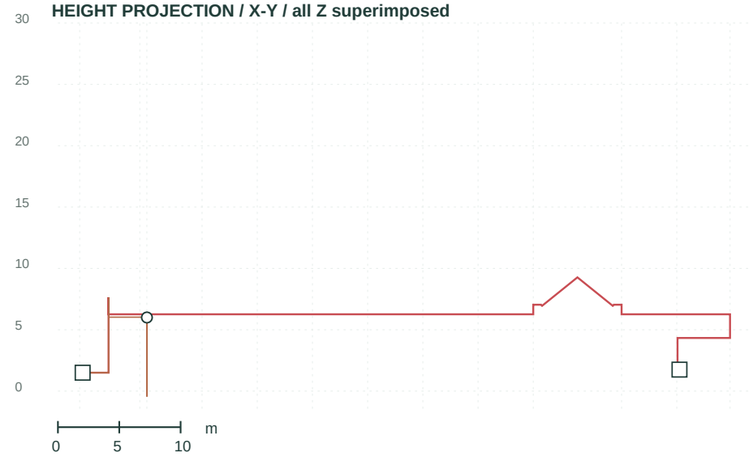

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I16, I25, I26 (key on sheet IM-01).

THACH BI CHURCH

V1 / Exhaust / front gable


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-016


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

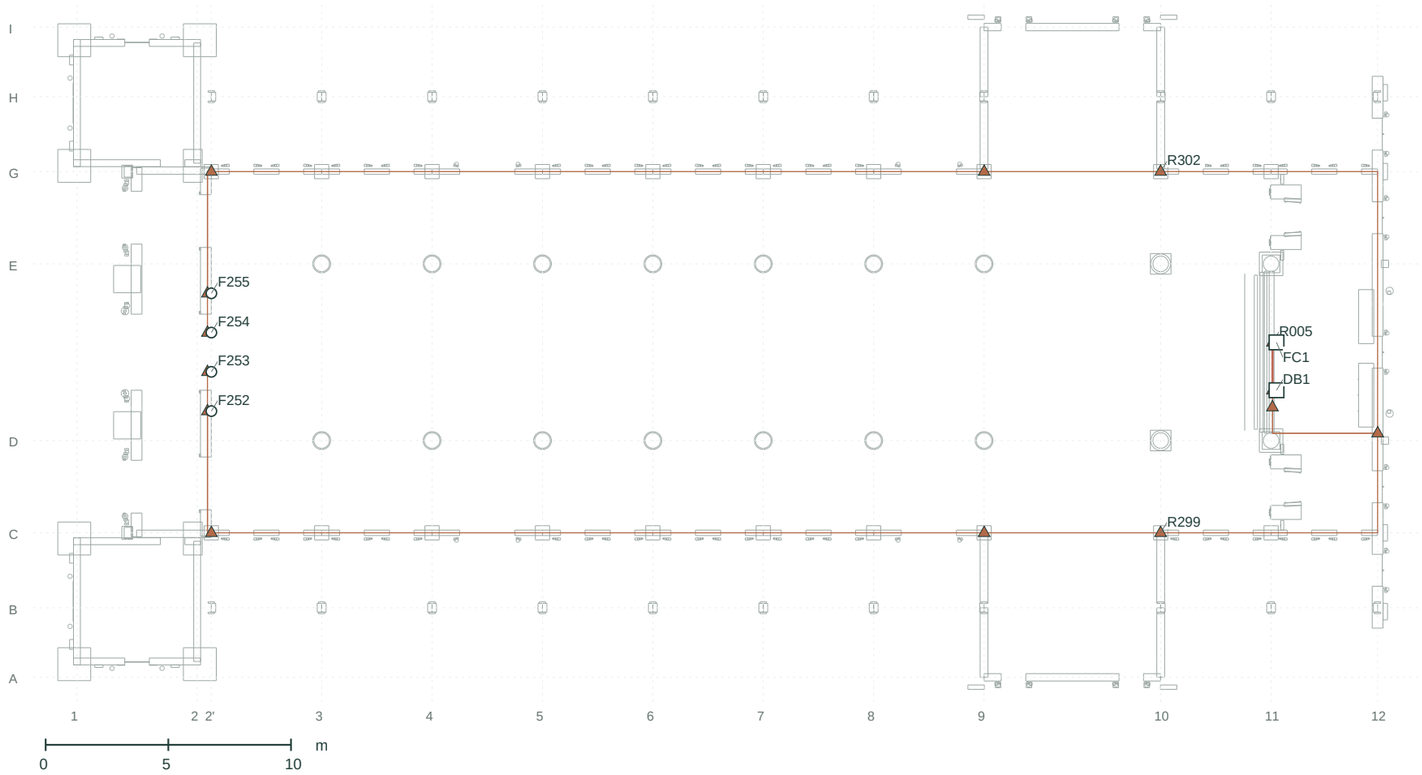

HEIGHT PROJECTION / X-Y / all Z superimposed

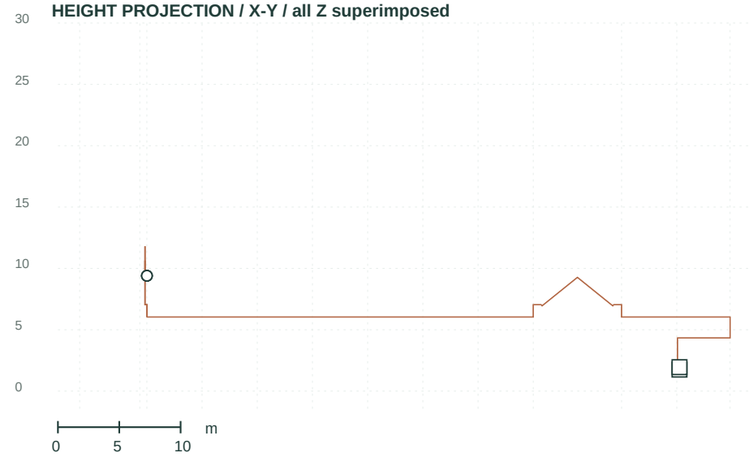

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F252	5.480	9.400	-2.400	2'+0.01/D+1.20	R300
F253	5.480	9.400	-0.800	2'+0.01/D+2.80	R301
F254	5.480	9.400	0.800	2'+0.01/E-2.80	R303
F255	5.480	9.400	2.400	2'+0.01/E-1.20	R304

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
FC1	48.895	1.950	0.400	11+0.22/E-3.20

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I05, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

V2 / Exhaust / wing gables


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-017


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

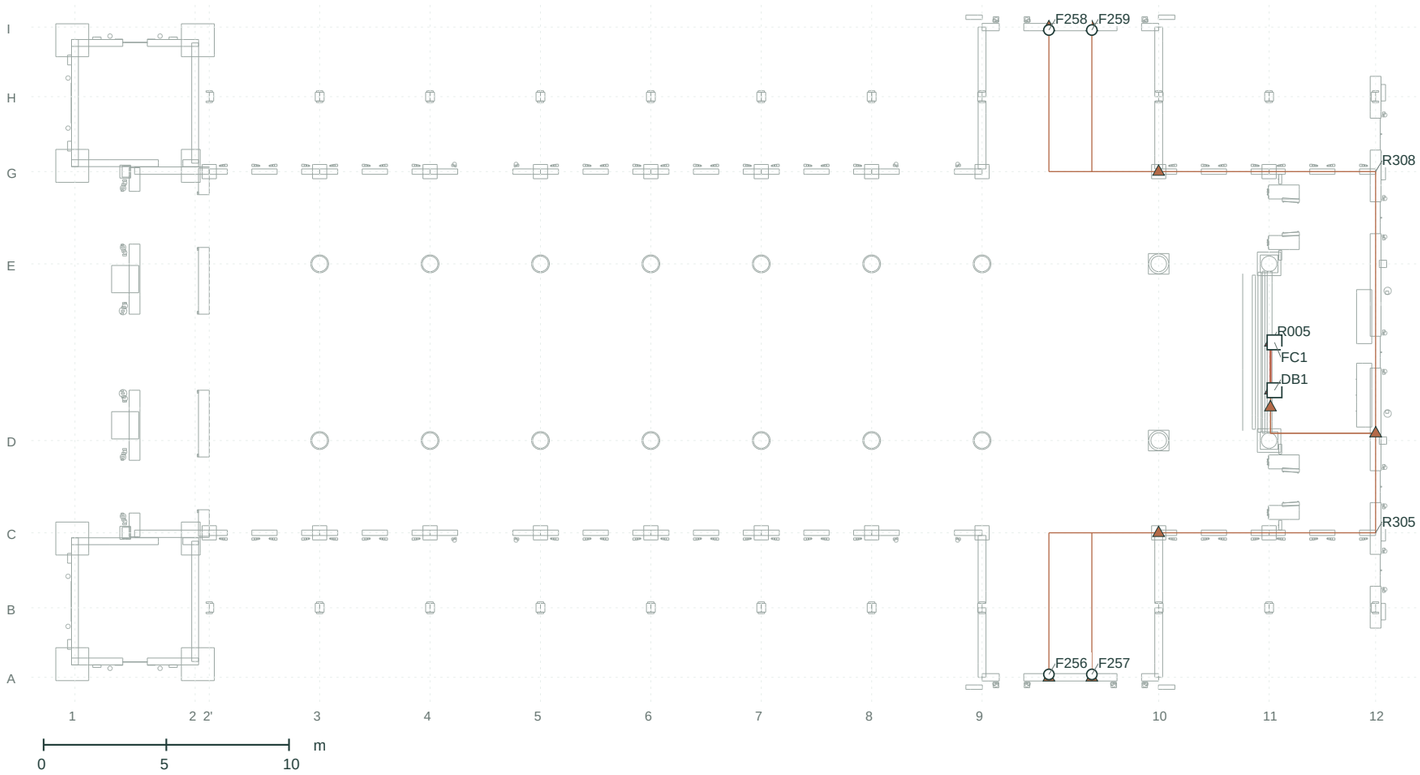

HEIGHT PROJECTION / X-Y / all Z superimposed

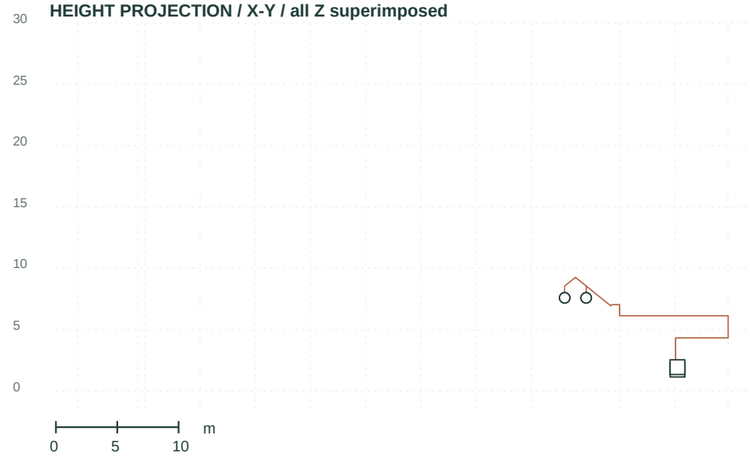

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F256	39.700	7.600	-13.130	9+2.73/A+0.12	R306
F257	41.450	7.600	-13.130	10-2.72/A+0.12	R307
F258	39.700	7.600	13.130	9+2.73/I-0.12	R309
F259	41.450	7.600	13.130	10-2.72/I-0.12	R310

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
FC1	48.895	1.950	0.400	11+0.22/E-3.20

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I11, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

V3 / Exhaust / service room


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-018


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

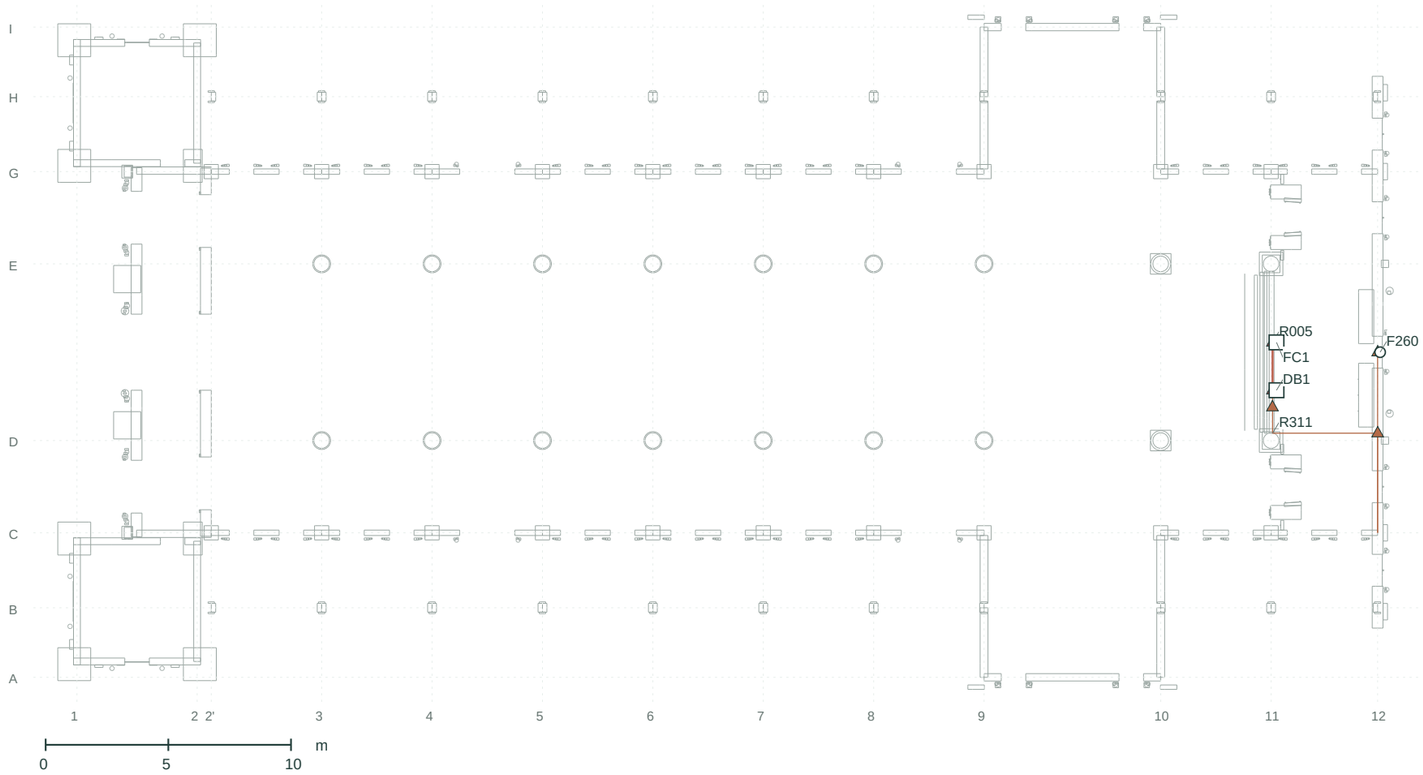

HEIGHT PROJECTION / X-Y / all Z superimposed

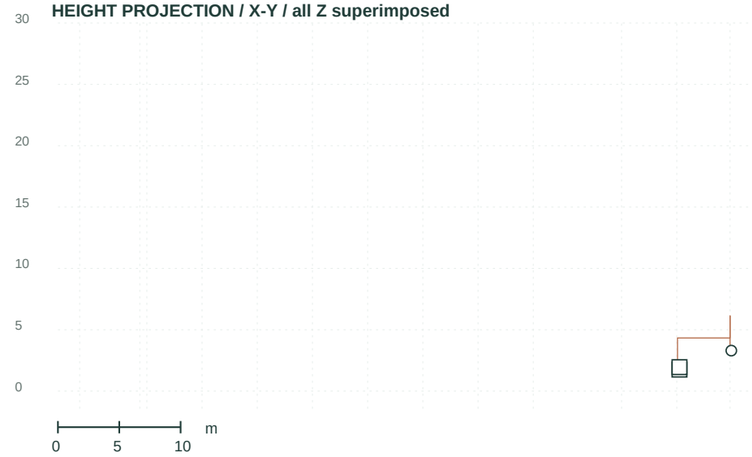

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
F260	53.120	3.300	0.000	12+0.10/D+3.60	R312

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
FC1	48.895	1.950	0.400	11+0.22/E-3.20

1 equipment / 3 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I17, I25 (key on sheet IM-01).

THACH BI CHURCH

A1 / Main & delay loudspeakers


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-019


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

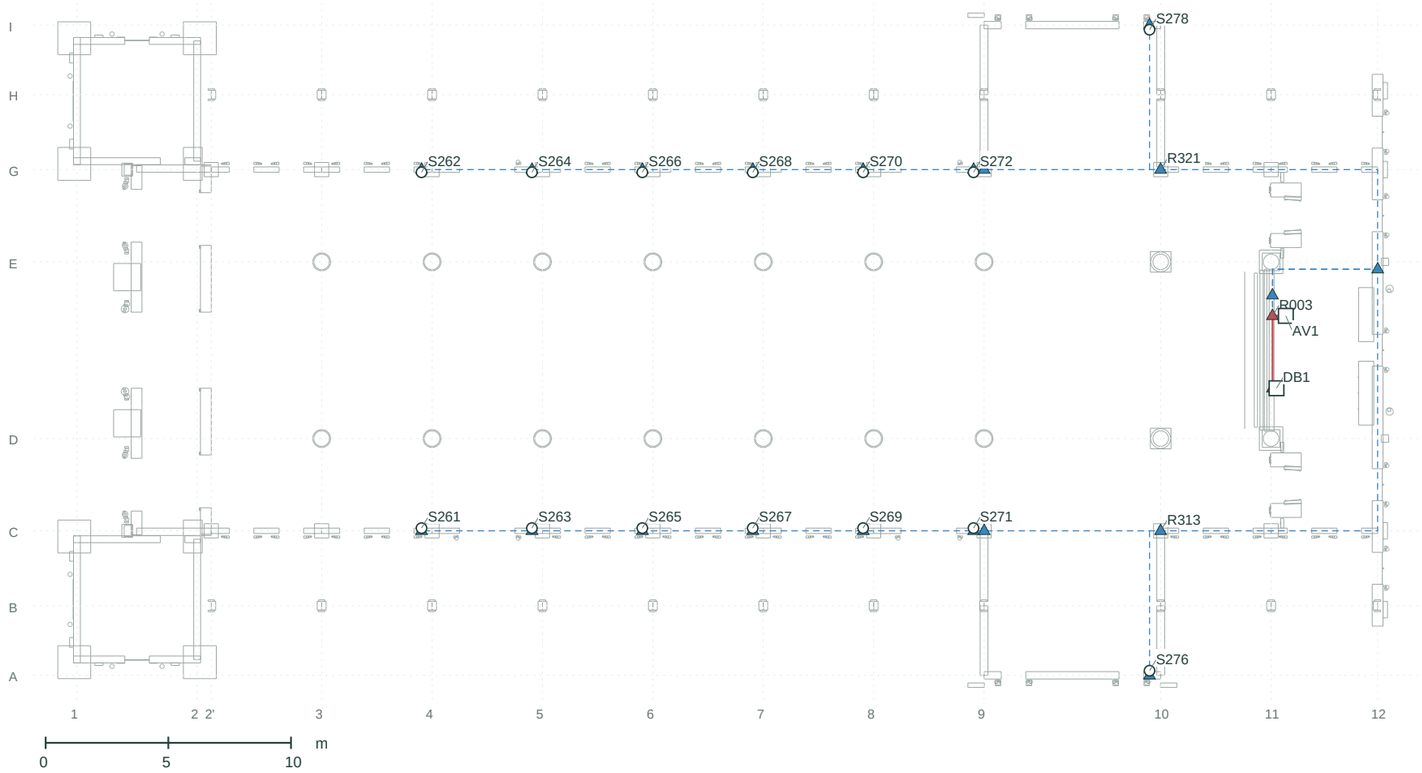

HEIGHT PROJECTION / X-Y / all Z superimposed

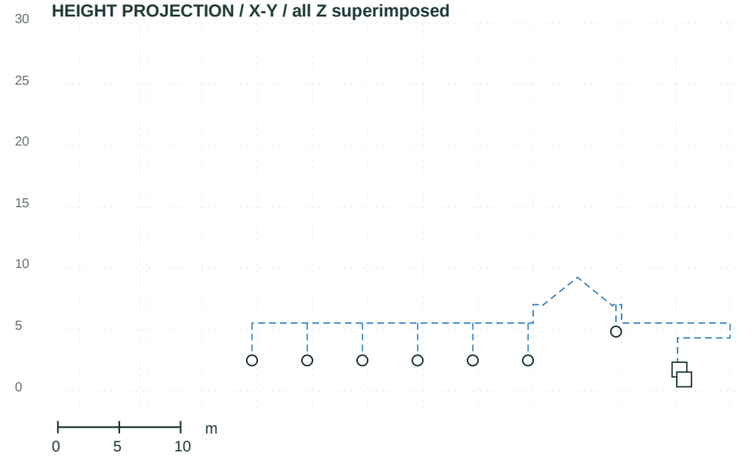

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
S261	14.045	2.500	-7.250	4-0.43/C+0.11	R314
S262	14.045	2.500	7.250	4-0.43/G-0.11	R322
S263	18.545	2.500	-7.250	5-0.43/C+0.11	R315
S264	18.545	2.500	7.250	5-0.43/G-0.11	R323
S265	23.045	2.500	-7.250	6-0.43/C+0.11	R316
S266	23.045	2.500	7.250	6-0.43/G-0.11	R324
S267	27.545	2.500	-7.250	7-0.43/C+0.11	R317
S268	27.545	2.500	7.250	7-0.43/G-0.11	R325
S269	32.045	2.500	-7.250	8-0.43/C+0.11	R318
S270	32.045	2.500	7.250	8-0.43/G-0.11	R326
S271	36.545	2.500	-7.250	9-0.43/C+0.11	R319
S272	36.545	2.500	7.250	9-0.43/G-0.11	R327
S276	43.720	4.850	-13.060	10-0.45/A+0.19	R320
S278	43.720	4.850	13.060	10-0.45/I-0.19	R328

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
AV1	49.275	0.950	1.400	11+0.60/E-2.20

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

A5 / Rear fill (crowded feasts)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-020


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

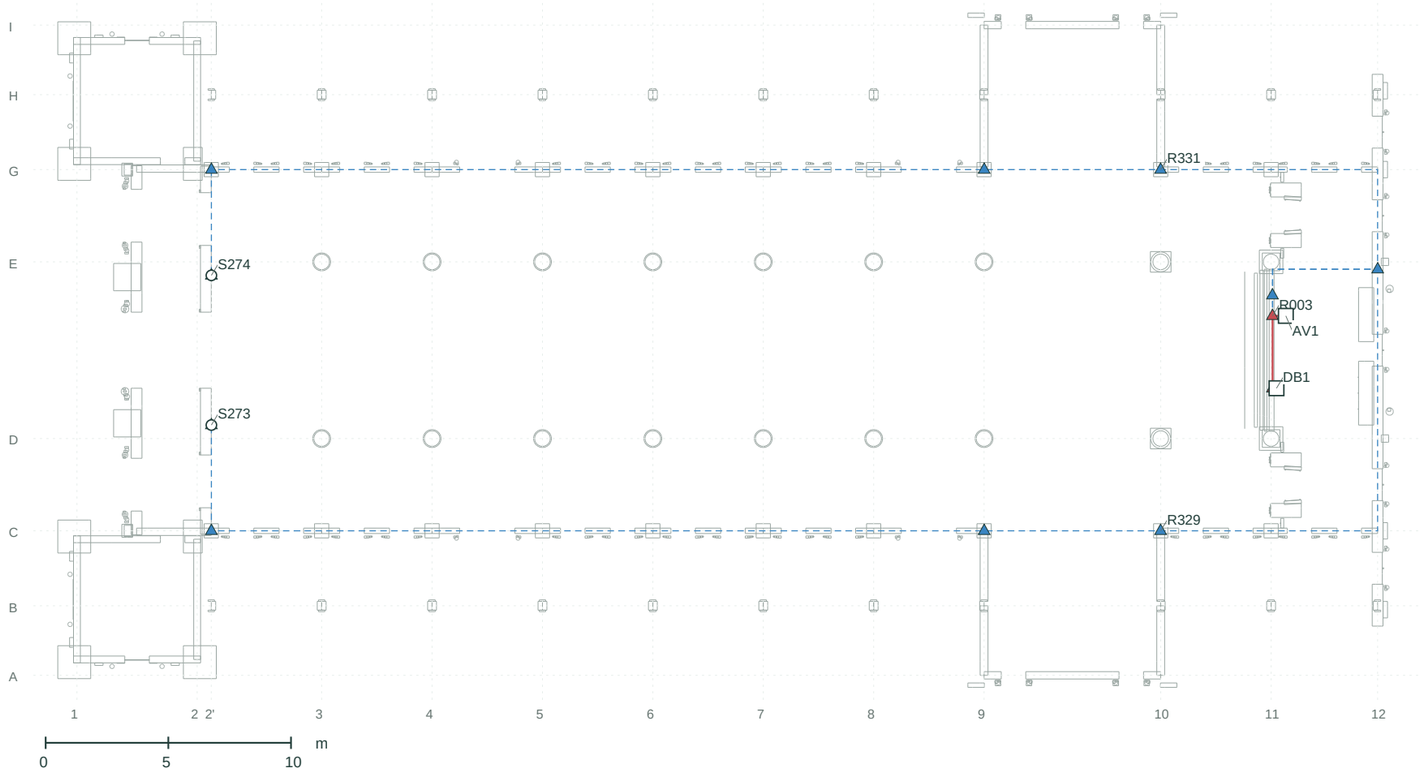

HEIGHT PROJECTION / X-Y / all Z superimposed

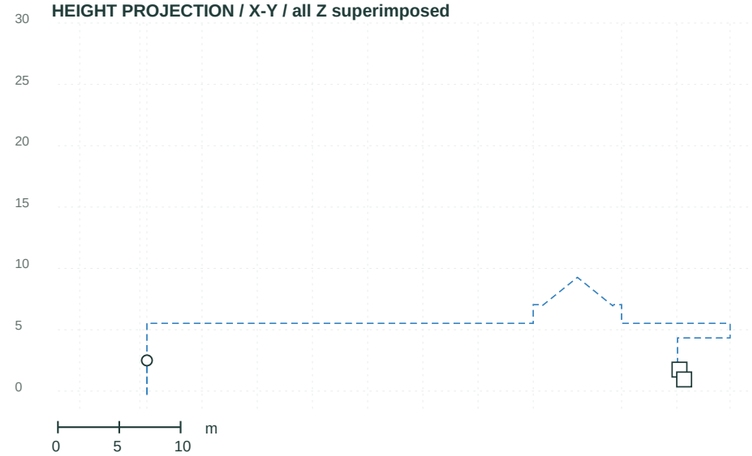

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
S273	5.480	2.500	-3.050	2'+0.00/D+0.55	R330
S274	5.480	2.500	3.050	2'+0.00/E-0.55	R332

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
AV1	49.275	0.950	1.400	11+0.60/E-2.20

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I16, I25 (key on sheet IM-01).

THACH BI CHURCH

A2 / Veranda fill


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-021


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

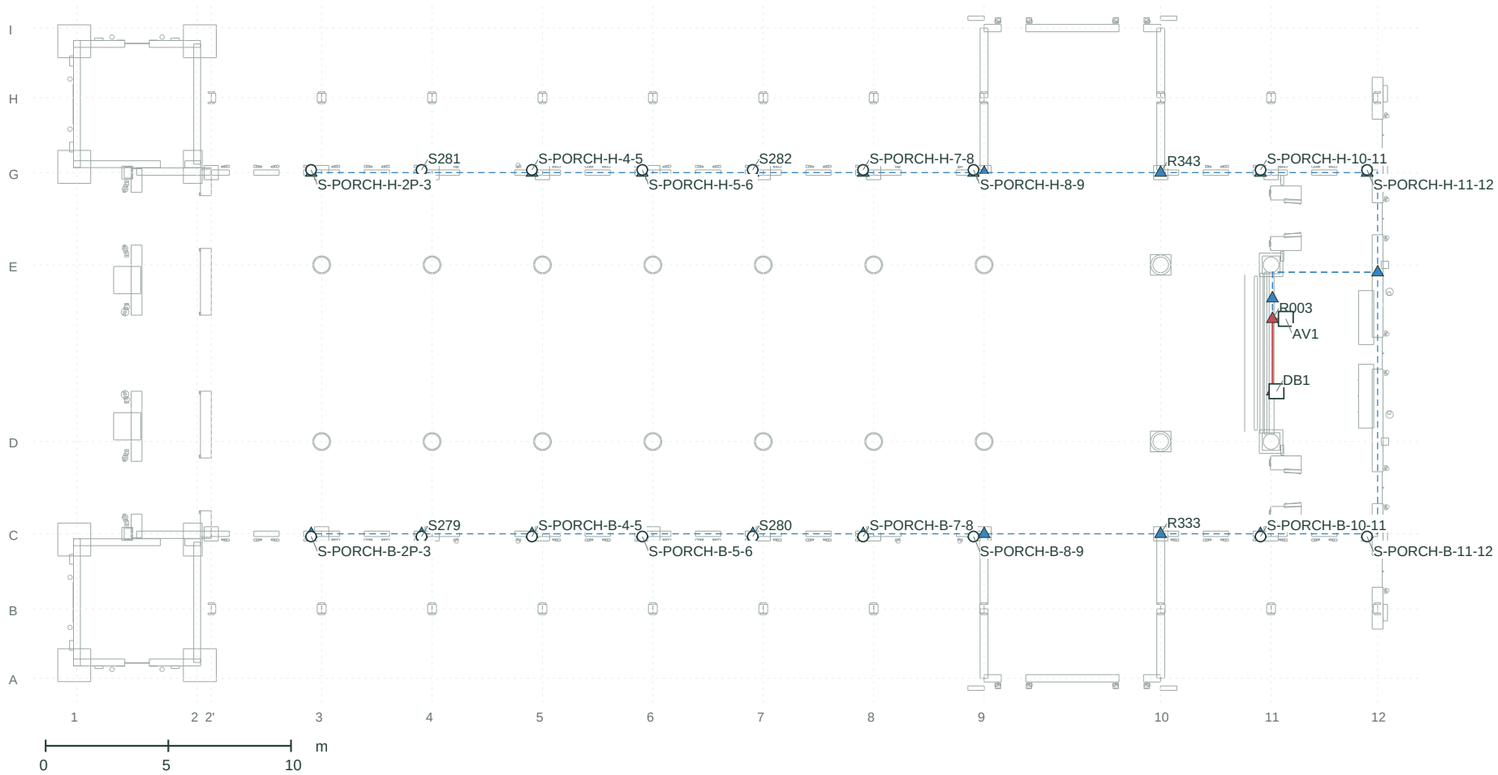

HEIGHT PROJECTION / X-Y / all Z superimposed

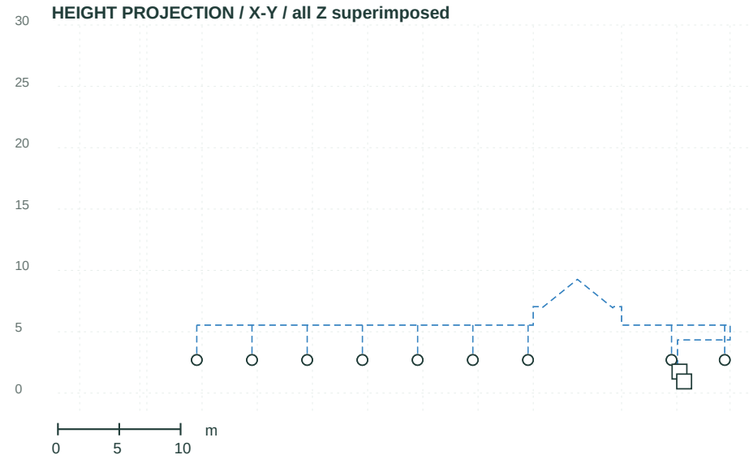

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
S279	14.045	2.700	-7.470	4-0.43/C-0.11	R334
S280	27.545	2.700	-7.470	7-0.43/C-0.11	R335
S281	14.045	2.700	7.470	4-0.43/G+0.11	R344
S282	27.545	2.700	7.470	7-0.43/G+0.11	R345
S-PORCH-B-2P-3	9.545	2.700	-7.470	3-0.43/C-0.11	R336
S-PORCH-B-4-5	18.545	2.700	-7.470	5-0.43/C-0.11	R337
S-PORCH-B-5-6	23.045	2.700	-7.470	6-0.43/C-0.11	R338
S-PORCH-B-7-8	32.045	2.700	-7.470	8-0.43/C-0.11	R339
S-PORCH-B-8-9	36.545	2.700	-7.470	9-0.43/C-0.11	R340
S-PORCH-B-10-11	48.245	2.700	-7.470	11-0.43/C-0.11	R341
S-PORCH-B-11-12	52.586	2.700	-7.470	12-0.43/C-0.11	R342
S-PORCH-H-2P-3	9.545	2.700	7.470	3-0.43/G+0.11	R346
S-PORCH-H-4-5	18.545	2.700	7.470	5-0.43/G+0.11	R347
S-PORCH-H-5-6	23.045	2.700	7.470	6-0.43/G+0.11	R348
S-PORCH-H-7-8	32.045	2.700	7.470	8-0.43/G+0.11	R349
S-PORCH-H-8-9	36.545	2.700	7.470	9-0.43/G+0.11	R350
S-PORCH-H-10-11	48.245	2.700	7.470	11-0.43/G+0.11	R351
S-PORCH-H-11-12	52.586	2.700	7.470	12-0.43/G+0.11	R352

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
AV1	49.275	0.950	1.400	11+0.60/E-2.20

18 equipment / 21 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

A3 / Courtyard


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-022


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

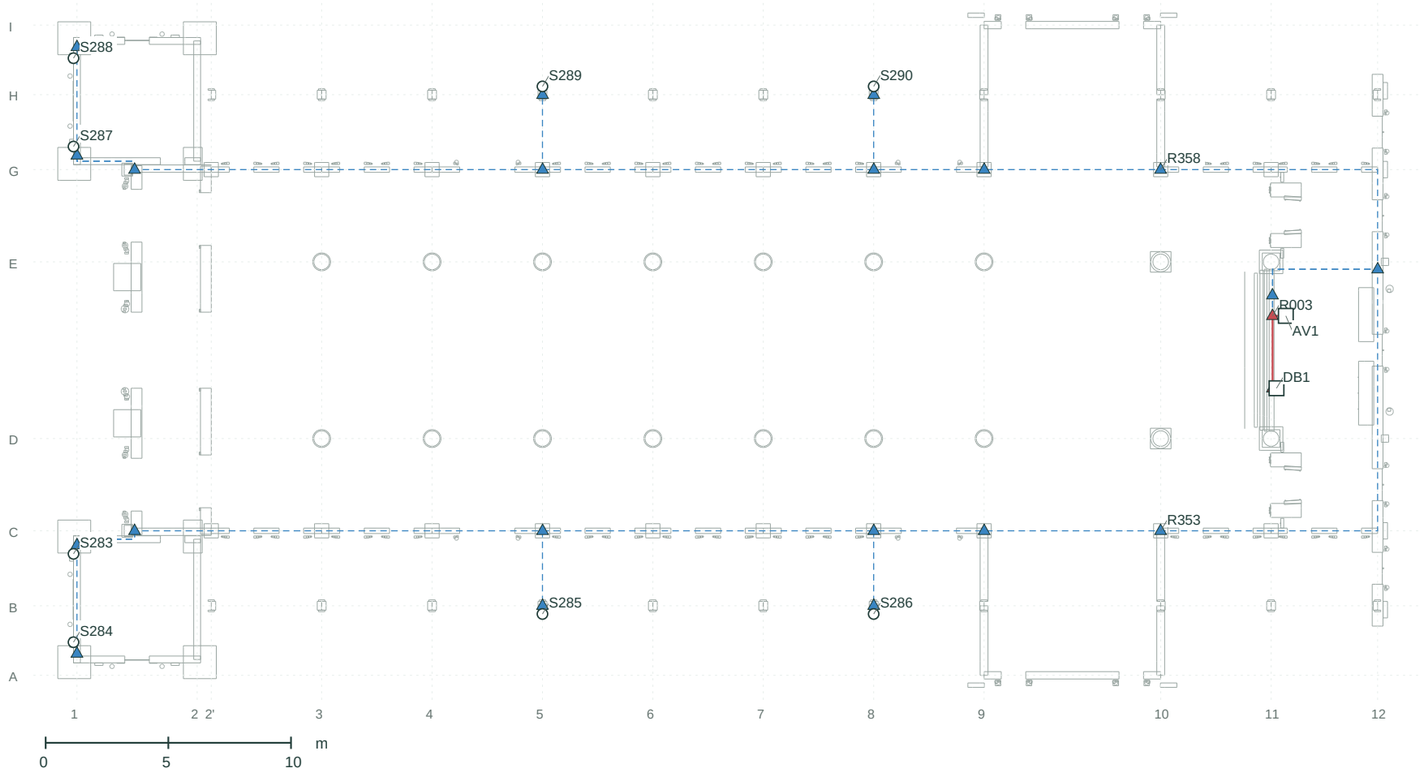

HEIGHT PROJECTION / X-Y / all Z superimposed

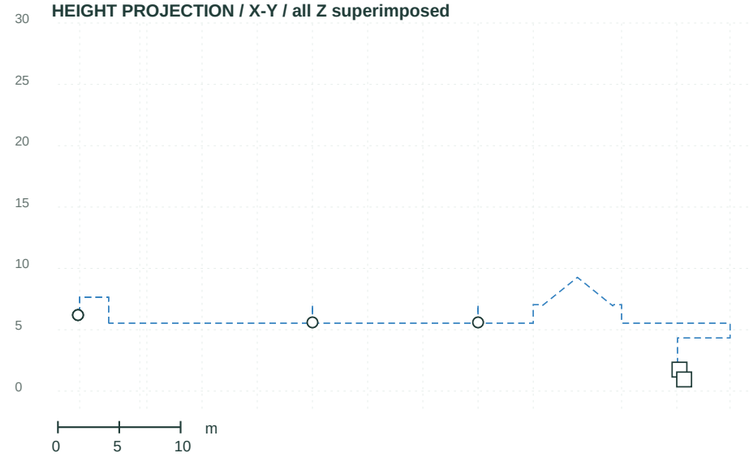

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
S283	-0.140	6.200	-8.300	1-0.14/C-0.94	R354
S284	-0.140	6.200	-11.900	1-0.14/A+1.35	R355
S285	18.975	5.600	-10.750	5+0.00/B-0.34	R356
S286	32.475	5.600	-10.750	8+0.00/B-0.34	R357
S287	-0.140	6.200	8.300	1-0.14/G+0.94	R359
S288	-0.140	6.200	11.900	1-0.14/I-1.35	R360
S289	18.975	5.600	10.750	5+0.00/H+0.34	R361
S290	32.475	5.600	10.750	8+0.00/H+0.34	R362

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
AV1	49.275	0.950	1.400	11+0.60/E-2.20

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I11, I14, I22, I25 (key on sheet IM-01).

THACH BI CHURCH

Microphones


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-023


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

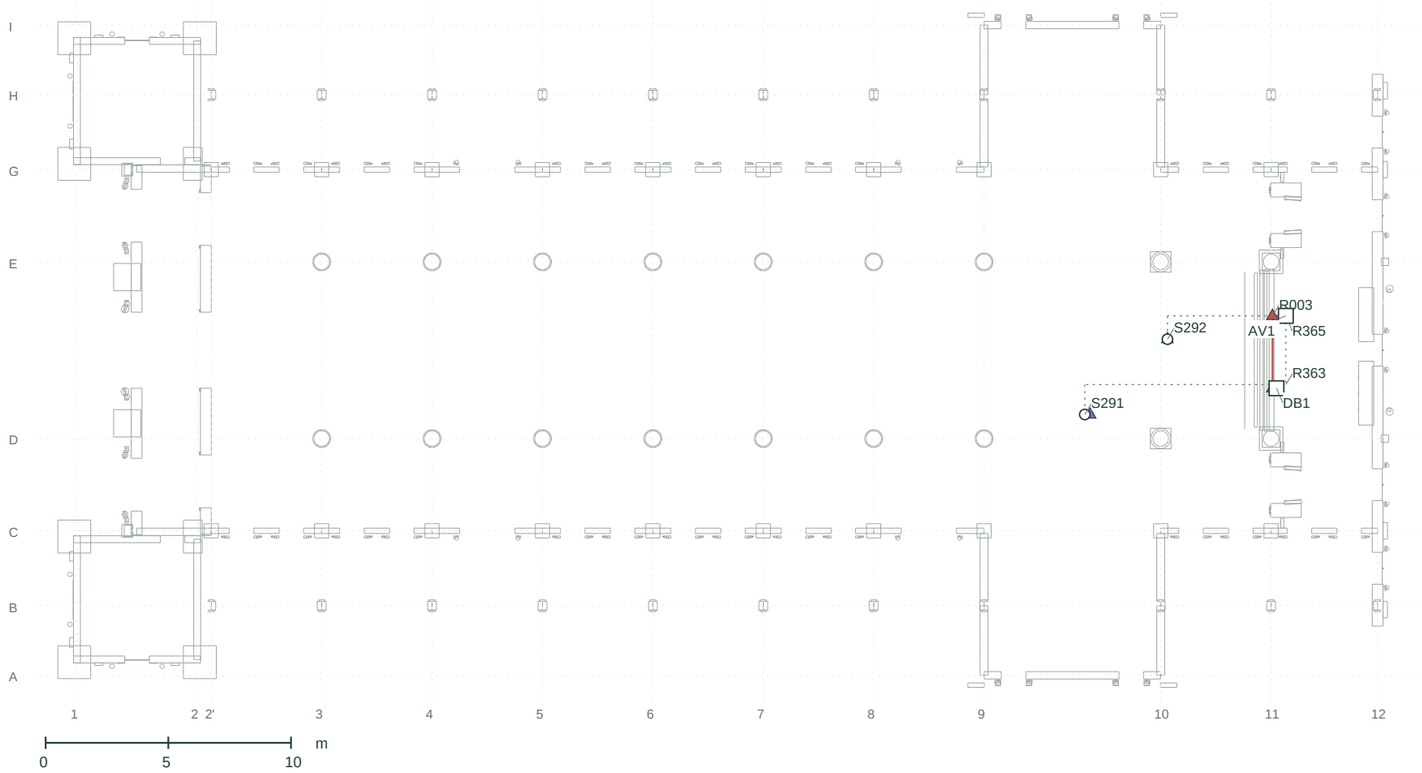

HEIGHT PROJECTION / X-Y / all Z superimposed

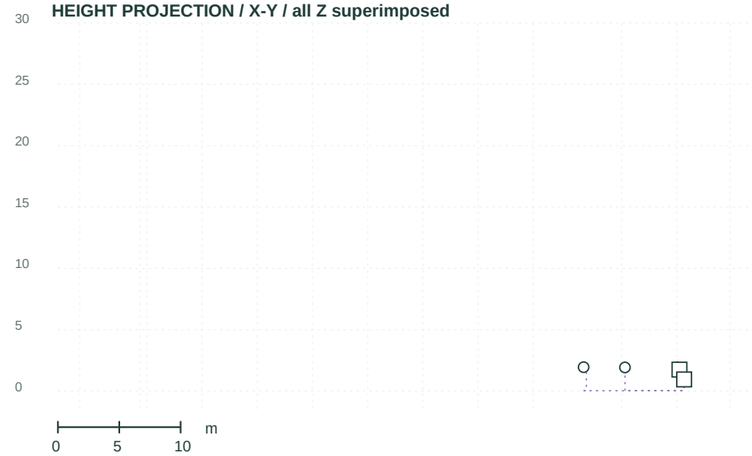

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
S291	41.080	1.950	-2.620	10-3.09/D+0.98	R364
S292	44.450	1.930	0.450	10+0.28/E-3.15	R366

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05	
AV1	49.275	0.950	1.400	11+0.60/E-2.20	

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I18, I19, I20 (key on sheet IM-01).

THACH BI CHURCH

P1 / Sockets / side B (sanctuary + nave)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-024


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

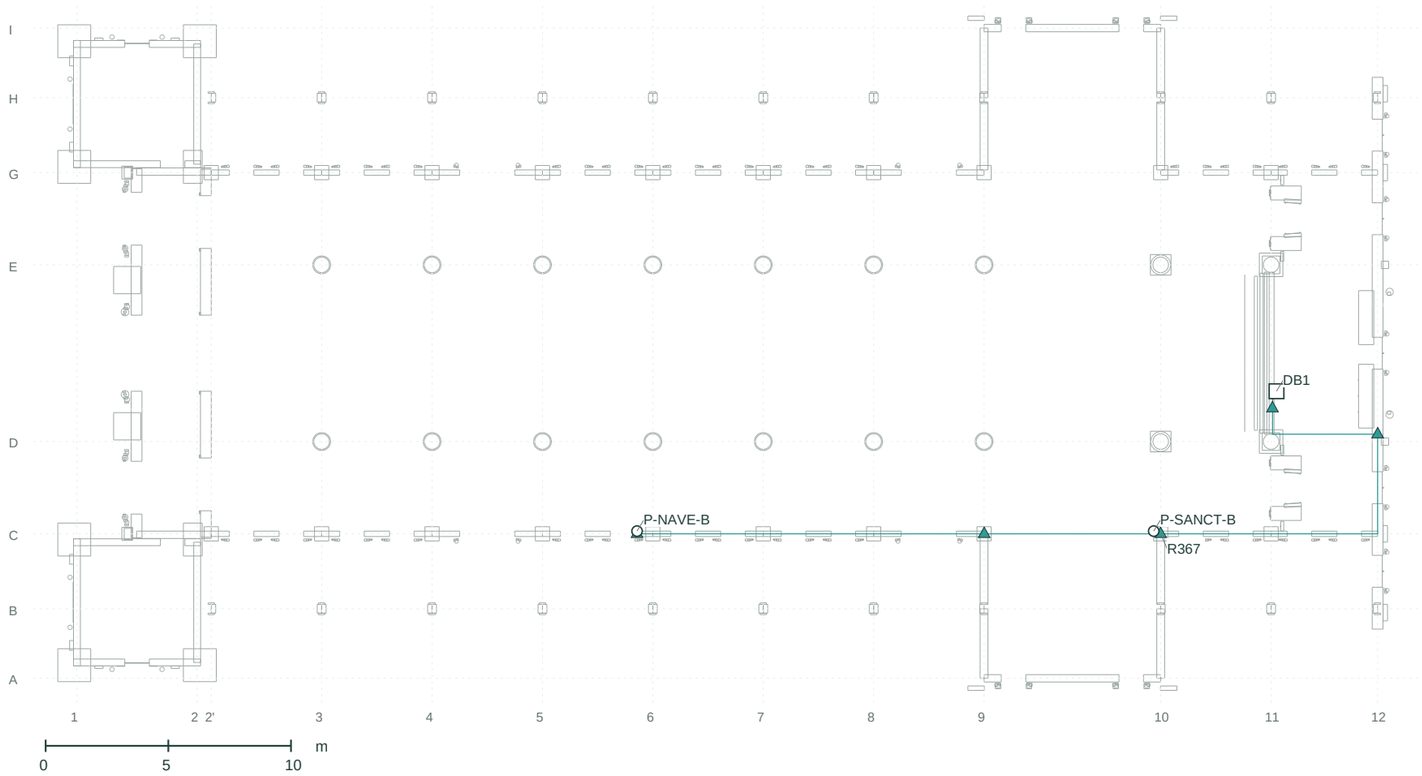

HEIGHT PROJECTION / X-Y / all Z superimposed

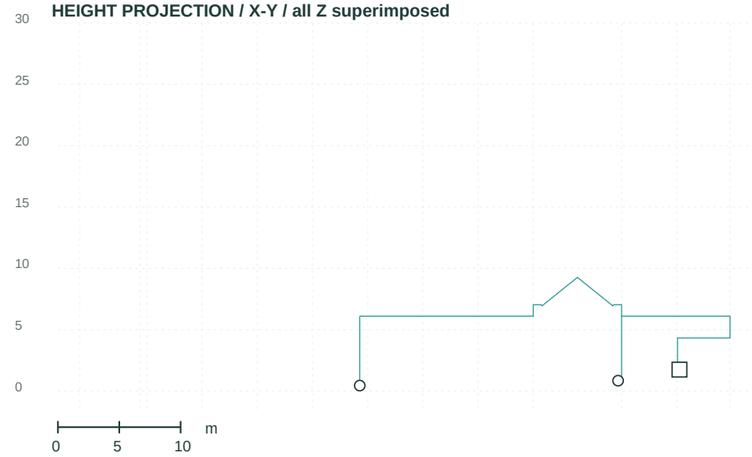

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
P-SANCT-B	43.890	0.850	-7.250	10-0.28/C+0.11	R368
P-NAVE-B	22.830	0.450	-7.250	6-0.65/C+0.11	R369

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05	

2 equipment / 3 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I25 (key on sheet IM-01).

THACH BI CHURCH

P3 / Event power / tower B


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-025


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

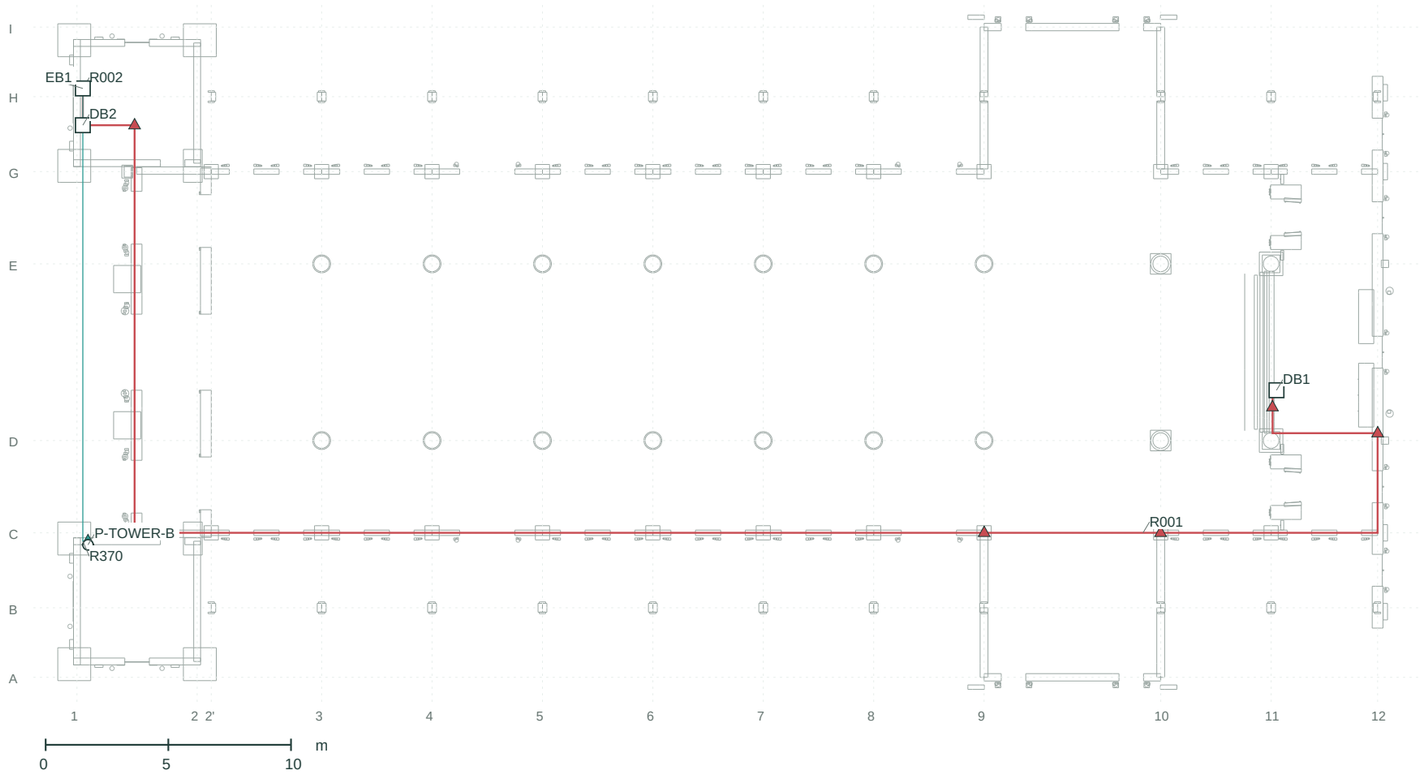

HEIGHT PROJECTION / X-Y / all Z superimposed

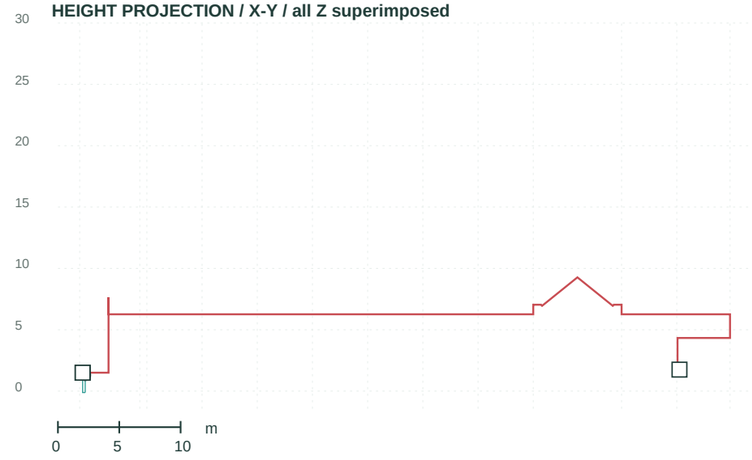

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
P-TOWER-B	0.450	1.300	-7.850	1+0.45/C-0.49	R371

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16
EB1	0.240	1.500	10.750	1+0.24/H+0.34

1 equipment / 4 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I07, I12, I21, I26 (key on sheet IM-01).

THACH BI CHURCH

P2 / Sockets / side H (sanctuary + nave)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-026


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

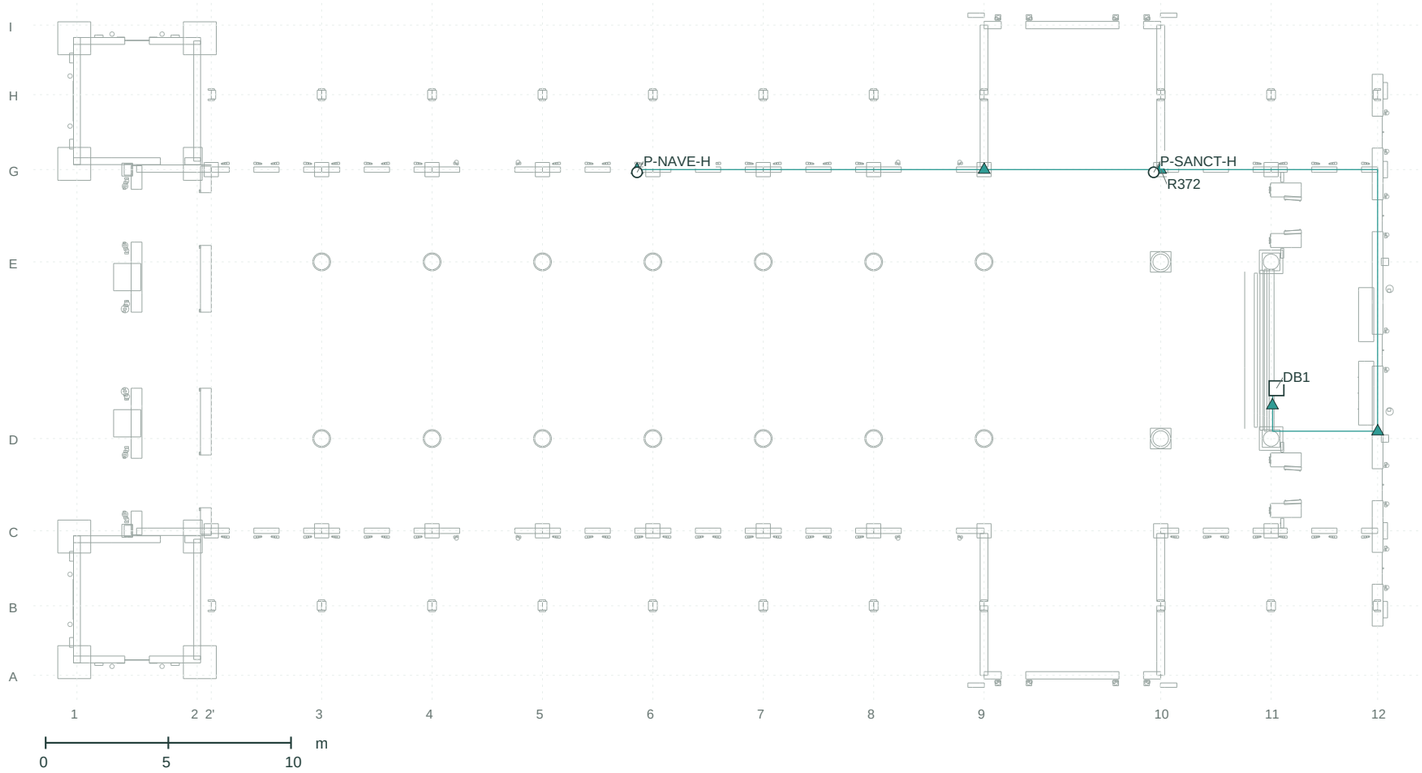

HEIGHT PROJECTION / X-Y / all Z superimposed

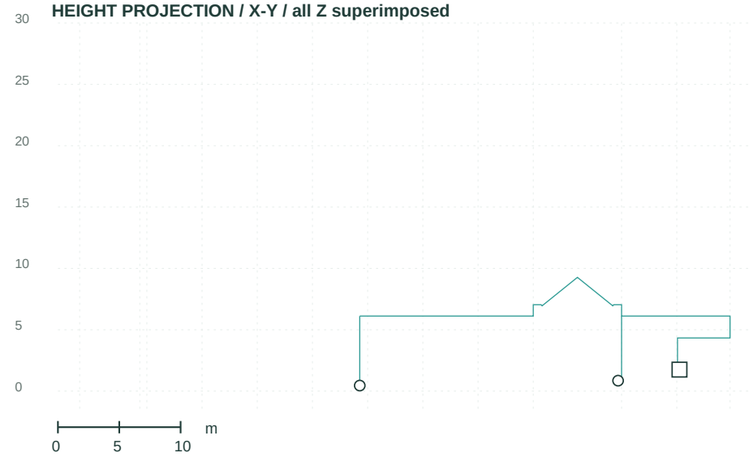

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
P-SANCT-H	43.890	0.850	7.250	10-0.28/G-0.11	R373
P-NAVE-H	22.830	0.450	7.250	6-0.65/G-0.11	R374

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05	

2 equipment / 3 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I25 (key on sheet IM-01).

THACH BI CHURCH

P4 / Event power / tower H


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-027


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

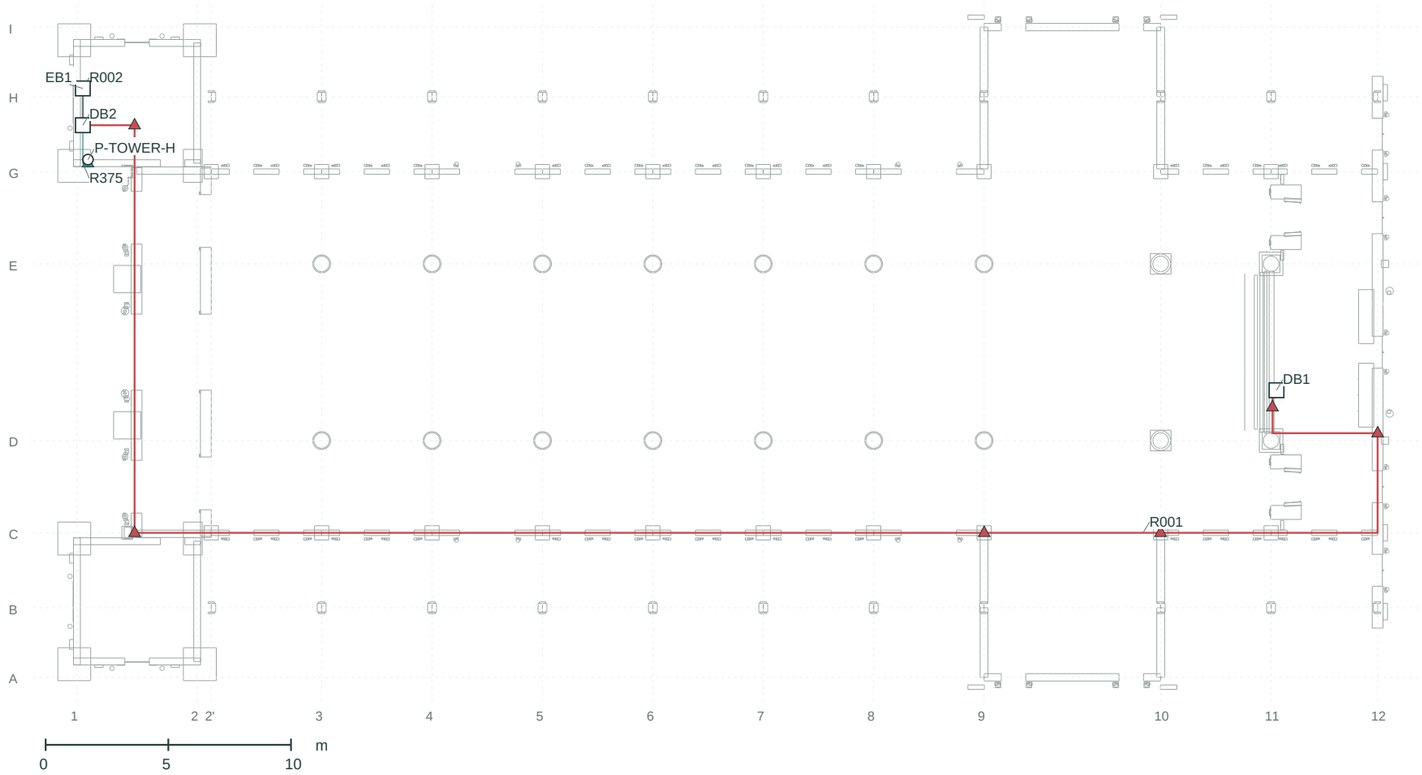

HEIGHT PROJECTION / X-Y / all Z superimposed

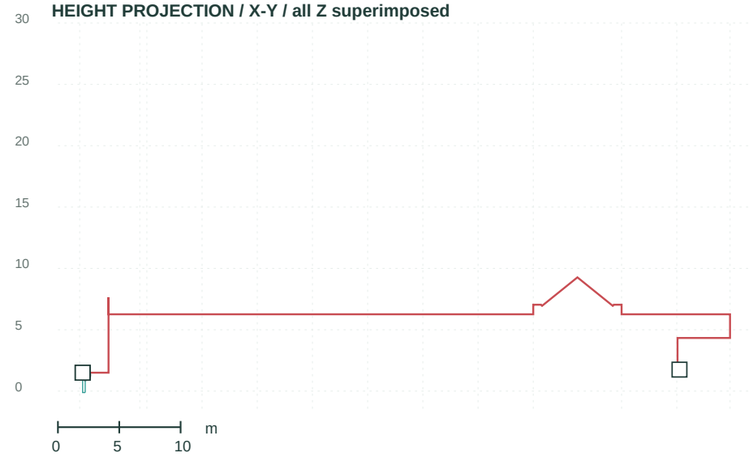

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
P-TOWER-H	0.450	1.300	7.850	1+0.45/G+0.49	R376

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16
EB1	0.240	1.500	10.750	1+0.24/H+0.34

1 equipment / 4 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I07, I12, I21, I26 (key on sheet IM-01).

THACH BI CHURCH

L10 / Facade statues & candles


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-028


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

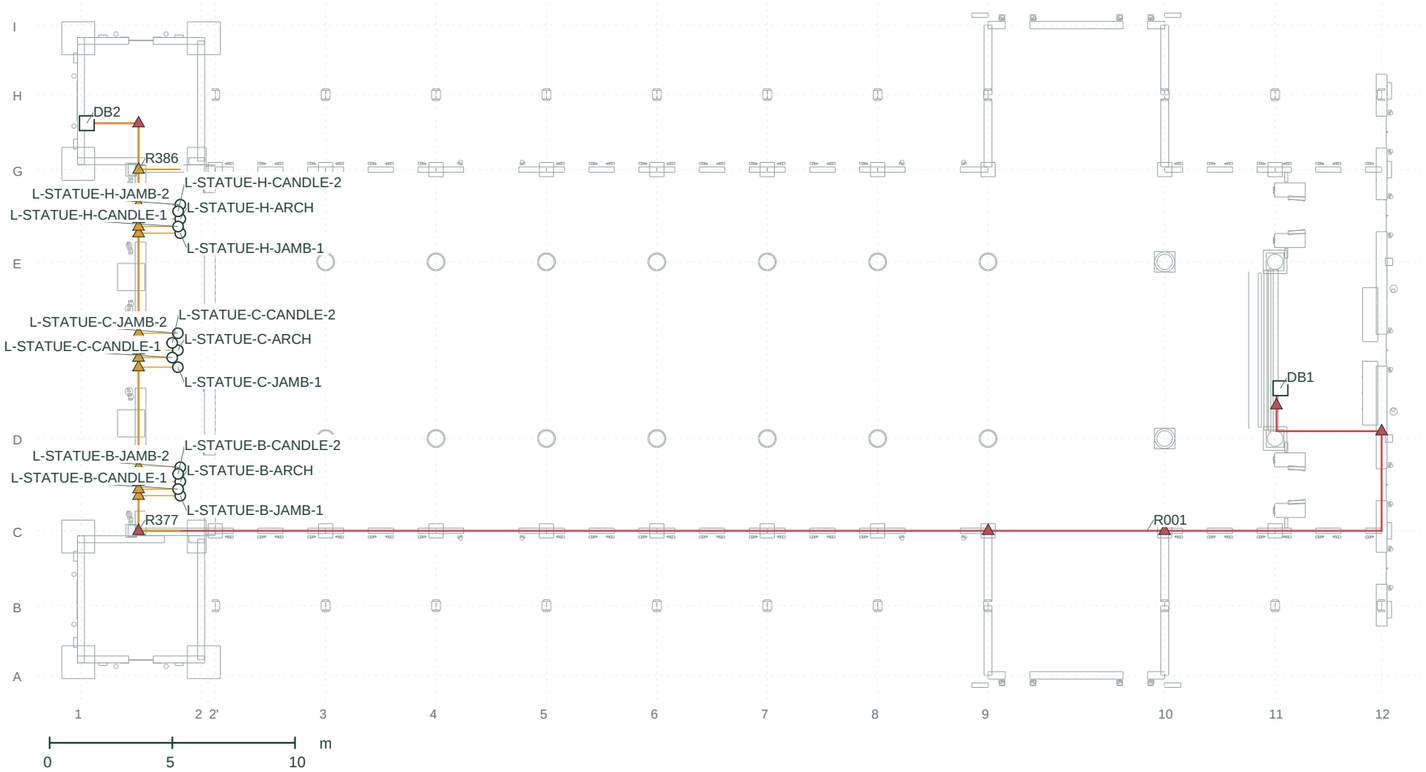

HEIGHT PROJECTION / X-Y / all Z superimposed

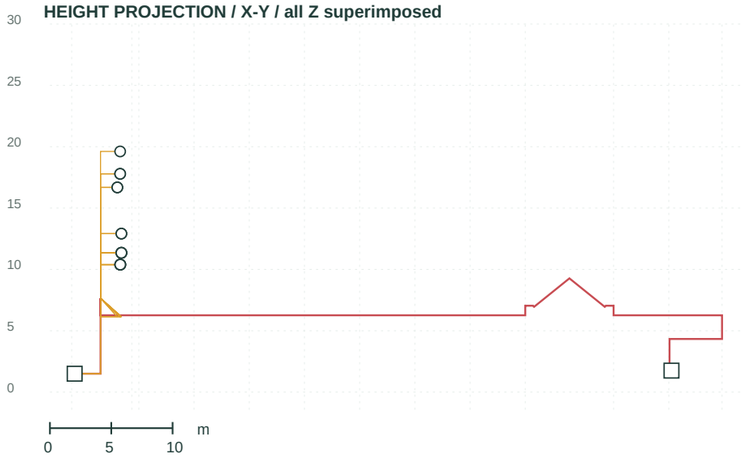

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L-STATUE-C-ARCH	3.950	19.614	0.000	2-0.95/D+3.60	R378
L-STATUE-C-JAMB-1	3.950	17.790	-0.691	2-0.95/D+2.91	R379
L-STATUE-C-CANDLE-1	3.720	16.683	-0.300	2-1.18/D+3.30	R380
L-STATUE-C-JAMB-2	3.950	17.790	0.691	2-0.95/E-2.91	R387
L-STATUE-C-CANDLE-2	3.720	16.683	0.300	2-1.18/E-3.30	R388
L-STATUE-B-ARCH	4.050	12.917	-5.350	2-0.85/D-1.75	R381
L-STATUE-B-JAMB-1	4.050	11.350	-5.929	2-0.85/C+1.43	R382
L-STATUE-B-CANDLE-1	3.960	10.391	-5.660	2-0.94/C+1.70	R383
L-STATUE-B-JAMB-2	4.050	11.350	-4.771	2-0.85/D-1.17	R384
L-STATUE-B-CANDLE-2	3.960	10.391	-5.040	2-0.94/D-1.44	R385
L-STATUE-H-ARCH	4.050	12.917	5.350	2-0.85/E+1.75	R389
L-STATUE-H-JAMB-1	4.050	11.350	4.771	2-0.85/E+1.17	R390
L-STATUE-H-CANDLE-1	3.960	10.391	5.040	2-0.94/E+1.44	R391
L-STATUE-H-JAMB-2	4.050	11.350	5.929	2-0.85/G-1.43	R392
L-STATUE-H-CANDLE-2	3.960	10.391	5.660	2-0.94/G-1.70	R393

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
DB2	0.240	1.500	9.250	1+0.24/H-1.16

15 equipment / 18 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I25, I26 (key on sheet IM-01).

THACH BI CHURCH

LS / Stations of the Cross candles


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-029


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

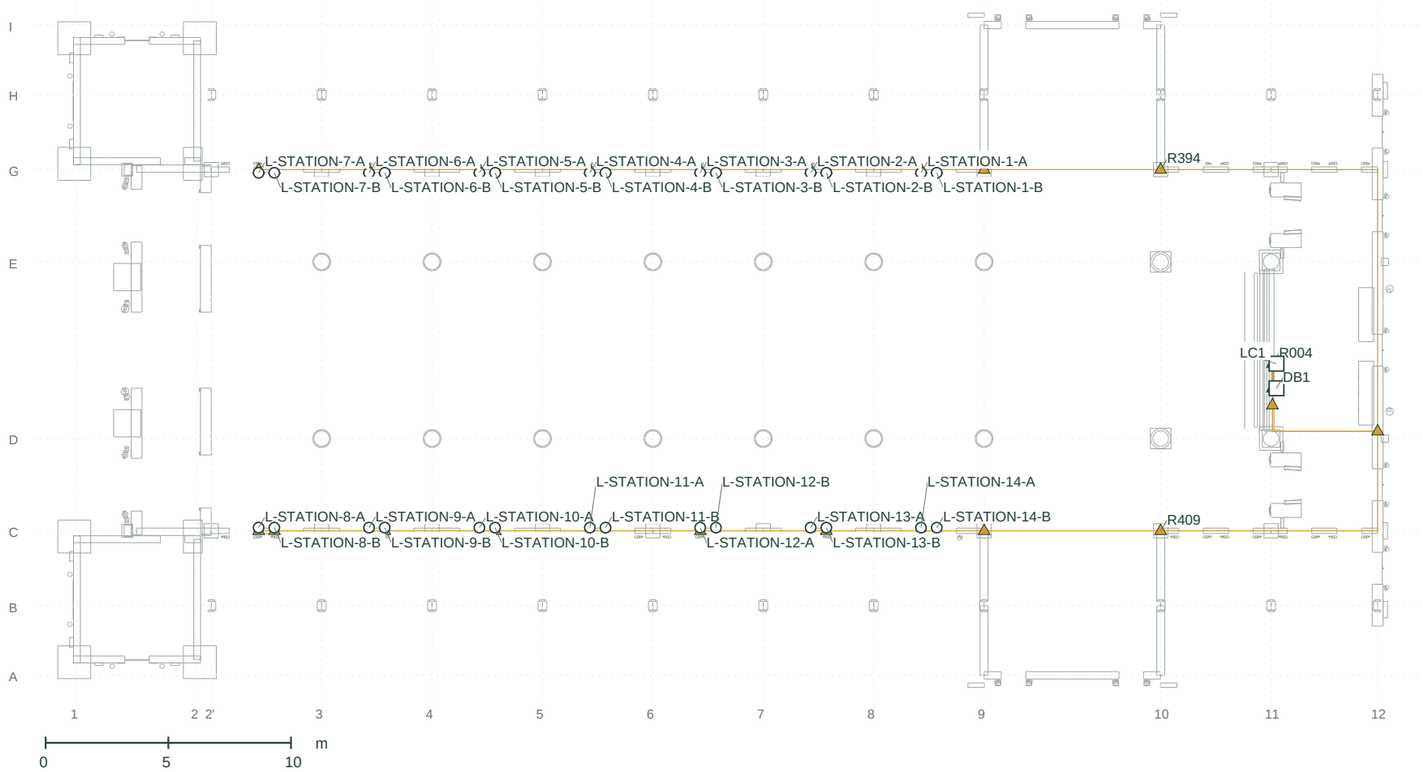

HEIGHT PROJECTION / X-Y / all Z superimposed

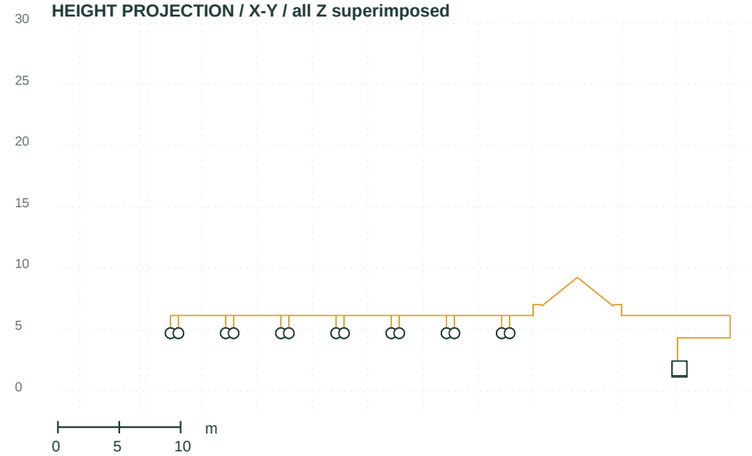

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I14, I25 (key on sheet IM-01).

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L-STATION-1-A	34.405	4.720	7.230	8+1.93/G-0.13	R395
L-STATION-1-B	35.045	4.720	7.230	9-1.93/G-0.13	R396
L-STATION-2-A	29.905	4.720	7.230	7+1.93/G-0.13	R397
L-STATION-2-B	30.545	4.720	7.230	8-1.93/G-0.13	R398
L-STATION-3-A	25.405	4.720	7.230	6+1.93/G-0.13	R399
L-STATION-3-B	26.045	4.720	7.230	7-1.93/G-0.13	R400
L-STATION-4-A	20.905	4.720	7.230	5+1.93/G-0.13	R401
L-STATION-4-B	21.545	4.720	7.230	6-1.93/G-0.13	R402
L-STATION-5-A	16.405	4.720	7.230	4+1.93/G-0.13	R403
L-STATION-5-B	17.045	4.720	7.230	5-1.93/G-0.13	R404
L-STATION-6-A	11.905	4.720	7.230	3+1.93/G-0.13	R405
L-STATION-6-B	12.545	4.720	7.230	4-1.93/G-0.13	R406
L-STATION-7-A	7.405	4.720	7.230	2'+1.93/G-0.13	R407
L-STATION-7-B	8.045	4.720	7.230	3-1.93/G-0.13	R408
L-STATION-8-A	7.405	4.720	-7.230	2'+1.93/C+0.13	R410
L-STATION-8-B	8.045	4.720	-7.230	3-1.93/C+0.13	R411
L-STATION-9-A	11.905	4.720	-7.230	3+1.93/C+0.13	R412
L-STATION-9-B	12.545	4.720	-7.230	4-1.93/C+0.13	R413
L-STATION-10-A	16.405	4.720	-7.230	4+1.93/C+0.13	R414
L-STATION-10-B	17.045	4.720	-7.230	5-1.93/C+0.13	R415
L-STATION-11-A	20.905	4.720	-7.230	5+1.93/C+0.13	R416
L-STATION-11-B	21.545	4.720	-7.230	6-1.93/C+0.13	R417
L-STATION-12-A	25.405	4.720	-7.230	6+1.93/C+0.13	R418
L-STATION-12-B	26.045	4.720	-7.230	7-1.93/C+0.13	R419
L-STATION-13-A	29.905	4.720	-7.230	7+1.93/C+0.13	R420
L-STATION-13-B	30.545	4.720	-7.230	8-1.93/C+0.13	R421
L-STATION-14-A	34.405	4.720	-7.230	8+1.93/C+0.13	R422
L-STATION-14-B	35.045	4.720	-7.230	9-1.93/C+0.13	R423

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05
LC1	48.895	1.850	-0.550	11+0.22/D+3.05

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

Source commit 10e5ce1806 + file hashes in manifest | Routing 2026-10-18-concealed-2

MODEL TRANSCRIPTION / DERIVED. Metres; displayed decimals are not survey accuracy. Review before installation.

A3 / sheet 31

Print 100% / no fit-to-page

THACH BI CHURCH

L8 / Wings / choir & ministers


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-030


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

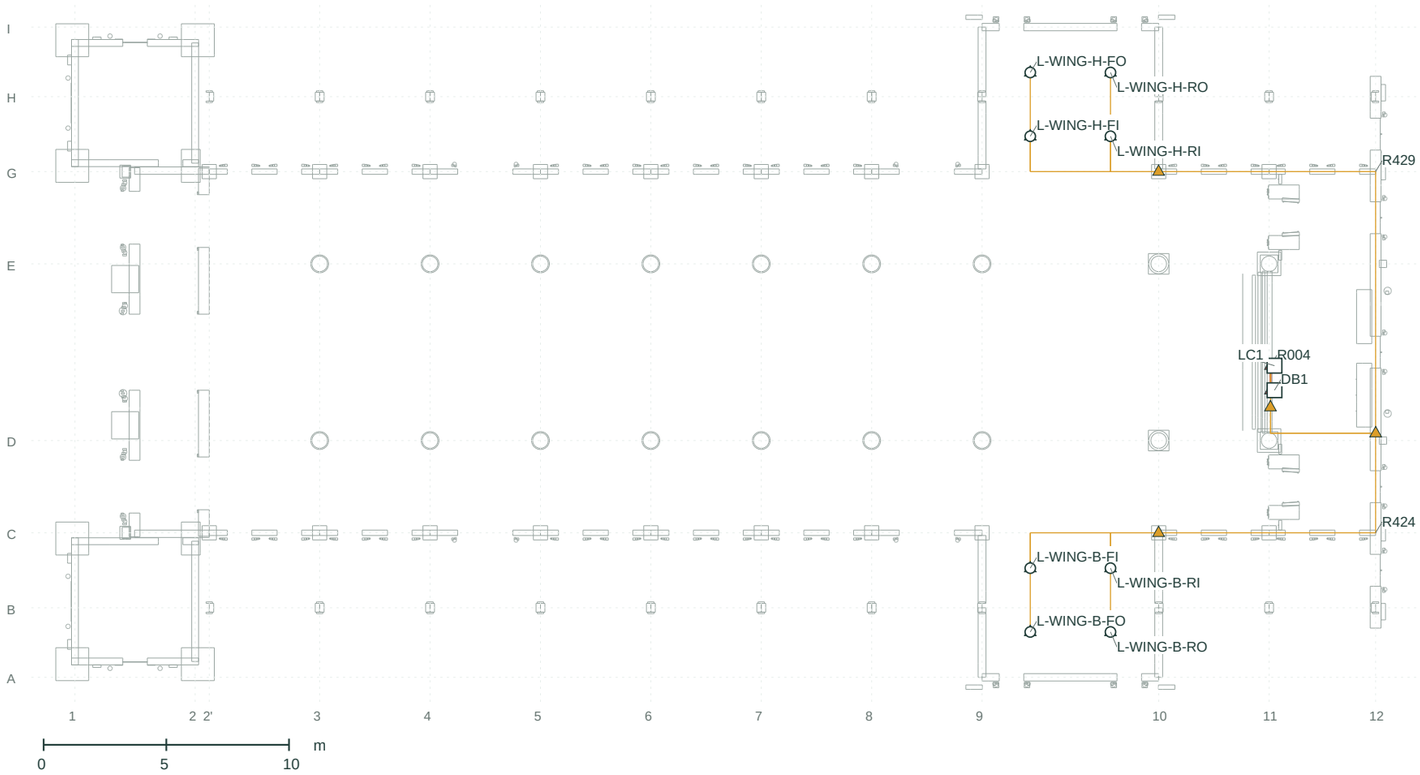

HEIGHT PROJECTION / X-Y / all Z superimposed

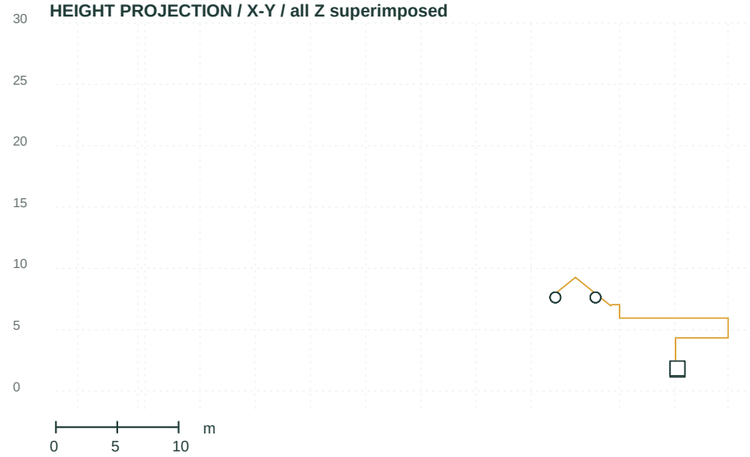

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L-WING-B-FI	38.940	7.636	-8.800	9+1.96/C-1.44	R425
L-WING-B-FO	38.940	7.636	-11.400	9+1.96/B-0.99	R426
L-WING-B-RI	42.210	7.636	-8.800	10-1.96/C-1.44	R427
L-WING-B-RO	42.210	7.636	-11.400	10-1.96/B-0.99	R428
L-WING-H-FI	38.940	7.636	8.800	9+1.96/G+1.44	R430
L-WING-H-FO	38.940	7.636	11.400	9+1.96/H+0.99	R431
L-WING-H-RI	42.210	7.636	8.800	10-1.96/G+1.44	R432
L-WING-H-RO	42.210	7.636	11.400	10-1.96/H+0.99	R433

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05	
LC1	48.895	1.850	-0.550	11+0.22/D+3.05	

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I03, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

LD / Column up/down lights


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-031


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

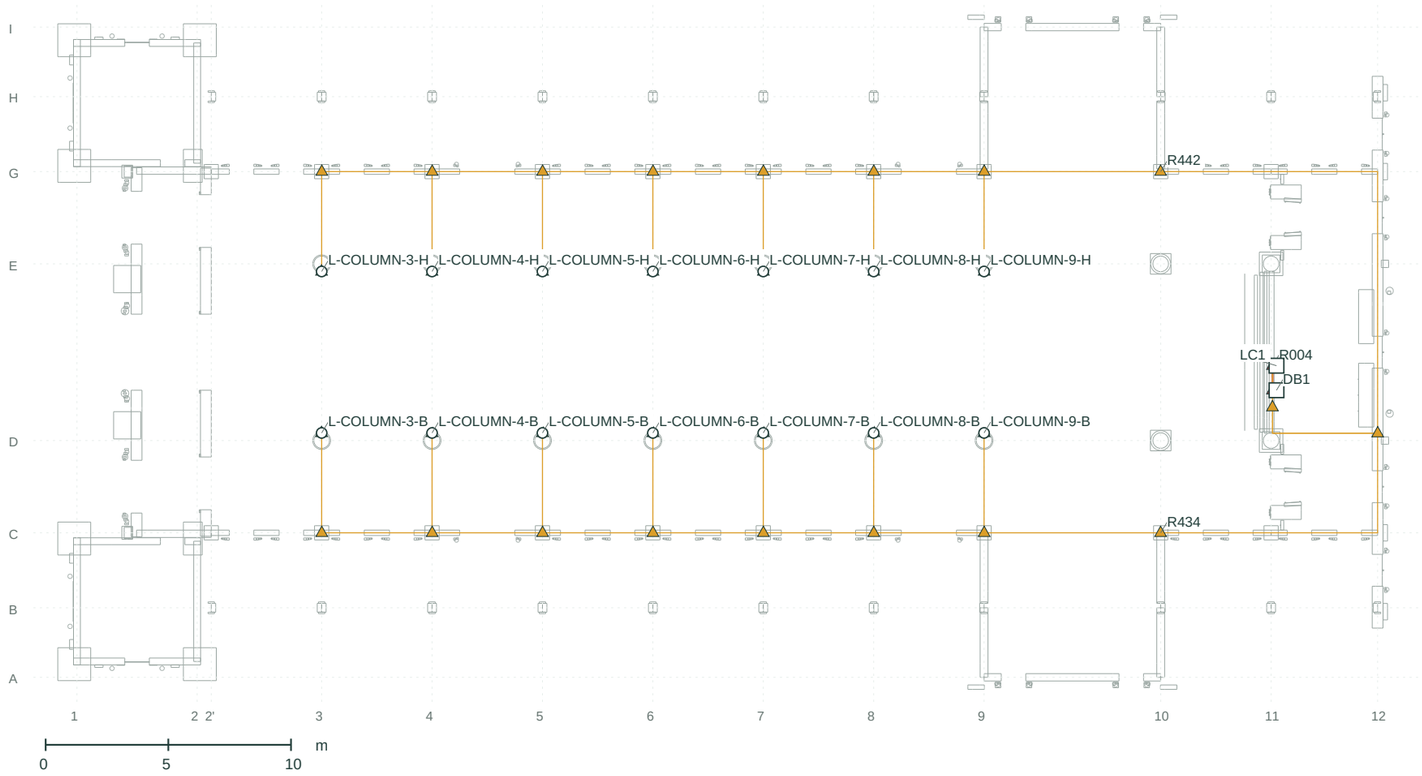

HEIGHT PROJECTION / X-Y / all Z superimposed

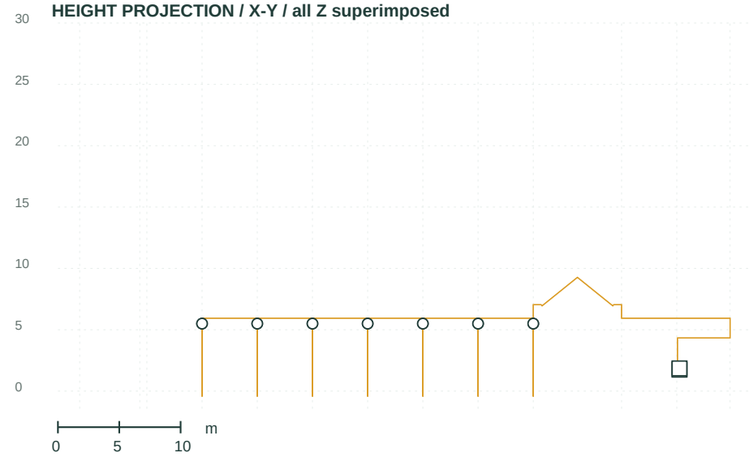

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Grid set-out	Branch
L-COLUMN-3-B	9.975	5.500	-3.290	3+0.00/D+0.31	R435
L-COLUMN-3-H	9.975	5.500	3.290	3+0.00/E-0.31	R443
L-COLUMN-4-B	14.475	5.500	-3.290	4+0.00/D+0.31	R436
L-COLUMN-4-H	14.475	5.500	3.290	4+0.00/E-0.31	R444
L-COLUMN-5-B	18.975	5.500	-3.290	5+0.00/D+0.31	R437
L-COLUMN-5-H	18.975	5.500	3.290	5+0.00/E-0.31	R445
L-COLUMN-6-B	23.475	5.500	-3.290	6+0.00/D+0.31	R438
L-COLUMN-6-H	23.475	5.500	3.290	6+0.00/E-0.31	R446
L-COLUMN-7-B	27.975	5.500	-3.290	7+0.00/D+0.31	R439
L-COLUMN-7-H	27.975	5.500	3.290	7+0.00/E-0.31	R447
L-COLUMN-8-B	32.475	5.500	-3.290	8+0.00/D+0.31	R440
L-COLUMN-8-H	32.475	5.500	3.290	8+0.00/E-0.31	R448
L-COLUMN-9-B	36.975	5.500	-3.290	9+0.00/D+0.31	R441
L-COLUMN-9-H	36.975	5.500	3.290	9+0.00/E-0.31	R449

Related enclosures

DB1	48.895	1.750	-1.550	11+0.22/D+2.05	
LC1	48.895	1.850	-0.550	11+0.22/D+3.05	

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I15, I25 (key on sheet IM-01).

THACH BI CHURCH

Tower fronts / conduit risers and decoration clearances

Front cut at X = +0.05 m (conduit plane) 1:150 at A3 / tower routes projected on Z-Y / metres


TW-01

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Tower B / seen from the courtyard

Tower H / seen from the courtyard

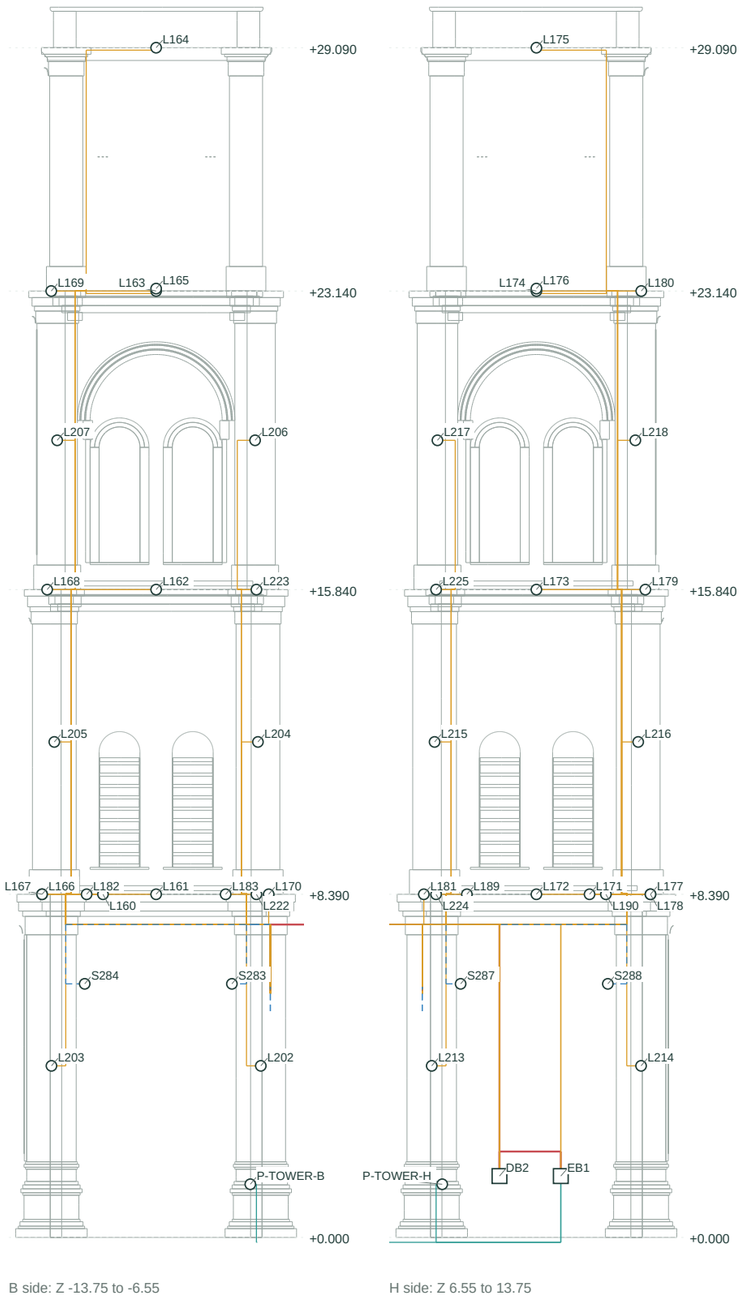

B side: Z -13.75 to -6.55

H side: Z 6.55 to 13.75

0 2.5 5 m

RISERS IN THE TOWER FRONT WALL

Tower	Grid set-out	From h	To h	Clear of arch	Routes
B	1+0.45/C-0.34	h-0.12	h+1.30	0.50 m	1: R371
B	1+0.00/C-0.58	h+4.20	h+7.65	0.26 m	1: R234
B	1+0.00/C-0.58	h+6.20	h+7.65	-	1: R354
B	1+0.00/C-0.58	h+7.65	h+8.40	-	5: R167/R211/R212/R236/R238
B	1+0.09/C-0.71	h+8.40	h+15.85	0.13 m	2: R212/R238
B	1+0.09/C-0.71	h+8.40	h+12.12	0.13 m	1: R236
B	1+0.19/C-0.81	h+15.85	h+19.49	0.06 m	1: R238
B	1+0.47/A+1.39	h+23.15	h+29.03	0.22 m	1: R204
B	1+0.19/A+1.11	h+15.85	h+23.15	0.06 m	4: R203/R204/R205/R209
B	1+0.19/A+1.11	h+15.85	h+19.49	0.06 m	1: R239
B	1+0.09/A+1.01	h+8.40	h+15.85	0.13 m	7: R202/R203/R204/R205/R208/R209 ...
B	1+0.09/A+1.01	h+8.40	h+12.12	0.13 m	1: R237
B	1+0.00/A+0.89	h+4.20	h+7.65	0.25 m	1: R235
B	1+0.00/A+0.89	h+6.20	h+7.65	-	1: R355
B	1+0.00/A+0.89	h+7.65	h+8.40	-	13: R166/R200/R201/R202/R203/R204 ...
H	1+0.45/G+0.34	h-0.12	h+1.30	0.50 m	1: R376
H	1+0.00/G+0.58	h+4.20	h+7.65	0.26 m	1: R248
H	1+0.00/G+0.58	h+6.20	h+7.65	-	1: R359
H	1+0.00/G+0.58	h+7.65	h+8.40	-	5: R170/R225/R226/R250/R252
H	1+0.09/G+0.71	h+8.40	h+15.85	0.13 m	2: R226/R252
H	1+0.09/G+0.71	h+8.40	h+12.12	0.13 m	1: R250
H	1+0.19/G+0.81	h+15.85	h+19.49	0.06 m	1: R252
H	1+0.24/H-1.16	h+1.50	h+2.10	board, room face	1: R002
H	1+0.24/H+0.34	h-0.12	h+1.50	board, room face	2: R370/R375
H	1+0.24/H+0.34	h+1.50	h+2.10	board, room face	1: R002
H	1+0.47/I-1.39	h+23.15	h+29.03	0.22 m	1: R218
H	1+0.19/I-1.11	h+15.85	h+23.15	0.06 m	4: R217/R218/R219/R223
H	1+0.19/I-1.11	h+15.85	h+19.49	0.06 m	1: R253
H	1+0.09/I-1.01	h+8.40	h+15.85	0.13 m	7: R216/R217/R218/R219/R222/R223 ...
H	1+0.09/I-1.01	h+8.40	h+12.12	0.13 m	1: R251
H	1+0.00/I-0.89	h+4.20	h+7.65	0.25 m	1: R249
H	1+0.00/I-0.89	h+6.20	h+7.65	-	1: R360
H	1+0.00/I-0.89	h+7.65	h+8.40	-	13: R171/R214/R215/R216/R217/R218 ...

Clear of arch: horizontal distance from the riser to the nearest traced arch envelope (outer moulding ring of the ground or stage arch) over the same height. Negative means inside the arch; louvres, roses and paired openings all lie inside these envelopes.

CAD basis (DWG 23 Oct 2026): the tower drawings dimension only the levels -2.080 / +0.000 / +8.390 / +15.840 / +23.140 / +29.090 / +36.920, the 4.900 m tower width and the 5.830 x 4.130 m plan at +15.84. Arch, louvre and rose centres and radii are traced from drawn lines (E01B, E02), not dimensioned. The DWG has no text for decoration sizes, materials or electrical items.

B / H: the sheet follows model axes (B left, H right seen from the courtyard). The CAD sheets draw H on the left (ENG-027 open). Name towers by grid letter, never left or right.

Keep risers in the solid corner piers. Never chase through louvres, roses or arch mouldings. Wall thickness, pier core, reinforcement and chase depth are on ENGINEERING HOLD; confirm on site before cutting.

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L1	L3	DB1	Service-room LED panel / 600 x 600 mm	Service-room ceiling panel / 50.0 m
L2	L3	DB1	Service-room LED panel / 600 x 600 mm	Service-room ceiling panel / 51.9 m
L3	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / B central
L4	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / B central / twin
L5	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / H central
L6	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / H central / twin
L7	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / B central
L8	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / B central / twin
L9	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / H central
L10	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / H central / twin
L11	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / B central
L12	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / B central / twin
L13	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / H central
L14	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / H central / twin
L15	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / B central
L16	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / B central / twin
L17	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / H central
L18	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / H central / twin
L19	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / B central
L20	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / B central / twin
L21	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / H central
L22	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / H central / twin
L23	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / B central
L24	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / B central / twin
L25	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / H central
L26	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / H central / twin
L27	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / B central
L28	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / B central / twin
L29	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / H central
L30	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / H central / twin
L31	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / B outer
L32	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / B outer / twin
L33	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / H outer
L34	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 3 / H outer / twin
L35	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / B outer
L36	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / B outer / twin
L37	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / H outer
L38	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 4 / H outer / twin
L39	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / B outer

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L40	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / B outer / twin
L41	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / H outer
L42	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 5 / H outer / twin
L43	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / B outer
L44	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / B outer / twin
L45	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / H outer
L46	L2	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 6 / H outer / twin
L47	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / B outer
L48	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / B outer / twin
L49	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / H outer
L50	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 7 / H outer / twin
L51	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / B outer
L52	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / B outer / twin
L53	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / H outer
L54	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 8 / H outer / twin
L55	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / B outer
L56	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / B outer / twin
L57	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / H outer
L58	L1	DB1	Reading projector / side bracket, finish-matched	Reading light / axis 9 / H outer / twin
L59	L2	DB1	Reading projector / side bracket, finish-matched	Rear rows light / entrance facade / B
L60	L2	DB1	Reading projector / side bracket, finish-matched	Rear centre light / entrance facade / B
L61	L2	DB1	Reading projector / side bracket, finish-matched	Rear rows light / entrance facade / H
L62	L2	DB1	Reading projector / side bracket, finish-matched	Rear centre light / entrance facade / H
L71	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 3
L72	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 4
L73	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 5
L74	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 6
L75	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 7
L76	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 8
L77	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 9
L81	L3	DB1	Grand chandelier / 12 lamps	Grand chandelier / crossing 9-10
L98	L3	DB1	LED projector / narrow 24	Altar key light / B
L99	L3	DB1	LED projector / narrow 24	Altar key light / H
L100	L3	DB1	Accent spotlight / 15	Ambo key light
L101	L3	DB1	LED projector / medium 36	Sanctuary step fill / B
L102	L3	DB1	LED projector / medium 36	Sanctuary step fill / H
L103	L3	DB1	Accent spotlight / 15	Presider chair light
L104	L3	DB1	LED projector / medium 36	Sanctuary frame wash / B
L105	L3	DB1	LED projector / medium 36	Sanctuary frame wash / H

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L106	L3	DB1	Accent spotlight / 15	Crucifix accent / B
L107	L3	DB1	LED projector / medium 36	Reredos wash / B
L108	L3	DB1	LED projector / medium 36	Reredos base wash / B
L109	L3	DB1	Roof uplight / wide flood	Sanctuary vault uplight / B
L110	L3	DB1	Accent spotlight / 15	Crucifix accent / H
L111	L3	DB1	LED projector / medium 36	Reredos wash / H
L112	L3	DB1	LED projector / medium 36	Reredos base wash / H
L113	L3	DB1	Roof uplight / wide flood	Sanctuary vault uplight / H
L114	L3	DB1	Accent spotlight / 15	Tabernacle accent
L115	L3	DB1	Accent spotlight / 15	Statue accent / B
L116	L3	DB1	LED projector / medium 36	Shrine wash / B
L117	L3	DB1	Accent spotlight / 15	Statue accent / H
L118	L3	DB1	LED projector / medium 36	Shrine wash / H
L119	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 2'-3
L120	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 3-4
L121	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 4-5
L122	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 5-6
L123	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 6-7
L124	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 7-8
L125	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 8-9
L126	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 10-11
L127	L4	DB1	Open-porch wall flood / concept	Porch path light / B / bay 11-12
L128	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 2'-3
L129	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 3-4
L130	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 4-5
L131	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 5-6
L132	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 6-7
L133	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 7-8
L134	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 8-9
L135	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 10-11
L136	L4	DB1	Open-porch wall flood / concept	Porch path light / H / bay 11-12
L137	L9	DB2	Wall lantern	Central front door lantern / B
L138	L9	DB2	Wall lantern	Central front door lantern / H
L139	L5	DB1	Wall lantern	Side door lantern / B / 16.725 / front
L140	L5	DB1	Wall lantern	Side door lantern / B / 16.725 / rear
L141	L5	DB1	Wall lantern	Side door lantern / B / 34.725 / front
L142	L5	DB1	Wall lantern	Side door lantern / B / 34.725 / rear
L145	L5	DB1	Wall lantern	Side door lantern / H / 16.725 / front
L146	L5	DB1	Wall lantern	Side door lantern / H / 16.725 / rear

THACH BI CHURCH

EQ-04

Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L147	L5	DB1	Wall lantern	Side door lantern / H / 34.725 / front
L148	L5	DB1	Wall lantern	Side door lantern / H / 34.725 / rear
L151	L3	DB1	Wall lantern	Service door lantern / B / front
L152	L3	DB1	Wall lantern	Service door lantern / B / rear
L153	L3	DB1	Wall lantern	Service door lantern / H / front
L154	L3	DB1	Wall lantern	Service door lantern / H / rear
L155	E1	DB1	Exit sign (maintained)	Exit sign / main doors
L156	E1	DB1	Exit sign (maintained)	Exit sign / side door 16.7 / B
L157	E1	DB1	Exit sign (maintained)	Exit sign / side door 16.7 / H
L158	E1	DB1	Exit sign (maintained)	Exit sign / side door 34.7 / B
L159	E1	DB1	Exit sign (maintained)	Exit sign / side door 34.7 / H
L160	L6	DB2	Compact ledge floodlight / cornice colour	Tower lower front wash / B
L161	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 2 flood / B
L162	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 3 flood / B
L163	L6	DB2	Tower ledge light bar / cornice colour	Belfry front wash / B
L164	L6	DB2	Compact ledge floodlight / cornice colour	Dome front wash / B
L165	L6	DB2	Roof uplight / wide flood	Belfry glow / B
L166	L6	DB2	Compact ledge floodlight / cornice colour	Tower lower side wash / B
L167	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 2 side wash / B
L168	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 3 side wash / B
L169	L6	DB2	Tower ledge light bar / cornice colour	Belfry side wash / B
L170	L6	DB2	Compact ledge floodlight / cornice colour	Facade wash / B
L171	L6	DB2	Compact ledge floodlight / cornice colour	Tower lower front wash / H
L172	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 2 flood / H
L173	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 3 flood / H
L174	L6	DB2	Tower ledge light bar / cornice colour	Belfry front wash / H
L175	L6	DB2	Compact ledge floodlight / cornice colour	Dome front wash / H
L176	L6	DB2	Roof uplight / wide flood	Belfry glow / H
L177	L6	DB2	Compact ledge floodlight / cornice colour	Tower lower side wash / H
L178	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 2 side wash / H
L179	L6	DB2	Tower ledge light bar / cornice colour	Tower stage 3 side wash / H
L180	L6	DB2	Tower ledge light bar / cornice colour	Belfry side wash / H
L181	L6	DB2	Compact ledge floodlight / cornice colour	Facade wash / H
L182	L9	DB2	Compact ledge floodlight / cornice colour	Stage flood / tower B / outer
L183	L9	DB2	Compact ledge floodlight / cornice colour	Stage flood / tower B / inner
L184	L5	DB1	LED projector / medium 36	Path light / axis 4 / B
L185	L5	DB1	LED projector / medium 36	Path light / axis 6 / B
L186	L5	DB1	LED projector / medium 36	Path light / axis 11 / B
L187	L5	DB1	LED projector / medium 36	Path light / wing gable B

THACH BI CHURCH

EQ-05

Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L188	L5	DB1	LED projector / medium 36	Path light / rear / B
L189	L9	DB2	Compact ledge floodlight / cornice colour	Stage flood / tower H / inner
L190	L9	DB2	Compact ledge floodlight / cornice colour	Stage flood / tower H / outer
L191	L5	DB1	LED projector / medium 36	Path light / axis 4 / H
L192	L5	DB1	LED projector / medium 36	Path light / axis 6 / H
L193	L5	DB1	LED projector / medium 36	Path light / axis 11 / H
L194	L5	DB1	LED projector / medium 36	Path light / wing gable H
L195	L5	DB1	LED projector / medium 36	Path light / rear / H
L196	L7	DB2	Festival bulb string (outdoor)	Festival lights / roof ridge
L197	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave B / nave
L198	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave B / sanctuary
L199	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave B / nave
L200	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave B / sanctuary
L201	L7	DB2	Festival bulb string (outdoor)	Festival lights / rear gable B
L202	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 1 / inner corner
L203	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 1 / outer corner
L204	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 2 / inner corner
L205	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 2 / outer corner
L206	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 3 / inner corner
L207	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 3 / outer corner
L208	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave H / nave
L209	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave H / sanctuary
L210	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave H / nave
L211	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave H / sanctuary
L212	L7	DB2	Festival bulb string (outdoor)	Festival lights / rear gable H
L213	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 1 / inner corner
L214	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 1 / outer corner
L215	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 2 / inner corner
L216	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 2 / outer corner
L217	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 3 / inner corner
L218	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 3 / outer corner
L219	L7	DB2	Festival bulb string (outdoor)	Festival lights / front terrace between the towers
L220	L7	DB2	Facade floodlight	Festival flood / rear gable B
L221	L7	DB2	Facade floodlight	Festival flood / rear gable H
L222	L6	DB2	Compact ledge floodlight / cornice colour	Central gable flood / B
L223	L6	DB2	Compact ledge floodlight / cornice colour	Central crown wash / B
L224	L6	DB2	Compact ledge floodlight / cornice colour	Central gable flood / H
L225	L6	DB2	Compact ledge floodlight / cornice colour	Central crown wash / H
F226	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 2'-3 / B aisle

THACH BI CHURCH

EQ-06

Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
F227	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 2'-3 / H aisle
F228	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 3-4 / B aisle
F229	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 3-4 / H aisle
F230	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 4-5 / B aisle
F231	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 4-5 / H aisle
F232	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 5-6 / B aisle
F233	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 5-6 / H aisle
F234	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 6-7 / B aisle
F235	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 6-7 / H aisle
F236	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 7-8 / B aisle
F237	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 7-8 / H aisle
F238	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 8-9 / B aisle
F239	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 8-9 / H aisle
F240	F5	DB1	Wing wall fan / 45 cm / extended bracket concept	Wall fan / wing B / 1 / held review
F241	F5	DB1	Wing wall fan / 45 cm / extended bracket concept	Wall fan / wing B / 2 / held review
F242	F5	DB1	Wing wall fan / 45 cm / extended bracket concept	Wall fan / wing H / 1 / held review
F243	F5	DB1	Wing wall fan / 45 cm / extended bracket concept	Wall fan / wing H / 2 / held review
F244	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 4 / B
F245	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 4 / H
F246	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 6 / B
F247	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 6 / H
F248	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 8 / B
F249	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 8 / H
F250	F4	DB2	Large wall circulator / 90 cm	Entrance circulator / B
F251	F4	DB2	Large wall circulator / 90 cm	Entrance circulator / H
F252	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / B outer
F253	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / B inner
F254	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / H inner
F255	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / H outer
F256	V2	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable B / front
F257	V2	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable B / rear
F258	V2	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable H / front
F259	V2	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable H / rear
F260	V3	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / service room
S261	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 4 / B
S262	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 4 / H
S263	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 5 / B
S264	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 5 / H
S265	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 6 / B

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
S266	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 6 / H
S267	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 7 / B
S268	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 7 / H
S269	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 8 / B
S270	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 8 / H
S271	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 9 / B
S272	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 9 / H
S273	A5	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / entrance hall / B
S274	A5	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / entrance hall / H
S276	A1	DB1	Slim wall column / 0.6 m, wall colour	Wing speaker / B / toward entrance / held
S278	A1	DB1	Slim wall column / 0.6 m, wall colour	Wing speaker / H / toward entrance / held
S279	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 3-4
S280	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 6-7
S281	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 3-4
S282	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 6-7
S283	A3	DB1	Outdoor horn / 30 W	Courtyard horn / B
S284	A3	DB1	Outdoor horn / 30 W	Tower horn / B / outer
S285	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 5 / B
S286	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 8 / B
S287	A3	DB1	Outdoor horn / 30 W	Courtyard horn / H
S288	A3	DB1	Outdoor horn / 30 W	Tower horn / H / outer
S289	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 5 / H
S290	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 8 / H
S291	MIC	DB1	Gooseneck microphone (cardioid)	Ambo microphone
S292	MIC	DB1	Gooseneck microphone (cardioid)	Altar microphone
F-NAVE-B-2P	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 2' / B
F-NAVE-H-2P	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 2' / H
F-NAVE-B-3	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 3 / B
F-NAVE-H-3	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 3 / H
F-NAVE-B-5	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 5 / B
F-NAVE-H-5	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 5 / H
F-NAVE-B-7	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 7 / B
F-NAVE-H-7	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 7 / H
F-NAVE-B-9	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 9 / B
F-NAVE-H-9	F2	DB1	Nave wall fan / 45 cm / extended bracket concept	Wall fan / axis 9 / H
P-SANCT-B	P1	DB1	Double socket outlet / 16 A / recessed	Socket / sanctuary side B / axis 10 pier
P-NAVE-B	P1	DB1	Double socket outlet / 16 A / recessed	Socket / mid-nave side B / axis 6
P-TOWER-B	P3	DB2	Event power point / 32 A + 2 x 16 A / lockable	Event power / tower B / inside the porch
P-SANCT-H	P2	DB1	Double socket outlet / 16 A / recessed	Socket / sanctuary side H / axis 10 pier

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
P-NAVE-H	P2	DB1	Double socket outlet / 16 A / recessed	Socket / mid-nave side H / axis 6
P-TOWER-H	P4	DB2	Event power point / 32 A + 2 x 16 A / lockable	Event power / tower H / inside the porch
L-STATUE-C-ARCH	L10	DB2	Concealed light line / niche arch	Hidden arch light / Assumption of Our Lady
L-STATUE-C-JAMB-1	L10	DB2	Concealed light line / niche jamb	Hidden jamb light / Assumption of Our Lady / B side
L-STATUE-C-CANDLE-1	L10	DB2	Statue candle light / electric flame	Statue candle light / Assumption of Our Lady / B side
L-STATUE-C-JAMB-2	L10	DB2	Concealed light line / niche jamb	Hidden jamb light / Assumption of Our Lady / H side
L-STATUE-C-CANDLE-2	L10	DB2	Statue candle light / electric flame	Statue candle light / Assumption of Our Lady / H side
L-STATUE-B-ARCH	L10	DB2	Concealed light line / niche arch	Hidden arch light / Saint Peter
L-STATUE-B-JAMB-1	L10	DB2	Concealed light line / niche jamb	Hidden jamb light / Saint Peter / B side
L-STATUE-B-CANDLE-1	L10	DB2	Statue candle light / electric flame	Statue candle light / Saint Peter / B side
L-STATUE-B-JAMB-2	L10	DB2	Concealed light line / niche jamb	Hidden jamb light / Saint Peter / H side
L-STATUE-B-CANDLE-2	L10	DB2	Statue candle light / electric flame	Statue candle light / Saint Peter / H side
L-STATUE-H-ARCH	L10	DB2	Concealed light line / niche arch	Hidden arch light / Saint Paul
L-STATUE-H-JAMB-1	L10	DB2	Concealed light line / niche jamb	Hidden jamb light / Saint Paul / B side
L-STATUE-H-CANDLE-1	L10	DB2	Statue candle light / electric flame	Statue candle light / Saint Paul / B side
L-STATUE-H-JAMB-2	L10	DB2	Concealed light line / niche jamb	Hidden jamb light / Saint Paul / H side
L-STATUE-H-CANDLE-2	L10	DB2	Statue candle light / electric flame	Statue candle light / Saint Paul / H side
L-STATION-1-A	LS	DB1	Station candle light / wall	Station candle / I / front
L-STATION-1-B	LS	DB1	Station candle light / wall	Station candle / I / rear
L-STATION-2-A	LS	DB1	Station candle light / wall	Station candle / II / front
L-STATION-2-B	LS	DB1	Station candle light / wall	Station candle / II / rear
L-STATION-3-A	LS	DB1	Station candle light / wall	Station candle / III / front
L-STATION-3-B	LS	DB1	Station candle light / wall	Station candle / III / rear
L-STATION-4-A	LS	DB1	Station candle light / wall	Station candle / IV / front
L-STATION-4-B	LS	DB1	Station candle light / wall	Station candle / IV / rear
L-STATION-5-A	LS	DB1	Station candle light / wall	Station candle / V / front
L-STATION-5-B	LS	DB1	Station candle light / wall	Station candle / V / rear
L-STATION-6-A	LS	DB1	Station candle light / wall	Station candle / VI / front
L-STATION-6-B	LS	DB1	Station candle light / wall	Station candle / VI / rear
L-STATION-7-A	LS	DB1	Station candle light / wall	Station candle / VII / front
L-STATION-7-B	LS	DB1	Station candle light / wall	Station candle / VII / rear
L-STATION-8-A	LS	DB1	Station candle light / wall	Station candle / VIII / front
L-STATION-8-B	LS	DB1	Station candle light / wall	Station candle / VIII / rear
L-STATION-9-A	LS	DB1	Station candle light / wall	Station candle / IX / front
L-STATION-9-B	LS	DB1	Station candle light / wall	Station candle / IX / rear
L-STATION-10-A	LS	DB1	Station candle light / wall	Station candle / X / front
L-STATION-10-B	LS	DB1	Station candle light / wall	Station candle / X / rear
L-STATION-11-A	LS	DB1	Station candle light / wall	Station candle / XI / front
L-STATION-11-B	LS	DB1	Station candle light / wall	Station candle / XI / rear

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L-STATION-12-A	LS	DB1	Station candle light / wall	Station candle / XII / front
L-STATION-12-B	LS	DB1	Station candle light / wall	Station candle / XII / rear
L-STATION-13-A	LS	DB1	Station candle light / wall	Station candle / XIII / front
L-STATION-13-B	LS	DB1	Station candle light / wall	Station candle / XIII / rear
L-STATION-14-A	LS	DB1	Station candle light / wall	Station candle / XIV / front
L-STATION-14-B	LS	DB1	Station candle light / wall	Station candle / XIV / rear
L-WING-B-FI	L8	DB1	LED projector / narrow 24	Wing downlight / B / front block / inner row
L-WING-B-FO	L8	DB1	LED projector / narrow 24	Wing downlight / B / front block / outer row
L-WING-B-RI	L8	DB1	LED projector / narrow 24	Wing downlight / B / rear block / inner row
L-WING-B-RO	L8	DB1	LED projector / narrow 24	Wing downlight / B / rear block / outer row
L-WING-H-FI	L8	DB1	LED projector / narrow 24	Wing downlight / H / front block / inner row
L-WING-H-FO	L8	DB1	LED projector / narrow 24	Wing downlight / H / front block / outer row
L-WING-H-RI	L8	DB1	LED projector / narrow 24	Wing downlight / H / rear block / inner row
L-WING-H-RO	L8	DB1	LED projector / narrow 24	Wing downlight / H / rear block / outer row
L-COLUMN-3-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 3 / B
L-COLUMN-3-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 3 / H
L-COLUMN-4-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 4 / B
L-COLUMN-4-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 4 / H
L-COLUMN-5-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 5 / B
L-COLUMN-5-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 5 / H
L-COLUMN-6-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 6 / B
L-COLUMN-6-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 6 / H
L-COLUMN-7-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 7 / B
L-COLUMN-7-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 7 / H
L-COLUMN-8-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 8 / B
L-COLUMN-8-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 8 / H
L-COLUMN-9-B	LD	DB1	Column up/down light / concept	Column up/down light / axis 9 / B
L-COLUMN-9-H	LD	DB1	Column up/down light / concept	Column up/down light / axis 9 / H
L-ARCH-B-2P-3-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 2'-3 / A
L-ARCH-B-2P-3-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 2'-3 / B
S-PORCH-B-2P-3	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 2'-3
L-ARCH-B-3-4-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 3-4 / A
L-ARCH-B-3-4-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 3-4 / B
L-ARCH-B-4-5-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 4-5 / A
L-ARCH-B-4-5-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 4-5 / B
S-PORCH-B-4-5	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 4-5
L-ARCH-B-5-6-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 5-6 / A
L-ARCH-B-5-6-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 5-6 / B
S-PORCH-B-5-6	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 5-6

Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L-ARCH-B-6-7-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 6-7 / A
L-ARCH-B-6-7-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 6-7 / B
L-ARCH-B-7-8-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 7-8 / A
L-ARCH-B-7-8-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 7-8 / B
S-PORCH-B-7-8	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 7-8
L-ARCH-B-8-9-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 8-9 / A
L-ARCH-B-8-9-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 8-9 / B
S-PORCH-B-8-9	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 8-9
L-ARCH-B-10-11-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 10-11 / A
L-ARCH-B-10-11-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 10-11 / B
S-PORCH-B-10-11	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 10-11
L-ARCH-B-11-12-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 11-12 / A
L-ARCH-B-11-12-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / B / bay 11-12 / B
S-PORCH-B-11-12	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / B / bay 11-12
L-ARCH-H-2P-3-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 2'-3 / A
L-ARCH-H-2P-3-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 2'-3 / B
S-PORCH-H-2P-3	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 2'-3
L-ARCH-H-3-4-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 3-4 / A
L-ARCH-H-3-4-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 3-4 / B
L-ARCH-H-4-5-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 4-5 / A
L-ARCH-H-4-5-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 4-5 / B
S-PORCH-H-4-5	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 4-5
L-ARCH-H-5-6-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 5-6 / A
L-ARCH-H-5-6-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 5-6 / B
S-PORCH-H-5-6	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 5-6
L-ARCH-H-6-7-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 6-7 / A
L-ARCH-H-6-7-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 6-7 / B
L-ARCH-H-7-8-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 7-8 / A
L-ARCH-H-7-8-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 7-8 / B
S-PORCH-H-7-8	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 7-8
L-ARCH-H-8-9-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 8-9 / A
L-ARCH-H-8-9-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 8-9 / B
S-PORCH-H-8-9	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 8-9
L-ARCH-H-10-11-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 10-11 / A
L-ARCH-H-10-11-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 10-11 / B
S-PORCH-H-10-11	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 10-11
L-ARCH-H-11-12-A	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 11-12 / A
L-ARCH-H-11-12-B	L4	DB1	Open-porch wall flood / concept	Porch arch wash / H / bay 11-12 / B
S-PORCH-H-11-12	A2	DB1	Open-porch wall fill / 6" / concept	Porch fill / H / bay 11-12

THACH BI CHURCH

RI-01

Unique route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R001	feeder:DB2	DB1	DB2-FEED	Shared context	94.96	-
R002	feeder:EB1	DB2	EB1-SUPPLY	Shared context	2.70	-
R003	feeder:AV1	DB1	AV1-SUPPLY	Shared context	5.79	-
R004	feeder:LC1	DB1	LC1-SUPPLY	Shared context	2.56	-
R005	feeder:FC1	DB1	FC1-SUPPLY	Shared context	3.41	-
R006	local:L1	LC1	L3	L1	8.03	-
R007	local:L2	LC1	L3	L2	9.93	-
R008	trunk:LC1:L2:light:-1	LC1	L2	Shared context	66.83	-
R009	drop:LC1:L2:light:-1:L3	LC1	L2	L3	9.70	-
R010	drop:LC1:L2:light:-1:L4	LC1	L2	L4	8.14	-
R011	drop:LC1:L2:light:-1:L7	LC1	L2	L7	9.70	-
R012	drop:LC1:L2:light:-1:L8	LC1	L2	L8	8.14	-
R013	drop:LC1:L2:light:-1:L11	LC1	L2	L11	9.70	-
R014	drop:LC1:L2:light:-1:L12	LC1	L2	L12	8.14	-
R015	drop:LC1:L2:light:-1:L16	LC1	L2	L16	8.14	-
R016	drop:LC1:L2:light:-1:L31	LC1	L2	L31	2.86	-
R017	drop:LC1:L2:light:-1:L32	LC1	L2	L32	4.10	-
R018	drop:LC1:L2:light:-1:L35	LC1	L2	L35	2.86	-
R019	drop:LC1:L2:light:-1:L36	LC1	L2	L36	4.10	-
R020	drop:LC1:L2:light:-1:L39	LC1	L2	L39	2.86	-
R021	drop:LC1:L2:light:-1:L40	LC1	L2	L40	4.10	-
R022	drop:LC1:L2:light:-1:L44	LC1	L2	L44	4.10	-
R023	drop:LC1:L2:light:-1:L59	LC1	L2	L59	13.40	-
R024	drop:LC1:L2:light:-1:L60	LC1	L2	L60	13.85	-
R025	trunk:LC1:L2:light:1	LC1	L2	Shared context	73.43	-
R026	drop:LC1:L2:light:1:L5	LC1	L2	L5	9.70	-
R027	drop:LC1:L2:light:1:L6	LC1	L2	L6	8.14	-
R028	drop:LC1:L2:light:1:L9	LC1	L2	L9	9.70	-
R029	drop:LC1:L2:light:1:L10	LC1	L2	L10	8.14	-
R030	drop:LC1:L2:light:1:L13	LC1	L2	L13	9.70	-
R031	drop:LC1:L2:light:1:L14	LC1	L2	L14	8.14	-
R032	drop:LC1:L2:light:1:L18	LC1	L2	L18	8.14	-
R033	drop:LC1:L2:light:1:L33	LC1	L2	L33	2.86	-
R034	drop:LC1:L2:light:1:L34	LC1	L2	L34	4.10	-
R035	drop:LC1:L2:light:1:L37	LC1	L2	L37	2.86	-
R036	drop:LC1:L2:light:1:L38	LC1	L2	L38	4.10	-
R037	drop:LC1:L2:light:1:L41	LC1	L2	L41	2.86	-
R038	drop:LC1:L2:light:1:L42	LC1	L2	L42	4.10	-
R039	drop:LC1:L2:light:1:L46	LC1	L2	L46	4.10	-

Unique route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R040	drop:LC1:L2:light:1:L61	LC1	L2	L61	13.40	-
R041	drop:LC1:L2:light:1:L62	LC1	L2	L62	13.85	-
R042	trunk:LC1:L1:light:-1	LC1	L1	Shared context	48.73	-
R043	drop:LC1:L1:light:-1:L15	LC1	L1	L15	9.71	-
R044	drop:LC1:L1:light:-1:L19	LC1	L1	L19	9.71	-
R045	drop:LC1:L1:light:-1:L20	LC1	L1	L20	8.14	-
R046	drop:LC1:L1:light:-1:L23	LC1	L1	L23	9.71	-
R047	drop:LC1:L1:light:-1:L24	LC1	L1	L24	8.14	-
R048	drop:LC1:L1:light:-1:L27	LC1	L1	L27	8.57	-
R049	drop:LC1:L1:light:-1:L28	LC1	L1	L28	7.00	-
R050	drop:LC1:L1:light:-1:L43	LC1	L1	L43	2.86	-
R051	drop:LC1:L1:light:-1:L47	LC1	L1	L47	2.86	-
R052	drop:LC1:L1:light:-1:L48	LC1	L1	L48	4.11	-
R053	drop:LC1:L1:light:-1:L51	LC1	L1	L51	2.86	-
R054	drop:LC1:L1:light:-1:L52	LC1	L1	L52	4.11	-
R055	drop:LC1:L1:light:-1:L55	LC1	L1	L55	1.72	-
R056	drop:LC1:L1:light:-1:L56	LC1	L1	L56	2.97	-
R057	trunk:LC1:L1:light:1	LC1	L1	Shared context	55.33	-
R058	drop:LC1:L1:light:1:L17	LC1	L1	L17	9.71	-
R059	drop:LC1:L1:light:1:L21	LC1	L1	L21	9.71	-
R060	drop:LC1:L1:light:1:L22	LC1	L1	L22	8.14	-
R061	drop:LC1:L1:light:1:L25	LC1	L1	L25	9.71	-
R062	drop:LC1:L1:light:1:L26	LC1	L1	L26	8.14	-
R063	drop:LC1:L1:light:1:L29	LC1	L1	L29	8.57	-
R064	drop:LC1:L1:light:1:L30	LC1	L1	L30	7.00	-
R065	drop:LC1:L1:light:1:L45	LC1	L1	L45	2.86	-
R066	drop:LC1:L1:light:1:L49	LC1	L1	L49	2.86	-
R067	drop:LC1:L1:light:1:L50	LC1	L1	L50	4.11	-
R068	drop:LC1:L1:light:1:L53	LC1	L1	L53	2.86	-
R069	drop:LC1:L1:light:1:L54	LC1	L1	L54	4.11	-
R070	drop:LC1:L1:light:1:L57	LC1	L1	L57	1.72	-
R071	drop:LC1:L1:light:1:L58	LC1	L1	L58	2.97	-
R072	trunk:LC1:LA:light:-1	LC1	LA	Shared context	62.31	-
R073	drop:LC1:LA:light:-1:L71	LC1	LA	L71	10.20	-
R074	drop:LC1:LA:light:-1:L72	LC1	LA	L72	10.20	-
R075	drop:LC1:LA:light:-1:L73	LC1	LA	L73	10.20	-
R076	drop:LC1:LA:light:-1:L74	LC1	LA	L74	10.20	-
R077	drop:LC1:LA:light:-1:L75	LC1	LA	L75	10.20	-
R078	drop:LC1:LA:light:-1:L76	LC1	LA	L76	10.20	-

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R079	drop:LC1:LA:light:-1:L77	LC1	LA	L77	10.20	-
R080	trunk:LC1:L3:light:-1	LC1	L3	Shared context	35.32	-
R081	drop:LC1:L3:light:-1:L81	LC1	L3	L81	11.56	-
R082	drop:LC1:L3:light:-1:L98	LC1	L3	L98	9.91	-
R083	drop:LC1:L3:light:-1:L100	LC1	L3	L100	9.19	-
R084	drop:LC1:L3:light:-1:L101	LC1	L3	L101	9.41	-
R085	drop:LC1:L3:light:-1:L104	LC1	L3	L104	10.71	-
R086	drop:LC1:L3:light:-1:L106	LC1	L3	L106	9.55	-
R087	drop:LC1:L3:light:-1:L107	LC1	L3	L107	9.20	-
R088	drop:LC1:L3:light:-1:L108	LC1	L3	L108	8.75	-
R089	drop:LC1:L3:light:-1:L109	LC1	L3	L109	10.07	-
R090	drop:LC1:L3:light:-1:L114	LC1	L3	L114	8.30	-
R091	drop:LC1:L3:light:-1:L115	LC1	L3	L115	8.06	-
R092	drop:LC1:L3:light:-1:L116	LC1	L3	L116	8.12	-
R093	drop:LC1:L3:light:-1:L151	LC1	L3	L151	6.93	-
R094	drop:LC1:L3:light:-1:L152	LC1	L3	L152	4.93	-
R095	trunk:LC1:L3:light:1	LC1	L3	Shared context	41.92	-
R096	drop:LC1:L3:light:1:L99	LC1	L3	L99	9.91	-
R097	drop:LC1:L3:light:1:L102	LC1	L3	L102	9.41	-
R098	drop:LC1:L3:light:1:L103	LC1	L3	L103	8.31	-
R099	drop:LC1:L3:light:1:L105	LC1	L3	L105	10.71	-
R100	drop:LC1:L3:light:1:L110	LC1	L3	L110	9.55	-
R101	drop:LC1:L3:light:1:L111	LC1	L3	L111	9.20	-
R102	drop:LC1:L3:light:1:L112	LC1	L3	L112	8.75	-
R103	drop:LC1:L3:light:1:L113	LC1	L3	L113	10.07	-
R104	drop:LC1:L3:light:1:L117	LC1	L3	L117	8.06	-
R105	drop:LC1:L3:light:1:L118	LC1	L3	L118	8.12	-
R106	drop:LC1:L3:light:1:L153	LC1	L3	L153	6.93	-
R107	drop:LC1:L3:light:1:L154	LC1	L3	L154	4.93	-
R108	trunk:LC1:L4:light:-1	LC1	L4	Shared context	66.74	-
R109	drop:LC1:L4:light:-1:L119	LC1	L4	L119	2.93	-
R110	drop:LC1:L4:light:-1:L120	LC1	L4	L120	2.93	-
R111	drop:LC1:L4:light:-1:L121	LC1	L4	L121	2.93	-
R112	drop:LC1:L4:light:-1:L122	LC1	L4	L122	2.93	-
R113	drop:LC1:L4:light:-1:L123	LC1	L4	L123	2.93	-
R114	drop:LC1:L4:light:-1:L124	LC1	L4	L124	2.93	-
R115	drop:LC1:L4:light:-1:L125	LC1	L4	L125	2.93	-
R116	drop:LC1:L4:light:-1:L126	LC1	L4	L126	2.93	-
R117	drop:LC1:L4:light:-1:L127	LC1	L4	L127	2.93	-

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R118	drop:LC1:L4:light:-1:L-ARCH-B-2P-3-A	LC1	L4	L-ARCH-B-2P-3-A	8.21	-
R119	drop:LC1:L4:light:-1:L-ARCH-B-2P-3-B	LC1	L4	L-ARCH-B-2P-3-B	8.21	-
R120	drop:LC1:L4:light:-1:L-ARCH-B-3-4-A	LC1	L4	L-ARCH-B-3-4-A	8.21	-
R121	drop:LC1:L4:light:-1:L-ARCH-B-3-4-B	LC1	L4	L-ARCH-B-3-4-B	8.21	-
R122	drop:LC1:L4:light:-1:L-ARCH-B-4-5-A	LC1	L4	L-ARCH-B-4-5-A	8.21	-
R123	drop:LC1:L4:light:-1:L-ARCH-B-4-5-B	LC1	L4	L-ARCH-B-4-5-B	8.21	-
R124	drop:LC1:L4:light:-1:L-ARCH-B-5-6-A	LC1	L4	L-ARCH-B-5-6-A	8.21	-
R125	drop:LC1:L4:light:-1:L-ARCH-B-5-6-B	LC1	L4	L-ARCH-B-5-6-B	8.21	-
R126	drop:LC1:L4:light:-1:L-ARCH-B-6-7-A	LC1	L4	L-ARCH-B-6-7-A	8.21	-
R127	drop:LC1:L4:light:-1:L-ARCH-B-6-7-B	LC1	L4	L-ARCH-B-6-7-B	8.21	-
R128	drop:LC1:L4:light:-1:L-ARCH-B-7-8-A	LC1	L4	L-ARCH-B-7-8-A	8.21	-
R129	drop:LC1:L4:light:-1:L-ARCH-B-7-8-B	LC1	L4	L-ARCH-B-7-8-B	8.21	-
R130	drop:LC1:L4:light:-1:L-ARCH-B-8-9-A	LC1	L4	L-ARCH-B-8-9-A	8.21	-
R131	drop:LC1:L4:light:-1:L-ARCH-B-8-9-B	LC1	L4	L-ARCH-B-8-9-B	8.24	-
R132	drop:LC1:L4:light:-1:L-ARCH-B-10-11-A	LC1	L4	L-ARCH-B-10-11-A	8.24	-
R133	drop:LC1:L4:light:-1:L-ARCH-B-10-11-B	LC1	L4	L-ARCH-B-10-11-B	8.21	-
R134	drop:LC1:L4:light:-1:L-ARCH-B-11-12-A	LC1	L4	L-ARCH-B-11-12-A	8.21	-
R135	drop:LC1:L4:light:-1:L-ARCH-B-11-12-B	LC1	L4	L-ARCH-B-11-12-B	6.77	-
R136	trunk:LC1:L4:light:1	LC1	L4	Shared context	73.34	-
R137	drop:LC1:L4:light:1:L128	LC1	L4	L128	2.93	-
R138	drop:LC1:L4:light:1:L129	LC1	L4	L129	2.93	-
R139	drop:LC1:L4:light:1:L130	LC1	L4	L130	2.93	-
R140	drop:LC1:L4:light:1:L131	LC1	L4	L131	2.93	-
R141	drop:LC1:L4:light:1:L132	LC1	L4	L132	2.93	-
R142	drop:LC1:L4:light:1:L133	LC1	L4	L133	2.93	-
R143	drop:LC1:L4:light:1:L134	LC1	L4	L134	2.93	-
R144	drop:LC1:L4:light:1:L135	LC1	L4	L135	2.93	-
R145	drop:LC1:L4:light:1:L136	LC1	L4	L136	2.93	-
R146	drop:LC1:L4:light:1:L-ARCH-H-2P-3-A	LC1	L4	L-ARCH-H-2P-3-A	8.21	-
R147	drop:LC1:L4:light:1:L-ARCH-H-2P-3-B	LC1	L4	L-ARCH-H-2P-3-B	8.21	-
R148	drop:LC1:L4:light:1:L-ARCH-H-3-4-A	LC1	L4	L-ARCH-H-3-4-A	8.21	-
R149	drop:LC1:L4:light:1:L-ARCH-H-3-4-B	LC1	L4	L-ARCH-H-3-4-B	8.21	-
R150	drop:LC1:L4:light:1:L-ARCH-H-4-5-A	LC1	L4	L-ARCH-H-4-5-A	8.21	-
R151	drop:LC1:L4:light:1:L-ARCH-H-4-5-B	LC1	L4	L-ARCH-H-4-5-B	8.21	-
R152	drop:LC1:L4:light:1:L-ARCH-H-5-6-A	LC1	L4	L-ARCH-H-5-6-A	8.21	-
R153	drop:LC1:L4:light:1:L-ARCH-H-5-6-B	LC1	L4	L-ARCH-H-5-6-B	8.21	-
R154	drop:LC1:L4:light:1:L-ARCH-H-6-7-A	LC1	L4	L-ARCH-H-6-7-A	8.21	-
R155	drop:LC1:L4:light:1:L-ARCH-H-6-7-B	LC1	L4	L-ARCH-H-6-7-B	8.21	-
R156	drop:LC1:L4:light:1:L-ARCH-H-7-8-A	LC1	L4	L-ARCH-H-7-8-A	8.21	-

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R157	drop:LC1:L4:light:1:L-ARCH-H-7-8-B	LC1	L4	L-ARCH-H-7-8-B	8.21	-
R158	drop:LC1:L4:light:1:L-ARCH-H-8-9-A	LC1	L4	L-ARCH-H-8-9-A	8.21	-
R159	drop:LC1:L4:light:1:L-ARCH-H-8-9-B	LC1	L4	L-ARCH-H-8-9-B	8.24	-
R160	drop:LC1:L4:light:1:L-ARCH-H-10-11-A	LC1	L4	L-ARCH-H-10-11-A	8.24	-
R161	drop:LC1:L4:light:1:L-ARCH-H-10-11-B	LC1	L4	L-ARCH-H-10-11-B	8.21	-
R162	drop:LC1:L4:light:1:L-ARCH-H-11-12-A	LC1	L4	L-ARCH-H-11-12-A	8.21	-
R163	drop:LC1:L4:light:1:L-ARCH-H-11-12-B	LC1	L4	L-ARCH-H-11-12-B	6.77	-
R164	trunk:DB2:L9:light:-1	DB2	L9	Shared context	26.55	-
R165	drop:DB2:L9:light:-1:L137	DB2	L9	L137	11.54	-
R166	drop:DB2:L9:light:-1:L182	DB2	L9	L182	10.78	-
R167	drop:DB2:L9:light:-1:L183	DB2	L9	L183	6.36	-
R168	trunk:DB2:L9:light:1	DB2	L9	Shared context	11.83	-
R169	drop:DB2:L9:light:1:L138	DB2	L9	L138	11.54	-
R170	drop:DB2:L9:light:1:L189	DB2	L9	L189	6.36	-
R171	drop:DB2:L9:light:1:L190	DB2	L9	L190	10.78	-
R172	trunk:LC1:L5:light:-1	LC1	L5	Shared context	57.79	-
R173	drop:LC1:L5:light:-1:L139	LC1	L5	L139	3.51	-
R174	drop:LC1:L5:light:-1:L140	LC1	L5	L140	3.51	-
R175	drop:LC1:L5:light:-1:L141	LC1	L5	L141	3.51	-
R176	drop:LC1:L5:light:-1:L142	LC1	L5	L142	3.51	-
R177	drop:LC1:L5:light:-1:L184	LC1	L5	L184	4.98	-
R178	drop:LC1:L5:light:-1:L185	LC1	L5	L185	4.98	-
R179	drop:LC1:L5:light:-1:L186	LC1	L5	L186	4.98	-
R180	drop:LC1:L5:light:-1:L187	LC1	L5	L187	9.08	-
R181	drop:LC1:L5:light:-1:L188	LC1	L5	L188	3.79	-
R182	trunk:LC1:L5:light:1	LC1	L5	Shared context	64.39	-
R183	drop:LC1:L5:light:1:L145	LC1	L5	L145	3.51	-
R184	drop:LC1:L5:light:1:L146	LC1	L5	L146	3.51	-
R185	drop:LC1:L5:light:1:L147	LC1	L5	L147	3.51	-
R186	drop:LC1:L5:light:1:L148	LC1	L5	L148	3.51	-
R187	drop:LC1:L5:light:1:L191	LC1	L5	L191	4.98	-
R188	drop:LC1:L5:light:1:L192	LC1	L5	L192	4.98	-
R189	drop:LC1:L5:light:1:L193	LC1	L5	L193	4.98	-
R190	drop:LC1:L5:light:1:L194	LC1	L5	L194	9.08	-
R191	drop:LC1:L5:light:1:L195	LC1	L5	L195	3.79	-
R192	trunk:DB1:E1:light:-1	DB1	E1	Shared context	65.77	-
R193	drop:DB1:E1:light:-1:L155	DB1	E1	L155	12.65	-
R194	drop:DB1:E1:light:-1:L156	DB1	E1	L156	6.97	-
R195	drop:DB1:E1:light:-1:L158	DB1	E1	L158	6.97	-

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R196	trunk:DB1:E1:light:1	DB1	E1	Shared context	59.91	-
R197	drop:DB1:E1:light:1:L157	DB1	E1	L157	6.97	-
R198	drop:DB1:E1:light:1:L159	DB1	E1	L159	6.97	-
R199	trunk:DB2:L6:light:-1	DB2	L6	Shared context	27.96	-
R200	drop:DB2:L6:light:-1:L160	DB2	L6	L160	11.23	-
R201	drop:DB2:L6:light:-1:L161	DB2	L6	L161	12.53	-
R202	drop:DB2:L6:light:-1:L162	DB2	L6	L162	20.09	-
R203	drop:DB2:L6:light:-1:L163	DB2	L6	L163	27.86	-
R204	drop:DB2:L6:light:-1:L164	DB2	L6	L164	33.50	-
R205	drop:DB2:L6:light:-1:L165	DB2	L6	L165	29.39	-
R206	drop:DB2:L6:light:-1:L166	DB2	L6	L166	14.88	-
R207	drop:DB2:L6:light:-1:L167	DB2	L6	L167	13.08	-
R208	drop:DB2:L6:light:-1:L168	DB2	L6	L168	20.61	-
R209	drop:DB2:L6:light:-1:L169	DB2	L6	L169	28.36	-
R210	drop:DB2:L6:light:-1:L170	DB2	L6	L170	4.97	-
R211	drop:DB2:L6:light:-1:L222	DB2	L6	L222	6.20	-
R212	drop:DB2:L6:light:-1:L223	DB2	L6	L223	14.00	-
R213	trunk:DB2:L6:light:1	DB2	L6	Shared context	13.24	-
R214	drop:DB2:L6:light:1:L171	DB2	L6	L171	11.23	-
R215	drop:DB2:L6:light:1:L172	DB2	L6	L172	12.53	-
R216	drop:DB2:L6:light:1:L173	DB2	L6	L173	20.09	-
R217	drop:DB2:L6:light:1:L174	DB2	L6	L174	27.86	-
R218	drop:DB2:L6:light:1:L175	DB2	L6	L175	33.50	-
R219	drop:DB2:L6:light:1:L176	DB2	L6	L176	29.39	-
R220	drop:DB2:L6:light:1:L177	DB2	L6	L177	14.88	-
R221	drop:DB2:L6:light:1:L178	DB2	L6	L178	13.08	-
R222	drop:DB2:L6:light:1:L179	DB2	L6	L179	20.61	-
R223	drop:DB2:L6:light:1:L180	DB2	L6	L180	28.36	-
R224	drop:DB2:L6:light:1:L181	DB2	L6	L181	4.97	-
R225	drop:DB2:L6:light:1:L224	DB2	L6	L224	6.20	-
R226	drop:DB2:L6:light:1:L225	DB2	L6	L225	14.00	-
R227	trunk:EB1:L7:light:-1	EB1	L7	Shared context	82.54	-
R228	drop:EB1:L7:light:-1:L196	EB1	L7	L196	10.46	-
R229	drop:EB1:L7:light:-1:L197	EB1	L7	L197	1.37	-
R230	drop:EB1:L7:light:-1:L198	EB1	L7	L198	1.37	-
R231	drop:EB1:L7:light:-1:L199	EB1	L7	L199	4.83	-
R232	drop:EB1:L7:light:-1:L200	EB1	L7	L200	4.83	-
R233	drop:EB1:L7:light:-1:L201	EB1	L7	L201	5.61	-
R234	drop:EB1:L7:light:-1:L202	EB1	L7	L202	9.18	-

Unique route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R235	drop:EB1:L7:light:-1:L203	EB1	L7	L203	13.60	-
R236	drop:EB1:L7:light:-1:L204	EB1	L7	L204	10.41	-
R237	drop:EB1:L7:light:-1:L205	EB1	L7	L205	14.83	-
R238	drop:EB1:L7:light:-1:L206	EB1	L7	L206	18.01	-
R239	drop:EB1:L7:light:-1:L207	EB1	L7	L207	22.43	-
R240	drop:EB1:L7:light:-1:L219	EB1	L7	L219	10.08	-
R241	drop:EB1:L7:light:-1:L220	EB1	L7	L220	3.75	-
R242	trunk:EB1:L7:light:1	EB1	L7	Shared context	67.82	-
R243	drop:EB1:L7:light:1:L208	EB1	L7	L208	1.37	-
R244	drop:EB1:L7:light:1:L209	EB1	L7	L209	1.37	-
R245	drop:EB1:L7:light:1:L210	EB1	L7	L210	4.83	-
R246	drop:EB1:L7:light:1:L211	EB1	L7	L211	4.83	-
R247	drop:EB1:L7:light:1:L212	EB1	L7	L212	5.61	-
R248	drop:EB1:L7:light:1:L213	EB1	L7	L213	9.18	-
R249	drop:EB1:L7:light:1:L214	EB1	L7	L214	13.60	-
R250	drop:EB1:L7:light:1:L215	EB1	L7	L215	10.41	-
R251	drop:EB1:L7:light:1:L216	EB1	L7	L216	14.83	-
R252	drop:EB1:L7:light:1:L217	EB1	L7	L217	18.01	-
R253	drop:EB1:L7:light:1:L218	EB1	L7	L218	22.43	-
R254	drop:EB1:L7:light:1:L221	EB1	L7	L221	3.75	-
R255	trunk:FC1:F1:fan:-1	FC1	F1	Shared context	64.03	-
R256	drop:FC1:F1:fan:-1:F226	FC1	F1	F226	10.99	-
R257	drop:FC1:F1:fan:-1:F228	FC1	F1	F228	12.39	-
R258	drop:FC1:F1:fan:-1:F230	FC1	F1	F230	12.38	-
R259	drop:FC1:F1:fan:-1:F232	FC1	F1	F232	12.39	-
R260	drop:FC1:F1:fan:-1:F234	FC1	F1	F234	12.39	-
R261	drop:FC1:F1:fan:-1:F236	FC1	F1	F236	12.39	-
R262	drop:FC1:F1:fan:-1:F238	FC1	F1	F238	12.38	-
R263	trunk:FC1:F1:fan:1	FC1	F1	Shared context	70.63	-
R264	drop:FC1:F1:fan:1:F227	FC1	F1	F227	10.99	-
R265	drop:FC1:F1:fan:1:F229	FC1	F1	F229	12.39	-
R266	drop:FC1:F1:fan:1:F231	FC1	F1	F231	12.38	-
R267	drop:FC1:F1:fan:1:F233	FC1	F1	F233	12.39	-
R268	drop:FC1:F1:fan:1:F235	FC1	F1	F235	12.39	-
R269	drop:FC1:F1:fan:1:F237	FC1	F1	F237	12.39	-
R270	drop:FC1:F1:fan:1:F239	FC1	F1	F239	12.38	-
R271	trunk:FC1:F5:fan:-1	FC1	F5	Shared context	33.83	-
R272	drop:FC1:F5:fan:-1:F240	FC1	F5	F240	9.26	-
R273	drop:FC1:F5:fan:-1:F241	FC1	F5	F241	9.26	-

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R274	trunk:FC1:F5:fan:1	FC1	F5	Shared context	40.43	-
R275	drop:FC1:F5:fan:1:F242	FC1	F5	F242	9.26	-
R276	drop:FC1:F5:fan:1:F243	FC1	F5	F243	9.26	-
R277	trunk:FC1:F2:fan:-1	FC1	F2	Shared context	66.96	-
R278	drop:FC1:F2:fan:-1:F244	FC1	F2	F244	2.20	-
R279	drop:FC1:F2:fan:-1:F246	FC1	F2	F246	2.20	-
R280	drop:FC1:F2:fan:-1:F248	FC1	F2	F248	2.20	-
R281	drop:FC1:F2:fan:-1:F-NAVE-B-2P	FC1	F2	F-NAVE-B-2P	2.20	-
R282	drop:FC1:F2:fan:-1:F-NAVE-B-3	FC1	F2	F-NAVE-B-3	2.20	-
R283	drop:FC1:F2:fan:-1:F-NAVE-B-5	FC1	F2	F-NAVE-B-5	2.20	-
R284	drop:FC1:F2:fan:-1:F-NAVE-B-7	FC1	F2	F-NAVE-B-7	2.20	-
R285	drop:FC1:F2:fan:-1:F-NAVE-B-9	FC1	F2	F-NAVE-B-9	2.20	-
R286	trunk:FC1:F2:fan:1	FC1	F2	Shared context	73.56	-
R287	drop:FC1:F2:fan:1:F245	FC1	F2	F245	2.20	-
R288	drop:FC1:F2:fan:1:F247	FC1	F2	F247	2.20	-
R289	drop:FC1:F2:fan:1:F249	FC1	F2	F249	2.20	-
R290	drop:FC1:F2:fan:1:F-NAVE-H-2P	FC1	F2	F-NAVE-H-2P	2.20	-
R291	drop:FC1:F2:fan:1:F-NAVE-H-3	FC1	F2	F-NAVE-H-3	2.20	-
R292	drop:FC1:F2:fan:1:F-NAVE-H-5	FC1	F2	F-NAVE-H-5	2.20	-
R293	drop:FC1:F2:fan:1:F-NAVE-H-7	FC1	F2	F-NAVE-H-7	2.20	-
R294	drop:FC1:F2:fan:1:F-NAVE-H-9	FC1	F2	F-NAVE-H-9	2.20	-
R295	trunk:DB2:F4:fan:-1	DB2	F4	Shared context	29.62	-
R296	drop:DB2:F4:fan:-1:F250	DB2	F4	F250	17.22	-
R297	trunk:DB2:F4:fan:1	DB2	F4	Shared context	14.90	-
R298	drop:DB2:F4:fan:1:F251	DB2	F4	F251	17.22	-
R299	trunk:FC1:V1:fan:-1	FC1	V1	Shared context	67.55	-
R300	drop:FC1:V1:fan:-1:F252	FC1	V1	F252	8.69	-
R301	drop:FC1:V1:fan:-1:F253	FC1	V1	F253	11.83	-
R302	trunk:FC1:V1:fan:1	FC1	V1	Shared context	74.15	-
R303	drop:FC1:V1:fan:1:F254	FC1	V1	F254	11.83	-
R304	drop:FC1:V1:fan:1:F255	FC1	V1	F255	8.69	-
R305	trunk:FC1:V2:fan:-1	FC1	V2	Shared context	31.71	-
R306	drop:FC1:V2:fan:-1:F256	FC1	V2	F256	6.97	-
R307	drop:FC1:V2:fan:-1:F257	FC1	V2	F257	6.97	-
R308	trunk:FC1:V2:fan:1	FC1	V2	Shared context	38.31	-
R309	drop:FC1:V2:fan:1:F258	FC1	V2	F258	6.97	-
R310	drop:FC1:V2:fan:1:F259	FC1	V2	F259	6.97	-
R311	trunk:FC1:V3:fan:-1	FC1	V3	Shared context	16.41	-
R312	drop:FC1:V3:fan:-1:F260	FC1	V3	F260	10.32	-

Unique route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R313	trunk:AV1:A1:audio:-1	AV1	A1	Shared context	65.65	-
R314	drop:AV1:A1:audio:-1:S261	AV1	A1	S261	3.16	68.81
R315	drop:AV1:A1:audio:-1:S263	AV1	A1	S263	3.16	64.31
R316	drop:AV1:A1:audio:-1:S265	AV1	A1	S265	3.16	59.81
R317	drop:AV1:A1:audio:-1:S267	AV1	A1	S267	3.16	55.31
R318	drop:AV1:A1:audio:-1:S269	AV1	A1	S269	3.16	50.81
R319	drop:AV1:A1:audio:-1:S271	AV1	A1	S271	3.16	46.31
R320	drop:AV1:A1:audio:-1:S276	AV1	A1	S276	8.04	40.81
R321	trunk:AV1:A1:audio:1	AV1	A1	Shared context	59.05	-
R322	drop:AV1:A1:audio:1:S262	AV1	A1	S262	3.16	62.21
R323	drop:AV1:A1:audio:1:S264	AV1	A1	S264	3.16	57.71
R324	drop:AV1:A1:audio:1:S266	AV1	A1	S266	3.16	53.21
R325	drop:AV1:A1:audio:1:S268	AV1	A1	S268	3.16	48.71
R326	drop:AV1:A1:audio:1:S270	AV1	A1	S270	3.16	44.21
R327	drop:AV1:A1:audio:1:S272	AV1	A1	S272	3.16	39.71
R328	drop:AV1:A1:audio:1:S278	AV1	A1	S278	8.04	34.21
R329	trunk:AV1:A5:audio:-1	AV1	A5	Shared context	74.25	-
R330	drop:AV1:A5:audio:-1:S273	AV1	A5	S273	13.21	87.45
R331	trunk:AV1:A5:audio:1	AV1	A5	Shared context	67.65	-
R332	drop:AV1:A5:audio:1:S274	AV1	A5	S274	13.21	80.85
R333	trunk:AV1:A2:audio:-1	AV1	A2	Shared context	70.16	-
R334	drop:AV1:A2:audio:-1:S279	AV1	A2	S279	2.95	68.61
R335	drop:AV1:A2:audio:-1:S280	AV1	A2	S280	2.95	55.11
R336	drop:AV1:A2:audio:-1:S-PORCH-B-2P-3	AV1	A2	S-PORCH-B-2P-3	2.95	73.11
R337	drop:AV1:A2:audio:-1:S-PORCH-B-4-5	AV1	A2	S-PORCH-B-4-5	2.95	64.11
R338	drop:AV1:A2:audio:-1:S-PORCH-B-5-6	AV1	A2	S-PORCH-B-5-6	2.95	59.61
R339	drop:AV1:A2:audio:-1:S-PORCH-B-7-8	AV1	A2	S-PORCH-B-7-8	2.95	50.61
R340	drop:AV1:A2:audio:-1:S-PORCH-B-8-9	AV1	A2	S-PORCH-B-8-9	2.95	46.11
R341	drop:AV1:A2:audio:-1:S-PORCH-B-10-11	AV1	A2	S-PORCH-B-10-11	2.95	29.70
R342	drop:AV1:A2:audio:-1:S-PORCH-B-11-12	AV1	A2	S-PORCH-B-11-12	2.95	25.35
R343	trunk:AV1:A2:audio:1	AV1	A2	Shared context	63.56	-
R344	drop:AV1:A2:audio:1:S281	AV1	A2	S281	2.95	62.01
R345	drop:AV1:A2:audio:1:S282	AV1	A2	S282	2.95	48.51
R346	drop:AV1:A2:audio:1:S-PORCH-H-2P-3	AV1	A2	S-PORCH-H-2P-3	2.95	66.51
R347	drop:AV1:A2:audio:1:S-PORCH-H-4-5	AV1	A2	S-PORCH-H-4-5	2.95	57.51
R348	drop:AV1:A2:audio:1:S-PORCH-H-5-6	AV1	A2	S-PORCH-H-5-6	2.95	53.01
R349	drop:AV1:A2:audio:1:S-PORCH-H-7-8	AV1	A2	S-PORCH-H-7-8	2.95	44.01
R350	drop:AV1:A2:audio:1:S-PORCH-H-8-9	AV1	A2	S-PORCH-H-8-9	2.95	39.51
R351	drop:AV1:A2:audio:1:S-PORCH-H-10-11	AV1	A2	S-PORCH-H-10-11	2.95	23.10

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R352	drop:AV1:A2:audio:1:S-PORCH-H-11-12	AV1	A2	S-PORCH-H-11-12	2.95	18.75
R353	trunk:AV1:A3:audio:-1	AV1	A3	Shared context	77.36	-
R354	drop:AV1:A3:audio:-1:S283	AV1	A3	S283	7.00	84.36
R355	drop:AV1:A3:audio:-1:S284	AV1	A3	S284	11.52	88.88
R356	drop:AV1:A3:audio:-1:S285	AV1	A3	S285	5.69	66.43
R357	drop:AV1:A3:audio:-1:S286	AV1	A3	S286	5.69	52.93
R358	trunk:AV1:A3:audio:1	AV1	A3	Shared context	70.76	-
R359	drop:AV1:A3:audio:1:S287	AV1	A3	S287	7.00	77.76
R360	drop:AV1:A3:audio:1:S288	AV1	A3	S288	11.52	82.28
R361	drop:AV1:A3:audio:1:S289	AV1	A3	S289	5.69	59.83
R362	drop:AV1:A3:audio:1:S290	AV1	A3	S290	5.69	46.33
R363	trunk:AV1:MIC:mic:-1	AV1	MIC	Shared context	11.91	-
R364	drop:AV1:MIC:mic:-1:S291	AV1	MIC	S291	3.63	15.54
R365	trunk:AV1:MIC:mic:1	AV1	MIC	Shared context	5.74	-
R366	drop:AV1:MIC:mic:1:S292	AV1	MIC	S292	2.85	8.59
R367	trunk:DB1:P1:power:-1	DB1	P1	Shared context	48.38	-
R368	drop:DB1:P1:power:-1:P-SANCT-B	DB1	P1	P-SANCT-B	5.65	-
R369	drop:DB1:P1:power:-1:P-NAVE-B	DB1	P1	P-NAVE-B	5.77	-
R370	trunk:EB1:P3:power:-1	EB1	P3	Shared context	20.28	-
R371	drop:EB1:P3:power:-1:P-TOWER-B	EB1	P3	P-TOWER-B	1.57	-
R372	trunk:DB1:P2:power:1	DB1	P2	Shared context	54.97	-
R373	drop:DB1:P2:power:1:P-SANCT-H	DB1	P2	P-SANCT-H	5.66	-
R374	drop:DB1:P2:power:1:P-NAVE-H	DB1	P2	P-NAVE-H	5.78	-
R375	trunk:EB1:P4:power:1	EB1	P4	Shared context	4.88	-
R376	drop:EB1:P4:power:1:P-TOWER-H	EB1	P4	P-TOWER-H	1.57	-
R377	trunk:DB2:L10:light:-1	DB2	L10	Shared context	28.08	-
R378	drop:DB2:L10:light:-1:L-STATUE-C-ARCH	DB2	L10	L-STATUE-C-ARCH	23.12	-
R379	drop:DB2:L10:light:-1:L-STATUE-C-JAMB-1	DB2	L10	L-STATUE-C-JAMB-1	20.61	-
R380	drop:DB2:L10:light:-1:L-STATUE-C-CANDLE-1	DB2	L10	L-STATUE-C-CANDLE-1	19.50	-
R381	drop:DB2:L10:light:-1:L-STATUE-B-ARCH	DB2	L10	L-STATUE-B-ARCH	11.25	-
R382	drop:DB2:L10:light:-1:L-STATUE-B-JAMB-1	DB2	L10	L-STATUE-B-JAMB-1	9.10	-
R383	drop:DB2:L10:light:-1:L-STATUE-B-CANDLE-1	DB2	L10	L-STATUE-B-CANDLE-1	8.26	-
R384	drop:DB2:L10:light:-1:L-STATUE-B-JAMB-2	DB2	L10	L-STATUE-B-JAMB-2	10.26	-
R385	drop:DB2:L10:light:-1:L-STATUE-B-CANDLE-2	DB2	L10	L-STATUE-B-CANDLE-2	8.88	-
R386	trunk:DB2:L10:light:1	DB2	L10	Shared context	13.36	-
R387	drop:DB2:L10:light:1:L-STATUE-C-JAMB-2	DB2	L10	L-STATUE-C-JAMB-2	20.61	-
R388	drop:DB2:L10:light:1:L-STATUE-C-CANDLE-2	DB2	L10	L-STATUE-C-CANDLE-2	19.50	-
R389	drop:DB2:L10:light:1:L-STATUE-H-ARCH	DB2	L10	L-STATUE-H-ARCH	11.25	-
R390	drop:DB2:L10:light:1:L-STATUE-H-JAMB-1	DB2	L10	L-STATUE-H-JAMB-1	10.26	-

Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R391	drop:DB2:L10:light:1:L-STATUE-H-CANDLE-1	DB2	L10	L-STATUE-H-CANDLE-1	8.88	-
R392	drop:DB2:L10:light:1:L-STATUE-H-JAMB-2	DB2	L10	L-STATUE-H-JAMB-2	9.10	-
R393	drop:DB2:L10:light:1:L-STATUE-H-CANDLE-2	DB2	L10	L-STATUE-H-CANDLE-2	8.26	-
R394	trunk:LC1:LS:light:1	LC1	LS	Shared context	71.24	-
R395	drop:LC1:LS:light:1:L-STATION-1-A	LC1	LS	L-STATION-1-A	1.57	-
R396	drop:LC1:LS:light:1:L-STATION-1-B	LC1	LS	L-STATION-1-B	1.57	-
R397	drop:LC1:LS:light:1:L-STATION-2-A	LC1	LS	L-STATION-2-A	1.57	-
R398	drop:LC1:LS:light:1:L-STATION-2-B	LC1	LS	L-STATION-2-B	1.57	-
R399	drop:LC1:LS:light:1:L-STATION-3-A	LC1	LS	L-STATION-3-A	1.57	-
R400	drop:LC1:LS:light:1:L-STATION-3-B	LC1	LS	L-STATION-3-B	1.57	-
R401	drop:LC1:LS:light:1:L-STATION-4-A	LC1	LS	L-STATION-4-A	1.57	-
R402	drop:LC1:LS:light:1:L-STATION-4-B	LC1	LS	L-STATION-4-B	1.57	-
R403	drop:LC1:LS:light:1:L-STATION-5-A	LC1	LS	L-STATION-5-A	1.57	-
R404	drop:LC1:LS:light:1:L-STATION-5-B	LC1	LS	L-STATION-5-B	1.57	-
R405	drop:LC1:LS:light:1:L-STATION-6-A	LC1	LS	L-STATION-6-A	1.57	-
R406	drop:LC1:LS:light:1:L-STATION-6-B	LC1	LS	L-STATION-6-B	1.57	-
R407	drop:LC1:LS:light:1:L-STATION-7-A	LC1	LS	L-STATION-7-A	1.57	-
R408	drop:LC1:LS:light:1:L-STATION-7-B	LC1	LS	L-STATION-7-B	1.57	-
R409	trunk:LC1:LS:light:-1	LC1	LS	Shared context	64.64	-
R410	drop:LC1:LS:light:-1:L-STATION-8-A	LC1	LS	L-STATION-8-A	1.57	-
R411	drop:LC1:LS:light:-1:L-STATION-8-B	LC1	LS	L-STATION-8-B	1.57	-
R412	drop:LC1:LS:light:-1:L-STATION-9-A	LC1	LS	L-STATION-9-A	1.57	-
R413	drop:LC1:LS:light:-1:L-STATION-9-B	LC1	LS	L-STATION-9-B	1.57	-
R414	drop:LC1:LS:light:-1:L-STATION-10-A	LC1	LS	L-STATION-10-A	1.57	-
R415	drop:LC1:LS:light:-1:L-STATION-10-B	LC1	LS	L-STATION-10-B	1.57	-
R416	drop:LC1:LS:light:-1:L-STATION-11-A	LC1	LS	L-STATION-11-A	1.57	-
R417	drop:LC1:LS:light:-1:L-STATION-11-B	LC1	LS	L-STATION-11-B	1.57	-
R418	drop:LC1:LS:light:-1:L-STATION-12-A	LC1	LS	L-STATION-12-A	1.57	-
R419	drop:LC1:LS:light:-1:L-STATION-12-B	LC1	LS	L-STATION-12-B	1.57	-
R420	drop:LC1:LS:light:-1:L-STATION-13-A	LC1	LS	L-STATION-13-A	1.57	-
R421	drop:LC1:LS:light:-1:L-STATION-13-B	LC1	LS	L-STATION-13-B	1.57	-
R422	drop:LC1:LS:light:-1:L-STATION-14-A	LC1	LS	L-STATION-14-A	1.57	-
R423	drop:LC1:LS:light:-1:L-STATION-14-B	LC1	LS	L-STATION-14-B	1.57	-
R424	trunk:LC1:L8:light:-1	LC1	L8	Shared context	31.84	-
R425	drop:LC1:L8:light:-1:L-WING-B-FI	LC1	L8	L-WING-B-FI	1.76	-
R426	drop:LC1:L8:light:-1:L-WING-B-FO	LC1	L8	L-WING-B-FO	4.36	-
R427	drop:LC1:L8:light:-1:L-WING-B-RI	LC1	L8	L-WING-B-RI	1.76	-
R428	drop:LC1:L8:light:-1:L-WING-B-RO	LC1	L8	L-WING-B-RO	4.36	-
R429	trunk:LC1:L8:light:1	LC1	L8	Shared context	38.44	-

Unique route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R430	drop:LC1:L8:light:1:L-WING-H-FI	LC1	L8	L-WING-H-FI	1.76	-
R431	drop:LC1:L8:light:1:L-WING-H-FO	LC1	L8	L-WING-H-FO	4.36	-
R432	drop:LC1:L8:light:1:L-WING-H-RI	LC1	L8	L-WING-H-RI	1.76	-
R433	drop:LC1:L8:light:1:L-WING-H-RO	LC1	L8	L-WING-H-RO	4.36	-
R434	trunk:LC1:LD:light:-1	LC1	LD	Shared context	62.30	-
R435	drop:LC1:LD:light:-1:L-COLUMN-3-B	LC1	LD	L-COLUMN-3-B	16.39	-
R436	drop:LC1:LD:light:-1:L-COLUMN-4-B	LC1	LD	L-COLUMN-4-B	16.39	-
R437	drop:LC1:LD:light:-1:L-COLUMN-5-B	LC1	LD	L-COLUMN-5-B	16.39	-
R438	drop:LC1:LD:light:-1:L-COLUMN-6-B	LC1	LD	L-COLUMN-6-B	16.39	-
R439	drop:LC1:LD:light:-1:L-COLUMN-7-B	LC1	LD	L-COLUMN-7-B	16.39	-
R440	drop:LC1:LD:light:-1:L-COLUMN-8-B	LC1	LD	L-COLUMN-8-B	16.39	-
R441	drop:LC1:LD:light:-1:L-COLUMN-9-B	LC1	LD	L-COLUMN-9-B	16.39	-
R442	trunk:LC1:LD:light:1	LC1	LD	Shared context	68.90	-
R443	drop:LC1:LD:light:1:L-COLUMN-3-H	LC1	LD	L-COLUMN-3-H	16.39	-
R444	drop:LC1:LD:light:1:L-COLUMN-4-H	LC1	LD	L-COLUMN-4-H	16.39	-
R445	drop:LC1:LD:light:1:L-COLUMN-5-H	LC1	LD	L-COLUMN-5-H	16.39	-
R446	drop:LC1:LD:light:1:L-COLUMN-6-H	LC1	LD	L-COLUMN-6-H	16.39	-
R447	drop:LC1:LD:light:1:L-COLUMN-7-H	LC1	LD	L-COLUMN-7-H	16.39	-
R448	drop:LC1:LD:light:1:L-COLUMN-8-H	LC1	LD	L-COLUMN-8-H	16.39	-
R449	drop:LC1:LD:light:1:L-COLUMN-9-H	LC1	LD	L-COLUMN-9-H	16.39	-

Installation note key

One note per distinct model installation method / proposals, not approved installation details

Code	Routes	Model installation note
I01	1	Above beam and covered rear-face return to lamp-body cable entry. Existing canopy/capital contact remains on mounting coordination hold; optical position unchanged.
I02	70	Above lining / beam tops, short covered joint and rear-face return to fitting. Roof access, rafter/tie interface and removable cover details pending; no timber drilling / notching.
I03	15	Above nave lining / covered soffit route at wings and verandas; cable continues inside the existing pendant stem. Roof build-up, supports and access pending.
I04	12	Above nave lining, then down the outer face of the column-line beam in a removable finish-matched cover to the hanger; cable continues inside the downrod. Hanger, beam section and access pending.
I05	4	Above roof lining to solid front gable above terrace; local fan connection.
I06	9	Back-wall band to service space behind chamber lining; local termination behind the fitting / cornice. Removable lining and cable-entry detail pending.
I07	2	Buried duct below the entrance-hall floor and tower plinth, rising inside the solid tower pier to the cabinet. Duct size, depth, draw pits, water sealing and separation pending; no chase through the arch mouldings.
I08	20	Concealed entrance wall band, solid pier and local termination.
I09	11	Concealed roof route to local roof-mounted fitting; weatherproof cable entry pending.
I10	104	Concealed solid-pier / wall drop and local termination.
I11	56	Covered roof-soffit crossing into outer arcade / wing-gable wall, then concealed pier drop. No exposed crossing at equipment height.
I12	2	Dedicated buried duct from EB-1 (beside DB-2) below the entrance-hall floor to the tower base; duct, depth, draw pits and water sealing pending.
I13	1	Entrance wall band to solid jamb outside coloured fanlight, fixed transom and local inside-face sign clip. Removable frame cover, fixing and emergency design pending.
I14	3	Existing service-room wall tray / local equipment connection
I15	14	Proposed underfloor approach and removable column-face raceway. The column base crossing, timber fixings, appearance, fire boundary and maintenance access require coordinated design; no concealed chase is assumed.
I16	8	Proposed underfloor return; this location needs a concealed local riser / connection design.
I17	11	Rear-wall band and local termination; gable / weatherproof entry details pending.
I18	1	Separate AV-1 home run below floor; central ambo passage through proposed hollow neck, sloped desk and removable microphone socket. Floorbox, furniture bore and access pending.
I19	1	Separate AV-1 home run below the floor; proposed furniture cable passage to microphone base. Floorbox, floor build-up and furniture access pending.
I20	2	Separate microphone home-run bundle below service-room and sanctuary floors; floor build-up / access pending.
I21	1	Short tray between the two boards on the tower front wall
I22	40	Solid tower corner/piers, stepped behind cornices; local ledge/fitting connection. No riser through louver openings; chase/finish and weathering details pending.
I23	4	Tower pier to proposed service space behind removable cornice finish, then local fitting lead. Cornice cavity, access, weathering and cable-entry details remain unresolved.
I24	4	Wall band to solid jamb beside coloured fanlight, fixed 220 mm door-head band and local sign lead. Frame containment, fixing and emergency design pending.
I25	50	Wall bands above openings; concealed finish-matched soffit crossing over the 9-10 wing opening.
I26	1	Wall bands, covered wing-roof crossing, entrance wall riser

Installation note key

One note per distinct model installation method / proposals, not approved installation details

Code	Routes	Model installation note
I27	2	Wall riser beside niche; containment above ceiling top +4.27 m; panel cable entry pending structural coordination.

THACH BI CHURCH

RS-01

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R001	Shared context DB2-FEED	I26	94.96	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.26 > 12+0.00/C+0.00 h+6.26 > 10+0.00/C+0.00 h+6.26 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.26 > 2'+0.00/C+0.00 h+6.26 > 1+2.35/C+0.00 h+6.26 > h+7.65 > 1+2.35/H-1.16 h+7.65 > h+1.50 > 1+0.24/H-1.16 h+1.50
R002	Shared context EB1-SUPPLY	I21	2.70	1+0.24/H-1.16 h+1.50 > h+2.10 > 1+0.24/H+0.34 h+2.10 > h+1.50
R003	Shared context AV1-SUPPLY	I14	5.79	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > h+2.42 > 11+0.06/E-2.20 h+2.42 > h+0.95 > 11+0.60/E-2.20 h+0.95
R004	Shared context LC1-SUPPLY	I14	2.56	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > h+2.42 > 11+0.06/D+3.05 h+2.42 > h+1.85 > 11+0.22/D+3.05 h+1.85
R005	Shared context FC1-SUPPLY	I14	3.41	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > h+2.42 > 11+0.06/E-3.20 h+2.42 > h+1.95 > 11+0.22/E-3.20 h+1.95
R006	L1	I27	8.03	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+1.33/D+1.36 h+4.33 > 11+1.33/D+3.60 h+4.33 > h+4.14
R007	L2	I27	9.93	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 12-1.12/D+1.36 h+4.33 > 12-1.12/D+3.60 h+4.33 > h+4.14
R008	Shared context L2	I25	66.83	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.91 > 12+0.00/C+0.00 h+5.91 > 10+0.00/C+0.00 h+5.91 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.91 > 2'+0.00/C+0.00 h+5.91
R009	L3	I02	9.70	3+0.15/C+0.00 h+5.91 > 3+0.35/C+0.00 h+5.91 > h+7.04 > 3+0.35/D-0.45 h+9.44 > h+9.23 > 3+0.35/D+0.60 h+9.23 > 3+0.00/D+0.60 h+9.23 > 3+0.15/D+2.70 h+9.23 > 3+0.21/D+2.70 h+9.23 > h+8.77 > 3+0.15/D+2.70 h+8.77
R010	L4	I02	8.14	3+0.15/C+0.00 h+5.91 > 3+0.35/C+0.00 h+5.91 > h+7.04 > 3+0.35/D-0.45 h+9.44 > h+9.23 > 3+0.35/D+0.60 h+9.23 > 3+0.00/D+0.60 h+9.23 > 3+0.15/D+1.12 h+9.23 > 3+0.21/D+1.12 h+9.23 > h+8.77 > 3+0.15/D+1.12 h+8.77
R011	L7	I02	9.70	4+0.15/C+0.00 h+5.91 > 4+0.35/C+0.00 h+5.91 > h+7.04 > 4+0.35/D-0.45 h+9.44 > h+9.23 > 4+0.35/D+0.60 h+9.23 > 4+0.00/D+0.60 h+9.23 > 4+0.15/D+2.70 h+9.23 > 4+0.21/D+2.70 h+9.23 > h+8.77 > 4+0.15/D+2.70 h+8.77
R012	L8	I02	8.14	4+0.15/C+0.00 h+5.91 > 4+0.35/C+0.00 h+5.91 > h+7.04 > 4+0.35/D-0.45 h+9.44 > h+9.23 > 4+0.35/D+0.60 h+9.23 > 4+0.00/D+0.60 h+9.23 > 4+0.15/D+1.12 h+9.23 > 4+0.21/D+1.12 h+9.23 > h+8.77 > 4+0.15/D+1.12 h+8.77
R013	L11	I02	9.70	5+0.15/C+0.00 h+5.91 > 5+0.34/C+0.00 h+5.91 > h+7.04 > 5+0.34/D-0.45 h+9.44 > h+9.23 > 5+0.34/D+0.60 h+9.23 > 5+0.00/D+0.60 h+9.23 > 5+0.15/D+2.70 h+9.23 > 5+0.20/D+2.70 h+9.23 > h+8.77 > 5+0.15/D+2.70 h+8.77
R014	L12	I02	8.14	5+0.15/C+0.00 h+5.91 > 5+0.34/C+0.00 h+5.91 > h+7.04 > 5+0.34/D-0.45 h+9.44 > h+9.23 > 5+0.34/D+0.60 h+9.23 > 5+0.00/D+0.60 h+9.23 > 5+0.15/D+1.12 h+9.23 > 5+0.20/D+1.12 h+9.23 > h+8.77 > 5+0.15/D+1.12 h+8.77
R015	L16	I02	8.14	6+0.15/C+0.00 h+5.91 > 6+0.34/C+0.00 h+5.91 > h+7.04 > 6+0.34/D-0.45 h+9.44 > h+9.23 > 6+0.34/D+0.60 h+9.23 > 6+0.00/D+0.60 h+9.23 > 6+0.15/D+1.12 h+9.23 > 6+0.20/D+1.12 h+9.23 > h+8.77 > 6+0.15/D+1.12 h+8.77
R016	L31	I02	2.86	3+0.11/C+0.00 h+5.91 > 3+0.00/C+0.00 h+5.91 > h+7.05 > 3+0.11/C+1.27 h+7.05 > 3+0.16/C+1.27 h+7.05 > h+6.84 > 3+0.11/C+1.27 h+6.84
R017	L32	I02	4.10	3+0.11/C+0.00 h+5.91 > 3+0.00/C+0.00 h+5.91 > h+7.05 > 3+0.11/D-1.24 h+7.05 > 3+0.16/D-1.24 h+7.05 > h+6.84 > 3+0.11/D-1.24 h+6.84
R018	L35	I02	2.86	4+0.11/C+0.00 h+5.91 > 4+0.00/C+0.00 h+5.91 > h+7.05 > 4+0.11/C+1.27 h+7.05 > 4+0.16/C+1.27 h+7.05 > h+6.84 > 4+0.11/C+1.27 h+6.84
R019	L36	I02	4.10	4+0.11/C+0.00 h+5.91 > 4+0.00/C+0.00 h+5.91 > h+7.05 > 4+0.11/D-1.24 h+7.05 > 4+0.16/D-1.24 h+7.05 > h+6.84 > 4+0.11/D-1.24 h+6.84
R020	L39	I02	2.86	5+0.11/C+0.00 h+5.91 > 5+0.00/C+0.00 h+5.91 > h+7.05 > 5+0.11/C+1.27 h+7.05 > 5+0.16/C+1.27 h+7.05 > h+6.84 > 5+0.11/C+1.27 h+6.84
R021	L40	I02	4.10	5+0.11/C+0.00 h+5.91 > 5+0.00/C+0.00 h+5.91 > h+7.05 > 5+0.11/D-1.24 h+7.05 > 5+0.16/D-1.24 h+7.05 > h+6.84 > 5+0.11/D-1.24 h+6.84
R022	L44	I02	4.10	6+0.11/C+0.00 h+5.91 > 6+0.00/C+0.00 h+5.91 > h+7.05 > 6+0.11/D-1.24 h+7.05 > 6+0.16/D-1.24 h+7.05 > h+6.84 > 6+0.11/D-1.24 h+6.84
R023	L59	I16	13.40	2'+0.00/C+0.00 h+5.91 > h-0.44 > 2'+0.00/D-0.60 h-0.44 > h+3.45
R024	L60	I16	13.85	2'+0.00/C+0.00 h+5.91 > h-0.44 > 2'+0.00/D-0.60 h-0.44 > h+3.90
R025	Shared context L2	I25	73.43	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.91 > 12+0.00/G+0.00 h+5.91 > 10+0.00/G+0.00 h+5.91 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.91 > 2'+0.00/G+0.00 h+5.91
R026	L5	I02	9.70	3+0.15/G+0.00 h+5.91 > 3+0.35/G+0.00 h+5.91 > h+7.04 > 3+0.35/E+0.45 h+9.44 > h+9.23 > 3+0.35/E-0.60 h+9.23 > 3+0.00/E-0.60 h+9.23 > 3+0.15/E-2.70 h+9.23 > 3+0.21/E-2.70 h+9.23 > h+8.77 > 3+0.15/E-2.70 h+8.77
R027	L6	I02	8.14	3+0.15/G+0.00 h+5.91 > 3+0.35/G+0.00 h+5.91 > h+7.04 > 3+0.35/E+0.45 h+9.44 > h+9.23 > 3+0.35/E-0.60 h+9.23 > 3+0.00/E-0.60 h+9.23 > 3+0.15/E-1.12 h+9.23 > 3+0.21/E-1.12 h+9.23 > h+8.77 > 3+0.15/E-1.12 h+8.77
R028	L9	I02	9.70	4+0.15/G+0.00 h+5.91 > 4+0.35/G+0.00 h+5.91 > h+7.04 > 4+0.35/E+0.45 h+9.44 > h+9.23 > 4+0.35/E-0.60 h+9.23 > 4+0.00/E-0.60 h+9.23 > 4+0.15/E-2.70 h+9.23 > 4+0.21/E-2.70 h+9.23 > h+8.77 > 4+0.15/E-2.70 h+8.77
R029	L10	I02	8.14	4+0.15/G+0.00 h+5.91 > 4+0.35/G+0.00 h+5.91 > h+7.04 > 4+0.35/E+0.45 h+9.44 > h+9.23 > 4+0.35/E-0.60 h+9.23 > 4+0.00/E-0.60 h+9.23 > 4+0.15/E-1.12 h+9.23 > 4+0.21/E-1.12 h+9.23 > h+8.77 > 4+0.15/E-1.12 h+8.77
R030	L13	I02	9.70	5+0.15/G+0.00 h+5.91 > 5+0.34/G+0.00 h+5.91 > h+7.04 > 5+0.34/E+0.45 h+9.44 > h+9.23 > 5+0.34/E-0.60 h+9.23 > 5+0.00/E-0.60 h+9.23 > 5+0.15/E-2.70 h+9.23 > 5+0.20/E-2.70 h+9.23 > h+8.77 > 5+0.15/E-2.70 h+8.77
R031	L14	I02	8.14	5+0.15/G+0.00 h+5.91 > 5+0.34/G+0.00 h+5.91 > h+7.04 > 5+0.34/E+0.45 h+9.44 > h+9.23 > 5+0.34/E-0.60 h+9.23 > 5+0.00/E-0.60 h+9.23 > 5+0.15/E-1.12 h+9.23 > 5+0.20/E-1.12 h+9.23 > h+8.77 > 5+0.15/E-1.12 h+8.77
R032	L18	I02	8.14	6+0.15/G+0.00 h+5.91 > 6+0.34/G+0.00 h+5.91 > h+7.04 > 6+0.34/E+0.45 h+9.44 > h+9.23 > 6+0.34/E-0.60 h+9.23 > 6+0.00/E-0.60 h+9.23 > 6+0.15/E-1.12 h+9.23 > 6+0.20/E-1.12 h+9.23 > h+8.77 > 6+0.15/E-1.12 h+8.77
R033	L33	I02	2.86	3+0.11/G+0.00 h+5.91 > 3+0.00/G+0.00 h+5.91 > h+7.05 > 3+0.11/G-1.27 h+7.05 > 3+0.16/G-1.27 h+7.05 > h+6.84 > 3+0.11/G-1.27 h+6.84
R034	L34	I02	4.10	3+0.11/G+0.00 h+5.91 > 3+0.00/G+0.00 h+5.91 > h+7.05 > 3+0.11/E+1.24 h+7.05 > 3+0.16/E+1.24 h+7.05 > h+6.84 > 3+0.11/E+1.24 h+6.84
R035	L37	I02	2.86	4+0.11/G+0.00 h+5.91 > 4+0.00/G+0.00 h+5.91 > h+7.05 > 4+0.11/G-1.27 h+7.05 > 4+0.16/G-1.27 h+7.05 > h+6.84 > 4+0.11/G-1.27 h+6.84
R036	L38	I02	4.10	4+0.11/G+0.00 h+5.91 > 4+0.00/G+0.00 h+5.91 > h+7.05 > 4+0.11/E+1.24 h+7.05 > 4+0.16/E+1.24 h+7.05 > h+6.84 > 4+0.11/E+1.24 h+6.84
R037	L41	I02	2.86	5+0.11/G+0.00 h+5.91 > 5+0.00/G+0.00 h+5.91 > h+7.05 > 5+0.11/G-1.27 h+7.05 > 5+0.16/G-1.27 h+7.05 > h+6.84 > 5+0.11/G-1.27 h+6.84
R038	L42	I02	4.10	5+0.11/G+0.00 h+5.91 > 5+0.00/G+0.00 h+5.91 > h+7.05 > 5+0.11/E+1.24 h+7.05 > 5+0.16/E+1.24 h+7.05 > h+6.84 > 5+0.11/E+1.24 h+6.84
R039	L46	I02	4.10	6+0.11/G+0.00 h+5.91 > 6+0.00/G+0.00 h+5.91 > h+7.05 > 6+0.11/E+1.24 h+7.05 > 6+0.16/E+1.24 h+7.05 > h+6.84 > 6+0.11/E+1.24 h+6.84
R040	L61	I16	13.40	2'+0.00/G+0.00 h+5.91 > h-0.44 > 2'+0.00/E+0.60 h-0.44 > h+3.45
R041	L62	I16	13.85	2'+0.00/G+0.00 h+5.91 > h-0.44 > 2'+0.00/E+0.60 h-0.44 > h+3.90
R042	Shared context L1	I25	48.73	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.90 > 12+0.00/C+0.00 h+5.90 > 10+0.00/C+0.00 h+5.90 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.90 > 6+0.11/C+0.00 h+5.90
R043	L15	I02	9.71	6+0.15/C+0.00 h+5.90 > 6+0.34/C+0.00 h+5.90 > h+7.04 > 6+0.34/D-0.45 h+9.44 > h+9.23 > 6+0.34/D+0.60 h+9.23 > 6+0.00/D+0.60 h+9.23 > 6+0.15/D+2.70 h+9.23 > 6+0.20/D+2.70 h+9.23 > h+8.77 > 6+0.15/D+2.70 h+8.77
R044	L19	I02	9.71	7+0.15/C+0.00 h+5.90 > 7+0.34/C+0.00 h+5.90 > h+7.04 > 7+0.34/D-0.45 h+9.44 > h+9.23 > 7+0.34/D+0.60 h+9.23 > 7+0.00/D+0.60 h+9.23 > 7+0.15/D+2.70 h+9.23 > 7+0.20/D+2.70 h+9.23 > h+8.77 > 7+0.15/D+2.70 h+8.77
R045	L20	I02	8.14	7+0.15/C+0.00 h+5.90 > 7+0.34/C+0.00 h+5.90 > h+7.04 > 7+0.34/D-0.45 h+9.44 > h+9.23 > 7+0.34/D+0.60 h+9.23 > 7+0.00/D+0.60 h+9.23 > 7+0.15/D+1.12 h+9.23 > 7+0.20/D+1.12 h+9.23 > h+8.77 > 7+0.15/D+1.12 h+8.77

THACH BI CHURCH

RS-02

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R046	L23	I02	9.71	8+0.15/C+0.00 h+5.90 > 8+0.34/C+0.00 h+5.90 > h+7.04 > 8+0.34/D-0.45 h+9.44 > h+9.23 > 8+0.34/D+0.60 h+9.23 > 8+0.00/D+0.60 h+9.23 > 8+0.15/D+2.70 h+9.23 > 8+0.20/D+2.70 h+9.23 > h+8.77 > 8+0.15/D+2.70 h+8.77
R047	L24	I02	8.14	8+0.15/C+0.00 h+5.90 > 8+0.34/C+0.00 h+5.90 > h+7.04 > 8+0.34/D-0.45 h+9.44 > h+9.23 > 8+0.34/D+0.60 h+9.23 > 8+0.00/D+0.60 h+9.23 > 8+0.15/D+1.12 h+9.23 > 8+0.20/D+1.12 h+9.23 > h+8.77 > 8+0.15/D+1.12 h+8.77
R048	L27	I02	8.57	9+0.15/C+0.00 h+7.04 > 9+0.34/C+0.00 h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.15/D+2.70 h+9.23 > 9+0.20/D+2.70 h+9.23 > h+8.77 > 9+0.15/D+2.70 h+8.77
R049	L28	I02	7.00	9+0.15/C+0.00 h+7.04 > 9+0.34/C+0.00 h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.15/D+1.12 h+9.23 > 9+0.20/D+1.12 h+9.23 > h+8.77 > 9+0.15/D+1.12 h+8.77
R050	L43	I02	2.86	6+0.11/C+0.00 h+5.90 > 6+0.00/C+0.00 h+5.90 > h+7.05 > 6+0.11/C+1.27 h+7.05 > 6+0.16/C+1.27 h+7.05 > h+6.84 > 6+0.11/C+1.27 h+6.84
R051	L47	I02	2.86	7+0.11/C+0.00 h+5.90 > 7+0.00/C+0.00 h+5.90 > h+7.05 > 7+0.11/C+1.27 h+7.05 > 7+0.16/C+1.27 h+7.05 > h+6.84 > 7+0.11/C+1.27 h+6.84
R052	L48	I02	4.11	7+0.11/C+0.00 h+5.90 > 7+0.00/C+0.00 h+5.90 > h+7.05 > 7+0.11/D-1.24 h+7.05 > 7+0.16/D-1.24 h+7.05 > h+6.84 > 7+0.11/D-1.24 h+6.84
R053	L51	I02	2.86	8+0.11/C+0.00 h+5.90 > 8+0.00/C+0.00 h+5.90 > h+7.05 > 8+0.11/C+1.27 h+7.05 > 8+0.16/C+1.27 h+7.05 > h+6.84 > 8+0.11/C+1.27 h+6.84
R054	L52	I02	4.11	8+0.11/C+0.00 h+5.90 > 8+0.00/C+0.00 h+5.90 > h+7.05 > 8+0.11/D-1.24 h+7.05 > 8+0.16/D-1.24 h+7.05 > h+6.84 > 8+0.11/D-1.24 h+6.84
R055	L55	I02	1.72	9+0.11/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+7.05 > 9+0.11/C+1.27 h+7.05 > 9+0.16/C+1.27 h+7.05 > h+6.84 > 9+0.11/C+1.27 h+6.84
R056	L56	I02	2.97	9+0.11/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+7.05 > 9+0.11/D-1.24 h+7.05 > 9+0.16/D-1.24 h+7.05 > h+6.84 > 9+0.11/D-1.24 h+6.84
R057	Shared context L1	I25	55.33	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.90 > 12+0.00/G+0.00 h+5.90 > 10+0.00/G+0.00 h+5.90 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.90 > 6+0.11/G+0.00 h+5.90
R058	L17	I02	9.71	6+0.15/G+0.00 h+5.90 > 6+0.34/G+0.00 h+5.90 > h+7.04 > 6+0.34/E+0.45 h+9.44 > h+9.23 > 6+0.34/E-0.60 h+9.23 > 6+0.00/E-0.60 h+9.23 > 6+0.15/E-2.70 h+9.23 > 6+0.20/E-2.70 h+9.23 > h+8.77 > 6+0.15/E-2.70 h+8.77
R059	L21	I02	9.71	7+0.15/G+0.00 h+5.90 > 7+0.34/G+0.00 h+5.90 > h+7.04 > 7+0.34/E+0.45 h+9.44 > h+9.23 > 7+0.34/E-0.60 h+9.23 > 7+0.00/E-0.60 h+9.23 > 7+0.15/E-2.70 h+9.23 > 7+0.20/E-2.70 h+9.23 > h+8.77 > 7+0.15/E-2.70 h+8.77
R060	L22	I02	8.14	7+0.15/G+0.00 h+5.90 > 7+0.34/G+0.00 h+5.90 > h+7.04 > 7+0.34/E+0.45 h+9.44 > h+9.23 > 7+0.34/E-0.60 h+9.23 > 7+0.00/E-0.60 h+9.23 > 7+0.15/E-1.12 h+9.23 > 7+0.20/E-1.12 h+9.23 > h+8.77 > 7+0.15/E-1.12 h+8.77
R061	L25	I02	9.71	8+0.15/G+0.00 h+5.90 > 8+0.34/G+0.00 h+5.90 > h+7.04 > 8+0.34/E+0.45 h+9.44 > h+9.23 > 8+0.34/E-0.60 h+9.23 > 8+0.00/E-0.60 h+9.23 > 8+0.15/E-2.70 h+9.23 > 8+0.20/E-2.70 h+9.23 > h+8.77 > 8+0.15/E-2.70 h+8.77
R062	L26	I02	8.14	8+0.15/G+0.00 h+5.90 > 8+0.34/G+0.00 h+5.90 > h+7.04 > 8+0.34/E+0.45 h+9.44 > h+9.23 > 8+0.34/E-0.60 h+9.23 > 8+0.00/E-0.60 h+9.23 > 8+0.15/E-1.12 h+9.23 > 8+0.20/E-1.12 h+9.23 > h+8.77 > 8+0.15/E-1.12 h+8.77
R063	L29	I02	8.57	9+0.15/G+0.00 h+7.04 > 9+0.34/G+0.00 h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.15/E-2.70 h+9.23 > 9+0.20/E-2.70 h+9.23 > h+8.77 > 9+0.15/E-2.70 h+8.77
R064	L30	I02	7.00	9+0.15/G+0.00 h+7.04 > 9+0.34/G+0.00 h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.15/E-1.12 h+9.23 > 9+0.20/E-1.12 h+9.23 > h+8.77 > 9+0.15/E-1.12 h+8.77
R065	L45	I02	2.86	6+0.11/G+0.00 h+5.90 > 6+0.00/G+0.00 h+5.90 > h+7.05 > 6+0.11/G-1.27 h+7.05 > 6+0.16/G-1.27 h+7.05 > h+6.84 > 6+0.11/G-1.27 h+6.84
R066	L49	I02	2.86	7+0.11/G+0.00 h+5.90 > 7+0.00/G+0.00 h+5.90 > h+7.05 > 7+0.11/G-1.27 h+7.05 > 7+0.16/G-1.27 h+7.05 > h+6.84 > 7+0.11/G-1.27 h+6.84
R067	L50	I02	4.11	7+0.11/G+0.00 h+5.90 > 7+0.00/G+0.00 h+5.90 > h+7.05 > 7+0.11/E+1.24 h+7.05 > 7+0.16/E+1.24 h+7.05 > h+6.84 > 7+0.11/E+1.24 h+6.84
R068	L53	I02	2.86	8+0.11/G+0.00 h+5.90 > 8+0.00/G+0.00 h+5.90 > h+7.05 > 8+0.11/G-1.27 h+7.05 > 8+0.16/G-1.27 h+7.05 > h+6.84 > 8+0.11/G-1.27 h+6.84
R069	L54	I02	4.11	8+0.11/G+0.00 h+5.90 > 8+0.00/G+0.00 h+5.90 > h+7.05 > 8+0.11/E+1.24 h+7.05 > 8+0.16/E+1.24 h+7.05 > h+6.84 > 8+0.11/E+1.24 h+6.84
R070	L57	I02	1.72	9+0.11/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+7.05 > 9+0.11/G-1.27 h+7.05 > 9+0.16/G-1.27 h+7.05 > h+6.84 > 9+0.11/G-1.27 h+6.84
R071	L58	I02	2.97	9+0.11/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+7.05 > 9+0.11/E+1.24 h+7.05 > 9+0.16/E+1.24 h+7.05 > h+6.84 > 9+0.11/E+1.24 h+6.84
R072	Shared context LA	I25	62.31	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.93 > 12+0.00/C+0.00 h+5.93 > 10+0.00/C+0.00 h+5.93 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.93 > 3+0.00/C+0.00 h+5.93
R073	L71	I02	10.20	3+0.00/C+0.00 h+5.93 > 3+0.35/C+0.00 h+5.93 > h+7.04 > 3+0.35/D-0.45 h+9.44 > h+9.23 > 3+0.35/D+0.60 h+9.23 > 3+0.00/D+0.60 h+9.23 > 3+0.00/D+3.60 h+9.23 > h+9.18
R074	L72	I02	10.20	4+0.00/C+0.00 h+5.93 > 4+0.35/C+0.00 h+5.93 > h+7.04 > 4+0.35/D-0.45 h+9.44 > h+9.23 > 4+0.35/D+0.60 h+9.23 > 4+0.00/D+0.60 h+9.23 > 4+0.00/D+3.60 h+9.23 > h+9.18
R075	L73	I02	10.20	5+0.00/C+0.00 h+5.93 > 5+0.34/C+0.00 h+5.93 > h+7.04 > 5+0.34/D-0.45 h+9.44 > h+9.23 > 5+0.34/D+0.60 h+9.23 > 5+0.00/D+0.60 h+9.23 > 5+0.00/D+3.60 h+9.23 > h+9.18
R076	L74	I02	10.20	6+0.00/C+0.00 h+5.93 > 6+0.34/C+0.00 h+5.93 > h+7.04 > 6+0.34/D-0.45 h+9.44 > h+9.23 > 6+0.34/D+0.60 h+9.23 > 6+0.00/D+0.60 h+9.23 > 6+0.00/D+3.60 h+9.23 > h+9.18
R077	L75	I02	10.20	7+0.00/C+0.00 h+5.93 > 7+0.34/C+0.00 h+5.93 > h+7.04 > 7+0.34/D-0.45 h+9.44 > h+9.23 > 7+0.34/D+0.60 h+9.23 > 7+0.00/D+0.60 h+9.23 > 7+0.00/D+3.60 h+9.23 > h+9.18
R078	L76	I02	10.20	8+0.00/C+0.00 h+5.93 > 8+0.34/C+0.00 h+5.93 > h+7.04 > 8+0.34/D-0.45 h+9.44 > h+9.23 > 8+0.34/D+0.60 h+9.23 > 8+0.00/D+0.60 h+9.23 > 8+0.00/D+3.60 h+9.23 > h+9.18
R079	L77	I02	10.20	9+0.00/C+0.00 h+5.93 > 9+0.34/C+0.00 h+5.93 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+3.60 h+9.23 > h+9.18
R080	Shared context L3	I25	35.32	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/C+0.00 h+5.92 > 10+0.00/C+0.00 h+5.92 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.92
R081	L81	I03	11.56	9+3.60/C+0.00 h+9.27 > 9+3.60/D-0.64 h+9.27 > 9+3.60/D-0.56 h+9.36 > 9+3.60/D+3.60 h+12.38 > h+11.95 > h+9.20
R082	L98	I02	9.91	9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+2.20 h+9.23 > 9+0.20/D+2.20 h+9.23 > h+8.54 > 9+0.00/D+2.20 h+8.54 > h+8.58
R083	L100	I01	9.19	9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+0.45 h+9.23 > 9+0.52/D+0.45 h+9.23 > h+8.48 > 9-0.05/D+0.45 h+8.48 > 9-0.05/D+0.44 h+8.48 > h+8.51
R084	L101	I02	9.41	9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+1.70 h+9.23 > 9+0.20/D+1.70 h+9.23 > h+8.54 > 9+0.00/D+1.70 h+8.54 > h+8.58
R085	L104	I02	10.71	9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+3.00 h+9.23 > 9+0.20/D+3.00 h+9.23 > h+8.54 > 9+0.00/D+3.00 h+8.54 > h+8.58
R086	L106	I06	9.55	11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+0.58/D+0.08 h+7.25 > h+7.60 > 10+0.58/D+0.36 h+7.60
R087	L107	I06	9.20	11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+0.58/D+0.08 h+7.25 > 10+0.58/D+0.36 h+7.25
R088	L108	I06	8.75	11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+1.03/D+0.08 h+7.25 > 10+1.03/D+0.36 h+7.25
R089	L109	I06	10.07	11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+1.18/D+0.08 h+7.25 > h+8.42 > 10+1.18/D+0.66 h+8.42
R090	L114	I06	8.30	11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+1.48/D+0.08 h+7.25 > 10+1.48/D+0.36 h+7.25
R091	L115	I03	8.06	10+0.51/C+0.00 h+5.92 > h+7.04 > 10+0.51/D-0.54 h+9.38 > h+6.48 > h+6.42

THACH BI CHURCH

RS-03

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R092	L116	I03	8.12	10+1.08/C+0.00 h+5.92 > h+7.04 > 10+1.08/D-0.54 h+9.38 > h+6.42 > h+6.36
R093	L151	I17	6.93	12-0.22/C+0.00 h+5.92 > 12+0.00/C+0.00 h+5.92 > 12+0.00/D-0.88 h+5.92 > h+2.30 > 12-0.22/D-0.88 h+2.30
R094	L152	I17	4.93	12-0.22/C+0.00 h+5.92 > 12+0.00/C+0.00 h+5.92 > 12+0.00/C+0.88 h+5.92 > h+2.30 > 12-0.22/C+0.88 h+2.30
R095	Shared context L3	I25	41.92	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/G+0.00 h+5.92 > 10+0.00/G+0.00 h+5.92 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.92
R096	L99	I02	9.91	9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.00/E-2.20 h+9.23 > 9+0.20/E-2.20 h+9.23 > h+8.54 > 9+0.00/E-2.20 h+8.54 > h+8.58
R097	L102	I02	9.41	9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.00/E-1.70 h+9.23 > 9+0.20/E-1.70 h+9.23 > h+8.54 > 9+0.00/E-1.70 h+8.54 > h+8.58
R098	L103	I02	8.31	9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.20/E-0.60 h+9.23 > h+8.54 > 9+0.00/E-0.60 h+8.54 > h+8.58
R099	L105	I02	10.71	9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.00/E-3.00 h+9.23 > 9+0.20/E-3.00 h+9.23 > h+8.54 > 9+0.00/E-3.00 h+8.54 > h+8.58
R100	L110	I06	9.55	11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+0.58/E-0.08 h+7.25 > h+7.60 > 10+0.58/E-0.36 h+7.60
R101	L111	I06	9.20	11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+0.58/E-0.08 h+7.25 > 10+0.58/E-0.36 h+7.25
R102	L112	I06	8.75	11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+1.03/E-0.08 h+7.25 > 10+1.03/E-0.36 h+7.25
R103	L113	I06	10.07	11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+1.18/E-0.08 h+7.25 > h+8.42 > 10+1.18/E-0.66 h+8.42
R104	L117	I03	8.06	10+0.51/G+0.00 h+5.92 > h+7.04 > 10+0.51/E+0.54 h+9.38 > h+6.48 > h+6.42
R105	L118	I03	8.12	10+1.08/G+0.00 h+5.92 > h+7.04 > 10+1.08/E+0.54 h+9.38 > h+6.42 > h+6.36
R106	L153	I17	6.93	12-0.22/G+0.00 h+5.92 > 12+0.00/G+0.00 h+5.92 > 12+0.00/E+0.88 h+5.92 > h+2.30 > 12-0.22/E+0.88 h+2.30
R107	L154	I17	4.93	12-0.22/G+0.00 h+5.92 > 12+0.00/G+0.00 h+5.92 > 12+0.00/G-0.88 h+5.92 > h+2.30 > 12-0.22/G-0.88 h+2.30
R108	Shared context L4	I25	66.74	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/C+0.00 h+5.92 > 10+0.00/C+0.00 h+5.92 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.92 > 2'+0.08/C+0.00 h+5.92
R109	L119	I10	2.93	3-0.43/C+0.00 h+5.92 > h+3.10 > 3-0.43/C-0.11 h+3.10
R110	L120	I10	2.93	4-0.43/C+0.00 h+5.92 > h+3.10 > 4-0.43/C-0.11 h+3.10
R111	L121	I10	2.93	5-0.43/C+0.00 h+5.92 > h+3.10 > 5-0.43/C-0.11 h+3.10
R112	L122	I10	2.93	6-0.43/C+0.00 h+5.92 > h+3.10 > 6-0.43/C-0.11 h+3.10
R113	L123	I10	2.93	7-0.43/C+0.00 h+5.92 > h+3.10 > 7-0.43/C-0.11 h+3.10
R114	L124	I10	2.93	8-0.43/C+0.00 h+5.92 > h+3.10 > 8-0.43/C-0.11 h+3.10
R115	L125	I10	2.93	9-0.43/C+0.00 h+5.92 > h+3.10 > 9-0.43/C-0.11 h+3.10
R116	L126	I10	2.93	11-0.43/C+0.00 h+5.92 > h+3.10 > 11-0.43/C-0.11 h+3.10
R117	L127	I10	2.93	12-0.43/C+0.00 h+5.92 > h+3.10 > 12-0.43/C-0.11 h+3.10
R118	L-ARCH-B-2P-3-A	I11	8.21	2'+0.08/C+0.00 h+5.92 > h+7.04 > 2'+0.08/C-0.08 h+6.93 > 2'+0.08/B+0.00 h+6.27 > h+2.60 > 2'+0.08/B-0.24 h+2.60
R119	L-ARCH-B-2P-3-B	I11	8.21	3-0.08/C+0.00 h+5.92 > h+7.04 > 3-0.07/C-0.08 h+6.93 > 3-0.07/B+0.00 h+6.27 > h+2.60 > 3-0.07/B-0.24 h+2.60
R120	L-ARCH-B-3-4-A	I11	8.21	3+0.07/C+0.00 h+5.92 > h+7.04 > 3+0.07/C-0.08 h+6.93 > 3+0.07/B+0.00 h+6.27 > h+2.60 > 3+0.07/B-0.24 h+2.60
R121	L-ARCH-B-3-4-B	I11	8.21	4-0.08/C+0.00 h+5.92 > h+7.04 > 4-0.07/C-0.08 h+6.93 > 4-0.07/B+0.00 h+6.27 > h+2.60 > 4-0.07/B-0.24 h+2.60
R122	L-ARCH-B-4-5-A	I11	8.21	4+0.07/C+0.00 h+5.92 > h+7.04 > 4+0.07/C-0.08 h+6.93 > 4+0.07/B+0.00 h+6.27 > h+2.60 > 4+0.07/B-0.24 h+2.60
R123	L-ARCH-B-4-5-B	I11	8.21	5-0.07/C+0.00 h+5.92 > h+7.04 > 5-0.07/C-0.08 h+6.93 > 5-0.07/B+0.00 h+6.27 > h+2.60 > 5-0.07/B-0.24 h+2.60
R124	L-ARCH-B-5-6-A	I11	8.21	5+0.07/C+0.00 h+5.92 > h+7.04 > 5+0.07/C-0.08 h+6.93 > 5+0.07/B+0.00 h+6.27 > h+2.60 > 5+0.07/B-0.24 h+2.60
R125	L-ARCH-B-5-6-B	I11	8.21	6-0.07/C+0.00 h+5.92 > h+7.04 > 6-0.07/C-0.08 h+6.93 > 6-0.07/B+0.00 h+6.27 > h+2.60 > 6-0.07/B-0.24 h+2.60
R126	L-ARCH-B-6-7-A	I11	8.21	6+0.07/C+0.00 h+5.92 > h+7.04 > 6+0.07/C-0.08 h+6.93 > 6+0.07/B+0.00 h+6.27 > h+2.60 > 6+0.07/B-0.24 h+2.60
R127	L-ARCH-B-6-7-B	I11	8.21	7-0.07/C+0.00 h+5.92 > h+7.04 > 7-0.07/C-0.08 h+6.93 > 7-0.07/B+0.00 h+6.27 > h+2.60 > 7-0.07/B-0.24 h+2.60
R128	L-ARCH-B-7-8-A	I11	8.21	7+0.07/C+0.00 h+5.92 > h+7.04 > 7+0.07/C-0.08 h+6.93 > 7+0.07/B+0.00 h+6.27 > h+2.60 > 7+0.07/B-0.24 h+2.60
R129	L-ARCH-B-7-8-B	I11	8.21	8-0.08/C+0.00 h+5.92 > h+7.04 > 8-0.08/C-0.08 h+6.93 > 8-0.08/B+0.00 h+6.27 > h+2.60 > 8-0.08/B-0.24 h+2.60
R130	L-ARCH-B-8-9-A	I11	8.21	8+0.08/C+0.00 h+5.92 > h+7.04 > 8+0.08/C-0.08 h+6.93 > 8+0.08/B+0.00 h+6.27 > h+2.60 > 8+0.08/B-0.24 h+2.60
R131	L-ARCH-B-8-9-B	I11	8.24	9-0.08/C+0.00 h+5.92 > h+7.04 > 9-0.08/C-0.08 h+6.93 > 9-0.08/B+0.23 h+6.32 > 9-0.08/B+0.16 h+6.31 > 9-0.08/B+0.00 h+6.31 > h+2.60 > 9-0.08/B-0.24 h+2.60
R132	L-ARCH-B-10-11-A	I11	8.24	10+0.08/C+0.00 h+5.92 > h+7.04 > 10+0.08/C-0.08 h+6.93 > 10+0.08/B+0.23 h+6.32 > 10+0.08/B+0.16 h+6.31 > 10+0.08/B+0.00 h+6.31 > h+2.60 > 10+0.08/B-0.24 h+2.60
R133	L-ARCH-B-10-11-B	I11	8.21	11-0.08/C+0.00 h+5.92 > h+7.04 > 11-0.08/C-0.08 h+6.93 > 11-0.08/B+0.00 h+6.27 > h+2.60 > 11-0.08/B-0.24 h+2.60
R134	L-ARCH-B-11-12-A	I11	8.21	11+0.08/C+0.00 h+5.92 > h+7.04 > 11+0.08/C-0.08 h+6.93 > 11+0.08/B+0.00 h+6.27 > h+2.60 > 11+0.08/B-0.24 h+2.60
R135	L-ARCH-B-11-12-B	I17	6.77	12-0.08/C+0.00 h+5.92 > 12+0.00/C+0.00 h+5.92 > 12+0.00/B-0.24 h+5.92 > h+2.60 > 12-0.08/B-0.24 h+2.60
R136	Shared context L4	I25	73.34	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/G+0.00 h+5.92 > 10+0.00/G+0.00 h+5.92 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.92 > 2'+0.08/G+0.00 h+5.92
R137	L128	I10	2.93	3-0.43/G+0.00 h+5.92 > h+3.10 > 3-0.43/G+0.11 h+3.10

THACH BI CHURCH

RS-04

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R138	L129	I10	2.93	4-0.43/G+0.00 h+5.92 > h+3.10 > 4-0.43/G+0.11 h+3.10
R139	L130	I10	2.93	5-0.43/G+0.00 h+5.92 > h+3.10 > 5-0.43/G+0.11 h+3.10
R140	L131	I10	2.93	6-0.43/G+0.00 h+5.92 > h+3.10 > 6-0.43/G+0.11 h+3.10
R141	L132	I10	2.93	7-0.43/G+0.00 h+5.92 > h+3.10 > 7-0.43/G+0.11 h+3.10
R142	L133	I10	2.93	8-0.43/G+0.00 h+5.92 > h+3.10 > 8-0.43/G+0.11 h+3.10
R143	L134	I10	2.93	9-0.43/G+0.00 h+5.92 > h+3.10 > 9-0.43/G+0.11 h+3.10
R144	L135	I10	2.93	11-0.43/G+0.00 h+5.92 > h+3.10 > 11-0.43/G+0.11 h+3.10
R145	L136	I10	2.93	12-0.43/G+0.00 h+5.92 > h+3.10 > 12-0.43/G+0.11 h+3.10
R146	L-ARCH-H-2P-3-A	I11	8.21	2'+0.08/G+0.00 h+5.92 > h+7.04 > 2'+0.08/G+0.08 h+6.93 > 2'+0.08/H+0.00 h+6.27 > h+2.60 > 2'+0.08/H+0.24 h+2.60
R147	L-ARCH-H-2P-3-B	I11	8.21	3-0.08/G+0.00 h+5.92 > h+7.04 > 3-0.07/G+0.08 h+6.93 > 3-0.07/H+0.00 h+6.27 > h+2.60 > 3-0.07/H+0.24 h+2.60
R148	L-ARCH-H-3-4-A	I11	8.21	3+0.07/G+0.00 h+5.92 > h+7.04 > 3+0.07/G+0.08 h+6.93 > 3+0.07/H+0.00 h+6.27 > h+2.60 > 3+0.07/H+0.24 h+2.60
R149	L-ARCH-H-3-4-B	I11	8.21	4-0.08/G+0.00 h+5.92 > h+7.04 > 4-0.07/G+0.08 h+6.93 > 4-0.07/H+0.00 h+6.27 > h+2.60 > 4-0.07/H+0.24 h+2.60
R150	L-ARCH-H-4-5-A	I11	8.21	4+0.07/G+0.00 h+5.92 > h+7.04 > 4+0.07/G+0.08 h+6.93 > 4+0.07/H+0.00 h+6.27 > h+2.60 > 4+0.07/H+0.24 h+2.60
R151	L-ARCH-H-4-5-B	I11	8.21	5-0.07/G+0.00 h+5.92 > h+7.04 > 5-0.07/G+0.08 h+6.93 > 5-0.07/H+0.00 h+6.27 > h+2.60 > 5-0.07/H+0.24 h+2.60
R152	L-ARCH-H-5-6-A	I11	8.21	5+0.07/G+0.00 h+5.92 > h+7.04 > 5+0.07/G+0.08 h+6.93 > 5+0.07/H+0.00 h+6.27 > h+2.60 > 5+0.07/H+0.24 h+2.60
R153	L-ARCH-H-5-6-B	I11	8.21	6-0.07/G+0.00 h+5.92 > h+7.04 > 6-0.07/G+0.08 h+6.93 > 6-0.07/H+0.00 h+6.27 > h+2.60 > 6-0.07/H+0.24 h+2.60
R154	L-ARCH-H-6-7-A	I11	8.21	6+0.07/G+0.00 h+5.92 > h+7.04 > 6+0.07/G+0.08 h+6.93 > 6+0.07/H+0.00 h+6.27 > h+2.60 > 6+0.07/H+0.24 h+2.60
R155	L-ARCH-H-6-7-B	I11	8.21	7-0.07/G+0.00 h+5.92 > h+7.04 > 7-0.07/G+0.08 h+6.93 > 7-0.07/H+0.00 h+6.27 > h+2.60 > 7-0.07/H+0.24 h+2.60
R156	L-ARCH-H-7-8-A	I11	8.21	7+0.07/G+0.00 h+5.92 > h+7.04 > 7+0.07/G+0.08 h+6.93 > 7+0.07/H+0.00 h+6.27 > h+2.60 > 7+0.07/H+0.24 h+2.60
R157	L-ARCH-H-7-8-B	I11	8.21	8-0.08/G+0.00 h+5.92 > h+7.04 > 8-0.08/G+0.08 h+6.93 > 8-0.08/H+0.00 h+6.27 > h+2.60 > 8-0.08/H+0.24 h+2.60
R158	L-ARCH-H-8-9-A	I11	8.21	8+0.08/G+0.00 h+5.92 > h+7.04 > 8+0.08/G+0.08 h+6.93 > 8+0.08/H+0.00 h+6.27 > h+2.60 > 8+0.08/H+0.24 h+2.60
R159	L-ARCH-H-8-9-B	I11	8.24	9-0.08/G+0.00 h+5.92 > h+7.04 > 9-0.08/G+0.08 h+6.93 > 9-0.08/H-0.23 h+6.32 > 9-0.08/H-0.16 h+6.31 > 9-0.08/H+0.00 h+6.31 > h+2.60 > 9-0.08/H+0.24 h+2.60
R160	L-ARCH-H-10-11-A	I11	8.24	10+0.08/G+0.00 h+5.92 > h+7.04 > 10+0.08/G+0.08 h+6.93 > 10+0.08/H-0.23 h+6.32 > 10+0.08/H-0.16 h+6.31 > 10+0.08/H+0.00 h+6.31 > h+2.60 > 10+0.08/H+0.24 h+2.60
R161	L-ARCH-H-10-11-B	I11	8.21	11-0.08/G+0.00 h+5.92 > h+7.04 > 11-0.08/G+0.08 h+6.93 > 11-0.08/H+0.00 h+6.27 > h+2.60 > 11-0.08/H+0.24 h+2.60
R162	L-ARCH-H-11-12-A	I11	8.21	11+0.08/G+0.00 h+5.92 > h+7.04 > 11+0.08/G+0.08 h+6.93 > 11+0.08/H+0.00 h+6.27 > h+2.60 > 11+0.08/H+0.24 h+2.60
R163	L-ARCH-H-11-12-B	I17	6.77	12-0.08/G+0.00 h+5.92 > 12+0.00/G+0.00 h+5.92 > 12+0.00/H+0.24 h+5.92 > h+2.60 > 12-0.08/H+0.24 h+2.60
R164	Shared context L9	I25	26.55	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+5.97
R165	L137	I08	11.54	1+2.35/C+0.00 h+5.97 > h+7.65 > 1+2.35/D+1.30 h+7.65 > h+3.00 > 1+2.20/D+1.30 h+3.00
R166	L182	I22	10.78	1+2.35/C+0.00 h+5.97 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/A+1.40 h+8.39 > 1-0.30/A+1.40 h+8.39
R167	L183	I22	6.36	1+2.35/C+0.00 h+5.97 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+8.39 > 1+0.09/C-1.09 h+8.39 > 1-0.30/C-1.09 h+8.39
R168	Shared context L9	I25	11.83	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+5.97
R169	L138	I08	11.54	1+2.35/G+0.00 h+5.97 > h+7.65 > 1+2.35/E-1.30 h+7.65 > h+3.00 > 1+2.20/E-1.30 h+3.00
R170	L189	I22	6.36	1+2.35/G+0.00 h+5.97 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+8.39 > 1+0.09/G+1.09 h+8.39 > 1-0.30/G+1.09 h+8.39
R171	L190	I22	10.78	1+2.35/G+0.00 h+5.97 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/I-1.40 h+8.39 > 1-0.30/I-1.40 h+8.39
R172	Shared context L5	I25	57.79	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.95 > 12+0.00/C+0.00 h+5.95 > 10+0.00/C+0.00 h+5.95 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.95 > 4+0.00/C+0.00 h+5.95
R173	L139	I10	3.51	4+0.83/C+0.00 h+5.95 > h+2.60 > 4+0.83/C-0.16 h+2.60
R174	L140	I10	3.51	5-0.82/C+0.00 h+5.95 > h+2.60 > 5-0.82/C-0.16 h+2.60
R175	L141	I10	3.51	8+0.83/C+0.00 h+5.95 > h+2.60 > 8+0.83/C-0.16 h+2.60
R176	L142	I10	3.51	9-0.83/C+0.00 h+5.95 > h+2.60 > 9-0.83/C-0.16 h+2.60
R177	L184	I11	4.98	4+0.00/C+0.00 h+5.95 > h+7.04 > 4+0.00/C-0.08 h+6.93 > 4+0.00/B+0.00 h+6.27 > h+5.90 > 4+0.00/B-0.34 h+5.90
R178	L185	I11	4.98	6+0.00/C+0.00 h+5.95 > h+7.04 > 6+0.00/C-0.08 h+6.93 > 6+0.00/B+0.00 h+6.27 > h+5.90 > 6+0.00/B-0.34 h+5.90
R179	L186	I11	4.98	11+0.00/C+0.00 h+5.95 > h+7.04 > 11+0.00/C-0.08 h+6.93 > 11+0.00/B+0.00 h+6.27 > h+5.90 > 11+0.00/B-0.34 h+5.90
R180	L187	I11	9.08	9+3.60/C+0.00 h+9.27 > 9+3.60/A+0.00 h+9.27 > h+6.20 > 9+3.60/A+0.12 h+6.20
R181	L188	I17	3.79	12+0.00/C+0.00 h+5.95 > 12+0.00/D-0.90 h+5.95 > h+5.20 > 12+0.18/D-0.90 h+5.20
R182	Shared context L5	I25	64.39	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.95 > 12+0.00/G+0.00 h+5.95 > 10+0.00/G+0.00 h+5.95 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.95 > 4+0.00/G+0.00 h+5.95
R183	L145	I10	3.51	4+0.83/G+0.00 h+5.95 > h+2.60 > 4+0.83/G+0.16 h+2.60
R184	L146	I10	3.51	5-0.82/G+0.00 h+5.95 > h+2.60 > 5-0.82/G+0.16 h+2.60

THACH BI CHURCH

RS-05

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R185	L147	I10	3.51	8+0.83/G+0.00 h+5.95 > h+2.60 > 8+0.83/G+0.16 h+2.60
R186	L148	I10	3.51	9-0.83/G+0.00 h+5.95 > h+2.60 > 9-0.83/G+0.16 h+2.60
R187	L191	I11	4.98	4+0.00/G+0.00 h+5.95 > h+7.04 > 4+0.00/G+0.08 h+6.93 > 4+0.00/H+0.00 h+6.27 > h+5.90 > 4+0.00/H+0.34 h+5.90
R188	L192	I11	4.98	6+0.00/G+0.00 h+5.95 > h+7.04 > 6+0.00/G+0.08 h+6.93 > 6+0.00/H+0.00 h+6.27 > h+5.90 > 6+0.00/H+0.34 h+5.90
R189	L193	I11	4.98	11+0.00/G+0.00 h+5.95 > h+7.04 > 11+0.00/G+0.08 h+6.93 > 11+0.00/H+0.00 h+6.27 > h+5.90 > 11+0.00/H+0.34 h+5.90
R190	L194	I11	9.08	9+3.60/G+0.00 h+9.27 > 9+3.60/I+0.00 h+9.27 > h+6.20 > 9+3.60/I-0.12 h+6.20
R191	L195	I17	3.79	12+0.00/G+0.00 h+5.95 > 12+0.00/E+0.90 h+5.95 > h+5.20 > 12+0.18/E+0.90 h+5.20
R192	Shared context E1	I25	65.77	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.99 > 12+0.00/C+0.00 h+5.99 > 10+0.00/C+0.00 h+5.99 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.99 > 2'+0.08/C+0.00 h+5.99
R193	L155	I13	12.65	2'+0.08/C+0.00 h+5.99 > 2'-0.25/C+0.00 h+5.99 > 2'-0.25/E-1.90 h+5.99 > h+4.90 > 2'-0.25/D+3.60 h+4.90 > 2'+0.08/D+3.60 h+4.90 > h+4.76
R194	L156	I24	6.97	5-0.96/C+0.00 h+5.99 > 4+0.98/C+0.00 h+5.99 > h+3.06 > 4+0.98/C-0.14 h+3.06 > 4+2.25/C-0.14 h+3.06 > 4+2.25/C-0.08 h+3.06
R195	L158	I24	6.97	9-0.95/C+0.00 h+5.99 > 8+0.98/C+0.00 h+5.99 > h+3.06 > 8+0.98/C-0.14 h+3.06 > 8+2.25/C-0.14 h+3.06 > 8+2.25/C-0.08 h+3.06
R196	Shared context E1	I25	59.91	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.99 > 12+0.00/G+0.00 h+5.99 > 10+0.00/G+0.00 h+5.99 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.99 > 5-0.96/G+0.00 h+5.99
R197	L157	I24	6.97	5-0.96/G+0.00 h+5.99 > 4+0.98/G+0.00 h+5.99 > h+3.06 > 4+0.98/G+0.14 h+3.06 > 4+2.25/G+0.14 h+3.06 > 4+2.25/G+0.08 h+3.06
R198	L159	I24	6.97	9-0.95/G+0.00 h+5.99 > 8+0.98/G+0.00 h+5.99 > h+3.06 > 8+0.98/G+0.14 h+3.06 > 8+2.25/G+0.14 h+3.06 > 8+2.25/G+0.08 h+3.06
R199	Shared context L6	I25	27.96	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+5.96 > 2-1.15/C+0.00 h+5.96
R200	L160	I22	11.23	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/B-1.04 h+8.39 > 1-0.34/B-1.04 h+8.39
R201	L161	I22	12.53	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/B+0.26 h+8.39 > 1-0.34/B+0.26 h+8.39
R202	L162	I22	20.09	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+15.84 > 1+0.19/B+0.26 h+15.84 > 1-0.25/B+0.26 h+15.84
R203	L163	I22	27.86	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+23.14 > 1+0.47/B+0.26 h+23.14 > 1-0.15/B+0.26 h+23.14
R204	L164	I23	33.50	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+29.03 > 1+0.47/B+0.26 h+29.03 > 1+0.14/B+0.26 h+29.03 > h+29.09
R205	L165	I23	29.39	1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+23.08 > 1+2.45/A+1.39 h+23.08 > 1+2.45/B+0.26 h+23.08 > h+23.20
R206	L166	I22	14.88	2-1.15/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/A+0.77 h+8.39 > 2-1.15/A+0.77 h+8.39 > 2-1.15/A+0.31 h+8.39
R207	L167	I22	13.08	1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/A+0.77 h+8.39 > 1+2.45/A+0.77 h+8.39 > 1+2.45/A+0.31 h+8.39
R208	L168	I22	20.61	1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+15.84 > 1+0.19/A+0.87 h+15.84 > 1+2.45/A+0.87 h+15.84 > 1+2.45/A+0.43 h+15.84
R209	L169	I22	28.36	1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+23.14 > 1+0.47/A+1.15 h+23.14 > 1+2.45/A+1.15 h+23.14 > 1+2.45/A+0.53 h+23.14
R210	L170	I08	4.97	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.04 h+7.65 > h+8.39 > 1-0.15/C-0.04 h+8.39
R211	L222	I22	6.20	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+8.39 > 1+0.09/C-0.34 h+8.39 > 1-0.15/C-0.34 h+8.39
R212	L223	I22	14.00	1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+15.85 > 1+0.19/C-0.71 h+15.85 > 1+0.19/C-0.81 h+15.85 > h+15.84 > 1+0.19/C-0.34 h+15.84 > 1-0.10/C-0.34 h+15.84
R213	Shared context L6	I25	13.24	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+5.96 > 2-1.15/G+0.00 h+5.96
R214	L171	I22	11.23	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/H+1.04 h+8.39 > 1-0.34/H+1.04 h+8.39
R215	L172	I22	12.53	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/H-0.26 h+8.39 > 1-0.34/H-0.26 h+8.39
R216	L173	I22	20.09	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+15.84 > 1+0.19/H-0.26 h+15.84 > 1-0.25/H-0.26 h+15.84
R217	L174	I22	27.86	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+23.14 > 1+0.47/H-0.26 h+23.14 > 1-0.15/H-0.26 h+23.14
R218	L175	I23	33.50	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+29.03 > 1+0.47/H-0.26 h+29.03 > 1+0.14/H-0.26 h+29.03 > h+29.09
R219	L176	I23	29.39	1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+23.08 > 1+2.45/I-1.39 h+23.08 > 1+2.45/H-0.26 h+23.08 > h+23.20
R220	L177	I22	14.88	2-1.15/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/I-0.77 h+8.39 > 2-1.15/I-0.77 h+8.39 > 2-1.15/I-0.31 h+8.39
R221	L178	I22	13.08	1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/I-0.77 h+8.39 > 1+2.45/I-0.77 h+8.39 > 1+2.45/I-0.31 h+8.39
R222	L179	I22	20.61	1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+15.84 > 1+0.19/I-0.87 h+15.84 > 1+2.45/I-0.87 h+15.84 > 1+2.45/I-0.43 h+15.84
R223	L180	I22	28.36	1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+23.14 > 1+0.47/I-1.15 h+23.14 > 1+2.45/I-1.15 h+23.14 > 1+2.45/I-0.53 h+23.14

THACH BI CHURCH

RS-06

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R224	L181	I08	4.97	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.04 h+7.65 > h+8.39 > 1-0.15/G+0.04 h+8.39
R225	L224	I22	6.20	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+8.39 > 1+0.09/G+0.34 h+8.39 > 1-0.15/G+0.34 h+8.39
R226	L225	I22	14.00	1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+15.85 > 1+0.19/G+0.71 h+15.85 > 1+0.19/G+0.81 h+15.85 > h+15.84 > 1+0.19/G+0.34 h+15.84 > 1-0.10/G+0.34 h+15.84
R227	Shared context L7	I25	82.54	1+0.24/H+0.34 h+1.50 > 1+2.35/H+0.34 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+5.98 > 2'+0.00/C+0.00 h+5.98 > 9+0.00/C+0.00 h+5.98 > h+7.04 > 9+0.64/C+0.00 h+7.04 > 9+0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 10-0.72/C+0.00 h+6.95 > 10-0.64/C+0.00 h+7.04 > 10+0.00/C+0.00 h+7.04 > h+5.98 > 12+0.00/C+0.00 h+5.98
R228	L196	I09	10.46	7+1.19/C+0.00 h+5.98 > h+7.04 > 7+1.18/D+3.60 h+12.38 > h+12.69
R229	L197	I09	1.37	6-2.12/C+0.00 h+5.98 > h+7.04 > 6-2.12/C+0.06 h+7.08 > h+7.32
R230	L198	I09	1.37	11-0.27/C+0.00 h+5.98 > h+7.04 > 11-0.27/C+0.06 h+7.08 > h+7.32
R231	L199	I09	4.83	6-2.12/C+0.00 h+5.98 > h+7.04 > 6-2.12/C-0.08 h+6.93 > 6-2.12/B-0.37 h+6.19 > h+6.40
R232	L200	I09	4.83	11-0.27/C+0.00 h+5.98 > h+7.04 > 11-0.27/C-0.08 h+6.93 > 11-0.27/B-0.37 h+6.19 > h+6.40
R233	L201	I17	5.61	12+0.00/C+0.00 h+5.98 > 12+0.00/D-1.87 h+5.98 > h+9.00 > 12+0.70/D-1.87 h+9.00
R234	L202	I22	9.18	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+4.20 > 1+0.00/C-0.23 h+4.20 > 1-0.77/C-0.23 h+4.20
R235	L203	I22	13.60	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+4.20 > 1+0.00/A+0.54 h+4.20 > 1-0.77/A+0.54 h+4.20
R236	L204	I22	10.41	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+12.12 > 1+0.09/C-0.30 h+12.12 > 1-0.64/C-0.30 h+12.12
R237	L205	I22	14.83	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+12.12 > 1+0.09/A+0.61 h+12.12 > 1-0.64/A+0.61 h+12.12
R238	L206	I22	18.01	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+15.85 > 1+0.19/C-0.71 h+15.85 > 1+0.19/C-0.81 h+15.85 > h+19.49 > 1+0.19/C-0.37 h+19.49 > 1-0.53/C-0.37 h+19.49
R239	L207	I22	22.43	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+19.49 > 1+0.19/A+0.68 h+19.49 > 1-0.53/A+0.68 h+19.49
R240	L219	I08	10.08	1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/D+3.60 h+7.65 > h+8.50 > 1+2.15/D+3.60 h+8.50
R241	L220	I09	3.75	12-0.42/C+0.00 h+5.98 > h+7.04 > 12-0.42/C-0.08 h+6.93 > 12-0.42/B+0.61 h+6.41 > h+6.55
R242	Shared context L7	I25	67.82	1+0.24/H+0.34 h+1.50 > 1+2.35/H+0.34 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+5.98 > 2'+0.00/G+0.00 h+5.98 > 9+0.00/G+0.00 h+5.98 > h+7.04 > 9+0.64/G+0.00 h+7.04 > 9+0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 10-0.72/G+0.00 h+6.95 > 10-0.64/G+0.00 h+7.04 > 10+0.00/G+0.00 h+7.04 > h+5.98 > 12+0.00/G+0.00 h+5.98
R243	L208	I09	1.37	6-2.12/G+0.00 h+5.98 > h+7.04 > 6-2.12/G-0.06 h+7.08 > h+7.32
R244	L209	I09	1.37	11-0.27/G+0.00 h+5.98 > h+7.04 > 11-0.27/G-0.06 h+7.08 > h+7.32
R245	L210	I09	4.83	6-2.12/G+0.00 h+5.98 > h+7.04 > 6-2.12/G+0.08 h+6.93 > 6-2.12/H+0.37 h+6.19 > h+6.40
R246	L211	I09	4.83	11-0.27/G+0.00 h+5.98 > h+7.04 > 11-0.27/G+0.08 h+6.93 > 11-0.27/H+0.37 h+6.19 > h+6.40
R247	L212	I17	5.61	12+0.00/G+0.00 h+5.98 > 12+0.00/E+1.87 h+5.98 > h+9.00 > 12+0.70/E+1.87 h+9.00
R248	L213	I22	9.18	1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+4.20 > 1+0.00/G+0.23 h+4.20 > 1-0.77/G+0.23 h+4.20
R249	L214	I22	13.60	1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+4.20 > 1+0.00/I-0.54 h+4.20 > 1-0.77/I-0.54 h+4.20
R250	L215	I22	10.41	1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+12.12 > 1+0.09/G+0.30 h+12.12 > 1-0.64/G+0.30 h+12.12
R251	L216	I22	14.83	1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+12.12 > 1+0.09/I-0.61 h+12.12 > 1-0.64/I-0.61 h+12.12
R252	L217	I22	18.01	1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+15.85 > 1+0.19/G+0.71 h+15.85 > 1+0.19/G+0.81 h+15.85 > h+19.49 > 1+0.19/G+0.37 h+19.49 > 1-0.53/G+0.37 h+19.49
R253	L218	I22	22.43	1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+19.49 > 1+0.19/I-0.68 h+19.49 > 1-0.53/I-0.68 h+19.49
R254	L221	I09	3.75	12-0.42/G+0.00 h+5.98 > h+7.04 > 12-0.42/G+0.08 h+6.93 > 12-0.42/H-0.61 h+6.41 > h+6.55
R255	Shared context F1	I25	64.03	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.00 > 12+0.00/C+0.00 h+6.00 > 10+0.00/C+0.00 h+6.00 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.00 > 3-0.94/C+0.00 h+6.00
R256	F226	I03	10.99	3-0.94/C+0.00 h+6.00 > h+7.04 > 2'+2.25/C+0.00 h+7.04 > 2'+2.25/D-0.80 h+9.19 > h+9.03 > h+4.20
R257	F228	I04	12.39	4-0.94/C+0.00 h+6.00 > h+7.04 > 4-1.30/C+0.00 h+7.04 > 4-1.30/D-0.17 h+9.64 > h+8.68 > 4-1.30/D+0.00 h+8.68 > 3+2.25/D+0.00 h+8.68 > h+4.20
R258	F230	I04	12.38	5-0.96/C+0.00 h+6.00 > h+7.04 > 5-1.30/C+0.00 h+7.04 > 5-1.30/D-0.17 h+9.64 > h+8.68 > 5-1.30/D+0.00 h+8.68 > 4+2.25/D+0.00 h+8.68 > h+4.20
R259	F232	I04	12.39	6-0.95/C+0.00 h+6.00 > h+7.04 > 6-1.30/C+0.00 h+7.04 > 6-1.30/D-0.17 h+9.64 > h+8.68 > 6-1.30/D+0.00 h+8.68 > 5+2.25/D+0.00 h+8.68 > h+4.20
R260	F234	I04	12.39	7-0.95/C+0.00 h+6.00 > h+7.04 > 7-1.30/C+0.00 h+7.04 > 7-1.30/D-0.17 h+9.64 > h+8.68 > 7-1.30/D+0.00 h+8.68 > 6+2.25/D+0.00 h+8.68 > h+4.20
R261	F236	I04	12.39	8-0.95/C+0.00 h+6.00 > h+7.04 > 8-1.30/C+0.00 h+7.04 > 8-1.30/D-0.17 h+9.64 > h+8.68 > 8-1.30/D+0.00 h+8.68 > 7+2.25/D+0.00 h+8.68 > h+4.20
R262	F238	I04	12.38	9-0.95/C+0.00 h+6.00 > h+7.04 > 9-1.30/C+0.00 h+7.04 > 9-1.30/D-0.17 h+9.64 > h+8.68 > 9-1.30/D+0.00 h+8.68 > 8+2.25/D+0.00 h+8.68 > h+4.20
R263	Shared context F1	I25	70.63	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.00 > 12+0.00/G+0.00 h+6.00 > 10+0.00/G+0.00 h+6.00 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.00 > 3-0.94/G+0.00 h+6.00
R264	F227	I03	10.99	3-0.94/G+0.00 h+6.00 > h+7.04 > 2'+2.25/G+0.00 h+7.04 > 2'+2.25/E+0.80 h+9.19 > h+9.03 > h+4.20
R265	F229	I04	12.39	4-0.94/G+0.00 h+6.00 > h+7.04 > 4-1.30/G+0.00 h+7.04 > 4-1.30/E+0.17 h+9.64 > h+8.68 > 4-1.30/E+0.00 h+8.68 > 3+2.25/E+0.00 h+8.68 > h+4.20
R266	F231	I04	12.38	5-0.96/G+0.00 h+6.00 > h+7.04 > 5-1.30/G+0.00 h+7.04 > 5-1.30/E+0.17 h+9.64 > h+8.68 > 5-1.30/E+0.00 h+8.68 > 4+2.25/E+0.00 h+8.68 > h+4.20
R267	F233	I04	12.39	6-0.95/G+0.00 h+6.00 > h+7.04 > 6-1.30/G+0.00 h+7.04 > 6-1.30/E+0.17 h+9.64 > h+8.68 > 6-1.30/E+0.00 h+8.68 > 5+2.25/E+0.00 h+8.68 > h+4.20
R268	F235	I04	12.39	7-0.95/G+0.00 h+6.00 > h+7.04 > 7-1.30/G+0.00 h+7.04 > 7-1.30/E+0.17 h+9.64 > h+8.68 > 7-1.30/E+0.00 h+8.68 > 6+2.25/E+0.00 h+8.68 > h+4.20

Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R269	F237	I04	12.39	8-0.95/G+0.00 h+6.00 > h+7.04 > 8-1.30/G+0.00 h+7.04 > 8-1.30/E+0.17 h+9.64 > h+8.68 > 8-1.30/E+0.00 h+8.68 > 7+2.25/E+0.00 h+8.68 > h+4.20
R270	F239	I04	12.38	9-0.95/G+0.00 h+6.00 > h+7.04 > 9-1.30/G+0.00 h+7.04 > 9-1.30/E+0.17 h+9.64 > h+8.68 > 9-1.30/E+0.00 h+8.68 > 8+2.25/E+0.00 h+8.68 > h+4.20
R271	Shared context F5	I25	33.83	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.10 > 12+0.00/C+0.00 h+6.10 > 10+0.00/C+0.00 h+6.10 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+1.07/C+0.00 h+7.24
R272	F240	I11	9.26	9+1.07/C+0.00 h+7.24 > 9+1.07/A+0.00 h+7.24 > h+4.05 > 9+1.07/A+0.19 h+4.05
R273	F241	I11	9.26	10-1.07/C+0.00 h+7.24 > 10-1.07/A+0.00 h+7.24 > h+4.05 > 10-1.07/A+0.19 h+4.05
R274	Shared context F5	I25	40.43	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.10 > 12+0.00/G+0.00 h+6.10 > 10+0.00/G+0.00 h+6.10 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+1.07/G+0.00 h+7.24
R275	F242	I11	9.26	9+1.07/G+0.00 h+7.24 > 9+1.07/I+0.00 h+7.24 > h+4.05 > 9+1.07/I-0.19 h+4.05
R276	F243	I11	9.26	10-1.07/G+0.00 h+7.24 > 10-1.07/I+0.00 h+7.24 > h+4.05 > 10-1.07/I-0.19 h+4.05
R277	Shared context F2	I25	66.96	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.01 > 12+0.00/C+0.00 h+6.01 > 10+0.00/C+0.00 h+6.01 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.01 > 2'+0.62/C+0.00 h+6.01
R278	F244	I10	2.20	4+0.00/C+0.00 h+6.01 > h+4.10 > 4+0.00/C+0.29 h+4.10
R279	F246	I10	2.20	6+0.00/C+0.00 h+6.01 > h+4.10 > 6+0.00/C+0.29 h+4.10
R280	F248	I10	2.20	8+0.00/C+0.00 h+6.01 > h+4.10 > 8+0.00/C+0.29 h+4.10
R281	F-NAVE-B-2P	I10	2.20	2'+0.62/C+0.00 h+6.01 > h+4.10 > 2'+0.62/C+0.29 h+4.10
R282	F-NAVE-B-3	I10	2.20	3+0.00/C+0.00 h+6.01 > h+4.10 > 3+0.00/C+0.29 h+4.10
R283	F-NAVE-B-5	I10	2.20	5+0.00/C+0.00 h+6.01 > h+4.10 > 5+0.00/C+0.29 h+4.10
R284	F-NAVE-B-7	I10	2.20	7+0.00/C+0.00 h+6.01 > h+4.10 > 7+0.00/C+0.29 h+4.10
R285	F-NAVE-B-9	I10	2.20	9+0.00/C+0.00 h+6.01 > h+4.10 > 9+0.00/C+0.29 h+4.10
R286	Shared context F2	I25	73.56	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.01 > 12+0.00/G+0.00 h+6.01 > 10+0.00/G+0.00 h+6.01 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.01 > 2'+0.62/G+0.00 h+6.01
R287	F245	I10	2.20	4+0.00/G+0.00 h+6.01 > h+4.10 > 4+0.00/G-0.29 h+4.10
R288	F247	I10	2.20	6+0.00/G+0.00 h+6.01 > h+4.10 > 6+0.00/G-0.29 h+4.10
R289	F249	I10	2.20	8+0.00/G+0.00 h+6.01 > h+4.10 > 8+0.00/G-0.29 h+4.10
R290	F-NAVE-H-2P	I10	2.20	2'+0.62/G+0.00 h+6.01 > h+4.10 > 2'+0.62/G-0.29 h+4.10
R291	F-NAVE-H-3	I10	2.20	3+0.00/G+0.00 h+6.01 > h+4.10 > 3+0.00/G-0.29 h+4.10
R292	F-NAVE-H-5	I10	2.20	5+0.00/G+0.00 h+6.01 > h+4.10 > 5+0.00/G-0.29 h+4.10
R293	F-NAVE-H-7	I10	2.20	7+0.00/G+0.00 h+6.01 > h+4.10 > 7+0.00/G-0.29 h+4.10
R294	F-NAVE-H-9	I10	2.20	9+0.00/G+0.00 h+6.01 > h+4.10 > 9+0.00/G-0.29 h+4.10
R295	Shared context F4	I25	29.62	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+6.03 > 2'+0.00/C+0.00 h+6.03 > h+6.03
R296	F250	I16	17.22	2'+0.00/C+0.00 h+6.03 > h-0.44 > 2'+0.00/D+0.55 h-0.44 > h+6.00
R297	Shared context F4	I25	14.90	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+6.03 > 2'+0.00/G+0.00 h+6.03 > h+6.03
R298	F251	I16	17.22	2'+0.00/G+0.00 h+6.03 > h-0.44 > 2'+0.00/E-0.55 h-0.44 > h+6.00
R299	Shared context V1	I25	67.55	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.04 > 12+0.00/C+0.00 h+6.04 > 10+0.00/C+0.00 h+6.04 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.04 > 2'+0.01/C+0.00 h+6.04
R300	F252	I05	8.69	2'+0.01/C+0.00 h+6.04 > h+7.04 > 2'-0.15/C+0.00 h+7.04 > 2'-0.15/D+1.20 h+10.64 > h+9.40 > 2'+0.01/D+1.20 h+9.40
R301	F253	I05	11.83	2'+0.01/C+0.00 h+6.04 > h+7.04 > 2'-0.15/C+0.00 h+7.04 > 2'-0.15/D+2.80 h+11.80 > h+9.40 > 2'+0.01/D+2.80 h+9.40
R302	Shared context V1	I25	74.15	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.04 > 12+0.00/G+0.00 h+6.04 > 10+0.00/G+0.00 h+6.04 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.04 > 2'+0.01/G+0.00 h+6.04
R303	F254	I05	11.83	2'+0.01/G+0.00 h+6.04 > h+7.04 > 2'-0.15/G+0.00 h+7.04 > 2'-0.15/E-2.80 h+11.80 > h+9.40 > 2'+0.01/E-2.80 h+9.40
R304	F255	I05	8.69	2'+0.01/G+0.00 h+6.04 > h+7.04 > 2'-0.15/G+0.00 h+7.04 > 2'-0.15/E-1.20 h+10.64 > h+9.40 > 2'+0.01/E-1.20 h+9.40
R305	Shared context V2	I25	31.71	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.15 > 12+0.00/C+0.00 h+6.15 > 10+0.00/C+0.00 h+6.15 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+2.73/C+0.00 h+8.57
R306	F256	I11	6.97	9+2.73/C+0.00 h+8.57 > 9+2.73/A+0.00 h+8.57 > h+7.60 > 9+2.73/A+0.12 h+7.60
R307	F257	I11	6.97	10-2.72/C+0.00 h+8.57 > 10-2.72/A+0.00 h+8.57 > h+7.60 > 10-2.72/A+0.12 h+7.60
R308	Shared context V2	I25	38.31	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.15 > 12+0.00/G+0.00 h+6.15 > 10+0.00/G+0.00 h+6.15 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+2.73/G+0.00 h+8.57
R309	F258	I11	6.97	9+2.73/G+0.00 h+8.57 > 9+2.73/I+0.00 h+8.57 > h+7.60 > 9+2.73/I-0.12 h+7.60
R310	F259	I11	6.97	10-2.72/G+0.00 h+8.57 > 10-2.72/I+0.00 h+8.57 > h+7.60 > 10-2.72/I-0.12 h+7.60

THACH BI CHURCH

RS-08

Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R311	Shared context V3	I25	16.41	11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.16 > 12+0.00/C+0.00 h+6.16
R312	F260	I17	10.32	12+0.00/C+0.00 h+6.16 > 12+0.00/D+3.60 h+6.16 > h+3.30 > 12+0.10/D+3.60 h+3.30
R313	Shared context A1	I25	65.65	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.55 > 12+0.00/C+0.00 h+5.55 > 10+0.00/C+0.00 h+5.55 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.55 > 4-0.43/C+0.00 h+5.55
R314	S261	I10	3.16	4-0.43/C+0.00 h+5.55 > h+2.50 > 4-0.43/C+0.11 h+2.50
R315	S263	I10	3.16	5-0.43/C+0.00 h+5.55 > h+2.50 > 5-0.43/C+0.11 h+2.50
R316	S265	I10	3.16	6-0.43/C+0.00 h+5.55 > h+2.50 > 6-0.43/C+0.11 h+2.50
R317	S267	I10	3.16	7-0.43/C+0.00 h+5.55 > h+2.50 > 7-0.43/C+0.11 h+2.50
R318	S269	I10	3.16	8-0.43/C+0.00 h+5.55 > h+2.50 > 8-0.43/C+0.11 h+2.50
R319	S271	I10	3.16	9-0.43/C+0.00 h+5.55 > h+2.50 > 9-0.43/C+0.11 h+2.50
R320	S276	I11	8.04	10-0.45/C+0.00 h+7.04 > 10-0.45/C-0.08 h+6.93 > 10-0.45/C-0.95 h+6.74 > 10-0.45/C-1.03 h+6.74 > 10-0.45/A+0.00 h+6.74 > h+4.85 > 10-0.45/A+0.19 h+4.85
R321	Shared context A1	I25	59.05	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.55 > 12+0.00/G+0.00 h+5.55 > 10+0.00/G+0.00 h+5.55 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.55 > 4-0.43/G+0.00 h+5.55
R322	S262	I10	3.16	4-0.43/G+0.00 h+5.55 > h+2.50 > 4-0.43/G-0.11 h+2.50
R323	S264	I10	3.16	5-0.43/G+0.00 h+5.55 > h+2.50 > 5-0.43/G-0.11 h+2.50
R324	S266	I10	3.16	6-0.43/G+0.00 h+5.55 > h+2.50 > 6-0.43/G-0.11 h+2.50
R325	S268	I10	3.16	7-0.43/G+0.00 h+5.55 > h+2.50 > 7-0.43/G-0.11 h+2.50
R326	S270	I10	3.16	8-0.43/G+0.00 h+5.55 > h+2.50 > 8-0.43/G-0.11 h+2.50
R327	S272	I10	3.16	9-0.43/G+0.00 h+5.55 > h+2.50 > 9-0.43/G-0.11 h+2.50
R328	S278	I11	8.04	10-0.45/G+0.00 h+7.04 > 10-0.45/G+0.08 h+6.93 > 10-0.45/G+0.95 h+6.74 > 10-0.45/G+1.03 h+6.74 > 10-0.45/I+0.00 h+6.74 > h+4.85 > 10-0.45/I-0.19 h+4.85
R329	Shared context A5	I25	74.25	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.52 > 12+0.00/C+0.00 h+5.52 > 10+0.00/C+0.00 h+5.52 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.52 > 2'+0.01/C+0.00 h+5.52
R330	S273	I16	13.21	2'+0.01/C+0.00 h+5.52 > h-0.44 > 2'+0.00/D+0.55 h-0.44 > h+2.50
R331	Shared context A5	I25	67.65	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.52 > 12+0.00/G+0.00 h+5.52 > 10+0.00/G+0.00 h+5.52 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.52 > 2'+0.01/G+0.00 h+5.52
R332	S274	I16	13.21	2'+0.01/G+0.00 h+5.52 > h-0.44 > 2'+0.00/E-0.55 h-0.44 > h+2.50
R333	Shared context A2	I25	70.16	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.54 > 12+0.00/C+0.00 h+5.54 > 10+0.00/C+0.00 h+5.54 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.54 > 3-0.43/C+0.00 h+5.54
R334	S279	I10	2.95	4-0.43/C+0.00 h+5.54 > h+2.70 > 4-0.43/C-0.11 h+2.70
R335	S280	I10	2.95	7-0.43/C+0.00 h+5.54 > h+2.70 > 7-0.43/C-0.11 h+2.70
R336	S-PORCH-B-2P-3	I10	2.95	3-0.43/C+0.00 h+5.54 > h+2.70 > 3-0.43/C-0.11 h+2.70
R337	S-PORCH-B-4-5	I10	2.95	5-0.43/C+0.00 h+5.54 > h+2.70 > 5-0.43/C-0.11 h+2.70
R338	S-PORCH-B-5-6	I10	2.95	6-0.43/C+0.00 h+5.54 > h+2.70 > 6-0.43/C-0.11 h+2.70
R339	S-PORCH-B-7-8	I10	2.95	8-0.43/C+0.00 h+5.54 > h+2.70 > 8-0.43/C-0.11 h+2.70
R340	S-PORCH-B-8-9	I10	2.95	9-0.43/C+0.00 h+5.54 > h+2.70 > 9-0.43/C-0.11 h+2.70
R341	S-PORCH-B-10-11	I10	2.95	11-0.43/C+0.00 h+5.54 > h+2.70 > 11-0.43/C-0.11 h+2.70
R342	S-PORCH-B-11-12	I10	2.95	12-0.43/C+0.00 h+5.54 > h+2.70 > 12-0.43/C-0.11 h+2.70
R343	Shared context A2	I25	63.56	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.54 > 12+0.00/G+0.00 h+5.54 > 10+0.00/G+0.00 h+5.54 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.54 > 3-0.43/G+0.00 h+5.54
R344	S281	I10	2.95	4-0.43/G+0.00 h+5.54 > h+2.70 > 4-0.43/G+0.11 h+2.70
R345	S282	I10	2.95	7-0.43/G+0.00 h+5.54 > h+2.70 > 7-0.43/G+0.11 h+2.70
R346	S-PORCH-H-2P-3	I10	2.95	3-0.43/G+0.00 h+5.54 > h+2.70 > 3-0.43/G+0.11 h+2.70
R347	S-PORCH-H-4-5	I10	2.95	5-0.43/G+0.00 h+5.54 > h+2.70 > 5-0.43/G+0.11 h+2.70
R348	S-PORCH-H-5-6	I10	2.95	6-0.43/G+0.00 h+5.54 > h+2.70 > 6-0.43/G+0.11 h+2.70
R349	S-PORCH-H-7-8	I10	2.95	8-0.43/G+0.00 h+5.54 > h+2.70 > 8-0.43/G+0.11 h+2.70
R350	S-PORCH-H-8-9	I10	2.95	9-0.43/G+0.00 h+5.54 > h+2.70 > 9-0.43/G+0.11 h+2.70
R351	S-PORCH-H-10-11	I10	2.95	11-0.43/G+0.00 h+5.54 > h+2.70 > 11-0.43/G+0.11 h+2.70
R352	S-PORCH-H-11-12	I10	2.95	12-0.43/G+0.00 h+5.54 > h+2.70 > 12-0.43/G+0.11 h+2.70
R353	Shared context A3	I25	77.36	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.53 > 12+0.00/C+0.00 h+5.53 > 10+0.00/C+0.00 h+5.53 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.53 > 2'+0.00/C+0.00 h+5.53 > 1+2.35/C+0.00 h+5.53

Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R354	S283	I22	7.00	1+2.35/C+0.00 h+5.53 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+6.20 > 1+0.00/C-0.94 h+6.20 > 1-0.14/C-0.94 h+6.20
R355	S284	I22	11.52	1+2.35/C+0.00 h+5.53 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+6.20 > 1+0.00/A+1.35 h+6.20 > 1-0.14/A+1.35 h+6.20
R356	S285	I11	5.69	5+0.00/C+0.00 h+5.53 > h+7.04 > 5+0.00/C-0.08 h+6.93 > 5+0.00/B+0.00 h+6.27 > h+5.60 > 5+0.00/B-0.34 h+5.60
R357	S286	I11	5.69	8+0.00/C+0.00 h+5.53 > h+7.04 > 8+0.00/C-0.08 h+6.93 > 8+0.00/B+0.00 h+6.27 > h+5.60 > 8+0.00/B-0.34 h+5.60
R358	Shared context A3	I25	70.76	11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.53 > 12+0.00/G+0.00 h+5.53 > 10+0.00/G+0.00 h+5.53 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.53 > 2'+0.00/G+0.00 h+5.53 > 1+2.35/G+0.00 h+5.53
R359	S287	I22	7.00	1+2.35/G+0.00 h+5.53 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+6.20 > 1+0.00/G+0.94 h+6.20 > 1-0.14/G+0.94 h+6.20
R360	S288	I22	11.52	1+2.35/G+0.00 h+5.53 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+6.20 > 1+0.00/I-1.35 h+6.20 > 1-0.14/I-1.35 h+6.20
R361	S289	I11	5.69	5+0.00/G+0.00 h+5.53 > h+7.04 > 5+0.00/G+0.08 h+6.93 > 5+0.00/H+0.00 h+6.27 > h+5.60 > 5+0.00/H+0.34 h+5.60
R362	S290	I11	5.69	8+0.00/G+0.00 h+5.53 > h+7.04 > 8+0.00/G+0.08 h+6.93 > 8+0.00/H+0.00 h+6.27 > h+5.60 > 8+0.00/H+0.34 h+5.60
R363	Shared context MIC	I20	11.91	11+0.60/E-2.20 h+0.95 > h+0.03 > 11+0.60/D+2.20 h+0.03 > 10-3.09/D+2.20 h+0.03
R364	S291	I18	3.63	10-3.09/D+2.20 h+0.03 > 10-3.09/D+0.98 h+0.03 > 10-2.88/D+0.98 h+0.03 > h+1.86 > 10-3.09/D+0.98 h+1.82 > h+1.95
R365	Shared context MIC	I20	5.74	11+0.60/E-2.20 h+0.95 > h+0.03 > 10+0.28/E-2.20 h+0.03
R366	S292	I19	2.85	10+0.28/E-2.20 h+0.03 > 10+0.28/E-3.15 h+0.03 > h+1.93
R367	Shared context P1	I25	48.38	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.11 > 12+0.00/C+0.00 h+6.11 > 10+0.00/C+0.00 h+6.11 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.11 > 6-0.65/C+0.00 h+6.11
R368	P-SANCT-B	I10	5.65	10+0.00/C+0.00 h+6.11 > h+0.85 > 10-0.28/C+0.00 h+0.85 > 10-0.28/C+0.11 h+0.85
R369	P-NAVE-B	I10	5.77	6-0.65/C+0.00 h+6.11 > h+0.45 > 6-0.65/C+0.11 h+0.45
R370	Shared context P3	I12	20.28	1+0.24/H+0.34 h+1.50 > h-0.12 > 1+0.24/C-0.34 h-0.12 > 1+0.45/C-0.34 h-0.12
R371	P-TOWER-B	I07	1.57	1+0.45/C-0.34 h-0.12 > h+1.30 > 1+0.45/C-0.49 h+1.30
R372	Shared context P2	I25	54.97	11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.12 > 12+0.00/G+0.00 h+6.12 > 10+0.00/G+0.00 h+6.12 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.12 > 6-0.65/G+0.00 h+6.12
R373	P-SANCT-H	I10	5.66	10+0.00/G+0.00 h+6.12 > h+0.85 > 10-0.28/G+0.00 h+0.85 > 10-0.28/G-0.11 h+0.85
R374	P-NAVE-H	I10	5.78	6-0.65/G+0.00 h+6.12 > h+0.45 > 6-0.65/G-0.11 h+0.45
R375	Shared context P4	I12	4.88	1+0.24/H+0.34 h+1.50 > h-0.12 > 1+0.24/G+0.34 h-0.12 > 1+0.45/G+0.34 h-0.12
R376	P-TOWER-H	I07	1.57	1+0.45/G+0.34 h-0.12 > h+1.30 > 1+0.45/G+0.49 h+1.30
R377	Shared context L10	I25	28.08	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+6.14 > 2-0.85/C+0.00 h+6.14
R378	L-STATUE-C-ARCH	I08	23.12	2-0.95/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D+3.60 h+7.65 > h+19.61 > 2-0.95/D+3.60 h+19.61
R379	L-STATUE-C-JAMB-1	I08	20.61	2-0.95/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D+2.91 h+7.65 > h+17.79 > 2-0.95/D+2.91 h+17.79
R380	L-STATUE-C-CANDLE-1	I08	19.50	2-1.18/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D+3.30 h+7.65 > h+16.68 > 2-1.18/D+3.30 h+16.68
R381	L-STATUE-B-ARCH	I08	11.25	2-0.85/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D-1.75 h+7.65 > h+12.92 > 2-0.85/D-1.75 h+12.92
R382	L-STATUE-B-JAMB-1	I08	9.10	2-0.85/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C+1.43 h+7.65 > h+11.35 > 2-0.85/C+1.43 h+11.35
R383	L-STATUE-B-CANDLE-1	I08	8.26	2-0.94/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C+1.70 h+7.65 > h+10.39 > 2-0.94/C+1.70 h+10.39
R384	L-STATUE-B-JAMB-2	I08	10.26	2-0.85/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D-1.17 h+7.65 > h+11.35 > 2-0.85/D-1.17 h+11.35
R385	L-STATUE-B-CANDLE-2	I08	8.88	2-0.94/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D-1.44 h+7.65 > h+10.39 > 2-0.94/D-1.44 h+10.39
R386	Shared context L10	I25	13.36	1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+6.14 > 2-0.85/G+0.00 h+6.14
R387	L-STATUE-C-JAMB-2	I08	20.61	2-0.95/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E-2.91 h+7.65 > h+17.79 > 2-0.95/E-2.91 h+17.79
R388	L-STATUE-C-CANDLE-2	I08	19.50	2-1.18/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E-3.30 h+7.65 > h+16.68 > 2-1.18/E-3.30 h+16.68
R389	L-STATUE-H-ARCH	I08	11.25	2-0.85/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E+1.75 h+7.65 > h+12.92 > 2-0.85/E+1.75 h+12.92
R390	L-STATUE-H-JAMB-1	I08	10.26	2-0.85/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E+1.17 h+7.65 > h+11.35 > 2-0.85/E+1.17 h+11.35
R391	L-STATUE-H-CANDLE-1	I08	8.88	2-0.94/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E+1.44 h+7.65 > h+10.39 > 2-0.94/E+1.44 h+10.39
R392	L-STATUE-H-JAMB-2	I08	9.10	2-0.85/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G-1.43 h+7.65 > h+11.35 > 2-0.85/G-1.43 h+11.35
R393	L-STATUE-H-CANDLE-2	I08	8.26	2-0.94/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G-1.70 h+7.65 > h+10.39 > 2-0.94/G-1.70 h+10.39
R394	Shared context LS	I25	71.24	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.16 > 12+0.00/G+0.00 h+6.16 > 10+0.00/G+0.00 h+6.16 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.16 > 2'+1.93/G+0.00 h+6.16
R395	L-STATION-1-A	I10	1.57	8+1.93/G+0.00 h+6.16 > h+4.72 > 8+1.93/G-0.13 h+4.72
R396	L-STATION-1-B	I10	1.57	9-1.93/G+0.00 h+6.16 > h+4.72 > 9-1.93/G-0.13 h+4.72
R397	L-STATION-2-A	I10	1.57	7+1.93/G+0.00 h+6.16 > h+4.72 > 7+1.93/G-0.13 h+4.72
R398	L-STATION-2-B	I10	1.57	8-1.93/G+0.00 h+6.16 > h+4.72 > 8-1.93/G-0.13 h+4.72

Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R399	L-STATION-3-A	I10	1.57	6+1.93/G+0.00 h+6.16 > h+4.72 > 6+1.93/G-0.13 h+4.72
R400	L-STATION-3-B	I10	1.57	7-1.93/G+0.00 h+6.16 > h+4.72 > 7-1.93/G-0.13 h+4.72
R401	L-STATION-4-A	I10	1.57	5+1.93/G+0.00 h+6.16 > h+4.72 > 5+1.93/G-0.13 h+4.72
R402	L-STATION-4-B	I10	1.57	6-1.93/G+0.00 h+6.16 > h+4.72 > 6-1.93/G-0.13 h+4.72
R403	L-STATION-5-A	I10	1.57	4+1.93/G+0.00 h+6.16 > h+4.72 > 4+1.93/G-0.13 h+4.72
R404	L-STATION-5-B	I10	1.57	5-1.93/G+0.00 h+6.16 > h+4.72 > 5-1.93/G-0.13 h+4.72
R405	L-STATION-6-A	I10	1.57	3+1.93/G+0.00 h+6.16 > h+4.72 > 3+1.93/G-0.13 h+4.72
R406	L-STATION-6-B	I10	1.57	4-1.93/G+0.00 h+6.16 > h+4.72 > 4-1.93/G-0.13 h+4.72
R407	L-STATION-7-A	I10	1.57	2'+1.93/G+0.00 h+6.16 > h+4.72 > 2'+1.93/G-0.13 h+4.72
R408	L-STATION-7-B	I10	1.57	3-1.93/G+0.00 h+6.16 > h+4.72 > 3-1.93/G-0.13 h+4.72
R409	Shared context LS	I25	64.64	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.16 > 12+0.00/C+0.00 h+6.16 > 10+0.00/C+0.00 h+6.16 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.16 > 2'+1.93/C+0.00 h+6.16
R410	L-STATION-8-A	I10	1.57	2'+1.93/C+0.00 h+6.16 > h+4.72 > 2'+1.93/C+0.13 h+4.72
R411	L-STATION-8-B	I10	1.57	3-1.93/C+0.00 h+6.16 > h+4.72 > 3-1.93/C+0.13 h+4.72
R412	L-STATION-9-A	I10	1.57	3+1.93/C+0.00 h+6.16 > h+4.72 > 3+1.93/C+0.13 h+4.72
R413	L-STATION-9-B	I10	1.57	4-1.93/C+0.00 h+6.16 > h+4.72 > 4-1.93/C+0.13 h+4.72
R414	L-STATION-10-A	I10	1.57	4+1.93/C+0.00 h+6.16 > h+4.72 > 4+1.93/C+0.13 h+4.72
R415	L-STATION-10-B	I10	1.57	5-1.93/C+0.00 h+6.16 > h+4.72 > 5-1.93/C+0.13 h+4.72
R416	L-STATION-11-A	I10	1.57	5+1.93/C+0.00 h+6.16 > h+4.72 > 5+1.93/C+0.13 h+4.72
R417	L-STATION-11-B	I10	1.57	6-1.93/C+0.00 h+6.16 > h+4.72 > 6-1.93/C+0.13 h+4.72
R418	L-STATION-12-A	I10	1.57	6+1.93/C+0.00 h+6.16 > h+4.72 > 6+1.93/C+0.13 h+4.72
R419	L-STATION-12-B	I10	1.57	7-1.93/C+0.00 h+6.16 > h+4.72 > 7-1.93/C+0.13 h+4.72
R420	L-STATION-13-A	I10	1.57	7+1.93/C+0.00 h+6.16 > h+4.72 > 7+1.93/C+0.13 h+4.72
R421	L-STATION-13-B	I10	1.57	8-1.93/C+0.00 h+6.16 > h+4.72 > 8-1.93/C+0.13 h+4.72
R422	L-STATION-14-A	I10	1.57	8+1.93/C+0.00 h+6.16 > h+4.72 > 8+1.93/C+0.13 h+4.72
R423	L-STATION-14-B	I10	1.57	9-1.93/C+0.00 h+6.16 > h+4.72 > 9-1.93/C+0.13 h+4.72
R424	Shared context L8	I25	31.84	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.96 > 12+0.00/C+0.00 h+5.96 > 10+0.00/C+0.00 h+5.96 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+1.96/C+0.00 h+7.95
R425	L-WING-B-FI	I03	1.76	9+1.96/C+0.00 h+7.95 > 9+1.96/C-1.44 h+7.95 > h+7.66 > h+7.64
R426	L-WING-B-FO	I03	4.36	9+1.96/C+0.00 h+7.95 > 9+1.96/B-0.99 h+7.95 > h+7.66 > h+7.64
R427	L-WING-B-RI	I03	1.76	10-1.96/C+0.00 h+7.95 > 10-1.96/C-1.44 h+7.95 > h+7.66 > h+7.64
R428	L-WING-B-RO	I03	4.36	10-1.96/C+0.00 h+7.95 > 10-1.96/B-0.99 h+7.95 > h+7.66 > h+7.64
R429	Shared context L8	I25	38.44	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.96 > 12+0.00/G+0.00 h+5.96 > 10+0.00/G+0.00 h+5.96 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+1.96/G+0.00 h+7.95
R430	L-WING-H-FI	I03	1.76	9+1.96/G+0.00 h+7.95 > 9+1.96/G+1.44 h+7.95 > h+7.66 > h+7.64
R431	L-WING-H-FO	I03	4.36	9+1.96/G+0.00 h+7.95 > 9+1.96/H+0.99 h+7.95 > h+7.66 > h+7.64
R432	L-WING-H-RI	I03	1.76	10-1.96/G+0.00 h+7.95 > 10-1.96/G+1.44 h+7.95 > h+7.66 > h+7.64
R433	L-WING-H-RO	I03	4.36	10-1.96/G+0.00 h+7.95 > 10-1.96/H+0.99 h+7.95 > h+7.66 > h+7.64
R434	Shared context LD	I25	62.30	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.94 > 12+0.00/C+0.00 h+5.94 > 10+0.00/C+0.00 h+5.94 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.94 > 3+0.00/C+0.00 h+5.94
R435	L-COLUMN-3-B	I15	16.39	3+0.00/C+0.00 h+5.94 > h-0.44 > 3+0.00/D+0.31 h-0.44 > h+5.50
R436	L-COLUMN-4-B	I15	16.39	4+0.00/C+0.00 h+5.94 > h-0.44 > 4+0.00/D+0.31 h-0.44 > h+5.50
R437	L-COLUMN-5-B	I15	16.39	5+0.00/C+0.00 h+5.94 > h-0.44 > 5+0.00/D+0.31 h-0.44 > h+5.50
R438	L-COLUMN-6-B	I15	16.39	6+0.00/C+0.00 h+5.94 > h-0.44 > 6+0.00/D+0.31 h-0.44 > h+5.50
R439	L-COLUMN-7-B	I15	16.39	7+0.00/C+0.00 h+5.94 > h-0.44 > 7+0.00/D+0.31 h-0.44 > h+5.50
R440	L-COLUMN-8-B	I15	16.39	8+0.00/C+0.00 h+5.94 > h-0.44 > 8+0.00/D+0.31 h-0.44 > h+5.50
R441	L-COLUMN-9-B	I15	16.39	9+0.00/C+0.00 h+5.94 > h-0.44 > 9+0.00/D+0.31 h-0.44 > h+5.50
R442	Shared context LD	I25	68.90	11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.94 > 12+0.00/G+0.00 h+5.94 > 10+0.00/G+0.00 h+5.94 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.94 > 3+0.00/G+0.00 h+5.94

Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

Ref	Equipment / context	Note	Drawn m	Vertex set-out from the source end
R443	L-COLUMN-3-H	I15	16.39	3+0.00/G+0.00 h+5.94 > h-0.44 > 3+0.00/E-0.31 h-0.44 > h+5.50
R444	L-COLUMN-4-H	I15	16.39	4+0.00/G+0.00 h+5.94 > h-0.44 > 4+0.00/E-0.31 h-0.44 > h+5.50
R445	L-COLUMN-5-H	I15	16.39	5+0.00/G+0.00 h+5.94 > h-0.44 > 5+0.00/E-0.31 h-0.44 > h+5.50
R446	L-COLUMN-6-H	I15	16.39	6+0.00/G+0.00 h+5.94 > h-0.44 > 6+0.00/E-0.31 h-0.44 > h+5.50
R447	L-COLUMN-7-H	I15	16.39	7+0.00/G+0.00 h+5.94 > h-0.44 > 7+0.00/E-0.31 h-0.44 > h+5.50
R448	L-COLUMN-8-H	I15	16.39	8+0.00/G+0.00 h+5.94 > h-0.44 > 8+0.00/E-0.31 h-0.44 > h+5.50
R449	L-COLUMN-9-H	I15	16.39	9+0.00/G+0.00 h+5.94 > h-0.44 > 9+0.00/E-0.31 h-0.44 > h+5.50

3D installation planning sequence

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

01 / Survey and coordinate

3D layer: all / building

Check grid, floor datum, equipment positions and all concealed routes against the measured building. Use the circuit sheets to record corrections.

HOLD / responsible specialist release required

Survey and coordinated light, sound, air, access and concealment review must precede physical setting-out. This default layout still has unmet targets.

02 / Boards and feeder paths

3D layer: distribution / systems

Review DB-1 to DB-2, LC-1, FC-1 and AV-1 paths. Confirm enclosure access and the proposed supply/control separation.

HOLD / responsible specialist release required

Electrical designer: supply, phases, earthing, fault level, protection, cable sizes, board capacity and final single-line diagram are pending. Do not energize from this model.

03 / Coordinate concealed containment

3D layer: all / systems

Review all shared corridors and individual branches together. Select each run for its vertices and height; compare with structure and finished surfaces before closing any cover.

HOLD / responsible specialist release required

Containment size, power/signal separation, fixings, fire stopping, access panels and penetrations require coordinated approval. Coloured routes are enlarged display lines, not cable diameters.

3D installation planning sequence

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

04 / Lighting routes and fittings

3D layer: lighting / systems

Review each light circuit and its LC-1 or DB-2 supply. Check chandelier support, aim, driver access, fan-blade interaction and labels against the matching paper sheet.

HOLD / responsible specialist release required

Selected-product photometry, support design, control channels, dimming compatibility and installation details remain pending. Review current per-seat lighting failures in the matching calculation report.

05 / Sound and microphone connections

3D layer: sound / systems

Trace speaker and microphone lines to AV-1 separately from rack mains. Review polarity, intended zones, furniture/floor interfaces and service access.

HOLD / responsible specialist release required

Amplifier topology, impedance/line voltage, connectors, shielding and separation are pending. Passive speaker ratings are not mains loads; feedback and wing clarity targets remain unmet.

06 / Fans and ventilation

3D layer: air / systems

Review FC-1 and DB-2 routes, motor control compatibility and air paths with the lighting and sound systems. Keep the central processional view clear of visible fans and supports.

HOLD / responsible specialist release required

Current geometry is a study, not an accepted fan installation. Mounting, guards/clearance, duty points, make-up air, noise, concealment and maintenance access need specialist approval.

3D installation planning sequence

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

07 / Exit signs and required safety functions

3D layer: exit / systems

Identify E1 separately from discretionary light scenes. Coordinate the required emergency system, operating labels and test access with the responsible designer.

HOLD / responsible specialist release required

Emergency supply, duration, coverage and failure behavior are not established by the simulator. No scene or walkthrough step authorizes isolation of required safety functions.

08 / Powered decoration and interfaces

3D layer: decoration / systems

Review decorative loads and concealed feeds, heat dissipation, isolation and replacement access without obstructing worship or other systems.

HOLD / responsible specialist release required

Final products, loads, supports, material/fire compatibility and control interfaces need approval. Empty stages may occur in edited layouts.

09 / Inspect, test and hand over

3D layer: all / building

After approved installation, the responsible team must record electrical verification, manual/scene and failure tests, light/sound/air measurements, as-built IDs and maintenance instructions.

HOLD / responsible specialist release required

No commissioning or construction approval is recorded here. Progress through these review steps does not release a hold or mark any work installed.