

Electrical routes / printable review set

Default model export - circuit plans, heights, equipment coordinates and route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Read the plan, then trace the same ID in 3D

296 connected installed-study equipment / 343 unique routes / 23 drawing scopes. Hidden alternatives and non-electrical furniture are excluded. Shared feeders and trunks repeat as context on circuit sheets; quantities are owned once in the route index.

Print and measure

Use A3 landscape at 100%, with no fit-to-page. The line below must measure 100 mm. Plans and height projections have separate stated scales. Never scale from a resized copy.

Coordinate basis

X: axis 1 toward sanctuary. Y: height above nave finished floor. Z: centre between D/E; negative toward B, positive toward H. Grid is a model transcription, not a measured floor plan or installation set-out.

Route reading

Solid: power/feed. Dashed: loudspeaker audio. Dotted: microphone. Circle: equipment. Square: enclosure. Projection crossings are not junctions. Overlapping vertical paths require the route-vertex CSV and 3D review.

Length basis

Route length = sum of 3D segment lengths. No spare, termination or installation allowances. Audio home run = branch plus its own upstream path; do not add shared bundle lengths again. This is not a conductor/cable take-off.

Stop before physical work

Cable sizes, protection, supply/earthing/fault level, product data, supports, containment and fire stopping, control channels, life-safety functions and commissioning approval are pending. Do not drill timber or close concealed works from these sheets.

Sheet index / circuit lookup

- E-001 Distribution and feeders
- E-002 L3 / Sanctuary
- E-003 L1 / Central seating
- E-004 L2 / Outer seating
- E-005 L8 / Wings / choir & ministers
- E-006 LA / Roof uplight
- E-007 LD / Chandeliers & sconces
- E-008 L4 / Circulation & verandas
- E-009 L9 / Front stage & central door
- E-010 L5 / Steps & paths
- E-011 E1 / Exit signs
- E-012 L6 / Facade & towers
- E-013 L7 / Festival exterior (strings & tower floods)
- E-014 F1 / Ceiling fans
- E-015 F5 / Wing wall fans / held review
- E-016 F2 / Wall fans
- E-017 F4 / Entrance circulators (trial)
- E-018 V1 / Exhaust ventilation
- E-019 A1 / Main & delay loudspeakers
- E-020 A5 / Rear fill (crowded feasts)
- E-021 A2 / Veranda fill
- E-022 A3 / Courtyard
- E-023 Microphones

After circuit sheets: equipment naming schedule, unique route index and the same nine-stage 3D coordination sequence. PDF bookmarks jump to each sheet.

Engineering baseline: feedback and wing speech clarity remain below targets; some seats miss the lighting brief. Fan performance, concealment, emergency design and installation access remain unverified. See docs/engineering/baseline.md and issues.md.

Companion files: drawing-index.json, model-snapshot.json, route-vertices.csv, equipment-coordinates.csv and manifest.json. Hashes bind this print set to its source files. Saved browser layouts are a different configuration.



100 mm print calibration

Distribution and feeders

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION




COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Branch
Related enclosures				
DB1	48.895	1.750	-1.550	
DB2	2.730	1.500	-3.300	
LC1	48.895	1.850	-0.550	
FC1	48.895	1.950	0.400	
AV1	49.275	0.950	1.400	

0 equipment / 4 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

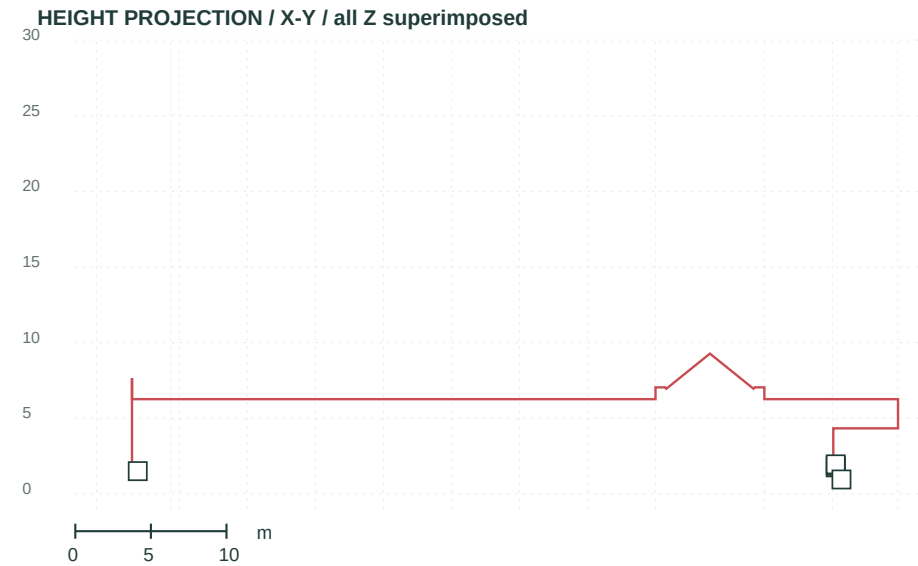


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L3 / Sanctuary

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres


DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

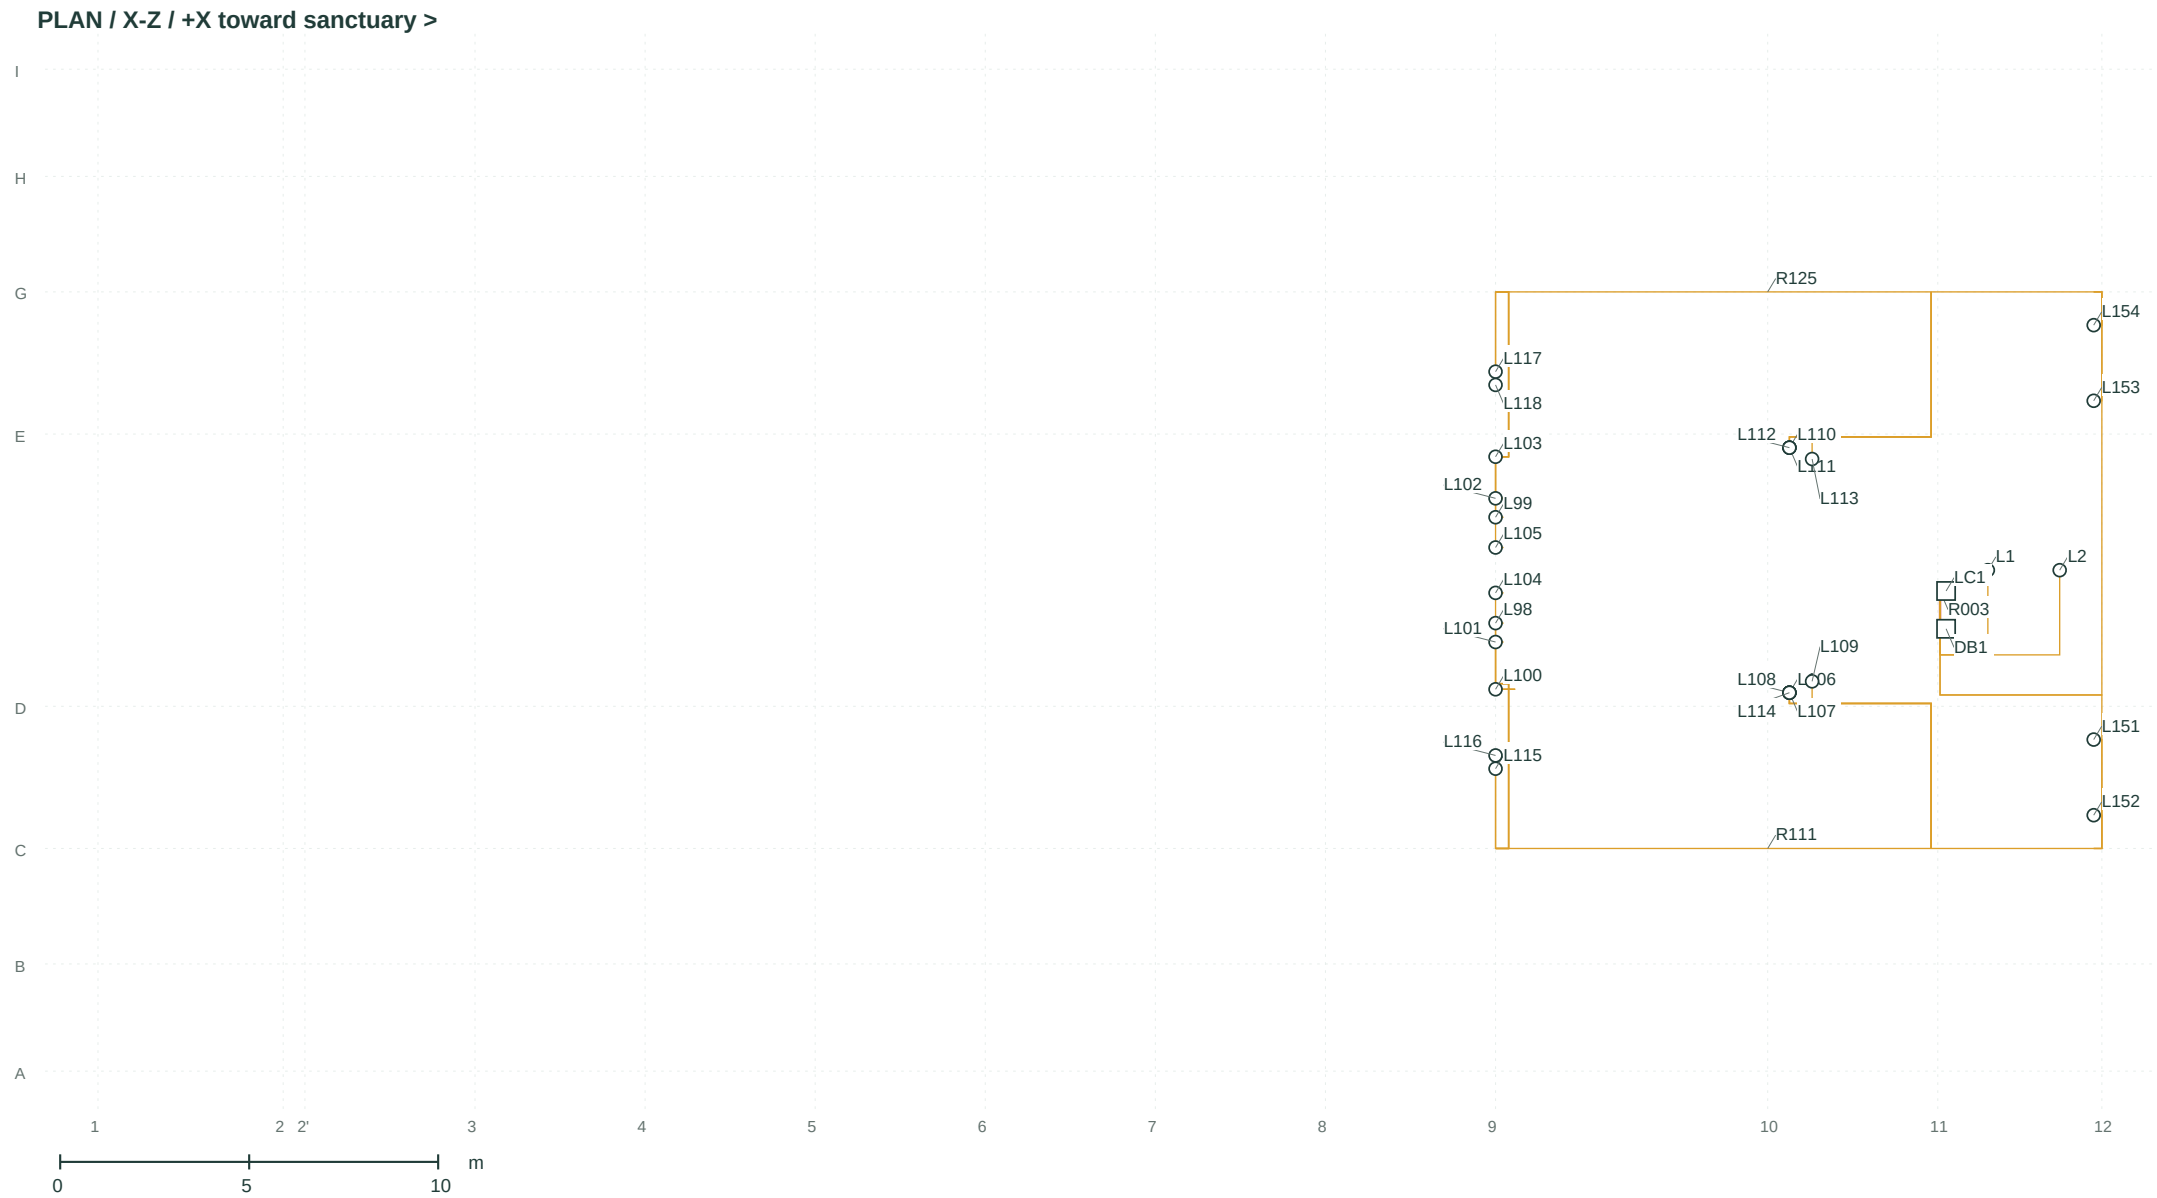

COORDINATES / X, Y, Z (m)				
ID	X	Y	Z	Branch
L1	50.000	4.140	0.000	R005
L2	51.900	4.140	0.000	R006
L98	36.975	8.585	-1.400	R112
L99	36.975	8.585	1.400	R126
L100	36.975	8.585	-3.150	R113
L101	36.975	8.585	-1.900	R114
L102	36.975	8.585	1.900	R127
L103	36.975	8.585	3.000	R128
L104	36.975	8.585	-0.600	R115
L105	36.975	8.585	0.600	R129
L106	44.750	7.600	-3.240	R116
L107	44.750	6.700	-3.240	R117
L108	44.750	5.400	-3.240	R118
L109	45.350	8.420	-2.940	R119
L110	44.750	7.600	3.240	R130
L111	44.750	6.700	3.240	R131
L112	44.750	5.400	3.240	R132
L113	45.350	8.420	2.940	R133
L114	44.750	4.900	-3.240	R120
L115	36.975	6.655	-5.250	R121
L116	36.975	6.655	-4.900	R122
L117	36.975	6.655	5.250	R134
L118	36.975	6.655	4.900	R135
L151	52.800	2.300	-4.480	R123
L152	52.800	2.300	-6.480	R124
L153	52.800	2.300	4.480	R136
L154	52.800	2.300	6.480	R137

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

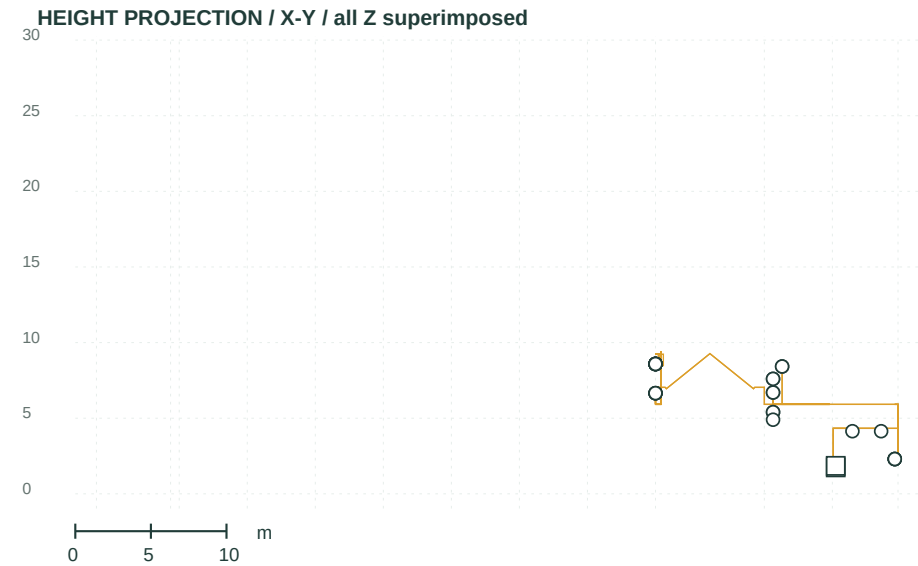

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.



Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

L1 / Central seating

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

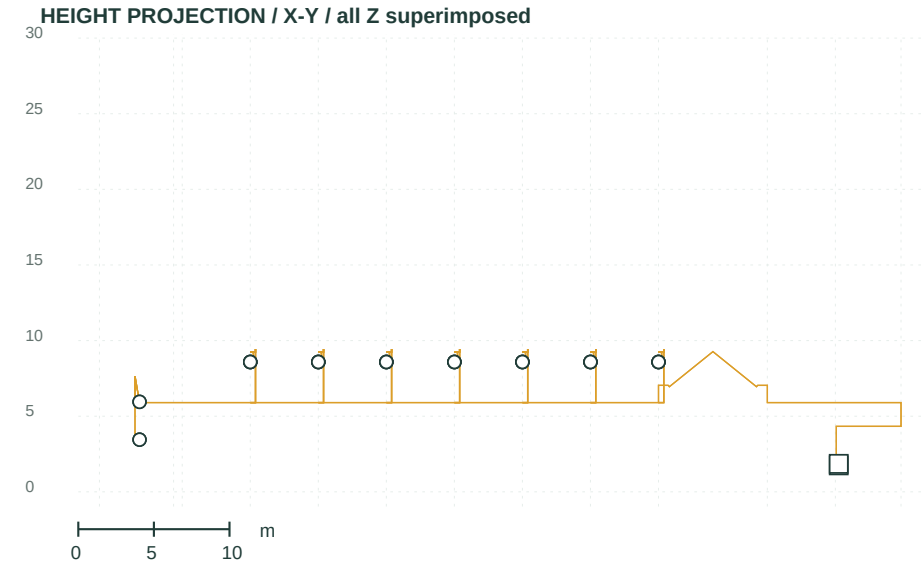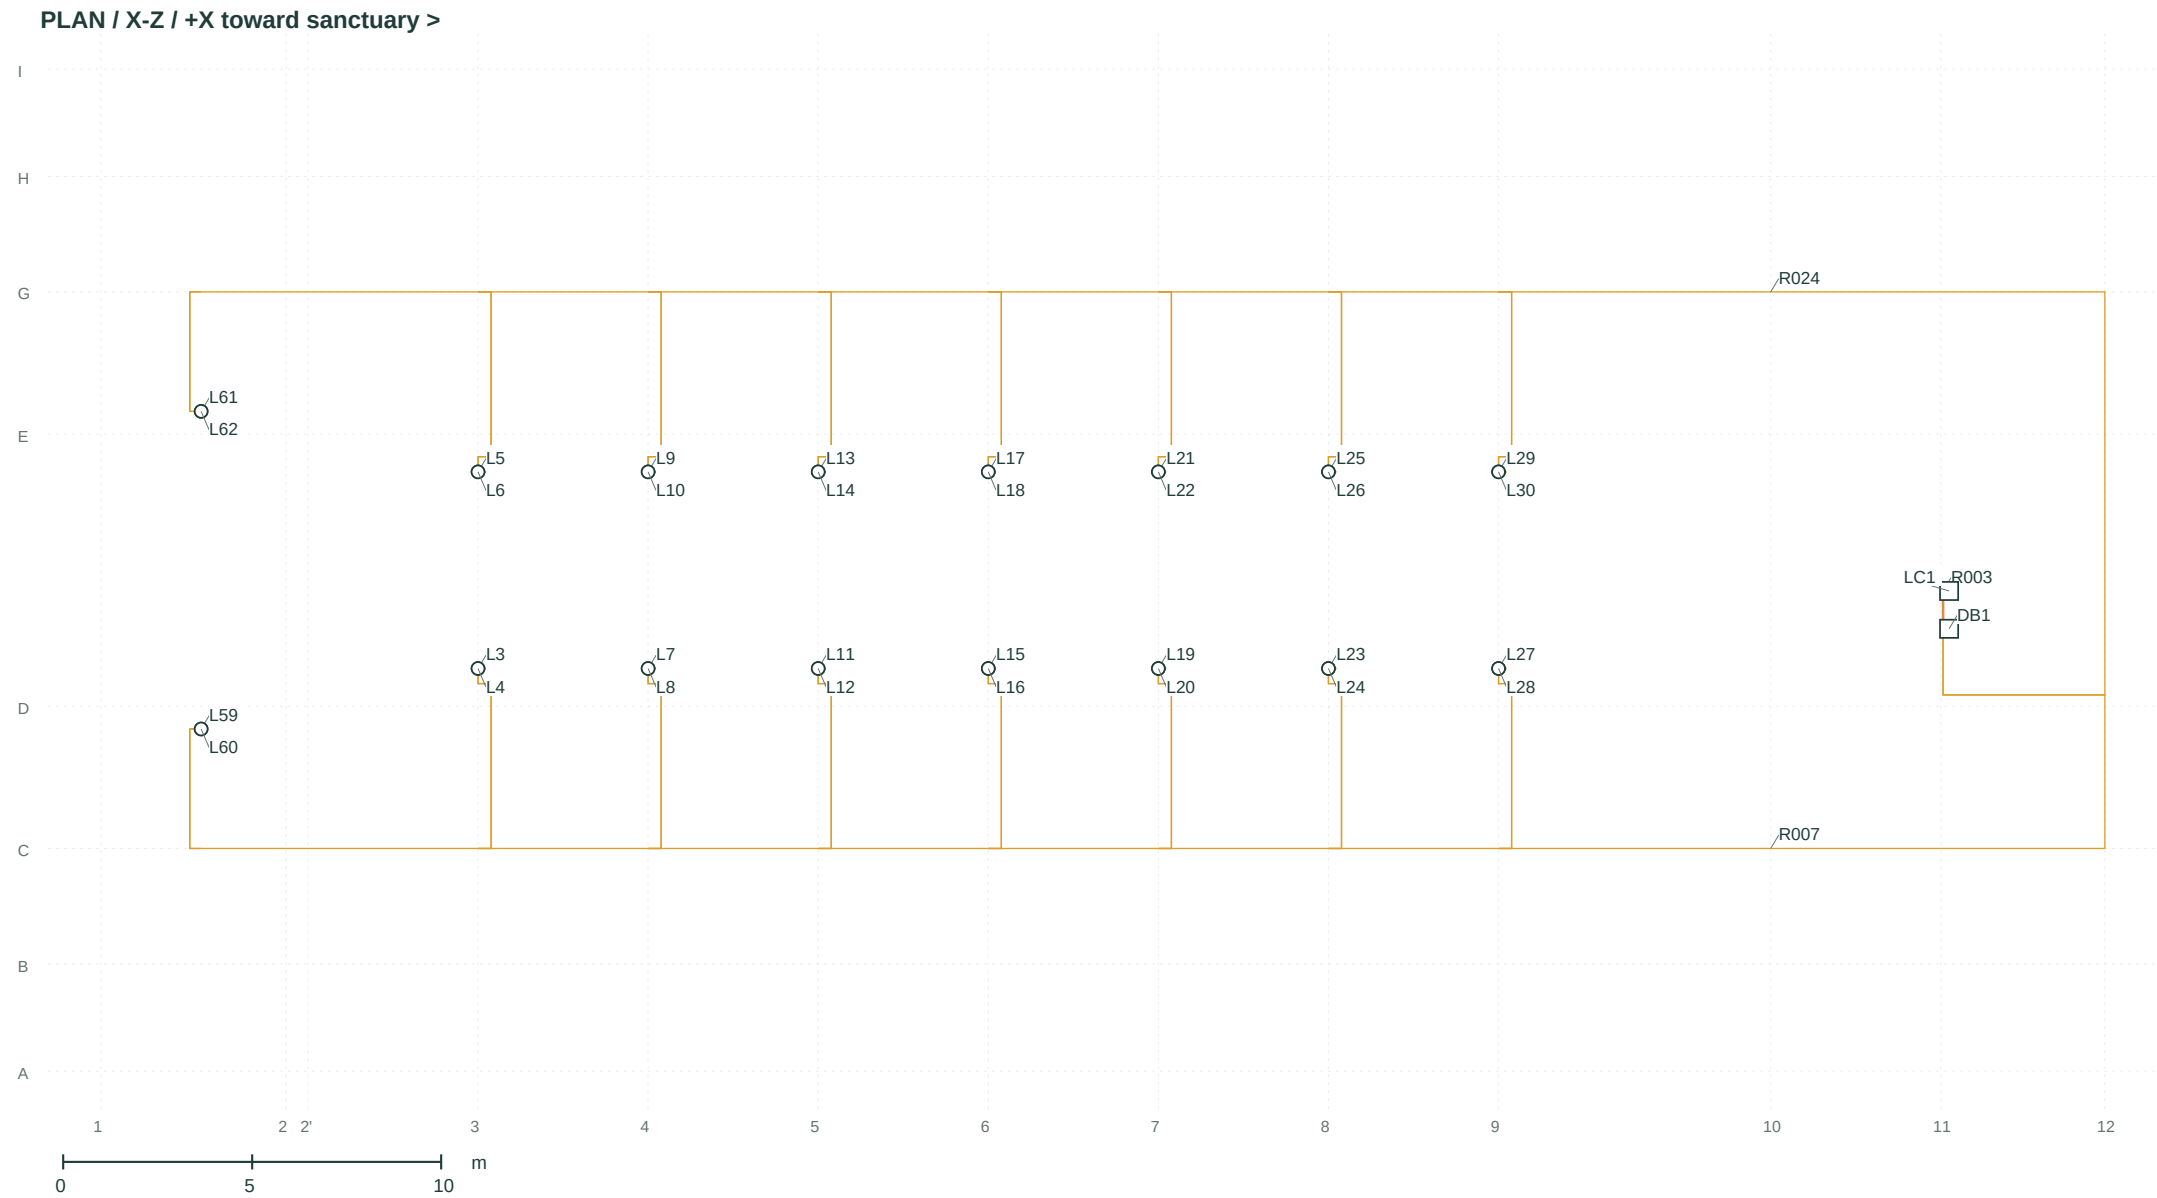

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

COORDINATES / X, Y, Z (m)				
ID	X	Y	Z	Branch
L3	9.975	8.585	-2.600	R008
L4	9.975	8.585	-2.600	R009
L5	9.975	8.585	2.600	R025
L6	9.975	8.585	2.600	R026
L7	14.475	8.585	-2.600	R010
L8	14.475	8.585	-2.600	R011
L9	14.475	8.585	2.600	R027
L10	14.475	8.585	2.600	R028
L11	18.975	8.585	-2.600	R012
L12	18.975	8.585	-2.600	R013
L13	18.975	8.585	2.600	R029
L14	18.975	8.585	2.600	R030
L15	23.475	8.585	-2.600	R014
L16	23.475	8.585	-2.600	R015
L17	23.475	8.585	2.600	R031
L18	23.475	8.585	2.600	R032
L19	27.975	8.585	-2.600	R016
L20	27.975	8.585	-2.600	R017
L21	27.975	8.585	2.600	R033
L22	27.975	8.585	2.600	R034
L23	32.475	8.585	-2.600	R018
L24	32.475	8.585	-2.600	R019
L25	32.475	8.585	2.600	R035
L26	32.475	8.585	2.600	R036
L27	36.975	8.585	-2.600	R020
L28	36.975	8.585	-2.600	R021
L29	36.975	8.585	2.600	R037
L30	36.975	8.585	2.600	R038
L59	2.650	3.450	-4.200	R022
L60	2.650	5.950	-4.200	R023
L61	2.650	3.450	4.200	R039
L62	2.650	5.950	4.200	R040

Related enclosures			
DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550


32 equipment / 35 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

L2 / Outer seating

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

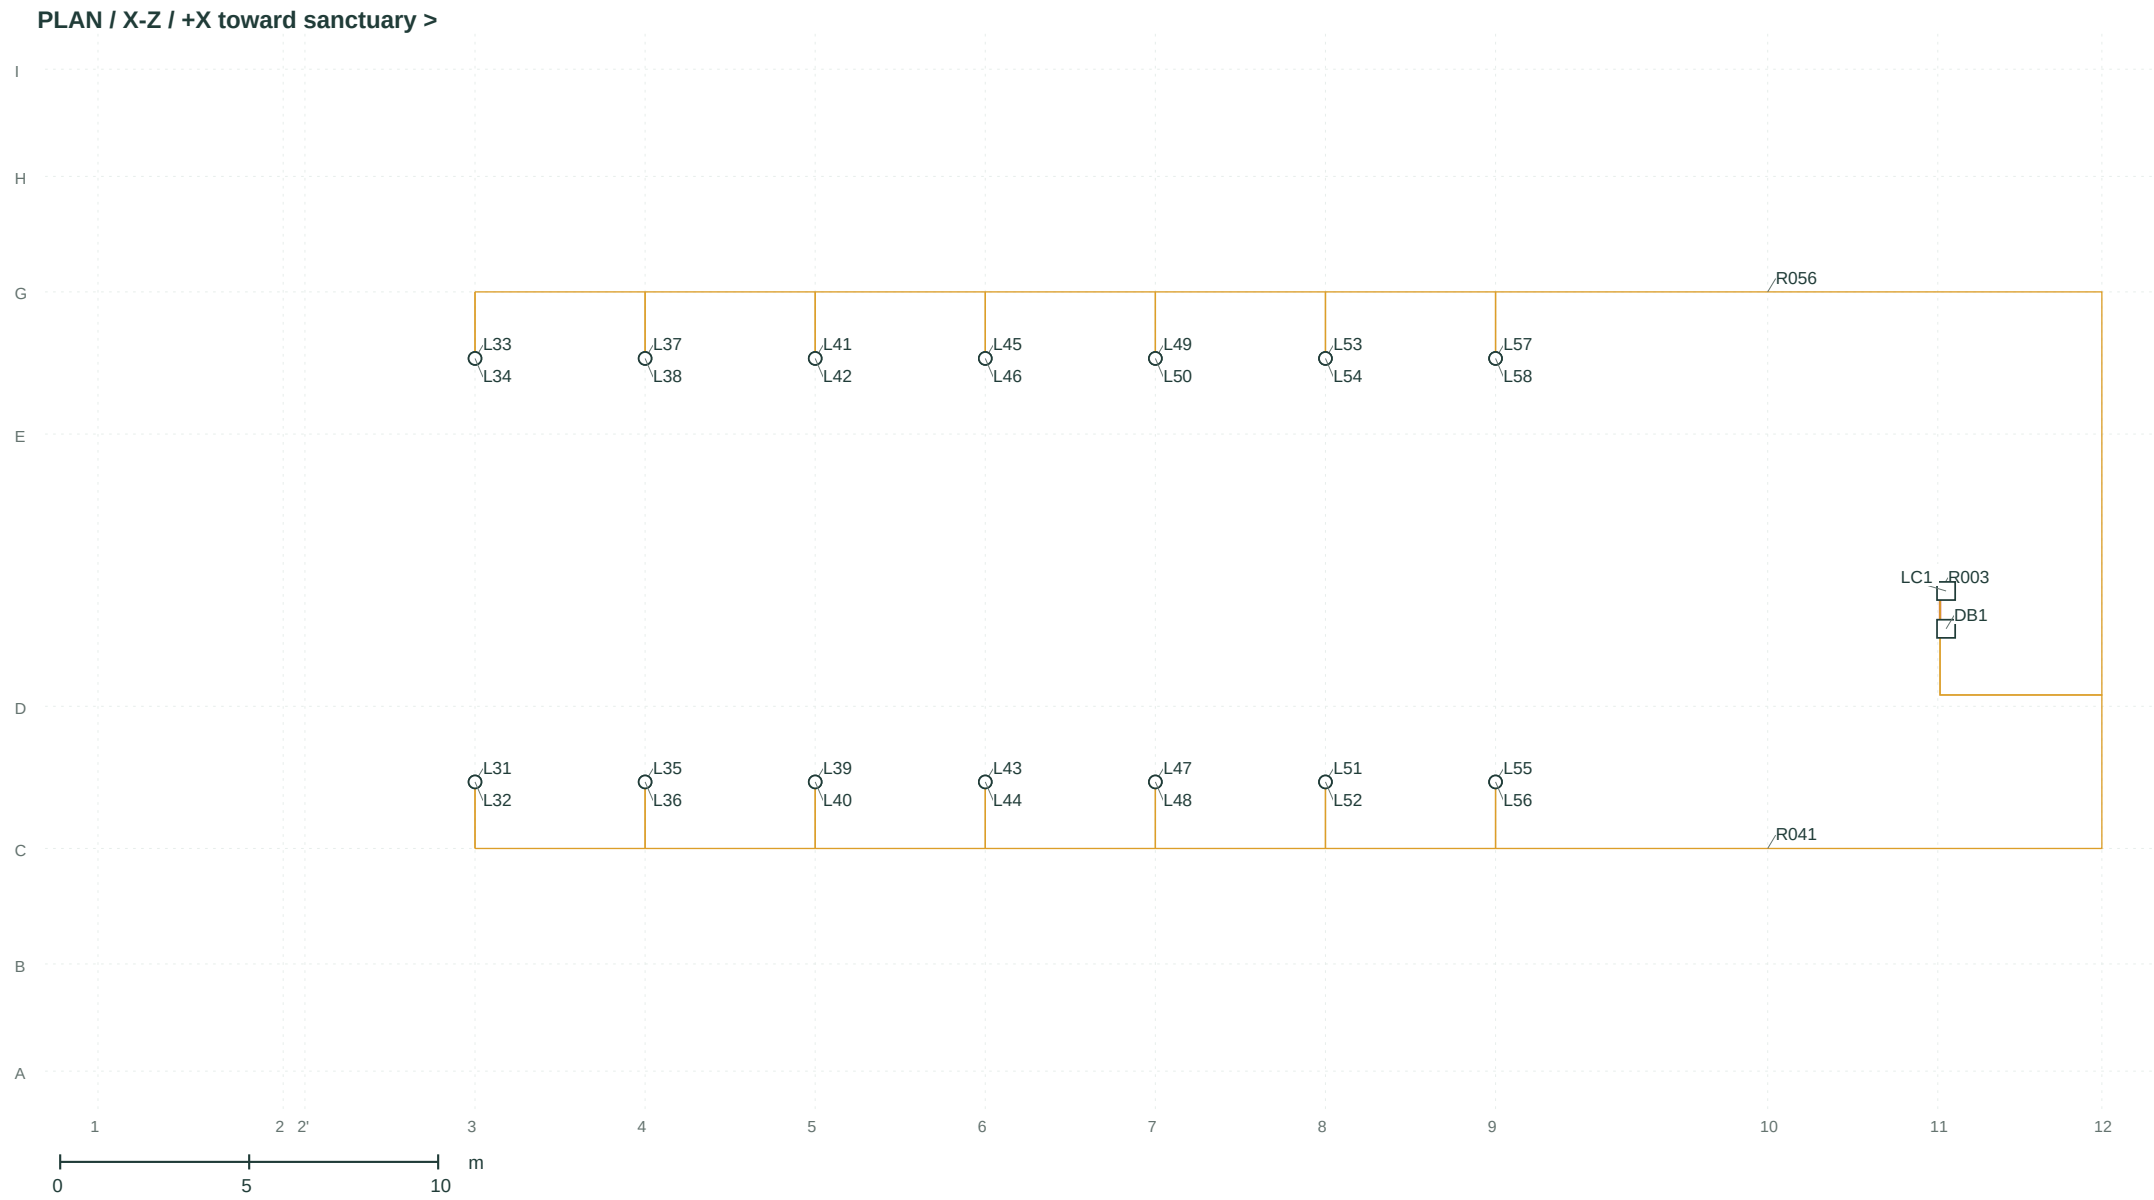


COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Branch
L31	9.975	6.655	-5.600	R042
L32	9.975	6.655	-5.600	R043
L33	9.975	6.655	5.600	R057
L34	9.975	6.655	5.600	R058
L35	14.475	6.655	-5.600	R044
L36	14.475	6.655	-5.600	R045
L37	14.475	6.655	5.600	R059
L38	14.475	6.655	5.600	R060
L39	18.975	6.655	-5.600	R046
L40	18.975	6.655	-5.600	R047
L41	18.975	6.655	5.600	R061
L42	18.975	6.655	5.600	R062
L43	23.475	6.655	-5.600	R048
L44	23.475	6.655	-5.600	R049
L45	23.475	6.655	5.600	R063
L46	23.475	6.655	5.600	R064
L47	27.975	6.655	-5.600	R050
L48	27.975	6.655	-5.600	R051
L49	27.975	6.655	5.600	R065
L50	27.975	6.655	5.600	R066
L51	32.475	6.655	-5.600	R052
L52	32.475	6.655	-5.600	R053
L53	32.475	6.655	5.600	R067
L54	32.475	6.655	5.600	R068
L55	36.975	6.655	-5.600	R054
L56	36.975	6.655	-5.600	R055
L57	36.975	6.655	5.600	R069
L58	36.975	6.655	5.600	R070

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

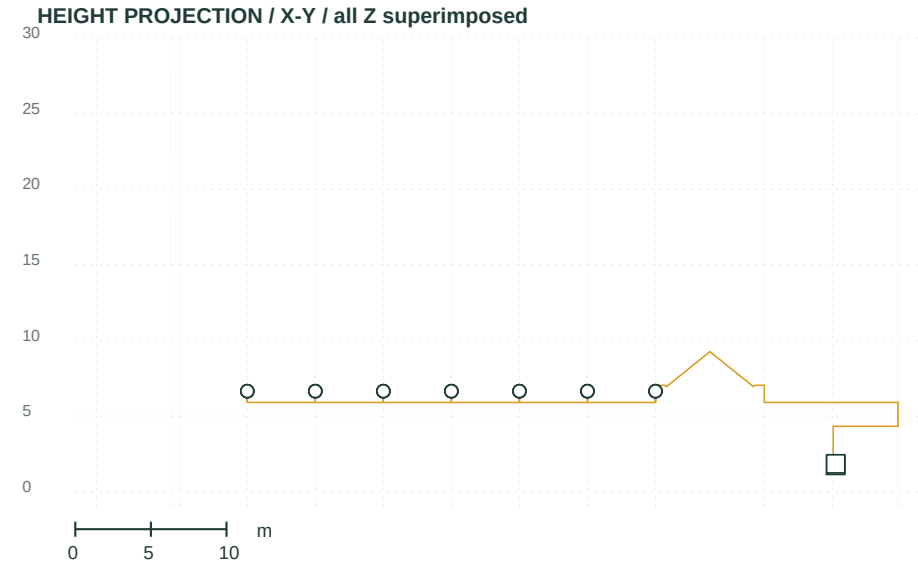

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.


28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

L8 / Wings / choir & ministers

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

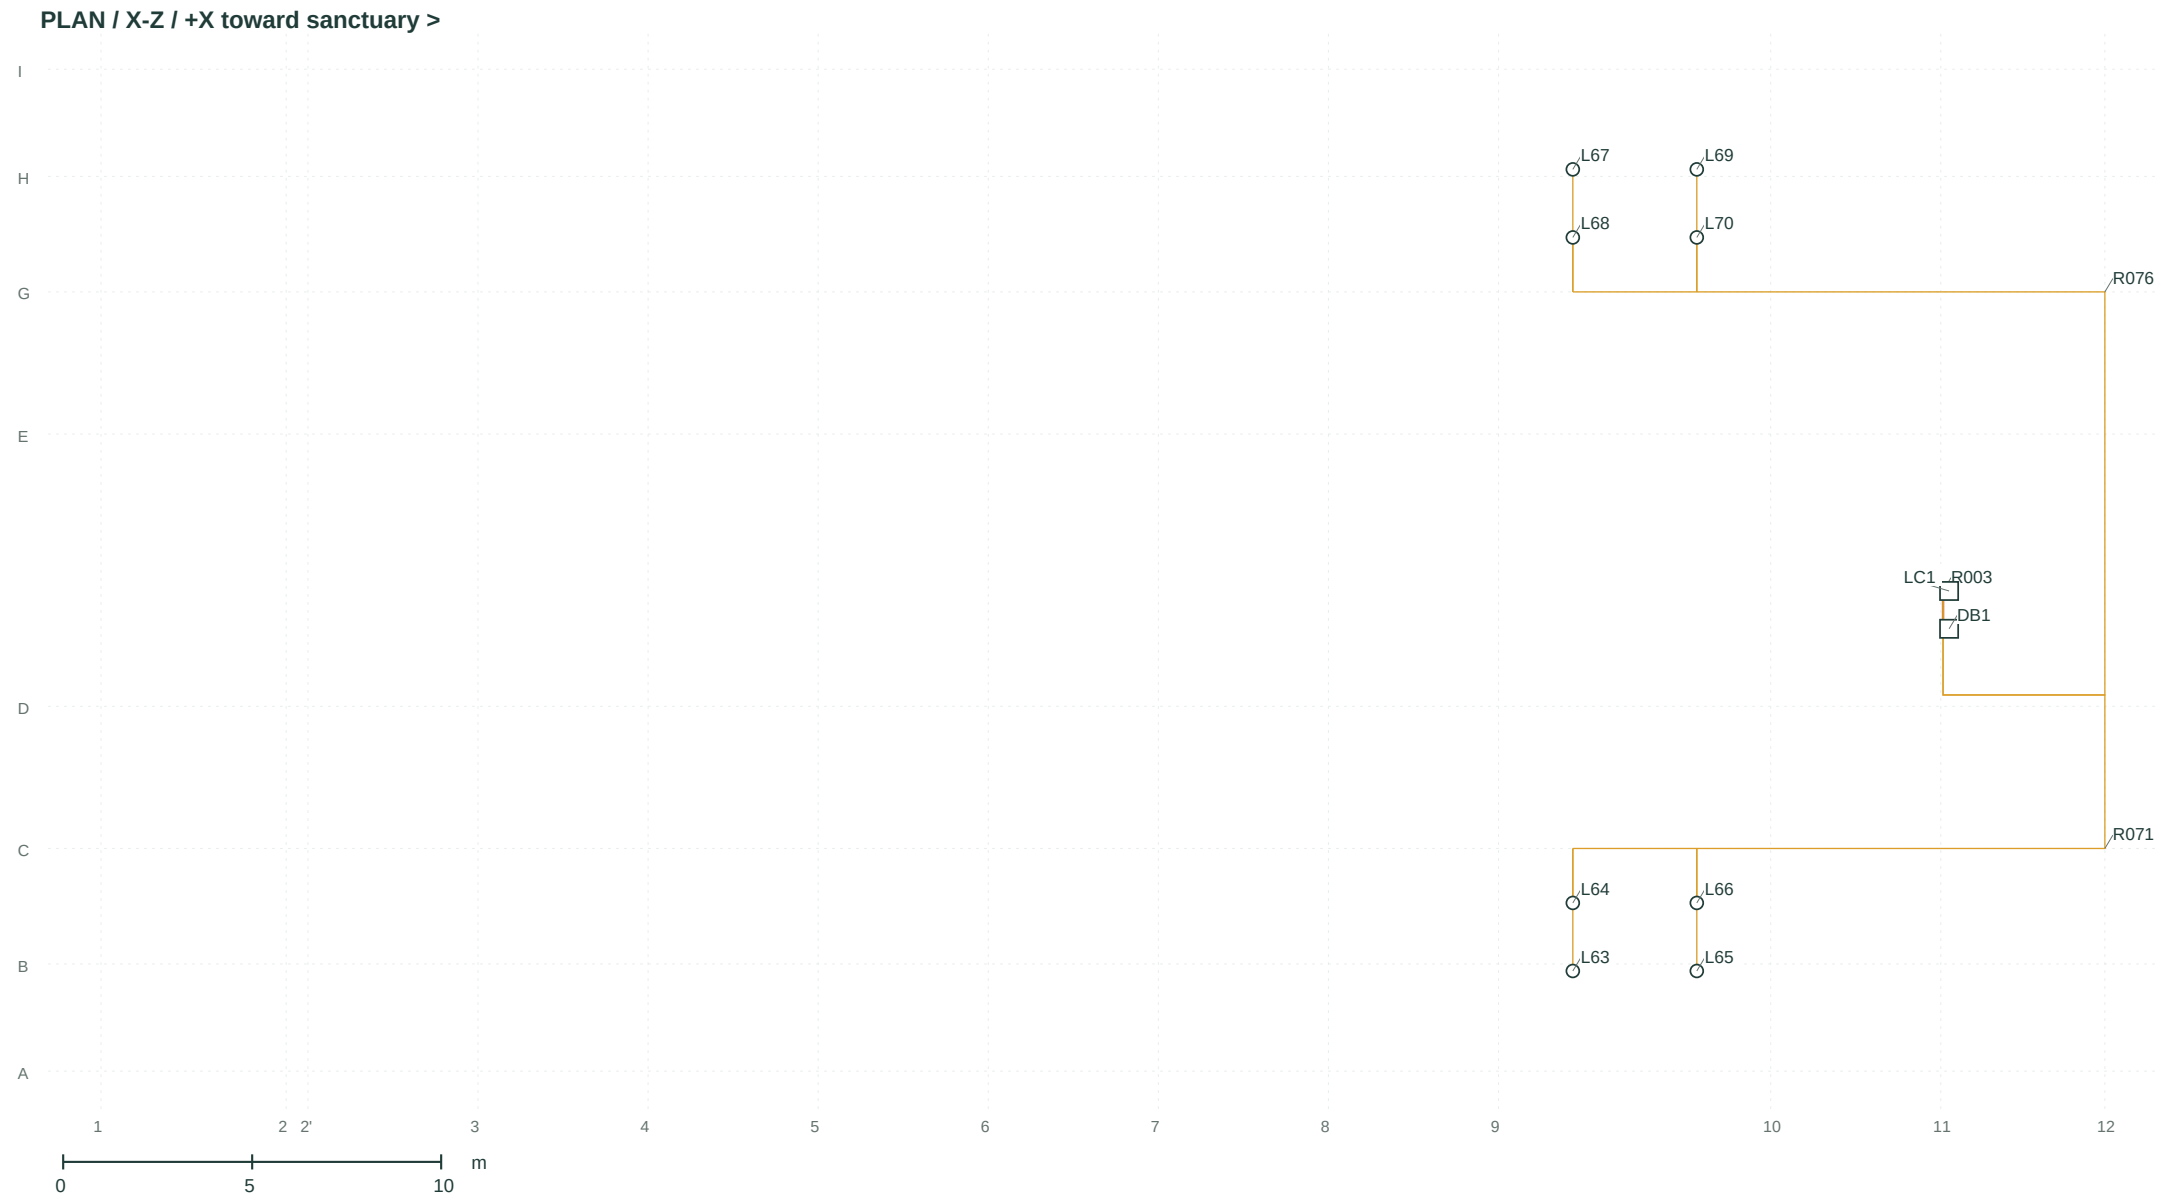

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L63	38.940	4.400	-10.600	R072
L64	38.940	4.400	-8.800	R073
L65	42.220	4.400	-10.600	R074
L66	42.220	4.400	-8.800	R075
L67	38.940	4.400	10.600	R077
L68	38.940	4.400	8.800	R078
L69	42.220	4.400	10.600	R079
L70	42.220	4.400	8.800	R080

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

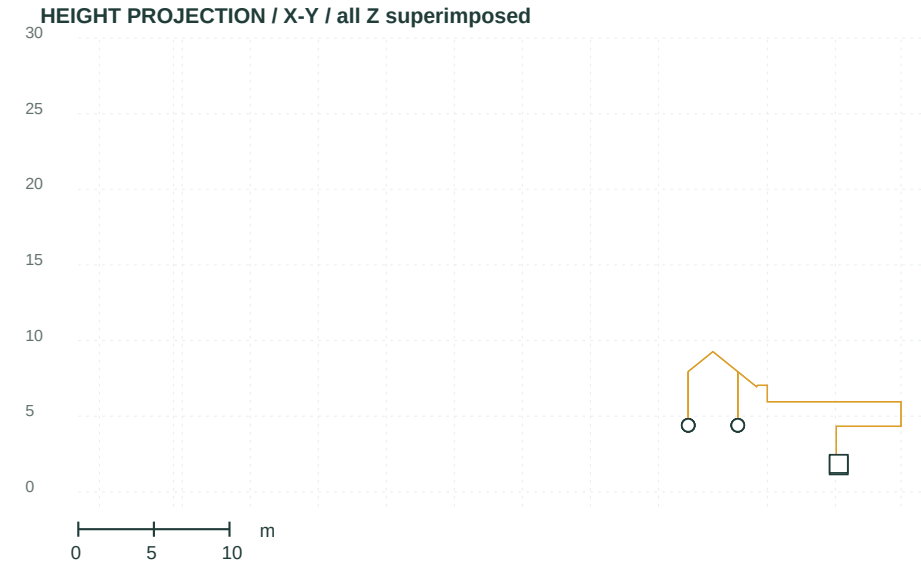

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.


Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

LA / Roof uplight

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

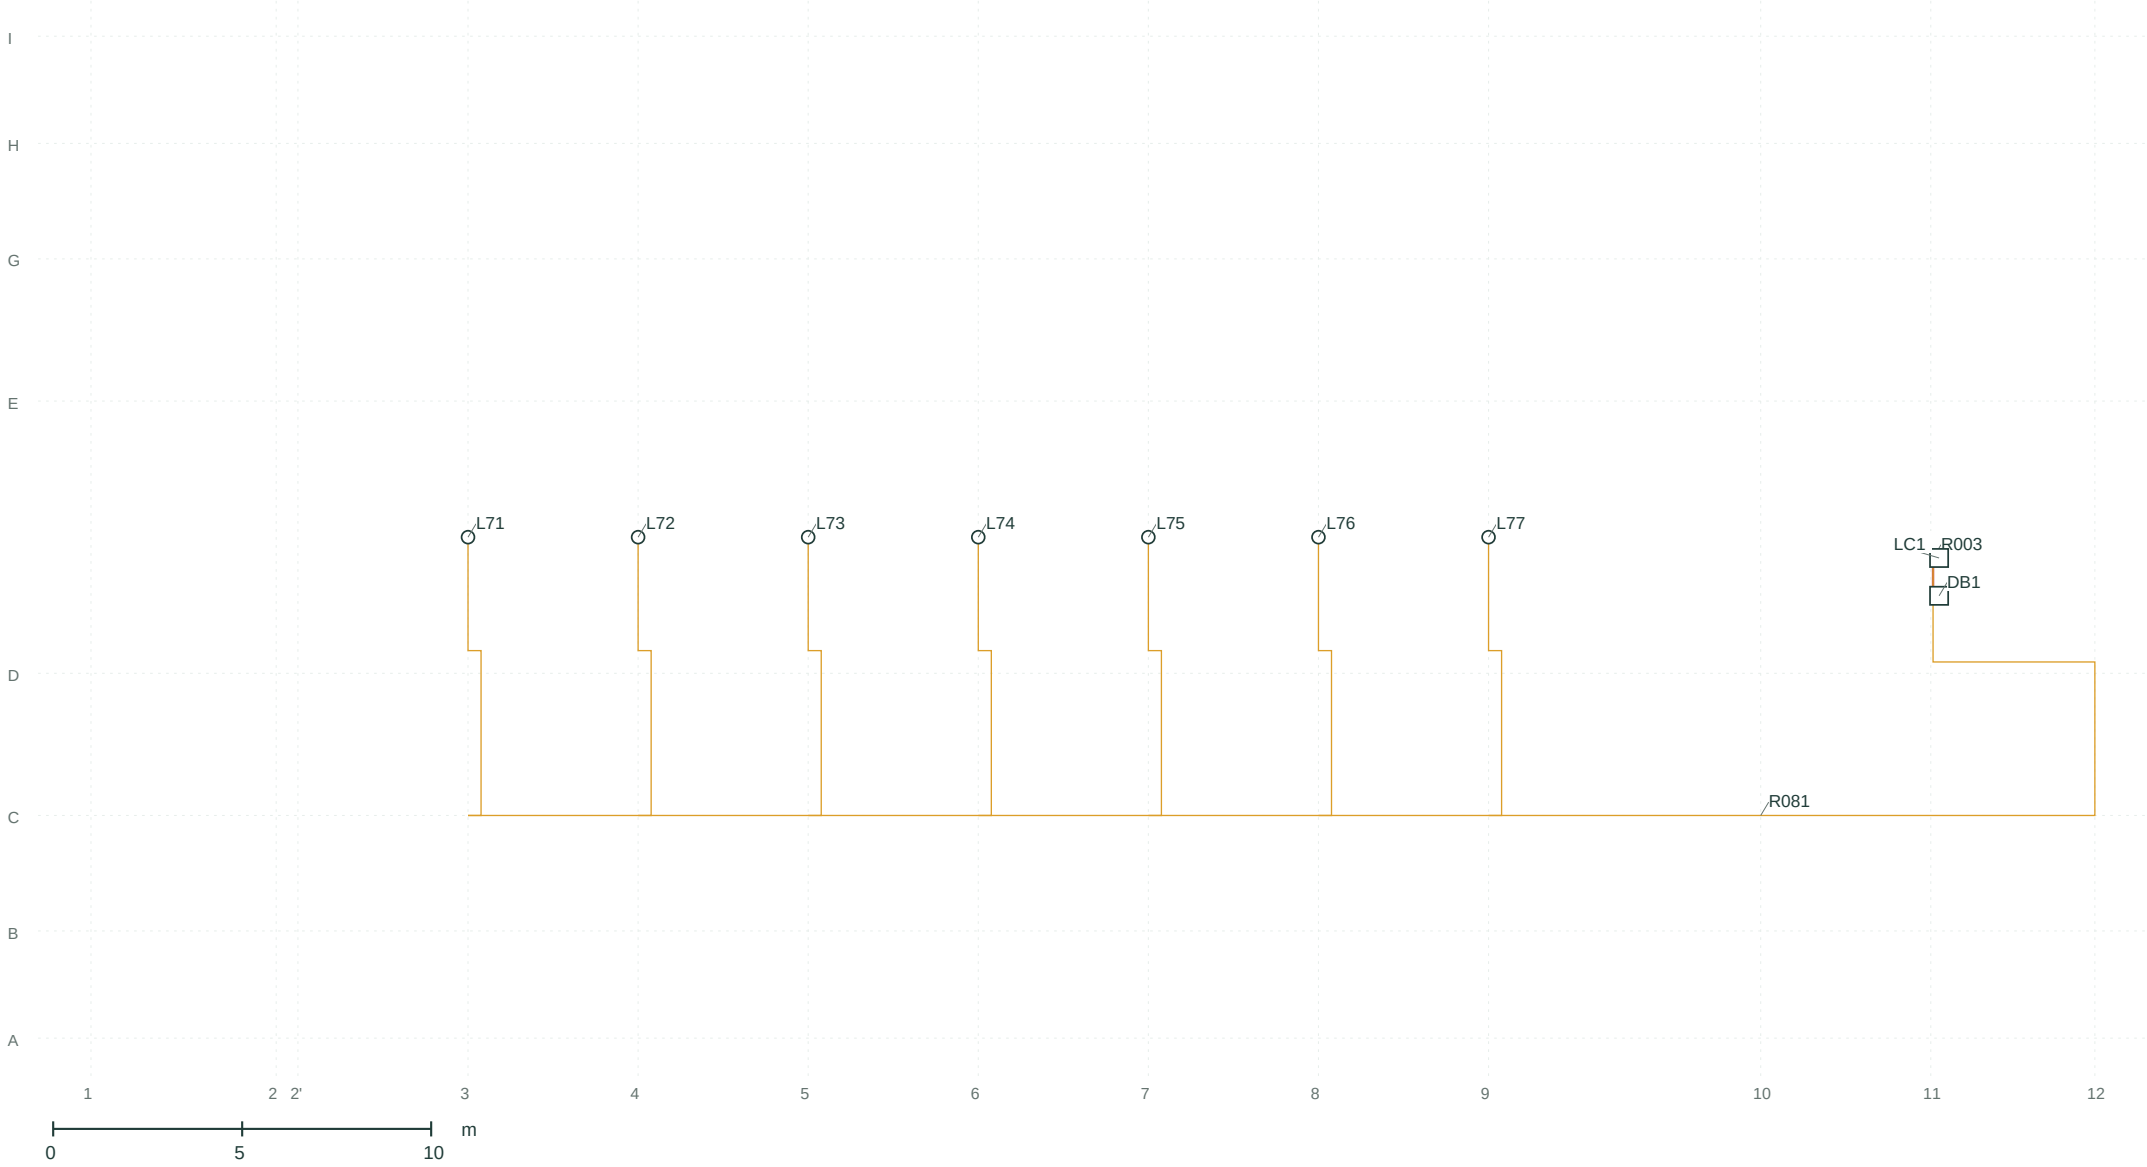

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Branch
L71	9.975	9.180	0.000	R082
L72	14.475	9.180	0.000	R083
L73	18.975	9.180	0.000	R084
L74	23.475	9.180	0.000	R085
L75	27.975	9.180	0.000	R086
L76	32.475	9.180	0.000	R087
L77	36.975	9.180	0.000	R088


Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

7 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

HEIGHT PROJECTION / X-Y / all Z superimposed

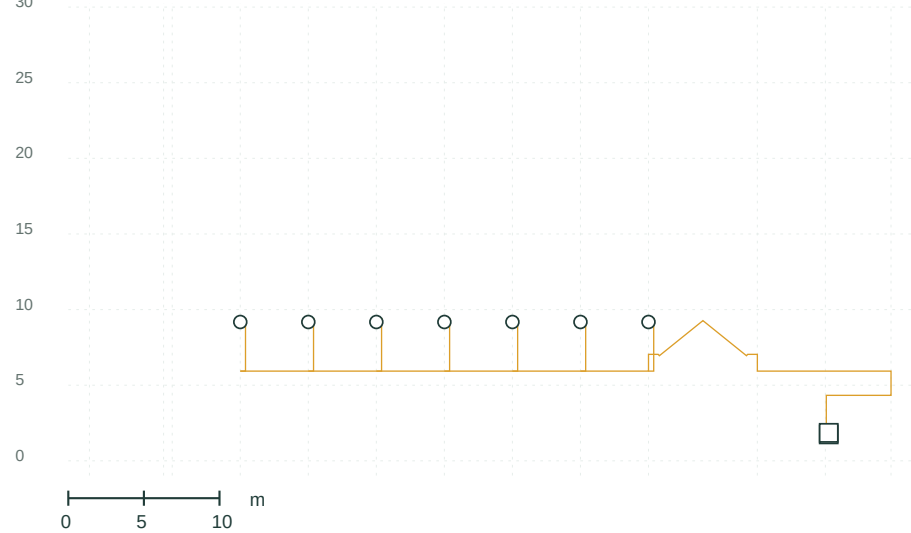


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

LD / Chandeliers & sconces

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

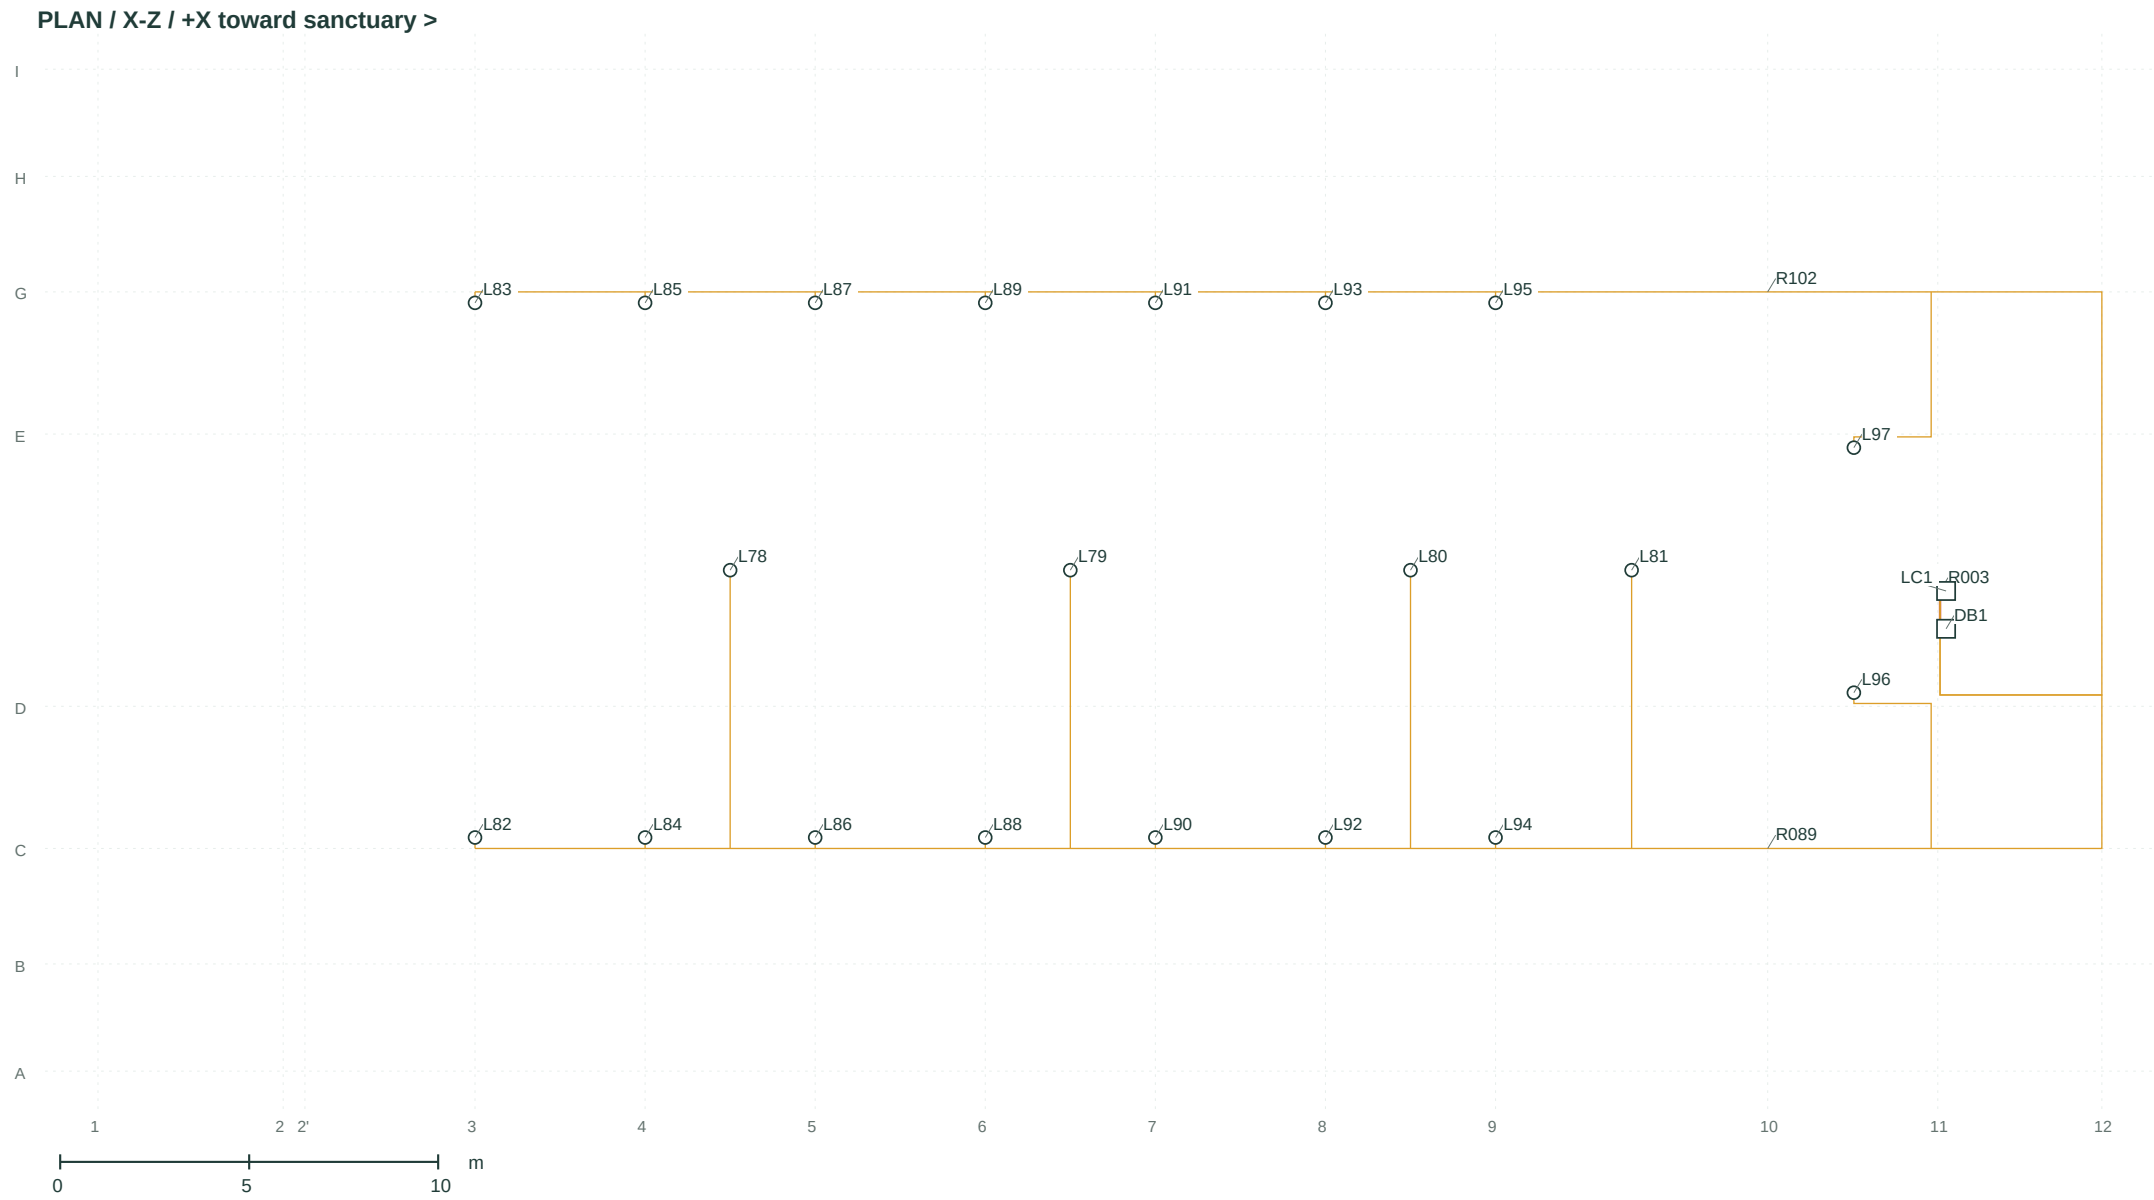

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L78	16.725	6.300	0.000	R090
L79	25.725	6.300	0.000	R091
L80	34.725	6.300	0.000	R092
L81	40.575	9.200	0.000	R093
L82	9.975	4.600	-7.070	R094
L83	9.975	4.600	7.070	R103
L84	14.475	4.600	-7.070	R095
L85	14.475	4.600	7.070	R104
L86	18.975	4.600	-7.070	R096
L87	18.975	4.600	7.070	R105
L88	23.475	4.600	-7.070	R097
L89	23.475	4.600	7.070	R106
L90	27.975	4.600	-7.070	R098
L91	27.975	4.600	7.070	R107
L92	32.475	4.600	-7.070	R099
L93	32.475	4.600	7.070	R108
L94	36.975	4.600	-7.070	R100
L95	36.975	4.600	7.070	R109
L96	46.455	4.300	-3.240	R101
L97	46.455	4.300	3.240	R110

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

20 equipment / 23 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

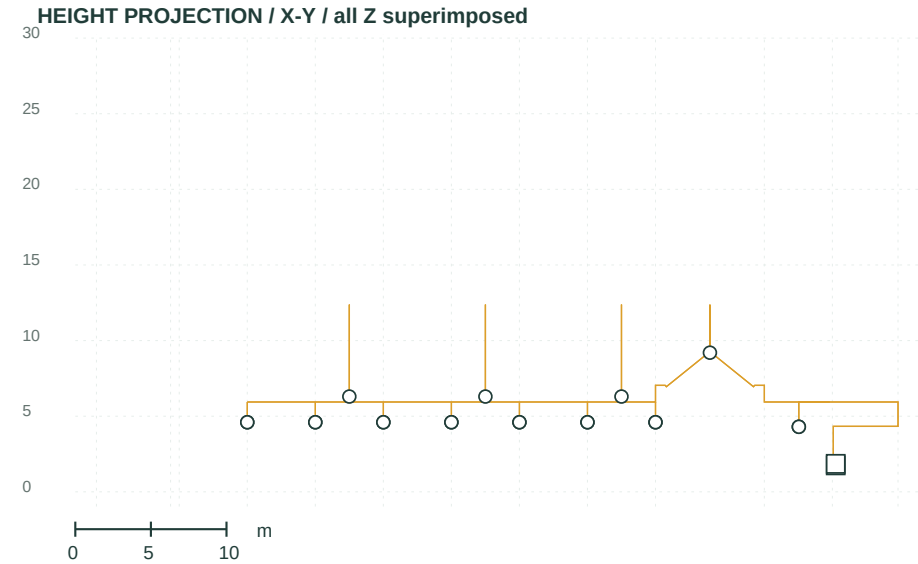


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L4 / Circulation & verandas

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

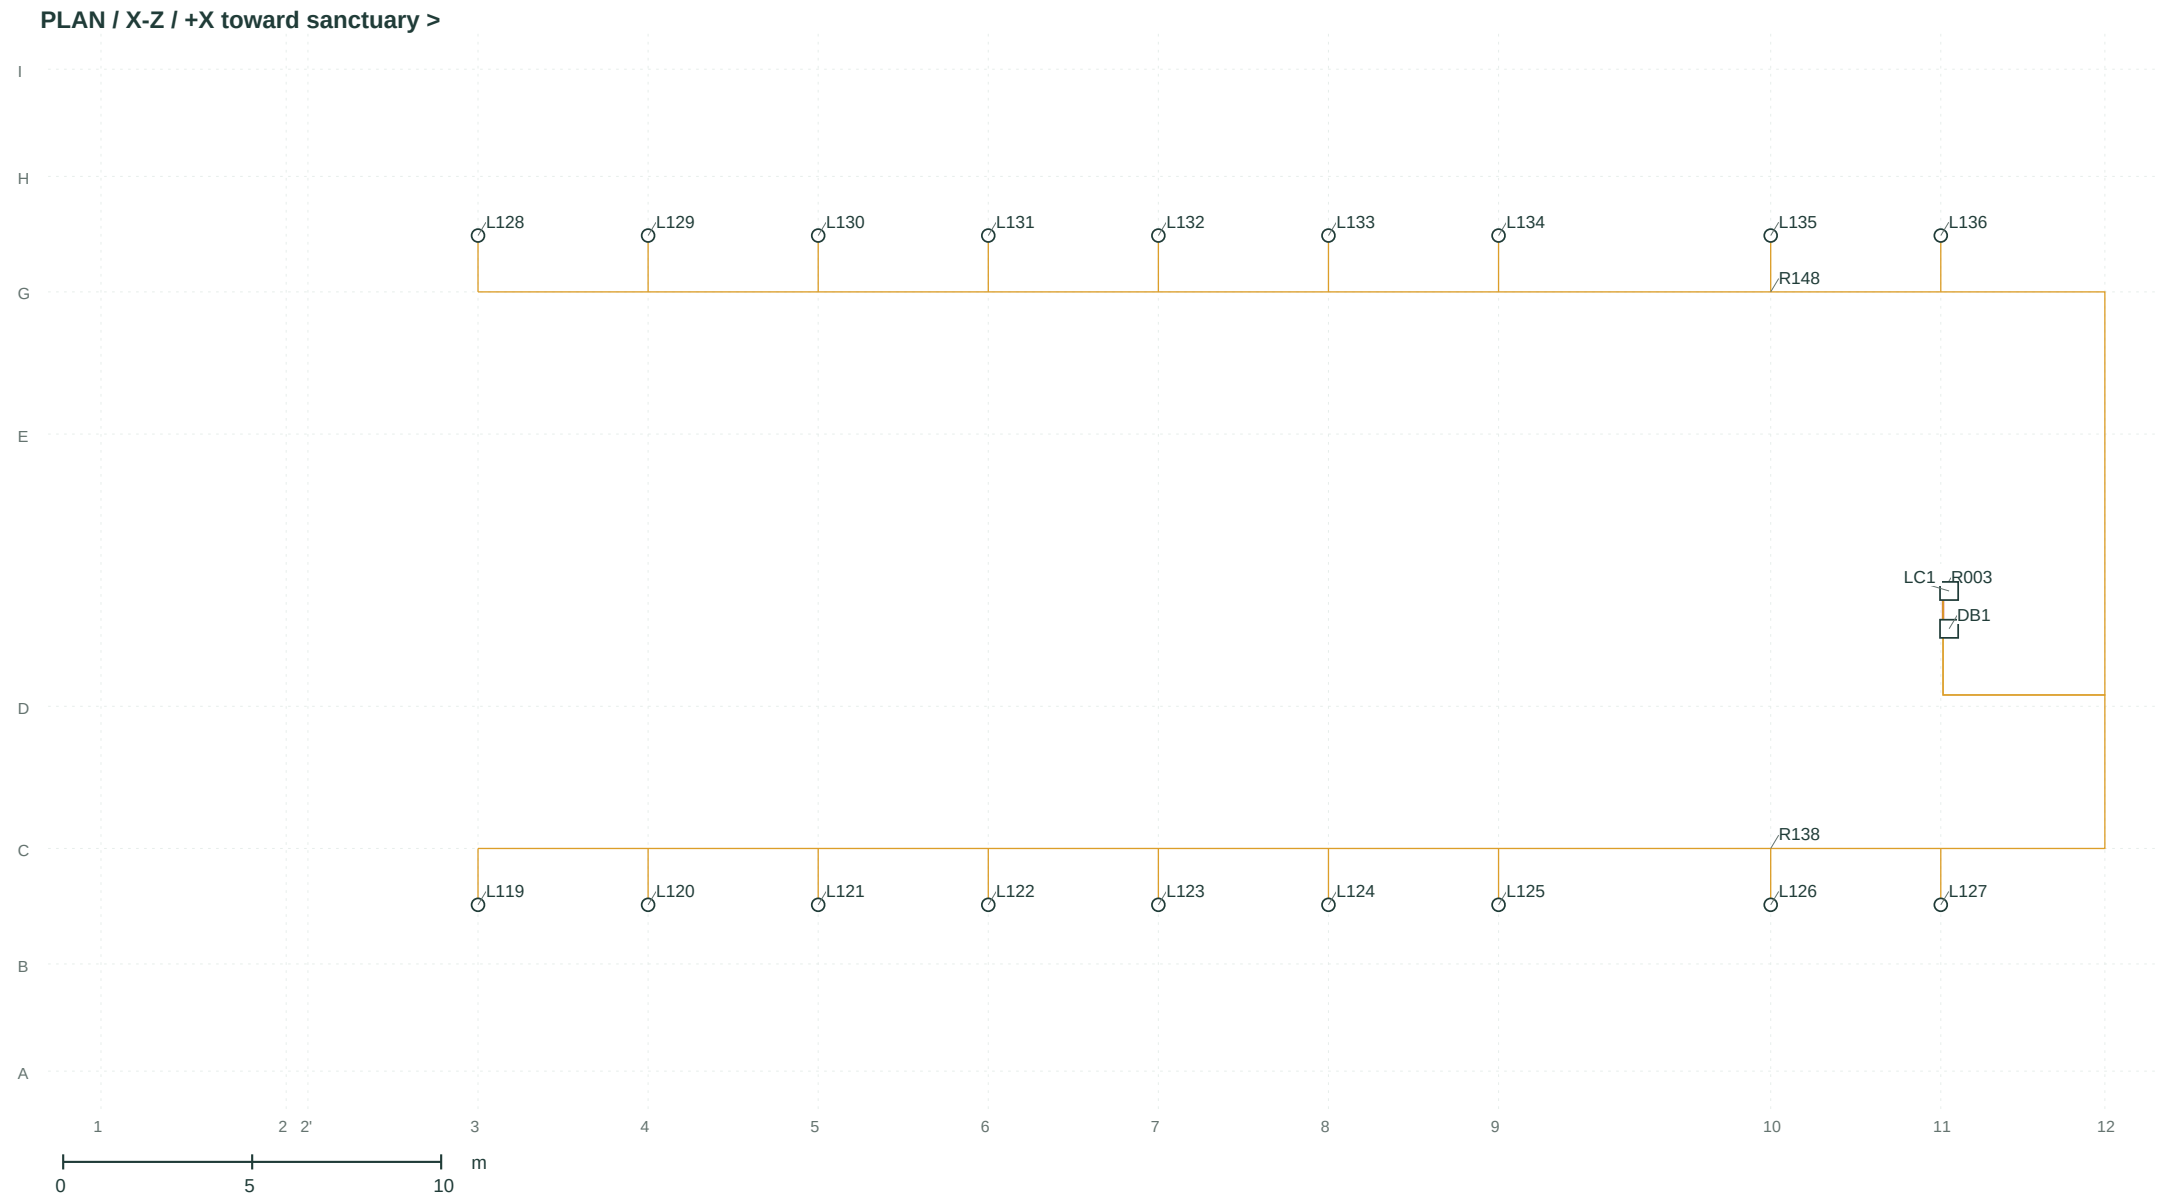

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L119	9.975	4.550	-8.850	R139
L120	14.475	4.550	-8.850	R140
L121	18.975	4.550	-8.850	R141
L122	23.475	4.550	-8.850	R142
L123	27.975	4.550	-8.850	R143
L124	32.475	4.550	-8.850	R144
L125	36.975	4.550	-8.850	R145
L126	44.175	4.550	-8.850	R146
L127	48.675	4.550	-8.850	R147
L128	9.975	4.550	8.850	R149
L129	14.475	4.550	8.850	R150
L130	18.975	4.550	8.850	R151
L131	23.475	4.550	8.850	R152
L132	27.975	4.550	8.850	R153
L133	32.475	4.550	8.850	R154
L134	36.975	4.550	8.850	R155
L135	44.175	4.550	8.850	R156
L136	48.675	4.550	8.850	R157

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

18 equipment / 21 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

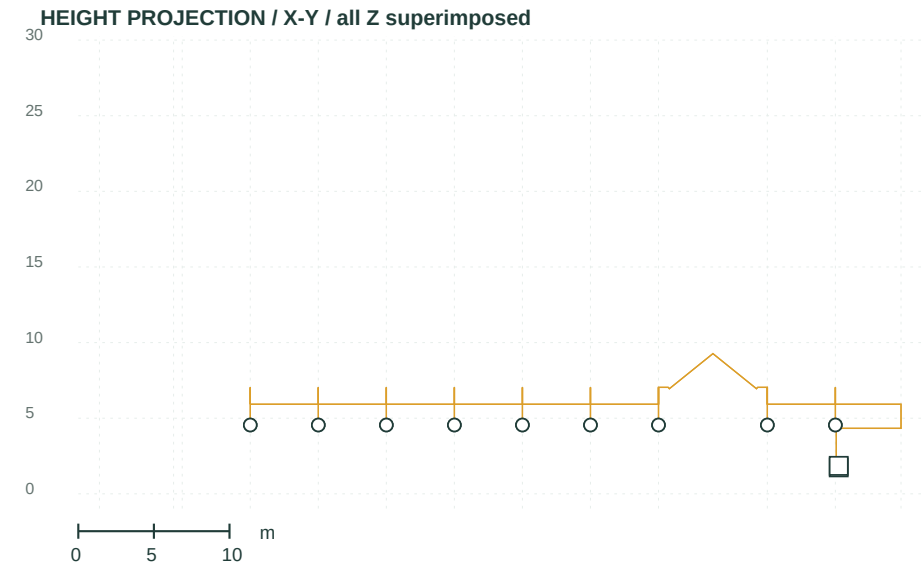

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L9 / Front stage & central door

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION



COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L137	2.200	3.000	-2.400	R159
L138	2.200	3.000	2.400	R163
L182	-0.075	8.400	-11.853	R160
L183	-0.075	8.400	-8.453	R161
L189	-0.075	8.400	8.453	R164
L190	-0.075	8.400	11.853	R165

Related enclosures

DB1	48.895	1.750	-1.550
DB2	2.730	1.500	-3.300

6 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

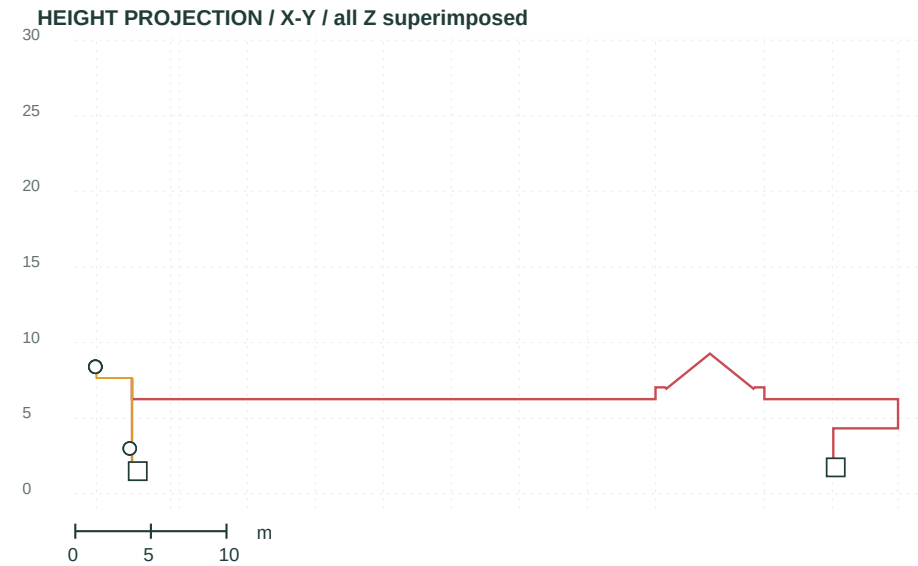


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L5 / Steps & paths

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

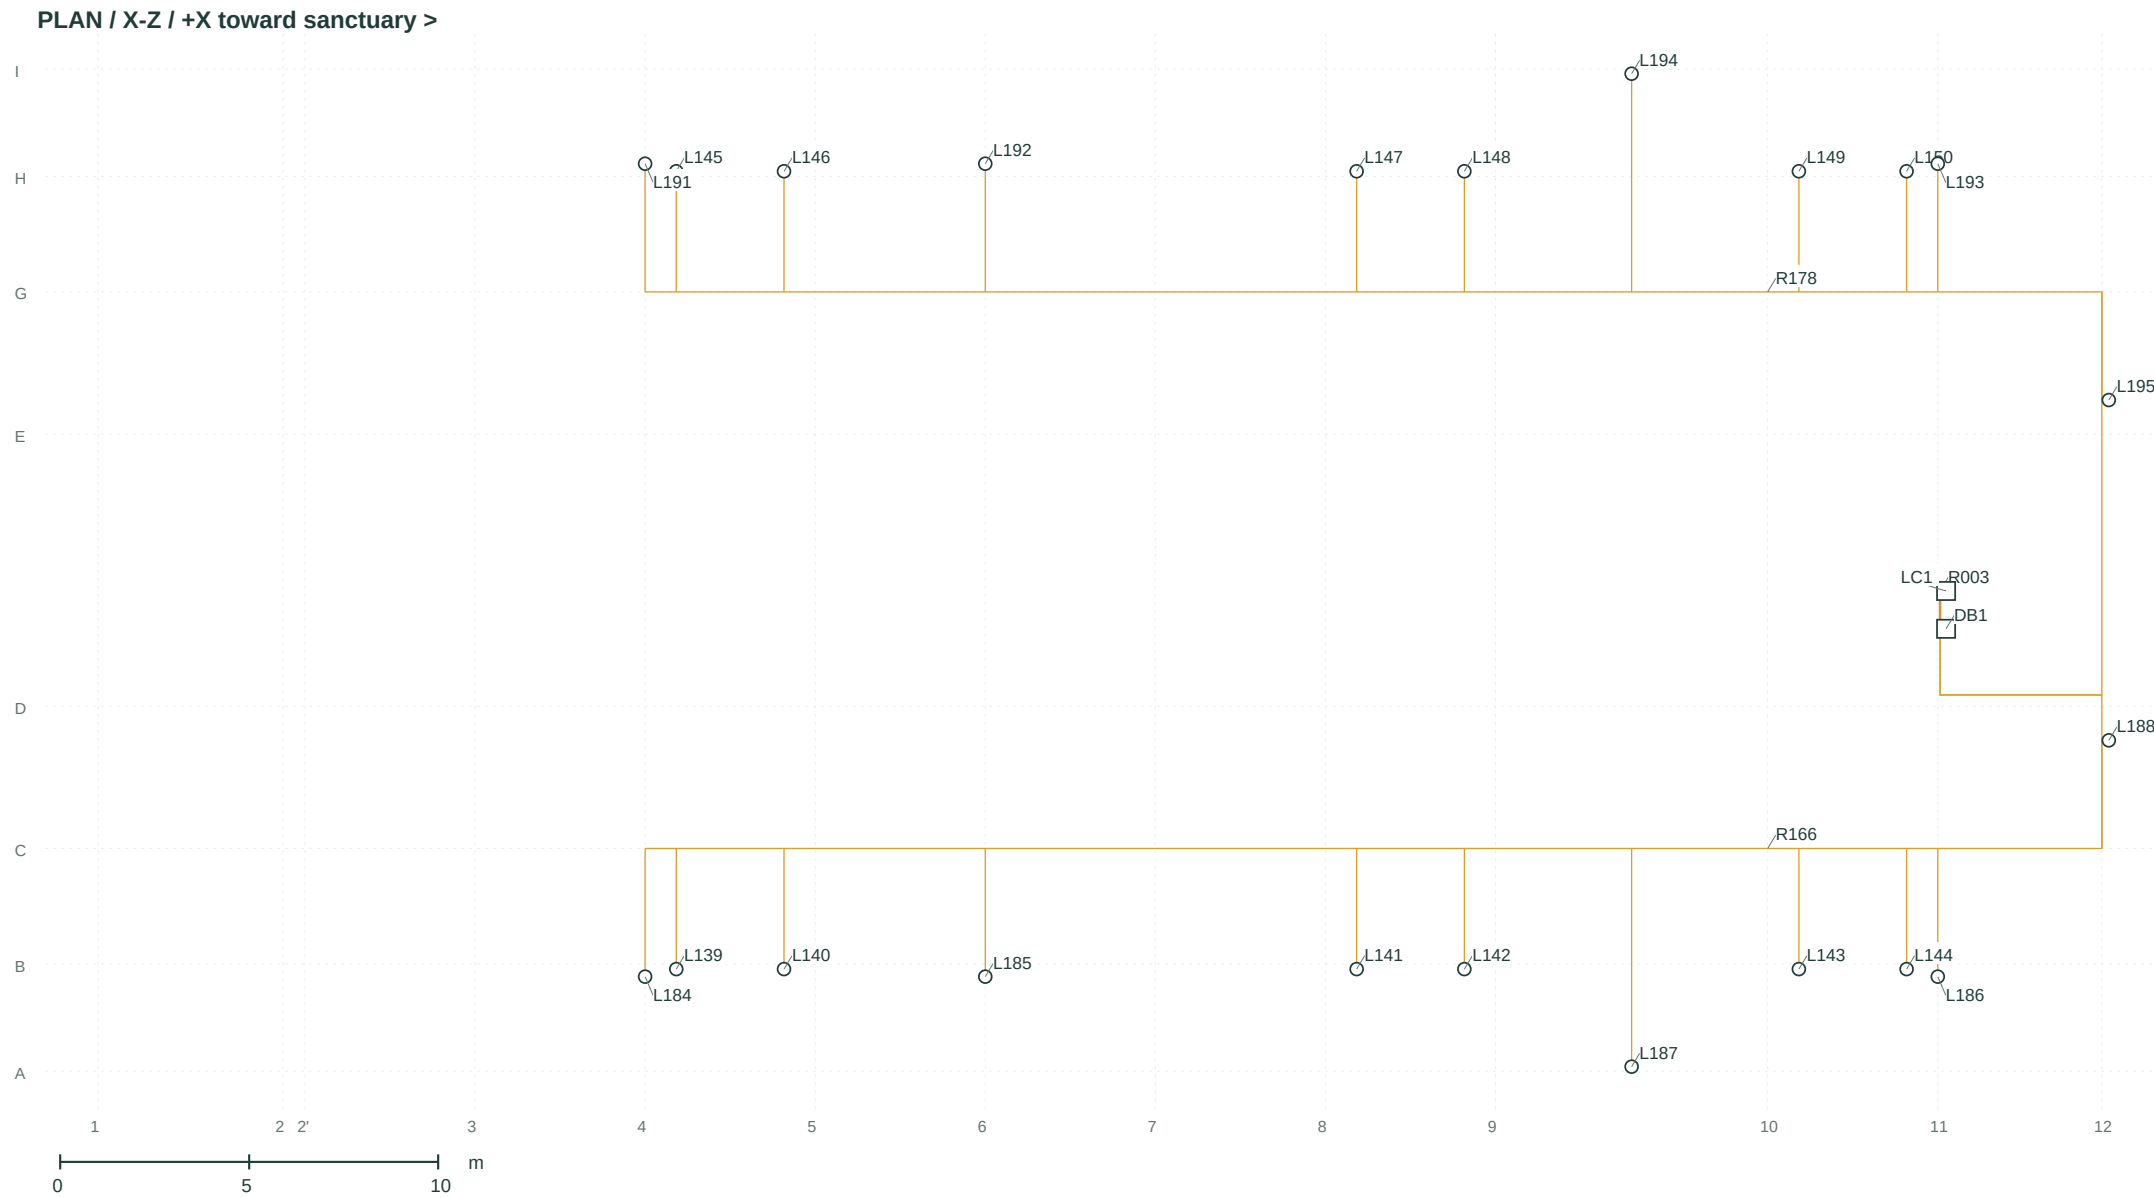

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L139	15.300	2.600	-10.550	R167
L140	18.150	2.600	-10.550	R168
L141	33.300	2.600	-10.550	R169
L142	36.150	2.600	-10.550	R170
L143	45.000	2.600	-10.550	R171
L144	47.850	2.600	-10.550	R172
L145	15.300	2.600	10.550	R179
L146	18.150	2.600	10.550	R180
L147	33.300	2.600	10.550	R181
L148	36.150	2.600	10.550	R182
L149	45.000	2.600	10.550	R183
L150	47.850	2.600	10.550	R184
L184	14.475	5.900	-10.750	R173
L185	23.475	5.900	-10.750	R174
L186	48.675	5.900	-10.750	R175
L187	40.575	6.200	-13.130	R176
L188	53.200	5.200	-4.500	R177
L191	14.475	5.900	10.750	R185
L192	23.475	5.900	10.750	R186
L193	48.675	5.900	10.750	R187
L194	40.575	6.200	13.130	R188
L195	53.200	5.200	4.500	R189

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

22 equipment / 25 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

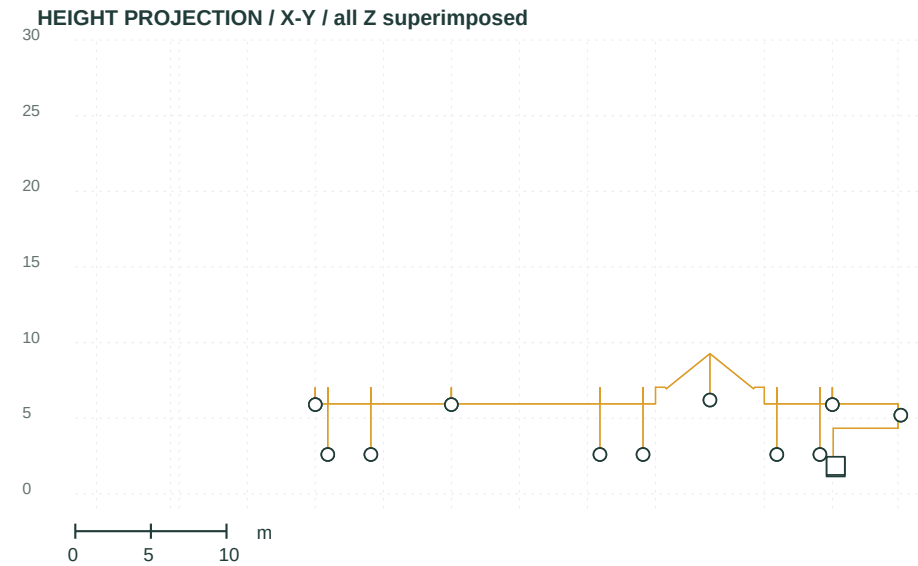

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.


Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

E1 / Exit signs


Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >

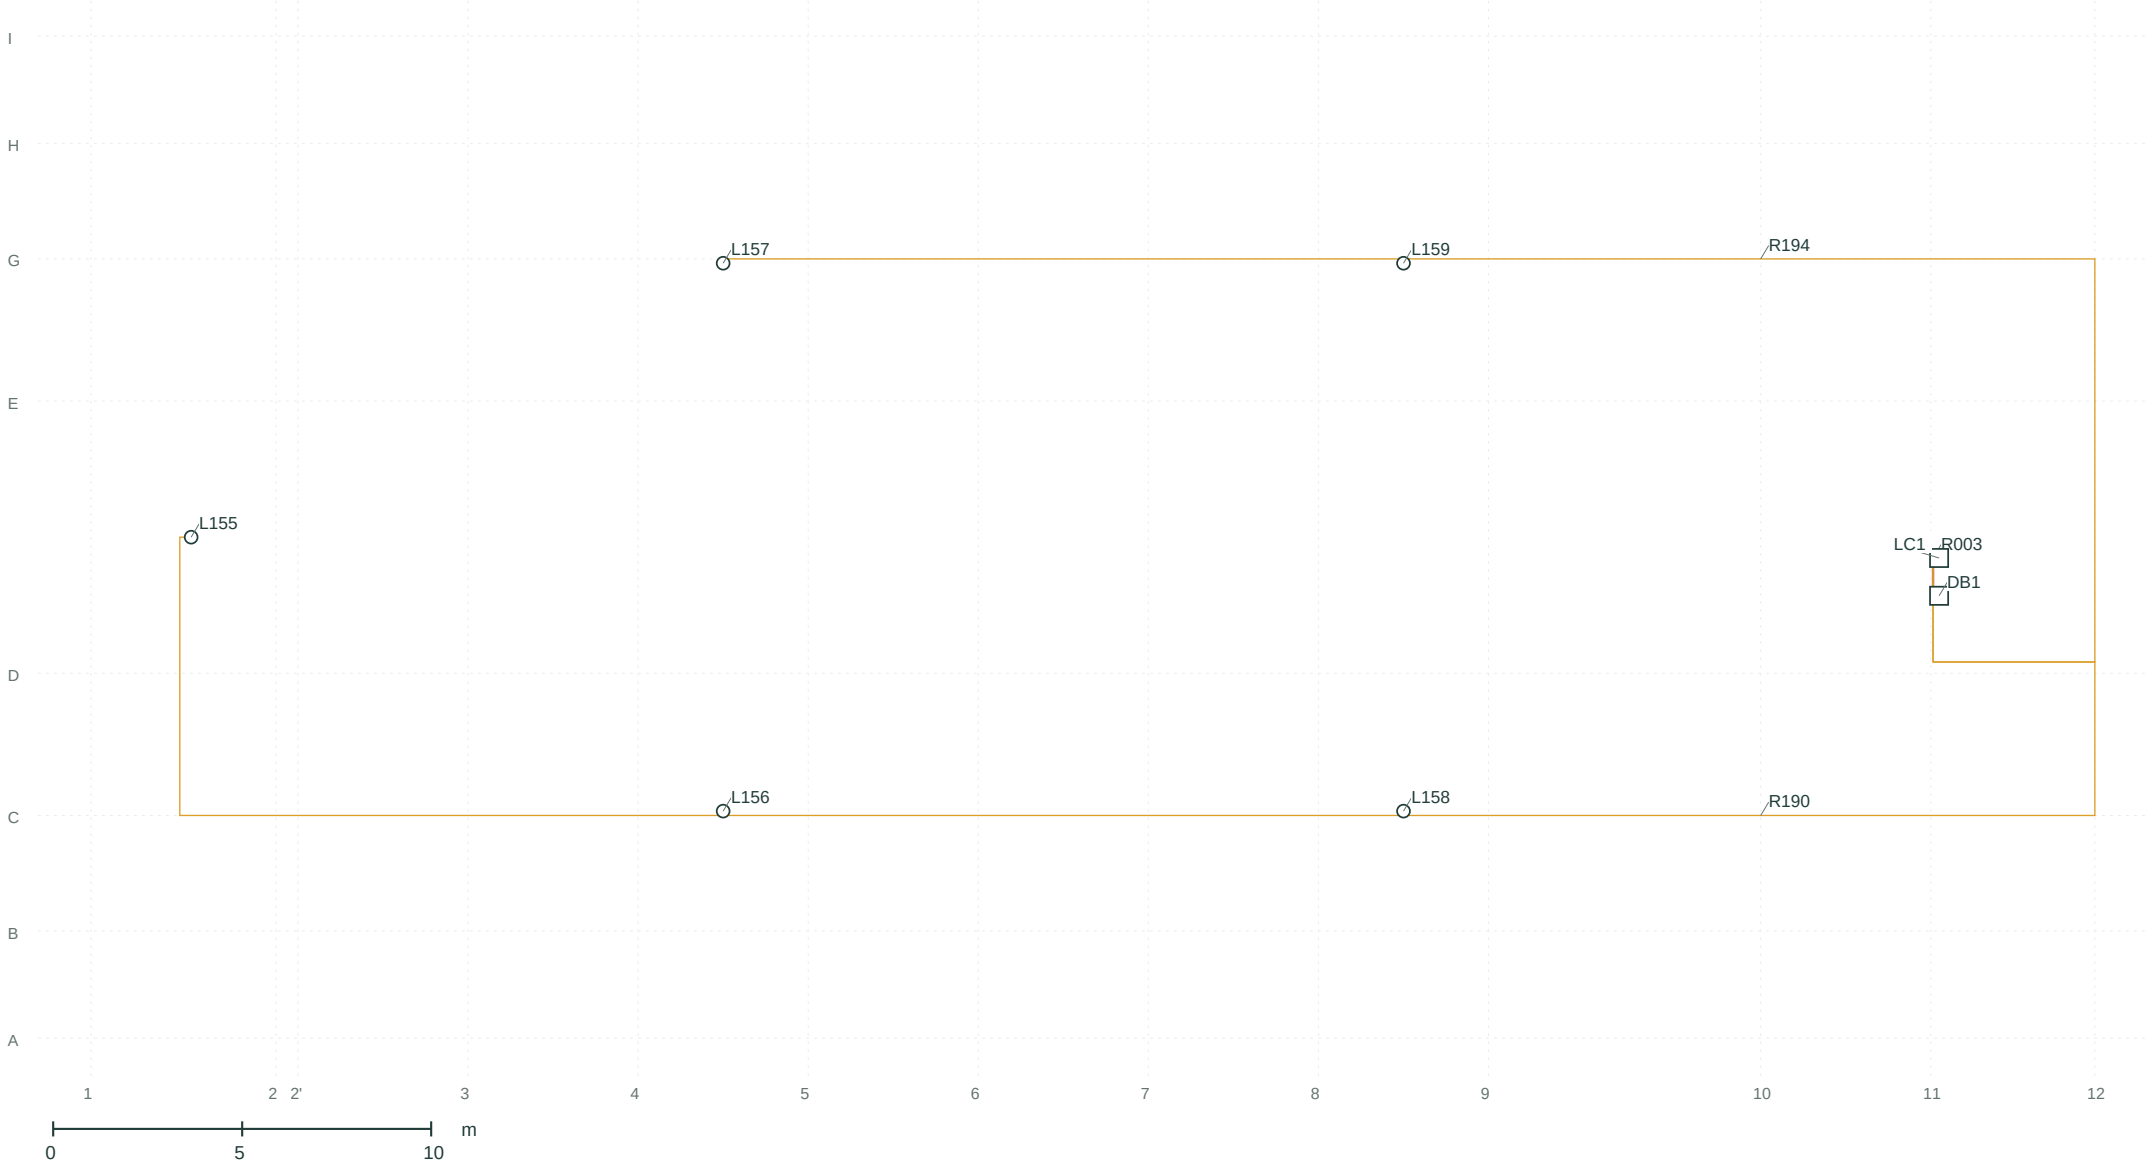

HEIGHT PROJECTION / X-Y / all Z superimposed

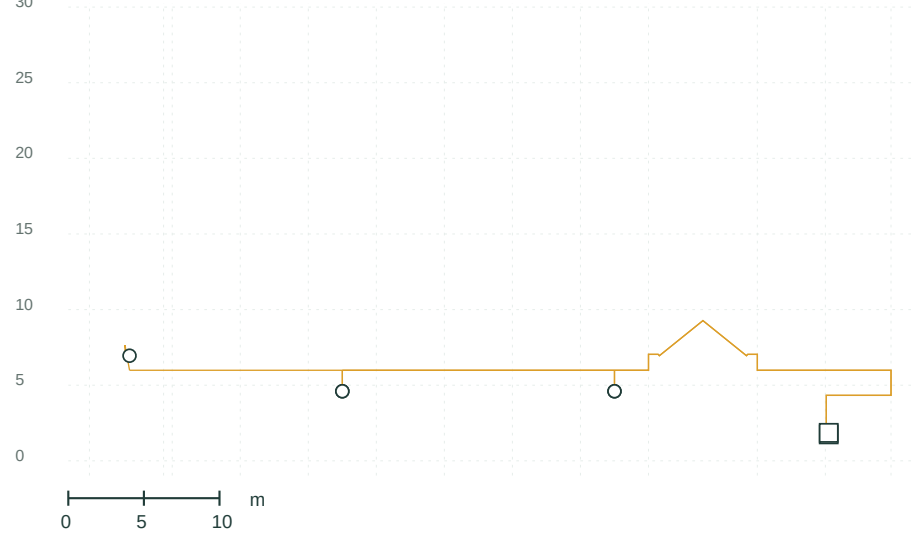

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Branch
L155	2.650	6.950	0.000	R191
L156	16.725	4.600	-7.245	R192
L157	16.725	4.600	7.245	R195
L158	34.725	4.600	-7.245	R193
L159	34.725	4.600	7.245	R196

Related enclosures

DB1	48.895	1.750	-1.550
LC1	48.895	1.850	-0.550

5 equipment / 8 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L6 / Facade & towers

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION



COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L160	-0.125	8.400	-10.853	R198
L161	-0.125	8.400	-10.153	R199
L162	-0.035	15.880	-10.153	R200
L163	0.065	23.200	-10.153	R201
L164	0.350	29.260	-10.153	R202
L165	2.450	23.200	-10.153	R203
L166	3.050	8.400	-12.738	R204
L167	2.450	8.400	-12.738	R205
L168	2.450	15.880	-12.613	R206
L169	2.450	23.200	-12.513	R207
L170	-0.075	8.400	-7.900	R208
L171	-0.125	8.400	10.853	R212
L172	-0.125	8.400	10.153	R213
L173	-0.035	15.880	10.153	R214
L174	0.065	23.200	10.153	R215
L175	0.350	29.260	10.153	R216
L176	2.450	23.200	10.153	R217
L177	3.050	8.400	12.738	R218
L178	2.450	8.400	12.738	R219
L179	2.450	15.880	12.613	R220
L180	2.450	23.200	12.513	R221
L181	-0.075	8.400	7.900	R222
L222	-0.075	8.400	-7.750	R209
L223	-0.035	15.880	-7.900	R210
L224	-0.075	8.400	7.750	R223
L225	-0.035	15.880	7.900	R224

Related enclosures

DB1	48.895	1.750	-1.550
DB2	2.730	1.500	-3.300

26 equipment / 29 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

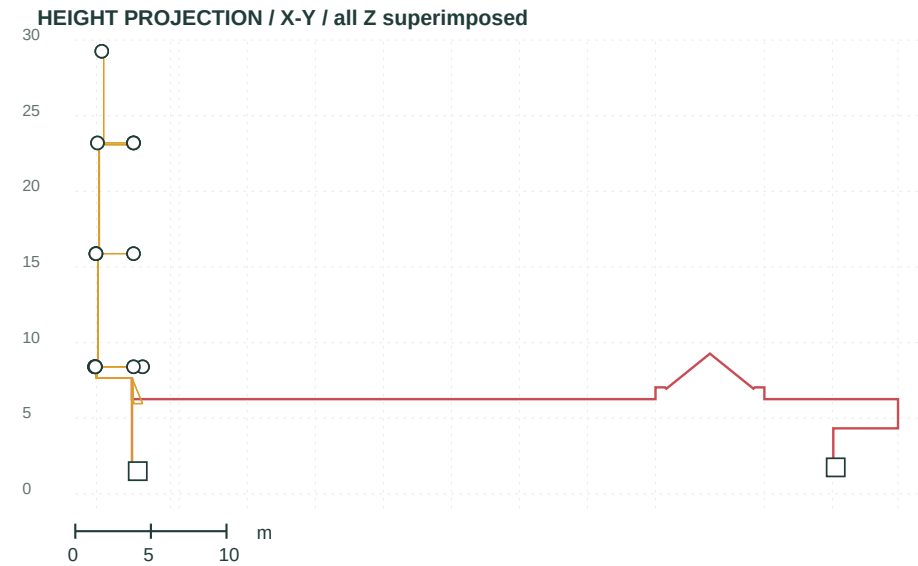


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

L7 / Festival exterior (strings & tower floods)

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

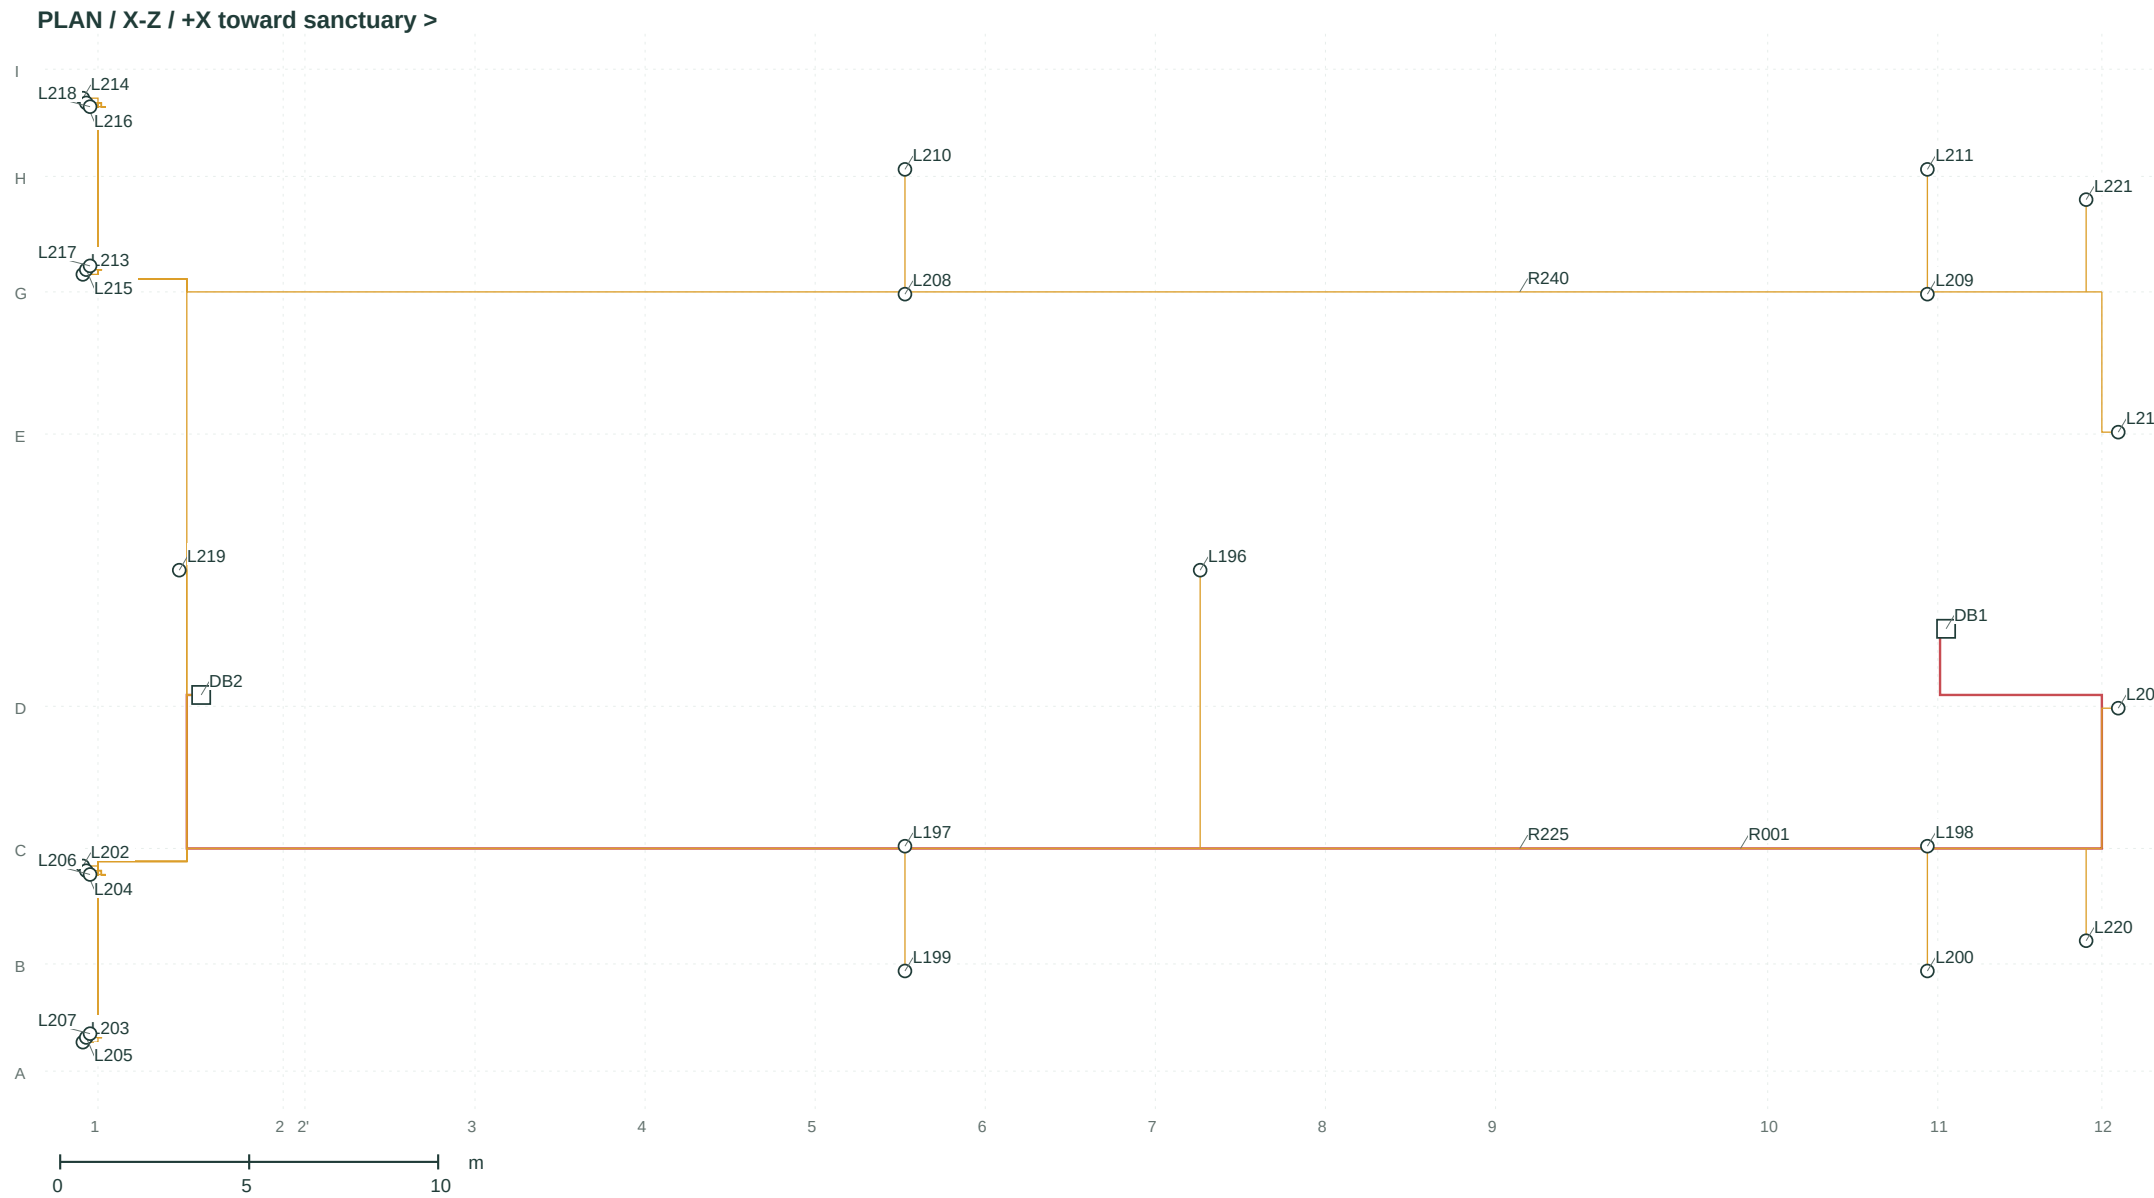

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
L196	29.160	12.690	0.000	R226
L197	21.350	7.320	-7.300	R227
L198	48.400	7.320	-7.300	R228
L199	21.350	6.470	-10.600	R229
L200	48.400	6.470	-10.600	R230
L201	53.450	10.000	-3.650	R231
L202	-0.400	4.195	-7.823	R232
L203	-0.400	4.195	-12.483	R233
L204	-0.310	12.115	-7.948	R234
L205	-0.310	12.115	-12.358	R235
L206	-0.210	19.490	-8.048	R236
L207	-0.210	19.490	-12.258	R237
L208	21.350	7.320	7.300	R241
L209	48.400	7.320	7.300	R242
L210	21.350	6.470	10.600	R243
L211	48.400	6.470	10.600	R244
L212	53.450	10.000	3.650	R245
L213	-0.400	4.195	7.823	R246
L214	-0.400	4.195	12.483	R247
L215	-0.310	12.115	7.948	R248
L216	-0.310	12.115	12.358	R249
L217	-0.210	19.490	8.048	R250
L218	-0.210	19.490	12.258	R251
L219	2.150	8.500	0.000	R238
L220	52.600	6.550	-9.800	R239
L221	52.600	6.550	9.800	R252

Related enclosures

DB1	48.895	1.750	-1.550
DB2	2.730	1.500	-3.300

26 equipment / 29 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

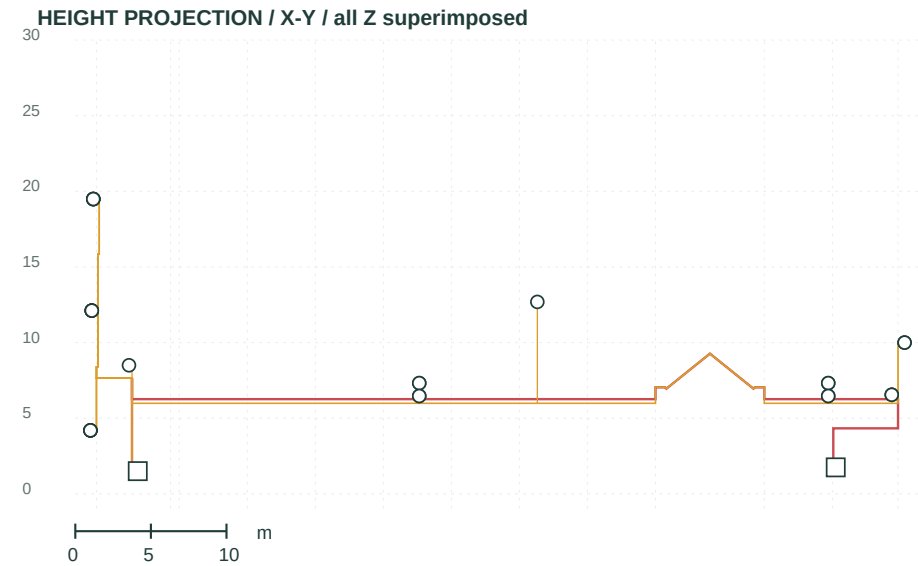

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F1 / Ceiling fans

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION



COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
F226	7.725	3.900	-4.400	R254
F227	7.725	3.900	4.400	R262
F228	12.225	3.900	-4.400	R255
F229	12.225	3.900	4.400	R263
F230	16.725	3.900	-4.400	R256
F231	16.725	3.900	4.400	R264
F232	21.225	3.900	-4.400	R257
F233	21.225	3.900	4.400	R265
F234	25.725	3.900	-4.400	R258
F235	25.725	3.900	4.400	R266
F236	30.225	3.900	-4.400	R259
F237	30.225	3.900	4.400	R267
F238	34.725	3.900	-4.400	R260
F239	34.725	3.900	4.400	R268

Related enclosures

DB1	48.895	1.750	-1.550
FC1	48.895	1.950	0.400

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

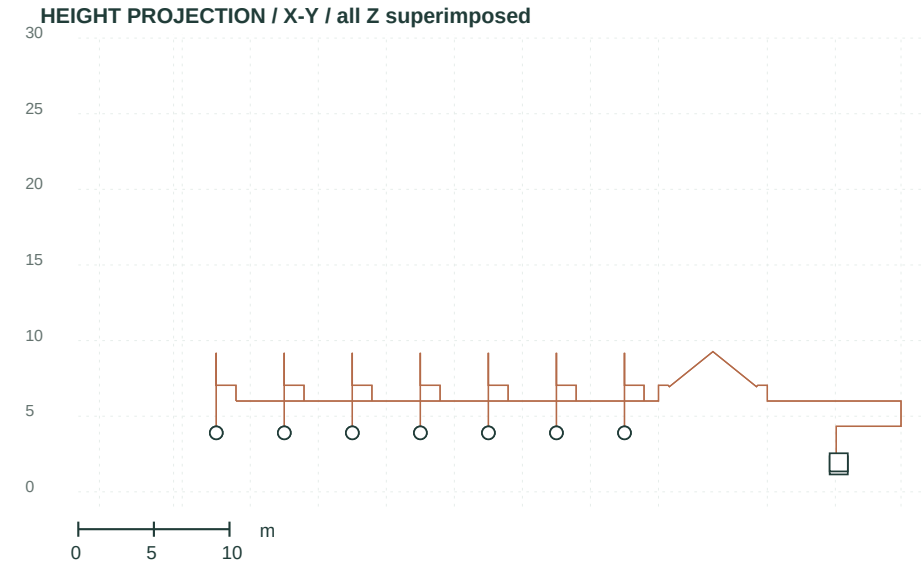


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F5 / Wing wall fans / held review

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

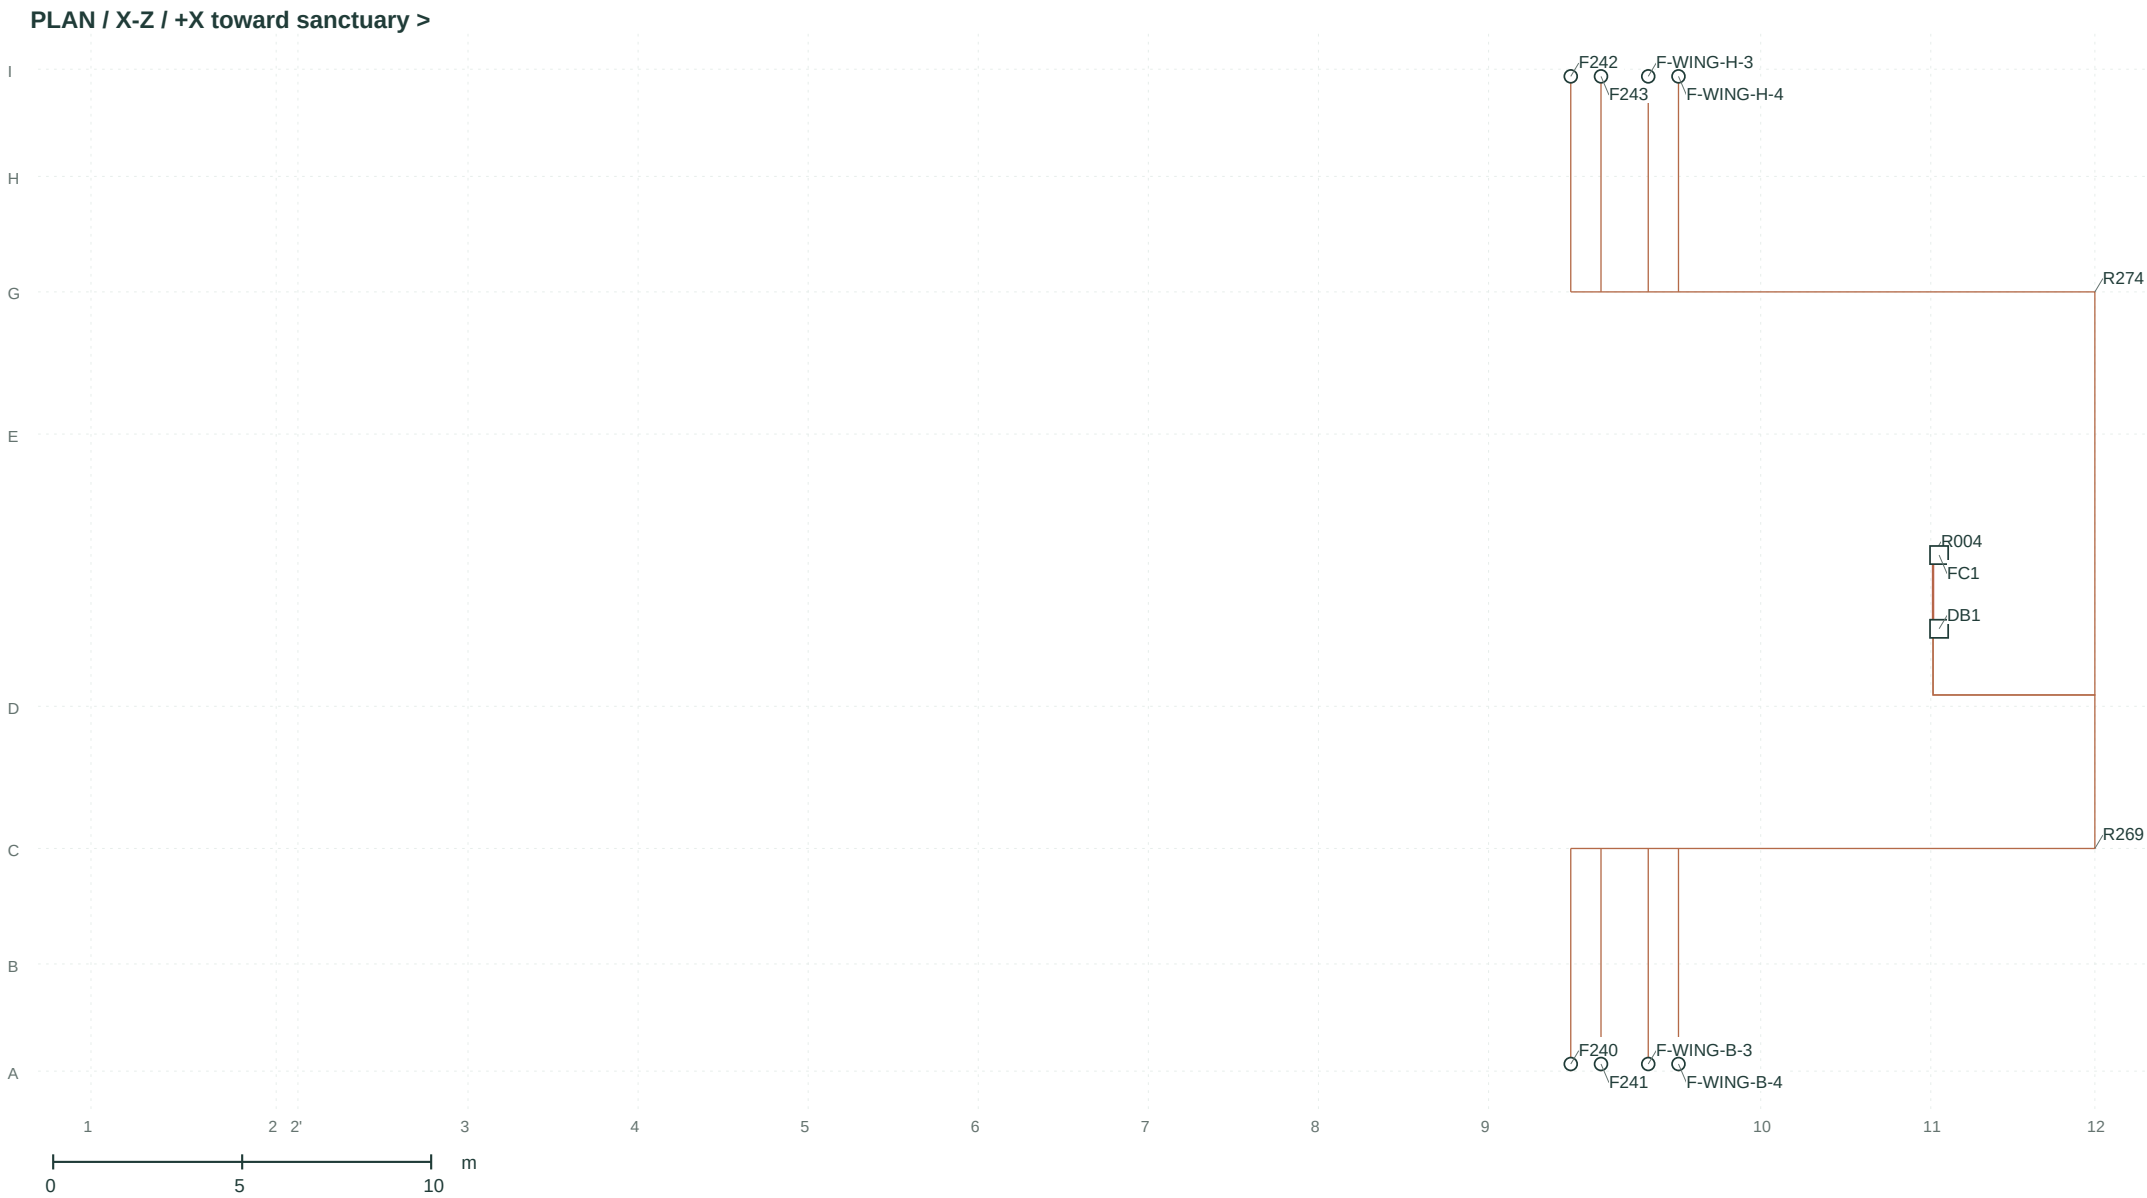

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
F240	39.150	3.500	-13.060	R270
F241	39.950	2.700	-13.060	R271
F242	39.150	3.500	13.060	R275
F243	39.950	2.700	13.060	R276
F-WING-B-3	41.200	2.700	-13.060	R272
F-WING-B-4	42.000	3.500	-13.060	R273
F-WING-H-3	41.200	2.700	13.060	R277
F-WING-H-4	42.000	3.500	13.060	R278

Related enclosures

DB1	48.895	1.750	-1.550
FC1	48.895	1.950	0.400

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

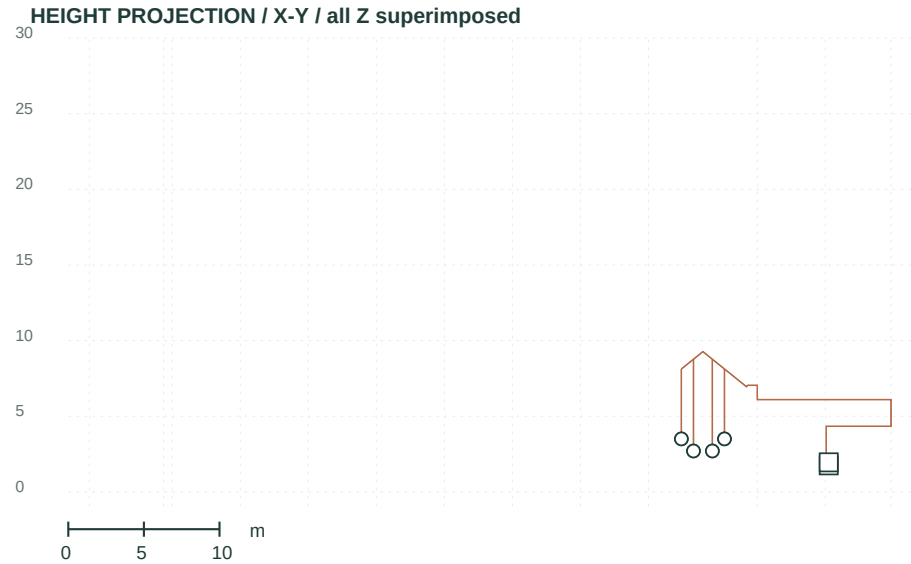


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F2 / Wall fans

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

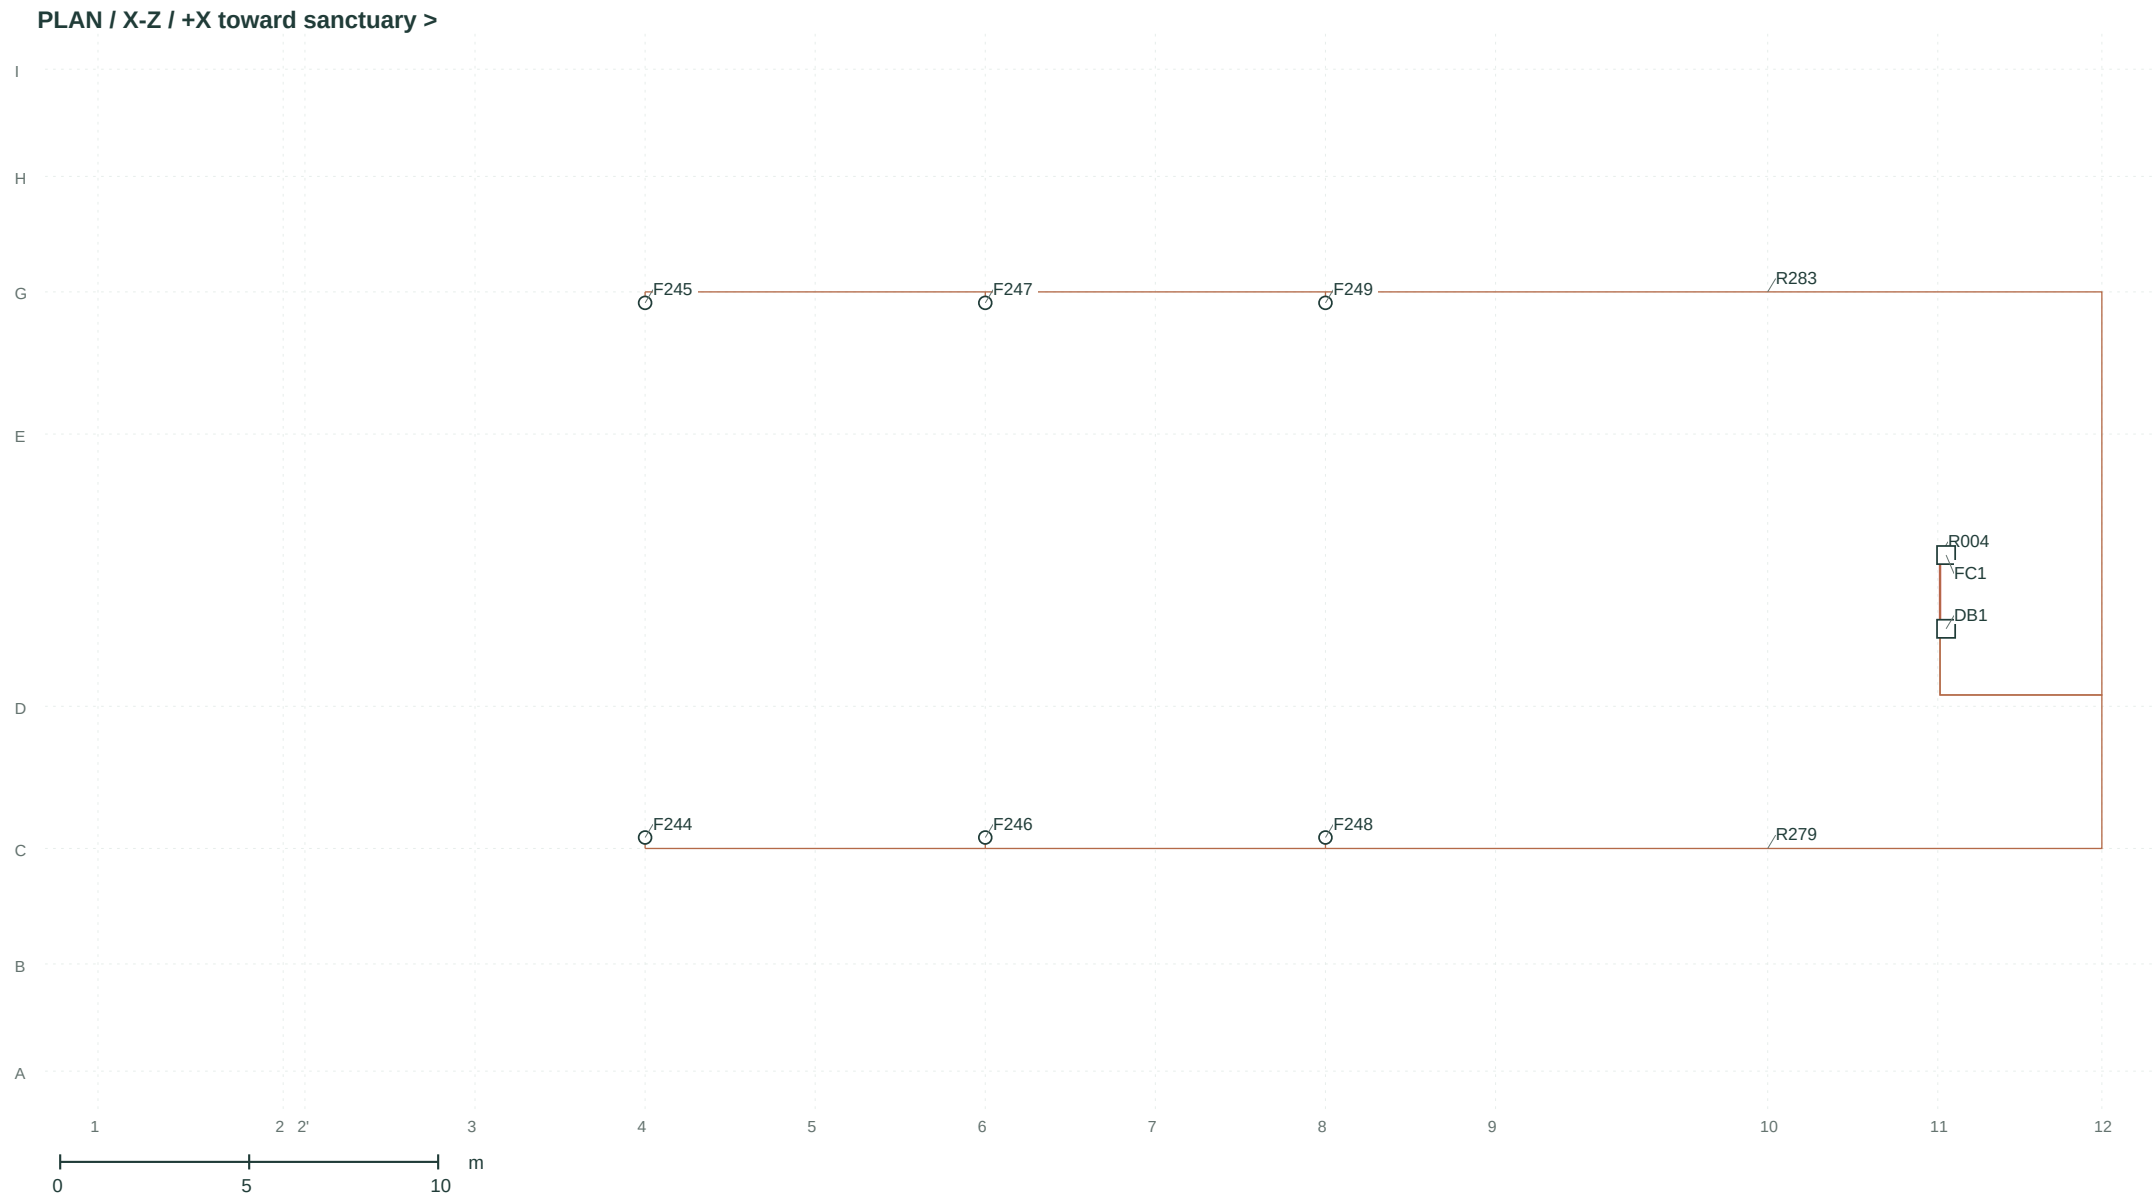

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
F244	14.475	5.550	-7.070	R280
F245	14.475	5.550	7.070	R284
F246	23.475	5.550	-7.070	R281
F247	23.475	5.550	7.070	R285
F248	32.475	5.550	-7.070	R282
F249	32.475	5.550	7.070	R286

Related enclosures

DB1	48.895	1.750	-1.550
FC1	48.895	1.950	0.400

6 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

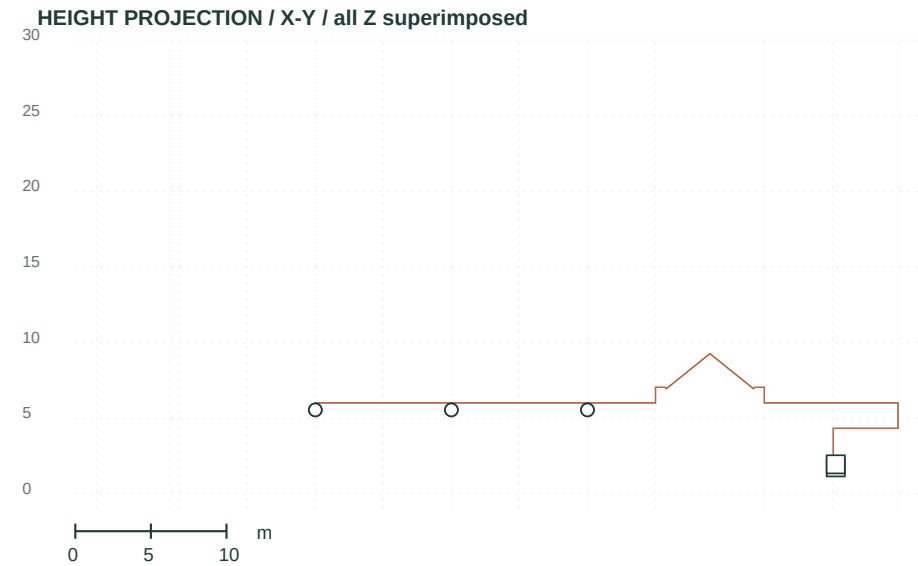

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

F4 / Entrance circulators (trial)

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION



COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
F250	2.655	6.000	-3.050	R288
F251	2.655	6.000	3.050	R290

Related enclosures

DB1	48.895	1.750	-1.550
DB2	2.730	1.500	-3.300

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

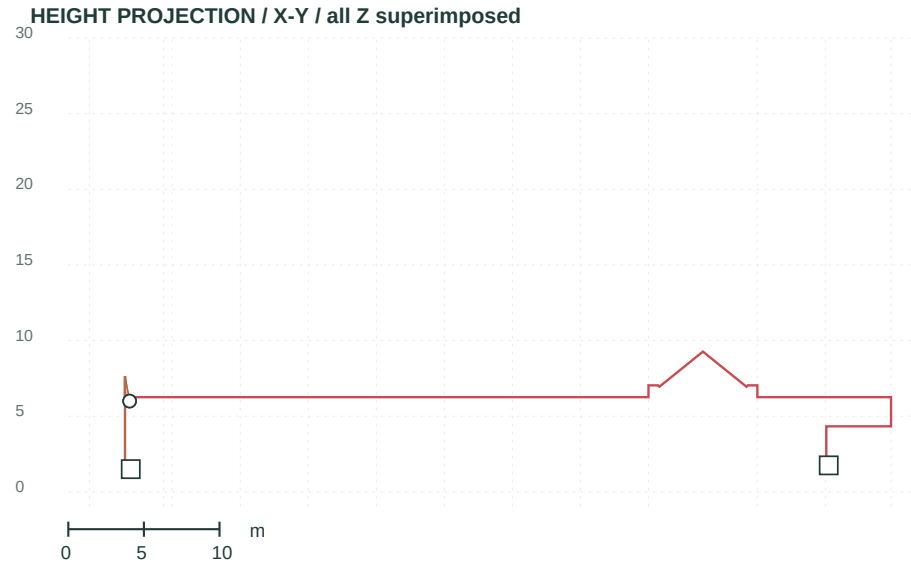


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

V1 / Exhaust ventilation

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

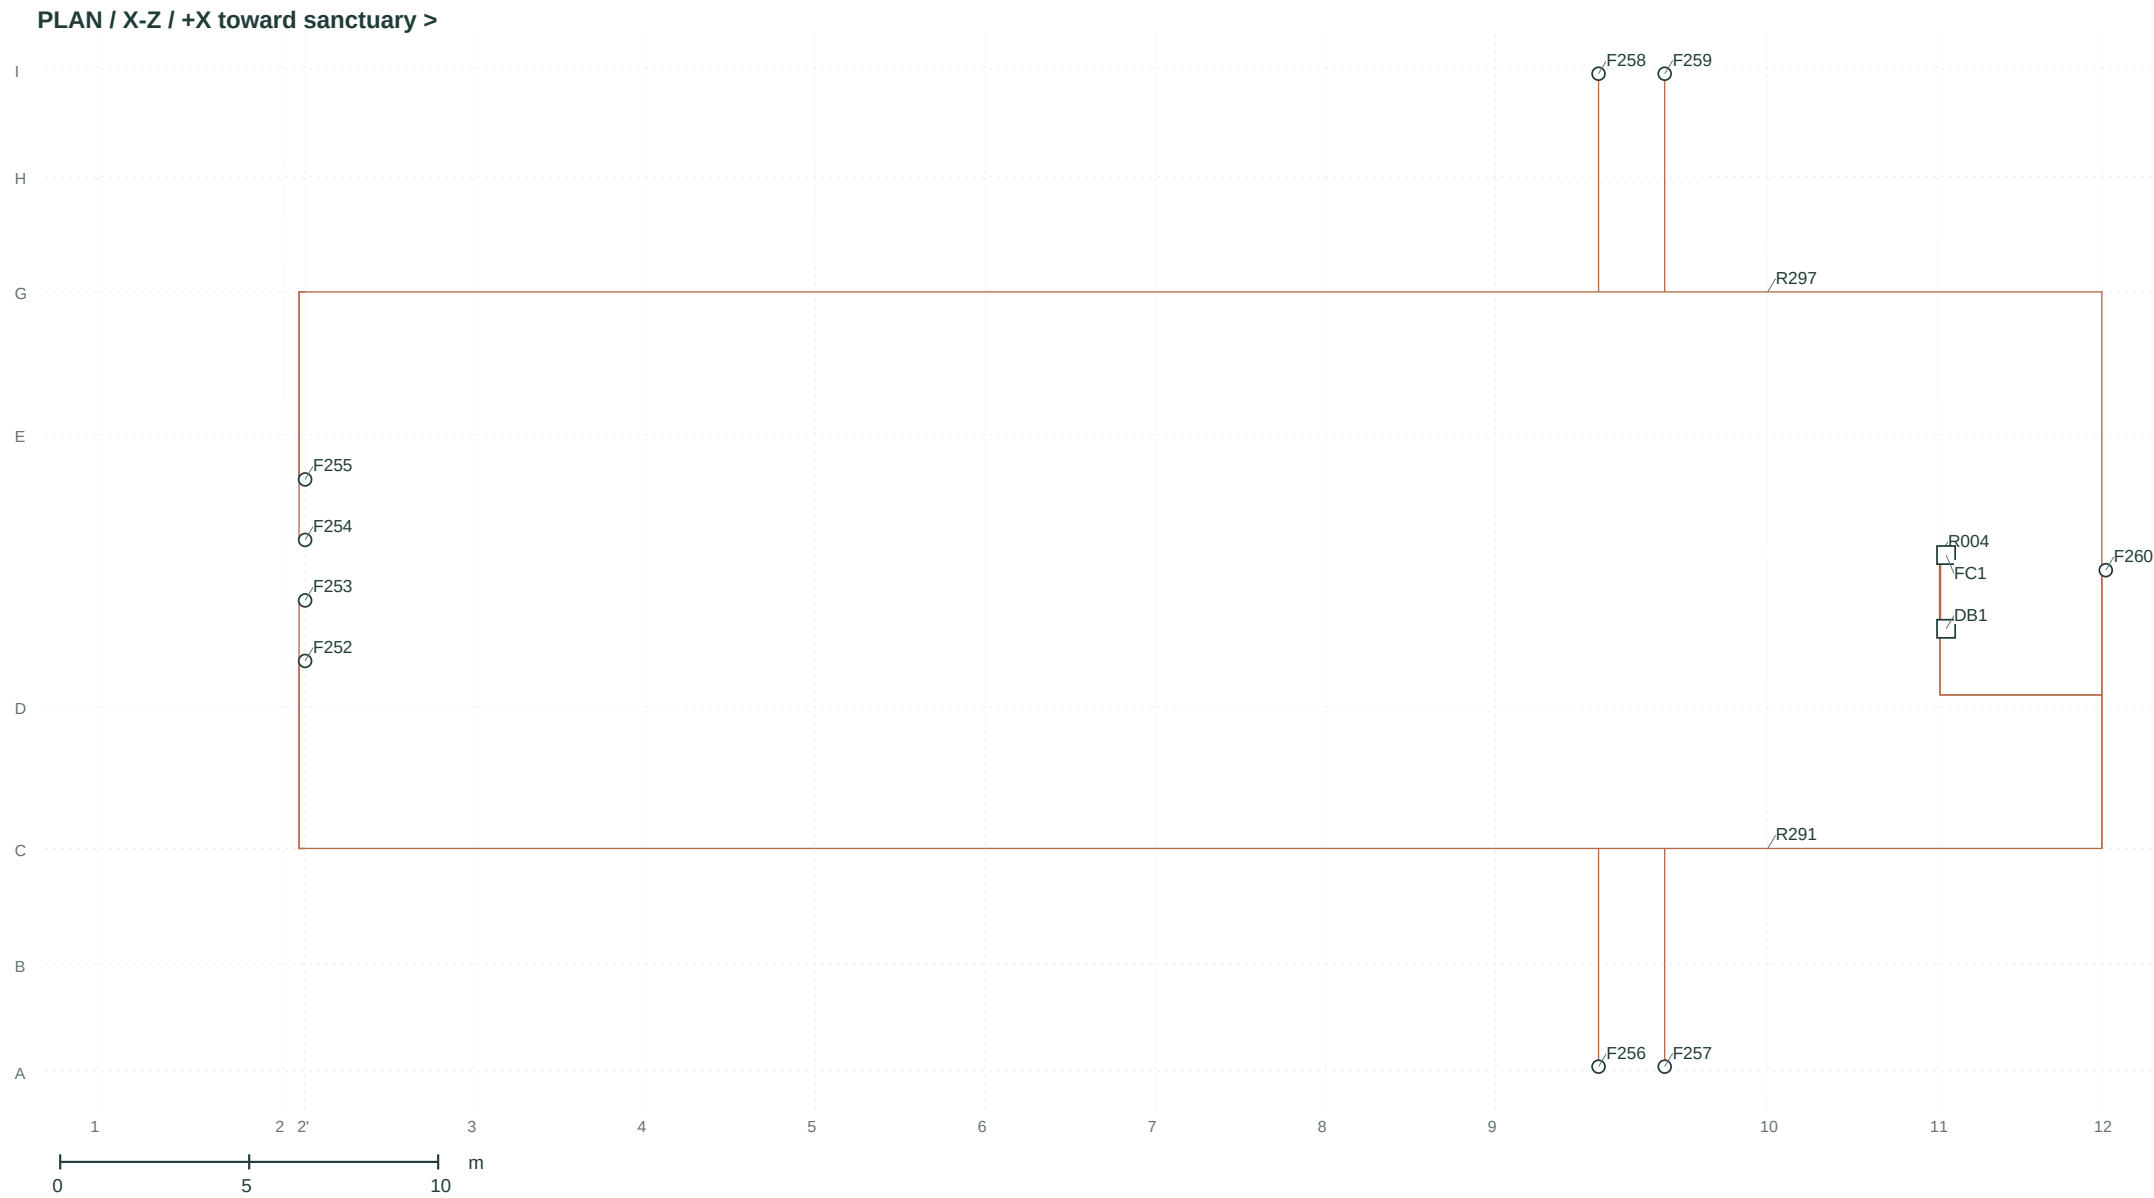

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
F252	5.480	9.400	-2.400	R292
F253	5.480	9.400	-0.800	R293
F254	5.480	9.400	0.800	R298
F255	5.480	9.400	2.400	R299
F256	39.700	7.600	-13.130	R294
F257	41.450	7.600	-13.130	R295
F258	39.700	7.600	13.130	R300
F259	41.450	7.600	13.130	R301
F260	53.120	3.300	0.000	R296

Related enclosures

DB1	48.895	1.750	-1.550
FC1	48.895	1.950	0.400

9 equipment / 12 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

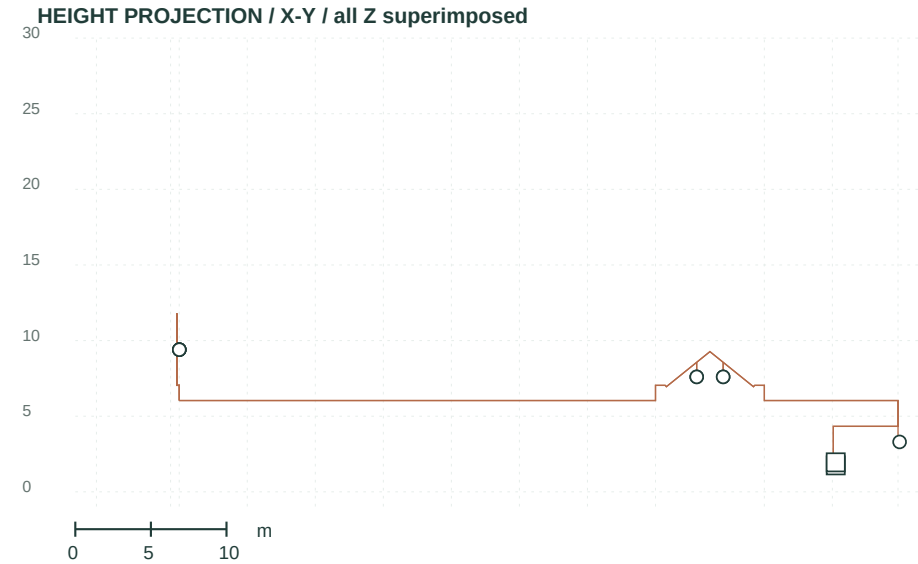



PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

A1 / Main & delay loudspeakers

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

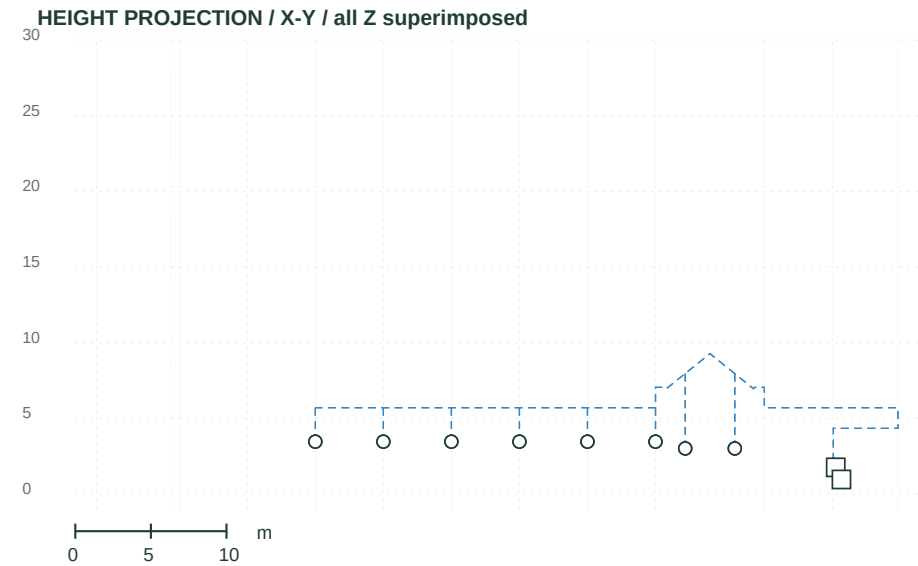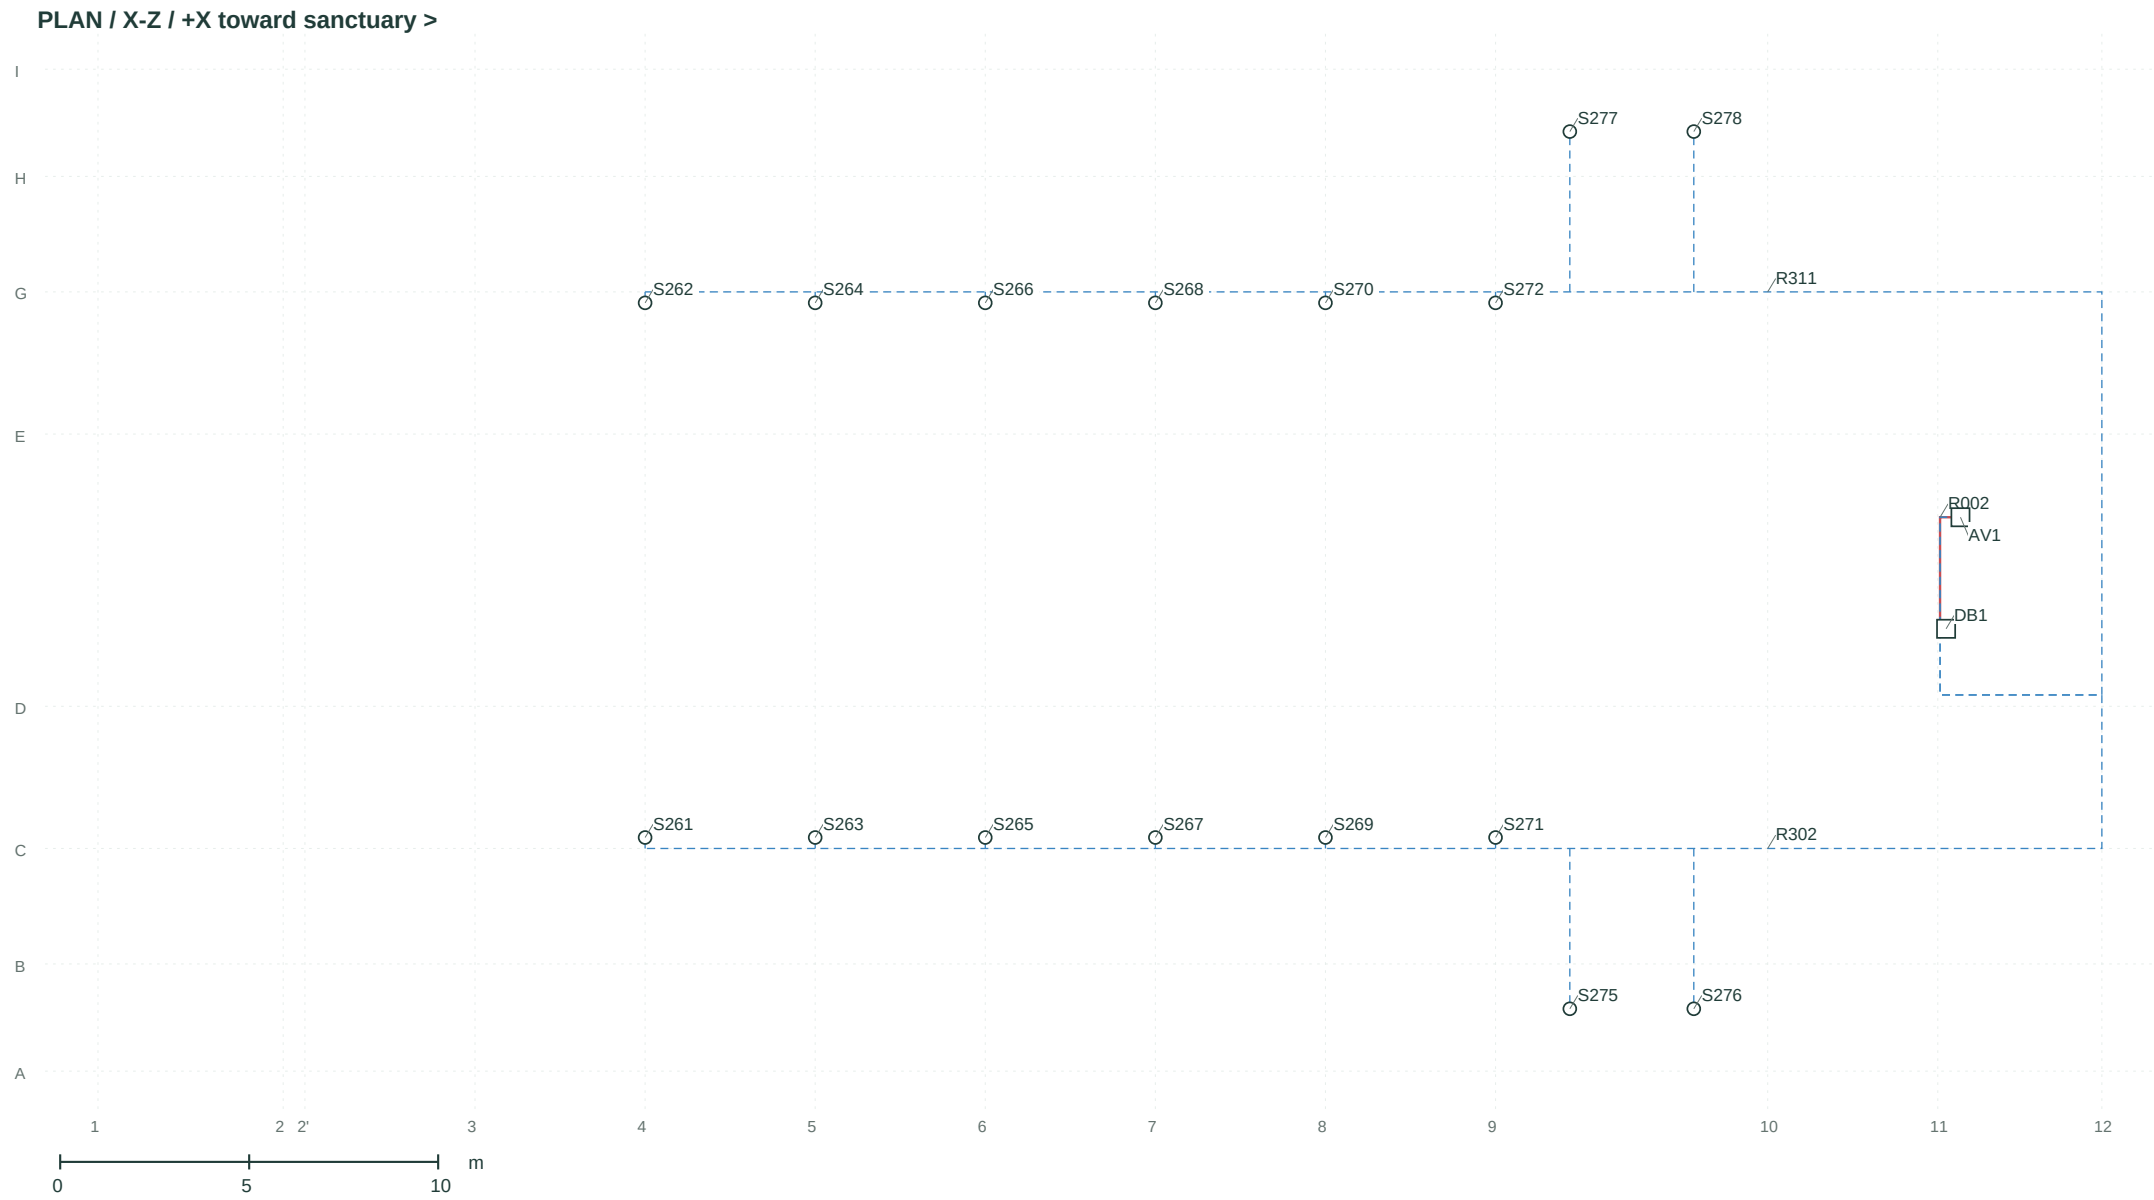

COORDINATES / X, Y, Z (m)				
ID	X	Y	Z	Branch
S261	14.475	3.450	-7.070	R303
S262	14.475	3.450	7.070	R312
S263	18.975	3.450	-7.070	R304
S264	18.975	3.450	7.070	R313
S265	23.475	3.450	-7.070	R305
S266	23.475	3.450	7.070	R314
S267	27.975	3.450	-7.070	R306
S268	27.975	3.450	7.070	R315
S269	32.475	3.450	-7.070	R307
S270	32.475	3.450	7.070	R316
S271	36.975	3.450	-7.070	R308
S272	36.975	3.450	7.070	R317
S275	38.940	3.000	-11.600	R309
S276	42.220	3.000	-11.600	R310
S277	38.940	3.000	11.600	R318
S278	42.220	3.000	11.600	R319

Related enclosures			
DB1	48.895	1.750	-1.550
AV1	49.275	0.950	1.400

16 equipment / 19 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.



PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

A5 / Rear fill (crowded feasts)

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

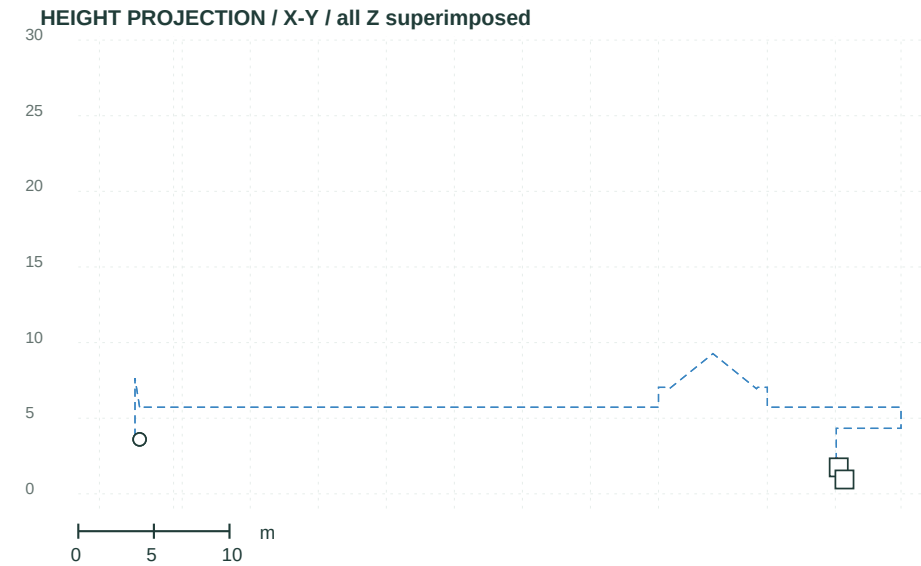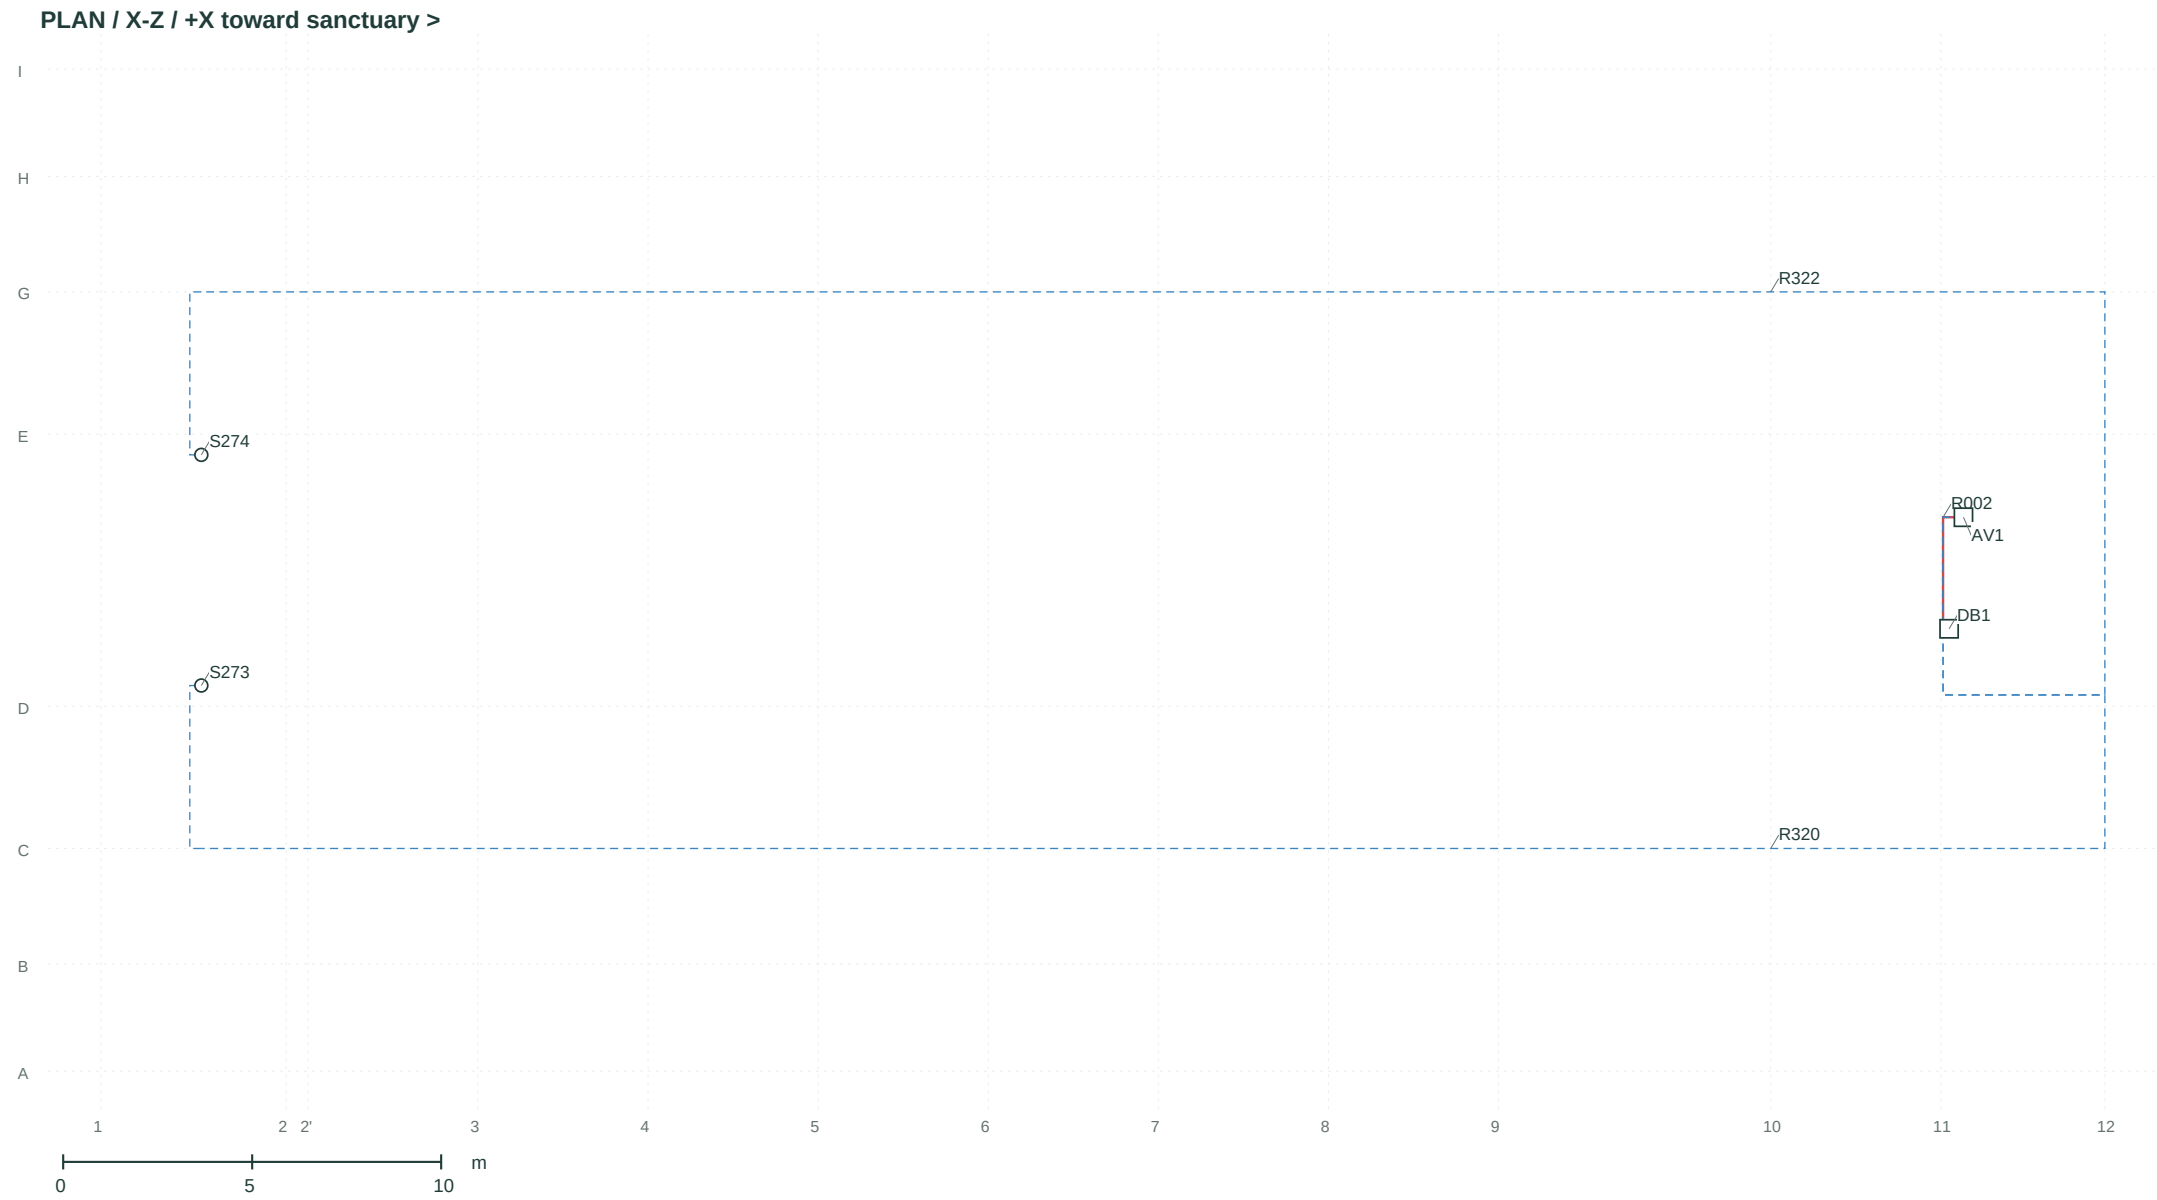

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Branch
S273	2.655	3.600	-3.050	R321
S274	2.655	3.600	3.050	R323

Related enclosures

DB1	48.895	1.750	-1.550
AV1	49.275	0.950	1.400

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.


PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

A2 / Veranda fill

Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

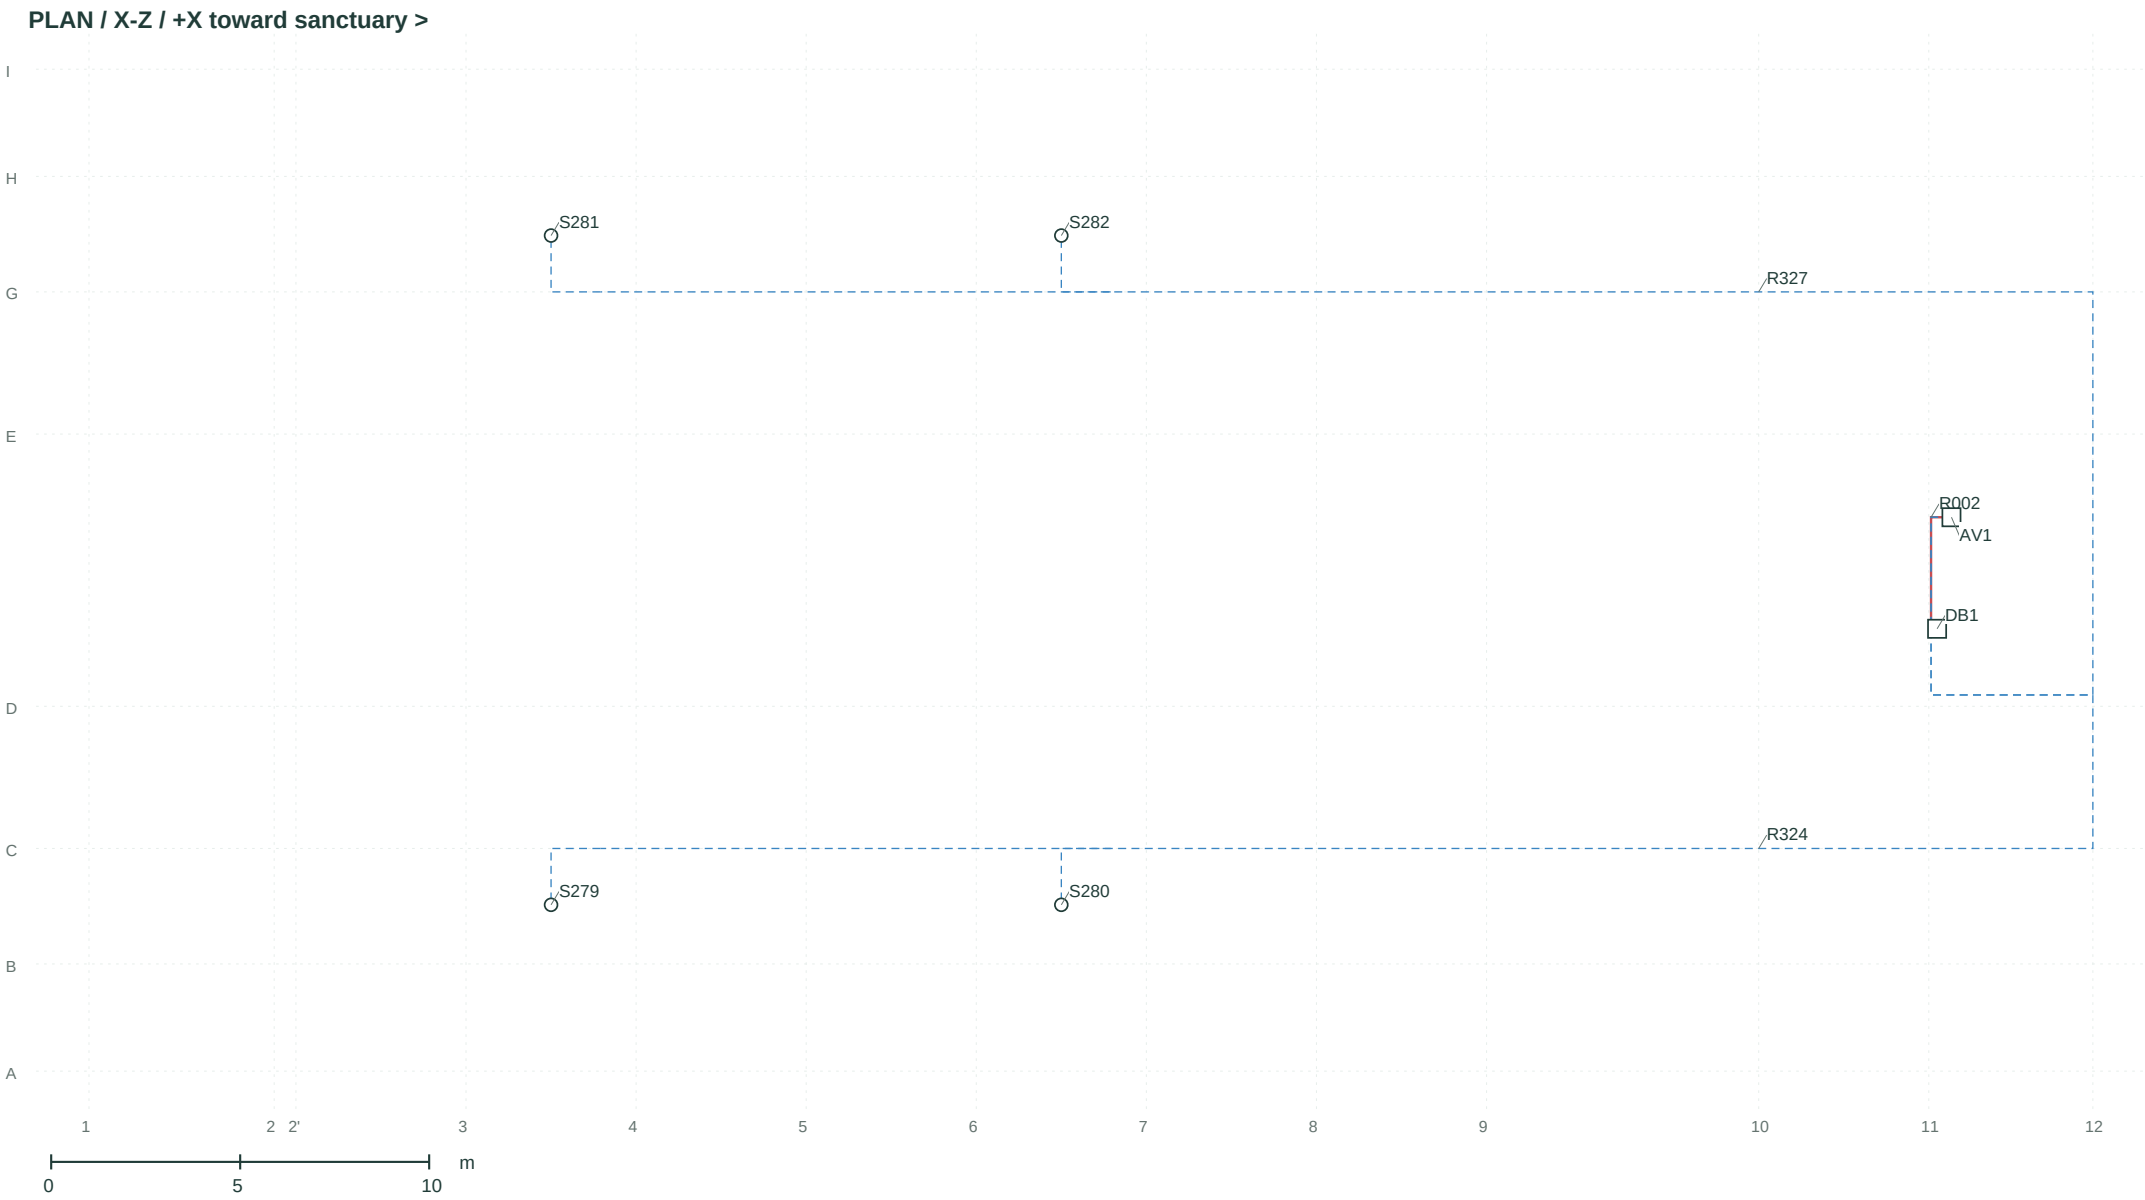

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
S279	12.225	3.900	-8.850	R325
S280	25.725	3.900	-8.850	R326
S281	12.225	3.900	8.850	R328
S282	25.725	3.900	8.850	R329

Related enclosures

DB1	48.895	1.750	-1.550
AV1	49.275	0.950	1.400


4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

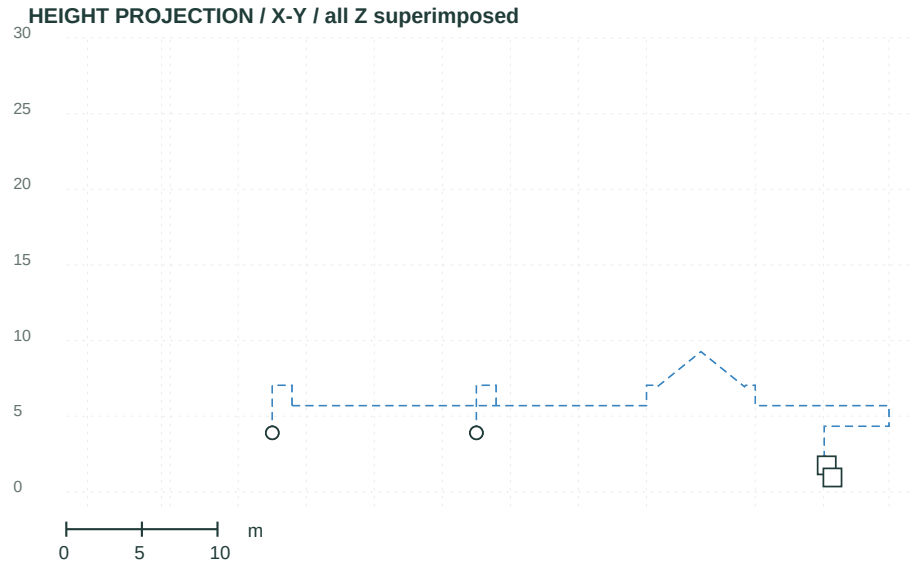

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

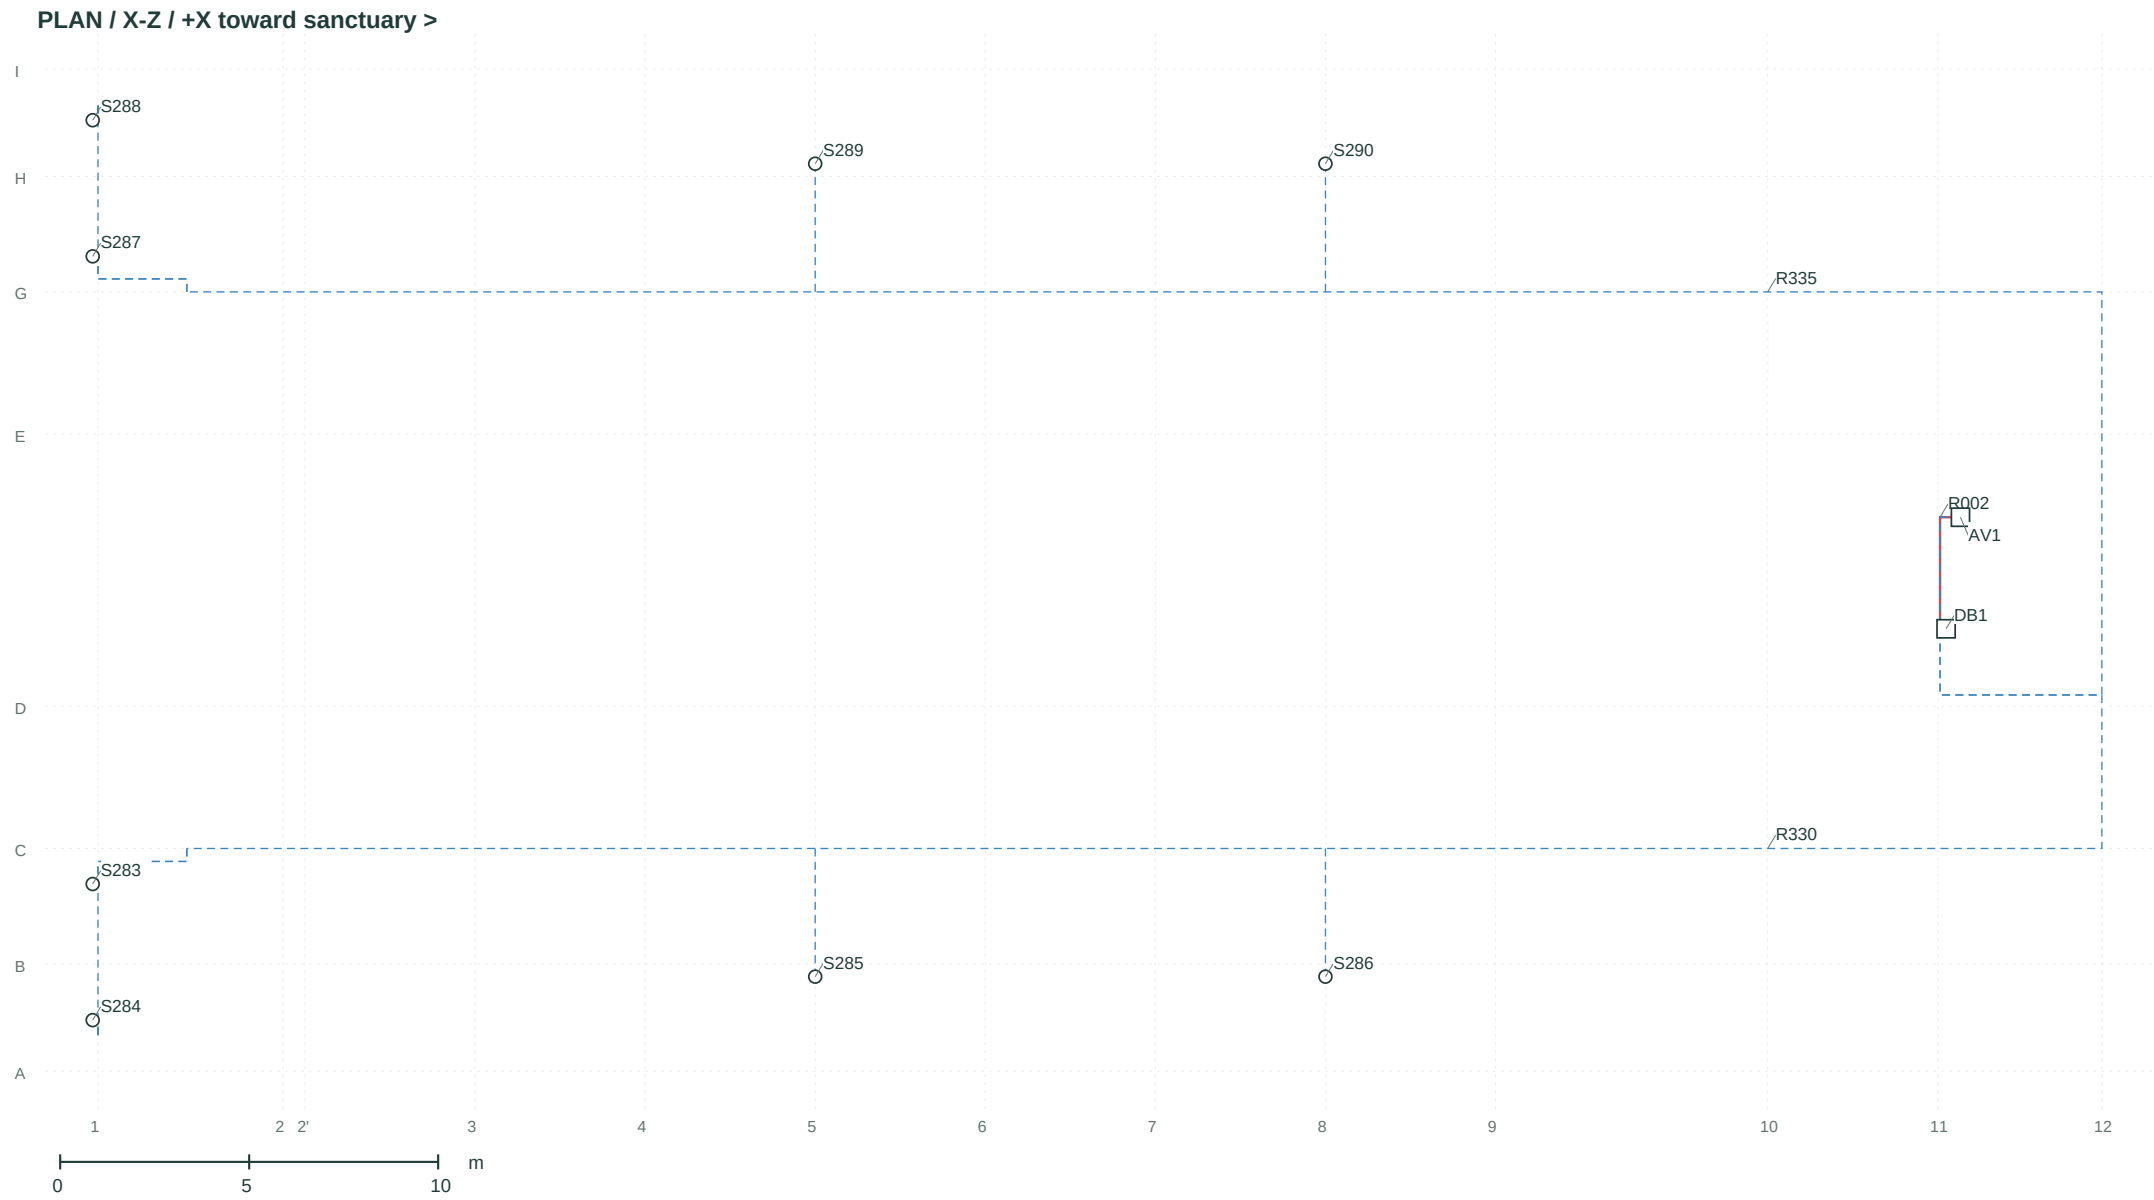

COORDINATES / X, Y, Z (m)


ID	X	Y	Z	Branch
S283	-0.140	6.200	-8.300	R331
S284	-0.140	6.200	-11.900	R332
S285	18.975	5.600	-10.750	R333
S286	32.475	5.600	-10.750	R334
S287	-0.140	6.200	8.300	R336
S288	-0.140	6.200	11.900	R337
S289	18.975	5.600	10.750	R338
S290	32.475	5.600	10.750	R339

Related enclosures

DB1	48.895	1.750	-1.550
AV1	49.275	0.950	1.400

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

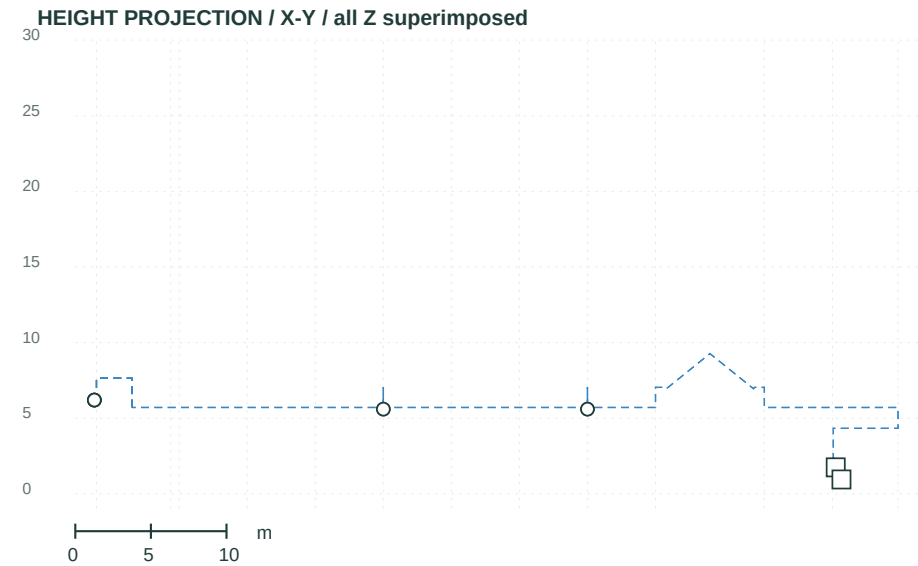

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Microphones


Top plan 1:200 / longitudinal height projection 1:500 at A3 / metres

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

PLAN / X-Z / +X toward sanctuary >



HEIGHT PROJECTION / X-Y / all Z superimposed

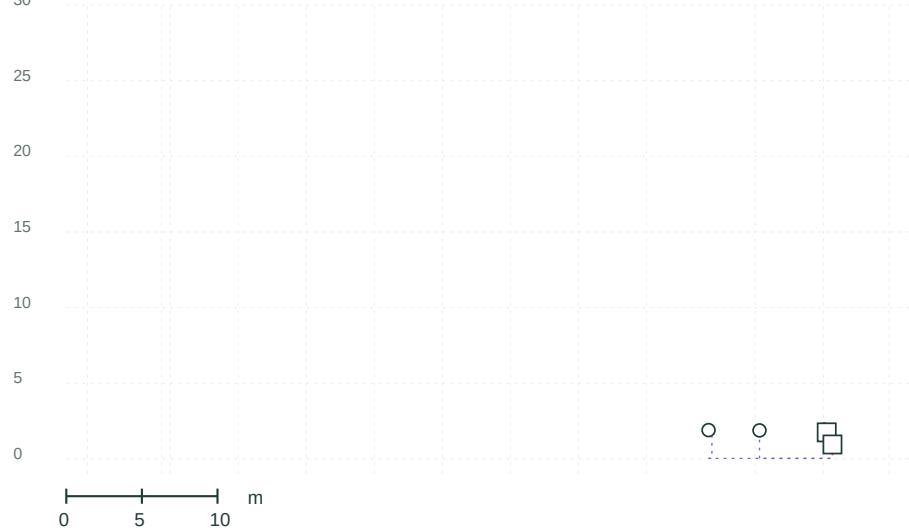

COORDINATES / X, Y, Z (m)

ID	X	Y	Z	Branch
S291	41.080	1.900	-2.620	R341
S292	44.450	1.880	0.450	R343

Related enclosures

DB1	48.895	1.750	-1.550
AV1	49.275	0.950	1.400

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: model grid only. Building outlines, support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L1	L3	DB1	Service-room LED panel / 600 x 600 mm	Service-room ceiling panel / 50.0 m
L2	L3	DB1	Service-room LED panel / 600 x 600 mm	Service-room ceiling panel / 51.9 m
L3	L1	DB1	LED projector / medium 36	Reading light / axis 3 / B central
L4	L1	DB1	LED projector / medium 36	Reading light / axis 3 / B central / twin
L5	L1	DB1	LED projector / medium 36	Reading light / axis 3 / H central
L6	L1	DB1	LED projector / medium 36	Reading light / axis 3 / H central / twin
L7	L1	DB1	LED projector / medium 36	Reading light / axis 4 / B central
L8	L1	DB1	LED projector / medium 36	Reading light / axis 4 / B central / twin
L9	L1	DB1	LED projector / medium 36	Reading light / axis 4 / H central
L10	L1	DB1	LED projector / medium 36	Reading light / axis 4 / H central / twin
L11	L1	DB1	LED projector / medium 36	Reading light / axis 5 / B central
L12	L1	DB1	LED projector / medium 36	Reading light / axis 5 / B central / twin
L13	L1	DB1	LED projector / medium 36	Reading light / axis 5 / H central
L14	L1	DB1	LED projector / medium 36	Reading light / axis 5 / H central / twin
L15	L1	DB1	LED projector / medium 36	Reading light / axis 6 / B central
L16	L1	DB1	LED projector / medium 36	Reading light / axis 6 / B central / twin
L17	L1	DB1	LED projector / medium 36	Reading light / axis 6 / H central
L18	L1	DB1	LED projector / medium 36	Reading light / axis 6 / H central / twin
L19	L1	DB1	LED projector / medium 36	Reading light / axis 7 / B central
L20	L1	DB1	LED projector / medium 36	Reading light / axis 7 / B central / twin
L21	L1	DB1	LED projector / medium 36	Reading light / axis 7 / H central
L22	L1	DB1	LED projector / medium 36	Reading light / axis 7 / H central / twin
L23	L1	DB1	LED projector / medium 36	Reading light / axis 8 / B central
L24	L1	DB1	LED projector / medium 36	Reading light / axis 8 / B central / twin
L25	L1	DB1	LED projector / medium 36	Reading light / axis 8 / H central
L26	L1	DB1	LED projector / medium 36	Reading light / axis 8 / H central / twin
L27	L1	DB1	LED projector / medium 36	Reading light / axis 9 / B central
L28	L1	DB1	LED projector / medium 36	Reading light / axis 9 / B central / twin
L29	L1	DB1	LED projector / medium 36	Reading light / axis 9 / H central
L30	L1	DB1	LED projector / medium 36	Reading light / axis 9 / H central / twin
L31	L2	DB1	LED projector / medium 36	Reading light / axis 3 / B outer
L32	L2	DB1	LED projector / medium 36	Reading light / axis 3 / B outer / twin
L33	L2	DB1	LED projector / medium 36	Reading light / axis 3 / H outer
L34	L2	DB1	LED projector / medium 36	Reading light / axis 3 / H outer / twin
L35	L2	DB1	LED projector / medium 36	Reading light / axis 4 / B outer
L36	L2	DB1	LED projector / medium 36	Reading light / axis 4 / B outer / twin
L37	L2	DB1	LED projector / medium 36	Reading light / axis 4 / H outer
L38	L2	DB1	LED projector / medium 36	Reading light / axis 4 / H outer / twin
L39	L2	DB1	LED projector / medium 36	Reading light / axis 5 / B outer

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L40	L2	DB1	LED projector / medium 36	Reading light / axis 5 / B outer / twin
L41	L2	DB1	LED projector / medium 36	Reading light / axis 5 / H outer
L42	L2	DB1	LED projector / medium 36	Reading light / axis 5 / H outer / twin
L43	L2	DB1	LED projector / medium 36	Reading light / axis 6 / B outer
L44	L2	DB1	LED projector / medium 36	Reading light / axis 6 / B outer / twin
L45	L2	DB1	LED projector / medium 36	Reading light / axis 6 / H outer
L46	L2	DB1	LED projector / medium 36	Reading light / axis 6 / H outer / twin
L47	L2	DB1	LED projector / medium 36	Reading light / axis 7 / B outer
L48	L2	DB1	LED projector / medium 36	Reading light / axis 7 / B outer / twin
L49	L2	DB1	LED projector / medium 36	Reading light / axis 7 / H outer
L50	L2	DB1	LED projector / medium 36	Reading light / axis 7 / H outer / twin
L51	L2	DB1	LED projector / medium 36	Reading light / axis 8 / B outer
L52	L2	DB1	LED projector / medium 36	Reading light / axis 8 / B outer / twin
L53	L2	DB1	LED projector / medium 36	Reading light / axis 8 / H outer
L54	L2	DB1	LED projector / medium 36	Reading light / axis 8 / H outer / twin
L55	L2	DB1	LED projector / medium 36	Reading light / axis 9 / B outer
L56	L2	DB1	LED projector / medium 36	Reading light / axis 9 / B outer / twin
L57	L2	DB1	LED projector / medium 36	Reading light / axis 9 / H outer
L58	L2	DB1	LED projector / medium 36	Reading light / axis 9 / H outer / twin
L59	L1	DB1	LED projector / medium 36	Rear rows light / entrance facade / B
L60	L1	DB1	LED projector / medium 36	Rear centre light / entrance facade / B
L61	L1	DB1	LED projector / medium 36	Rear rows light / entrance facade / H
L62	L1	DB1	LED projector / medium 36	Rear centre light / entrance facade / H
L63	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / B / front block / back rows
L64	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / B / front block / front rows
L65	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / B / rear block / back rows
L66	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / B / rear block / front rows
L67	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / H / front block / back rows
L68	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / H / front block / front rows
L69	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / H / rear block / back rows
L70	L8	DB1	Small brass chandelier + reading optic / concept	Wing light / H / rear block / front rows
L71	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 3
L72	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 4
L73	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 5
L74	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 6
L75	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 7
L76	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 8
L77	LA	DB1	Roof uplight / wide flood	Roof uplight / axis 9
L78	LD	DB1	Brass candle chandelier / 8 lamps	Chandelier / bay 4-5

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L79	LD	DB1	Brass candle chandelier / 8 lamps	Chandelier / bay 6-7
L80	LD	DB1	Brass candle chandelier / 8 lamps	Chandelier / bay 8-9
L81	LD	DB1	Grand chandelier / 12 lamps	Grand chandelier / crossing 9-10
L82	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 3 / B
L83	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 3 / H
L84	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 4 / B
L85	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 4 / H
L86	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 5 / B
L87	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 5 / H
L88	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 6 / B
L89	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 6 / H
L90	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 7 / B
L91	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 7 / H
L92	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 8 / B
L93	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 8 / H
L94	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 9 / B
L95	LD	DB1	Brass candle sconce / 2 lamps	Sconce / axis 9 / H
L96	LD	DB1	Brass candle sconce / 2 lamps	Sconce / sanctuary pier / B
L97	LD	DB1	Brass candle sconce / 2 lamps	Sconce / sanctuary pier / H
L98	L3	DB1	LED projector / narrow 24	Altar key light / B
L99	L3	DB1	LED projector / narrow 24	Altar key light / H
L100	L3	DB1	Accent spotlight / 15	Ambo key light
L101	L3	DB1	LED projector / medium 36	Sanctuary step fill / B
L102	L3	DB1	LED projector / medium 36	Sanctuary step fill / H
L103	L3	DB1	Accent spotlight / 15	Presider chair light
L104	L3	DB1	LED projector / medium 36	Sanctuary frame wash / B
L105	L3	DB1	LED projector / medium 36	Sanctuary frame wash / H
L106	L3	DB1	Accent spotlight / 15	Crucifix accent / B
L107	L3	DB1	LED projector / medium 36	Reredos wash / B
L108	L3	DB1	LED projector / medium 36	Reredos base wash / B
L109	L3	DB1	Roof uplight / wide flood	Sanctuary vault uplight / B
L110	L3	DB1	Accent spotlight / 15	Crucifix accent / H
L111	L3	DB1	LED projector / medium 36	Reredos wash / H
L112	L3	DB1	LED projector / medium 36	Reredos base wash / H
L113	L3	DB1	Roof uplight / wide flood	Sanctuary vault uplight / H
L114	L3	DB1	Accent spotlight / 15	Tabernacle accent
L115	L3	DB1	Accent spotlight / 15	Statue accent / B
L116	L3	DB1	LED projector / medium 36	Shrine wash / B
L117	L3	DB1	Accent spotlight / 15	Statue accent / H

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L118	L3	DB1	LED projector / medium 36	Shrine wash / H
L119	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 3
L120	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 4
L121	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 5
L122	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 6
L123	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 7
L124	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 8
L125	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 9
L126	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 10
L127	L4	DB1	Pendant lantern / opal	Veranda lantern / B / axis 11
L128	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 3
L129	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 4
L130	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 5
L131	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 6
L132	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 7
L133	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 8
L134	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 9
L135	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 10
L136	L4	DB1	Pendant lantern / opal	Veranda lantern / H / axis 11
L137	L9	DB2	Wall lantern	Central front door lantern / B
L138	L9	DB2	Wall lantern	Central front door lantern / H
L139	L5	DB1	Wall lantern	Side door lantern / B / 16.725 / front
L140	L5	DB1	Wall lantern	Side door lantern / B / 16.725 / rear
L141	L5	DB1	Wall lantern	Side door lantern / B / 34.725 / front
L142	L5	DB1	Wall lantern	Side door lantern / B / 34.725 / rear
L143	L5	DB1	Wall lantern	Side door lantern / B / 46.425 / front
L144	L5	DB1	Wall lantern	Side door lantern / B / 46.425 / rear
L145	L5	DB1	Wall lantern	Side door lantern / H / 16.725 / front
L146	L5	DB1	Wall lantern	Side door lantern / H / 16.725 / rear
L147	L5	DB1	Wall lantern	Side door lantern / H / 34.725 / front
L148	L5	DB1	Wall lantern	Side door lantern / H / 34.725 / rear
L149	L5	DB1	Wall lantern	Side door lantern / H / 46.425 / front
L150	L5	DB1	Wall lantern	Side door lantern / H / 46.425 / rear
L151	L3	DB1	Wall lantern	Service door lantern / B / front
L152	L3	DB1	Wall lantern	Service door lantern / B / rear
L153	L3	DB1	Wall lantern	Service door lantern / H / front
L154	L3	DB1	Wall lantern	Service door lantern / H / rear
L155	E1	DB1	Exit sign (maintained)	Exit sign / main doors
L156	E1	DB1	Exit sign (maintained)	Exit sign / side door 16.7 / B

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L157	E1	DB1	Exit sign (maintained)	Exit sign / side door 16.7 / H
L158	E1	DB1	Exit sign (maintained)	Exit sign / side door 34.7 / B
L159	E1	DB1	Exit sign (maintained)	Exit sign / side door 34.7 / H
L160	L6	DB2	Tower floodlight / projecting arm	Tower lower front wash / B
L161	L6	DB2	Tower floodlight / projecting arm	Tower stage 2 flood / B
L162	L6	DB2	Tower floodlight / projecting arm	Tower stage 3 flood / B
L163	L6	DB2	Tower floodlight / projecting arm	Belfry front wash / B
L164	L6	DB2	Tower floodlight / projecting arm	Dome front wash / B
L165	L6	DB2	Roof uplight / wide flood	Belfry glow / B
L166	L6	DB2	Tower floodlight / projecting arm	Tower lower side wash / B
L167	L6	DB2	Tower floodlight / projecting arm	Tower stage 2 side wash / B
L168	L6	DB2	Tower floodlight / projecting arm	Tower stage 3 side wash / B
L169	L6	DB2	Tower floodlight / projecting arm	Belfry side wash / B
L170	L6	DB2	Facade floodlight	Facade wash / B
L171	L6	DB2	Tower floodlight / projecting arm	Tower lower front wash / H
L172	L6	DB2	Tower floodlight / projecting arm	Tower stage 2 flood / H
L173	L6	DB2	Tower floodlight / projecting arm	Tower stage 3 flood / H
L174	L6	DB2	Tower floodlight / projecting arm	Belfry front wash / H
L175	L6	DB2	Tower floodlight / projecting arm	Dome front wash / H
L176	L6	DB2	Roof uplight / wide flood	Belfry glow / H
L177	L6	DB2	Tower floodlight / projecting arm	Tower lower side wash / H
L178	L6	DB2	Tower floodlight / projecting arm	Tower stage 2 side wash / H
L179	L6	DB2	Tower floodlight / projecting arm	Tower stage 3 side wash / H
L180	L6	DB2	Tower floodlight / projecting arm	Belfry side wash / H
L181	L6	DB2	Facade floodlight	Facade wash / H
L182	L9	DB2	Facade floodlight	Stage flood / tower B / outer
L183	L9	DB2	Facade floodlight	Stage flood / tower B / inner
L184	L5	DB1	LED projector / medium 36	Path light / axis 4 / B
L185	L5	DB1	LED projector / medium 36	Path light / axis 6 / B
L186	L5	DB1	LED projector / medium 36	Path light / axis 11 / B
L187	L5	DB1	LED projector / medium 36	Path light / wing gable B
L188	L5	DB1	LED projector / medium 36	Path light / rear / B
L189	L9	DB2	Facade floodlight	Stage flood / tower H / inner
L190	L9	DB2	Facade floodlight	Stage flood / tower H / outer
L191	L5	DB1	LED projector / medium 36	Path light / axis 4 / H
L192	L5	DB1	LED projector / medium 36	Path light / axis 6 / H
L193	L5	DB1	LED projector / medium 36	Path light / axis 11 / H
L194	L5	DB1	LED projector / medium 36	Path light / wing gable H
L195	L5	DB1	LED projector / medium 36	Path light / rear / H

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
L196	L7	DB2	Festival bulb string (outdoor)	Festival lights / roof ridge
L197	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave B / nave
L198	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave B / sanctuary
L199	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave B / nave
L200	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave B / sanctuary
L201	L7	DB2	Festival bulb string (outdoor)	Festival lights / rear gable B
L202	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 1 / inner corner
L203	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 1 / outer corner
L204	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 2 / inner corner
L205	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 2 / outer corner
L206	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 3 / inner corner
L207	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower B / stage 3 / outer corner
L208	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave H / nave
L209	L7	DB2	Festival bulb string (outdoor)	Festival lights / main eave H / sanctuary
L210	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave H / nave
L211	L7	DB2	Festival bulb string (outdoor)	Festival lights / veranda eave H / sanctuary
L212	L7	DB2	Festival bulb string (outdoor)	Festival lights / rear gable H
L213	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 1 / inner corner
L214	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 1 / outer corner
L215	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 2 / inner corner
L216	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 2 / outer corner
L217	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 3 / inner corner
L218	L7	DB2	Festival bulb string (outdoor)	Festival lights / tower H / stage 3 / outer corner
L219	L7	DB2	Festival bulb string (outdoor)	Festival lights / front terrace between the towers
L220	L7	DB2	Facade floodlight	Festival flood / rear gable B
L221	L7	DB2	Facade floodlight	Festival flood / rear gable H
L222	L6	DB2	Facade floodlight	Central gable flood / B
L223	L6	DB2	Facade floodlight	Central crown wash / B
L224	L6	DB2	Facade floodlight	Central gable flood / H
L225	L6	DB2	Facade floodlight	Central crown wash / H
F226	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 2'-3 / B aisle
F227	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 2'-3 / H aisle
F228	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 3-4 / B aisle
F229	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 3-4 / H aisle
F230	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 4-5 / B aisle
F231	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 4-5 / H aisle
F232	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 5-6 / B aisle
F233	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 5-6 / H aisle
F234	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 6-7 / B aisle

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
F235	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 6-7 / H aisle
F236	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 7-8 / B aisle
F237	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 7-8 / H aisle
F238	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 8-9 / B aisle
F239	F1	DB1	Ceiling fan / 1.42 m (56")	Ceiling fan / bay 8-9 / H aisle
F240	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing B / 1 / held review
F241	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing B / 2 / held review
F242	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing H / 1 / held review
F243	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing H / 2 / held review
F244	F2	DB1	Wall fan / oscillating 45 cm	Wall fan / axis 4 / B
F245	F2	DB1	Wall fan / oscillating 45 cm	Wall fan / axis 4 / H
F246	F2	DB1	Wall fan / oscillating 45 cm	Wall fan / axis 6 / B
F247	F2	DB1	Wall fan / oscillating 45 cm	Wall fan / axis 6 / H
F248	F2	DB1	Wall fan / oscillating 45 cm	Wall fan / axis 8 / B
F249	F2	DB1	Wall fan / oscillating 45 cm	Wall fan / axis 8 / H
F250	F4	DB2	Large wall circulator / 90 cm	Entrance circulator / B
F251	F4	DB2	Large wall circulator / 90 cm	Entrance circulator / H
F252	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / B outer
F253	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / B inner
F254	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / H inner
F255	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / front gable / H outer
F256	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable B / front
F257	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable B / rear
F258	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable H / front
F259	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / wing gable H / rear
F260	V1	DB1	Exhaust (ventilation) fan / 50 cm	Exhaust fan / service room
S261	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 4 / B
S262	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 4 / H
S263	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 5 / B
S264	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 5 / H
S265	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 6 / B
S266	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 6 / H
S267	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 7 / B
S268	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 7 / H
S269	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 8 / B
S270	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 8 / H
S271	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 9 / B
S272	A1	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / axis 9 / H
S273	A5	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / entrance hall / B

Equipment naming schedule

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

ID	Circuit	Board	Provisional category	Model equipment name
S274	A5	DB1	Slim wall column / 0.6 m, wall colour	Wall speaker / entrance hall / H
S275	A1	DB1	Pendant loudspeaker / 6"	Wing speaker / B / front block
S276	A1	DB1	Pendant loudspeaker / 6"	Wing speaker / B / rear block
S277	A1	DB1	Pendant loudspeaker / 6"	Wing speaker / H / front block
S278	A1	DB1	Pendant loudspeaker / 6"	Wing speaker / H / rear block
S279	A2	DB1	Pendant loudspeaker / 6"	Veranda fill / B / 12.2
S280	A2	DB1	Pendant loudspeaker / 6"	Veranda fill / B / 25.7
S281	A2	DB1	Pendant loudspeaker / 6"	Veranda fill / H / 12.2
S282	A2	DB1	Pendant loudspeaker / 6"	Veranda fill / H / 25.7
S283	A3	DB1	Outdoor horn / 30 W	Courtyard horn / B
S284	A3	DB1	Outdoor horn / 30 W	Tower horn / B / outer
S285	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 5 / B
S286	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 8 / B
S287	A3	DB1	Outdoor horn / 30 W	Courtyard horn / H
S288	A3	DB1	Outdoor horn / 30 W	Tower horn / H / outer
S289	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 5 / H
S290	A3	DB1	Outdoor horn / 30 W	Side courtyard horn / axis 8 / H
S291	MIC	DB1	Gooseneck microphone (cardioid)	Ambo microphone
S292	MIC	DB1	Gooseneck microphone (cardioid)	Altar microphone
F-WING-B-3	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing B / 3 / held review
F-WING-B-4	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing B / 4 / held review
F-WING-H-3	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing H / 3 / held review
F-WING-H-4	F5	DB1	Wall fan / oscillating 45 cm	Wall fan / wing H / 4 / held review

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R001	feeder:DB2	DB1	DB2-FEED	Shared context	80.68	-
R002	feeder:AV1	DB1	AV1-SUPPLY	Shared context	5.79	-
R003	feeder:LC1	DB1	LC1-SUPPLY	Shared context	2.56	-
R004	feeder:FC1	DB1	FC1-SUPPLY	Shared context	3.41	-
R005	local:L1	LC1	L3	L1	8.03	-
R006	local:L2	LC1	L3	L2	9.93	-
R007	trunk:LC1:L1:light:-1	LC1	L1	Shared context	69.66	-
R008	drop:LC1:L1:light:-1:L3	LC1	L1	L3	8.73	-
R009	drop:LC1:L1:light:-1:L4	LC1	L1	L4	8.73	-
R010	drop:LC1:L1:light:-1:L7	LC1	L1	L7	8.73	-
R011	drop:LC1:L1:light:-1:L8	LC1	L1	L8	8.73	-
R012	drop:LC1:L1:light:-1:L11	LC1	L1	L11	8.73	-
R013	drop:LC1:L1:light:-1:L12	LC1	L1	L12	8.73	-
R014	drop:LC1:L1:light:-1:L15	LC1	L1	L15	8.73	-
R015	drop:LC1:L1:light:-1:L16	LC1	L1	L16	8.73	-
R016	drop:LC1:L1:light:-1:L19	LC1	L1	L19	8.73	-
R017	drop:LC1:L1:light:-1:L20	LC1	L1	L20	8.73	-
R018	drop:LC1:L1:light:-1:L23	LC1	L1	L23	8.73	-
R019	drop:LC1:L1:light:-1:L24	LC1	L1	L24	8.73	-
R020	drop:LC1:L1:light:-1:L27	LC1	L1	L27	8.73	-
R021	drop:LC1:L1:light:-1:L28	LC1	L1	L28	8.73	-
R022	drop:LC1:L1:light:-1:L59	LC1	L1	L59	9.44	-
R023	drop:LC1:L1:light:-1:L60	LC1	L1	L60	6.94	-
R024	trunk:LC1:L1:light:1	LC1	L1	Shared context	76.26	-
R025	drop:LC1:L1:light:1:L5	LC1	L1	L5	8.73	-
R026	drop:LC1:L1:light:1:L6	LC1	L1	L6	8.73	-
R027	drop:LC1:L1:light:1:L9	LC1	L1	L9	8.73	-
R028	drop:LC1:L1:light:1:L10	LC1	L1	L10	8.73	-
R029	drop:LC1:L1:light:1:L13	LC1	L1	L13	8.73	-
R030	drop:LC1:L1:light:1:L14	LC1	L1	L14	8.73	-
R031	drop:LC1:L1:light:1:L17	LC1	L1	L17	8.73	-
R032	drop:LC1:L1:light:1:L18	LC1	L1	L18	8.73	-
R033	drop:LC1:L1:light:1:L21	LC1	L1	L21	8.73	-
R034	drop:LC1:L1:light:1:L22	LC1	L1	L22	8.73	-
R035	drop:LC1:L1:light:1:L25	LC1	L1	L25	8.73	-
R036	drop:LC1:L1:light:1:L26	LC1	L1	L26	8.73	-
R037	drop:LC1:L1:light:1:L29	LC1	L1	L29	8.73	-
R038	drop:LC1:L1:light:1:L30	LC1	L1	L30	8.73	-
R039	drop:LC1:L1:light:1:L61	LC1	L1	L61	9.44	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R040	drop:LC1:L1:light:1:L62	LC1	L1	L62	6.94	-
R041	trunk:LC1:L2:light:-1	LC1	L2	Shared context	62.33	-
R042	drop:LC1:L2:light:-1:L31	LC1	L2	L31	3.73	-
R043	drop:LC1:L2:light:-1:L32	LC1	L2	L32	3.73	-
R044	drop:LC1:L2:light:-1:L35	LC1	L2	L35	3.73	-
R045	drop:LC1:L2:light:-1:L36	LC1	L2	L36	3.73	-
R046	drop:LC1:L2:light:-1:L39	LC1	L2	L39	3.73	-
R047	drop:LC1:L2:light:-1:L40	LC1	L2	L40	3.73	-
R048	drop:LC1:L2:light:-1:L43	LC1	L2	L43	3.73	-
R049	drop:LC1:L2:light:-1:L44	LC1	L2	L44	3.73	-
R050	drop:LC1:L2:light:-1:L47	LC1	L2	L47	3.73	-
R051	drop:LC1:L2:light:-1:L48	LC1	L2	L48	3.73	-
R052	drop:LC1:L2:light:-1:L51	LC1	L2	L51	3.73	-
R053	drop:LC1:L2:light:-1:L52	LC1	L2	L52	3.73	-
R054	drop:LC1:L2:light:-1:L55	LC1	L2	L55	3.73	-
R055	drop:LC1:L2:light:-1:L56	LC1	L2	L56	3.73	-
R056	trunk:LC1:L2:light:1	LC1	L2	Shared context	68.93	-
R057	drop:LC1:L2:light:1:L33	LC1	L2	L33	3.73	-
R058	drop:LC1:L2:light:1:L34	LC1	L2	L34	3.73	-
R059	drop:LC1:L2:light:1:L37	LC1	L2	L37	3.73	-
R060	drop:LC1:L2:light:1:L38	LC1	L2	L38	3.73	-
R061	drop:LC1:L2:light:1:L41	LC1	L2	L41	3.73	-
R062	drop:LC1:L2:light:1:L42	LC1	L2	L42	3.73	-
R063	drop:LC1:L2:light:1:L45	LC1	L2	L45	3.73	-
R064	drop:LC1:L2:light:1:L46	LC1	L2	L46	3.73	-
R065	drop:LC1:L2:light:1:L49	LC1	L2	L49	3.73	-
R066	drop:LC1:L2:light:1:L50	LC1	L2	L50	3.73	-
R067	drop:LC1:L2:light:1:L53	LC1	L2	L53	3.73	-
R068	drop:LC1:L2:light:1:L54	LC1	L2	L54	3.73	-
R069	drop:LC1:L2:light:1:L57	LC1	L2	L57	3.73	-
R070	drop:LC1:L2:light:1:L58	LC1	L2	L58	3.73	-
R071	trunk:LC1:L8:light:-1	LC1	L8	Shared context	31.84	-
R072	drop:LC1:L8:light:-1:L63	LC1	L8	L63	6.79	-
R073	drop:LC1:L8:light:-1:L64	LC1	L8	L64	4.99	-
R074	drop:LC1:L8:light:-1:L65	LC1	L8	L65	6.79	-
R075	drop:LC1:L8:light:-1:L66	LC1	L8	L66	4.99	-
R076	trunk:LC1:L8:light:1	LC1	L8	Shared context	38.44	-
R077	drop:LC1:L8:light:1:L67	LC1	L8	L67	6.79	-
R078	drop:LC1:L8:light:1:L68	LC1	L8	L68	4.99	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R079	drop:LC1:L8:light:1:L69	LC1	L8	L69	6.79	-
R080	drop:LC1:L8:light:1:L70	LC1	L8	L70	4.99	-
R081	trunk:LC1:LA:light:-1	LC1	LA	Shared context	62.31	-
R082	drop:LC1:LA:light:-1:L71	LC1	LA	L71	10.20	-
R083	drop:LC1:LA:light:-1:L72	LC1	LA	L72	10.20	-
R084	drop:LC1:LA:light:-1:L73	LC1	LA	L73	10.20	-
R085	drop:LC1:LA:light:-1:L74	LC1	LA	L74	10.20	-
R086	drop:LC1:LA:light:-1:L75	LC1	LA	L75	10.20	-
R087	drop:LC1:LA:light:-1:L76	LC1	LA	L76	10.20	-
R088	drop:LC1:LA:light:-1:L77	LC1	LA	L77	10.20	-
R089	trunk:LC1:LD:light:-1	LC1	LD	Shared context	62.30	-
R090	drop:LC1:LD:light:-1:L78	LC1	LD	L78	16.28	-
R091	drop:LC1:LD:light:-1:L79	LC1	LD	L79	16.28	-
R092	drop:LC1:LD:light:-1:L80	LC1	LD	L80	16.28	-
R093	drop:LC1:LD:light:-1:L81	LC1	LD	L81	11.56	-
R094	drop:LC1:LD:light:-1:L82	LC1	LD	L82	1.63	-
R095	drop:LC1:LD:light:-1:L84	LC1	LD	L84	1.63	-
R096	drop:LC1:LD:light:-1:L86	LC1	LD	L86	1.63	-
R097	drop:LC1:LD:light:-1:L88	LC1	LD	L88	1.63	-
R098	drop:LC1:LD:light:-1:L90	LC1	LD	L90	1.63	-
R099	drop:LC1:LD:light:-1:L92	LC1	LD	L92	1.63	-
R100	drop:LC1:LD:light:-1:L94	LC1	LD	L94	1.63	-
R101	drop:LC1:LD:light:-1:L96	LC1	LD	L96	7.81	-
R102	trunk:LC1:LD:light:1	LC1	LD	Shared context	68.90	-
R103	drop:LC1:LD:light:1:L83	LC1	LD	L83	1.63	-
R104	drop:LC1:LD:light:1:L85	LC1	LD	L85	1.63	-
R105	drop:LC1:LD:light:1:L87	LC1	LD	L87	1.63	-
R106	drop:LC1:LD:light:1:L89	LC1	LD	L89	1.63	-
R107	drop:LC1:LD:light:1:L91	LC1	LD	L91	1.63	-
R108	drop:LC1:LD:light:1:L93	LC1	LD	L93	1.63	-
R109	drop:LC1:LD:light:1:L95	LC1	LD	L95	1.63	-
R110	drop:LC1:LD:light:1:L97	LC1	LD	L97	7.81	-
R111	trunk:LC1:L3:light:-1	LC1	L3	Shared context	35.32	-
R112	drop:LC1:L3:light:-1:L98	LC1	L3	L98	9.91	-
R113	drop:LC1:L3:light:-1:L100	LC1	L3	L100	9.19	-
R114	drop:LC1:L3:light:-1:L101	LC1	L3	L101	9.41	-
R115	drop:LC1:L3:light:-1:L104	LC1	L3	L104	10.71	-
R116	drop:LC1:L3:light:-1:L106	LC1	L3	L106	9.55	-
R117	drop:LC1:L3:light:-1:L107	LC1	L3	L107	8.65	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R118	drop:LC1:L3:light:-1:L108	LC1	L3	L108	8.39	-
R119	drop:LC1:L3:light:-1:L109	LC1	L3	L109	10.07	-
R120	drop:LC1:L3:light:-1:L114	LC1	L3	L114	8.89	-
R121	drop:LC1:L3:light:-1:L115	LC1	L3	L115	4.07	-
R122	drop:LC1:L3:light:-1:L116	LC1	L3	L116	4.42	-
R123	drop:LC1:L3:light:-1:L151	LC1	L3	L151	6.93	-
R124	drop:LC1:L3:light:-1:L152	LC1	L3	L152	4.93	-
R125	trunk:LC1:L3:light:1	LC1	L3	Shared context	41.92	-
R126	drop:LC1:L3:light:1:L99	LC1	L3	L99	9.91	-
R127	drop:LC1:L3:light:1:L102	LC1	L3	L102	9.41	-
R128	drop:LC1:L3:light:1:L103	LC1	L3	L103	8.31	-
R129	drop:LC1:L3:light:1:L105	LC1	L3	L105	10.71	-
R130	drop:LC1:L3:light:1:L110	LC1	L3	L110	9.55	-
R131	drop:LC1:L3:light:1:L111	LC1	L3	L111	8.65	-
R132	drop:LC1:L3:light:1:L112	LC1	L3	L112	8.39	-
R133	drop:LC1:L3:light:1:L113	LC1	L3	L113	10.07	-
R134	drop:LC1:L3:light:1:L117	LC1	L3	L117	4.07	-
R135	drop:LC1:L3:light:1:L118	LC1	L3	L118	4.42	-
R136	drop:LC1:L3:light:1:L153	LC1	L3	L153	6.93	-
R137	drop:LC1:L3:light:1:L154	LC1	L3	L154	4.93	-
R138	trunk:LC1:L4:light:-1	LC1	L4	Shared context	62.31	-
R139	drop:LC1:L4:light:-1:L119	LC1	L4	L119	4.76	-
R140	drop:LC1:L4:light:-1:L120	LC1	L4	L120	4.76	-
R141	drop:LC1:L4:light:-1:L121	LC1	L4	L121	4.76	-
R142	drop:LC1:L4:light:-1:L122	LC1	L4	L122	4.76	-
R143	drop:LC1:L4:light:-1:L123	LC1	L4	L123	4.76	-
R144	drop:LC1:L4:light:-1:L124	LC1	L4	L124	4.76	-
R145	drop:LC1:L4:light:-1:L125	LC1	L4	L125	4.76	-
R146	drop:LC1:L4:light:-1:L126	LC1	L4	L126	4.76	-
R147	drop:LC1:L4:light:-1:L127	LC1	L4	L127	4.76	-
R148	trunk:LC1:L4:light:1	LC1	L4	Shared context	68.91	-
R149	drop:LC1:L4:light:1:L128	LC1	L4	L128	4.76	-
R150	drop:LC1:L4:light:1:L129	LC1	L4	L129	4.76	-
R151	drop:LC1:L4:light:1:L130	LC1	L4	L130	4.76	-
R152	drop:LC1:L4:light:1:L131	LC1	L4	L131	4.76	-
R153	drop:LC1:L4:light:1:L132	LC1	L4	L132	4.76	-
R154	drop:LC1:L4:light:1:L133	LC1	L4	L133	4.76	-
R155	drop:LC1:L4:light:1:L134	LC1	L4	L134	4.76	-
R156	drop:LC1:L4:light:1:L135	LC1	L4	L135	4.76	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R157	drop:LC1:L4:light:1:L136	LC1	L4	L136	4.76	-
R158	trunk:DB2:L9:light:-1	DB2	L9	Shared context	12.27	-
R159	drop:DB2:L9:light:-1:L137	DB2	L9	L137	11.44	-
R160	drop:DB2:L9:light:-1:L182	DB2	L9	L182	10.55	-
R161	drop:DB2:L9:light:-1:L183	DB2	L9	L183	6.13	-
R162	trunk:DB2:L9:light:1	DB2	L9	Shared context	18.87	-
R163	drop:DB2:L9:light:1:L138	DB2	L9	L138	11.44	-
R164	drop:DB2:L9:light:1:L189	DB2	L9	L189	6.13	-
R165	drop:DB2:L9:light:1:L190	DB2	L9	L190	10.55	-
R166	trunk:LC1:L5:light:-1	LC1	L5	Shared context	57.79	-
R167	drop:LC1:L5:light:-1:L139	LC1	L5	L139	8.08	-
R168	drop:LC1:L5:light:-1:L140	LC1	L5	L140	8.08	-
R169	drop:LC1:L5:light:-1:L141	LC1	L5	L141	8.08	-
R170	drop:LC1:L5:light:-1:L142	LC1	L5	L142	8.08	-
R171	drop:LC1:L5:light:-1:L143	LC1	L5	L143	8.08	-
R172	drop:LC1:L5:light:-1:L144	LC1	L5	L144	8.08	-
R173	drop:LC1:L5:light:-1:L184	LC1	L5	L184	4.98	-
R174	drop:LC1:L5:light:-1:L185	LC1	L5	L185	4.98	-
R175	drop:LC1:L5:light:-1:L186	LC1	L5	L186	4.98	-
R176	drop:LC1:L5:light:-1:L187	LC1	L5	L187	9.08	-
R177	drop:LC1:L5:light:-1:L188	LC1	L5	L188	3.79	-
R178	trunk:LC1:L5:light:1	LC1	L5	Shared context	64.39	-
R179	drop:LC1:L5:light:1:L145	LC1	L5	L145	8.08	-
R180	drop:LC1:L5:light:1:L146	LC1	L5	L146	8.08	-
R181	drop:LC1:L5:light:1:L147	LC1	L5	L147	8.08	-
R182	drop:LC1:L5:light:1:L148	LC1	L5	L148	8.08	-
R183	drop:LC1:L5:light:1:L149	LC1	L5	L149	8.08	-
R184	drop:LC1:L5:light:1:L150	LC1	L5	L150	8.08	-
R185	drop:LC1:L5:light:1:L191	LC1	L5	L191	4.98	-
R186	drop:LC1:L5:light:1:L192	LC1	L5	L192	4.98	-
R187	drop:LC1:L5:light:1:L193	LC1	L5	L193	4.98	-
R188	drop:LC1:L5:light:1:L194	LC1	L5	L194	9.08	-
R189	drop:LC1:L5:light:1:L195	LC1	L5	L195	3.79	-
R190	trunk:LC1:E1:light:-1	LC1	E1	Shared context	69.58	-
R191	drop:LC1:E1:light:-1:L155	LC1	E1	L155	10.05	-
R192	drop:LC1:E1:light:-1:L156	LC1	E1	L156	1.50	-
R193	drop:LC1:E1:light:-1:L158	LC1	E1	L158	1.50	-
R194	trunk:LC1:E1:light:1	LC1	E1	Shared context	62.10	-
R195	drop:LC1:E1:light:1:L157	LC1	E1	L157	1.50	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R196	drop:LC1:E1:light:1:L159	LC1	E1	L159	1.50	-
R197	trunk:DB2:L6:light:-1	DB2	L6	Shared context	12.98	-
R198	drop:DB2:L6:light:-1:L160	DB2	L6	L160	11.60	-
R199	drop:DB2:L6:light:-1:L161	DB2	L6	L161	12.30	-
R200	drop:DB2:L6:light:-1:L162	DB2	L6	L162	19.89	-
R201	drop:DB2:L6:light:-1:L163	DB2	L6	L163	27.68	-
R202	drop:DB2:L6:light:-1:L164	DB2	L6	L164	33.46	-
R203	drop:DB2:L6:light:-1:L165	DB2	L6	L165	29.39	-
R204	drop:DB2:L6:light:-1:L166	DB2	L6	L166	13.60	-
R205	drop:DB2:L6:light:-1:L167	DB2	L6	L167	12.87	-
R206	drop:DB2:L6:light:-1:L168	DB2	L6	L168	20.42	-
R207	drop:DB2:L6:light:-1:L169	DB2	L6	L169	28.19	-
R208	drop:DB2:L6:light:-1:L170	DB2	L6	L170	5.92	-
R209	drop:DB2:L6:light:-1:L222	DB2	L6	L222	6.07	-
R210	drop:DB2:L6:light:-1:L223	DB2	L6	L223	13.76	-
R211	trunk:DB2:L6:light:1	DB2	L6	Shared context	19.58	-
R212	drop:DB2:L6:light:1:L171	DB2	L6	L171	11.60	-
R213	drop:DB2:L6:light:1:L172	DB2	L6	L172	12.30	-
R214	drop:DB2:L6:light:1:L173	DB2	L6	L173	19.89	-
R215	drop:DB2:L6:light:1:L174	DB2	L6	L174	27.68	-
R216	drop:DB2:L6:light:1:L175	DB2	L6	L175	33.46	-
R217	drop:DB2:L6:light:1:L176	DB2	L6	L176	29.39	-
R218	drop:DB2:L6:light:1:L177	DB2	L6	L177	13.60	-
R219	drop:DB2:L6:light:1:L178	DB2	L6	L178	12.87	-
R220	drop:DB2:L6:light:1:L179	DB2	L6	L179	20.42	-
R221	drop:DB2:L6:light:1:L180	DB2	L6	L180	28.19	-
R222	drop:DB2:L6:light:1:L181	DB2	L6	L181	5.92	-
R223	drop:DB2:L6:light:1:L224	DB2	L6	L224	6.07	-
R224	drop:DB2:L6:light:1:L225	DB2	L6	L225	13.76	-
R225	trunk:DB2:L7:light:-1	DB2	L7	Shared context	66.76	-
R226	drop:DB2:L7:light:-1:L196	DB2	L7	L196	10.46	-
R227	drop:DB2:L7:light:-1:L197	DB2	L7	L197	1.37	-
R228	drop:DB2:L7:light:-1:L198	DB2	L7	L198	1.37	-
R229	drop:DB2:L7:light:-1:L199	DB2	L7	L199	4.67	-
R230	drop:DB2:L7:light:-1:L200	DB2	L7	L200	4.67	-
R231	drop:DB2:L7:light:-1:L201	DB2	L7	L201	8.16	-
R232	drop:DB2:L7:light:-1:L202	DB2	L7	L202	8.58	-
R233	drop:DB2:L7:light:-1:L203	DB2	L7	L203	13.00	-
R234	drop:DB2:L7:light:-1:L204	DB2	L7	L204	9.80	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R235	drop:DB2:L7:light:-1:L205	DB2	L7	L205	14.22	-
R236	drop:DB2:L7:light:-1:L206	DB2	L7	L206	17.38	-
R237	drop:DB2:L7:light:-1:L207	DB2	L7	L207	21.80	-
R238	drop:DB2:L7:light:-1:L219	DB2	L7	L219	10.08	-
R239	drop:DB2:L7:light:-1:L220	DB2	L7	L220	3.75	-
R240	trunk:DB2:L7:light:1	DB2	L7	Shared context	73.36	-
R241	drop:DB2:L7:light:1:L208	DB2	L7	L208	1.37	-
R242	drop:DB2:L7:light:1:L209	DB2	L7	L209	1.37	-
R243	drop:DB2:L7:light:1:L210	DB2	L7	L210	4.67	-
R244	drop:DB2:L7:light:1:L211	DB2	L7	L211	4.67	-
R245	drop:DB2:L7:light:1:L212	DB2	L7	L212	8.16	-
R246	drop:DB2:L7:light:1:L213	DB2	L7	L213	8.58	-
R247	drop:DB2:L7:light:1:L214	DB2	L7	L214	13.00	-
R248	drop:DB2:L7:light:1:L215	DB2	L7	L215	9.80	-
R249	drop:DB2:L7:light:1:L216	DB2	L7	L216	14.22	-
R250	drop:DB2:L7:light:1:L217	DB2	L7	L217	17.38	-
R251	drop:DB2:L7:light:1:L218	DB2	L7	L218	21.80	-
R252	drop:DB2:L7:light:1:L221	DB2	L7	L221	3.75	-
R253	trunk:FC1:F1:fan:-1	FC1	F1	Shared context	64.03	-
R254	drop:FC1:F1:fan:-1:F226	FC1	F1	F226	11.29	-
R255	drop:FC1:F1:fan:-1:F228	FC1	F1	F228	11.29	-
R256	drop:FC1:F1:fan:-1:F230	FC1	F1	F230	11.28	-
R257	drop:FC1:F1:fan:-1:F232	FC1	F1	F232	11.29	-
R258	drop:FC1:F1:fan:-1:F234	FC1	F1	F234	11.29	-
R259	drop:FC1:F1:fan:-1:F236	FC1	F1	F236	11.29	-
R260	drop:FC1:F1:fan:-1:F238	FC1	F1	F238	11.28	-
R261	trunk:FC1:F1:fan:1	FC1	F1	Shared context	70.63	-
R262	drop:FC1:F1:fan:1:F227	FC1	F1	F227	11.29	-
R263	drop:FC1:F1:fan:1:F229	FC1	F1	F229	11.29	-
R264	drop:FC1:F1:fan:1:F231	FC1	F1	F231	11.28	-
R265	drop:FC1:F1:fan:1:F233	FC1	F1	F233	11.29	-
R266	drop:FC1:F1:fan:1:F235	FC1	F1	F235	11.29	-
R267	drop:FC1:F1:fan:1:F237	FC1	F1	F237	11.29	-
R268	drop:FC1:F1:fan:1:F239	FC1	F1	F239	11.28	-
R269	trunk:FC1:F5:fan:-1	FC1	F5	Shared context	32.42	-
R270	drop:FC1:F5:fan:-1:F240	FC1	F5	F240	10.70	-
R271	drop:FC1:F5:fan:-1:F241	FC1	F5	F241	12.14	-
R272	drop:FC1:F5:fan:-1:F-WING-B-3	FC1	F5	F-WING-B-3	12.14	-
R273	drop:FC1:F5:fan:-1:F-WING-B-4	FC1	F5	F-WING-B-4	10.70	-

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R274	trunk:FC1:F5:fan:1	FC1	F5	Shared context	39.02	-
R275	drop:FC1:F5:fan:1:F242	FC1	F5	F242	10.70	-
R276	drop:FC1:F5:fan:1:F243	FC1	F5	F243	12.14	-
R277	drop:FC1:F5:fan:1:F-WING-H-3	FC1	F5	F-WING-H-3	12.14	-
R278	drop:FC1:F5:fan:1:F-WING-H-4	FC1	F5	F-WING-H-4	10.70	-
R279	trunk:FC1:F2:fan:-1	FC1	F2	Shared context	58.58	-
R280	drop:FC1:F2:fan:-1:F244	FC1	F2	F244	0.75	-
R281	drop:FC1:F2:fan:-1:F246	FC1	F2	F246	0.75	-
R282	drop:FC1:F2:fan:-1:F248	FC1	F2	F248	0.75	-
R283	trunk:FC1:F2:fan:1	FC1	F2	Shared context	65.18	-
R284	drop:FC1:F2:fan:1:F245	FC1	F2	F245	0.75	-
R285	drop:FC1:F2:fan:1:F247	FC1	F2	F247	0.75	-
R286	drop:FC1:F2:fan:1:F249	FC1	F2	F249	0.75	-
R287	trunk:DB2:F4:fan:-1	DB2	F4	Shared context	12.52	-
R288	drop:DB2:F4:fan:-1:F250	DB2	F4	F250	7.92	-
R289	trunk:DB2:F4:fan:1	DB2	F4	Shared context	19.12	-
R290	drop:DB2:F4:fan:1:F251	DB2	F4	F251	7.92	-
R291	trunk:FC1:V1:fan:-1	FC1	V1	Shared context	67.55	-
R292	drop:FC1:V1:fan:-1:F252	FC1	V1	F252	8.69	-
R293	drop:FC1:V1:fan:-1:F253	FC1	V1	F253	11.83	-
R294	drop:FC1:V1:fan:-1:F256	FC1	V1	F256	6.97	-
R295	drop:FC1:V1:fan:-1:F257	FC1	V1	F257	6.97	-
R296	drop:FC1:V1:fan:-1:F260	FC1	V1	F260	10.20	-
R297	trunk:FC1:V1:fan:1	FC1	V1	Shared context	74.15	-
R298	drop:FC1:V1:fan:1:F254	FC1	V1	F254	11.83	-
R299	drop:FC1:V1:fan:1:F255	FC1	V1	F255	8.69	-
R300	drop:FC1:V1:fan:1:F258	FC1	V1	F258	6.97	-
R301	drop:FC1:V1:fan:1:F259	FC1	V1	F259	6.97	-
R302	trunk:AV1:A1:audio:-1	AV1	A1	Shared context	61.27	-
R303	drop:AV1:A1:audio:-1:S261	AV1	A1	S261	2.53	63.81
R304	drop:AV1:A1:audio:-1:S263	AV1	A1	S263	2.53	59.31
R305	drop:AV1:A1:audio:-1:S265	AV1	A1	S265	2.53	54.81
R306	drop:AV1:A1:audio:-1:S267	AV1	A1	S267	2.53	50.31
R307	drop:AV1:A1:audio:-1:S269	AV1	A1	S269	2.53	45.81
R308	drop:AV1:A1:audio:-1:S271	AV1	A1	S271	2.53	41.31
R309	drop:AV1:A1:audio:-1:S275	AV1	A1	S275	9.19	44.26
R310	drop:AV1:A1:audio:-1:S276	AV1	A1	S276	9.19	40.04
R311	trunk:AV1:A1:audio:1	AV1	A1	Shared context	67.87	-
R312	drop:AV1:A1:audio:1:S262	AV1	A1	S262	2.53	70.41

Unique route index

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

Ref	Stable route ID	From	Circuit/zone	Equipment / context	Drawn m	Audio home run m
R313	drop:AV1:A1:audio:1:S264	AV1	A1	S264	2.53	65.91
R314	drop:AV1:A1:audio:1:S266	AV1	A1	S266	2.53	61.41
R315	drop:AV1:A1:audio:1:S268	AV1	A1	S268	2.53	56.91
R316	drop:AV1:A1:audio:1:S270	AV1	A1	S270	2.53	52.41
R317	drop:AV1:A1:audio:1:S272	AV1	A1	S272	2.53	47.91
R318	drop:AV1:A1:audio:1:S277	AV1	A1	S277	9.19	50.86
R319	drop:AV1:A1:audio:1:S278	AV1	A1	S278	9.19	46.64
R320	trunk:AV1:A5:audio:-1	AV1	A5	Shared context	73.06	-
R321	drop:AV1:A5:audio:-1:S273	AV1	A5	S273	10.61	83.68
R322	trunk:AV1:A5:audio:1	AV1	A5	Shared context	79.66	-
R323	drop:AV1:A5:audio:1:S274	AV1	A5	S274	10.61	90.28
R324	trunk:AV1:A2:audio:-1	AV1	A2	Shared context	62.21	-
R325	drop:AV1:A2:audio:-1:S279	AV1	A2	S279	6.94	69.15
R326	drop:AV1:A2:audio:-1:S280	AV1	A2	S280	6.94	55.65
R327	trunk:AV1:A2:audio:1	AV1	A2	Shared context	68.81	-
R328	drop:AV1:A2:audio:1:S281	AV1	A2	S281	6.94	75.75
R329	drop:AV1:A2:audio:1:S282	AV1	A2	S282	6.94	62.25
R330	trunk:AV1:A3:audio:-1	AV1	A3	Shared context	73.38	-
R331	drop:AV1:A3:audio:-1:S283	AV1	A3	S283	6.82	80.20
R332	drop:AV1:A3:audio:-1:S284	AV1	A3	S284	11.35	84.73
R333	drop:AV1:A3:audio:-1:S285	AV1	A3	S285	5.52	62.28
R334	drop:AV1:A3:audio:-1:S286	AV1	A3	S286	5.52	48.78
R335	trunk:AV1:A3:audio:1	AV1	A3	Shared context	79.98	-
R336	drop:AV1:A3:audio:1:S287	AV1	A3	S287	6.82	86.80
R337	drop:AV1:A3:audio:1:S288	AV1	A3	S288	11.35	91.33
R338	drop:AV1:A3:audio:1:S289	AV1	A3	S289	5.52	68.88
R339	drop:AV1:A3:audio:1:S290	AV1	A3	S290	5.52	55.38
R340	trunk:AV1:MIC:mic:-1	AV1	MIC	Shared context	11.91	-
R341	drop:AV1:MIC:mic:-1:S291	AV1	MIC	S291	3.58	15.49
R342	trunk:AV1:MIC:mic:1	AV1	MIC	Shared context	5.74	-
R343	drop:AV1:MIC:mic:1:S292	AV1	MIC	S292	2.80	8.54

3D installation planning sequence

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

01 / Survey and coordinate

3D layer: all / building

Check grid, floor datum, equipment positions and all concealed routes against the measured building. Use the circuit sheets to record corrections.

HOLD / responsible specialist release required

Survey and coordinated light, sound, air, access and concealment review must precede physical setting-out. This default layout still has unmet targets.

02 / Boards and feeder paths

3D layer: distribution / systems

Review DB-1 to DB-2, LC-1, FC-1 and AV-1 paths. Confirm enclosure access and the proposed supply/control separation.

HOLD / responsible specialist release required

Electrical designer: supply, phases, earthing, fault level, protection, cable sizes, board capacity and final single-line diagram are pending. Do not energize from this model.

03 / Coordinate concealed containment

3D layer: all / systems

Review all shared corridors and individual branches together. Select each run for its vertices and height; compare with structure and finished surfaces before closing any cover.

HOLD / responsible specialist release required

Containment size, power/signal separation, fixings, fire stopping, access panels and penetrations require coordinated approval. Coloured routes are enlarged display lines, not cable diameters.

3D installation planning sequence

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

04 / Lighting routes and fittings

3D layer: lighting / systems

Review each light circuit and its LC-1 or DB-2 supply. Check chandelier support, aim, driver access, fan-blade interaction and labels against the matching paper sheet.

HOLD / responsible specialist release required

Selected-product photometry, support design, control channels, dimming compatibility and installation details remain pending. Four default sampled seats miss the lighting brief.

05 / Sound and microphone connections

3D layer: sound / systems

Trace speaker and microphone lines to AV-1 separately from rack mains. Review polarity, intended zones, furniture/floor interfaces and service access.

HOLD / responsible specialist release required

Amplifier topology, impedance/line voltage, connectors, shielding and separation are pending. Passive speaker ratings are not mains loads; feedback and wing clarity targets remain unmet.

06 / Fans and ventilation

3D layer: air / systems

Review FC-1 and DB-2 routes, motor control compatibility and air paths with the lighting and sound systems. Keep the central processional view clear of visible fans and supports.

HOLD / responsible specialist release required

Current geometry is a study, not an accepted fan installation. Mounting, guards/clearance, duty points, make-up air, noise, concealment and maintenance access need specialist approval.

3D installation planning sequence

DESIGN DEVELOPMENT
NOT FOR CONSTRUCTION

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

07 / Exit signs and required safety functions

3D layer: exit / systems

Identify E1 separately from discretionary light scenes. Coordinate the required emergency system, operating labels and test access with the responsible designer.

HOLD / responsible specialist release required

Emergency supply, duration, coverage and failure behavior are not established by the simulator. No scene or walkthrough step authorizes isolation of required safety functions.

08 / Powered decoration and interfaces

3D layer: decoration / systems

Review decorative loads and concealed feeds, heat dissipation, isolation and replacement access without obstructing worship or other systems.

HOLD / responsible specialist release required

Final products, loads, supports, material/fire compatibility and control interfaces need approval. Empty stages may occur in edited layouts.

09 / Inspect, test and hand over

3D layer: all / building

After approved installation, the responsible team must record electrical verification, manual/scene and failure tests, light/sound/air measurements, as-built IDs and maintenance instructions.

HOLD / responsible specialist release required

No commissioning or construction approval is recorded here. Progress through these review steps does not release a hold or mark any work installed.