# Electrical routes / printable review set

Default model export - circuit plans, heights, equipment coordinates and route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## Read the plan, then trace the same ID in 3D

390 connected installed-study equipment / 449 unique routes / 31 drawing scopes. Hidden alternatives and non-electrical furniture are excluded. Shared feeders and trunks repeat as context on circuit sheets; quantities are owned once in the route index.

### Print and measure

Use A3 landscape at 100%, with no fit-to-page. The line below must measure 100 mm. Plans and height projections have separate stated scales. Never scale from a resized copy.

### Coordinate basis

X: axis 1 toward sanctuary. Y: height above nave finished floor. Z: centre between D/E; negative toward B, positive toward H. Grid is a model transcription, not a measured floor plan or installation set-out.

### Setting out from the grid

Each equipment point and route vertex is also given from its nearest grid axis: 5+1.20/D-0.35 h+2.40 = 1.20 m past axis 5 toward the sanctuary, 0.35 m from axis D toward B, 2.40 m above nave floor +0.000. On the dais (+0.80) or side floors (+0.16), subtract the local floor level. Check the axes on site first.

### Route reading

Solid: power/feed. Dashed: loudspeaker audio. Dotted: microphone. Circle: equipment. Square: enclosure. Projection crossings are not junctions. Overlapping vertical paths require the route-vertex CSV and 3D review.

### Length basis

Route length = sum of 3D segment lengths. No spare, termination or installation allowances. Audio home run = branch plus its own upstream path; do not add shared bundle lengths again. This is not a conductor/cable take-off.

### Stop before physical work

Cable sizes, protection, supply/earthing/fault level, product data, supports, containment and fire stopping, control channels, life-safety functions and commissioning approval are pending. Do not drill timber or close concealed works from these sheets.

100 mm print calibration

## Sheet index / circuit lookup

E-001 Distribution and feeders
E-002 L3 / Sanctuary
E-003 L2 / Nave / 4 rear bays (2'-6)
E-004 L1 / Nave / 3 front bays (6-9)
E-005 LA / Roof uplight
E-006 L4 / Circulation & verandas
E-007 L9 / Front stage & central door
E-008 L5 / Steps & paths
E-009 E1 / Exit signs
E-010 L6 / Facade & towers
E-011 L7 / Festival exterior (strings & tower floods)
E-012 F1 / Ceiling fans
E-013 F5 / Wing wall fans / held review
E-014 F2 / Wall fans
E-015 F4 / Entrance circulators (trial)
E-016 V1 / Exhaust / front gable
E-017 V2 / Exhaust / wing gables
E-018 V3 / Exhaust / service room
E-019 A1 / Main & delay loudspeakers
E-020 A5 / Rear fill (crowded feasts)
E-021 A2 / Veranda fill
E-022 A3 / Courtyard
E-023 Microphones
E-024 P1 / Sockets / side B (sanctuary + nave)
E-025 P3 / Event power / tower B
E-026 P2 / Sockets / side H (sanctuary + nave)
E-027 P4 / Event power / tower H
E-028 L10 / Facade statues & candles
E-029 LS / Stations of the Cross candles
E-030 L8 / Wings / choir & ministers
E-031 LD / Column up/down lights

After circuit sheets: TW-01 tower fronts with riser clearances, equipment naming schedule (EQ), unique route index (RI), installation note key (IM), route set-out schedule (RS) and the same nine-stage 3D coordination sequence (SQ). PDF bookmarks jump to each sheet.

Engineering baseline: feedback and wing speech clarity remain below targets; some seats miss the lighting brief. Fan performance, concealment, emergency design and installation access remain unverified. See docs/engineering/baseline.md and issues.md.

Companion files: drawing-index.json, model-snapshot.json, route-vertices.csv, equipment-coordinates.csv and manifest.json. Hashes bind this print set to its source files. Saved browser layouts are a different configuration.

THACH BI CHURCH

# Distribution and feeders


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-001


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

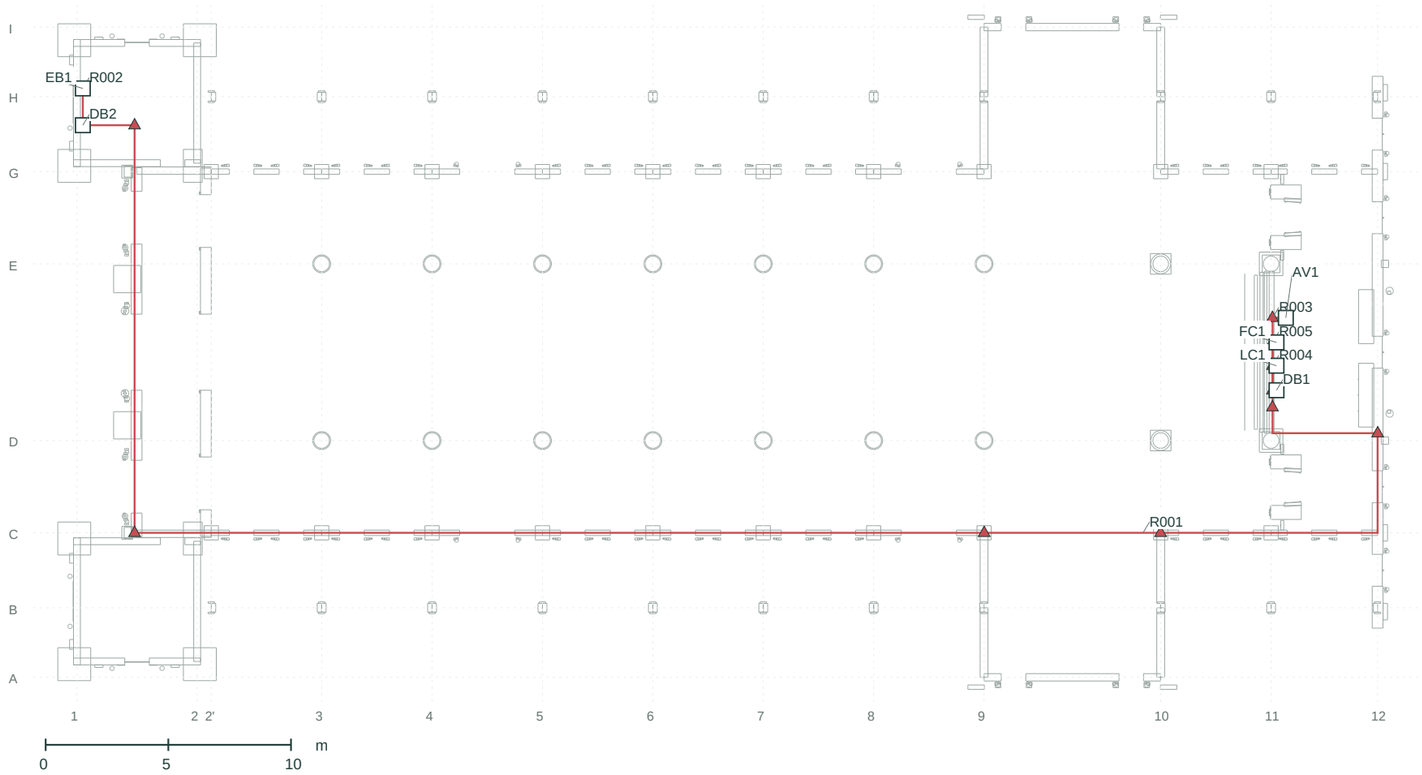


## HEIGHT PROJECTION / X-Y / all Z superimposed

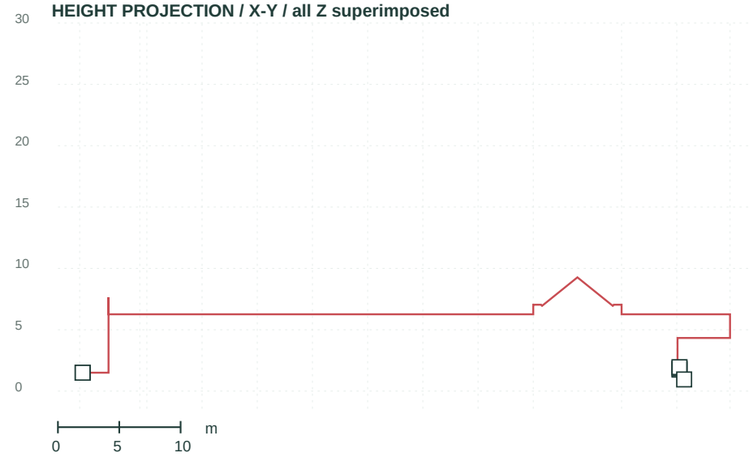


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **Related enclosures** | | | | | |
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 | |
| **EB1** | 0.240 | 1.500 | 10.750 | 1+0.24/H+0.34 | |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 | |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 | |
| **AV1** | 49.275 | 0.950 | 1.400 | 11+0.60/E-2.20 | |

0 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I21, I26 (key on sheet IM-01).

THACH BI CHURCH

# L3 / Sanctuary


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-002


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

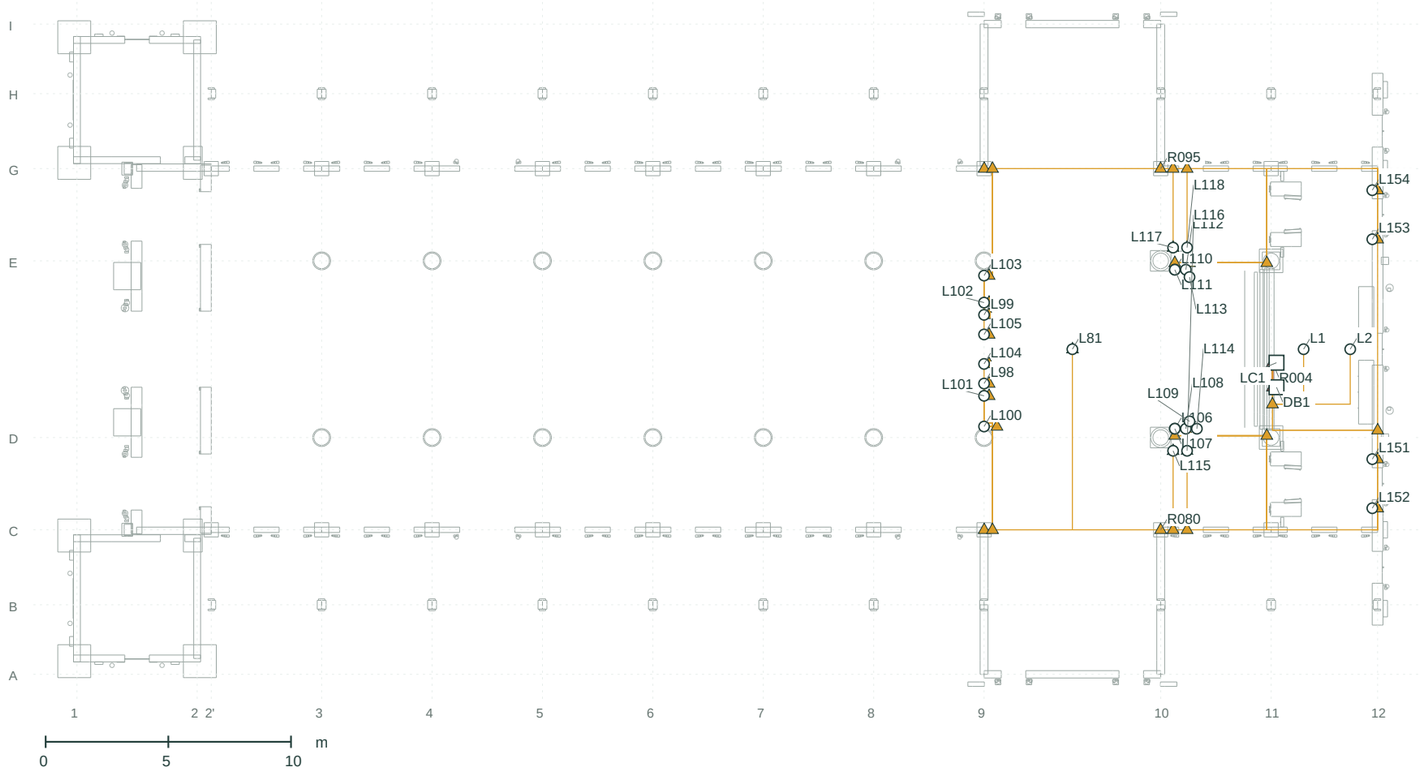


## HEIGHT PROJECTION / X-Y / all Z superimposed

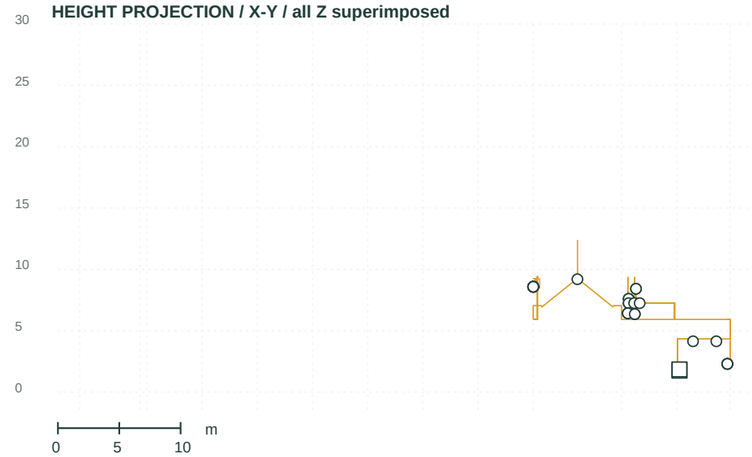


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I01, I02, I03, I06, I14, I17, I25, I27 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L1** | 50.000 | 4.140 | 0.000 | 11+1.33/D+3.60 | R006 |
| **L2** | 51.900 | 4.140 | 0.000 | 12-1.12/D+3.60 | R007 |
| **L81** | 40.575 | 9.200 | 0.000 | 9+3.60/D+3.60 | R081 |
| **L98** | 36.975 | 8.585 | -1.400 | 9+0.00/D+2.20 | R082 |
| **L99** | 36.975 | 8.585 | 1.400 | 9+0.00/E-2.20 | R096 |
| **L100** | 36.975 | 8.585 | -3.150 | 9+0.00/D+0.45 | R083 |
| **L101** | 36.975 | 8.585 | -1.900 | 9+0.00/D+1.70 | R084 |
| **L102** | 36.975 | 8.585 | 1.900 | 9+0.00/E-1.70 | R097 |
| **L103** | 36.975 | 8.585 | 3.000 | 9+0.00/E-0.60 | R098 |
| **L104** | 36.975 | 8.585 | -0.600 | 9+0.00/D+3.00 | R085 |
| **L105** | 36.975 | 8.585 | 0.600 | 9+0.00/E-3.00 | R099 |
| **L106** | 44.750 | 7.600 | -3.240 | 10+0.58/D+0.36 | R086 |
| **L107** | 44.750 | 7.250 | -3.240 | 10+0.58/D+0.36 | R087 |
| **L108** | 45.200 | 7.250 | -3.240 | 10+1.03/D+0.36 | R088 |
| **L109** | 45.350 | 8.420 | -2.940 | 10+1.18/D+0.66 | R089 |
| **L110** | 44.750 | 7.600 | 3.240 | 10+0.58/E-0.36 | R100 |
| **L111** | 44.750 | 7.250 | 3.240 | 10+0.58/E-0.36 | R101 |
| **L112** | 45.200 | 7.250 | 3.240 | 10+1.03/E-0.36 | R102 |
| **L113** | 45.350 | 8.420 | 2.940 | 10+1.18/E-0.66 | R103 |
| **L114** | 45.650 | 7.250 | -3.240 | 10+1.48/D+0.36 | R090 |
| **L115** | 44.680 | 6.424 | -4.140 | 10+0.51/D-0.54 | R091 |
| **L116** | 45.250 | 6.356 | -4.140 | 10+1.08/D-0.54 | R092 |
| **L117** | 44.680 | 6.424 | 4.140 | 10+0.51/E+0.54 | R104 |
| **L118** | 45.250 | 6.356 | 4.140 | 10+1.08/E+0.54 | R105 |
| **L151** | 52.800 | 2.300 | -4.480 | 12-0.22/D-0.88 | R093 |
| **L152** | 52.800 | 2.300 | -6.480 | 12-0.22/C+0.88 | R094 |
| **L153** | 52.800 | 2.300 | 4.480 | 12-0.22/E+0.88 | R106 |
| **L154** | 52.800 | 2.300 | 6.480 | 12-0.22/G-0.88 | R107 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 | |

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# L2 / Nave / 4 rear bays (2'-6)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-003


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

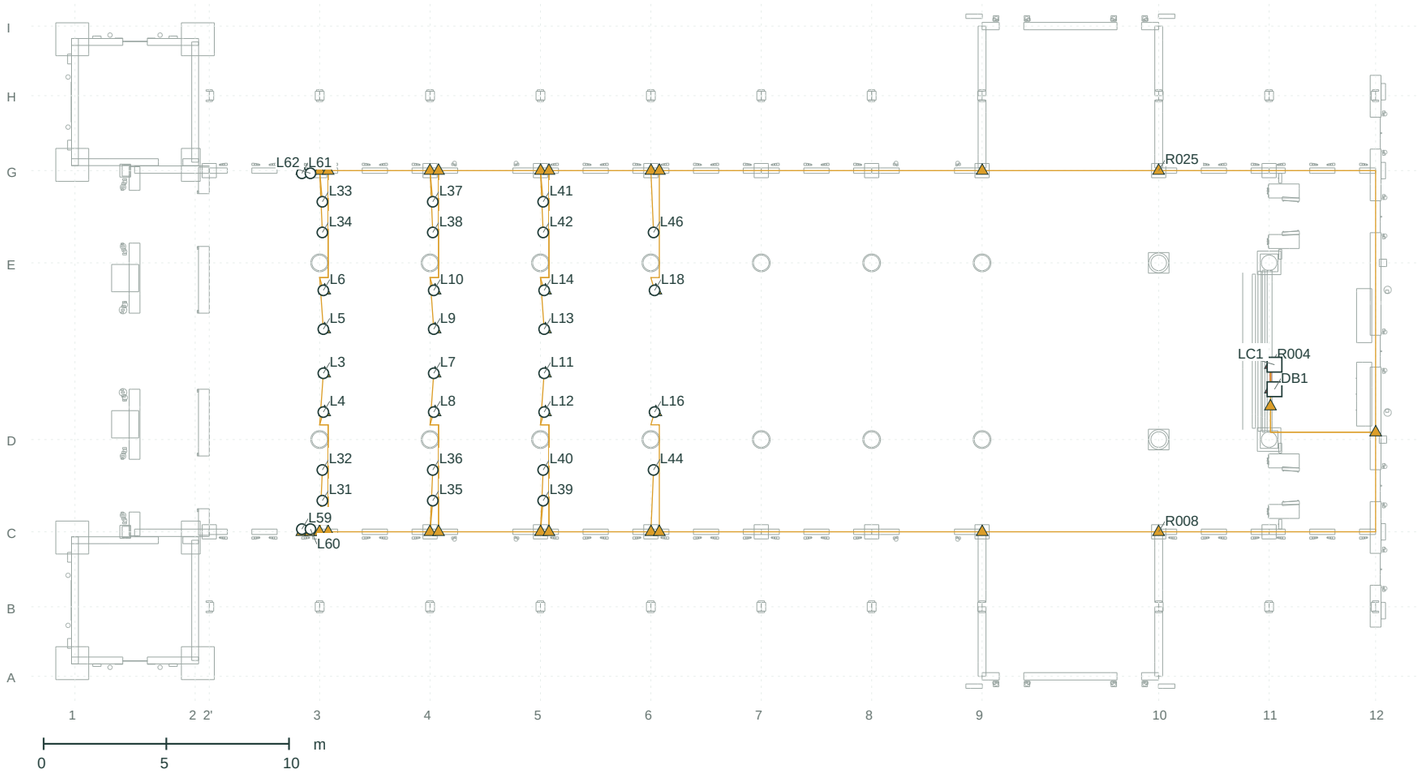


## HEIGHT PROJECTION / X-Y / all Z superimposed

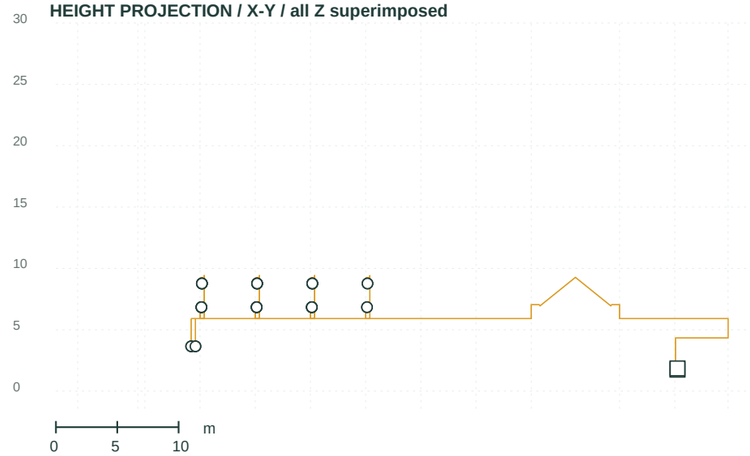


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I02, I10, I14, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L3** | 10.125 | 8.770 | -0.900 | 3+0.15/D+2.70 | R009 |
| **L4** | 10.125 | 8.770 | -2.480 | 3+0.15/D+1.12 | R010 |
| **L5** | 10.125 | 8.770 | 0.900 | 3+0.15/E-2.70 | R026 |
| **L6** | 10.125 | 8.770 | 2.480 | 3+0.15/E-1.12 | R027 |
| **L7** | 14.625 | 8.770 | -0.900 | 4+0.15/D+2.70 | R011 |
| **L8** | 14.625 | 8.770 | -2.480 | 4+0.15/D+1.12 | R012 |
| **L9** | 14.625 | 8.770 | 0.900 | 4+0.15/E-2.70 | R028 |
| **L10** | 14.625 | 8.770 | 2.480 | 4+0.15/E-1.12 | R029 |
| **L11** | 19.125 | 8.770 | -0.900 | 5+0.15/D+2.70 | R013 |
| **L12** | 19.125 | 8.770 | -2.480 | 5+0.15/D+1.12 | R014 |
| **L13** | 19.125 | 8.770 | 0.900 | 5+0.15/E-2.70 | R030 |
| **L14** | 19.125 | 8.770 | 2.480 | 5+0.15/E-1.12 | R031 |
| **L16** | 23.625 | 8.770 | -2.480 | 6+0.15/D+1.12 | R015 |
| **L18** | 23.625 | 8.770 | 2.480 | 6+0.15/E-1.12 | R032 |
| **L31** | 10.085 | 6.840 | -6.090 | 3+0.11/C+1.27 | R016 |
| **L32** | 10.085 | 6.840 | -4.840 | 3+0.11/D-1.24 | R017 |
| **L33** | 10.085 | 6.840 | 6.090 | 3+0.11/G-1.27 | R033 |
| **L34** | 10.085 | 6.840 | 4.840 | 3+0.11/E+1.24 | R034 |
| **L35** | 14.585 | 6.840 | -6.090 | 4+0.11/C+1.27 | R018 |
| **L36** | 14.585 | 6.840 | -4.840 | 4+0.11/D-1.24 | R019 |
| **L37** | 14.585 | 6.840 | 6.090 | 4+0.11/G-1.27 | R035 |
| **L38** | 14.585 | 6.840 | 4.840 | 4+0.11/E+1.24 | R036 |
| **L39** | 19.085 | 6.840 | -6.090 | 5+0.11/C+1.27 | R020 |
| **L40** | 19.085 | 6.840 | -4.840 | 5+0.11/D-1.24 | R021 |
| **L41** | 19.085 | 6.840 | 6.090 | 5+0.11/G-1.27 | R037 |
| **L42** | 19.085 | 6.840 | 4.840 | 5+0.11/E+1.24 | R038 |
| **L44** | 23.585 | 6.840 | -4.840 | 6+0.11/D-1.24 | R022 |
| **L46** | 23.585 | 6.840 | 4.840 | 6+0.11/E+1.24 | R039 |
| **L59** | 9.250 | 3.650 | -7.250 | 3-0.72/C+0.11 | R023 |
| **L60** | 9.600 | 3.650 | -7.250 | 3-0.38/C+0.11 | R024 |
| **L61** | 9.250 | 3.650 | 7.250 | 3-0.72/G-0.11 | R040 |
| **L62** | 9.600 | 3.650 | 7.250 | 3-0.38/G-0.11 | R041 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

32 equipment / 35 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# L1 / Nave / 3 front bays (6-9)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-004


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

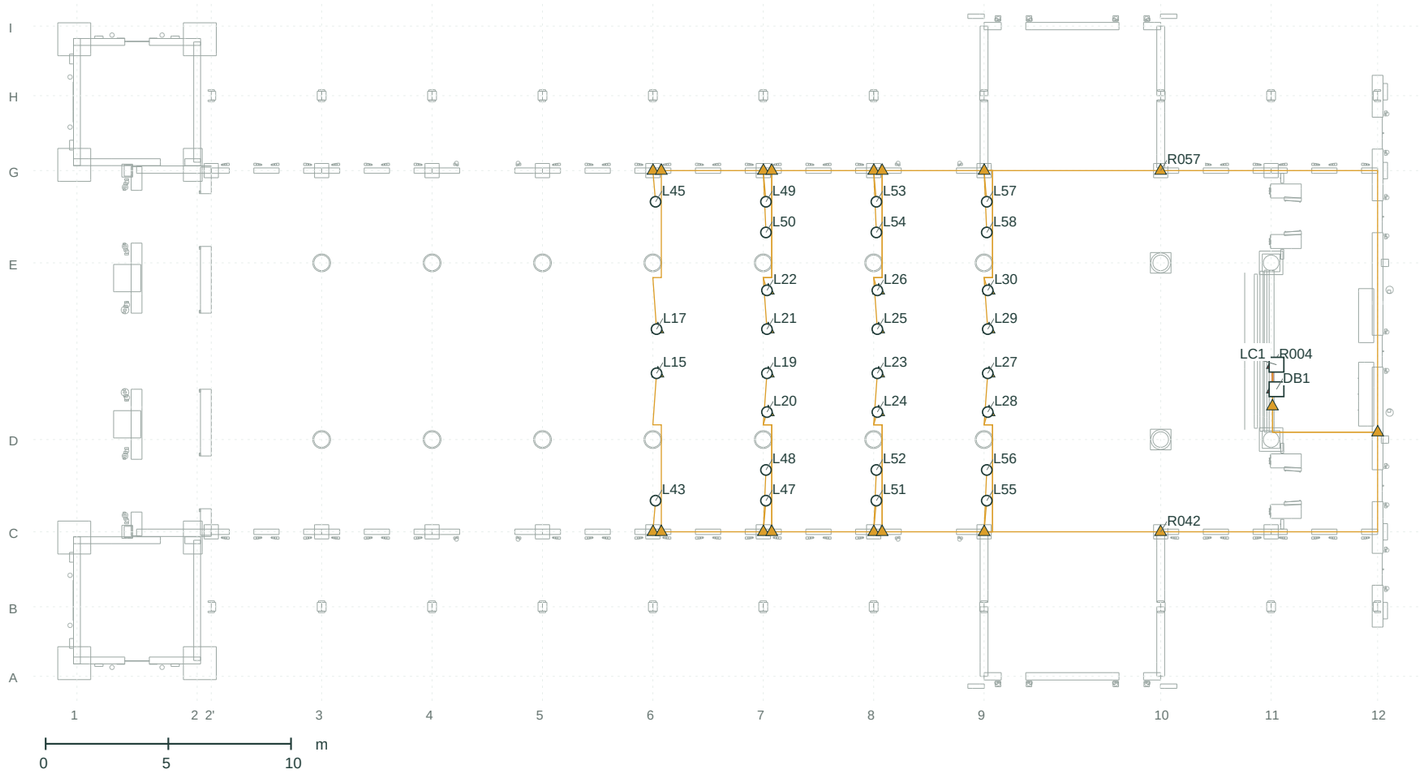


## HEIGHT PROJECTION / X-Y / all Z superimposed

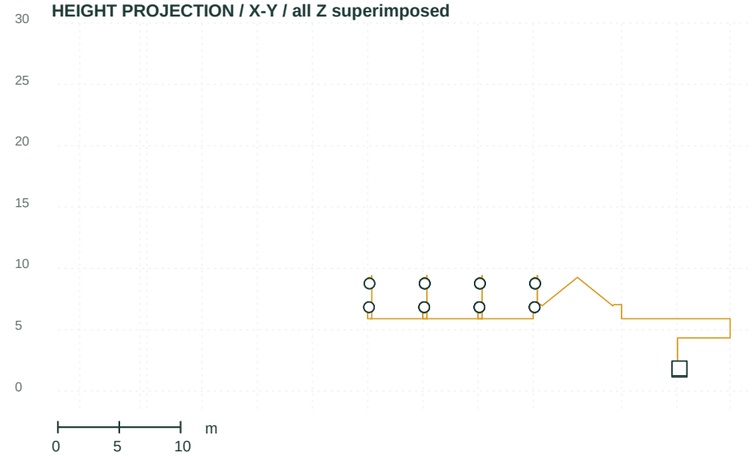


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I02, I14, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L15** | 23.625 | 8.770 | -0.900 | 6+0.15/D+2.70 | R043 |
| **L17** | 23.625 | 8.770 | 0.900 | 6+0.15/E-2.70 | R058 |
| **L19** | 28.125 | 8.770 | -0.900 | 7+0.15/D+2.70 | R044 |
| **L20** | 28.125 | 8.770 | -2.480 | 7+0.15/D+1.12 | R045 |
| **L21** | 28.125 | 8.770 | 0.900 | 7+0.15/E-2.70 | R059 |
| **L22** | 28.125 | 8.770 | 2.480 | 7+0.15/E-1.12 | R060 |
| **L23** | 32.625 | 8.770 | -0.900 | 8+0.15/D+2.70 | R046 |
| **L24** | 32.625 | 8.770 | -2.480 | 8+0.15/D+1.12 | R047 |
| **L25** | 32.625 | 8.770 | 0.900 | 8+0.15/E-2.70 | R061 |
| **L26** | 32.625 | 8.770 | 2.480 | 8+0.15/E-1.12 | R062 |
| **L27** | 37.125 | 8.770 | -0.900 | 9+0.15/D+2.70 | R048 |
| **L28** | 37.125 | 8.770 | -2.480 | 9+0.15/D+1.12 | R049 |
| **L29** | 37.125 | 8.770 | 0.900 | 9+0.15/E-2.70 | R063 |
| **L30** | 37.125 | 8.770 | 2.480 | 9+0.15/E-1.12 | R064 |
| **L43** | 23.585 | 6.840 | -6.090 | 6+0.11/C+1.27 | R050 |
| **L45** | 23.585 | 6.840 | 6.090 | 6+0.11/G-1.27 | R065 |
| **L47** | 28.085 | 6.840 | -6.090 | 7+0.11/C+1.27 | R051 |
| **L48** | 28.085 | 6.840 | -4.840 | 7+0.11/D-1.24 | R052 |
| **L49** | 28.085 | 6.840 | 6.090 | 7+0.11/G-1.27 | R066 |
| **L50** | 28.085 | 6.840 | 4.840 | 7+0.11/E+1.24 | R067 |
| **L51** | 32.585 | 6.840 | -6.090 | 8+0.11/C+1.27 | R053 |
| **L52** | 32.585 | 6.840 | -4.840 | 8+0.11/D-1.24 | R054 |
| **L53** | 32.585 | 6.840 | 6.090 | 8+0.11/G-1.27 | R068 |
| **L54** | 32.585 | 6.840 | 4.840 | 8+0.11/E+1.24 | R069 |
| **L55** | 37.085 | 6.840 | -6.090 | 9+0.11/C+1.27 | R055 |
| **L56** | 37.085 | 6.840 | -4.840 | 9+0.11/D-1.24 | R056 |
| **L57** | 37.085 | 6.840 | 6.090 | 9+0.11/G-1.27 | R070 |
| **L58** | 37.085 | 6.840 | 4.840 | 9+0.11/E+1.24 | R071 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

Source commit 7e3547d9af + file hashes in manifest | Routing 2026-10-18-concealed-2

MODEL TRANSCRIPTION / DERIVED. Metres; displayed decimals are not survey accuracy. Review before installation.

**A3 / sheet 05**

Print 100% / no fit-to-page

THACH BI CHURCH

# LA / Roof uplight


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-005


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

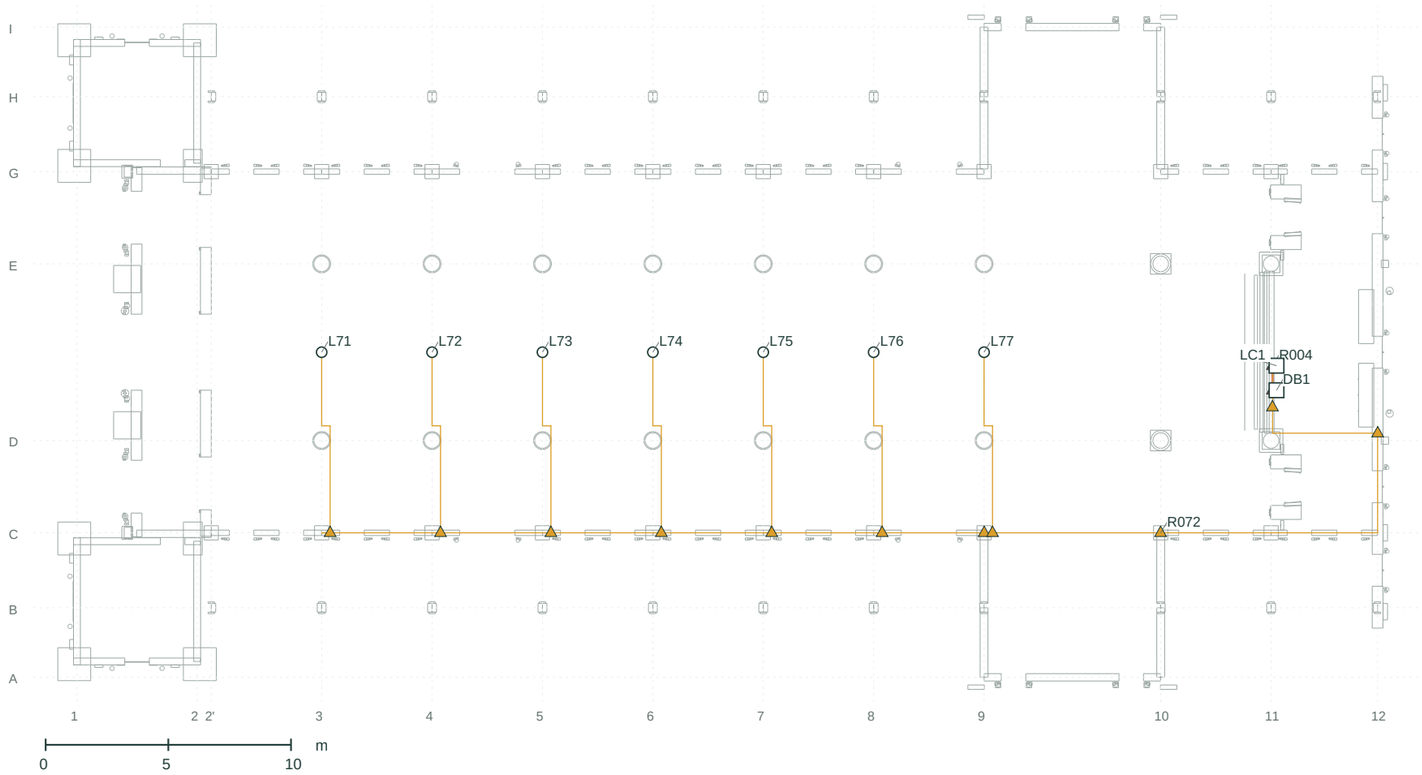


## HEIGHT PROJECTION / X-Y / all Z superimposed

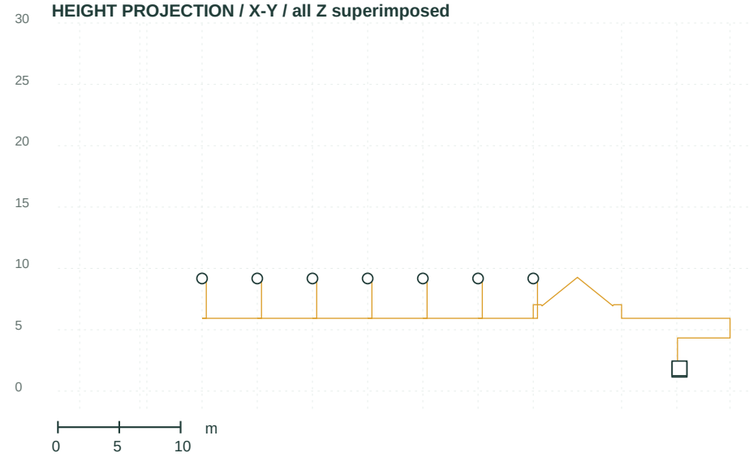


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L71** | 9.975 | 9.180 | 0.000 | 3+0.00/D+3.60 | R073 |
| **L72** | 14.475 | 9.180 | 0.000 | 4+0.00/D+3.60 | R074 |
| **L73** | 18.975 | 9.180 | 0.000 | 5+0.00/D+3.60 | R075 |
| **L74** | 23.475 | 9.180 | 0.000 | 6+0.00/D+3.60 | R076 |
| **L75** | 27.975 | 9.180 | 0.000 | 7+0.00/D+3.60 | R077 |
| **L76** | 32.475 | 9.180 | 0.000 | 8+0.00/D+3.60 | R078 |
| **L77** | 36.975 | 9.180 | 0.000 | 9+0.00/D+3.60 | R079 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

7 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I02, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# L4 / Circulation & verandas


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-006-1


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

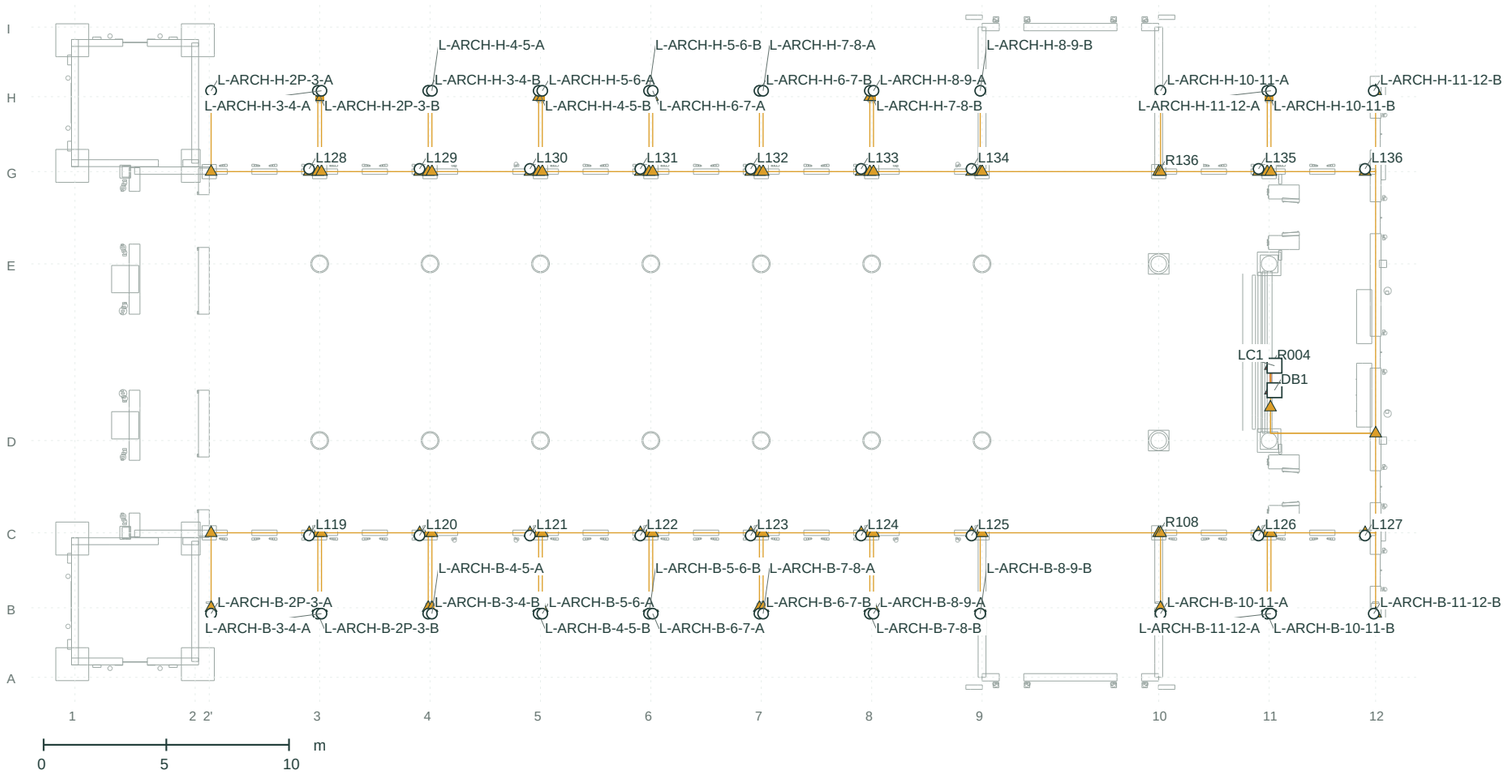


## HEIGHT PROJECTION / X-Y / all Z superimposed

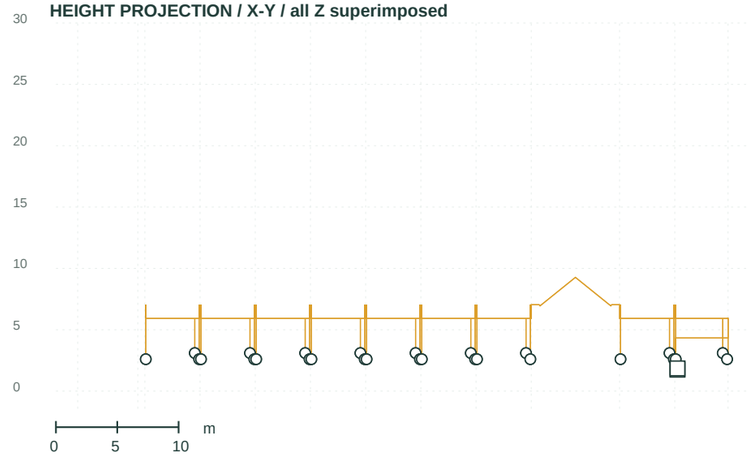


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I17, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L119** | 9.545 | 3.100 | -7.470 | 3-0.43/C-0.11 | R109 |
| **L120** | 14.045 | 3.100 | -7.470 | 4-0.43/C-0.11 | R110 |
| **L121** | 18.545 | 3.100 | -7.470 | 5-0.43/C-0.11 | R111 |
| **L122** | 23.045 | 3.100 | -7.470 | 6-0.43/C-0.11 | R112 |
| **L123** | 27.545 | 3.100 | -7.470 | 7-0.43/C-0.11 | R113 |
| **L124** | 32.045 | 3.100 | -7.470 | 8-0.43/C-0.11 | R114 |
| **L125** | 36.545 | 3.100 | -7.470 | 9-0.43/C-0.11 | R115 |
| **L126** | 48.245 | 3.100 | -7.470 | 11-0.43/C-0.11 | R116 |
| **L127** | 52.586 | 3.100 | -7.470 | 12-0.43/C-0.11 | R117 |
| **L128** | 9.545 | 3.100 | 7.470 | 3-0.43/G+0.11 | R137 |
| **L129** | 14.045 | 3.100 | 7.470 | 4-0.43/G+0.11 | R138 |
| **L130** | 18.545 | 3.100 | 7.470 | 5-0.43/G+0.11 | R139 |
| **L131** | 23.045 | 3.100 | 7.470 | 6-0.43/G+0.11 | R140 |
| **L132** | 27.545 | 3.100 | 7.470 | 7-0.43/G+0.11 | R141 |
| **L133** | 32.045 | 3.100 | 7.470 | 8-0.43/G+0.11 | R142 |
| **L134** | 36.545 | 3.100 | 7.470 | 9-0.43/G+0.11 | R143 |
| **L135** | 48.245 | 3.100 | 7.470 | 11-0.43/G+0.11 | R144 |
| **L136** | 52.586 | 3.100 | 7.470 | 12-0.43/G+0.11 | R145 |
| **L-ARCH-B-2P-3-A** | 5.550 | 2.600 | -10.654 | 2'+0.08/B-0.24 | R118 |
| **L-ARCH-B-2P-3-B** | 9.900 | 2.600 | -10.654 | 3-0.07/B-0.24 | R119 |
| **L-ARCH-B-3-4-A** | 10.050 | 2.600 | -10.654 | 3+0.07/B-0.24 | R120 |
| **L-ARCH-B-3-4-B** | 14.400 | 2.600 | -10.654 | 4-0.07/B-0.24 | R121 |
| **L-ARCH-B-4-5-A** | 14.550 | 2.600 | -10.654 | 4+0.07/B-0.24 | R122 |
| **L-ARCH-B-4-5-B** | 18.900 | 2.600 | -10.654 | 5-0.07/B-0.24 | R123 |
| **L-ARCH-B-5-6-A** | 19.050 | 2.600 | -10.654 | 5+0.07/B-0.24 | R124 |
| **L-ARCH-B-5-6-B** | 23.400 | 2.600 | -10.654 | 6-0.07/B-0.24 | R125 |
| **L-ARCH-B-6-7-A** | 23.550 | 2.600 | -10.654 | 6+0.07/B-0.24 | R126 |
| **L-ARCH-B-6-7-B** | 27.900 | 2.600 | -10.654 | 7-0.07/B-0.24 | R127 |
| **L-ARCH-B-7-8-A** | 28.050 | 2.600 | -10.654 | 7+0.07/B-0.24 | R128 |
| **L-ARCH-B-7-8-B** | 32.400 | 2.600 | -10.654 | 8-0.08/B-0.24 | R129 |
| **L-ARCH-B-8-9-A** | 32.550 | 2.600 | -10.654 | 8+0.08/B-0.24 | R130 |
| **L-ARCH-B-8-9-B** | 36.900 | 2.600 | -10.654 | 9-0.08/B-0.24 | R131 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

54 equipment / 57 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# L4 / Circulation & verandas


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-006-2


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

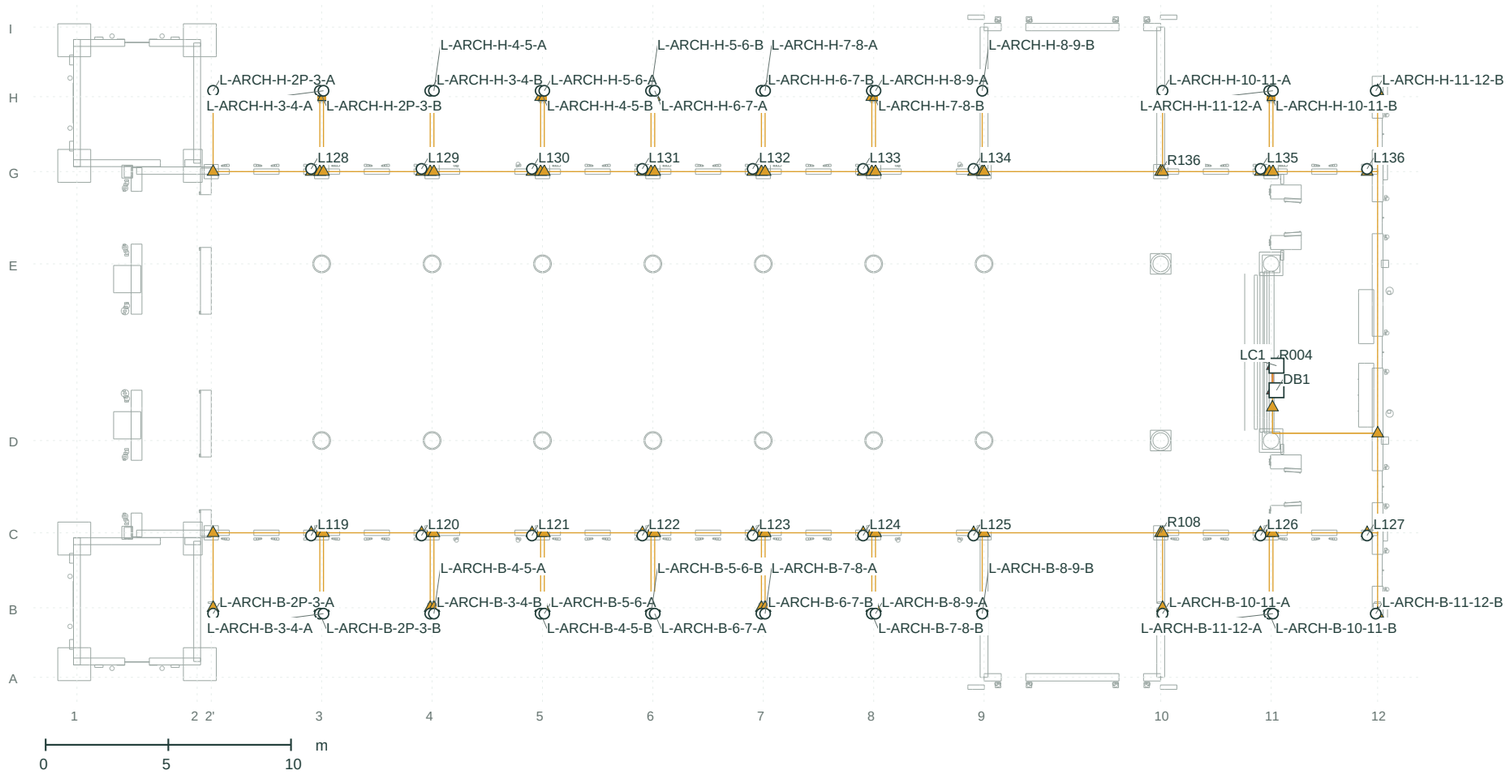


## HEIGHT PROJECTION / X-Y / all Z superimposed

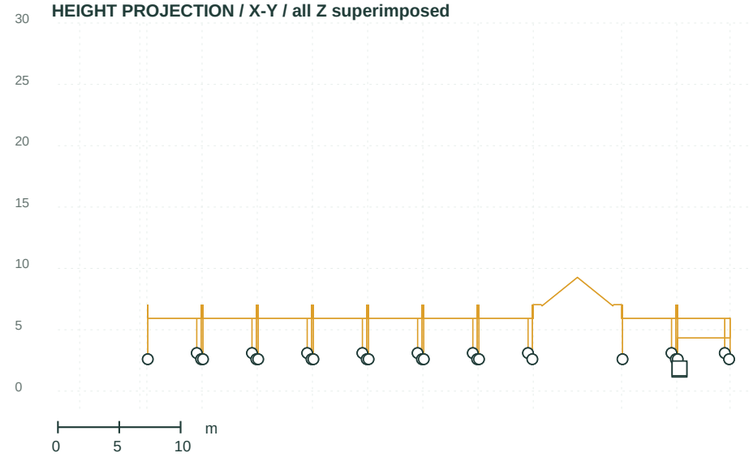


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I17, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L-ARCH-B-10-11-A** | 44.250 | 2.600 | -10.654 | 10+0.08/B-0.24 | R132 |
| **L-ARCH-B-10-11-B** | 48.600 | 2.600 | -10.654 | 11-0.08/B-0.24 | R133 |
| **L-ARCH-B-11-12-A** | 48.750 | 2.600 | -10.654 | 11+0.08/B-0.24 | R134 |
| **L-ARCH-B-11-12-B** | 52.941 | 2.600 | -10.654 | 12-0.08/B-0.24 | R135 |
| **L-ARCH-H-2P-3-A** | 5.550 | 2.600 | 10.654 | 2'+0.08/H+0.24 | R146 |
| **L-ARCH-H-2P-3-B** | 9.900 | 2.600 | 10.654 | 3-0.07/H+0.24 | R147 |
| **L-ARCH-H-3-4-A** | 10.050 | 2.600 | 10.654 | 3+0.07/H+0.24 | R148 |
| **L-ARCH-H-3-4-B** | 14.400 | 2.600 | 10.654 | 4-0.07/H+0.24 | R149 |
| **L-ARCH-H-4-5-A** | 14.550 | 2.600 | 10.654 | 4+0.07/H+0.24 | R150 |
| **L-ARCH-H-4-5-B** | 18.900 | 2.600 | 10.654 | 5-0.07/H+0.24 | R151 |
| **L-ARCH-H-5-6-A** | 19.050 | 2.600 | 10.654 | 5+0.07/H+0.24 | R152 |
| **L-ARCH-H-5-6-B** | 23.400 | 2.600 | 10.654 | 6-0.07/H+0.24 | R153 |
| **L-ARCH-H-6-7-A** | 23.550 | 2.600 | 10.654 | 6+0.07/H+0.24 | R154 |
| **L-ARCH-H-6-7-B** | 27.900 | 2.600 | 10.654 | 7-0.07/H+0.24 | R155 |
| **L-ARCH-H-7-8-A** | 28.050 | 2.600 | 10.654 | 7+0.07/H+0.24 | R156 |
| **L-ARCH-H-7-8-B** | 32.400 | 2.600 | 10.654 | 8-0.08/H+0.24 | R157 |
| **L-ARCH-H-8-9-A** | 32.550 | 2.600 | 10.654 | 8+0.08/H+0.24 | R158 |
| **L-ARCH-H-8-9-B** | 36.900 | 2.600 | 10.654 | 9-0.08/H+0.24 | R159 |
| **L-ARCH-H-10-11-A** | 44.250 | 2.600 | 10.654 | 10+0.08/H+0.24 | R160 |
| **L-ARCH-H-10-11-B** | 48.600 | 2.600 | 10.654 | 11-0.08/H+0.24 | R161 |
| **L-ARCH-H-11-12-A** | 48.750 | 2.600 | 10.654 | 11+0.08/H+0.24 | R162 |
| **L-ARCH-H-11-12-B** | 52.941 | 2.600 | 10.654 | 12-0.08/H+0.24 | R163 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

54 equipment / 57 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# L9 / Front stage & central door


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-007


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

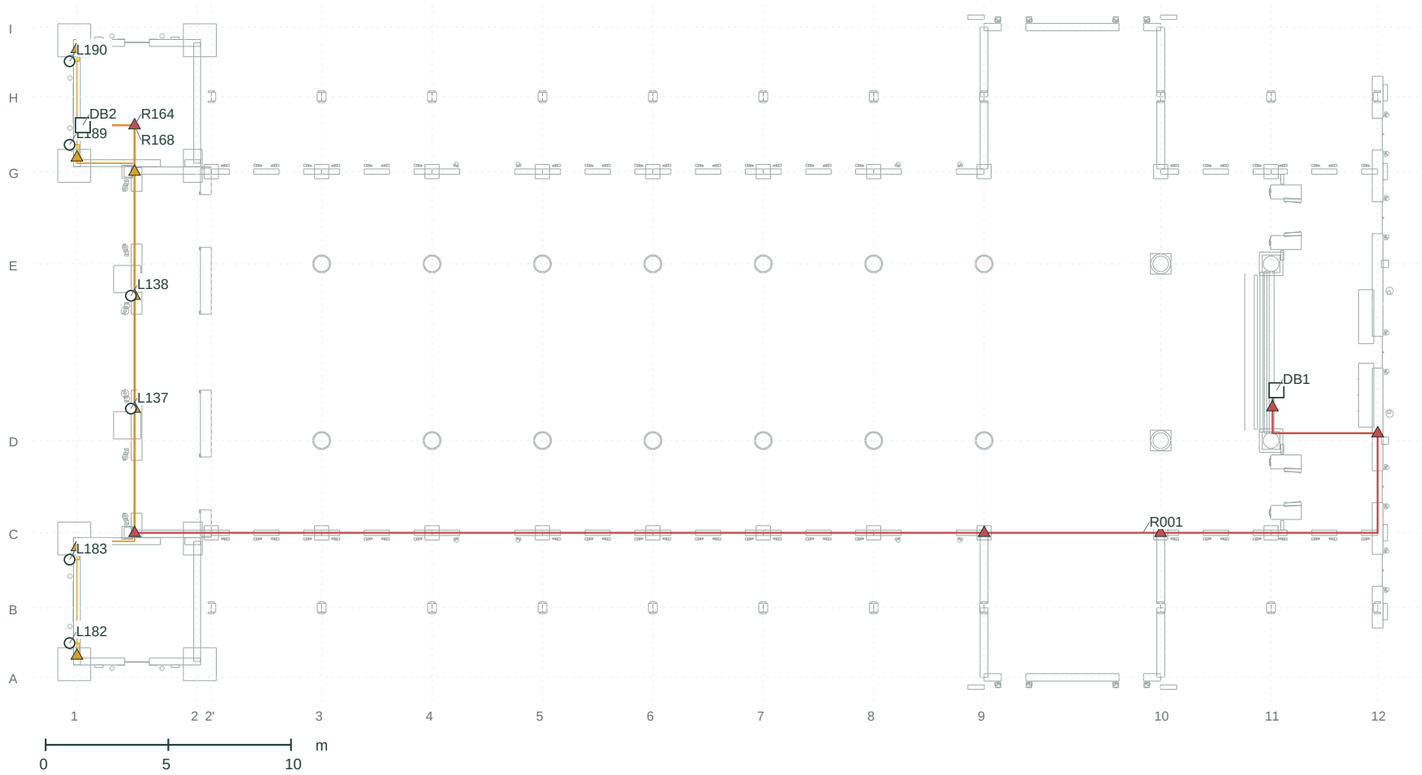


## HEIGHT PROJECTION / X-Y / all Z superimposed

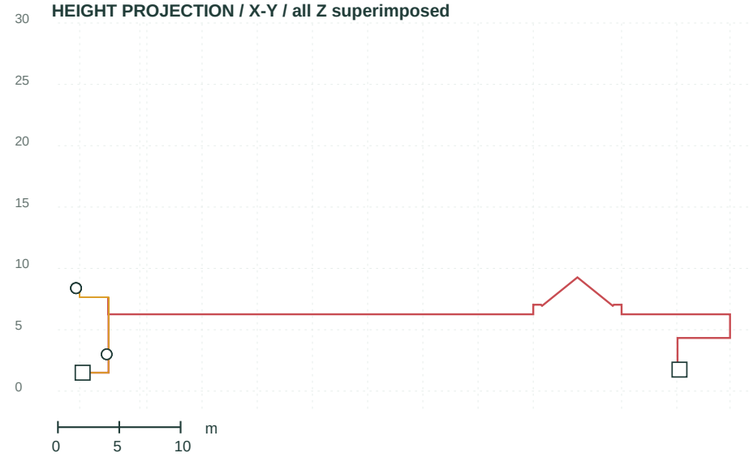


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L137** | 2.200 | 3.000 | -2.300 | 1+2.20/D+1.30 | R165 |
| **L138** | 2.200 | 3.000 | 2.300 | 1+2.20/E-1.30 | R169 |
| **L182** | -0.300 | 8.390 | -11.853 | 1-0.30/A+1.40 | R166 |
| **L183** | -0.300 | 8.390 | -8.453 | 1-0.30/C-1.09 | R167 |
| **L189** | -0.300 | 8.390 | 8.453 | 1-0.30/G+1.09 | R170 |
| **L190** | -0.300 | 8.390 | 11.853 | 1-0.30/I-1.40 | R171 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 |

6 equipment / 9 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I22, I25, I26 (key on sheet IM-01).

THACH BI CHURCH

# L5 / Steps & paths


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-008


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

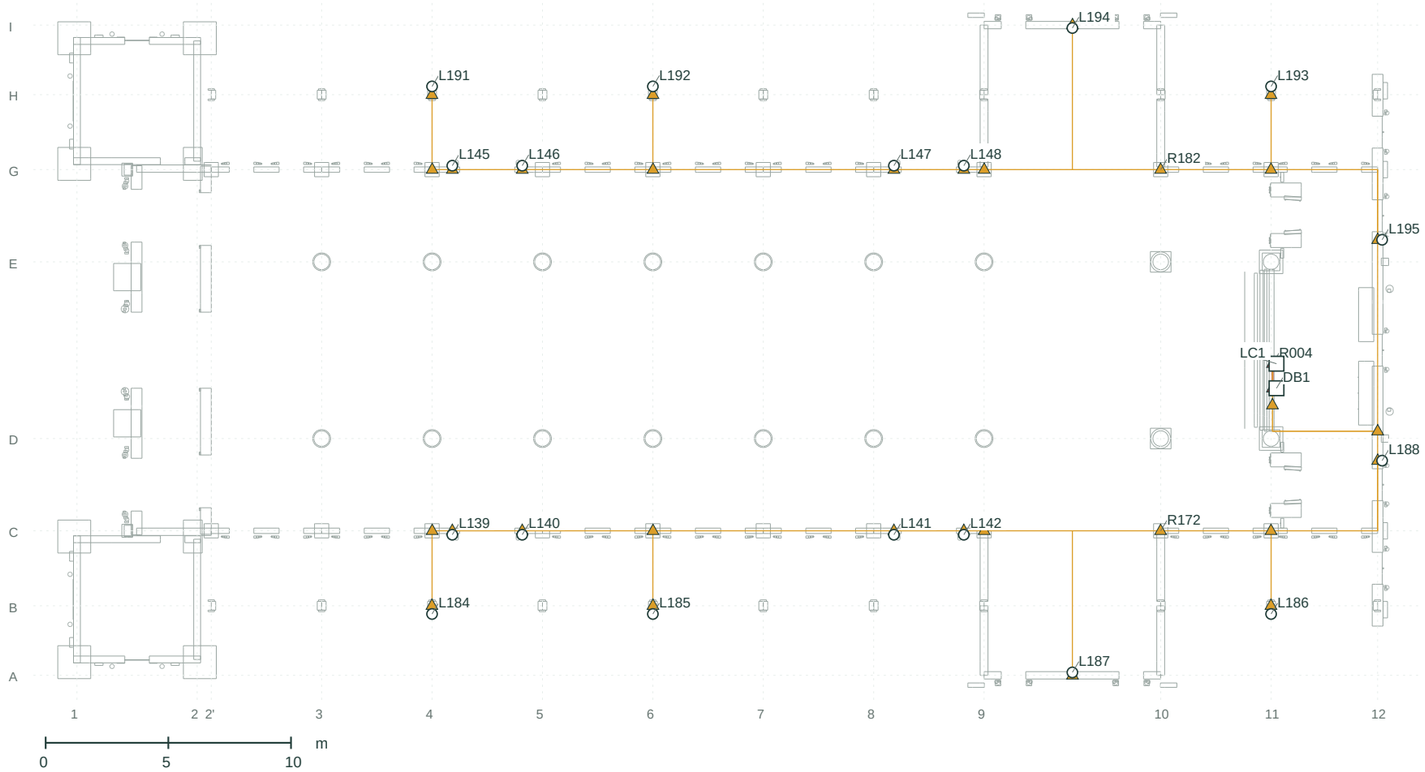


## HEIGHT PROJECTION / X-Y / all Z superimposed

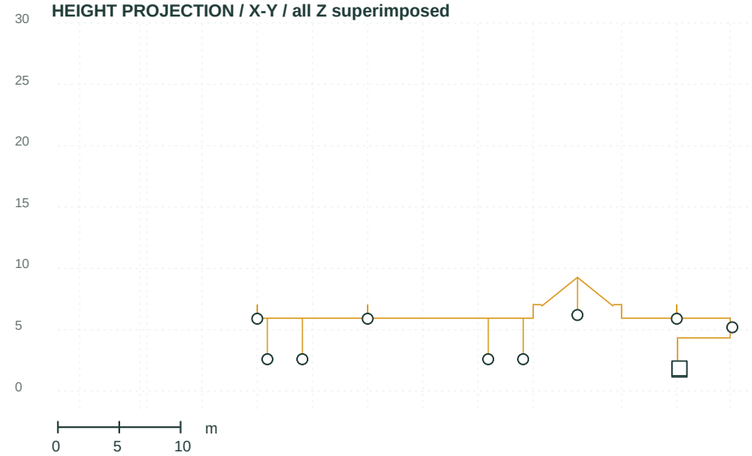


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I17, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L139** | 15.300 | 2.600 | -7.520 | 4+0.83/C-0.16 | R173 |
| **L140** | 18.150 | 2.600 | -7.520 | 5-0.82/C-0.16 | R174 |
| **L141** | 33.300 | 2.600 | -7.520 | 8+0.83/C-0.16 | R175 |
| **L142** | 36.150 | 2.600 | -7.520 | 9-0.83/C-0.16 | R176 |
| **L145** | 15.300 | 2.600 | 7.520 | 4+0.83/G+0.16 | R183 |
| **L146** | 18.150 | 2.600 | 7.520 | 5-0.82/G+0.16 | R184 |
| **L147** | 33.300 | 2.600 | 7.520 | 8+0.83/G+0.16 | R185 |
| **L148** | 36.150 | 2.600 | 7.520 | 9-0.83/G+0.16 | R186 |
| **L184** | 14.475 | 5.900 | -10.750 | 4+0.00/B-0.34 | R177 |
| **L185** | 23.475 | 5.900 | -10.750 | 6+0.00/B-0.34 | R178 |
| **L186** | 48.675 | 5.900 | -10.750 | 11+0.00/B-0.34 | R179 |
| **L187** | 40.575 | 6.200 | -13.130 | 9+3.60/A+0.12 | R180 |
| **L188** | 53.200 | 5.200 | -4.500 | 12+0.18/D-0.90 | R181 |
| **L191** | 14.475 | 5.900 | 10.750 | 4+0.00/H+0.34 | R187 |
| **L192** | 23.475 | 5.900 | 10.750 | 6+0.00/H+0.34 | R188 |
| **L193** | 48.675 | 5.900 | 10.750 | 11+0.00/H+0.34 | R189 |
| **L194** | 40.575 | 6.200 | 13.130 | 9+3.60/I-0.12 | R190 |
| **L195** | 53.200 | 5.200 | 4.500 | 12+0.18/E+0.90 | R191 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

18 equipment / 21 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# E1 / Exit signs


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-009


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

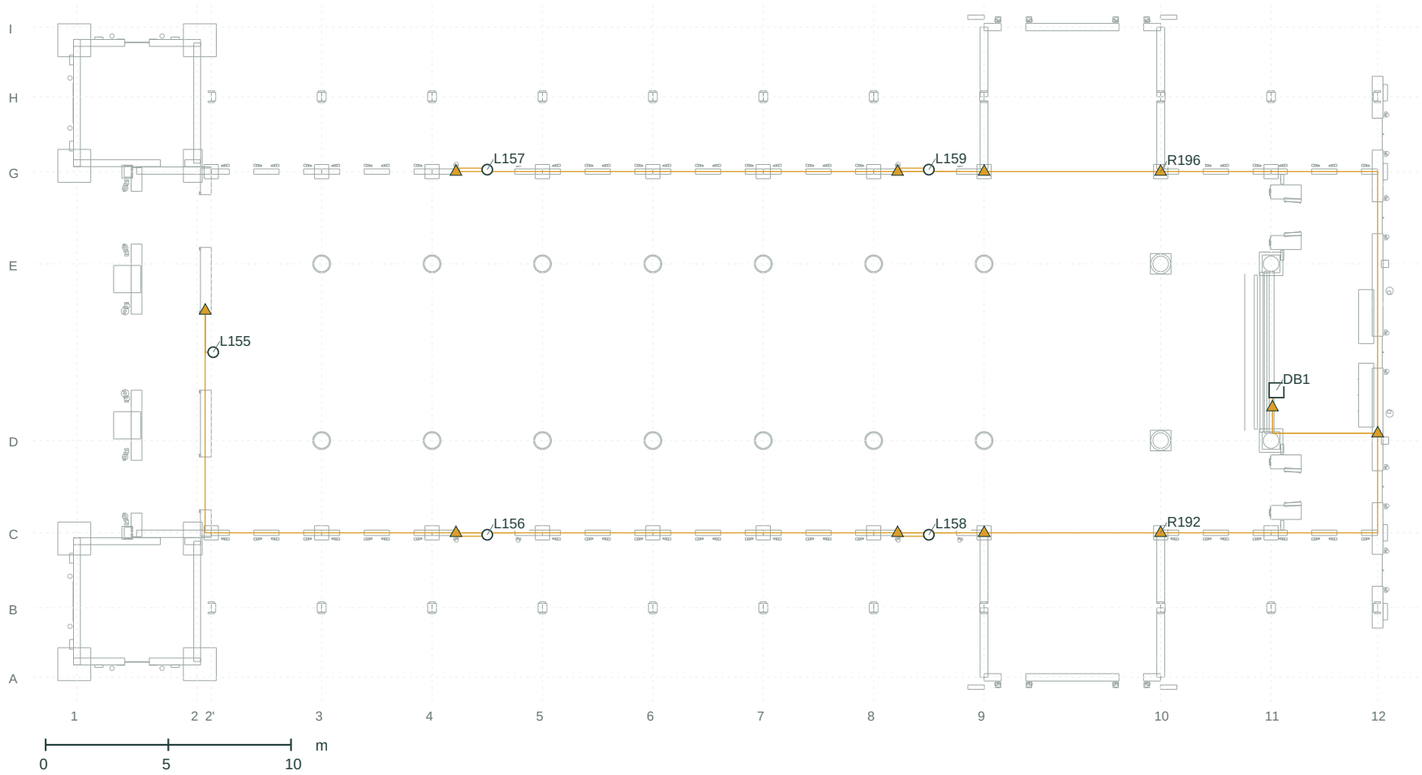


## HEIGHT PROJECTION / X-Y / all Z superimposed

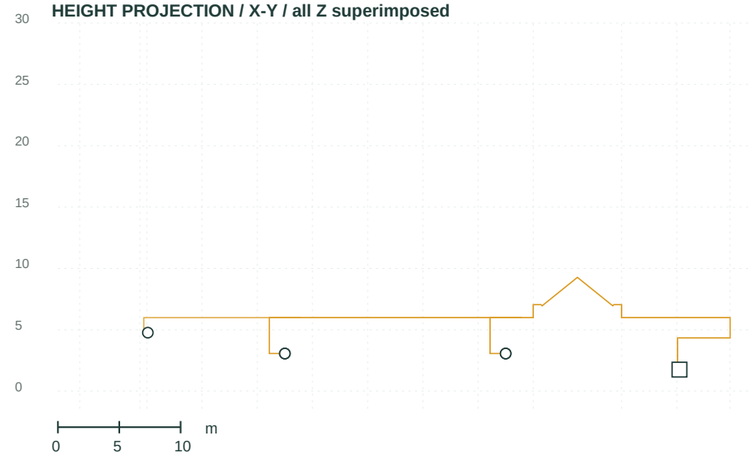


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L155** | 5.555 | 4.762 | 0.000 | 2'+0.08/D+3.60 | R193 |
| **L156** | 16.725 | 3.061 | -7.440 | 4+2.25/C-0.08 | R194 |
| **L157** | 16.725 | 3.061 | 7.440 | 4+2.25/G+0.08 | R197 |
| **L158** | 34.725 | 3.061 | -7.440 | 8+2.25/C-0.08 | R195 |
| **L159** | 34.725 | 3.061 | 7.440 | 8+2.25/G+0.08 | R198 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |

5 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I13, I24, I25 (key on sheet IM-01).

THACH BI CHURCH

# L6 / Facade & towers


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-010


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

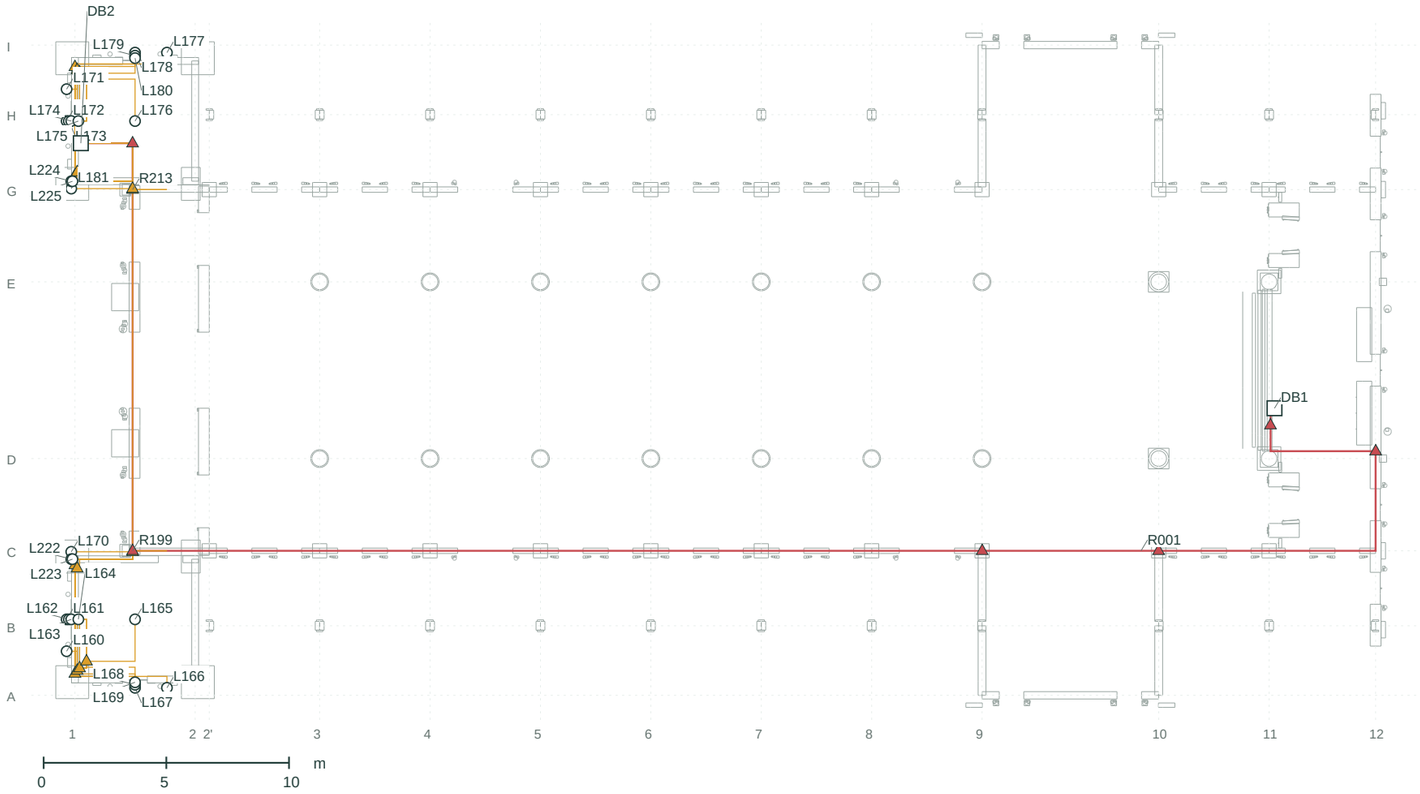


## HEIGHT PROJECTION / X-Y / all Z superimposed

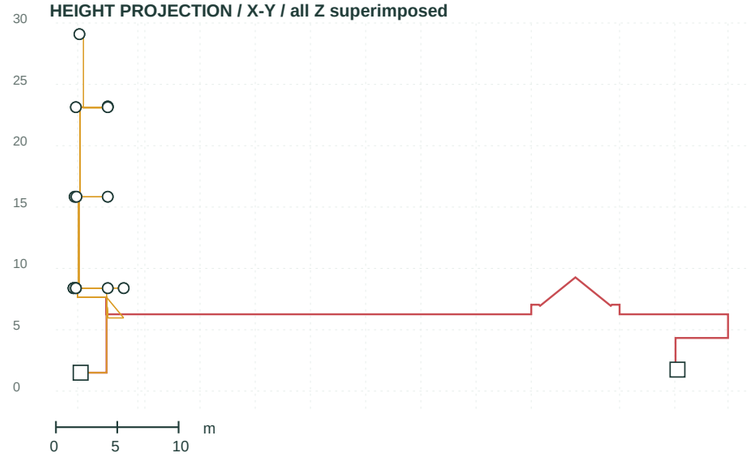


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I22, I23, I25, I26 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L160** | -0.340 | 8.390 | -11.453 | 1-0.34/B-1.04 | R200 |
| **L161** | -0.340 | 8.390 | -10.153 | 1-0.34/B+0.26 | R201 |
| **L162** | -0.250 | 15.840 | -10.153 | 1-0.25/B+0.26 | R202 |
| **L163** | -0.150 | 23.140 | -10.153 | 1-0.15/B+0.26 | R203 |
| **L164** | 0.140 | 29.090 | -10.153 | 1+0.14/B+0.26 | R204 |
| **L165** | 2.450 | 23.200 | -10.153 | 1+2.45/B+0.26 | R205 |
| **L166** | 3.750 | 8.390 | -12.943 | 2-1.15/A+0.31 | R206 |
| **L167** | 2.450 | 8.390 | -12.943 | 1+2.45/A+0.31 | R207 |
| **L168** | 2.450 | 15.840 | -12.818 | 1+2.45/A+0.43 | R208 |
| **L169** | 2.450 | 23.140 | -12.718 | 1+2.45/A+0.53 | R209 |
| **L170** | -0.150 | 8.390 | -7.400 | 1-0.15/C-0.04 | R210 |
| **L171** | -0.340 | 8.390 | 11.453 | 1-0.34/H+1.04 | R214 |
| **L172** | -0.340 | 8.390 | 10.153 | 1-0.34/H-0.26 | R215 |
| **L173** | -0.250 | 15.840 | 10.153 | 1-0.25/H-0.26 | R216 |
| **L174** | -0.150 | 23.140 | 10.153 | 1-0.15/H-0.26 | R217 |
| **L175** | 0.140 | 29.090 | 10.153 | 1+0.14/H-0.26 | R218 |
| **L176** | 2.450 | 23.200 | 10.153 | 1+2.45/H-0.26 | R219 |
| **L177** | 3.750 | 8.390 | 12.943 | 2-1.15/I-0.31 | R220 |
| **L178** | 2.450 | 8.390 | 12.943 | 1+2.45/I-0.31 | R221 |
| **L179** | 2.450 | 15.840 | 12.818 | 1+2.45/I-0.43 | R222 |
| **L180** | 2.450 | 23.140 | 12.718 | 1+2.45/I-0.53 | R223 |
| **L181** | -0.150 | 8.390 | 7.400 | 1-0.15/G+0.04 | R224 |
| **L222** | -0.150 | 8.390 | -7.700 | 1-0.15/C-0.34 | R211 |
| **L223** | -0.100 | 15.840 | -7.700 | 1-0.10/C-0.34 | R212 |
| **L224** | -0.150 | 8.390 | 7.700 | 1-0.15/G+0.34 | R225 |
| **L225** | -0.100 | 15.840 | 7.700 | 1-0.10/G+0.34 | R226 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 |

26 equipment / 29 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# L7 / Festival exterior (strings & tower floods)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-011


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

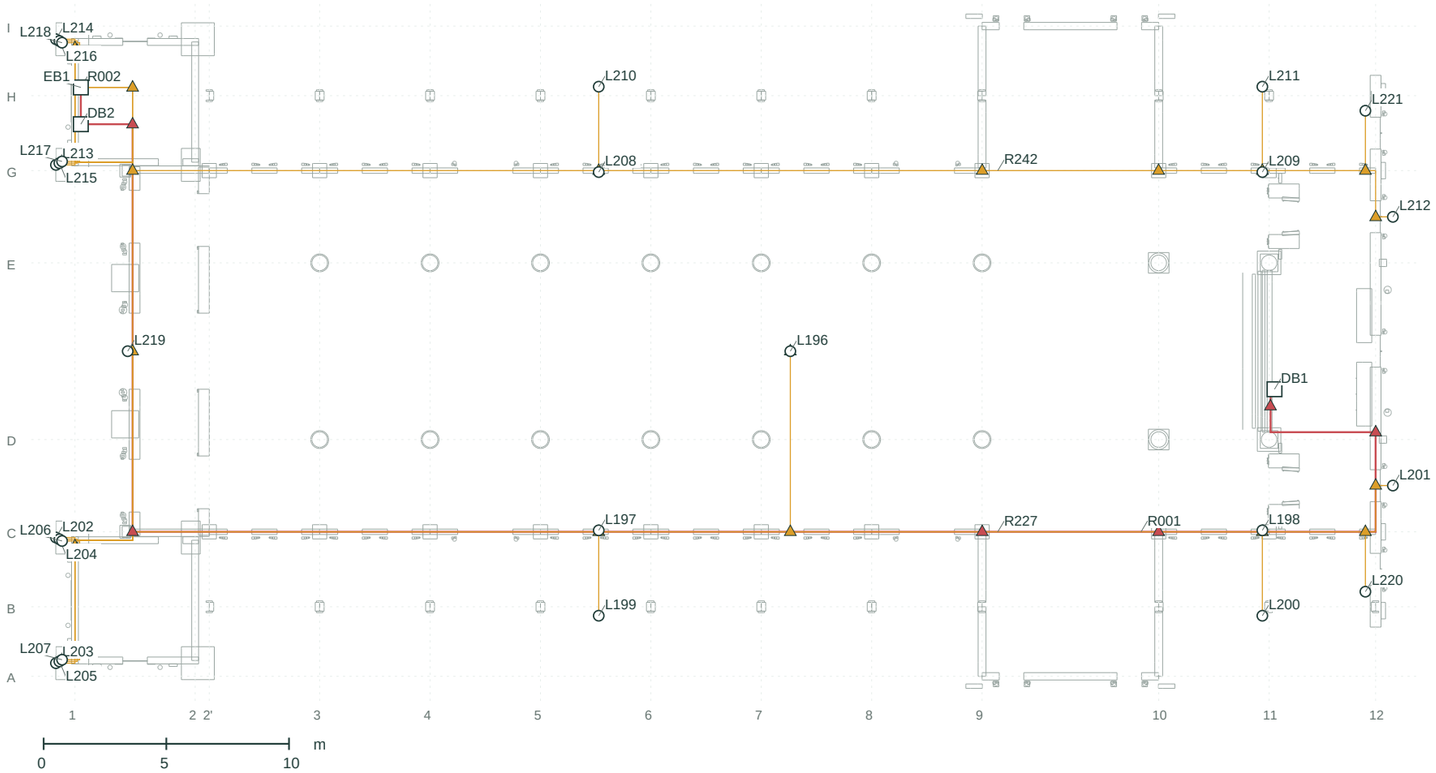


## HEIGHT PROJECTION / X-Y / all Z superimposed

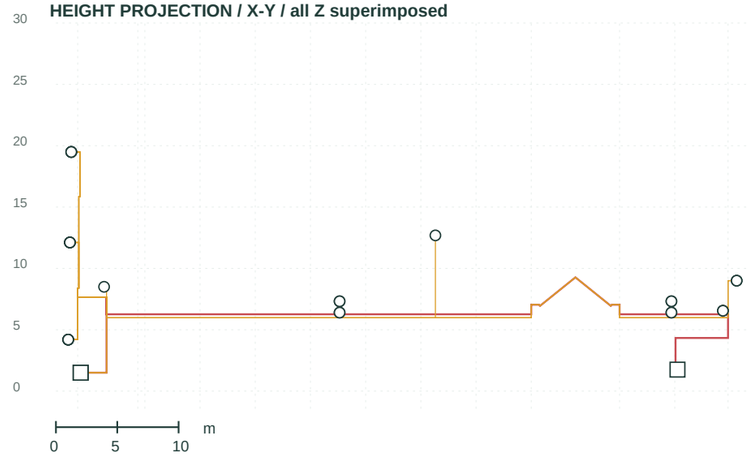


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I09, I17, I21, I22, I25, I26 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L196** | 29.160 | 12.690 | 0.000 | 7+1.18/D+3.60 | R228 |
| **L197** | 21.350 | 7.320 | -7.300 | 6-2.12/C+0.06 | R229 |
| **L198** | 48.400 | 7.320 | -7.300 | 11-0.27/C+0.06 | R230 |
| **L199** | 21.350 | 6.400 | -10.780 | 6-2.12/B-0.37 | R231 |
| **L200** | 48.400 | 6.400 | -10.780 | 11-0.27/B-0.37 | R232 |
| **L201** | 53.720 | 9.000 | -5.475 | 12+0.70/D-1.87 | R233 |
| **L202** | -0.775 | 4.195 | -7.593 | 1-0.77/C-0.23 | R234 |
| **L203** | -0.775 | 4.195 | -12.713 | 1-0.77/A+0.54 | R235 |
| **L204** | -0.635 | 12.115 | -7.663 | 1-0.64/C-0.30 | R236 |
| **L205** | -0.635 | 12.115 | -12.643 | 1-0.64/A+0.61 | R237 |
| **L206** | -0.525 | 19.490 | -7.733 | 1-0.53/C-0.37 | R238 |
| **L207** | -0.525 | 19.490 | -12.573 | 1-0.53/A+0.68 | R239 |
| **L208** | 21.350 | 7.320 | 7.300 | 6-2.12/G-0.06 | R243 |
| **L209** | 48.400 | 7.320 | 7.300 | 11-0.27/G-0.06 | R244 |
| **L210** | 21.350 | 6.400 | 10.780 | 6-2.12/H+0.37 | R245 |
| **L211** | 48.400 | 6.400 | 10.780 | 11-0.27/H+0.37 | R246 |
| **L212** | 53.720 | 9.000 | 5.475 | 12+0.70/E+1.87 | R247 |
| **L213** | -0.775 | 4.195 | 7.593 | 1-0.77/G+0.23 | R248 |
| **L214** | -0.775 | 4.195 | 12.713 | 1-0.77/I-0.54 | R249 |
| **L215** | -0.635 | 12.115 | 7.663 | 1-0.64/G+0.30 | R250 |
| **L216** | -0.635 | 12.115 | 12.643 | 1-0.64/I-0.61 | R251 |
| **L217** | -0.525 | 19.490 | 7.733 | 1-0.53/G+0.37 | R252 |
| **L218** | -0.525 | 19.490 | 12.573 | 1-0.53/I-0.68 | R253 |
| **L219** | 2.150 | 8.500 | 0.000 | 1+2.15/D+3.60 | R240 |
| **L220** | 52.600 | 6.550 | -9.800 | 12-0.42/B+0.61 | R241 |
| **L221** | 52.600 | 6.550 | 9.800 | 12-0.42/H-0.61 | R254 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 | |
| **EB1** | 0.240 | 1.500 | 10.750 | 1+0.24/H+0.34 | |

26 equipment / 30 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# F1 / Ceiling fans


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-012


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

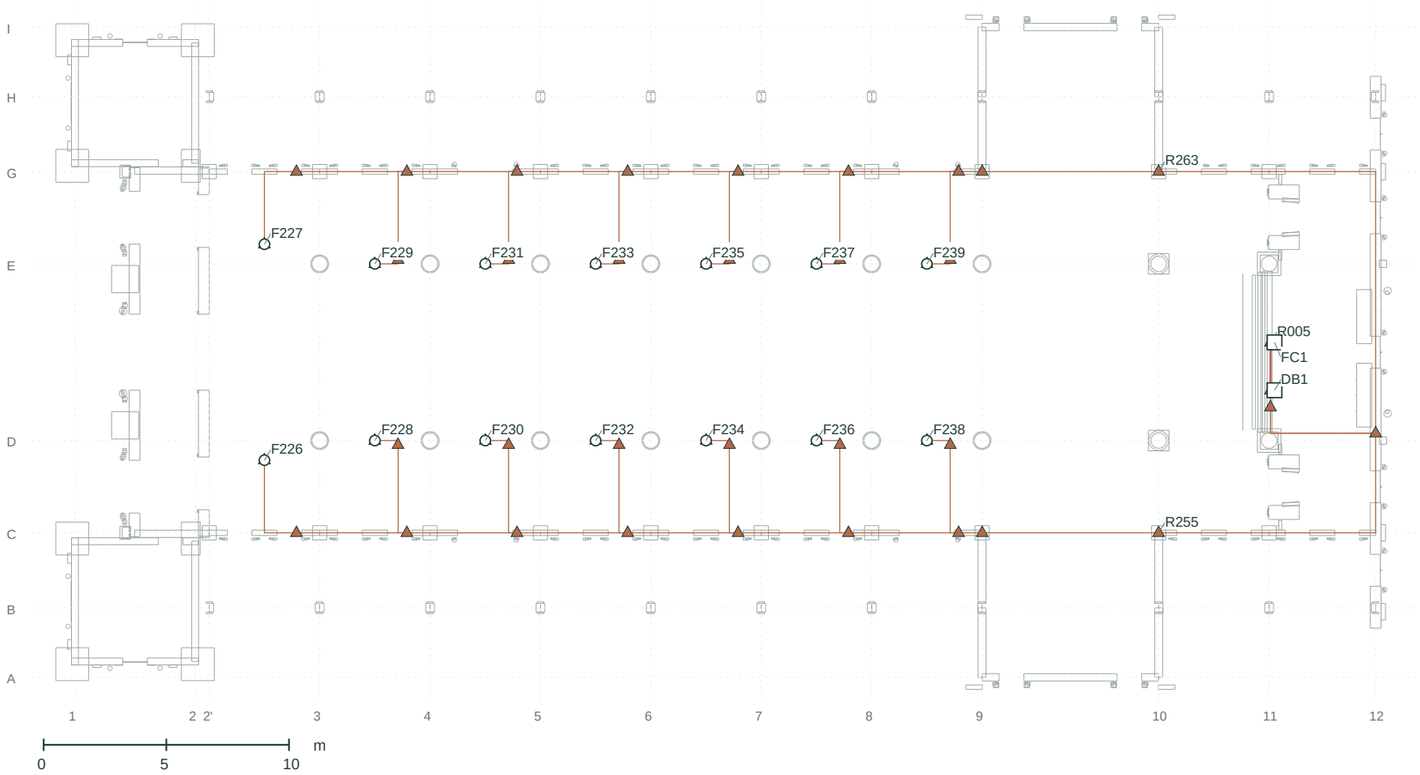


## HEIGHT PROJECTION / X-Y / all Z superimposed

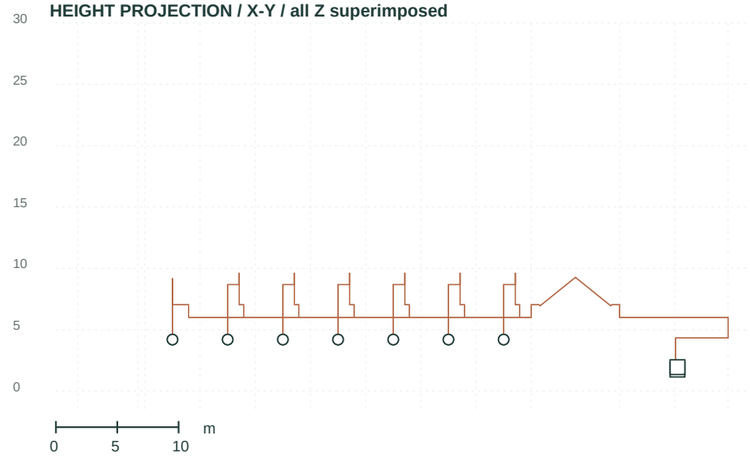


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F226** | 7.725 | 4.200 | -4.400 | 2'+2.25/D-0.80 | R256 |
| **F227** | 7.725 | 4.200 | 4.400 | 2'+2.25/E+0.80 | R264 |
| **F228** | 12.225 | 4.200 | -3.600 | 3+2.25/D+0.00 | R257 |
| **F229** | 12.225 | 4.200 | 3.600 | 3+2.25/E+0.00 | R265 |
| **F230** | 16.725 | 4.200 | -3.600 | 4+2.25/D+0.00 | R258 |
| **F231** | 16.725 | 4.200 | 3.600 | 4+2.25/E+0.00 | R266 |
| **F232** | 21.225 | 4.200 | -3.600 | 5+2.25/D+0.00 | R259 |
| **F233** | 21.225 | 4.200 | 3.600 | 5+2.25/E+0.00 | R267 |
| **F234** | 25.725 | 4.200 | -3.600 | 6+2.25/D+0.00 | R260 |
| **F235** | 25.725 | 4.200 | 3.600 | 6+2.25/E+0.00 | R268 |
| **F236** | 30.225 | 4.200 | -3.600 | 7+2.25/D+0.00 | R261 |
| **F237** | 30.225 | 4.200 | 3.600 | 7+2.25/E+0.00 | R269 |
| **F238** | 34.725 | 4.200 | -3.600 | 8+2.25/D+0.00 | R262 |
| **F239** | 34.725 | 4.200 | 3.600 | 8+2.25/E+0.00 | R270 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 |

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I03, I04, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# F5 / Wing wall fans / held review


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-013


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

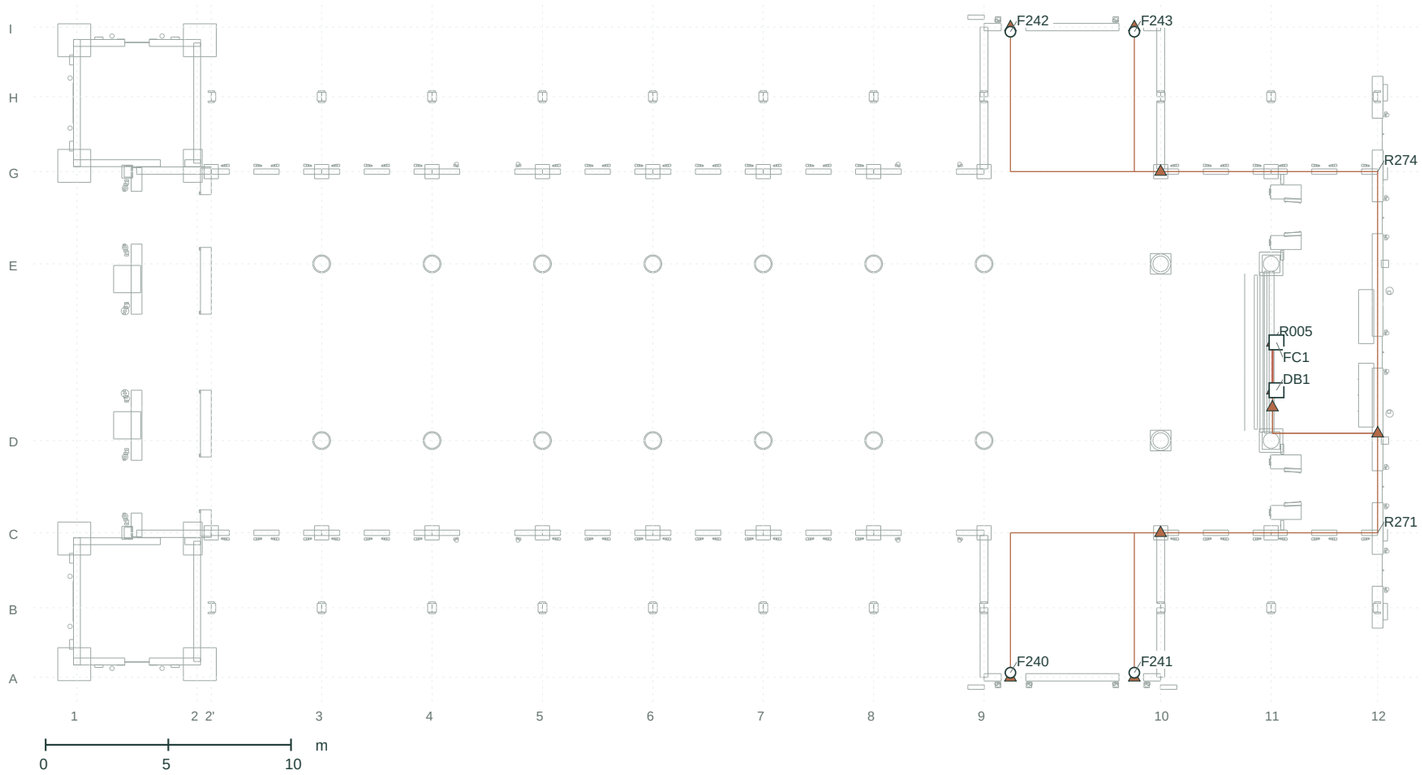


## HEIGHT PROJECTION / X-Y / all Z superimposed

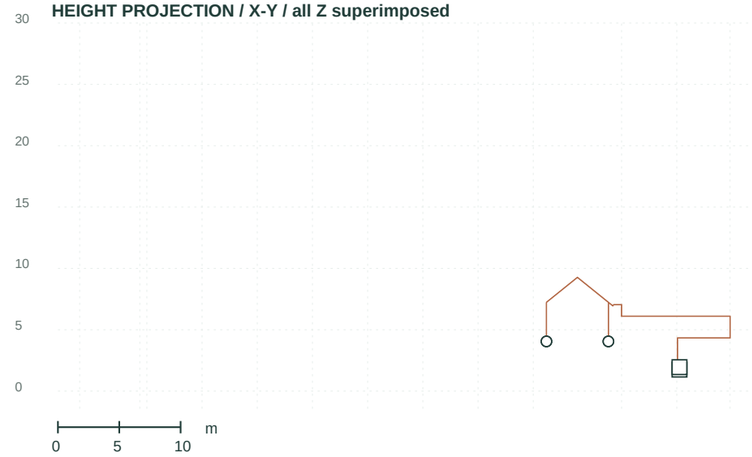


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F240** | 38.050 | 4.050 | -13.060 | 9+1.07/A+0.19 | R272 |
| **F241** | 43.100 | 4.050 | -13.060 | 10-1.07/A+0.19 | R273 |
| **F242** | 38.050 | 4.050 | 13.060 | 9+1.07/I-0.19 | R275 |
| **F243** | 43.100 | 4.050 | 13.060 | 10-1.07/I-0.19 | R276 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 |

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I11, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# F2 / Wall fans


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-014


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

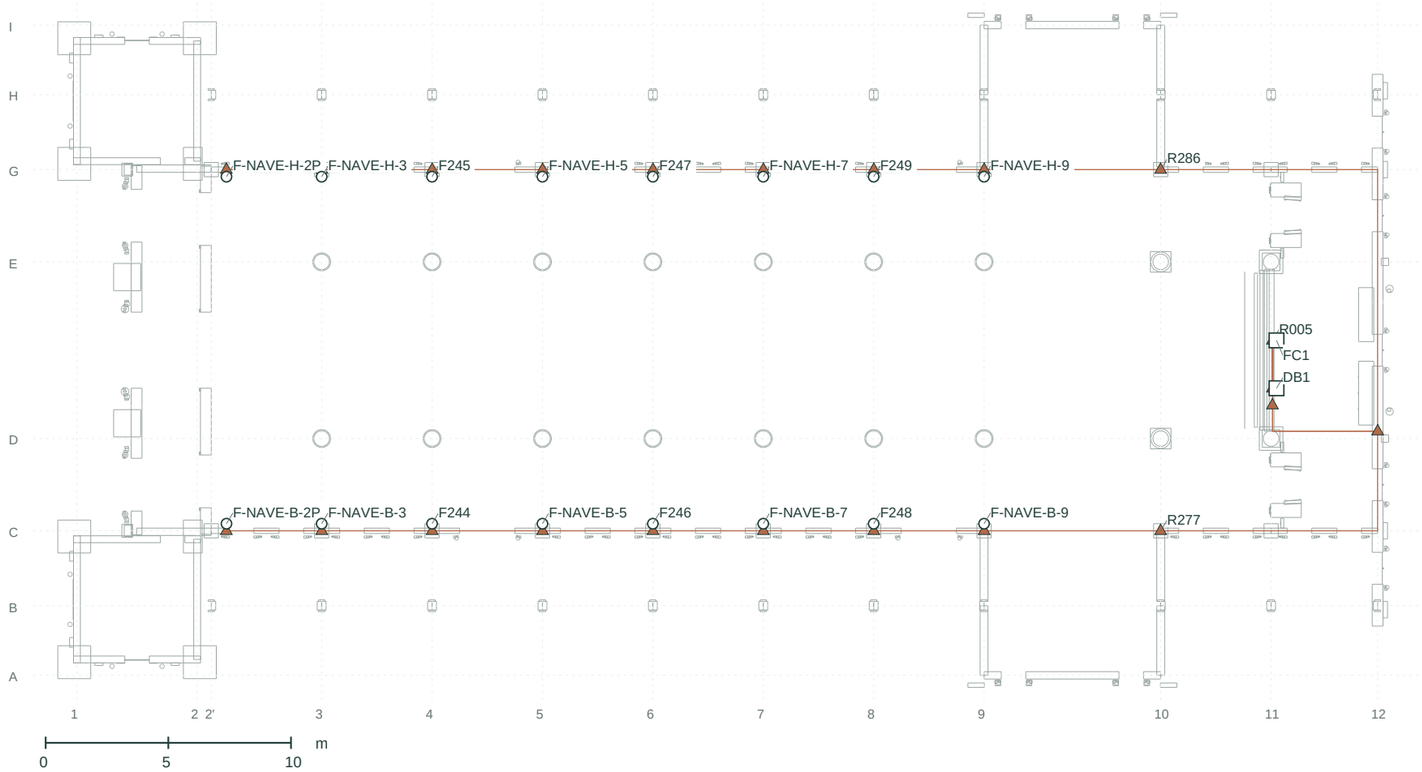


## HEIGHT PROJECTION / X-Y / all Z superimposed

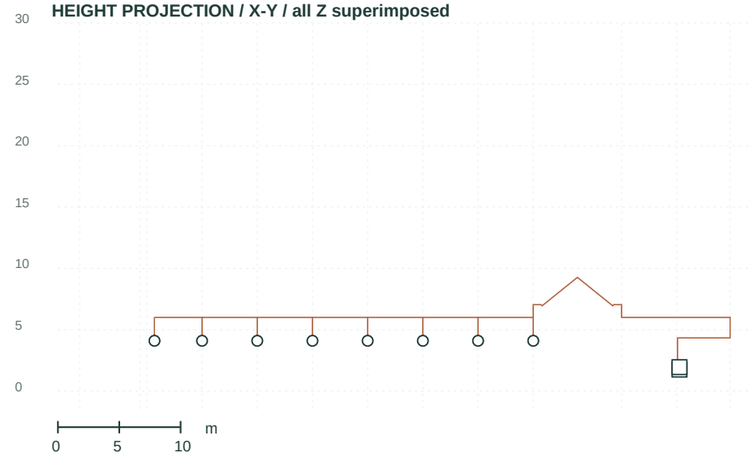


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F244** | 14.475 | 4.100 | -7.070 | 4+0.00/C+0.29 | R278 |
| **F245** | 14.475 | 4.100 | 7.070 | 4+0.00/G-0.29 | R287 |
| **F246** | 23.475 | 4.100 | -7.070 | 6+0.00/C+0.29 | R279 |
| **F247** | 23.475 | 4.100 | 7.070 | 6+0.00/G-0.29 | R288 |
| **F248** | 32.475 | 4.100 | -7.070 | 8+0.00/C+0.29 | R280 |
| **F249** | 32.475 | 4.100 | 7.070 | 8+0.00/G-0.29 | R289 |
| **F-NAVE-B-2P** | 6.095 | 4.100 | -7.070 | 2'+0.62/C+0.29 | R281 |
| **F-NAVE-H-2P** | 6.095 | 4.100 | 7.070 | 2'+0.62/G-0.29 | R290 |
| **F-NAVE-B-3** | 9.975 | 4.100 | -7.070 | 3+0.00/C+0.29 | R282 |
| **F-NAVE-H-3** | 9.975 | 4.100 | 7.070 | 3+0.00/G-0.29 | R291 |
| **F-NAVE-B-5** | 18.975 | 4.100 | -7.070 | 5+0.00/C+0.29 | R283 |
| **F-NAVE-H-5** | 18.975 | 4.100 | 7.070 | 5+0.00/G-0.29 | R292 |
| **F-NAVE-B-7** | 27.975 | 4.100 | -7.070 | 7+0.00/C+0.29 | R284 |
| **F-NAVE-H-7** | 27.975 | 4.100 | 7.070 | 7+0.00/G-0.29 | R293 |
| **F-NAVE-B-9** | 36.975 | 4.100 | -7.070 | 9+0.00/C+0.29 | R285 |
| **F-NAVE-H-9** | 36.975 | 4.100 | 7.070 | 9+0.00/G-0.29 | R294 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 |

16 equipment / 19 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# F4 / Entrance circulators (trial)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-015

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

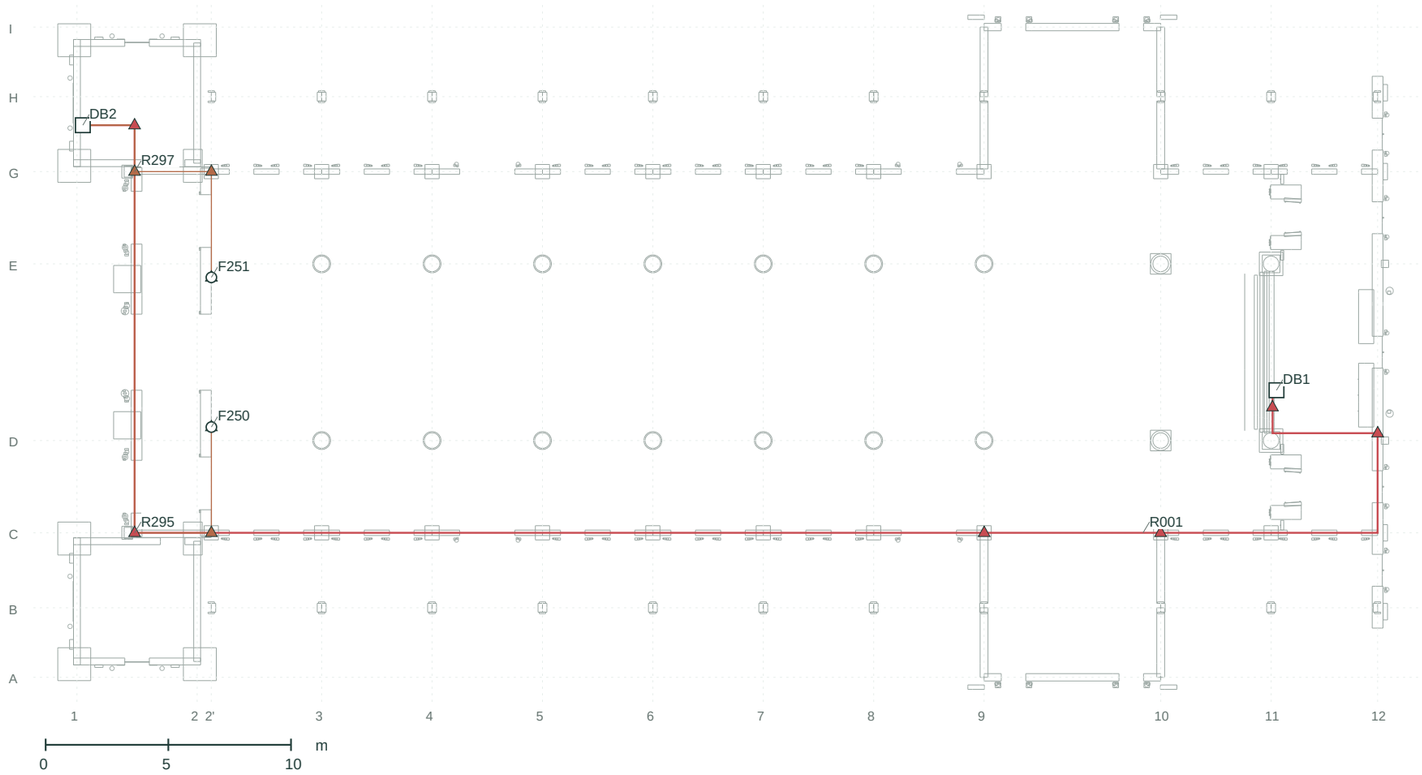


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F250** | 5.480 | 6.000 | -3.050 | 2'+0.00/D+0.55 | R296 |
| **F251** | 5.480 | 6.000 | 3.050 | 2'+0.00/E-0.55 | R298 |

### Related enclosures


| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 |

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

## HEIGHT PROJECTION / X-Y / all Z superimposed

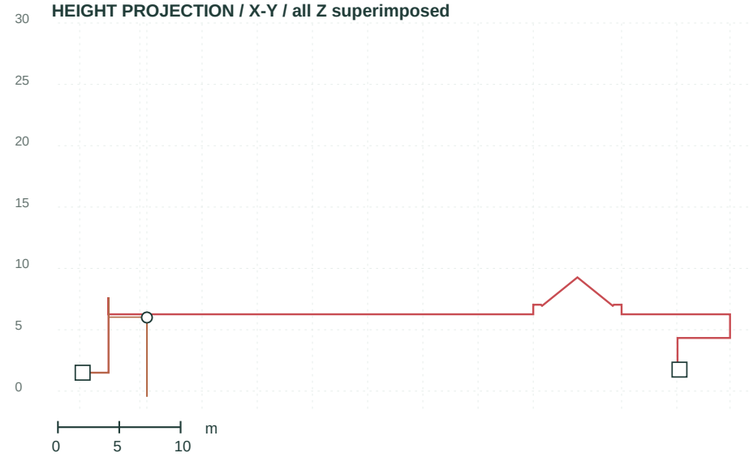


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I16, I25, I26 (key on sheet IM-01).

THACH BI CHURCH

# V1 / Exhaust / front gable


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-016


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

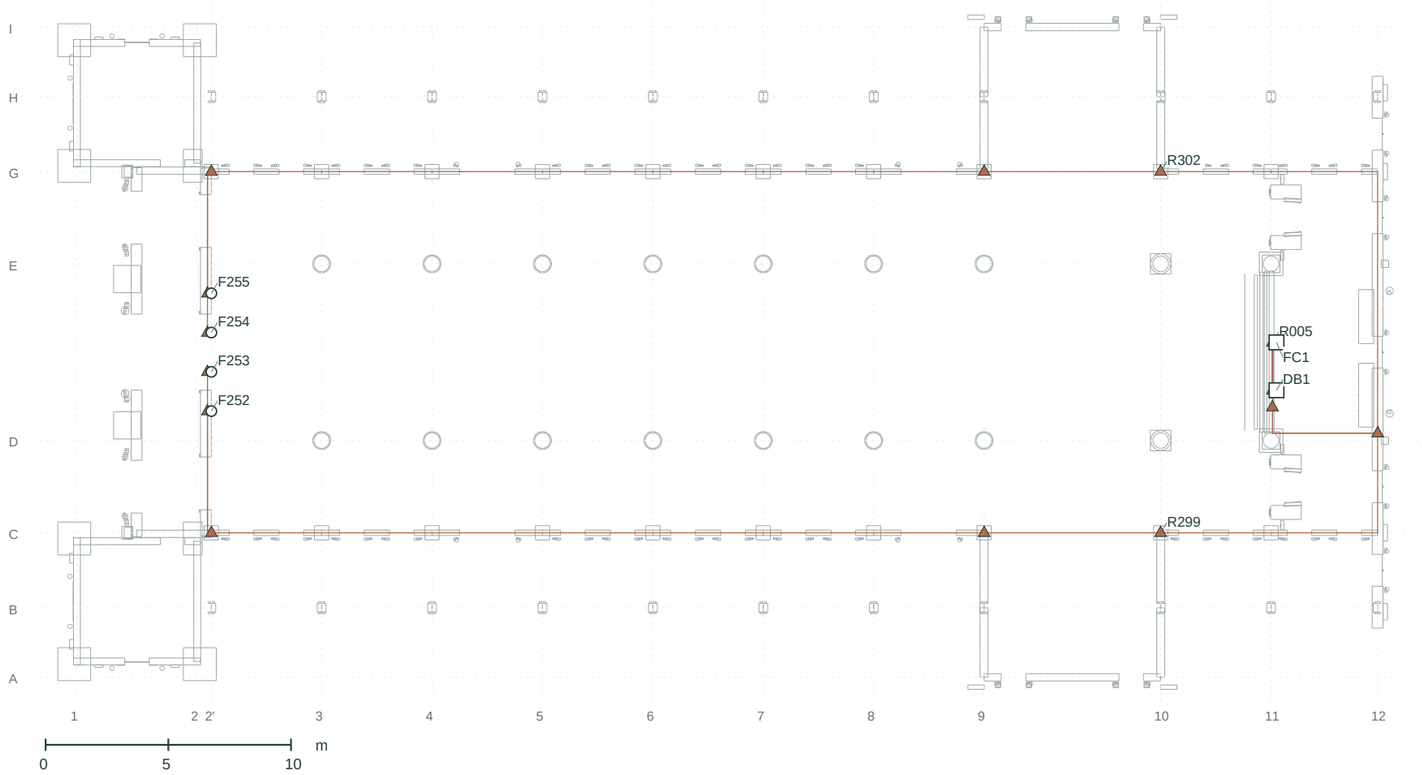


## HEIGHT PROJECTION / X-Y / all Z superimposed

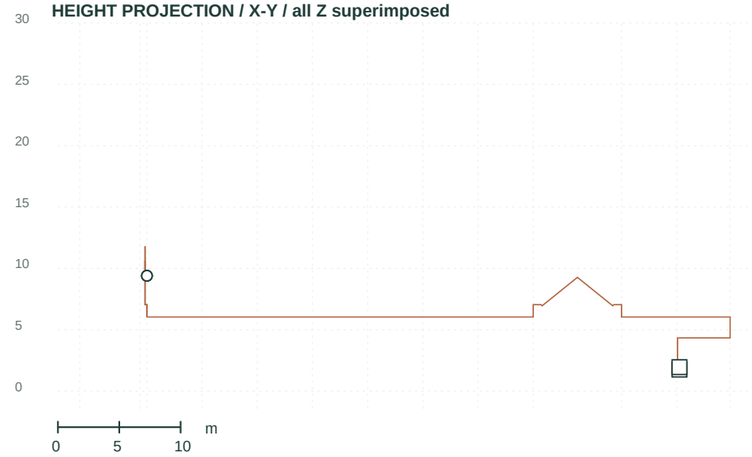


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F252** | 5.480 | 9.400 | -2.400 | 2'+0.01/D+1.20 | R300 |
| **F253** | 5.480 | 9.400 | -0.800 | 2'+0.01/D+2.80 | R301 |
| **F254** | 5.480 | 9.400 | 0.800 | 2'+0.01/E-2.80 | R303 |
| **F255** | 5.480 | 9.400 | 2.400 | 2'+0.01/E-1.20 | R304 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 |

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I05, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# V2 / Exhaust / wing gables


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-017


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

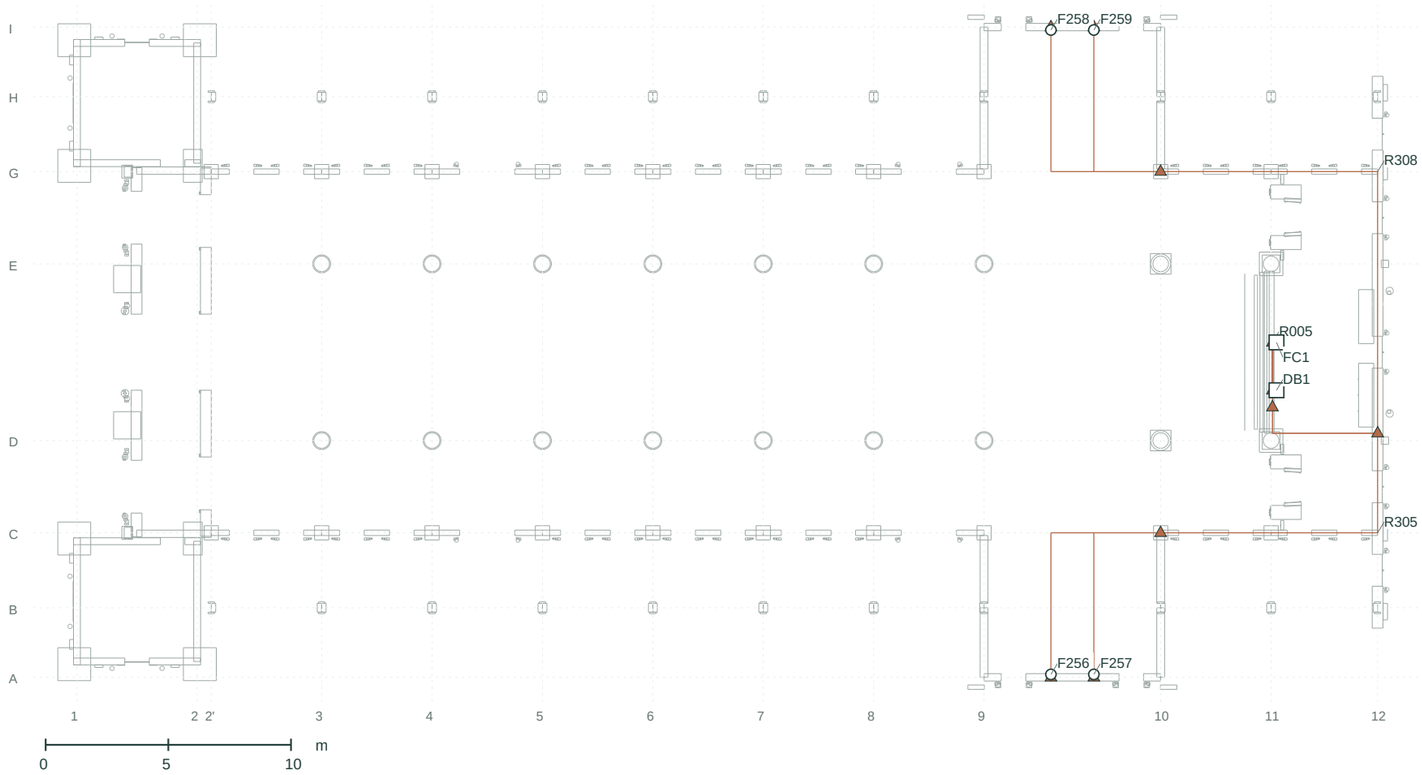


## HEIGHT PROJECTION / X-Y / all Z superimposed

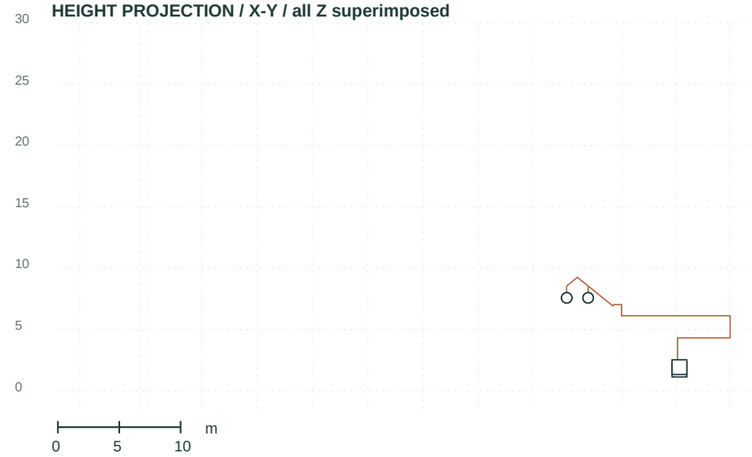


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F256** | 39.700 | 7.600 | -13.130 | 9+2.73/A+0.12 | R306 |
| **F257** | 41.450 | 7.600 | -13.130 | 10-2.72/A+0.12 | R307 |
| **F258** | 39.700 | 7.600 | 13.130 | 9+2.73/I-0.12 | R309 |
| **F259** | 41.450 | 7.600 | 13.130 | 10-2.72/I-0.12 | R310 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 |

4 equipment / 7 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I11, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# V3 / Exhaust / service room


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-018


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

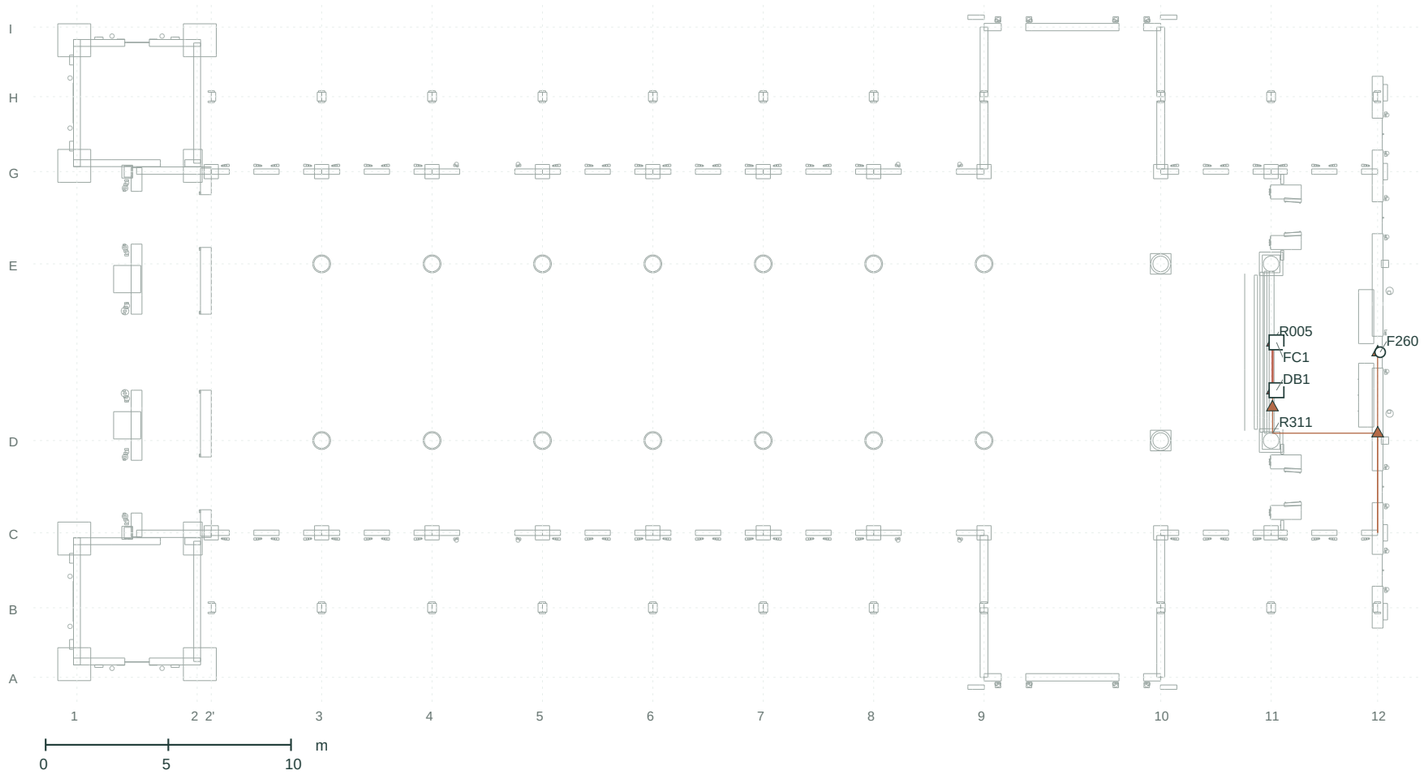


## HEIGHT PROJECTION / X-Y / all Z superimposed

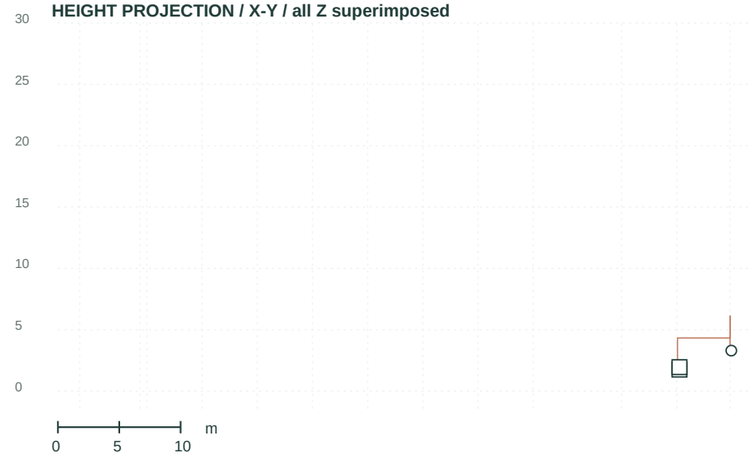


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **F260** | 53.120 | 3.300 | 0.000 | 12+0.10/D+3.60 | R312 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **FC1** | 48.895 | 1.950 | 0.400 | 11+0.22/E-3.20 |

1 equipment / 3 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I17, I25 (key on sheet IM-01).

THACH BI CHURCH

# A1 / Main & delay loudspeakers


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-019


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

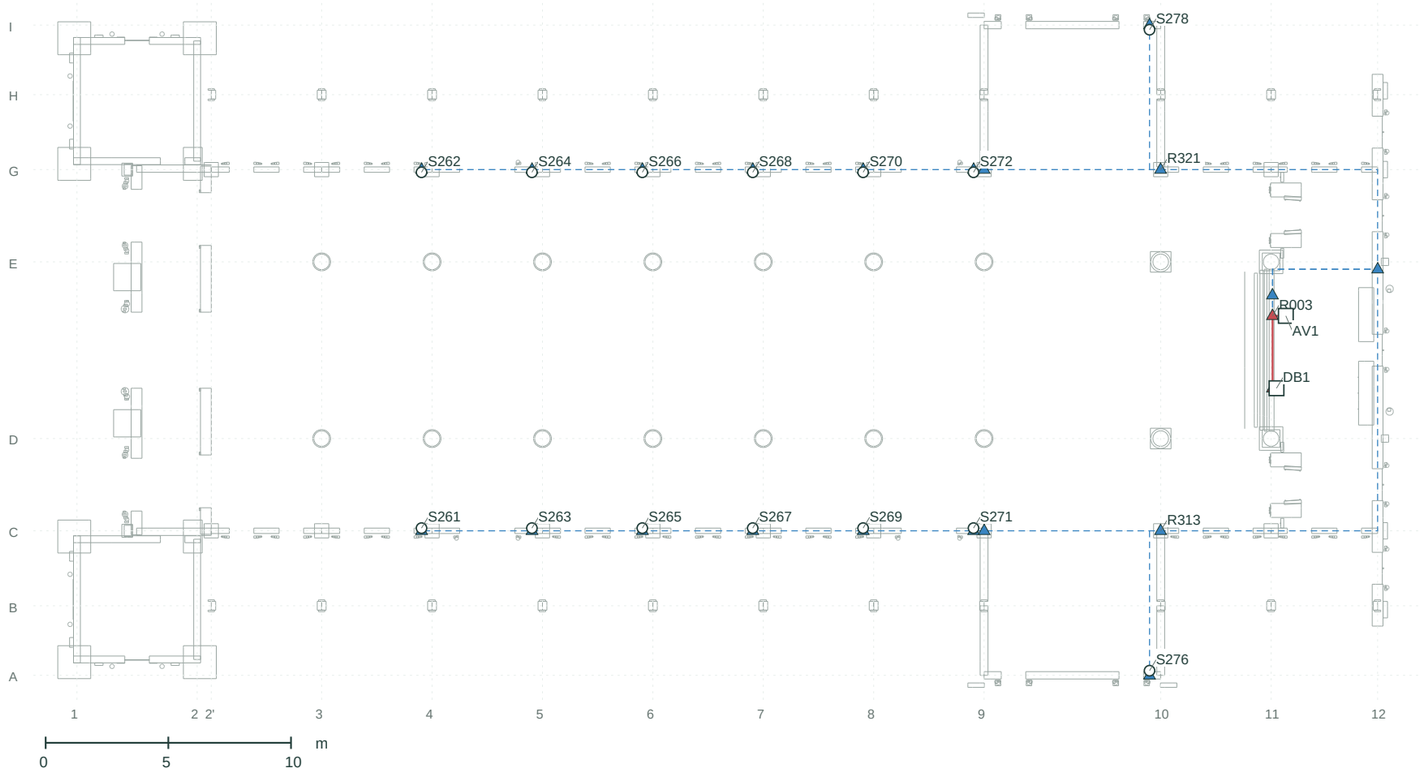


## HEIGHT PROJECTION / X-Y / all Z superimposed

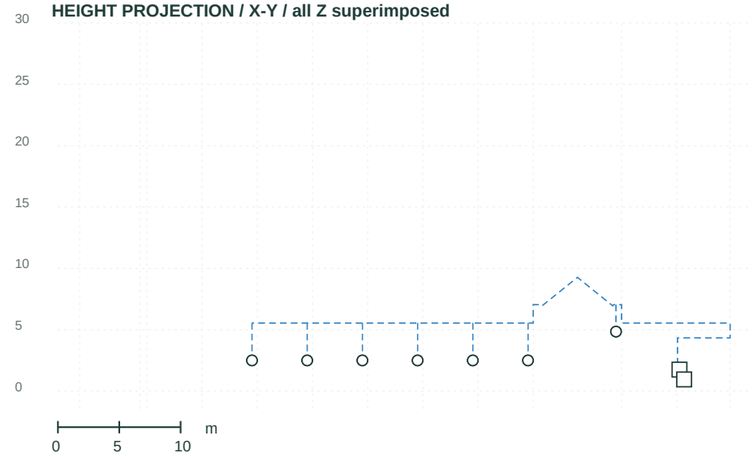


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **S261** | 14.045 | 2.500 | -7.250 | 4-0.43/C+0.11 | R314 |
| **S262** | 14.045 | 2.500 | 7.250 | 4-0.43/G-0.11 | R322 |
| **S263** | 18.545 | 2.500 | -7.250 | 5-0.43/C+0.11 | R315 |
| **S264** | 18.545 | 2.500 | 7.250 | 5-0.43/G-0.11 | R323 |
| **S265** | 23.045 | 2.500 | -7.250 | 6-0.43/C+0.11 | R316 |
| **S266** | 23.045 | 2.500 | 7.250 | 6-0.43/G-0.11 | R324 |
| **S267** | 27.545 | 2.500 | -7.250 | 7-0.43/C+0.11 | R317 |
| **S268** | 27.545 | 2.500 | 7.250 | 7-0.43/G-0.11 | R325 |
| **S269** | 32.045 | 2.500 | -7.250 | 8-0.43/C+0.11 | R318 |
| **S270** | 32.045 | 2.500 | 7.250 | 8-0.43/G-0.11 | R326 |
| **S271** | 36.545 | 2.500 | -7.250 | 9-0.43/C+0.11 | R319 |
| **S272** | 36.545 | 2.500 | 7.250 | 9-0.43/G-0.11 | R327 |
| **S276** | 43.720 | 4.850 | -13.060 | 10-0.45/A+0.19 | R320 |
| **S278** | 43.720 | 4.850 | 13.060 | 10-0.45/I-0.19 | R328 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **AV1** | 49.275 | 0.950 | 1.400 | 11+0.60/E-2.20 |

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I11, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# A5 / Rear fill (crowded feasts)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-020


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

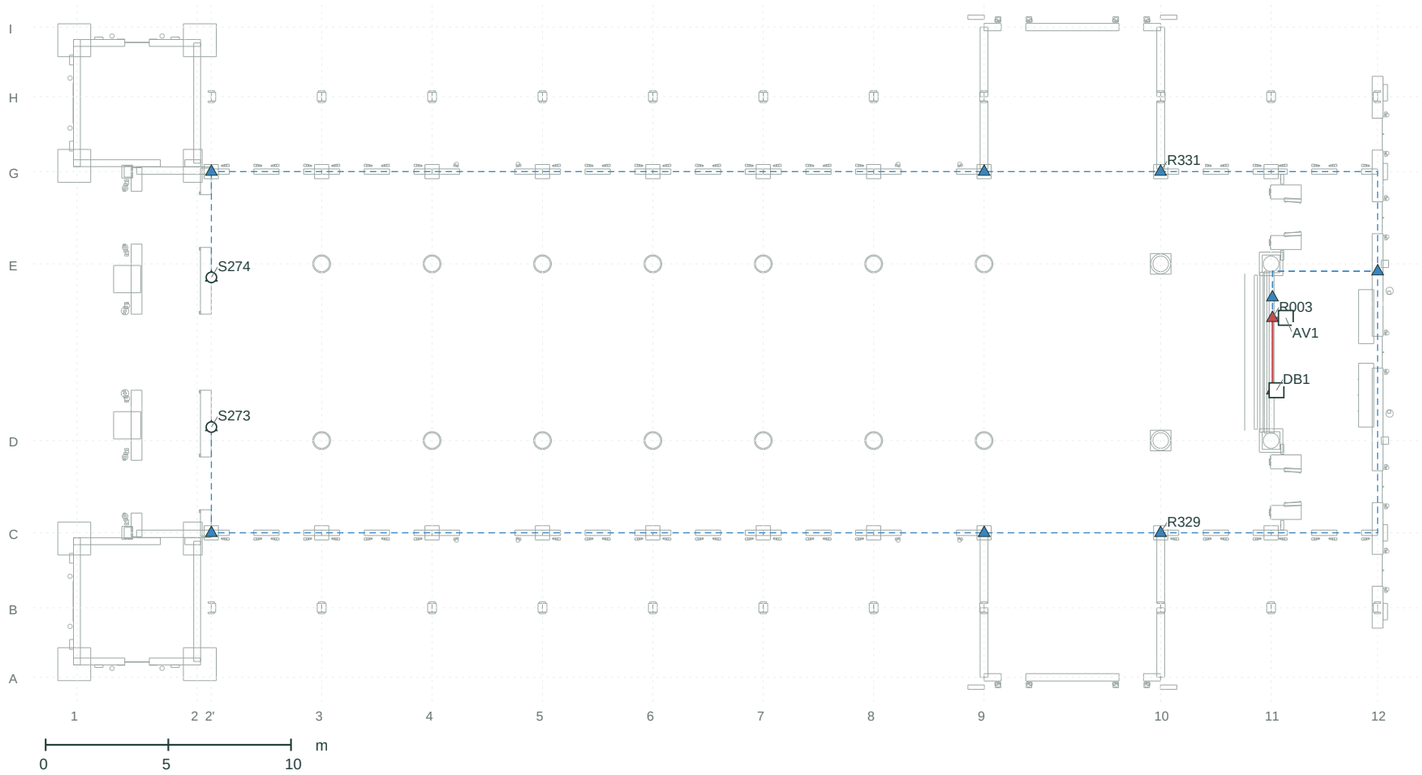


## HEIGHT PROJECTION / X-Y / all Z superimposed

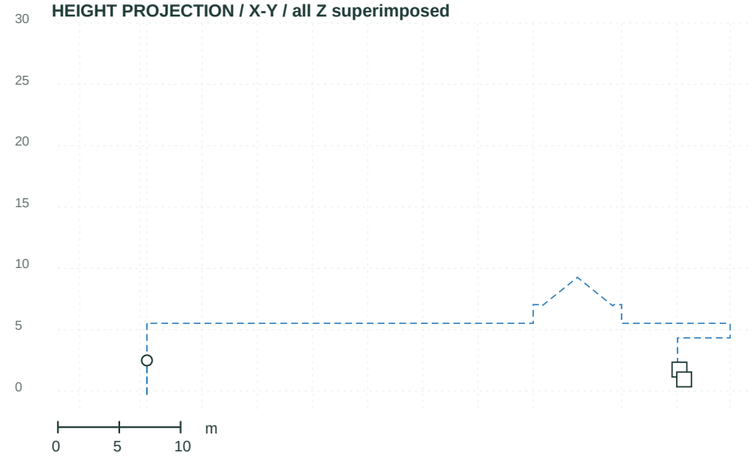


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **S273** | 5.480 | 2.500 | -3.050 | 2'+0.00/D+0.55 | R330 |
| **S274** | 5.480 | 2.500 | 3.050 | 2'+0.00/E-0.55 | R332 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **AV1** | 49.275 | 0.950 | 1.400 | 11+0.60/E-2.20 |

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I16, I25 (key on sheet IM-01).

THACH BI CHURCH

# A2 / Veranda fill


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-021


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

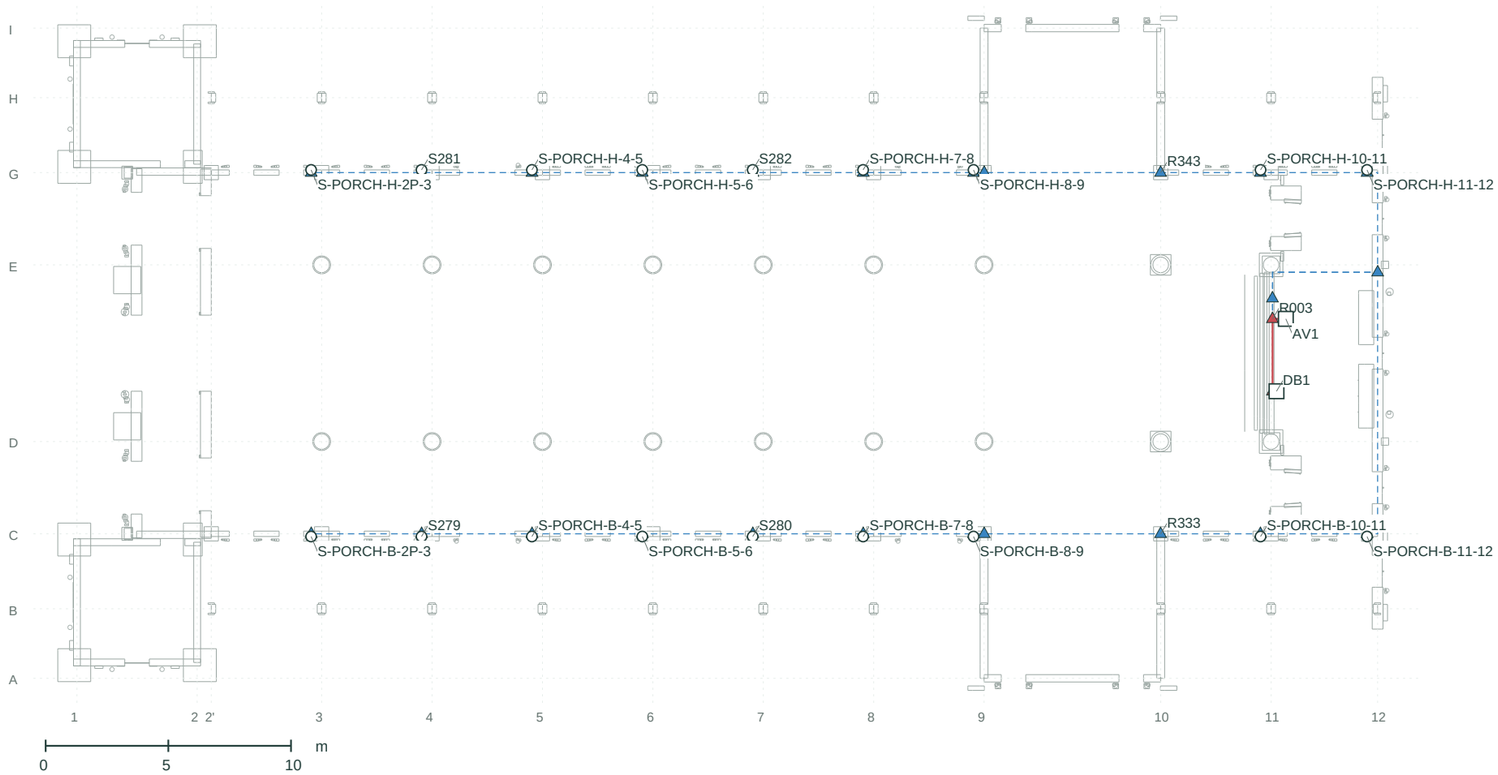


## HEIGHT PROJECTION / X-Y / all Z superimposed

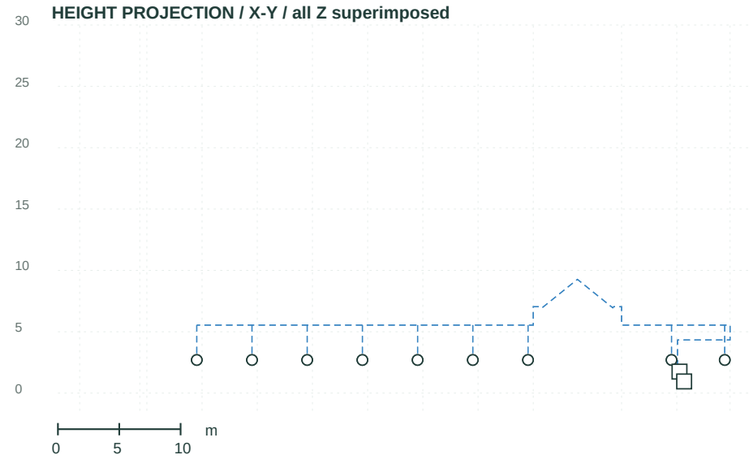


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I14, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **S279** | 14.045 | 2.700 | -7.470 | 4-0.43/C-0.11 | R334 |
| **S280** | 27.545 | 2.700 | -7.470 | 7-0.43/C-0.11 | R335 |
| **S281** | 14.045 | 2.700 | 7.470 | 4-0.43/G+0.11 | R344 |
| **S282** | 27.545 | 2.700 | 7.470 | 7-0.43/G+0.11 | R345 |
| **S-PORCH-B-2P-3** | 9.545 | 2.700 | -7.470 | 3-0.43/C-0.11 | R336 |
| **S-PORCH-B-4-5** | 18.545 | 2.700 | -7.470 | 5-0.43/C-0.11 | R337 |
| **S-PORCH-B-5-6** | 23.045 | 2.700 | -7.470 | 6-0.43/C-0.11 | R338 |
| **S-PORCH-B-7-8** | 32.045 | 2.700 | -7.470 | 8-0.43/C-0.11 | R339 |
| **S-PORCH-B-8-9** | 36.545 | 2.700 | -7.470 | 9-0.43/C-0.11 | R340 |
| **S-PORCH-B-10-11** | 48.245 | 2.700 | -7.470 | 11-0.43/C-0.11 | R341 |
| **S-PORCH-B-11-12** | 52.586 | 2.700 | -7.470 | 12-0.43/C-0.11 | R342 |
| **S-PORCH-H-2P-3** | 9.545 | 2.700 | 7.470 | 3-0.43/G+0.11 | R346 |
| **S-PORCH-H-4-5** | 18.545 | 2.700 | 7.470 | 5-0.43/G+0.11 | R347 |
| **S-PORCH-H-5-6** | 23.045 | 2.700 | 7.470 | 6-0.43/G+0.11 | R348 |
| **S-PORCH-H-7-8** | 32.045 | 2.700 | 7.470 | 8-0.43/G+0.11 | R349 |
| **S-PORCH-H-8-9** | 36.545 | 2.700 | 7.470 | 9-0.43/G+0.11 | R350 |
| **S-PORCH-H-10-11** | 48.245 | 2.700 | 7.470 | 11-0.43/G+0.11 | R351 |
| **S-PORCH-H-11-12** | 52.586 | 2.700 | 7.470 | 12-0.43/G+0.11 | R352 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **AV1** | 49.275 | 0.950 | 1.400 | 11+0.60/E-2.20 |

18 equipment / 21 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

THACH BI CHURCH

# A3 / Courtyard


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-022


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

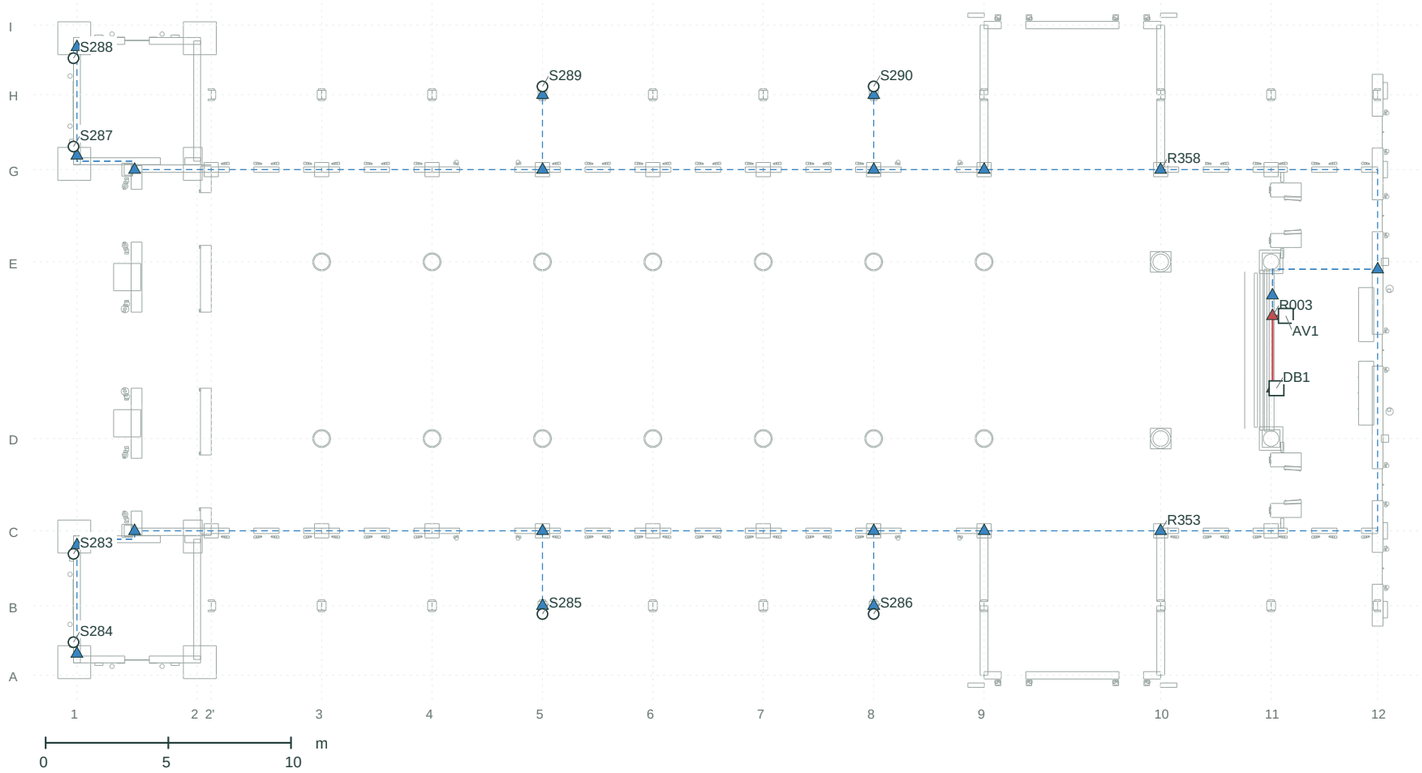


## HEIGHT PROJECTION / X-Y / all Z superimposed

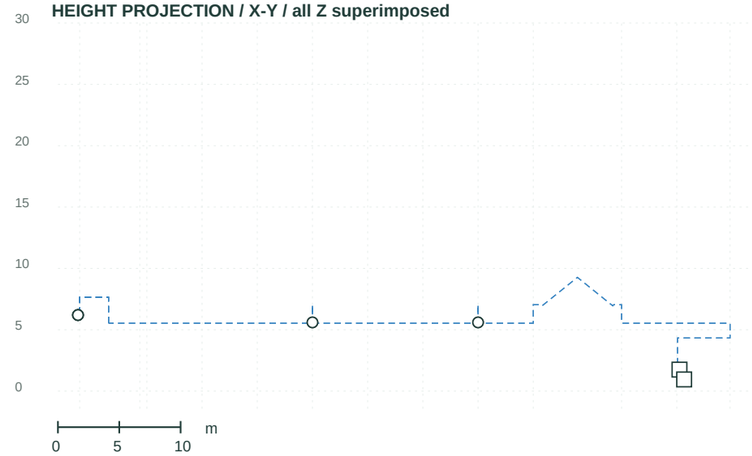


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **S283** | -0.140 | 6.200 | -8.300 | 1-0.14/C-0.94 | R354 |
| **S284** | -0.140 | 6.200 | -11.900 | 1-0.14/A+1.35 | R355 |
| **S285** | 18.975 | 5.600 | -10.750 | 5+0.00/B-0.34 | R356 |
| **S286** | 32.475 | 5.600 | -10.750 | 8+0.00/B-0.34 | R357 |
| **S287** | -0.140 | 6.200 | 8.300 | 1-0.14/G+0.94 | R359 |
| **S288** | -0.140 | 6.200 | 11.900 | 1-0.14/I-1.35 | R360 |
| **S289** | 18.975 | 5.600 | 10.750 | 5+0.00/H+0.34 | R361 |
| **S290** | 32.475 | 5.600 | 10.750 | 8+0.00/H+0.34 | R362 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **AV1** | 49.275 | 0.950 | 1.400 | 11+0.60/E-2.20 |

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I11, I14, I22, I25 (key on sheet IM-01).

THACH BI CHURCH

# Microphones


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-023


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

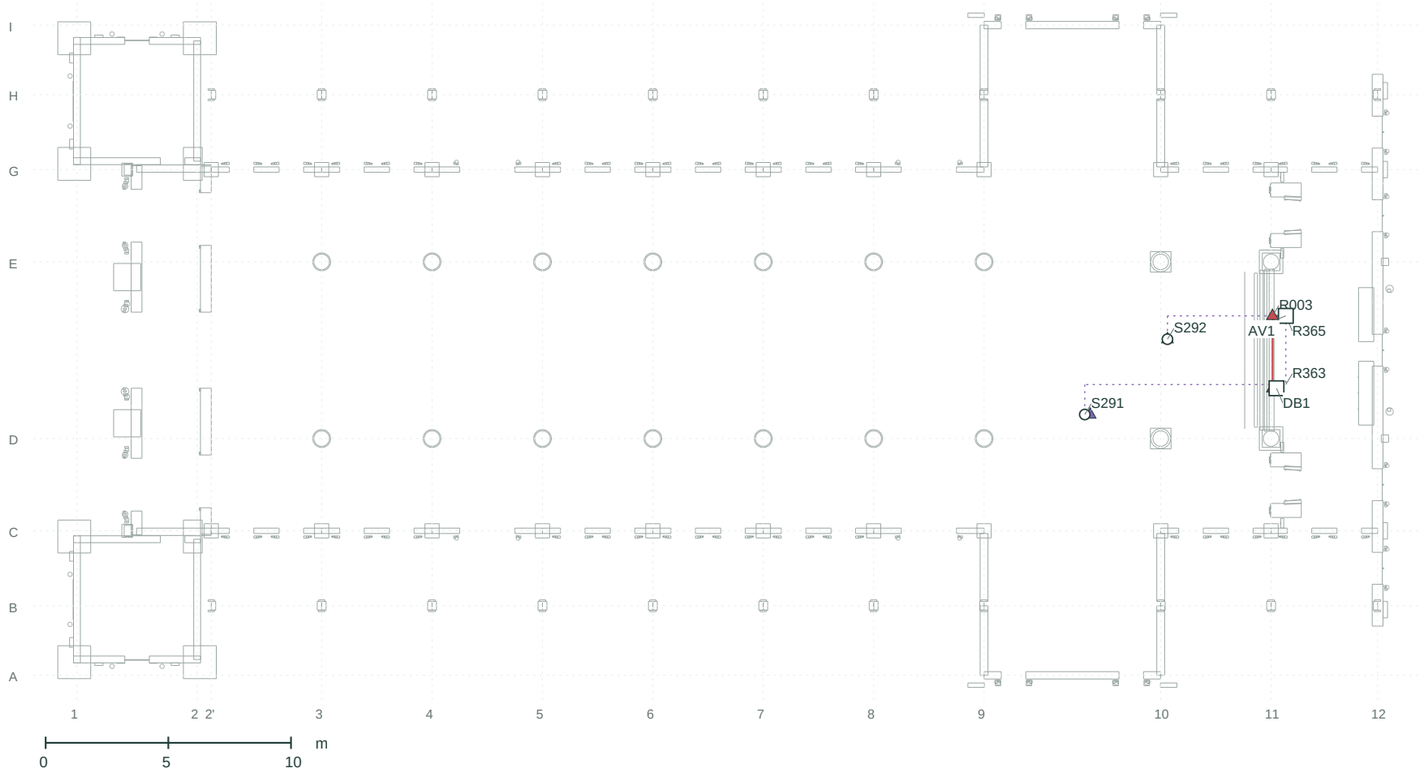


## HEIGHT PROJECTION / X-Y / all Z superimposed

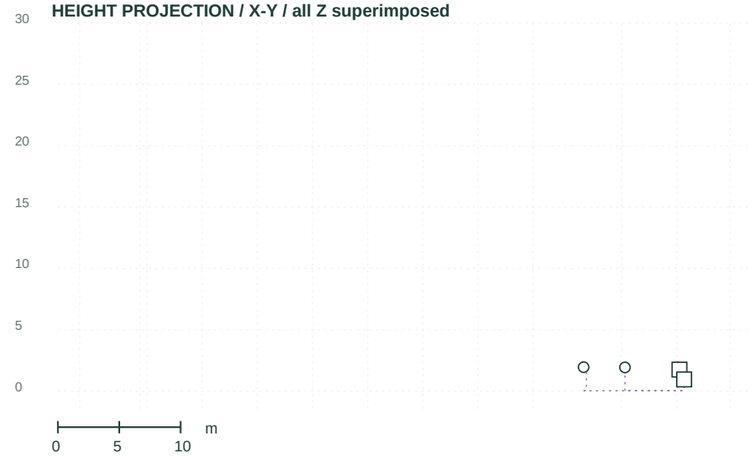


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **S291** | 41.080 | 1.950 | -2.620 | 10-3.09/D+0.98 | R364 |
| **S292** | 44.450 | 1.930 | 0.450 | 10+0.28/E-3.15 | R366 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |
| **AV1** | 49.275 | 0.950 | 1.400 | 11+0.60/E-2.20 | |

2 equipment / 5 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I18, I19, I20 (key on sheet IM-01).

THACH BI CHURCH

# P1 / Sockets / side B (sanctuary + nave)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-024


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

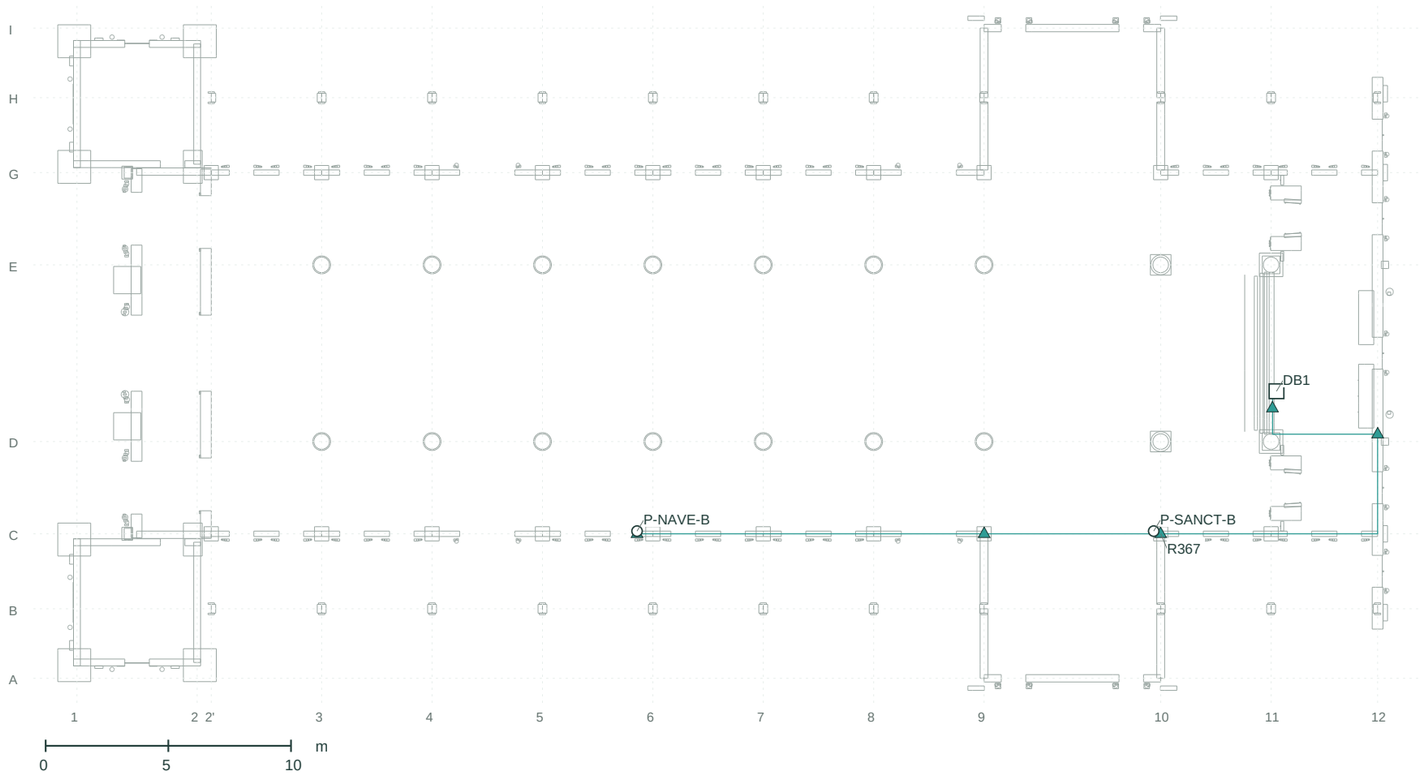


## HEIGHT PROJECTION / X-Y / all Z superimposed

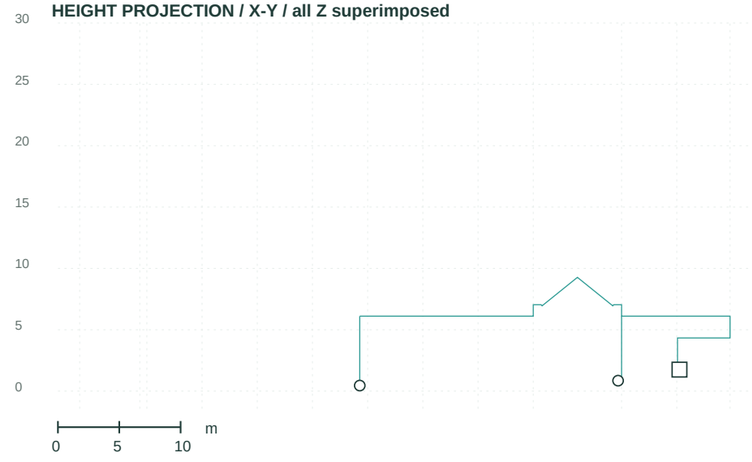


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **P-SANCT-B** | 43.890 | 0.850 | -7.250 | 10-0.28/C+0.11 | R368 |
| **P-NAVE-B** | 22.830 | 0.450 | -7.250 | 6-0.65/C+0.11 | R369 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |

2 equipment / 3 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I25 (key on sheet IM-01).

THACH BI CHURCH

# P3 / Event power / tower B


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-025


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

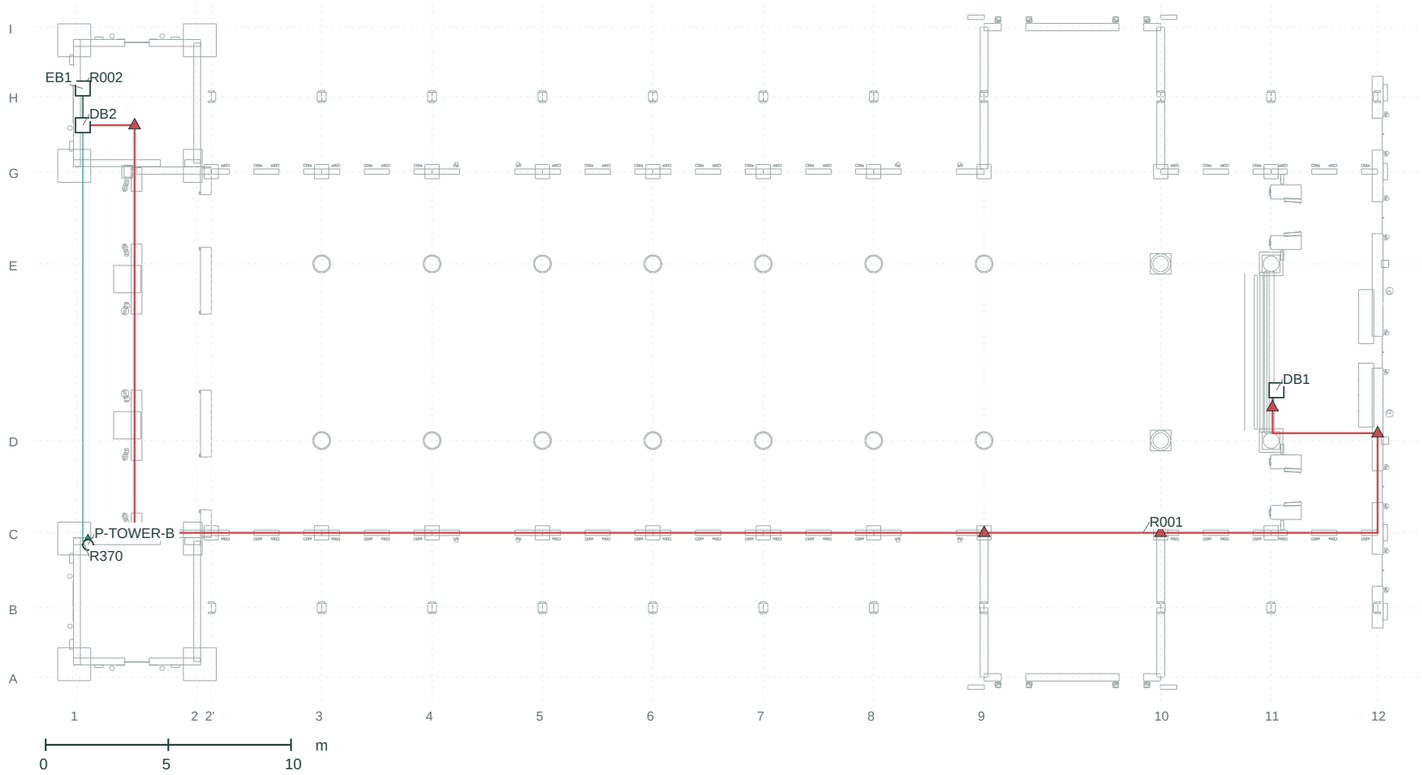


## HEIGHT PROJECTION / X-Y / all Z superimposed

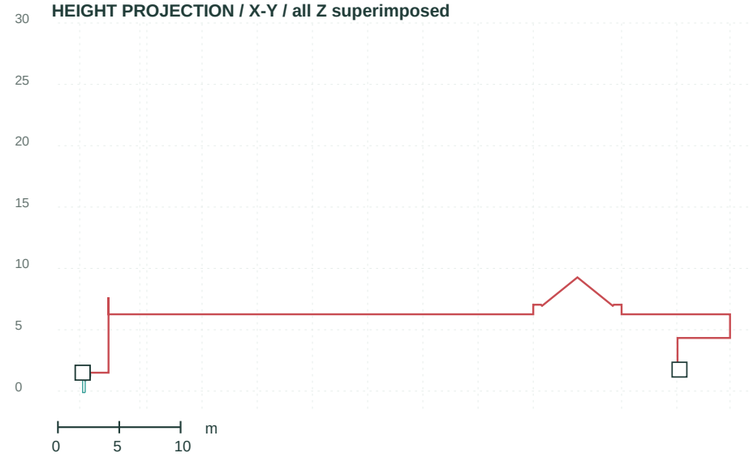


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **P-TOWER-B** | 0.450 | 1.300 | -7.850 | 1+0.45/C-0.49 | R371 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 |
| **EB1** | 0.240 | 1.500 | 10.750 | 1+0.24/H+0.34 |

1 equipment / 4 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I07, I12, I21, I26 (key on sheet IM-01).

THACH BI CHURCH

# P2 / Sockets / side H (sanctuary + nave)


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-026


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

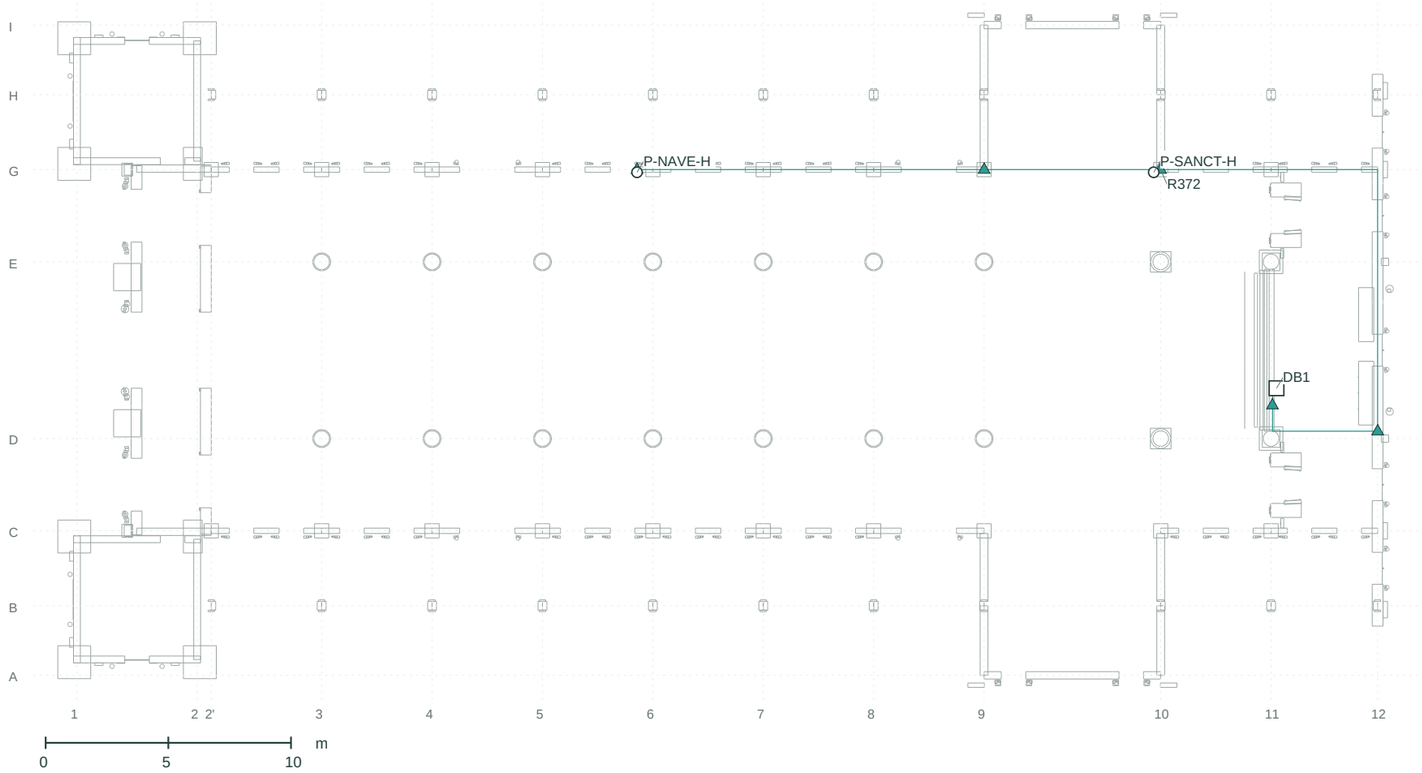


## HEIGHT PROJECTION / X-Y / all Z superimposed

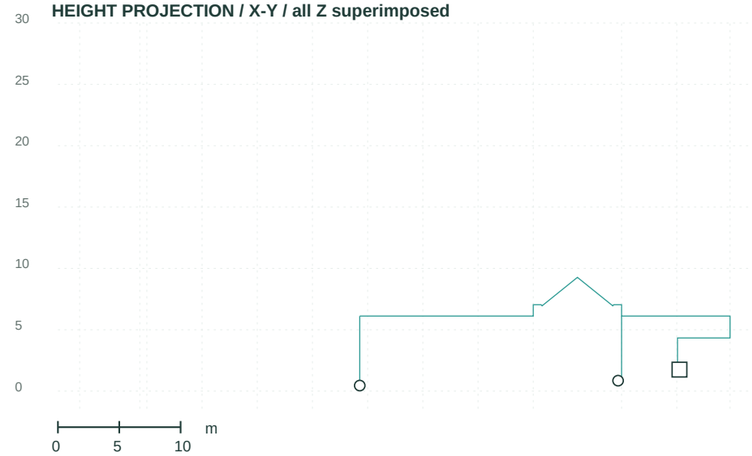


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **P-SANCT-H** | 43.890 | 0.850 | 7.250 | 10-0.28/G-0.11 | R373 |
| **P-NAVE-H** | 22.830 | 0.450 | 7.250 | 6-0.65/G-0.11 | R374 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |

2 equipment / 3 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I25 (key on sheet IM-01).

THACH BI CHURCH

# P4 / Event power / tower H


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-027


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

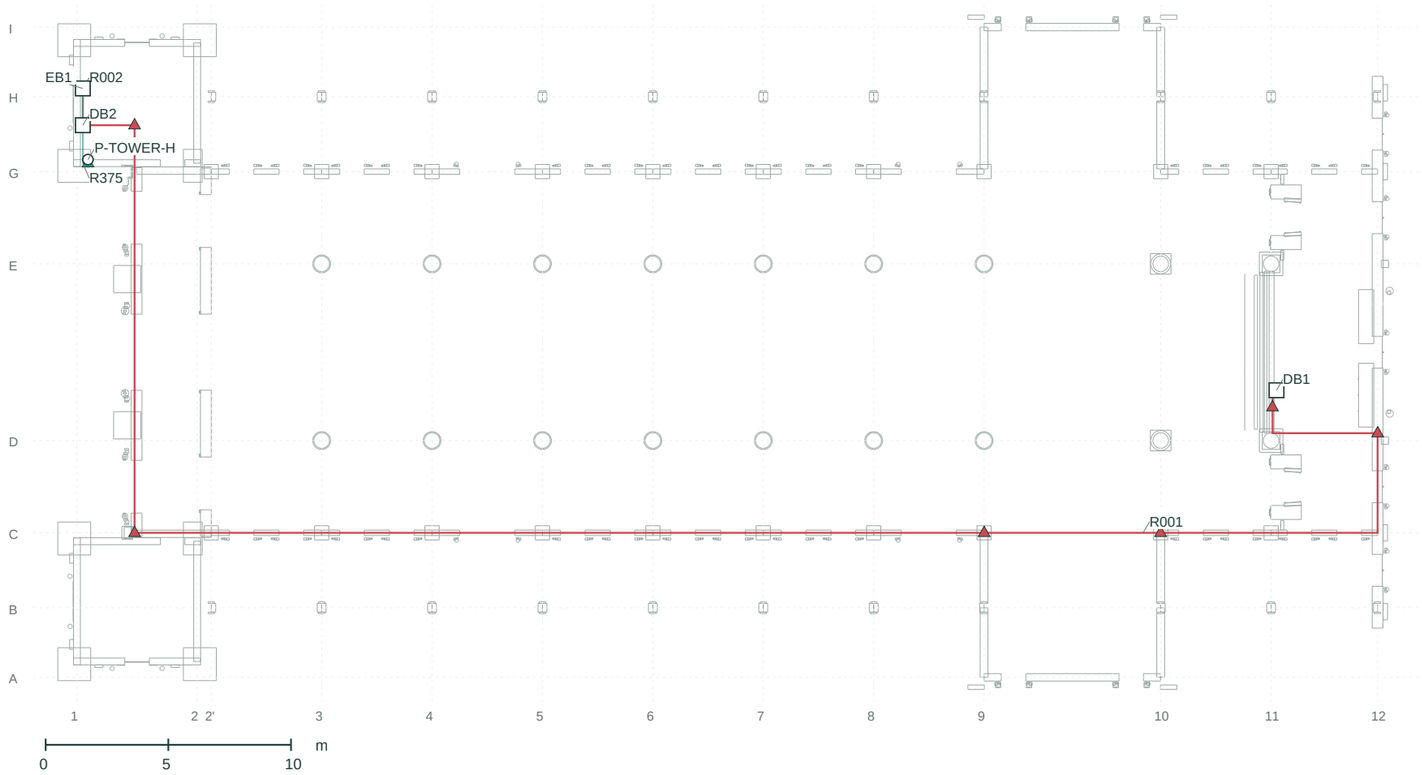


## HEIGHT PROJECTION / X-Y / all Z superimposed

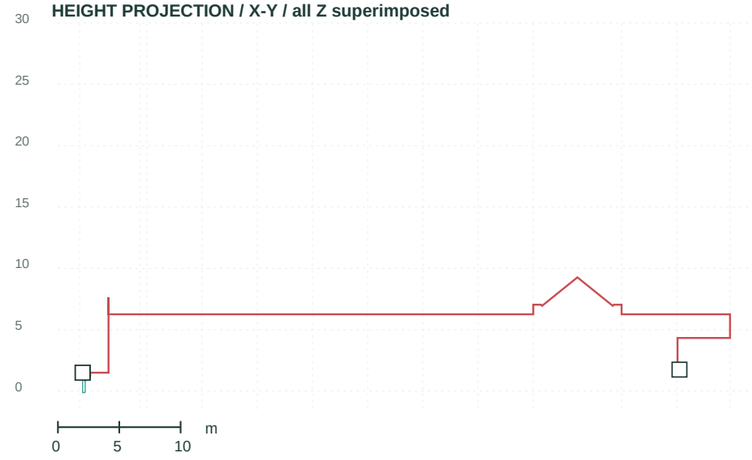


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| P-TOWER-H | 0.450 | 1.300 | 7.850 | 1+0.45/G+0.49 | R376 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| DB1 | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| DB2 | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 |
| EB1 | 0.240 | 1.500 | 10.750 | 1+0.24/H+0.34 |

1 equipment / 4 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I07, I12, I21, I26 (key on sheet IM-01).

THACH BI CHURCH

# L10 / Facade statues & candles


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-028


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

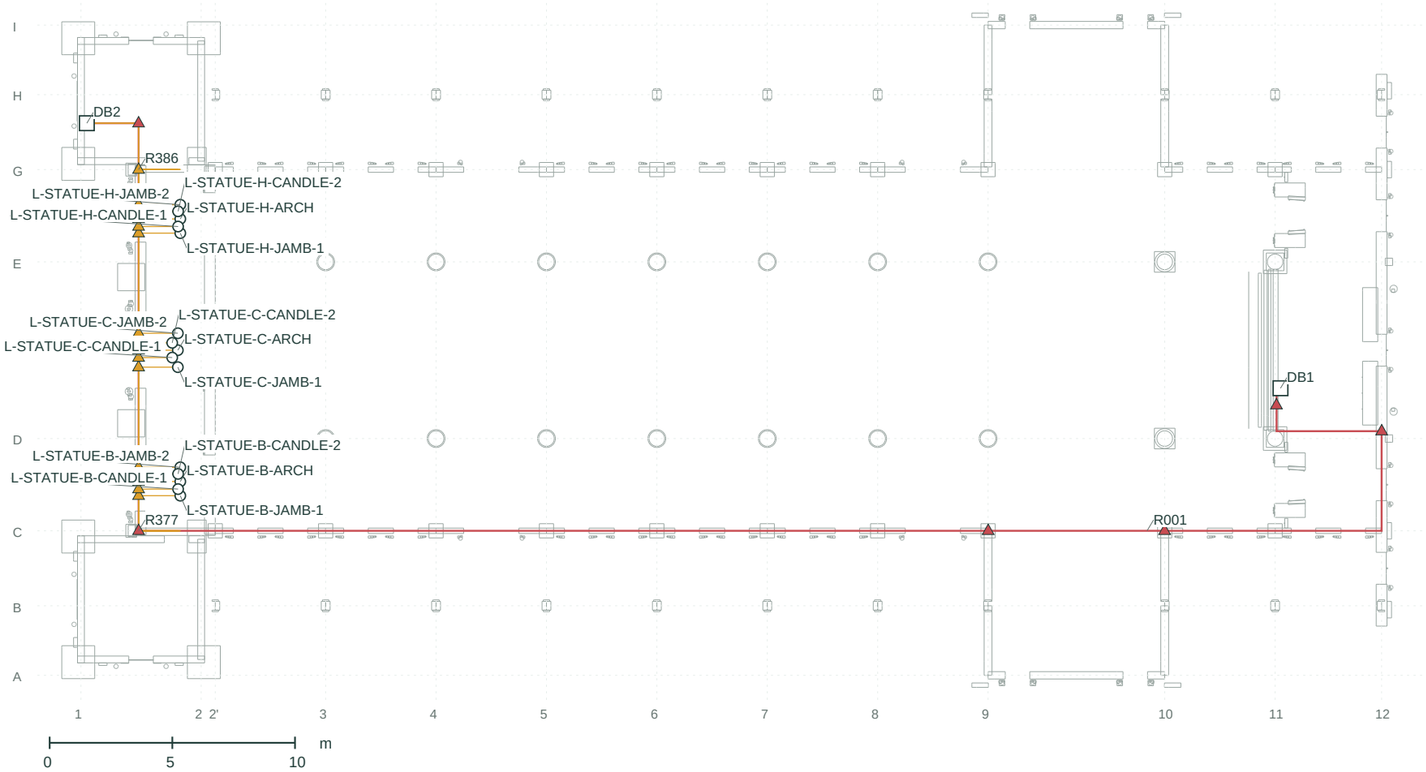


## HEIGHT PROJECTION / X-Y / all Z superimposed

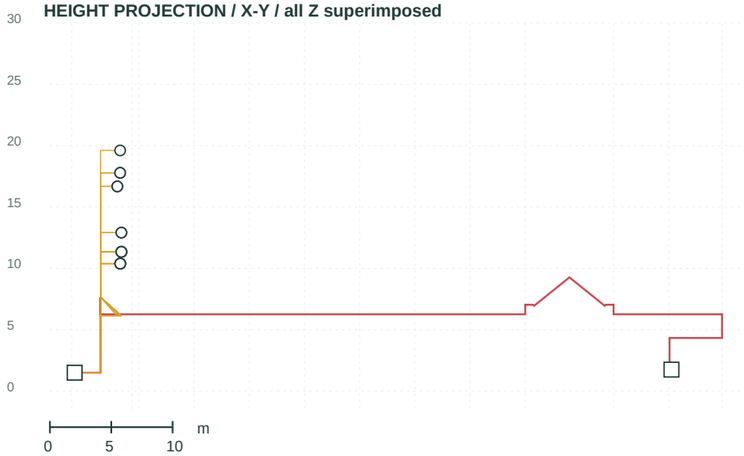


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L-STATUE-C-ARCH** | 3.950 | 19.614 | 0.000 | 2-0.95/D+3.60 | R378 |
| **L-STATUE-C-JAMB-1** | 3.950 | 17.790 | -0.691 | 2-0.95/D+2.91 | R379 |
| **L-STATUE-C-CANDLE-1** | 3.720 | 16.683 | -0.300 | 2-1.18/D+3.30 | R380 |
| **L-STATUE-C-JAMB-2** | 3.950 | 17.790 | 0.691 | 2-0.95/E-2.91 | R387 |
| **L-STATUE-C-CANDLE-2** | 3.720 | 16.683 | 0.300 | 2-1.18/E-3.30 | R388 |
| **L-STATUE-B-ARCH** | 4.050 | 12.917 | -5.350 | 2-0.85/D-1.75 | R381 |
| **L-STATUE-B-JAMB-1** | 4.050 | 11.350 | -5.929 | 2-0.85/C+1.43 | R382 |
| **L-STATUE-B-CANDLE-1** | 3.960 | 10.391 | -5.660 | 2-0.94/C+1.70 | R383 |
| **L-STATUE-B-JAMB-2** | 4.050 | 11.350 | -4.771 | 2-0.85/D-1.17 | R384 |
| **L-STATUE-B-CANDLE-2** | 3.960 | 10.391 | -5.040 | 2-0.94/D-1.44 | R385 |
| **L-STATUE-H-ARCH** | 4.050 | 12.917 | 5.350 | 2-0.85/E+1.75 | R389 |
| **L-STATUE-H-JAMB-1** | 4.050 | 11.350 | 4.771 | 2-0.85/E+1.17 | R390 |
| **L-STATUE-H-CANDLE-1** | 3.960 | 10.391 | 5.040 | 2-0.94/E+1.44 | R391 |
| **L-STATUE-H-JAMB-2** | 4.050 | 11.350 | 5.929 | 2-0.85/G-1.43 | R392 |
| **L-STATUE-H-CANDLE-2** | 3.960 | 10.391 | 5.660 | 2-0.94/G-1.70 | R393 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **DB2** | 0.240 | 1.500 | 9.250 | 1+0.24/H-1.16 |

15 equipment / 18 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I08, I25, I26 (key on sheet IM-01).

THACH BI CHURCH

# LS / Stations of the Cross candles


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-029


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

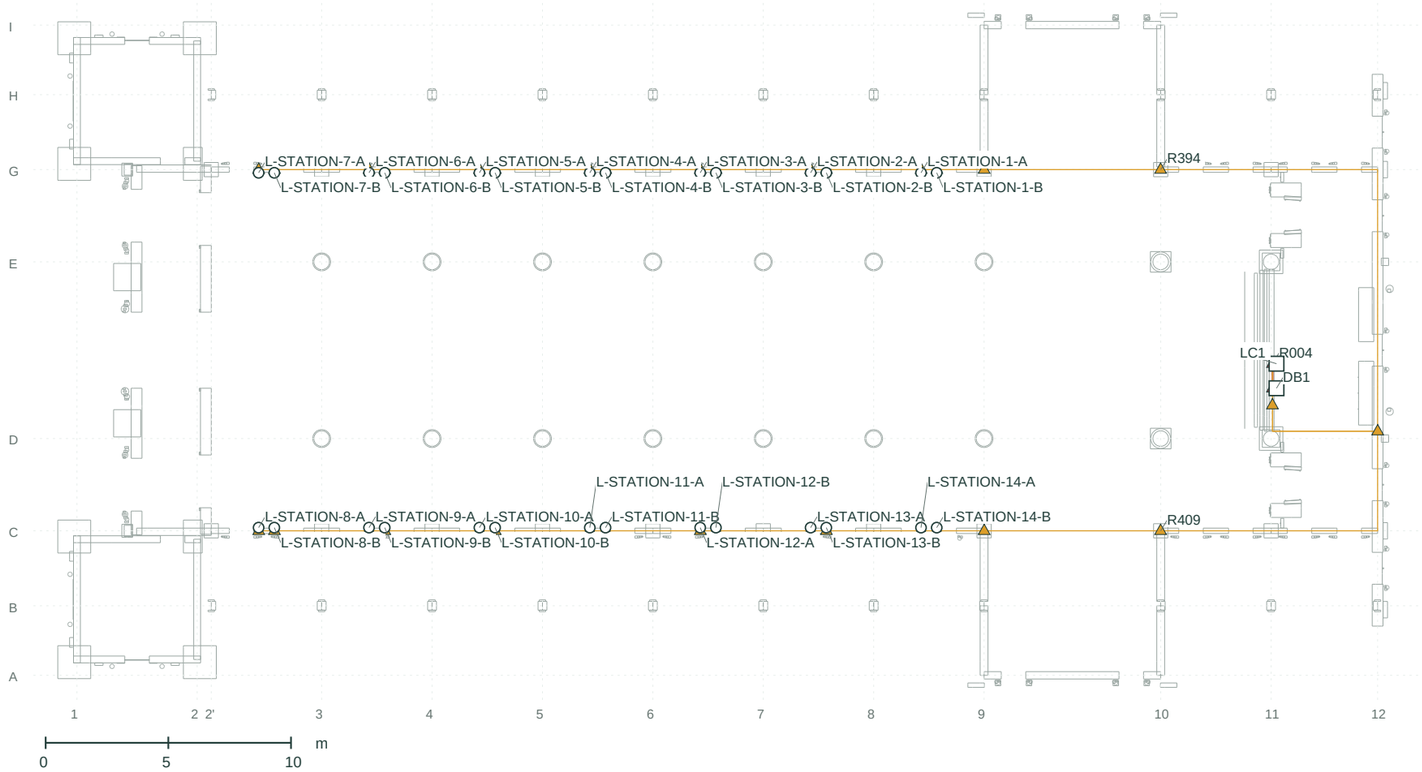


## HEIGHT PROJECTION / X-Y / all Z superimposed

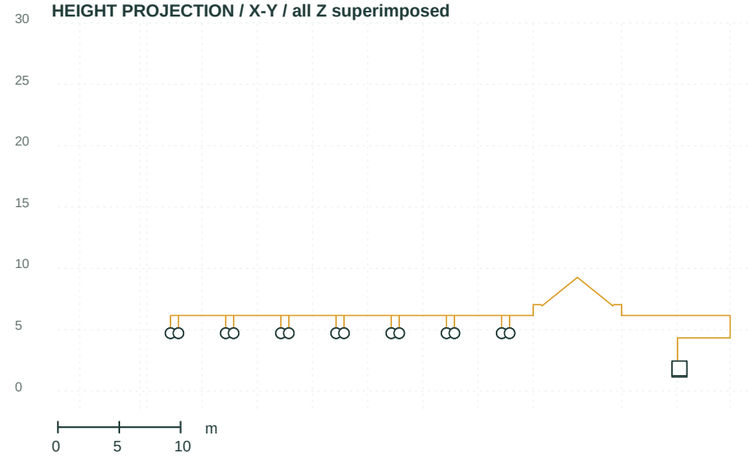


PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I10, I14, I25 (key on sheet IM-01).

## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L-STATION-1-A** | 34.405 | 4.720 | 7.230 | 8+1.93/G-0.13 | R395 |
| **L-STATION-1-B** | 35.045 | 4.720 | 7.230 | 9-1.93/G-0.13 | R396 |
| **L-STATION-2-A** | 29.905 | 4.720 | 7.230 | 7+1.93/G-0.13 | R397 |
| **L-STATION-2-B** | 30.545 | 4.720 | 7.230 | 8-1.93/G-0.13 | R398 |
| **L-STATION-3-A** | 25.405 | 4.720 | 7.230 | 6+1.93/G-0.13 | R399 |
| **L-STATION-3-B** | 26.045 | 4.720 | 7.230 | 7-1.93/G-0.13 | R400 |
| **L-STATION-4-A** | 20.905 | 4.720 | 7.230 | 5+1.93/G-0.13 | R401 |
| **L-STATION-4-B** | 21.545 | 4.720 | 7.230 | 6-1.93/G-0.13 | R402 |
| **L-STATION-5-A** | 16.405 | 4.720 | 7.230 | 4+1.93/G-0.13 | R403 |
| **L-STATION-5-B** | 17.045 | 4.720 | 7.230 | 5-1.93/G-0.13 | R404 |
| **L-STATION-6-A** | 11.905 | 4.720 | 7.230 | 3+1.93/G-0.13 | R405 |
| **L-STATION-6-B** | 12.545 | 4.720 | 7.230 | 4-1.93/G-0.13 | R406 |
| **L-STATION-7-A** | 7.405 | 4.720 | 7.230 | 2'+1.93/G-0.13 | R407 |
| **L-STATION-7-B** | 8.045 | 4.720 | 7.230 | 3-1.93/G-0.13 | R408 |
| **L-STATION-8-A** | 7.405 | 4.720 | -7.230 | 2'+1.93/C+0.13 | R410 |
| **L-STATION-8-B** | 8.045 | 4.720 | -7.230 | 3-1.93/C+0.13 | R411 |
| **L-STATION-9-A** | 11.905 | 4.720 | -7.230 | 3+1.93/C+0.13 | R412 |
| **L-STATION-9-B** | 12.545 | 4.720 | -7.230 | 4-1.93/C+0.13 | R413 |
| **L-STATION-10-A** | 16.405 | 4.720 | -7.230 | 4+1.93/C+0.13 | R414 |
| **L-STATION-10-B** | 17.045 | 4.720 | -7.230 | 5-1.93/C+0.13 | R415 |
| **L-STATION-11-A** | 20.905 | 4.720 | -7.230 | 5+1.93/C+0.13 | R416 |
| **L-STATION-11-B** | 21.545 | 4.720 | -7.230 | 6-1.93/C+0.13 | R417 |
| **L-STATION-12-A** | 25.405 | 4.720 | -7.230 | 6+1.93/C+0.13 | R418 |
| **L-STATION-12-B** | 26.045 | 4.720 | -7.230 | 7-1.93/C+0.13 | R419 |
| **L-STATION-13-A** | 29.905 | 4.720 | -7.230 | 7+1.93/C+0.13 | R420 |
| **L-STATION-13-B** | 30.545 | 4.720 | -7.230 | 8-1.93/C+0.13 | R421 |
| **L-STATION-14-A** | 34.405 | 4.720 | -7.230 | 8+1.93/C+0.13 | R422 |
| **L-STATION-14-B** | 35.045 | 4.720 | -7.230 | 9-1.93/C+0.13 | R423 |

### Related enclosures

| | | | | |
|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 |

28 equipment / 31 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

Source commit 7e3547d9af + file hashes in manifest | Routing 2026-10-18-concealed-2

MODEL TRANSCRIPTION / DERIVED. Metres; displayed decimals are not survey accuracy. Review before installation.

**A3 / sheet 31**

Print 100% / no fit-to-page

THACH BI CHURCH

# L8 / Wings / choir & ministers


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-030


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

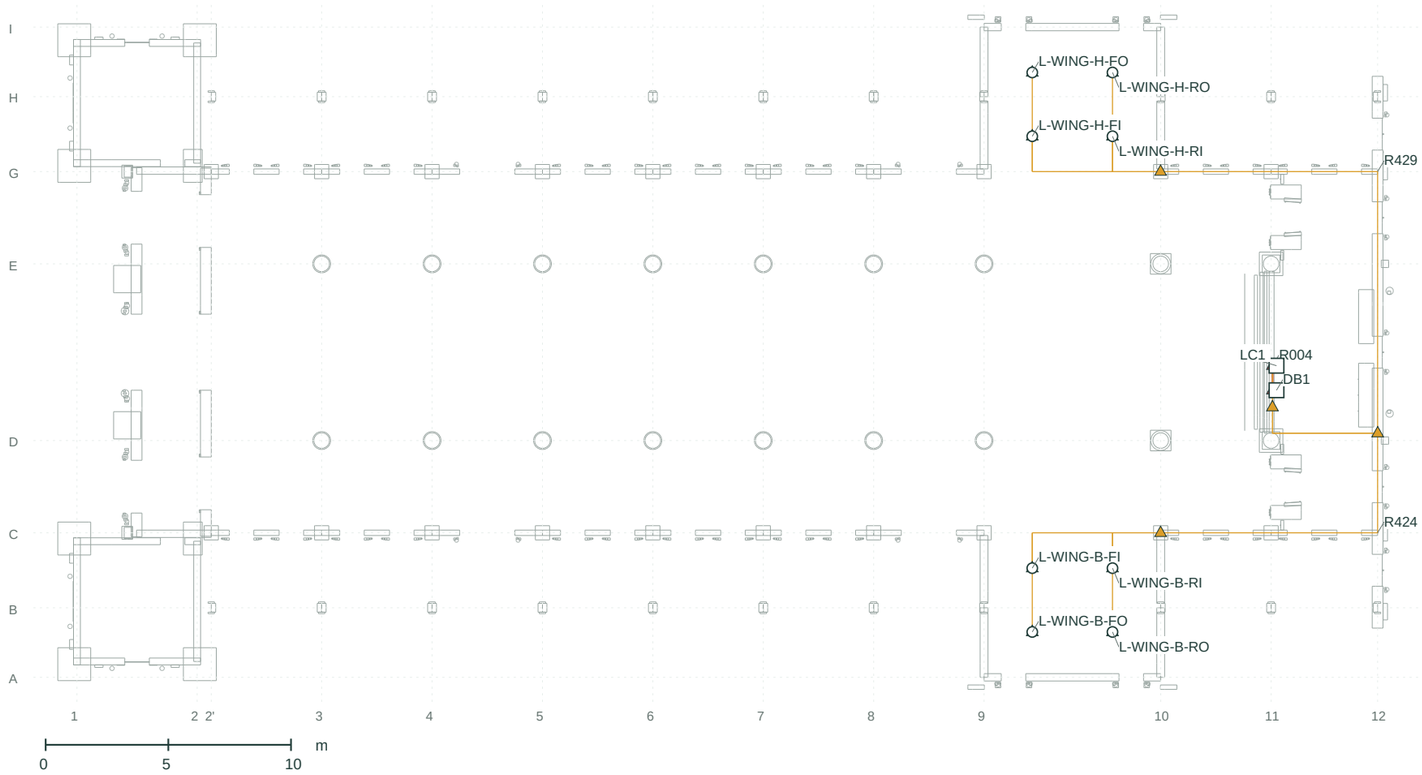


## HEIGHT PROJECTION / X-Y / all Z superimposed

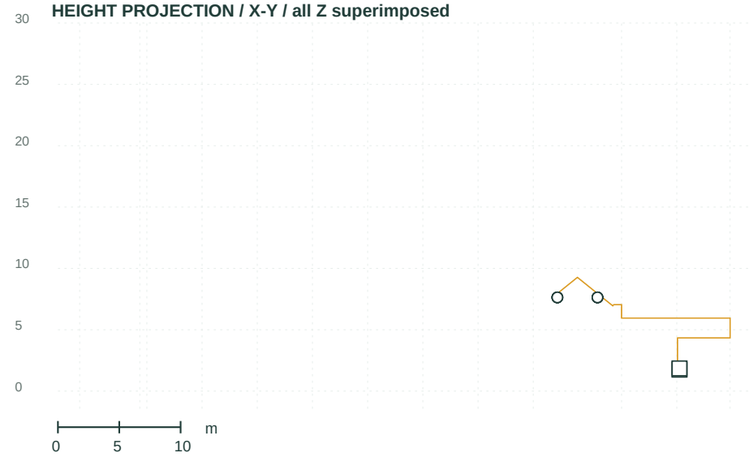


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L-WING-B-FI** | 38.940 | 7.636 | -8.800 | 9+1.96/C-1.44 | R425 |
| **L-WING-B-FO** | 38.940 | 7.636 | -11.400 | 9+1.96/B-0.99 | R426 |
| **L-WING-B-RI** | 42.210 | 7.636 | -8.800 | 10-1.96/C-1.44 | R427 |
| **L-WING-B-RO** | 42.210 | 7.636 | -11.400 | 10-1.96/B-0.99 | R428 |
| **L-WING-H-FI** | 38.940 | 7.636 | 8.800 | 9+1.96/G+1.44 | R430 |
| **L-WING-H-FO** | 38.940 | 7.636 | 11.400 | 9+1.96/H+0.99 | R431 |
| **L-WING-H-RI** | 42.210 | 7.636 | 8.800 | 10-1.96/G+1.44 | R432 |
| **L-WING-H-RO** | 42.210 | 7.636 | 11.400 | 10-1.96/H+0.99 | R433 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 | |

8 equipment / 11 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I03, I14, I25 (key on sheet IM-01).

THACH BI CHURCH

# LD / Column up/down lights


Top plan 1:250 / longitudinal height projection 1:500 at A3 / metres

E-031


DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

## PLAN / X-Z / +X toward sanctuary >

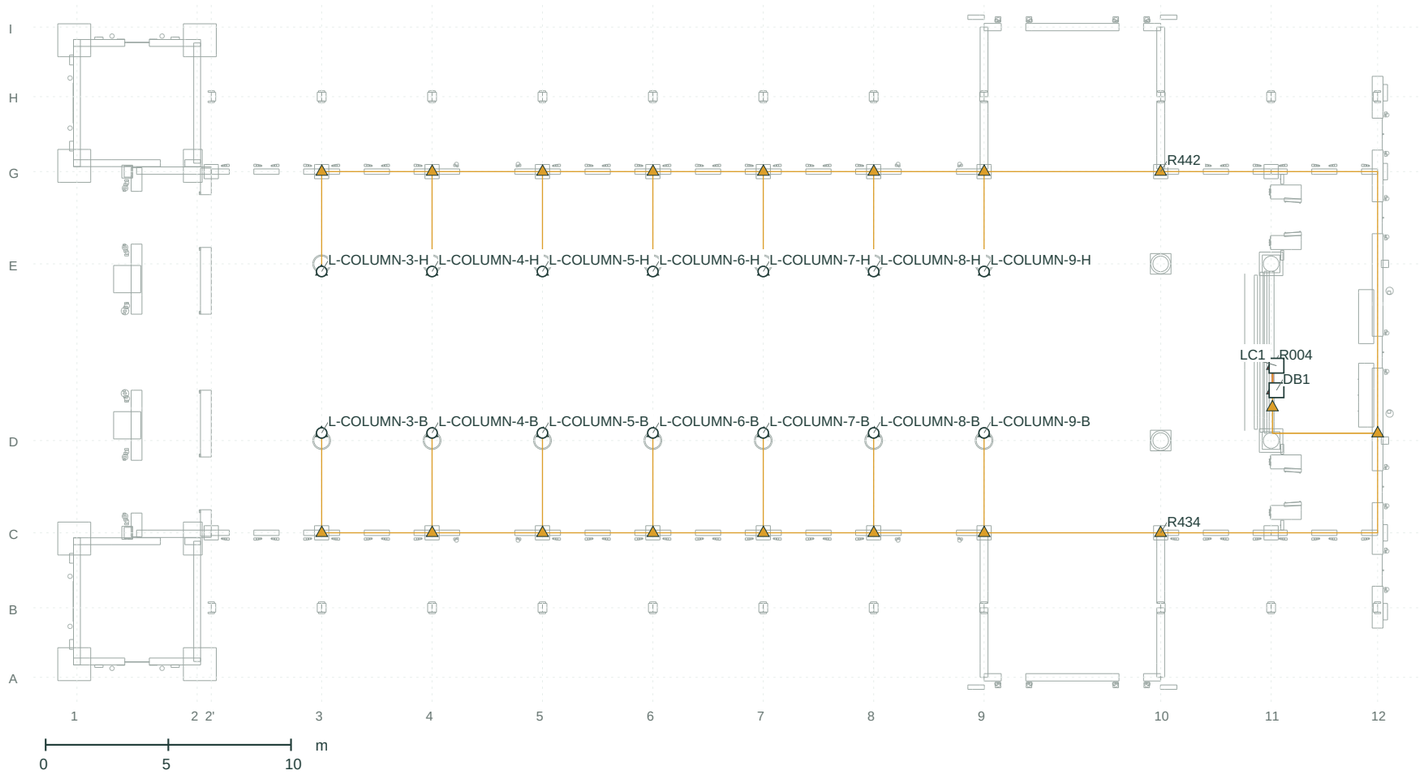


## HEIGHT PROJECTION / X-Y / all Z superimposed

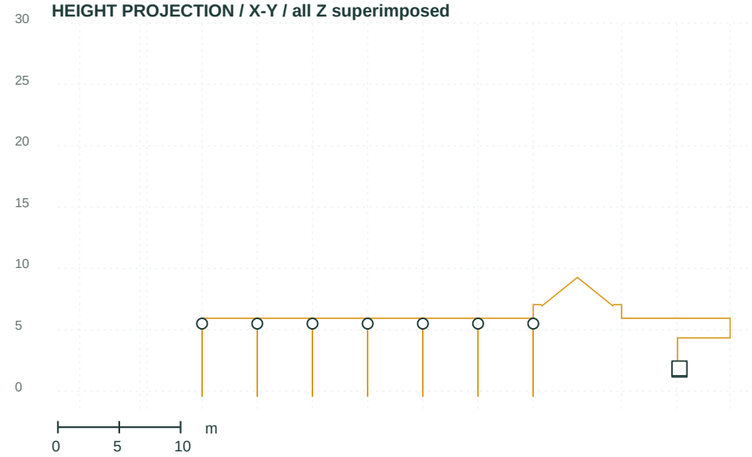


## COORDINATES / X, Y, Z (m)

| ID | X | Y | Z | Grid set-out | Branch |
|---|---|---|---|---|---|
| **L-COLUMN-3-B** | 9.975 | 5.500 | -3.290 | 3+0.00/D+0.31 | R435 |
| **L-COLUMN-3-H** | 9.975 | 5.500 | 3.290 | 3+0.00/E-0.31 | R443 |
| **L-COLUMN-4-B** | 14.475 | 5.500 | -3.290 | 4+0.00/D+0.31 | R436 |
| **L-COLUMN-4-H** | 14.475 | 5.500 | 3.290 | 4+0.00/E-0.31 | R444 |
| **L-COLUMN-5-B** | 18.975 | 5.500 | -3.290 | 5+0.00/D+0.31 | R437 |
| **L-COLUMN-5-H** | 18.975 | 5.500 | 3.290 | 5+0.00/E-0.31 | R445 |
| **L-COLUMN-6-B** | 23.475 | 5.500 | -3.290 | 6+0.00/D+0.31 | R438 |
| **L-COLUMN-6-H** | 23.475 | 5.500 | 3.290 | 6+0.00/E-0.31 | R446 |
| **L-COLUMN-7-B** | 27.975 | 5.500 | -3.290 | 7+0.00/D+0.31 | R439 |
| **L-COLUMN-7-H** | 27.975 | 5.500 | 3.290 | 7+0.00/E-0.31 | R447 |
| **L-COLUMN-8-B** | 32.475 | 5.500 | -3.290 | 8+0.00/D+0.31 | R440 |
| **L-COLUMN-8-H** | 32.475 | 5.500 | 3.290 | 8+0.00/E-0.31 | R448 |
| **L-COLUMN-9-B** | 36.975 | 5.500 | -3.290 | 9+0.00/D+0.31 | R441 |
| **L-COLUMN-9-H** | 36.975 | 5.500 | 3.290 | 9+0.00/E-0.31 | R449 |

### Related enclosures

| | | | | | |
|---|---|---|---|---|---|
| **DB1** | 48.895 | 1.750 | -1.550 | 11+0.22/D+2.05 | |
| **LC1** | 48.895 | 1.850 | -0.550 | 11+0.22/D+3.05 | |

14 equipment / 17 routes including upstream context. Coordinates describe model reference points, not anchor or terminal locations.

Grid set-out: nearest axis and offset in metres. 5+1.20 = 1.20 m past axis 5 toward the sanctuary; D-0.35 = 0.35 m from axis D toward B. Height h is above nave floor +0.000.

POWER / SIGNAL: solid / dashed / dotted. Circle: equipment. Square: enclosure. At overlaps, use the coordinate table and the CSV vertices, not a ruler.

PLAN CONTEXT: grey lines are a cut through the model walls, piers and columns at +1.00 m, for orientation. They are not a measured survey; support capacity and openings are not certified here. Lines crossing in projection do not establish a connection.

Triangle: vertical run (riser or drop) in a wall, pier or column. Its heights are in the route set-out sheets (RS).

Trace: equipment ID > branch in route index > shared trunk > feeder. Select that ID in Simulator / Wiring for vertices, height and related controls. Final terminals and control channels: pending.

Installation notes on this sheet: I14, I15, I25 (key on sheet IM-01).

THACH BI CHURCH

# Tower fronts / conduit risers and decoration clearances

Front cut at X = +0.05 m (conduit plane) 1:150 at A3 / tower routes projected on Z-Y / metres


TW-01

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

### Tower B / seen from the courtyard

### Tower H / seen from the courtyard

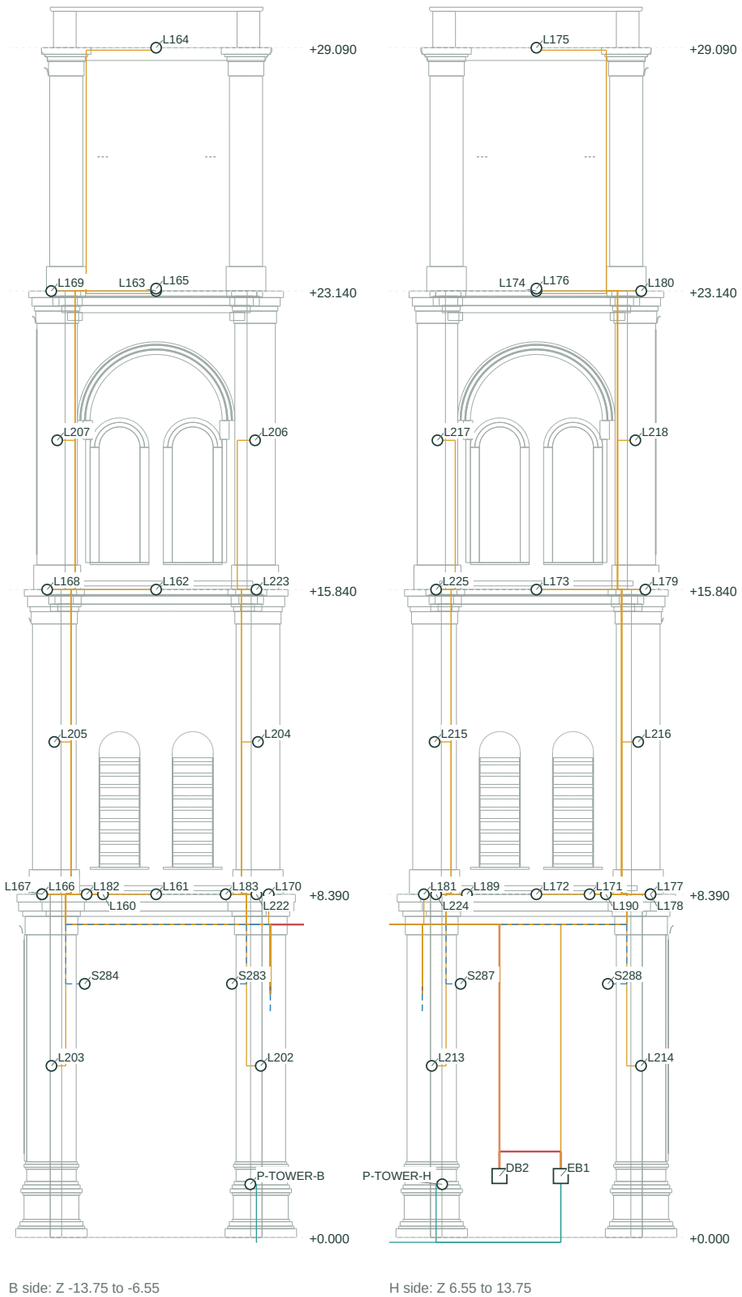


B side: Z -13.75 to -6.55

H side: Z 6.55 to 13.75

0 2.5 5 m

### RISERS IN THE TOWER FRONT WALL

| Tower | Grid set-out | From h | To h | Clear of arch | Routes |
|---|---|---|---|---|---|
| B | 1+0.45/C-0.34 | h-0.12 | h+1.30 | 0.50 m | 1: R371 |
| B | 1+0.00/C-0.58 | h+4.20 | h+7.65 | 0.26 m | 1: R234 |
| B | 1+0.00/C-0.58 | h+6.20 | h+7.65 | - | 1: R354 |
| B | 1+0.00/C-0.58 | h+7.65 | h+8.40 | - | 5: R167/R211/R212/R236/R238 |
| B | 1+0.09/C-0.71 | h+8.40 | h+15.85 | 0.13 m | 2: R212/R238 |
| B | 1+0.09/C-0.71 | h+8.40 | h+12.12 | 0.13 m | 1: R236 |
| B | 1+0.19/C-0.81 | h+15.85 | h+19.49 | 0.06 m | 1: R238 |
| B | 1+0.47/A+1.39 | h+23.15 | h+29.03 | 0.22 m | 1: R204 |
| B | 1+0.19/A+1.11 | h+15.85 | h+23.15 | 0.06 m | 4: R203/R204/R205/R209 |
| B | 1+0.19/A+1.11 | h+15.85 | h+19.49 | 0.06 m | 1: R239 |
| B | 1+0.09/A+1.01 | h+8.40 | h+15.85 | 0.13 m | 7: R202/R203/R204/R205/R208/R209 ... |
| B | 1+0.09/A+1.01 | h+8.40 | h+12.12 | 0.13 m | 1: R237 |
| B | 1+0.00/A+0.89 | h+4.20 | h+7.65 | 0.25 m | 1: R235 |
| B | 1+0.00/A+0.89 | h+6.20 | h+7.65 | - | 1: R355 |
| B | 1+0.00/A+0.89 | h+7.65 | h+8.40 | - | 13: R166/R200/R201/R202/R203/R204 ... |
| H | 1+0.45/G+0.34 | h-0.12 | h+1.30 | 0.50 m | 1: R376 |
| H | 1+0.00/G+0.58 | h+4.20 | h+7.65 | 0.26 m | 1: R248 |
| H | 1+0.00/G+0.58 | h+6.20 | h+7.65 | - | 1: R359 |
| H | 1+0.00/G+0.58 | h+7.65 | h+8.40 | - | 5: R170/R225/R226/R250/R252 |
| H | 1+0.09/G+0.71 | h+8.40 | h+15.85 | 0.13 m | 2: R226/R252 |
| H | 1+0.09/G+0.71 | h+8.40 | h+12.12 | 0.13 m | 1: R250 |
| H | 1+0.19/G+0.81 | h+15.85 | h+19.49 | 0.06 m | 1: R252 |
| H | 1+0.24/H-1.16 | h+1.50 | h+2.10 | board, room face | 1: R002 |
| H | 1+0.24/H+0.34 | h-0.12 | h+1.50 | board, room face | 2: R370/R375 |
| H | 1+0.24/H+0.34 | h+1.50 | h+2.10 | board, room face | 1: R002 |
| H | 1+0.47/I-1.39 | h+23.15 | h+29.03 | 0.22 m | 1: R218 |
| H | 1+0.19/I-1.11 | h+15.85 | h+23.15 | 0.06 m | 4: R217/R218/R219/R223 |
| H | 1+0.19/I-1.11 | h+15.85 | h+19.49 | 0.06 m | 1: R253 |
| H | 1+0.09/I-1.01 | h+8.40 | h+15.85 | 0.13 m | 7: R216/R217/R218/R219/R222/R223 ... |
| H | 1+0.09/I-1.01 | h+8.40 | h+12.12 | 0.13 m | 1: R251 |
| H | 1+0.00/I-0.89 | h+4.20 | h+7.65 | 0.25 m | 1: R249 |
| H | 1+0.00/I-0.89 | h+6.20 | h+7.65 | - | 1: R360 |
| H | 1+0.00/I-0.89 | h+7.65 | h+8.40 | - | 13: R171/R214/R215/R216/R217/R218 ... |

Clear of arch: horizontal distance from the riser to the nearest traced arch envelope (outer moulding ring of the ground or stage arch) over the same height. Negative means inside the arch; louvres, roses and paired openings all lie inside these envelopes.

CAD basis (DWG 23 Oct 2026): the tower drawings dimension only the levels -2.080 / +0.000 / +8.390 / +15.840 / +23.140 / +29.090 / +36.920, the 4.900 m tower width and the 5.830 x 4.130 m plan at +15.84. Arch, louvre and rose centres and radii are traced from drawn lines (E01B, E02), not dimensioned. The DWG has no text for decoration sizes, materials or electrical items.

B / H: the sheet follows model axes (B left, H right seen from the courtyard). The CAD sheets draw H on the left (ENG-027 open). Name towers by grid letter, never left or right.

Keep risers in the solid corner piers. Never chase through louvres, roses or arch mouldings. Wall thickness, pier core, reinforcement and chase depth are on ENGINEERING HOLD; confirm on site before cutting.

THACH BI CHURCH

EQ-01

# Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L1 | L3 | DB1 | Service-room LED panel / 600 x 600 mm | Service-room ceiling panel / 50.0 m |
| L2 | L3 | DB1 | Service-room LED panel / 600 x 600 mm | Service-room ceiling panel / 51.9 m |
| L3 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / B central |
| L4 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / B central / twin |
| L5 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / H central |
| L6 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / H central / twin |
| L7 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / B central |
| L8 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / B central / twin |
| L9 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / H central |
| L10 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / H central / twin |
| L11 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / B central |
| L12 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / B central / twin |
| L13 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / H central |
| L14 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / H central / twin |
| L15 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / B central |
| L16 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / B central / twin |
| L17 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / H central |
| L18 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / H central / twin |
| L19 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / B central |
| L20 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / B central / twin |
| L21 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / H central |
| L22 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / H central / twin |
| L23 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / B central |
| L24 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / B central / twin |
| L25 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / H central |
| L26 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / H central / twin |
| L27 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / B central |
| L28 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / B central / twin |
| L29 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / H central |
| L30 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / H central / twin |
| L31 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / B outer |
| L32 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / B outer / twin |
| L33 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / H outer |
| L34 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 3 / H outer / twin |
| L35 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / B outer |
| L36 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / B outer / twin |
| L37 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / H outer |
| L38 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 4 / H outer / twin |
| L39 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / B outer |

THACH BI CHURCH

EQ-02

# Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L40 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / B outer / twin |
| L41 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / H outer |
| L42 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 5 / H outer / twin |
| L43 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / B outer |
| L44 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / B outer / twin |
| L45 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / H outer |
| L46 | L2 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 6 / H outer / twin |
| L47 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / B outer |
| L48 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / B outer / twin |
| L49 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / H outer |
| L50 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 7 / H outer / twin |
| L51 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / B outer |
| L52 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / B outer / twin |
| L53 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / H outer |
| L54 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 8 / H outer / twin |
| L55 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / B outer |
| L56 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / B outer / twin |
| L57 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / H outer |
| L58 | L1 | DB1 | Reading projector / side bracket, finish-matched | Reading light / axis 9 / H outer / twin |
| L59 | L2 | DB1 | Reading projector / side bracket, finish-matched | Rear rows light / axis 3 side wall / B |
| L60 | L2 | DB1 | Reading projector / side bracket, finish-matched | Rear centre light / axis 3 side wall / B |
| L61 | L2 | DB1 | Reading projector / side bracket, finish-matched | Rear rows light / axis 3 side wall / H |
| L62 | L2 | DB1 | Reading projector / side bracket, finish-matched | Rear centre light / axis 3 side wall / H |
| L71 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 3 |
| L72 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 4 |
| L73 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 5 |
| L74 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 6 |
| L75 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 7 |
| L76 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 8 |
| L77 | LA | DB1 | Roof uplight / wide flood | Roof uplight / axis 9 |
| L81 | L3 | DB1 | Grand chandelier / 12 lamps | Grand chandelier / crossing 9-10 |
| L98 | L3 | DB1 | LED projector / narrow 24 | Altar key light / B |
| L99 | L3 | DB1 | LED projector / narrow 24 | Altar key light / H |
| L100 | L3 | DB1 | Accent spotlight / 15 | Ambo key light |
| L101 | L3 | DB1 | LED projector / medium 36 | Sanctuary step fill / B |
| L102 | L3 | DB1 | LED projector / medium 36 | Sanctuary step fill / H |
| L103 | L3 | DB1 | Accent spotlight / 15 | Presider chair light |
| L104 | L3 | DB1 | LED projector / medium 36 | Sanctuary frame wash / B |
| L105 | L3 | DB1 | LED projector / medium 36 | Sanctuary frame wash / H |

THACH BI CHURCH

EQ-03

# Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L106 | L3 | DB1 | Accent spotlight / 15 | Crucifix accent / B |
| L107 | L3 | DB1 | LED projector / medium 36 | Reredos wash / B |
| L108 | L3 | DB1 | LED projector / medium 36 | Reredos base wash / B |
| L109 | L3 | DB1 | Roof uplight / wide flood | Sanctuary vault uplight / B |
| L110 | L3 | DB1 | Accent spotlight / 15 | Crucifix accent / H |
| L111 | L3 | DB1 | LED projector / medium 36 | Reredos wash / H |
| L112 | L3 | DB1 | LED projector / medium 36 | Reredos base wash / H |
| L113 | L3 | DB1 | Roof uplight / wide flood | Sanctuary vault uplight / H |
| L114 | L3 | DB1 | Accent spotlight / 15 | Tabernacle accent |
| L115 | L3 | DB1 | Accent spotlight / 15 | Statue accent / B |
| L116 | L3 | DB1 | LED projector / medium 36 | Shrine wash / B |
| L117 | L3 | DB1 | Accent spotlight / 15 | Statue accent / H |
| L118 | L3 | DB1 | LED projector / medium 36 | Shrine wash / H |
| L119 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 2'-3 |
| L120 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 3-4 |
| L121 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 4-5 |
| L122 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 5-6 |
| L123 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 6-7 |
| L124 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 7-8 |
| L125 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 8-9 |
| L126 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 10-11 |
| L127 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / B / bay 11-12 |
| L128 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 2'-3 |
| L129 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 3-4 |
| L130 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 4-5 |
| L131 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 5-6 |
| L132 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 6-7 |
| L133 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 7-8 |
| L134 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 8-9 |
| L135 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 10-11 |
| L136 | L4 | DB1 | Open-porch wall flood / concept | Porch path light / H / bay 11-12 |
| L137 | L9 | DB2 | Wall lantern | Central front door lantern / B |
| L138 | L9 | DB2 | Wall lantern | Central front door lantern / H |
| L139 | L5 | DB1 | Wall lantern | Side door lantern / B / 16.725 / front |
| L140 | L5 | DB1 | Wall lantern | Side door lantern / B / 16.725 / rear |
| L141 | L5 | DB1 | Wall lantern | Side door lantern / B / 34.725 / front |
| L142 | L5 | DB1 | Wall lantern | Side door lantern / B / 34.725 / rear |
| L145 | L5 | DB1 | Wall lantern | Side door lantern / H / 16.725 / front |
| L146 | L5 | DB1 | Wall lantern | Side door lantern / H / 16.725 / rear |

# Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L147 | L5 | DB1 | Wall lantern | Side door lantern / H / 34.725 / front |
| L148 | L5 | DB1 | Wall lantern | Side door lantern / H / 34.725 / rear |
| L151 | L3 | DB1 | Wall lantern | Service door lantern / B / front |
| L152 | L3 | DB1 | Wall lantern | Service door lantern / B / rear |
| L153 | L3 | DB1 | Wall lantern | Service door lantern / H / front |
| L154 | L3 | DB1 | Wall lantern | Service door lantern / H / rear |
| L155 | E1 | DB1 | Exit sign (maintained) | Exit sign / main doors |
| L156 | E1 | DB1 | Exit sign (maintained) | Exit sign / side door 16.7 / B |
| L157 | E1 | DB1 | Exit sign (maintained) | Exit sign / side door 16.7 / H |
| L158 | E1 | DB1 | Exit sign (maintained) | Exit sign / side door 34.7 / B |
| L159 | E1 | DB1 | Exit sign (maintained) | Exit sign / side door 34.7 / H |
| L160 | L6 | DB2 | Compact ledge floodlight / cornice colour | Tower lower front wash / B |
| L161 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 2 flood / B |
| L162 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 3 flood / B |
| L163 | L6 | DB2 | Tower ledge light bar / cornice colour | Belfry front wash / B |
| L164 | L6 | DB2 | Compact ledge floodlight / cornice colour | Dome front wash / B |
| L165 | L6 | DB2 | Roof uplight / wide flood | Belfry glow / B |
| L166 | L6 | DB2 | Compact ledge floodlight / cornice colour | Tower lower side wash / B |
| L167 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 2 side wash / B |
| L168 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 3 side wash / B |
| L169 | L6 | DB2 | Tower ledge light bar / cornice colour | Belfry side wash / B |
| L170 | L6 | DB2 | Compact ledge floodlight / cornice colour | Facade wash / B |
| L171 | L6 | DB2 | Compact ledge floodlight / cornice colour | Tower lower front wash / H |
| L172 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 2 flood / H |
| L173 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 3 flood / H |
| L174 | L6 | DB2 | Tower ledge light bar / cornice colour | Belfry front wash / H |
| L175 | L6 | DB2 | Compact ledge floodlight / cornice colour | Dome front wash / H |
| L176 | L6 | DB2 | Roof uplight / wide flood | Belfry glow / H |
| L177 | L6 | DB2 | Compact ledge floodlight / cornice colour | Tower lower side wash / H |
| L178 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 2 side wash / H |
| L179 | L6 | DB2 | Tower ledge light bar / cornice colour | Tower stage 3 side wash / H |
| L180 | L6 | DB2 | Tower ledge light bar / cornice colour | Belfry side wash / H |
| L181 | L6 | DB2 | Compact ledge floodlight / cornice colour | Facade wash / H |
| L182 | L9 | DB2 | Compact ledge floodlight / cornice colour | Stage flood / tower B / outer |
| L183 | L9 | DB2 | Compact ledge floodlight / cornice colour | Stage flood / tower B / inner |
| L184 | L5 | DB1 | LED projector / medium 36 | Path light / axis 4 / B |
| L185 | L5 | DB1 | LED projector / medium 36 | Path light / axis 6 / B |
| L186 | L5 | DB1 | LED projector / medium 36 | Path light / axis 11 / B |
| L187 | L5 | DB1 | LED projector / medium 36 | Path light / wing gable B |

THACH BI CHURCH

EQ-05

# Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L188 | L5 | DB1 | LED projector / medium 36 | Path light / rear / B |
| L189 | L9 | DB2 | Compact ledge floodlight / cornice colour | Stage flood / tower H / inner |
| L190 | L9 | DB2 | Compact ledge floodlight / cornice colour | Stage flood / tower H / outer |
| L191 | L5 | DB1 | LED projector / medium 36 | Path light / axis 4 / H |
| L192 | L5 | DB1 | LED projector / medium 36 | Path light / axis 6 / H |
| L193 | L5 | DB1 | LED projector / medium 36 | Path light / axis 11 / H |
| L194 | L5 | DB1 | LED projector / medium 36 | Path light / wing gable H |
| L195 | L5 | DB1 | LED projector / medium 36 | Path light / rear / H |
| L196 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / roof ridge |
| L197 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / main eave B / nave |
| L198 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / main eave B / sanctuary |
| L199 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / veranda eave B / nave |
| L200 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / veranda eave B / sanctuary |
| L201 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / rear gable B |
| L202 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower B / stage 1 / inner corner |
| L203 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower B / stage 1 / outer corner |
| L204 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower B / stage 2 / inner corner |
| L205 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower B / stage 2 / outer corner |
| L206 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower B / stage 3 / inner corner |
| L207 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower B / stage 3 / outer corner |
| L208 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / main eave H / nave |
| L209 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / main eave H / sanctuary |
| L210 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / veranda eave H / nave |
| L211 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / veranda eave H / sanctuary |
| L212 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / rear gable H |
| L213 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower H / stage 1 / inner corner |
| L214 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower H / stage 1 / outer corner |
| L215 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower H / stage 2 / inner corner |
| L216 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower H / stage 2 / outer corner |
| L217 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower H / stage 3 / inner corner |
| L218 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / tower H / stage 3 / outer corner |
| L219 | L7 | DB2 | Festival bulb string (outdoor) | Festival lights / front terrace between the towers |
| L220 | L7 | DB2 | Facade floodlight | Festival flood / rear gable B |
| L221 | L7 | DB2 | Facade floodlight | Festival flood / rear gable H |
| L222 | L6 | DB2 | Compact ledge floodlight / cornice colour | Central gable flood / B |
| L223 | L6 | DB2 | Compact ledge floodlight / cornice colour | Central crown wash / B |
| L224 | L6 | DB2 | Compact ledge floodlight / cornice colour | Central gable flood / H |
| L225 | L6 | DB2 | Compact ledge floodlight / cornice colour | Central crown wash / H |
| F226 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 2'-3 / B aisle |

THACH BI CHURCH

EQ-06

# Equipment naming schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| F227 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 2'-3 / H aisle |
| F228 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 3-4 / B aisle |
| F229 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 3-4 / H aisle |
| F230 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 4-5 / B aisle |
| F231 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 4-5 / H aisle |
| F232 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 5-6 / B aisle |
| F233 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 5-6 / H aisle |
| F234 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 6-7 / B aisle |
| F235 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 6-7 / H aisle |
| F236 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 7-8 / B aisle |
| F237 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 7-8 / H aisle |
| F238 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 8-9 / B aisle |
| F239 | F1 | DB1 | Ceiling fan / 1.42 m (56") | Ceiling fan / bay 8-9 / H aisle |
| F240 | F5 | DB1 | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing B / 1 / held review |
| F241 | F5 | DB1 | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing B / 2 / held review |
| F242 | F5 | DB1 | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing H / 1 / held review |
| F243 | F5 | DB1 | Wing wall fan / 45 cm / extended bracket concept | Wall fan / wing H / 2 / held review |
| F244 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 4 / B |
| F245 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 4 / H |
| F246 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 6 / B |
| F247 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 6 / H |
| F248 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 8 / B |
| F249 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 8 / H |
| F250 | F4 | DB2 | Large wall circulator / 90 cm | Entrance circulator / B |
| F251 | F4 | DB2 | Large wall circulator / 90 cm | Entrance circulator / H |
| F252 | V1 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / front gable / B outer |
| F253 | V1 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / front gable / B inner |
| F254 | V1 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / front gable / H inner |
| F255 | V1 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / front gable / H outer |
| F256 | V2 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / wing gable B / front |
| F257 | V2 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / wing gable B / rear |
| F258 | V2 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / wing gable H / front |
| F259 | V2 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / wing gable H / rear |
| F260 | V3 | DB1 | Exhaust (ventilation) fan / 50 cm | Exhaust fan / service room |
| S261 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 4 / B |
| S262 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 4 / H |
| S263 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 5 / B |
| S264 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 5 / H |
| S265 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 6 / B |

# Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| S266 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 6 / H |
| S267 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 7 / B |
| S268 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 7 / H |
| S269 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 8 / B |
| S270 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 8 / H |
| S271 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 9 / B |
| S272 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / axis 9 / H |
| S273 | A5 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / entrance hall / B |
| S274 | A5 | DB1 | Slim wall column / 0.6 m, wall colour | Wall speaker / entrance hall / H |
| S276 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wing speaker / B / toward entrance / held |
| S278 | A1 | DB1 | Slim wall column / 0.6 m, wall colour | Wing speaker / H / toward entrance / held |
| S279 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 3-4 |
| S280 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 6-7 |
| S281 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 3-4 |
| S282 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 6-7 |
| S283 | A3 | DB1 | Outdoor horn / 30 W | Courtyard horn / B |
| S284 | A3 | DB1 | Outdoor horn / 30 W | Tower horn / B / outer |
| S285 | A3 | DB1 | Outdoor horn / 30 W | Side courtyard horn / axis 5 / B |
| S286 | A3 | DB1 | Outdoor horn / 30 W | Side courtyard horn / axis 8 / B |
| S287 | A3 | DB1 | Outdoor horn / 30 W | Courtyard horn / H |
| S288 | A3 | DB1 | Outdoor horn / 30 W | Tower horn / H / outer |
| S289 | A3 | DB1 | Outdoor horn / 30 W | Side courtyard horn / axis 5 / H |
| S290 | A3 | DB1 | Outdoor horn / 30 W | Side courtyard horn / axis 8 / H |
| S291 | MIC | DB1 | Gooseneck microphone (cardioid) | Ambo microphone |
| S292 | MIC | DB1 | Gooseneck microphone (cardioid) | Altar microphone |
| F-NAVE-B-2P | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 2' / B |
| F-NAVE-H-2P | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 2' / H |
| F-NAVE-B-3 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 3 / B |
| F-NAVE-H-3 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 3 / H |
| F-NAVE-B-5 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 5 / B |
| F-NAVE-H-5 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 5 / H |
| F-NAVE-B-7 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 7 / B |
| F-NAVE-H-7 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 7 / H |
| F-NAVE-B-9 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 9 / B |
| F-NAVE-H-9 | F2 | DB1 | Nave wall fan / 45 cm / extended bracket concept | Wall fan / axis 9 / H |
| P-SANCT-B | P1 | DB1 | Double socket outlet / 16 A / recessed | Socket / sanctuary side B / axis 10 pier |
| P-NAVE-B | P1 | DB1 | Double socket outlet / 16 A / recessed | Socket / mid-nave side B / axis 6 |
| P-TOWER-B | P3 | DB2 | Event power point / 32 A + 2 x 16 A / lockable | Event power / tower B / inside the porch |
| P-SANCT-H | P2 | DB1 | Double socket outlet / 16 A / recessed | Socket / sanctuary side H / axis 10 pier |

# Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| P-NAVE-H | P2 | DB1 | Double socket outlet / 16 A / recessed | Socket / mid-nave side H / axis 6 |
| P-TOWER-H | P4 | DB2 | Event power point / 32 A + 2 x 16 A / lockable | Event power / tower H / inside the porch |
| L-STATUE-C-ARCH | L10 | DB2 | Concealed light line / niche arch | Hidden arch light / Assumption of Our Lady |
| L-STATUE-C-JAMB-1 | L10 | DB2 | Concealed light line / niche jamb | Hidden jamb light / Assumption of Our Lady / B side |
| L-STATUE-C-CANDLE-1 | L10 | DB2 | Statue candle light / electric flame | Statue candle light / Assumption of Our Lady / B side |
| L-STATUE-C-JAMB-2 | L10 | DB2 | Concealed light line / niche jamb | Hidden jamb light / Assumption of Our Lady / H side |
| L-STATUE-C-CANDLE-2 | L10 | DB2 | Statue candle light / electric flame | Statue candle light / Assumption of Our Lady / H side |
| L-STATUE-B-ARCH | L10 | DB2 | Concealed light line / niche arch | Hidden arch light / Saint Peter |
| L-STATUE-B-JAMB-1 | L10 | DB2 | Concealed light line / niche jamb | Hidden jamb light / Saint Peter / B side |
| L-STATUE-B-CANDLE-1 | L10 | DB2 | Statue candle light / electric flame | Statue candle light / Saint Peter / B side |
| L-STATUE-B-JAMB-2 | L10 | DB2 | Concealed light line / niche jamb | Hidden jamb light / Saint Peter / H side |
| L-STATUE-B-CANDLE-2 | L10 | DB2 | Statue candle light / electric flame | Statue candle light / Saint Peter / H side |
| L-STATUE-H-ARCH | L10 | DB2 | Concealed light line / niche arch | Hidden arch light / Saint Paul |
| L-STATUE-H-JAMB-1 | L10 | DB2 | Concealed light line / niche jamb | Hidden jamb light / Saint Paul / B side |
| L-STATUE-H-CANDLE-1 | L10 | DB2 | Statue candle light / electric flame | Statue candle light / Saint Paul / B side |
| L-STATUE-H-JAMB-2 | L10 | DB2 | Concealed light line / niche jamb | Hidden jamb light / Saint Paul / H side |
| L-STATUE-H-CANDLE-2 | L10 | DB2 | Statue candle light / electric flame | Statue candle light / Saint Paul / H side |
| L-STATION-1-A | LS | DB1 | Station candle light / wall | Station candle / I / front |
| L-STATION-1-B | LS | DB1 | Station candle light / wall | Station candle / I / rear |
| L-STATION-2-A | LS | DB1 | Station candle light / wall | Station candle / II / front |
| L-STATION-2-B | LS | DB1 | Station candle light / wall | Station candle / II / rear |
| L-STATION-3-A | LS | DB1 | Station candle light / wall | Station candle / III / front |
| L-STATION-3-B | LS | DB1 | Station candle light / wall | Station candle / III / rear |
| L-STATION-4-A | LS | DB1 | Station candle light / wall | Station candle / IV / front |
| L-STATION-4-B | LS | DB1 | Station candle light / wall | Station candle / IV / rear |
| L-STATION-5-A | LS | DB1 | Station candle light / wall | Station candle / V / front |
| L-STATION-5-B | LS | DB1 | Station candle light / wall | Station candle / V / rear |
| L-STATION-6-A | LS | DB1 | Station candle light / wall | Station candle / VI / front |
| L-STATION-6-B | LS | DB1 | Station candle light / wall | Station candle / VI / rear |
| L-STATION-7-A | LS | DB1 | Station candle light / wall | Station candle / VII / front |
| L-STATION-7-B | LS | DB1 | Station candle light / wall | Station candle / VII / rear |
| L-STATION-8-A | LS | DB1 | Station candle light / wall | Station candle / VIII / front |
| L-STATION-8-B | LS | DB1 | Station candle light / wall | Station candle / VIII / rear |
| L-STATION-9-A | LS | DB1 | Station candle light / wall | Station candle / IX / front |
| L-STATION-9-B | LS | DB1 | Station candle light / wall | Station candle / IX / rear |
| L-STATION-10-A | LS | DB1 | Station candle light / wall | Station candle / X / front |
| L-STATION-10-B | LS | DB1 | Station candle light / wall | Station candle / X / rear |
| L-STATION-11-A | LS | DB1 | Station candle light / wall | Station candle / XI / front |
| L-STATION-11-B | LS | DB1 | Station candle light / wall | Station candle / XI / rear |

# Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L-STATION-12-A | LS | DB1 | Station candle light / wall | Station candle / XII / front |
| L-STATION-12-B | LS | DB1 | Station candle light / wall | Station candle / XII / rear |
| L-STATION-13-A | LS | DB1 | Station candle light / wall | Station candle / XIII / front |
| L-STATION-13-B | LS | DB1 | Station candle light / wall | Station candle / XIII / rear |
| L-STATION-14-A | LS | DB1 | Station candle light / wall | Station candle / XIV / front |
| L-STATION-14-B | LS | DB1 | Station candle light / wall | Station candle / XIV / rear |
| L-WING-B-FI | L8 | DB1 | LED projector / narrow 24 | Wing downlight / B / front block / inner row |
| L-WING-B-FO | L8 | DB1 | LED projector / narrow 24 | Wing downlight / B / front block / outer row |
| L-WING-B-RI | L8 | DB1 | LED projector / narrow 24 | Wing downlight / B / rear block / inner row |
| L-WING-B-RO | L8 | DB1 | LED projector / narrow 24 | Wing downlight / B / rear block / outer row |
| L-WING-H-FI | L8 | DB1 | LED projector / narrow 24 | Wing downlight / H / front block / inner row |
| L-WING-H-FO | L8 | DB1 | LED projector / narrow 24 | Wing downlight / H / front block / outer row |
| L-WING-H-RI | L8 | DB1 | LED projector / narrow 24 | Wing downlight / H / rear block / inner row |
| L-WING-H-RO | L8 | DB1 | LED projector / narrow 24 | Wing downlight / H / rear block / outer row |
| L-COLUMN-3-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 3 / B |
| L-COLUMN-3-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 3 / H |
| L-COLUMN-4-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 4 / B |
| L-COLUMN-4-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 4 / H |
| L-COLUMN-5-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 5 / B |
| L-COLUMN-5-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 5 / H |
| L-COLUMN-6-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 6 / B |
| L-COLUMN-6-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 6 / H |
| L-COLUMN-7-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 7 / B |
| L-COLUMN-7-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 7 / H |
| L-COLUMN-8-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 8 / B |
| L-COLUMN-8-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 8 / H |
| L-COLUMN-9-B | LD | DB1 | Column up/down light / concept | Column up/down light / axis 9 / B |
| L-COLUMN-9-H | LD | DB1 | Column up/down light / concept | Column up/down light / axis 9 / H |
| L-ARCH-B-2P-3-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 2'-3 / A |
| L-ARCH-B-2P-3-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 2'-3 / B |
| S-PORCH-B-2P-3 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 2'-3 |
| L-ARCH-B-3-4-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 3-4 / A |
| L-ARCH-B-3-4-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 3-4 / B |
| L-ARCH-B-4-5-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 4-5 / A |
| L-ARCH-B-4-5-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 4-5 / B |
| S-PORCH-B-4-5 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 4-5 |
| L-ARCH-B-5-6-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 5-6 / A |
| L-ARCH-B-5-6-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 5-6 / B |
| S-PORCH-B-5-6 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 5-6 |

# Equipment naming schedule

Installed-study items only / product ratings, dimensions and selected manufacturers remain pending

| ID | Circuit | Board | Provisional category | Model equipment name |
|---|---|---|---|---|
| L-ARCH-B-6-7-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 6-7 / A |
| L-ARCH-B-6-7-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 6-7 / B |
| L-ARCH-B-7-8-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 7-8 / A |
| L-ARCH-B-7-8-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 7-8 / B |
| S-PORCH-B-7-8 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 7-8 |
| L-ARCH-B-8-9-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 8-9 / A |
| L-ARCH-B-8-9-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 8-9 / B |
| S-PORCH-B-8-9 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 8-9 |
| L-ARCH-B-10-11-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 10-11 / A |
| L-ARCH-B-10-11-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 10-11 / B |
| S-PORCH-B-10-11 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 10-11 |
| L-ARCH-B-11-12-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 11-12 / A |
| L-ARCH-B-11-12-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / B / bay 11-12 / B |
| S-PORCH-B-11-12 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / B / bay 11-12 |
| L-ARCH-H-2P-3-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 2'-3 / A |
| L-ARCH-H-2P-3-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 2'-3 / B |
| S-PORCH-H-2P-3 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 2'-3 |
| L-ARCH-H-3-4-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 3-4 / A |
| L-ARCH-H-3-4-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 3-4 / B |
| L-ARCH-H-4-5-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 4-5 / A |
| L-ARCH-H-4-5-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 4-5 / B |
| S-PORCH-H-4-5 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 4-5 |
| L-ARCH-H-5-6-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 5-6 / A |
| L-ARCH-H-5-6-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 5-6 / B |
| S-PORCH-H-5-6 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 5-6 |
| L-ARCH-H-6-7-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 6-7 / A |
| L-ARCH-H-6-7-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 6-7 / B |
| L-ARCH-H-7-8-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 7-8 / A |
| L-ARCH-H-7-8-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 7-8 / B |
| S-PORCH-H-7-8 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 7-8 |
| L-ARCH-H-8-9-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 8-9 / A |
| L-ARCH-H-8-9-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 8-9 / B |
| S-PORCH-H-8-9 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 8-9 |
| L-ARCH-H-10-11-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 10-11 / A |
| L-ARCH-H-10-11-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 10-11 / B |
| S-PORCH-H-10-11 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 10-11 |
| L-ARCH-H-11-12-A | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 11-12 / A |
| L-ARCH-H-11-12-B | L4 | DB1 | Open-porch wall flood / concept | Porch arch wash / H / bay 11-12 / B |
| S-PORCH-H-11-12 | A2 | DB1 | Open-porch wall fill / 6" / concept | Porch fill / H / bay 11-12 |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R001 | feeder:DB2 | DB1 | DB2-FEED | Shared context | 94.96 | - |
| R002 | feeder:EB1 | DB2 | EB1-SUPPLY | Shared context | 2.70 | - |
| R003 | feeder:AV1 | DB1 | AV1-SUPPLY | Shared context | 5.79 | - |
| R004 | feeder:LC1 | DB1 | LC1-SUPPLY | Shared context | 2.56 | - |
| R005 | feeder:FC1 | DB1 | FC1-SUPPLY | Shared context | 3.41 | - |
| R006 | local:L1 | LC1 | L3 | L1 | 8.03 | - |
| R007 | local:L2 | LC1 | L3 | L2 | 9.93 | - |
| R008 | trunk:LC1:L2:light:-1 | LC1 | L2 | Shared context | 63.06 | - |
| R009 | drop:LC1:L2:light:-1:L3 | LC1 | L2 | L3 | 9.70 | - |
| R010 | drop:LC1:L2:light:-1:L4 | LC1 | L2 | L4 | 8.14 | - |
| R011 | drop:LC1:L2:light:-1:L7 | LC1 | L2 | L7 | 9.70 | - |
| R012 | drop:LC1:L2:light:-1:L8 | LC1 | L2 | L8 | 8.14 | - |
| R013 | drop:LC1:L2:light:-1:L11 | LC1 | L2 | L11 | 9.70 | - |
| R014 | drop:LC1:L2:light:-1:L12 | LC1 | L2 | L12 | 8.14 | - |
| R015 | drop:LC1:L2:light:-1:L16 | LC1 | L2 | L16 | 8.14 | - |
| R016 | drop:LC1:L2:light:-1:L31 | LC1 | L2 | L31 | 2.86 | - |
| R017 | drop:LC1:L2:light:-1:L32 | LC1 | L2 | L32 | 4.10 | - |
| R018 | drop:LC1:L2:light:-1:L35 | LC1 | L2 | L35 | 2.86 | - |
| R019 | drop:LC1:L2:light:-1:L36 | LC1 | L2 | L36 | 4.10 | - |
| R020 | drop:LC1:L2:light:-1:L39 | LC1 | L2 | L39 | 2.86 | - |
| R021 | drop:LC1:L2:light:-1:L40 | LC1 | L2 | L40 | 4.10 | - |
| R022 | drop:LC1:L2:light:-1:L44 | LC1 | L2 | L44 | 4.10 | - |
| R023 | drop:LC1:L2:light:-1:L59 | LC1 | L2 | L59 | 2.37 | - |
| R024 | drop:LC1:L2:light:-1:L60 | LC1 | L2 | L60 | 2.37 | - |
| R025 | trunk:LC1:L2:light:1 | LC1 | L2 | Shared context | 69.66 | - |
| R026 | drop:LC1:L2:light:1:L5 | LC1 | L2 | L5 | 9.70 | - |
| R027 | drop:LC1:L2:light:1:L6 | LC1 | L2 | L6 | 8.14 | - |
| R028 | drop:LC1:L2:light:1:L9 | LC1 | L2 | L9 | 9.70 | - |
| R029 | drop:LC1:L2:light:1:L10 | LC1 | L2 | L10 | 8.14 | - |
| R030 | drop:LC1:L2:light:1:L13 | LC1 | L2 | L13 | 9.70 | - |
| R031 | drop:LC1:L2:light:1:L14 | LC1 | L2 | L14 | 8.14 | - |
| R032 | drop:LC1:L2:light:1:L18 | LC1 | L2 | L18 | 8.14 | - |
| R033 | drop:LC1:L2:light:1:L33 | LC1 | L2 | L33 | 2.86 | - |
| R034 | drop:LC1:L2:light:1:L34 | LC1 | L2 | L34 | 4.10 | - |
| R035 | drop:LC1:L2:light:1:L37 | LC1 | L2 | L37 | 2.86 | - |
| R036 | drop:LC1:L2:light:1:L38 | LC1 | L2 | L38 | 4.10 | - |
| R037 | drop:LC1:L2:light:1:L41 | LC1 | L2 | L41 | 2.86 | - |
| R038 | drop:LC1:L2:light:1:L42 | LC1 | L2 | L42 | 4.10 | - |
| R039 | drop:LC1:L2:light:1:L46 | LC1 | L2 | L46 | 4.10 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R040 | drop:LC1:L2:light:1:L61 | LC1 | L2 | L61 | 2.37 | - |
| R041 | drop:LC1:L2:light:1:L62 | LC1 | L2 | L62 | 2.37 | - |
| R042 | trunk:LC1:L1:light:-1 | LC1 | L1 | Shared context | 48.73 | - |
| R043 | drop:LC1:L1:light:-1:L15 | LC1 | L1 | L15 | 9.71 | - |
| R044 | drop:LC1:L1:light:-1:L19 | LC1 | L1 | L19 | 9.71 | - |
| R045 | drop:LC1:L1:light:-1:L20 | LC1 | L1 | L20 | 8.14 | - |
| R046 | drop:LC1:L1:light:-1:L23 | LC1 | L1 | L23 | 9.71 | - |
| R047 | drop:LC1:L1:light:-1:L24 | LC1 | L1 | L24 | 8.14 | - |
| R048 | drop:LC1:L1:light:-1:L27 | LC1 | L1 | L27 | 8.57 | - |
| R049 | drop:LC1:L1:light:-1:L28 | LC1 | L1 | L28 | 7.00 | - |
| R050 | drop:LC1:L1:light:-1:L43 | LC1 | L1 | L43 | 2.86 | - |
| R051 | drop:LC1:L1:light:-1:L47 | LC1 | L1 | L47 | 2.86 | - |
| R052 | drop:LC1:L1:light:-1:L48 | LC1 | L1 | L48 | 4.11 | - |
| R053 | drop:LC1:L1:light:-1:L51 | LC1 | L1 | L51 | 2.86 | - |
| R054 | drop:LC1:L1:light:-1:L52 | LC1 | L1 | L52 | 4.11 | - |
| R055 | drop:LC1:L1:light:-1:L55 | LC1 | L1 | L55 | 1.72 | - |
| R056 | drop:LC1:L1:light:-1:L56 | LC1 | L1 | L56 | 2.97 | - |
| R057 | trunk:LC1:L1:light:1 | LC1 | L1 | Shared context | 55.33 | - |
| R058 | drop:LC1:L1:light:1:L17 | LC1 | L1 | L17 | 9.71 | - |
| R059 | drop:LC1:L1:light:1:L21 | LC1 | L1 | L21 | 9.71 | - |
| R060 | drop:LC1:L1:light:1:L22 | LC1 | L1 | L22 | 8.14 | - |
| R061 | drop:LC1:L1:light:1:L25 | LC1 | L1 | L25 | 9.71 | - |
| R062 | drop:LC1:L1:light:1:L26 | LC1 | L1 | L26 | 8.14 | - |
| R063 | drop:LC1:L1:light:1:L29 | LC1 | L1 | L29 | 8.57 | - |
| R064 | drop:LC1:L1:light:1:L30 | LC1 | L1 | L30 | 7.00 | - |
| R065 | drop:LC1:L1:light:1:L45 | LC1 | L1 | L45 | 2.86 | - |
| R066 | drop:LC1:L1:light:1:L49 | LC1 | L1 | L49 | 2.86 | - |
| R067 | drop:LC1:L1:light:1:L50 | LC1 | L1 | L50 | 4.11 | - |
| R068 | drop:LC1:L1:light:1:L53 | LC1 | L1 | L53 | 2.86 | - |
| R069 | drop:LC1:L1:light:1:L54 | LC1 | L1 | L54 | 4.11 | - |
| R070 | drop:LC1:L1:light:1:L57 | LC1 | L1 | L57 | 1.72 | - |
| R071 | drop:LC1:L1:light:1:L58 | LC1 | L1 | L58 | 2.97 | - |
| R072 | trunk:LC1:LA:light:-1 | LC1 | LA | Shared context | 62.31 | - |
| R073 | drop:LC1:LA:light:-1:L71 | LC1 | LA | L71 | 10.20 | - |
| R074 | drop:LC1:LA:light:-1:L72 | LC1 | LA | L72 | 10.20 | - |
| R075 | drop:LC1:LA:light:-1:L73 | LC1 | LA | L73 | 10.20 | - |
| R076 | drop:LC1:LA:light:-1:L74 | LC1 | LA | L74 | 10.20 | - |
| R077 | drop:LC1:LA:light:-1:L75 | LC1 | LA | L75 | 10.20 | - |
| R078 | drop:LC1:LA:light:-1:L76 | LC1 | LA | L76 | 10.20 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R079 | drop:LC1:LA:light:-1:L77 | LC1 | LA | L77 | 10.20 | - |
| R080 | trunk:LC1:L3:light:-1 | LC1 | L3 | Shared context | 35.32 | - |
| R081 | drop:LC1:L3:light:-1:L81 | LC1 | L3 | L81 | 11.56 | - |
| R082 | drop:LC1:L3:light:-1:L98 | LC1 | L3 | L98 | 9.91 | - |
| R083 | drop:LC1:L3:light:-1:L100 | LC1 | L3 | L100 | 9.19 | - |
| R084 | drop:LC1:L3:light:-1:L101 | LC1 | L3 | L101 | 9.41 | - |
| R085 | drop:LC1:L3:light:-1:L104 | LC1 | L3 | L104 | 10.71 | - |
| R086 | drop:LC1:L3:light:-1:L106 | LC1 | L3 | L106 | 9.55 | - |
| R087 | drop:LC1:L3:light:-1:L107 | LC1 | L3 | L107 | 9.20 | - |
| R088 | drop:LC1:L3:light:-1:L108 | LC1 | L3 | L108 | 8.75 | - |
| R089 | drop:LC1:L3:light:-1:L109 | LC1 | L3 | L109 | 10.07 | - |
| R090 | drop:LC1:L3:light:-1:L114 | LC1 | L3 | L114 | 8.30 | - |
| R091 | drop:LC1:L3:light:-1:L115 | LC1 | L3 | L115 | 8.06 | - |
| R092 | drop:LC1:L3:light:-1:L116 | LC1 | L3 | L116 | 8.12 | - |
| R093 | drop:LC1:L3:light:-1:L151 | LC1 | L3 | L151 | 6.93 | - |
| R094 | drop:LC1:L3:light:-1:L152 | LC1 | L3 | L152 | 4.93 | - |
| R095 | trunk:LC1:L3:light:1 | LC1 | L3 | Shared context | 41.92 | - |
| R096 | drop:LC1:L3:light:1:L99 | LC1 | L3 | L99 | 9.91 | - |
| R097 | drop:LC1:L3:light:1:L102 | LC1 | L3 | L102 | 9.41 | - |
| R098 | drop:LC1:L3:light:1:L103 | LC1 | L3 | L103 | 8.31 | - |
| R099 | drop:LC1:L3:light:1:L105 | LC1 | L3 | L105 | 10.71 | - |
| R100 | drop:LC1:L3:light:1:L110 | LC1 | L3 | L110 | 9.55 | - |
| R101 | drop:LC1:L3:light:1:L111 | LC1 | L3 | L111 | 9.20 | - |
| R102 | drop:LC1:L3:light:1:L112 | LC1 | L3 | L112 | 8.75 | - |
| R103 | drop:LC1:L3:light:1:L113 | LC1 | L3 | L113 | 10.07 | - |
| R104 | drop:LC1:L3:light:1:L117 | LC1 | L3 | L117 | 8.06 | - |
| R105 | drop:LC1:L3:light:1:L118 | LC1 | L3 | L118 | 8.12 | - |
| R106 | drop:LC1:L3:light:1:L153 | LC1 | L3 | L153 | 6.93 | - |
| R107 | drop:LC1:L3:light:1:L154 | LC1 | L3 | L154 | 4.93 | - |
| R108 | trunk:LC1:L4:light:-1 | LC1 | L4 | Shared context | 66.74 | - |
| R109 | drop:LC1:L4:light:-1:L119 | LC1 | L4 | L119 | 2.93 | - |
| R110 | drop:LC1:L4:light:-1:L120 | LC1 | L4 | L120 | 2.93 | - |
| R111 | drop:LC1:L4:light:-1:L121 | LC1 | L4 | L121 | 2.93 | - |
| R112 | drop:LC1:L4:light:-1:L122 | LC1 | L4 | L122 | 2.93 | - |
| R113 | drop:LC1:L4:light:-1:L123 | LC1 | L4 | L123 | 2.93 | - |
| R114 | drop:LC1:L4:light:-1:L124 | LC1 | L4 | L124 | 2.93 | - |
| R115 | drop:LC1:L4:light:-1:L125 | LC1 | L4 | L125 | 2.93 | - |
| R116 | drop:LC1:L4:light:-1:L126 | LC1 | L4 | L126 | 2.93 | - |
| R117 | drop:LC1:L4:light:-1:L127 | LC1 | L4 | L127 | 2.93 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R118 | drop:LC1:L4:light:-1:L-ARCH-B-2P-3-A | LC1 | L4 | L-ARCH-B-2P-3-A | 8.21 | - |
| R119 | drop:LC1:L4:light:-1:L-ARCH-B-2P-3-B | LC1 | L4 | L-ARCH-B-2P-3-B | 8.21 | - |
| R120 | drop:LC1:L4:light:-1:L-ARCH-B-3-4-A | LC1 | L4 | L-ARCH-B-3-4-A | 8.21 | - |
| R121 | drop:LC1:L4:light:-1:L-ARCH-B-3-4-B | LC1 | L4 | L-ARCH-B-3-4-B | 8.21 | - |
| R122 | drop:LC1:L4:light:-1:L-ARCH-B-4-5-A | LC1 | L4 | L-ARCH-B-4-5-A | 8.21 | - |
| R123 | drop:LC1:L4:light:-1:L-ARCH-B-4-5-B | LC1 | L4 | L-ARCH-B-4-5-B | 8.21 | - |
| R124 | drop:LC1:L4:light:-1:L-ARCH-B-5-6-A | LC1 | L4 | L-ARCH-B-5-6-A | 8.21 | - |
| R125 | drop:LC1:L4:light:-1:L-ARCH-B-5-6-B | LC1 | L4 | L-ARCH-B-5-6-B | 8.21 | - |
| R126 | drop:LC1:L4:light:-1:L-ARCH-B-6-7-A | LC1 | L4 | L-ARCH-B-6-7-A | 8.21 | - |
| R127 | drop:LC1:L4:light:-1:L-ARCH-B-6-7-B | LC1 | L4 | L-ARCH-B-6-7-B | 8.21 | - |
| R128 | drop:LC1:L4:light:-1:L-ARCH-B-7-8-A | LC1 | L4 | L-ARCH-B-7-8-A | 8.21 | - |
| R129 | drop:LC1:L4:light:-1:L-ARCH-B-7-8-B | LC1 | L4 | L-ARCH-B-7-8-B | 8.21 | - |
| R130 | drop:LC1:L4:light:-1:L-ARCH-B-8-9-A | LC1 | L4 | L-ARCH-B-8-9-A | 8.21 | - |
| R131 | drop:LC1:L4:light:-1:L-ARCH-B-8-9-B | LC1 | L4 | L-ARCH-B-8-9-B | 8.24 | - |
| R132 | drop:LC1:L4:light:-1:L-ARCH-B-10-11-A | LC1 | L4 | L-ARCH-B-10-11-A | 8.24 | - |
| R133 | drop:LC1:L4:light:-1:L-ARCH-B-10-11-B | LC1 | L4 | L-ARCH-B-10-11-B | 8.21 | - |
| R134 | drop:LC1:L4:light:-1:L-ARCH-B-11-12-A | LC1 | L4 | L-ARCH-B-11-12-A | 8.21 | - |
| R135 | drop:LC1:L4:light:-1:L-ARCH-B-11-12-B | LC1 | L4 | L-ARCH-B-11-12-B | 6.77 | - |
| R136 | trunk:LC1:L4:light:1 | LC1 | L4 | Shared context | 73.34 | - |
| R137 | drop:LC1:L4:light:1:L128 | LC1 | L4 | L128 | 2.93 | - |
| R138 | drop:LC1:L4:light:1:L129 | LC1 | L4 | L129 | 2.93 | - |
| R139 | drop:LC1:L4:light:1:L130 | LC1 | L4 | L130 | 2.93 | - |
| R140 | drop:LC1:L4:light:1:L131 | LC1 | L4 | L131 | 2.93 | - |
| R141 | drop:LC1:L4:light:1:L132 | LC1 | L4 | L132 | 2.93 | - |
| R142 | drop:LC1:L4:light:1:L133 | LC1 | L4 | L133 | 2.93 | - |
| R143 | drop:LC1:L4:light:1:L134 | LC1 | L4 | L134 | 2.93 | - |
| R144 | drop:LC1:L4:light:1:L135 | LC1 | L4 | L135 | 2.93 | - |
| R145 | drop:LC1:L4:light:1:L136 | LC1 | L4 | L136 | 2.93 | - |
| R146 | drop:LC1:L4:light:1:L-ARCH-H-2P-3-A | LC1 | L4 | L-ARCH-H-2P-3-A | 8.21 | - |
| R147 | drop:LC1:L4:light:1:L-ARCH-H-2P-3-B | LC1 | L4 | L-ARCH-H-2P-3-B | 8.21 | - |
| R148 | drop:LC1:L4:light:1:L-ARCH-H-3-4-A | LC1 | L4 | L-ARCH-H-3-4-A | 8.21 | - |
| R149 | drop:LC1:L4:light:1:L-ARCH-H-3-4-B | LC1 | L4 | L-ARCH-H-3-4-B | 8.21 | - |
| R150 | drop:LC1:L4:light:1:L-ARCH-H-4-5-A | LC1 | L4 | L-ARCH-H-4-5-A | 8.21 | - |
| R151 | drop:LC1:L4:light:1:L-ARCH-H-4-5-B | LC1 | L4 | L-ARCH-H-4-5-B | 8.21 | - |
| R152 | drop:LC1:L4:light:1:L-ARCH-H-5-6-A | LC1 | L4 | L-ARCH-H-5-6-A | 8.21 | - |
| R153 | drop:LC1:L4:light:1:L-ARCH-H-5-6-B | LC1 | L4 | L-ARCH-H-5-6-B | 8.21 | - |
| R154 | drop:LC1:L4:light:1:L-ARCH-H-6-7-A | LC1 | L4 | L-ARCH-H-6-7-A | 8.21 | - |
| R155 | drop:LC1:L4:light:1:L-ARCH-H-6-7-B | LC1 | L4 | L-ARCH-H-6-7-B | 8.21 | - |
| R156 | drop:LC1:L4:light:1:L-ARCH-H-7-8-A | LC1 | L4 | L-ARCH-H-7-8-A | 8.21 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R157 | drop:LC1:L4:light:1:L-ARCH-H-7-8-B | LC1 | L4 | L-ARCH-H-7-8-B | 8.21 | - |
| R158 | drop:LC1:L4:light:1:L-ARCH-H-8-9-A | LC1 | L4 | L-ARCH-H-8-9-A | 8.21 | - |
| R159 | drop:LC1:L4:light:1:L-ARCH-H-8-9-B | LC1 | L4 | L-ARCH-H-8-9-B | 8.24 | - |
| R160 | drop:LC1:L4:light:1:L-ARCH-H-10-11-A | LC1 | L4 | L-ARCH-H-10-11-A | 8.24 | - |
| R161 | drop:LC1:L4:light:1:L-ARCH-H-10-11-B | LC1 | L4 | L-ARCH-H-10-11-B | 8.21 | - |
| R162 | drop:LC1:L4:light:1:L-ARCH-H-11-12-A | LC1 | L4 | L-ARCH-H-11-12-A | 8.21 | - |
| R163 | drop:LC1:L4:light:1:L-ARCH-H-11-12-B | LC1 | L4 | L-ARCH-H-11-12-B | 6.77 | - |
| R164 | trunk:DB2:L9:light:-1 | DB2 | L9 | Shared context | 26.55 | - |
| R165 | drop:DB2:L9:light:-1:L137 | DB2 | L9 | L137 | 11.54 | - |
| R166 | drop:DB2:L9:light:-1:L182 | DB2 | L9 | L182 | 10.78 | - |
| R167 | drop:DB2:L9:light:-1:L183 | DB2 | L9 | L183 | 6.36 | - |
| R168 | trunk:DB2:L9:light:1 | DB2 | L9 | Shared context | 11.83 | - |
| R169 | drop:DB2:L9:light:1:L138 | DB2 | L9 | L138 | 11.54 | - |
| R170 | drop:DB2:L9:light:1:L189 | DB2 | L9 | L189 | 6.36 | - |
| R171 | drop:DB2:L9:light:1:L190 | DB2 | L9 | L190 | 10.78 | - |
| R172 | trunk:LC1:L5:light:-1 | LC1 | L5 | Shared context | 57.79 | - |
| R173 | drop:LC1:L5:light:-1:L139 | LC1 | L5 | L139 | 3.51 | - |
| R174 | drop:LC1:L5:light:-1:L140 | LC1 | L5 | L140 | 3.51 | - |
| R175 | drop:LC1:L5:light:-1:L141 | LC1 | L5 | L141 | 3.51 | - |
| R176 | drop:LC1:L5:light:-1:L142 | LC1 | L5 | L142 | 3.51 | - |
| R177 | drop:LC1:L5:light:-1:L184 | LC1 | L5 | L184 | 4.98 | - |
| R178 | drop:LC1:L5:light:-1:L185 | LC1 | L5 | L185 | 4.98 | - |
| R179 | drop:LC1:L5:light:-1:L186 | LC1 | L5 | L186 | 4.98 | - |
| R180 | drop:LC1:L5:light:-1:L187 | LC1 | L5 | L187 | 9.08 | - |
| R181 | drop:LC1:L5:light:-1:L188 | LC1 | L5 | L188 | 3.79 | - |
| R182 | trunk:LC1:L5:light:1 | LC1 | L5 | Shared context | 64.39 | - |
| R183 | drop:LC1:L5:light:1:L145 | LC1 | L5 | L145 | 3.51 | - |
| R184 | drop:LC1:L5:light:1:L146 | LC1 | L5 | L146 | 3.51 | - |
| R185 | drop:LC1:L5:light:1:L147 | LC1 | L5 | L147 | 3.51 | - |
| R186 | drop:LC1:L5:light:1:L148 | LC1 | L5 | L148 | 3.51 | - |
| R187 | drop:LC1:L5:light:1:L191 | LC1 | L5 | L191 | 4.98 | - |
| R188 | drop:LC1:L5:light:1:L192 | LC1 | L5 | L192 | 4.98 | - |
| R189 | drop:LC1:L5:light:1:L193 | LC1 | L5 | L193 | 4.98 | - |
| R190 | drop:LC1:L5:light:1:L194 | LC1 | L5 | L194 | 9.08 | - |
| R191 | drop:LC1:L5:light:1:L195 | LC1 | L5 | L195 | 3.79 | - |
| R192 | trunk:DB1:E1:light:-1 | DB1 | E1 | Shared context | 65.77 | - |
| R193 | drop:DB1:E1:light:-1:L155 | DB1 | E1 | L155 | 12.65 | - |
| R194 | drop:DB1:E1:light:-1:L156 | DB1 | E1 | L156 | 6.97 | - |
| R195 | drop:DB1:E1:light:-1:L158 | DB1 | E1 | L158 | 6.97 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R196 | trunk:DB1:E1:light:1 | DB1 | E1 | Shared context | 59.91 | - |
| R197 | drop:DB1:E1:light:1:L157 | DB1 | E1 | L157 | 6.97 | - |
| R198 | drop:DB1:E1:light:1:L159 | DB1 | E1 | L159 | 6.97 | - |
| R199 | trunk:DB2:L6:light:-1 | DB2 | L6 | Shared context | 27.96 | - |
| R200 | drop:DB2:L6:light:-1:L160 | DB2 | L6 | L160 | 11.23 | - |
| R201 | drop:DB2:L6:light:-1:L161 | DB2 | L6 | L161 | 12.53 | - |
| R202 | drop:DB2:L6:light:-1:L162 | DB2 | L6 | L162 | 20.09 | - |
| R203 | drop:DB2:L6:light:-1:L163 | DB2 | L6 | L163 | 27.86 | - |
| R204 | drop:DB2:L6:light:-1:L164 | DB2 | L6 | L164 | 33.50 | - |
| R205 | drop:DB2:L6:light:-1:L165 | DB2 | L6 | L165 | 29.39 | - |
| R206 | drop:DB2:L6:light:-1:L166 | DB2 | L6 | L166 | 14.88 | - |
| R207 | drop:DB2:L6:light:-1:L167 | DB2 | L6 | L167 | 13.08 | - |
| R208 | drop:DB2:L6:light:-1:L168 | DB2 | L6 | L168 | 20.61 | - |
| R209 | drop:DB2:L6:light:-1:L169 | DB2 | L6 | L169 | 28.36 | - |
| R210 | drop:DB2:L6:light:-1:L170 | DB2 | L6 | L170 | 4.97 | - |
| R211 | drop:DB2:L6:light:-1:L222 | DB2 | L6 | L222 | 6.20 | - |
| R212 | drop:DB2:L6:light:-1:L223 | DB2 | L6 | L223 | 14.00 | - |
| R213 | trunk:DB2:L6:light:1 | DB2 | L6 | Shared context | 13.24 | - |
| R214 | drop:DB2:L6:light:1:L171 | DB2 | L6 | L171 | 11.23 | - |
| R215 | drop:DB2:L6:light:1:L172 | DB2 | L6 | L172 | 12.53 | - |
| R216 | drop:DB2:L6:light:1:L173 | DB2 | L6 | L173 | 20.09 | - |
| R217 | drop:DB2:L6:light:1:L174 | DB2 | L6 | L174 | 27.86 | - |
| R218 | drop:DB2:L6:light:1:L175 | DB2 | L6 | L175 | 33.50 | - |
| R219 | drop:DB2:L6:light:1:L176 | DB2 | L6 | L176 | 29.39 | - |
| R220 | drop:DB2:L6:light:1:L177 | DB2 | L6 | L177 | 14.88 | - |
| R221 | drop:DB2:L6:light:1:L178 | DB2 | L6 | L178 | 13.08 | - |
| R222 | drop:DB2:L6:light:1:L179 | DB2 | L6 | L179 | 20.61 | - |
| R223 | drop:DB2:L6:light:1:L180 | DB2 | L6 | L180 | 28.36 | - |
| R224 | drop:DB2:L6:light:1:L181 | DB2 | L6 | L181 | 4.97 | - |
| R225 | drop:DB2:L6:light:1:L224 | DB2 | L6 | L224 | 6.20 | - |
| R226 | drop:DB2:L6:light:1:L225 | DB2 | L6 | L225 | 14.00 | - |
| R227 | trunk:EB1:L7:light:-1 | EB1 | L7 | Shared context | 82.54 | - |
| R228 | drop:EB1:L7:light:-1:L196 | EB1 | L7 | L196 | 10.46 | - |
| R229 | drop:EB1:L7:light:-1:L197 | EB1 | L7 | L197 | 1.37 | - |
| R230 | drop:EB1:L7:light:-1:L198 | EB1 | L7 | L198 | 1.37 | - |
| R231 | drop:EB1:L7:light:-1:L199 | EB1 | L7 | L199 | 4.83 | - |
| R232 | drop:EB1:L7:light:-1:L200 | EB1 | L7 | L200 | 4.83 | - |
| R233 | drop:EB1:L7:light:-1:L201 | EB1 | L7 | L201 | 5.61 | - |
| R234 | drop:EB1:L7:light:-1:L202 | EB1 | L7 | L202 | 9.18 | - |

# Unique route index

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R235 | drop:EB1:L7:light:-1:L203 | EB1 | L7 | L203 | 13.60 | - |
| R236 | drop:EB1:L7:light:-1:L204 | EB1 | L7 | L204 | 10.41 | - |
| R237 | drop:EB1:L7:light:-1:L205 | EB1 | L7 | L205 | 14.83 | - |
| R238 | drop:EB1:L7:light:-1:L206 | EB1 | L7 | L206 | 18.01 | - |
| R239 | drop:EB1:L7:light:-1:L207 | EB1 | L7 | L207 | 22.43 | - |
| R240 | drop:EB1:L7:light:-1:L219 | EB1 | L7 | L219 | 10.08 | - |
| R241 | drop:EB1:L7:light:-1:L220 | EB1 | L7 | L220 | 3.75 | - |
| R242 | trunk:EB1:L7:light:1 | EB1 | L7 | Shared context | 67.82 | - |
| R243 | drop:EB1:L7:light:1:L208 | EB1 | L7 | L208 | 1.37 | - |
| R244 | drop:EB1:L7:light:1:L209 | EB1 | L7 | L209 | 1.37 | - |
| R245 | drop:EB1:L7:light:1:L210 | EB1 | L7 | L210 | 4.83 | - |
| R246 | drop:EB1:L7:light:1:L211 | EB1 | L7 | L211 | 4.83 | - |
| R247 | drop:EB1:L7:light:1:L212 | EB1 | L7 | L212 | 5.61 | - |
| R248 | drop:EB1:L7:light:1:L213 | EB1 | L7 | L213 | 9.18 | - |
| R249 | drop:EB1:L7:light:1:L214 | EB1 | L7 | L214 | 13.60 | - |
| R250 | drop:EB1:L7:light:1:L215 | EB1 | L7 | L215 | 10.41 | - |
| R251 | drop:EB1:L7:light:1:L216 | EB1 | L7 | L216 | 14.83 | - |
| R252 | drop:EB1:L7:light:1:L217 | EB1 | L7 | L217 | 18.01 | - |
| R253 | drop:EB1:L7:light:1:L218 | EB1 | L7 | L218 | 22.43 | - |
| R254 | drop:EB1:L7:light:1:L221 | EB1 | L7 | L221 | 3.75 | - |
| R255 | trunk:FC1:F1:fan:-1 | FC1 | F1 | Shared context | 64.03 | - |
| R256 | drop:FC1:F1:fan:-1:F226 | FC1 | F1 | F226 | 10.99 | - |
| R257 | drop:FC1:F1:fan:-1:F228 | FC1 | F1 | F228 | 12.39 | - |
| R258 | drop:FC1:F1:fan:-1:F230 | FC1 | F1 | F230 | 12.38 | - |
| R259 | drop:FC1:F1:fan:-1:F232 | FC1 | F1 | F232 | 12.39 | - |
| R260 | drop:FC1:F1:fan:-1:F234 | FC1 | F1 | F234 | 12.39 | - |
| R261 | drop:FC1:F1:fan:-1:F236 | FC1 | F1 | F236 | 12.39 | - |
| R262 | drop:FC1:F1:fan:-1:F238 | FC1 | F1 | F238 | 12.38 | - |
| R263 | trunk:FC1:F1:fan:1 | FC1 | F1 | Shared context | 70.63 | - |
| R264 | drop:FC1:F1:fan:1:F227 | FC1 | F1 | F227 | 10.99 | - |
| R265 | drop:FC1:F1:fan:1:F229 | FC1 | F1 | F229 | 12.39 | - |
| R266 | drop:FC1:F1:fan:1:F231 | FC1 | F1 | F231 | 12.38 | - |
| R267 | drop:FC1:F1:fan:1:F233 | FC1 | F1 | F233 | 12.39 | - |
| R268 | drop:FC1:F1:fan:1:F235 | FC1 | F1 | F235 | 12.39 | - |
| R269 | drop:FC1:F1:fan:1:F237 | FC1 | F1 | F237 | 12.39 | - |
| R270 | drop:FC1:F1:fan:1:F239 | FC1 | F1 | F239 | 12.38 | - |
| R271 | trunk:FC1:F5:fan:-1 | FC1 | F5 | Shared context | 33.83 | - |
| R272 | drop:FC1:F5:fan:-1:F240 | FC1 | F5 | F240 | 9.26 | - |
| R273 | drop:FC1:F5:fan:-1:F241 | FC1 | F5 | F241 | 9.26 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R274 | trunk:FC1:F5:fan:1 | FC1 | F5 | Shared context | 40.43 | - |
| R275 | drop:FC1:F5:fan:1:F242 | FC1 | F5 | F242 | 9.26 | - |
| R276 | drop:FC1:F5:fan:1:F243 | FC1 | F5 | F243 | 9.26 | - |
| R277 | trunk:FC1:F2:fan:-1 | FC1 | F2 | Shared context | 66.96 | - |
| R278 | drop:FC1:F2:fan:-1:F244 | FC1 | F2 | F244 | 2.20 | - |
| R279 | drop:FC1:F2:fan:-1:F246 | FC1 | F2 | F246 | 2.20 | - |
| R280 | drop:FC1:F2:fan:-1:F248 | FC1 | F2 | F248 | 2.20 | - |
| R281 | drop:FC1:F2:fan:-1:F-NAVE-B-2P | FC1 | F2 | F-NAVE-B-2P | 2.20 | - |
| R282 | drop:FC1:F2:fan:-1:F-NAVE-B-3 | FC1 | F2 | F-NAVE-B-3 | 2.20 | - |
| R283 | drop:FC1:F2:fan:-1:F-NAVE-B-5 | FC1 | F2 | F-NAVE-B-5 | 2.20 | - |
| R284 | drop:FC1:F2:fan:-1:F-NAVE-B-7 | FC1 | F2 | F-NAVE-B-7 | 2.20 | - |
| R285 | drop:FC1:F2:fan:-1:F-NAVE-B-9 | FC1 | F2 | F-NAVE-B-9 | 2.20 | - |
| R286 | trunk:FC1:F2:fan:1 | FC1 | F2 | Shared context | 73.56 | - |
| R287 | drop:FC1:F2:fan:1:F245 | FC1 | F2 | F245 | 2.20 | - |
| R288 | drop:FC1:F2:fan:1:F247 | FC1 | F2 | F247 | 2.20 | - |
| R289 | drop:FC1:F2:fan:1:F249 | FC1 | F2 | F249 | 2.20 | - |
| R290 | drop:FC1:F2:fan:1:F-NAVE-H-2P | FC1 | F2 | F-NAVE-H-2P | 2.20 | - |
| R291 | drop:FC1:F2:fan:1:F-NAVE-H-3 | FC1 | F2 | F-NAVE-H-3 | 2.20 | - |
| R292 | drop:FC1:F2:fan:1:F-NAVE-H-5 | FC1 | F2 | F-NAVE-H-5 | 2.20 | - |
| R293 | drop:FC1:F2:fan:1:F-NAVE-H-7 | FC1 | F2 | F-NAVE-H-7 | 2.20 | - |
| R294 | drop:FC1:F2:fan:1:F-NAVE-H-9 | FC1 | F2 | F-NAVE-H-9 | 2.20 | - |
| R295 | trunk:DB2:F4:fan:-1 | DB2 | F4 | Shared context | 29.62 | - |
| R296 | drop:DB2:F4:fan:-1:F250 | DB2 | F4 | F250 | 17.22 | - |
| R297 | trunk:DB2:F4:fan:1 | DB2 | F4 | Shared context | 14.90 | - |
| R298 | drop:DB2:F4:fan:1:F251 | DB2 | F4 | F251 | 17.22 | - |
| R299 | trunk:FC1:V1:fan:-1 | FC1 | V1 | Shared context | 67.55 | - |
| R300 | drop:FC1:V1:fan:-1:F252 | FC1 | V1 | F252 | 8.69 | - |
| R301 | drop:FC1:V1:fan:-1:F253 | FC1 | V1 | F253 | 11.83 | - |
| R302 | trunk:FC1:V1:fan:1 | FC1 | V1 | Shared context | 74.15 | - |
| R303 | drop:FC1:V1:fan:1:F254 | FC1 | V1 | F254 | 11.83 | - |
| R304 | drop:FC1:V1:fan:1:F255 | FC1 | V1 | F255 | 8.69 | - |
| R305 | trunk:FC1:V2:fan:-1 | FC1 | V2 | Shared context | 31.71 | - |
| R306 | drop:FC1:V2:fan:-1:F256 | FC1 | V2 | F256 | 6.97 | - |
| R307 | drop:FC1:V2:fan:-1:F257 | FC1 | V2 | F257 | 6.97 | - |
| R308 | trunk:FC1:V2:fan:1 | FC1 | V2 | Shared context | 38.31 | - |
| R309 | drop:FC1:V2:fan:1:F258 | FC1 | V2 | F258 | 6.97 | - |
| R310 | drop:FC1:V2:fan:1:F259 | FC1 | V2 | F259 | 6.97 | - |
| R311 | trunk:FC1:V3:fan:-1 | FC1 | V3 | Shared context | 16.41 | - |
| R312 | drop:FC1:V3:fan:-1:F260 | FC1 | V3 | F260 | 10.32 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R313 | trunk:AV1:A1:audio:-1 | AV1 | A1 | Shared context | 65.65 | - |
| R314 | drop:AV1:A1:audio:-1:S261 | AV1 | A1 | S261 | 3.16 | 68.81 |
| R315 | drop:AV1:A1:audio:-1:S263 | AV1 | A1 | S263 | 3.16 | 64.31 |
| R316 | drop:AV1:A1:audio:-1:S265 | AV1 | A1 | S265 | 3.16 | 59.81 |
| R317 | drop:AV1:A1:audio:-1:S267 | AV1 | A1 | S267 | 3.16 | 55.31 |
| R318 | drop:AV1:A1:audio:-1:S269 | AV1 | A1 | S269 | 3.16 | 50.81 |
| R319 | drop:AV1:A1:audio:-1:S271 | AV1 | A1 | S271 | 3.16 | 46.31 |
| R320 | drop:AV1:A1:audio:-1:S276 | AV1 | A1 | S276 | 8.04 | 40.81 |
| R321 | trunk:AV1:A1:audio:1 | AV1 | A1 | Shared context | 59.05 | - |
| R322 | drop:AV1:A1:audio:1:S262 | AV1 | A1 | S262 | 3.16 | 62.21 |
| R323 | drop:AV1:A1:audio:1:S264 | AV1 | A1 | S264 | 3.16 | 57.71 |
| R324 | drop:AV1:A1:audio:1:S266 | AV1 | A1 | S266 | 3.16 | 53.21 |
| R325 | drop:AV1:A1:audio:1:S268 | AV1 | A1 | S268 | 3.16 | 48.71 |
| R326 | drop:AV1:A1:audio:1:S270 | AV1 | A1 | S270 | 3.16 | 44.21 |
| R327 | drop:AV1:A1:audio:1:S272 | AV1 | A1 | S272 | 3.16 | 39.71 |
| R328 | drop:AV1:A1:audio:1:S278 | AV1 | A1 | S278 | 8.04 | 34.21 |
| R329 | trunk:AV1:A5:audio:-1 | AV1 | A5 | Shared context | 74.25 | - |
| R330 | drop:AV1:A5:audio:-1:S273 | AV1 | A5 | S273 | 13.21 | 87.45 |
| R331 | trunk:AV1:A5:audio:1 | AV1 | A5 | Shared context | 67.65 | - |
| R332 | drop:AV1:A5:audio:1:S274 | AV1 | A5 | S274 | 13.21 | 80.85 |
| R333 | trunk:AV1:A2:audio:-1 | AV1 | A2 | Shared context | 70.16 | - |
| R334 | drop:AV1:A2:audio:-1:S279 | AV1 | A2 | S279 | 2.95 | 68.61 |
| R335 | drop:AV1:A2:audio:-1:S280 | AV1 | A2 | S280 | 2.95 | 55.11 |
| R336 | drop:AV1:A2:audio:-1:S-PORCH-B-2P-3 | AV1 | A2 | S-PORCH-B-2P-3 | 2.95 | 73.11 |
| R337 | drop:AV1:A2:audio:-1:S-PORCH-B-4-5 | AV1 | A2 | S-PORCH-B-4-5 | 2.95 | 64.11 |
| R338 | drop:AV1:A2:audio:-1:S-PORCH-B-5-6 | AV1 | A2 | S-PORCH-B-5-6 | 2.95 | 59.61 |
| R339 | drop:AV1:A2:audio:-1:S-PORCH-B-7-8 | AV1 | A2 | S-PORCH-B-7-8 | 2.95 | 50.61 |
| R340 | drop:AV1:A2:audio:-1:S-PORCH-B-8-9 | AV1 | A2 | S-PORCH-B-8-9 | 2.95 | 46.11 |
| R341 | drop:AV1:A2:audio:-1:S-PORCH-B-10-11 | AV1 | A2 | S-PORCH-B-10-11 | 2.95 | 29.70 |
| R342 | drop:AV1:A2:audio:-1:S-PORCH-B-11-12 | AV1 | A2 | S-PORCH-B-11-12 | 2.95 | 25.35 |
| R343 | trunk:AV1:A2:audio:1 | AV1 | A2 | Shared context | 63.56 | - |
| R344 | drop:AV1:A2:audio:1:S281 | AV1 | A2 | S281 | 2.95 | 62.01 |
| R345 | drop:AV1:A2:audio:1:S282 | AV1 | A2 | S282 | 2.95 | 48.51 |
| R346 | drop:AV1:A2:audio:1:S-PORCH-H-2P-3 | AV1 | A2 | S-PORCH-H-2P-3 | 2.95 | 66.51 |
| R347 | drop:AV1:A2:audio:1:S-PORCH-H-4-5 | AV1 | A2 | S-PORCH-H-4-5 | 2.95 | 57.51 |
| R348 | drop:AV1:A2:audio:1:S-PORCH-H-5-6 | AV1 | A2 | S-PORCH-H-5-6 | 2.95 | 53.01 |
| R349 | drop:AV1:A2:audio:1:S-PORCH-H-7-8 | AV1 | A2 | S-PORCH-H-7-8 | 2.95 | 44.01 |
| R350 | drop:AV1:A2:audio:1:S-PORCH-H-8-9 | AV1 | A2 | S-PORCH-H-8-9 | 2.95 | 39.51 |
| R351 | drop:AV1:A2:audio:1:S-PORCH-H-10-11 | AV1 | A2 | S-PORCH-H-10-11 | 2.95 | 23.10 |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R352 | drop:AV1:A2:audio:1:S-PORCH-H-11-12 | AV1 | A2 | S-PORCH-H-11-12 | 2.95 | 18.75 |
| R353 | trunk:AV1:A3:audio:-1 | AV1 | A3 | Shared context | 77.36 | - |
| R354 | drop:AV1:A3:audio:-1:S283 | AV1 | A3 | S283 | 7.00 | 84.36 |
| R355 | drop:AV1:A3:audio:-1:S284 | AV1 | A3 | S284 | 11.52 | 88.88 |
| R356 | drop:AV1:A3:audio:-1:S285 | AV1 | A3 | S285 | 5.69 | 66.43 |
| R357 | drop:AV1:A3:audio:-1:S286 | AV1 | A3 | S286 | 5.69 | 52.93 |
| R358 | trunk:AV1:A3:audio:1 | AV1 | A3 | Shared context | 70.76 | - |
| R359 | drop:AV1:A3:audio:1:S287 | AV1 | A3 | S287 | 7.00 | 77.76 |
| R360 | drop:AV1:A3:audio:1:S288 | AV1 | A3 | S288 | 11.52 | 82.28 |
| R361 | drop:AV1:A3:audio:1:S289 | AV1 | A3 | S289 | 5.69 | 59.83 |
| R362 | drop:AV1:A3:audio:1:S290 | AV1 | A3 | S290 | 5.69 | 46.33 |
| R363 | trunk:AV1:MIC:mic:-1 | AV1 | MIC | Shared context | 11.91 | - |
| R364 | drop:AV1:MIC:mic:-1:S291 | AV1 | MIC | S291 | 3.63 | 15.54 |
| R365 | trunk:AV1:MIC:mic:1 | AV1 | MIC | Shared context | 5.74 | - |
| R366 | drop:AV1:MIC:mic:1:S292 | AV1 | MIC | S292 | 2.85 | 8.59 |
| R367 | trunk:DB1:P1:power:-1 | DB1 | P1 | Shared context | 48.38 | - |
| R368 | drop:DB1:P1:power:-1:P-SANCT-B | DB1 | P1 | P-SANCT-B | 5.65 | - |
| R369 | drop:DB1:P1:power:-1:P-NAVE-B | DB1 | P1 | P-NAVE-B | 5.77 | - |
| R370 | trunk:EB1:P3:power:-1 | EB1 | P3 | Shared context | 20.28 | - |
| R371 | drop:EB1:P3:power:-1:P-TOWER-B | EB1 | P3 | P-TOWER-B | 1.57 | - |
| R372 | trunk:DB1:P2:power:1 | DB1 | P2 | Shared context | 54.97 | - |
| R373 | drop:DB1:P2:power:1:P-SANCT-H | DB1 | P2 | P-SANCT-H | 5.66 | - |
| R374 | drop:DB1:P2:power:1:P-NAVE-H | DB1 | P2 | P-NAVE-H | 5.78 | - |
| R375 | trunk:EB1:P4:power:1 | EB1 | P4 | Shared context | 4.88 | - |
| R376 | drop:EB1:P4:power:1:P-TOWER-H | EB1 | P4 | P-TOWER-H | 1.57 | - |
| R377 | trunk:DB2:L10:light:-1 | DB2 | L10 | Shared context | 28.08 | - |
| R378 | drop:DB2:L10:light:-1:L-STATUE-C-ARCH | DB2 | L10 | L-STATUE-C-ARCH | 23.12 | - |
| R379 | drop:DB2:L10:light:-1:L-STATUE-C-JAMB-1 | DB2 | L10 | L-STATUE-C-JAMB-1 | 20.61 | - |
| R380 | drop:DB2:L10:light:-1:L-STATUE-C-CANDLE-1 | DB2 | L10 | L-STATUE-C-CANDLE-1 | 19.50 | - |
| R381 | drop:DB2:L10:light:-1:L-STATUE-B-ARCH | DB2 | L10 | L-STATUE-B-ARCH | 11.25 | - |
| R382 | drop:DB2:L10:light:-1:L-STATUE-B-JAMB-1 | DB2 | L10 | L-STATUE-B-JAMB-1 | 9.10 | - |
| R383 | drop:DB2:L10:light:-1:L-STATUE-B-CANDLE-1 | DB2 | L10 | L-STATUE-B-CANDLE-1 | 8.26 | - |
| R384 | drop:DB2:L10:light:-1:L-STATUE-B-JAMB-2 | DB2 | L10 | L-STATUE-B-JAMB-2 | 10.26 | - |
| R385 | drop:DB2:L10:light:-1:L-STATUE-B-CANDLE-2 | DB2 | L10 | L-STATUE-B-CANDLE-2 | 8.88 | - |
| R386 | trunk:DB2:L10:light:1 | DB2 | L10 | Shared context | 13.36 | - |
| R387 | drop:DB2:L10:light:1:L-STATUE-C-JAMB-2 | DB2 | L10 | L-STATUE-C-JAMB-2 | 20.61 | - |
| R388 | drop:DB2:L10:light:1:L-STATUE-C-CANDLE-2 | DB2 | L10 | L-STATUE-C-CANDLE-2 | 19.50 | - |
| R389 | drop:DB2:L10:light:1:L-STATUE-H-ARCH | DB2 | L10 | L-STATUE-H-ARCH | 11.25 | - |
| R390 | drop:DB2:L10:light:1:L-STATUE-H-JAMB-1 | DB2 | L10 | L-STATUE-H-JAMB-1 | 10.26 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R391 | drop:DB2:L10:light:1:L-STATUE-H-CANDLE-1 | DB2 | L10 | L-STATUE-H-CANDLE-1 | 8.88 | - |
| R392 | drop:DB2:L10:light:1:L-STATUE-H-JAMB-2 | DB2 | L10 | L-STATUE-H-JAMB-2 | 9.10 | - |
| R393 | drop:DB2:L10:light:1:L-STATUE-H-CANDLE-2 | DB2 | L10 | L-STATUE-H-CANDLE-2 | 8.26 | - |
| R394 | trunk:LC1:LS:light:1 | LC1 | LS | Shared context | 71.24 | - |
| R395 | drop:LC1:LS:light:1:L-STATION-1-A | LC1 | LS | L-STATION-1-A | 1.57 | - |
| R396 | drop:LC1:LS:light:1:L-STATION-1-B | LC1 | LS | L-STATION-1-B | 1.57 | - |
| R397 | drop:LC1:LS:light:1:L-STATION-2-A | LC1 | LS | L-STATION-2-A | 1.57 | - |
| R398 | drop:LC1:LS:light:1:L-STATION-2-B | LC1 | LS | L-STATION-2-B | 1.57 | - |
| R399 | drop:LC1:LS:light:1:L-STATION-3-A | LC1 | LS | L-STATION-3-A | 1.57 | - |
| R400 | drop:LC1:LS:light:1:L-STATION-3-B | LC1 | LS | L-STATION-3-B | 1.57 | - |
| R401 | drop:LC1:LS:light:1:L-STATION-4-A | LC1 | LS | L-STATION-4-A | 1.57 | - |
| R402 | drop:LC1:LS:light:1:L-STATION-4-B | LC1 | LS | L-STATION-4-B | 1.57 | - |
| R403 | drop:LC1:LS:light:1:L-STATION-5-A | LC1 | LS | L-STATION-5-A | 1.57 | - |
| R404 | drop:LC1:LS:light:1:L-STATION-5-B | LC1 | LS | L-STATION-5-B | 1.57 | - |
| R405 | drop:LC1:LS:light:1:L-STATION-6-A | LC1 | LS | L-STATION-6-A | 1.57 | - |
| R406 | drop:LC1:LS:light:1:L-STATION-6-B | LC1 | LS | L-STATION-6-B | 1.57 | - |
| R407 | drop:LC1:LS:light:1:L-STATION-7-A | LC1 | LS | L-STATION-7-A | 1.57 | - |
| R408 | drop:LC1:LS:light:1:L-STATION-7-B | LC1 | LS | L-STATION-7-B | 1.57 | - |
| R409 | trunk:LC1:LS:light:-1 | LC1 | LS | Shared context | 64.64 | - |
| R410 | drop:LC1:LS:light:-1:L-STATION-8-A | LC1 | LS | L-STATION-8-A | 1.57 | - |
| R411 | drop:LC1:LS:light:-1:L-STATION-8-B | LC1 | LS | L-STATION-8-B | 1.57 | - |
| R412 | drop:LC1:LS:light:-1:L-STATION-9-A | LC1 | LS | L-STATION-9-A | 1.57 | - |
| R413 | drop:LC1:LS:light:-1:L-STATION-9-B | LC1 | LS | L-STATION-9-B | 1.57 | - |
| R414 | drop:LC1:LS:light:-1:L-STATION-10-A | LC1 | LS | L-STATION-10-A | 1.57 | - |
| R415 | drop:LC1:LS:light:-1:L-STATION-10-B | LC1 | LS | L-STATION-10-B | 1.57 | - |
| R416 | drop:LC1:LS:light:-1:L-STATION-11-A | LC1 | LS | L-STATION-11-A | 1.57 | - |
| R417 | drop:LC1:LS:light:-1:L-STATION-11-B | LC1 | LS | L-STATION-11-B | 1.57 | - |
| R418 | drop:LC1:LS:light:-1:L-STATION-12-A | LC1 | LS | L-STATION-12-A | 1.57 | - |
| R419 | drop:LC1:LS:light:-1:L-STATION-12-B | LC1 | LS | L-STATION-12-B | 1.57 | - |
| R420 | drop:LC1:LS:light:-1:L-STATION-13-A | LC1 | LS | L-STATION-13-A | 1.57 | - |
| R421 | drop:LC1:LS:light:-1:L-STATION-13-B | LC1 | LS | L-STATION-13-B | 1.57 | - |
| R422 | drop:LC1:LS:light:-1:L-STATION-14-A | LC1 | LS | L-STATION-14-A | 1.57 | - |
| R423 | drop:LC1:LS:light:-1:L-STATION-14-B | LC1 | LS | L-STATION-14-B | 1.57 | - |
| R424 | trunk:LC1:L8:light:-1 | LC1 | L8 | Shared context | 31.84 | - |
| R425 | drop:LC1:L8:light:-1:L-WING-B-FI | LC1 | L8 | L-WING-B-FI | 1.76 | - |
| R426 | drop:LC1:L8:light:-1:L-WING-B-FO | LC1 | L8 | L-WING-B-FO | 4.36 | - |
| R427 | drop:LC1:L8:light:-1:L-WING-B-RI | LC1 | L8 | L-WING-B-RI | 1.76 | - |
| R428 | drop:LC1:L8:light:-1:L-WING-B-RO | LC1 | L8 | L-WING-B-RO | 4.36 | - |
| R429 | trunk:LC1:L8:light:1 | LC1 | L8 | Shared context | 38.44 | - |

# Unique route index

Geometric centreline lengths only / no cable sizing or installation allowance / each route owned once

| Ref | Stable route ID | From | Circuit/zone | Equipment / context | Drawn m | Audio home run m |
|---|---|---|---|---|---|---|
| R430 | drop:LC1:L8:light:1:L-WING-H-FI | LC1 | L8 | L-WING-H-FI | 1.76 | - |
| R431 | drop:LC1:L8:light:1:L-WING-H-FO | LC1 | L8 | L-WING-H-FO | 4.36 | - |
| R432 | drop:LC1:L8:light:1:L-WING-H-RI | LC1 | L8 | L-WING-H-RI | 1.76 | - |
| R433 | drop:LC1:L8:light:1:L-WING-H-RO | LC1 | L8 | L-WING-H-RO | 4.36 | - |
| R434 | trunk:LC1:LD:light:-1 | LC1 | LD | Shared context | 62.30 | - |
| R435 | drop:LC1:LD:light:-1:L-COLUMN-3-B | LC1 | LD | L-COLUMN-3-B | 16.39 | - |
| R436 | drop:LC1:LD:light:-1:L-COLUMN-4-B | LC1 | LD | L-COLUMN-4-B | 16.39 | - |
| R437 | drop:LC1:LD:light:-1:L-COLUMN-5-B | LC1 | LD | L-COLUMN-5-B | 16.39 | - |
| R438 | drop:LC1:LD:light:-1:L-COLUMN-6-B | LC1 | LD | L-COLUMN-6-B | 16.39 | - |
| R439 | drop:LC1:LD:light:-1:L-COLUMN-7-B | LC1 | LD | L-COLUMN-7-B | 16.39 | - |
| R440 | drop:LC1:LD:light:-1:L-COLUMN-8-B | LC1 | LD | L-COLUMN-8-B | 16.39 | - |
| R441 | drop:LC1:LD:light:-1:L-COLUMN-9-B | LC1 | LD | L-COLUMN-9-B | 16.39 | - |
| R442 | trunk:LC1:LD:light:1 | LC1 | LD | Shared context | 68.90 | - |
| R443 | drop:LC1:LD:light:1:L-COLUMN-3-H | LC1 | LD | L-COLUMN-3-H | 16.39 | - |
| R444 | drop:LC1:LD:light:1:L-COLUMN-4-H | LC1 | LD | L-COLUMN-4-H | 16.39 | - |
| R445 | drop:LC1:LD:light:1:L-COLUMN-5-H | LC1 | LD | L-COLUMN-5-H | 16.39 | - |
| R446 | drop:LC1:LD:light:1:L-COLUMN-6-H | LC1 | LD | L-COLUMN-6-H | 16.39 | - |
| R447 | drop:LC1:LD:light:1:L-COLUMN-7-H | LC1 | LD | L-COLUMN-7-H | 16.39 | - |
| R448 | drop:LC1:LD:light:1:L-COLUMN-8-H | LC1 | LD | L-COLUMN-8-H | 16.39 | - |
| R449 | drop:LC1:LD:light:1:L-COLUMN-9-H | LC1 | LD | L-COLUMN-9-H | 16.39 | - |

# Installation note key

One note per distinct model installation method / proposals, not approved installation details

| Code | Routes | Model installation note |
|---|---|---|
| **I01** | 1 | Above beam and covered rear-face return to lamp-body cable entry. Existing canopy/capital contact remains on mounting coordination hold; optical position unchanged. |
| **I02** | 70 | Above lining / beam tops, short covered joint and rear-face return to fitting. Roof access, rafter/tie interface and removable cover details pending; no timber drilling / notching. |
| **I03** | 15 | Above nave lining / covered soffit route at wings and verandas; cable continues inside the existing pendant stem. Roof build-up, supports and access pending. |
| **I04** | 12 | Above nave lining, then down the outer face of the column-line beam in a removable finish-matched cover to the hanger; cable continues inside the downrod. Hanger, beam section and access pending. |
| **I05** | 4 | Above roof lining to solid front gable above terrace; local fan connection. |
| **I06** | 9 | Back-wall band to service space behind chamber lining; local termination behind the fitting / cornice. Removable lining and cable-entry detail pending. |
| **I07** | 2 | Buried duct below the entrance-hall floor and tower plinth, rising inside the solid tower pier to the cabinet. Duct size, depth, draw pits, water sealing and separation pending; no chase through the arch mouldings. |
| **I08** | 20 | Concealed entrance wall band, solid pier and local termination. |
| **I09** | 11 | Concealed roof route to local roof-mounted fitting; weatherproof cable entry pending. |
| **I10** | 108 | Concealed solid-pier / wall drop and local termination. |
| **I11** | 56 | Covered roof-soffit crossing into outer arcade / wing-gable wall, then concealed pier drop. No exposed crossing at equipment height. |
| **I12** | 2 | Dedicated buried duct from EB-1 (beside DB-2) below the entrance-hall floor to the tower base; duct, depth, draw pits and water sealing pending. |
| **I13** | 1 | Entrance wall band to solid jamb outside coloured fanlight, fixed transom and local inside-face sign clip. Removable frame cover, fixing and emergency design pending. |
| **I14** | 3 | Existing service-room wall tray / local equipment connection |
| **I15** | 14 | Proposed underfloor approach and removable column-face raceway. The column base crossing, timber fixings, appearance, fire boundary and maintenance access require coordinated design; no concealed chase is assumed. |
| **I16** | 4 | Proposed underfloor return; this location needs a concealed local riser / connection design. |
| **I17** | 11 | Rear-wall band and local termination; gable / weatherproof entry details pending. |
| **I18** | 1 | Separate AV-1 home run below floor; central ambo passage through proposed hollow neck, sloped desk and removable microphone socket. Floorbox, furniture bore and access pending. |
| **I19** | 1 | Separate AV-1 home run below the floor; proposed furniture cable passage to microphone base. Floorbox, floor build-up and furniture access pending. |
| **I20** | 2 | Separate microphone home-run bundle below service-room and sanctuary floors; floor build-up / access pending. |
| **I21** | 1 | Short tray between the two boards on the tower front wall |
| **I22** | 40 | Solid tower corner/piers, stepped behind cornices; local ledge/fitting connection. No riser through louver openings; chase/finish and weathering details pending. |
| **I23** | 4 | Tower pier to proposed service space behind removable cornice finish, then local fitting lead. Cornice cavity, access, weathering and cable-entry details remain unresolved. |
| **I24** | 4 | Wall band to solid jamb beside coloured fanlight, fixed 220 mm door-head band and local sign lead. Frame containment, fixing and emergency design pending. |
| **I25** | 50 | Wall bands above openings; concealed finish-matched soffit crossing over the 9-10 wing opening. |
| **I26** | 1 | Wall bands, covered wing-roof crossing, entrance wall riser |

# Installation note key

One note per distinct model installation method / proposals, not approved installation details

| Code | Routes | Model installation note |
|---|---|---|
| **I27** | 2 | Wall riser beside niche; containment above ceiling top +4.27 m; panel cable entry pending structural coordination. |

THACH BI CHURCH

RS-01

# Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R001** | Shared context DB2-FEED | I26 | 94.96 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.26 > 12+0.00/C+0.00 h+6.26 > 10+0.00/C+0.00 h+6.26 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.26 > 2'+0.00/C+0.00 h+6.26 > 1+2.35/C+0.00 h+6.26 > h+7.65 > 1+2.35/H-1.16 h+7.65 > h+1.50 > 1+0.24/H-1.16 h+1.50 |
| **R002** | Shared context EB1-SUPPLY | I21 | 2.70 | 1+0.24/H-1.16 h+1.50 > h+2.10 > 1+0.24/H+0.34 h+2.10 > h+1.50 |
| **R003** | Shared context AV1-SUPPLY | I14 | 5.79 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > h+2.42 > 11+0.06/E-2.20 h+2.42 > h+0.95 > 11+0.60/E-2.20 h+0.95 |
| **R004** | Shared context LC1-SUPPLY | I14 | 2.56 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > h+2.42 > 11+0.06/D+3.05 h+2.42 > h+1.85 > 11+0.22/D+3.05 h+1.85 |
| **R005** | Shared context FC1-SUPPLY | I14 | 3.41 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > h+2.42 > 11+0.06/E-3.20 h+2.42 > h+1.95 > 11+0.22/E-3.20 h+1.95 |
| **R006** | L1 | I27 | 8.03 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+1.33/D+1.36 h+4.33 > 11+1.33/D+3.60 h+4.33 > h+4.14 |
| **R007** | L2 | I27 | 9.93 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 12-1.12/D+1.36 h+4.33 > 12-1.12/D+3.60 h+4.33 > h+4.14 |
| **R008** | Shared context L2 | I25 | 63.06 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.91 > 12+0.00/C+0.00 h+5.91 > 10+0.00/C+0.00 h+5.91 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.91 > 3-0.72/C+0.00 h+5.91 |
| **R009** | L3 | I02 | 9.70 | 3+0.15/C+0.00 h+5.91 > 3+0.35/C+0.00 h+5.91 > h+7.04 > 3+0.35/D-0.45 h+9.44 > h+9.23 > 3+0.35/D+0.60 h+9.23 > 3+0.00/D+0.60 h+9.23 > 3+0.15/D+2.70 h+9.23 > 3+0.21/D+2.70 h+9.23 > h+8.77 > 3+0.15/D+2.70 h+8.77 |
| **R010** | L4 | I02 | 8.14 | 3+0.15/C+0.00 h+5.91 > 3+0.35/C+0.00 h+5.91 > h+7.04 > 3+0.35/D-0.45 h+9.44 > h+9.23 > 3+0.35/D+0.60 h+9.23 > 3+0.00/D+0.60 h+9.23 > 3+0.15/D+1.12 h+9.23 > 3+0.21/D+1.12 h+9.23 > h+8.77 > 3+0.15/D+1.12 h+8.77 |
| **R011** | L7 | I02 | 9.70 | 4+0.15/C+0.00 h+5.91 > 4+0.35/C+0.00 h+5.91 > h+7.04 > 4+0.35/D-0.45 h+9.44 > h+9.23 > 4+0.35/D+0.60 h+9.23 > 4+0.00/D+0.60 h+9.23 > 4+0.15/D+2.70 h+9.23 > 4+0.21/D+2.70 h+9.23 > h+8.77 > 4+0.15/D+2.70 h+8.77 |
| **R012** | L8 | I02 | 8.14 | 4+0.15/C+0.00 h+5.91 > 4+0.35/C+0.00 h+5.91 > h+7.04 > 4+0.35/D-0.45 h+9.44 > h+9.23 > 4+0.35/D+0.60 h+9.23 > 4+0.00/D+0.60 h+9.23 > 4+0.15/D+1.12 h+9.23 > 4+0.21/D+1.12 h+9.23 > h+8.77 > 4+0.15/D+1.12 h+8.77 |
| **R013** | L11 | I02 | 9.70 | 5+0.15/C+0.00 h+5.91 > 5+0.34/C+0.00 h+5.91 > h+7.04 > 5+0.34/D-0.45 h+9.44 > h+9.23 > 5+0.34/D+0.60 h+9.23 > 5+0.00/D+0.60 h+9.23 > 5+0.15/D+2.70 h+9.23 > 5+0.20/D+2.70 h+9.23 > h+8.77 > 5+0.15/D+2.70 h+8.77 |
| **R014** | L12 | I02 | 8.14 | 5+0.15/C+0.00 h+5.91 > 5+0.34/C+0.00 h+5.91 > h+7.04 > 5+0.34/D-0.45 h+9.44 > h+9.23 > 5+0.34/D+0.60 h+9.23 > 5+0.00/D+0.60 h+9.23 > 5+0.15/D+1.12 h+9.23 > 5+0.20/D+1.12 h+9.23 > h+8.77 > 5+0.15/D+1.12 h+8.77 |
| **R015** | L16 | I02 | 8.14 | 6+0.15/C+0.00 h+5.91 > 6+0.34/C+0.00 h+5.91 > h+7.04 > 6+0.34/D-0.45 h+9.44 > h+9.23 > 6+0.34/D+0.60 h+9.23 > 6+0.00/D+0.60 h+9.23 > 6+0.15/D+1.12 h+9.23 > 6+0.20/D+1.12 h+9.23 > h+8.77 > 6+0.15/D+1.12 h+8.77 |
| **R016** | L31 | I02 | 2.86 | 3+0.11/C+0.00 h+5.91 > 3+0.00/C+0.00 h+5.91 > h+7.05 > 3+0.11/C+1.27 h+7.05 > 3+0.16/C+1.27 h+7.05 > h+6.84 > 3+0.11/C+1.27 h+6.84 |
| **R017** | L32 | I02 | 4.10 | 3+0.11/C+0.00 h+5.91 > 3+0.00/C+0.00 h+5.91 > h+7.05 > 3+0.11/D-1.24 h+7.05 > 3+0.16/D-1.24 h+7.05 > h+6.84 > 3+0.11/D-1.24 h+6.84 |
| **R018** | L35 | I02 | 2.86 | 4+0.11/C+0.00 h+5.91 > 4+0.00/C+0.00 h+5.91 > h+7.05 > 4+0.11/C+1.27 h+7.05 > 4+0.16/C+1.27 h+7.05 > h+6.84 > 4+0.11/C+1.27 h+6.84 |
| **R019** | L36 | I02 | 4.10 | 4+0.11/C+0.00 h+5.91 > 4+0.00/C+0.00 h+5.91 > h+7.05 > 4+0.11/D-1.24 h+7.05 > 4+0.16/D-1.24 h+7.05 > h+6.84 > 4+0.11/D-1.24 h+6.84 |
| **R020** | L39 | I02 | 2.86 | 5+0.11/C+0.00 h+5.91 > 5+0.00/C+0.00 h+5.91 > h+7.05 > 5+0.11/C+1.27 h+7.05 > 5+0.16/C+1.27 h+7.05 > h+6.84 > 5+0.11/C+1.27 h+6.84 |
| **R021** | L40 | I02 | 4.10 | 5+0.11/C+0.00 h+5.91 > 5+0.00/C+0.00 h+5.91 > h+7.05 > 5+0.11/D-1.24 h+7.05 > 5+0.16/D-1.24 h+7.05 > h+6.84 > 5+0.11/D-1.24 h+6.84 |
| **R022** | L44 | I02 | 4.10 | 6+0.11/C+0.00 h+5.91 > 6+0.00/C+0.00 h+5.91 > h+7.05 > 6+0.11/D-1.24 h+7.05 > 6+0.16/D-1.24 h+7.05 > h+6.84 > 6+0.11/D-1.24 h+6.84 |
| **R023** | L59 | I10 | 2.37 | 3-0.72/C+0.00 h+5.91 > h+3.65 > 3-0.72/C+0.11 h+3.65 |
| **R024** | L60 | I10 | 2.37 | 3-0.37/C+0.00 h+5.91 > h+3.65 > 3-0.38/C+0.11 h+3.65 |
| **R025** | Shared context L2 | I25 | 69.66 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.91 > 12+0.00/G+0.00 h+5.91 > 10+0.00/G+0.00 h+5.91 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.91 > 3-0.72/G+0.00 h+5.91 |
| **R026** | L5 | I02 | 9.70 | 3+0.15/G+0.00 h+5.91 > 3+0.35/G+0.00 h+5.91 > h+7.04 > 3+0.35/E+0.45 h+9.44 > h+9.23 > 3+0.35/E-0.60 h+9.23 > 3+0.00/E-0.60 h+9.23 > 3+0.15/E-2.70 h+9.23 > 3+0.21/E-2.70 h+9.23 > h+8.77 > 3+0.15/E-2.70 h+8.77 |
| **R027** | L6 | I02 | 8.14 | 3+0.15/G+0.00 h+5.91 > 3+0.35/G+0.00 h+5.91 > h+7.04 > 3+0.35/E+0.45 h+9.44 > h+9.23 > 3+0.35/E-0.60 h+9.23 > 3+0.00/E-0.60 h+9.23 > 3+0.15/E-1.12 h+9.23 > 3+0.21/E-1.12 h+9.23 > h+8.77 > 3+0.15/E-1.12 h+8.77 |
| **R028** | L9 | I02 | 9.70 | 4+0.15/G+0.00 h+5.91 > 4+0.35/G+0.00 h+5.91 > h+7.04 > 4+0.35/E+0.45 h+9.44 > h+9.23 > 4+0.35/E-0.60 h+9.23 > 4+0.00/E-0.60 h+9.23 > 4+0.15/E-2.70 h+9.23 > 4+0.21/E-2.70 h+9.23 > h+8.77 > 4+0.15/E-2.70 h+8.77 |
| **R029** | L10 | I02 | 8.14 | 4+0.15/G+0.00 h+5.91 > 4+0.35/G+0.00 h+5.91 > h+7.04 > 4+0.35/E+0.45 h+9.44 > h+9.23 > 4+0.35/E-0.60 h+9.23 > 4+0.00/E-0.60 h+9.23 > 4+0.15/E-1.12 h+9.23 > 4+0.21/E-1.12 h+9.23 > h+8.77 > 4+0.15/E-1.12 h+8.77 |
| **R030** | L13 | I02 | 9.70 | 5+0.15/G+0.00 h+5.91 > 5+0.34/G+0.00 h+5.91 > h+7.04 > 5+0.34/E+0.45 h+9.44 > h+9.23 > 5+0.34/E-0.60 h+9.23 > 5+0.00/E-0.60 h+9.23 > 5+0.15/E-2.70 h+9.23 > 5+0.20/E-2.70 h+9.23 > h+8.77 > 5+0.15/E-2.70 h+8.77 |
| **R031** | L14 | I02 | 8.14 | 5+0.15/G+0.00 h+5.91 > 5+0.34/G+0.00 h+5.91 > h+7.04 > 5+0.34/E+0.45 h+9.44 > h+9.23 > 5+0.34/E-0.60 h+9.23 > 5+0.00/E-0.60 h+9.23 > 5+0.15/E-1.12 h+9.23 > 5+0.20/E-1.12 h+9.23 > h+8.77 > 5+0.15/E-1.12 h+8.77 |
| **R032** | L18 | I02 | 8.14 | 6+0.15/G+0.00 h+5.91 > 6+0.34/G+0.00 h+5.91 > h+7.04 > 6+0.34/E+0.45 h+9.44 > h+9.23 > 6+0.34/E-0.60 h+9.23 > 6+0.00/E-0.60 h+9.23 > 6+0.15/E-1.12 h+9.23 > 6+0.20/E-1.12 h+9.23 > h+8.77 > 6+0.15/E-1.12 h+8.77 |
| **R033** | L33 | I02 | 2.86 | 3+0.11/G+0.00 h+5.91 > 3+0.00/G+0.00 h+5.91 > h+7.05 > 3+0.11/G-1.27 h+7.05 > 3+0.16/G-1.27 h+7.05 > h+6.84 > 3+0.11/G-1.27 h+6.84 |
| **R034** | L34 | I02 | 4.10 | 3+0.11/G+0.00 h+5.91 > 3+0.00/G+0.00 h+5.91 > h+7.05 > 3+0.11/E+1.24 h+7.05 > 3+0.16/E+1.24 h+7.05 > h+6.84 > 3+0.11/E+1.24 h+6.84 |
| **R035** | L37 | I02 | 2.86 | 4+0.11/G+0.00 h+5.91 > 4+0.00/G+0.00 h+5.91 > h+7.05 > 4+0.11/G-1.27 h+7.05 > 4+0.16/G-1.27 h+7.05 > h+6.84 > 4+0.11/G-1.27 h+6.84 |
| **R036** | L38 | I02 | 4.10 | 4+0.11/G+0.00 h+5.91 > 4+0.00/G+0.00 h+5.91 > h+7.05 > 4+0.11/E+1.24 h+7.05 > 4+0.16/E+1.24 h+7.05 > h+6.84 > 4+0.11/E+1.24 h+6.84 |
| **R037** | L41 | I02 | 2.86 | 5+0.11/G+0.00 h+5.91 > 5+0.00/G+0.00 h+5.91 > h+7.05 > 5+0.11/G-1.27 h+7.05 > 5+0.16/G-1.27 h+7.05 > h+6.84 > 5+0.11/G-1.27 h+6.84 |
| **R038** | L42 | I02 | 4.10 | 5+0.11/G+0.00 h+5.91 > 5+0.00/G+0.00 h+5.91 > h+7.05 > 5+0.11/E+1.24 h+7.05 > 5+0.16/E+1.24 h+7.05 > h+6.84 > 5+0.11/E+1.24 h+6.84 |
| **R039** | L46 | I02 | 4.10 | 6+0.11/G+0.00 h+5.91 > 6+0.00/G+0.00 h+5.91 > h+7.05 > 6+0.11/E+1.24 h+7.05 > 6+0.16/E+1.24 h+7.05 > h+6.84 > 6+0.11/E+1.24 h+6.84 |
| **R040** | L61 | I10 | 2.37 | 3-0.72/G+0.00 h+5.91 > h+3.65 > 3-0.72/G-0.11 h+3.65 |
| **R041** | L62 | I10 | 2.37 | 3-0.37/G+0.00 h+5.91 > h+3.65 > 3-0.38/G-0.11 h+3.65 |
| **R042** | Shared context L1 | I25 | 48.73 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.90 > 12+0.00/C+0.00 h+5.90 > 10+0.00/C+0.00 h+5.90 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.90 > 6+0.11/C+0.00 h+5.90 |
| **R043** | L15 | I02 | 9.71 | 6+0.15/C+0.00 h+5.90 > 6+0.34/C+0.00 h+5.90 > h+7.04 > 6+0.34/D-0.45 h+9.44 > h+9.23 > 6+0.34/D+0.60 h+9.23 > 6+0.00/D+0.60 h+9.23 > 6+0.15/D+2.70 h+9.23 > 6+0.20/D+2.70 h+9.23 > h+8.77 > 6+0.15/D+2.70 h+8.77 |
| **R044** | L19 | I02 | 9.71 | 7+0.15/C+0.00 h+5.90 > 7+0.34/C+0.00 h+5.90 > h+7.04 > 7+0.34/D-0.45 h+9.44 > h+9.23 > 7+0.34/D+0.60 h+9.23 > 7+0.00/D+0.60 h+9.23 > 7+0.15/D+2.70 h+9.23 > 7+0.20/D+2.70 h+9.23 > h+8.77 > 7+0.15/D+2.70 h+8.77 |
| **R045** | L20 | I02 | 8.14 | 7+0.15/C+0.00 h+5.90 > 7+0.34/C+0.00 h+5.90 > h+7.04 > 7+0.34/D-0.45 h+9.44 > h+9.23 > 7+0.34/D+0.60 h+9.23 > 7+0.00/D+0.60 h+9.23 > 7+0.15/D+1.12 h+9.23 > 7+0.20/D+1.12 h+9.23 > h+8.77 > 7+0.15/D+1.12 h+8.77 |

# Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R046** | L23 | I02 | 9.71 | 8+0.15/C+0.00 h+5.90 > 8+0.34/C+0.00 h+5.90 > h+7.04 > 8+0.34/D-0.45 h+9.44 > h+9.23 > 8+0.34/D+0.60 h+9.23 > 8+0.00/D+0.60 h+9.23 > 8+0.15/D+2.70 h+9.23 > 8+0.20/D+2.70 h+9.23 > h+8.77 > 8+0.15/D+2.70 h+8.77 |
| **R047** | L24 | I02 | 8.14 | 8+0.15/C+0.00 h+5.90 > 8+0.34/C+0.00 h+5.90 > h+7.04 > 8+0.34/D-0.45 h+9.44 > h+9.23 > 8+0.34/D+0.60 h+9.23 > 8+0.00/D+0.60 h+9.23 > 8+0.15/D+1.12 h+9.23 > 8+0.20/D+1.12 h+9.23 > h+8.77 > 8+0.15/D+1.12 h+8.77 |
| **R048** | L27 | I02 | 8.57 | 9+0.15/C+0.00 h+7.04 > 9+0.34/C+0.00 h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.15/D+2.70 h+9.23 > 9+0.20/D+2.70 h+9.23 > h+8.77 > 9+0.15/D+2.70 h+8.77 |
| **R049** | L28 | I02 | 7.00 | 9+0.15/C+0.00 h+7.04 > 9+0.34/C+0.00 h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.15/D+1.12 h+9.23 > 9+0.20/D+1.12 h+9.23 > h+8.77 > 9+0.15/D+1.12 h+8.77 |
| **R050** | L43 | I02 | 2.86 | 6+0.11/C+0.00 h+5.90 > 6+0.00/C+0.00 h+5.90 > h+7.05 > 6+0.11/C+1.27 h+7.05 > 6+0.16/C+1.27 h+7.05 > h+6.84 > 6+0.11/C+1.27 h+6.84 |
| **R051** | L47 | I02 | 2.86 | 7+0.11/C+0.00 h+5.90 > 7+0.00/C+0.00 h+5.90 > h+7.05 > 7+0.11/C+1.27 h+7.05 > 7+0.16/C+1.27 h+7.05 > h+6.84 > 7+0.11/C+1.27 h+6.84 |
| **R052** | L48 | I02 | 4.11 | 7+0.11/C+0.00 h+5.90 > 7+0.00/C+0.00 h+5.90 > h+7.05 > 7+0.11/D-1.24 h+7.05 > 7+0.16/D-1.24 h+7.05 > h+6.84 > 7+0.11/D-1.24 h+6.84 |
| **R053** | L51 | I02 | 2.86 | 8+0.11/C+0.00 h+5.90 > 8+0.00/C+0.00 h+5.90 > h+7.05 > 8+0.11/C+1.27 h+7.05 > 8+0.16/C+1.27 h+7.05 > h+6.84 > 8+0.11/C+1.27 h+6.84 |
| **R054** | L52 | I02 | 4.11 | 8+0.11/C+0.00 h+5.90 > 8+0.00/C+0.00 h+5.90 > h+7.05 > 8+0.11/D-1.24 h+7.05 > 8+0.16/D-1.24 h+7.05 > h+6.84 > 8+0.11/D-1.24 h+6.84 |
| **R055** | L55 | I02 | 1.72 | 9+0.11/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+7.05 > 9+0.11/C+1.27 h+7.05 > 9+0.16/C+1.27 h+7.05 > h+6.84 > 9+0.11/C+1.27 h+6.84 |
| **R056** | L56 | I02 | 2.97 | 9+0.11/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+7.05 > 9+0.11/D-1.24 h+7.05 > 9+0.16/D-1.24 h+7.05 > h+6.84 > 9+0.11/D-1.24 h+6.84 |
| **R057** | Shared context L1 | I25 | 55.33 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.90 > 12+0.00/G+0.00 h+5.90 > 10+0.00/G+0.00 h+5.90 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.90 > 6+0.11/G+0.00 h+5.90 |
| **R058** | L17 | I02 | 9.71 | 6+0.15/G+0.00 h+5.90 > 6+0.34/G+0.00 h+5.90 > h+7.04 > 6+0.34/E+0.45 h+9.44 > h+9.23 > 6+0.34/E-0.60 h+9.23 > 6+0.00/E-0.60 h+9.23 > 6+0.15/E-2.70 h+9.23 > 6+0.20/E-2.70 h+9.23 > h+8.77 > 6+0.15/E-2.70 h+8.77 |
| **R059** | L21 | I02 | 9.71 | 7+0.15/G+0.00 h+5.90 > 7+0.34/G+0.00 h+5.90 > h+7.04 > 7+0.34/E+0.45 h+9.44 > h+9.23 > 7+0.34/E-0.60 h+9.23 > 7+0.00/E-0.60 h+9.23 > 7+0.15/E-2.70 h+9.23 > 7+0.20/E-2.70 h+9.23 > h+8.77 > 7+0.15/E-2.70 h+8.77 |
| **R060** | L22 | I02 | 8.14 | 7+0.15/G+0.00 h+5.90 > 7+0.34/G+0.00 h+5.90 > h+7.04 > 7+0.34/E+0.45 h+9.44 > h+9.23 > 7+0.34/E-0.60 h+9.23 > 7+0.00/E-0.60 h+9.23 > 7+0.15/E-1.12 h+9.23 > 7+0.20/E-1.12 h+9.23 > h+8.77 > 7+0.15/E-1.12 h+8.77 |
| **R061** | L25 | I02 | 9.71 | 8+0.15/G+0.00 h+5.90 > 8+0.34/G+0.00 h+5.90 > h+7.04 > 8+0.34/E+0.45 h+9.44 > h+9.23 > 8+0.34/E-0.60 h+9.23 > 8+0.00/E-0.60 h+9.23 > 8+0.15/E-2.70 h+9.23 > 8+0.20/E-2.70 h+9.23 > h+8.77 > 8+0.15/E-2.70 h+8.77 |
| **R062** | L26 | I02 | 8.14 | 8+0.15/G+0.00 h+5.90 > 8+0.34/G+0.00 h+5.90 > h+7.04 > 8+0.34/E+0.45 h+9.44 > h+9.23 > 8+0.34/E-0.60 h+9.23 > 8+0.00/E-0.60 h+9.23 > 8+0.15/E-1.12 h+9.23 > 8+0.20/E-1.12 h+9.23 > h+8.77 > 8+0.15/E-1.12 h+8.77 |
| **R063** | L29 | I02 | 8.57 | 9+0.15/G+0.00 h+7.04 > 9+0.34/G+0.00 h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.15/E-2.70 h+9.23 > 9+0.20/E-2.70 h+9.23 > h+8.77 > 9+0.15/E-2.70 h+8.77 |
| **R064** | L30 | I02 | 7.00 | 9+0.15/G+0.00 h+7.04 > 9+0.34/G+0.00 h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.15/E-1.12 h+9.23 > 9+0.20/E-1.12 h+9.23 > h+8.77 > 9+0.15/E-1.12 h+8.77 |
| **R065** | L45 | I02 | 2.86 | 6+0.11/G+0.00 h+5.90 > 6+0.00/G+0.00 h+5.90 > h+7.05 > 6+0.11/G-1.27 h+7.05 > 6+0.16/G-1.27 h+7.05 > h+6.84 > 6+0.11/G-1.27 h+6.84 |
| **R066** | L49 | I02 | 2.86 | 7+0.11/G+0.00 h+5.90 > 7+0.00/G+0.00 h+5.90 > h+7.05 > 7+0.11/G-1.27 h+7.05 > 7+0.16/G-1.27 h+7.05 > h+6.84 > 7+0.11/G-1.27 h+6.84 |
| **R067** | L50 | I02 | 4.11 | 7+0.11/G+0.00 h+5.90 > 7+0.00/G+0.00 h+5.90 > h+7.05 > 7+0.11/E+1.24 h+7.05 > 7+0.16/E+1.24 h+7.05 > h+6.84 > 7+0.11/E+1.24 h+6.84 |
| **R068** | L53 | I02 | 2.86 | 8+0.11/G+0.00 h+5.90 > 8+0.00/G+0.00 h+5.90 > h+7.05 > 8+0.11/G-1.27 h+7.05 > 8+0.16/G-1.27 h+7.05 > h+6.84 > 8+0.11/G-1.27 h+6.84 |
| **R069** | L54 | I02 | 4.11 | 8+0.11/G+0.00 h+5.90 > 8+0.00/G+0.00 h+5.90 > h+7.05 > 8+0.11/E+1.24 h+7.05 > 8+0.16/E+1.24 h+7.05 > h+6.84 > 8+0.11/E+1.24 h+6.84 |
| **R070** | L57 | I02 | 1.72 | 9+0.11/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+7.05 > 9+0.11/G-1.27 h+7.05 > 9+0.16/G-1.27 h+7.05 > h+6.84 > 9+0.11/G-1.27 h+6.84 |
| **R071** | L58 | I02 | 2.97 | 9+0.11/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+7.05 > 9+0.11/E+1.24 h+7.05 > 9+0.16/E+1.24 h+7.05 > h+6.84 > 9+0.11/E+1.24 h+6.84 |
| **R072** | Shared context LA | I25 | 62.31 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.93 > 12+0.00/C+0.00 h+5.93 > 10+0.00/C+0.00 h+5.93 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.93 > 3+0.00/C+0.00 h+5.93 |
| **R073** | L71 | I02 | 10.20 | 3+0.00/C+0.00 h+5.93 > 3+0.35/C+0.00 h+5.93 > h+7.04 > 3+0.35/D-0.45 h+9.44 > h+9.23 > 3+0.35/D+0.60 h+9.23 > 3+0.00/D+0.60 h+9.23 > 3+0.00/D+3.60 h+9.23 > h+9.18 |
| **R074** | L72 | I02 | 10.20 | 4+0.00/C+0.00 h+5.93 > 4+0.35/C+0.00 h+5.93 > h+7.04 > 4+0.35/D-0.45 h+9.44 > h+9.23 > 4+0.35/D+0.60 h+9.23 > 4+0.00/D+0.60 h+9.23 > 4+0.00/D+3.60 h+9.23 > h+9.18 |
| **R075** | L73 | I02 | 10.20 | 5+0.00/C+0.00 h+5.93 > 5+0.34/C+0.00 h+5.93 > h+7.04 > 5+0.34/D-0.45 h+9.44 > h+9.23 > 5+0.34/D+0.60 h+9.23 > 5+0.00/D+0.60 h+9.23 > 5+0.00/D+3.60 h+9.23 > h+9.18 |
| **R076** | L74 | I02 | 10.20 | 6+0.00/C+0.00 h+5.93 > 6+0.34/C+0.00 h+5.93 > h+7.04 > 6+0.34/D-0.45 h+9.44 > h+9.23 > 6+0.34/D+0.60 h+9.23 > 6+0.00/D+0.60 h+9.23 > 6+0.00/D+3.60 h+9.23 > h+9.18 |
| **R077** | L75 | I02 | 10.20 | 7+0.00/C+0.00 h+5.93 > 7+0.34/C+0.00 h+5.93 > h+7.04 > 7+0.34/D-0.45 h+9.44 > h+9.23 > 7+0.34/D+0.60 h+9.23 > 7+0.00/D+0.60 h+9.23 > 7+0.00/D+3.60 h+9.23 > h+9.18 |
| **R078** | L76 | I02 | 10.20 | 8+0.00/C+0.00 h+5.93 > 8+0.34/C+0.00 h+5.93 > h+7.04 > 8+0.34/D-0.45 h+9.44 > h+9.23 > 8+0.34/D+0.60 h+9.23 > 8+0.00/D+0.60 h+9.23 > 8+0.00/D+3.60 h+9.23 > h+9.18 |
| **R079** | L77 | I02 | 10.20 | 9+0.00/C+0.00 h+5.93 > 9+0.34/C+0.00 h+5.93 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+3.60 h+9.23 > h+9.18 |
| **R080** | Shared context L3 | I25 | 35.32 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/C+0.00 h+5.92 > 10+0.00/C+0.00 h+5.92 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.92 |
| **R081** | L81 | I03 | 11.56 | 9+3.60/C+0.00 h+9.27 > 9+3.60/D-0.64 h+9.27 > 9+3.60/D-0.56 h+9.36 > 9+3.60/D+3.60 h+12.38 > h+11.95 > h+9.20 |
| **R082** | L98 | I02 | 9.91 | 9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+2.20 h+9.23 > 9+0.20/D+2.20 h+9.23 > h+8.54 > 9+0.00/D+2.20 h+8.54 > h+8.58 |
| **R083** | L100 | I01 | 9.19 | 9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+0.45 h+9.23 > 9+0.52/D+0.45 h+9.23 > h+8.48 > 9-0.05/D+0.45 h+8.48 > 9-0.05/D+0.44 h+8.48 > h+8.51 |
| **R084** | L101 | I02 | 9.41 | 9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+1.70 h+9.23 > 9+0.20/D+1.70 h+9.23 > h+8.54 > 9+0.00/D+1.70 h+8.54 > h+8.58 |
| **R085** | L104 | I02 | 10.71 | 9+0.00/C+0.00 h+5.92 > 9+0.34/C+0.00 h+5.92 > h+7.04 > 9+0.34/D-0.45 h+9.44 > h+9.23 > 9+0.34/D+0.60 h+9.23 > 9+0.00/D+0.60 h+9.23 > 9+0.00/D+3.00 h+9.23 > 9+0.20/D+3.00 h+9.23 > h+8.54 > 9+0.00/D+3.00 h+8.54 > h+8.58 |
| **R086** | L106 | I06 | 9.55 | 11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+0.58/D+0.08 h+7.25 > h+7.60 > 10+0.58/D+0.36 h+7.60 |
| **R087** | L107 | I06 | 9.20 | 11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+0.58/D+0.08 h+7.25 > 10+0.58/D+0.36 h+7.25 |
| **R088** | L108 | I06 | 8.75 | 11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+1.03/D+0.08 h+7.25 > 10+1.03/D+0.36 h+7.25 |
| **R089** | L109 | I06 | 10.07 | 11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+1.18/D+0.08 h+7.25 > h+8.42 > 10+1.18/D+0.66 h+8.42 |
| **R090** | L114 | I06 | 8.30 | 11-0.17/C+0.00 h+5.92 > 11-0.17/D+0.08 h+5.92 > h+7.25 > 10+1.48/D+0.08 h+7.25 > 10+1.48/D+0.36 h+7.25 |
| **R091** | L115 | I03 | 8.06 | 10+0.51/C+0.00 h+5.92 > h+7.04 > 10+0.51/D-0.54 h+9.38 > h+6.48 > h+6.42 |

THACH BI CHURCH

RS-03

# Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R092** | L116 | I03 | 8.12 | 10+1.08/C+0.00 h+5.92 > h+7.04 > 10+1.08/D-0.54 h+9.38 > h+6.42 > h+6.36 |
| **R093** | L151 | I17 | 6.93 | 12-0.22/C+0.00 h+5.92 > 12+0.00/C+0.00 h+5.92 > 12+0.00/D-0.88 h+5.92 > h+2.30 > 12-0.22/D-0.88 h+2.30 |
| **R094** | L152 | I17 | 4.93 | 12-0.22/C+0.00 h+5.92 > 12+0.00/C+0.00 h+5.92 > 12+0.00/C+0.88 h+5.92 > h+2.30 > 12-0.22/C+0.88 h+2.30 |
| **R095** | Shared context L3 | I25 | 41.92 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/G+0.00 h+5.92 > 10+0.00/G+0.00 h+5.92 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.92 |
| **R096** | L99 | I02 | 9.91 | 9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.00/E-2.20 h+9.23 > 9+0.20/E-2.20 h+9.23 > h+8.54 > 9+0.00/E-2.20 h+8.54 > h+8.58 |
| **R097** | L102 | I02 | 9.41 | 9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.00/E-1.70 h+9.23 > 9+0.20/E-1.70 h+9.23 > h+8.54 > 9+0.00/E-1.70 h+8.54 > h+8.58 |
| **R098** | L103 | I02 | 8.31 | 9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.20/E-0.60 h+9.23 > h+8.54 > 9+0.00/E-0.60 h+8.54 > h+8.58 |
| **R099** | L105 | I02 | 10.71 | 9+0.00/G+0.00 h+5.92 > 9+0.34/G+0.00 h+5.92 > h+7.04 > 9+0.34/E+0.45 h+9.44 > h+9.23 > 9+0.34/E-0.60 h+9.23 > 9+0.00/E-0.60 h+9.23 > 9+0.00/E-3.00 h+9.23 > 9+0.20/E-3.00 h+9.23 > h+8.54 > 9+0.00/E-3.00 h+8.54 > h+8.58 |
| **R100** | L110 | I06 | 9.55 | 11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+0.58/E-0.08 h+7.25 > h+7.60 > 10+0.58/E-0.36 h+7.60 |
| **R101** | L111 | I06 | 9.20 | 11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+0.58/E-0.08 h+7.25 > 10+0.58/E-0.36 h+7.25 |
| **R102** | L112 | I06 | 8.75 | 11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+1.03/E-0.08 h+7.25 > 10+1.03/E-0.36 h+7.25 |
| **R103** | L113 | I06 | 10.07 | 11-0.17/G+0.00 h+5.92 > 11-0.17/E-0.08 h+5.92 > h+7.25 > 10+1.18/E-0.08 h+7.25 > h+8.42 > 10+1.18/E-0.66 h+8.42 |
| **R104** | L117 | I03 | 8.06 | 10+0.51/G+0.00 h+5.92 > h+7.04 > 10+0.51/E+0.54 h+9.38 > h+6.48 > h+6.42 |
| **R105** | L118 | I03 | 8.12 | 10+1.08/G+0.00 h+5.92 > h+7.04 > 10+1.08/E+0.54 h+9.38 > h+6.42 > h+6.36 |
| **R106** | L153 | I17 | 6.93 | 12-0.22/G+0.00 h+5.92 > 12+0.00/G+0.00 h+5.92 > 12+0.00/E+0.88 h+5.92 > h+2.30 > 12-0.22/E+0.88 h+2.30 |
| **R107** | L154 | I17 | 4.93 | 12-0.22/G+0.00 h+5.92 > 12+0.00/G+0.00 h+5.92 > 12+0.00/G-0.88 h+5.92 > h+2.30 > 12-0.22/G-0.88 h+2.30 |
| **R108** | Shared context L4 | I25 | 66.74 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/C+0.00 h+5.92 > 10+0.00/C+0.00 h+5.92 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.92 > 2'+0.08/C+0.00 h+5.92 |
| **R109** | L119 | I10 | 2.93 | 3-0.43/C+0.00 h+5.92 > h+3.10 > 3-0.43/C-0.11 h+3.10 |
| **R110** | L120 | I10 | 2.93 | 4-0.43/C+0.00 h+5.92 > h+3.10 > 4-0.43/C-0.11 h+3.10 |
| **R111** | L121 | I10 | 2.93 | 5-0.43/C+0.00 h+5.92 > h+3.10 > 5-0.43/C-0.11 h+3.10 |
| **R112** | L122 | I10 | 2.93 | 6-0.43/C+0.00 h+5.92 > h+3.10 > 6-0.43/C-0.11 h+3.10 |
| **R113** | L123 | I10 | 2.93 | 7-0.43/C+0.00 h+5.92 > h+3.10 > 7-0.43/C-0.11 h+3.10 |
| **R114** | L124 | I10 | 2.93 | 8-0.43/C+0.00 h+5.92 > h+3.10 > 8-0.43/C-0.11 h+3.10 |
| **R115** | L125 | I10 | 2.93 | 9-0.43/C+0.00 h+5.92 > h+3.10 > 9-0.43/C-0.11 h+3.10 |
| **R116** | L126 | I10 | 2.93 | 11-0.43/C+0.00 h+5.92 > h+3.10 > 11-0.43/C-0.11 h+3.10 |
| **R117** | L127 | I10 | 2.93 | 12-0.43/C+0.00 h+5.92 > h+3.10 > 12-0.43/C-0.11 h+3.10 |
| **R118** | L-ARCH-B-2P-3-A | I11 | 8.21 | 2'+0.08/C+0.00 h+5.92 > h+7.04 > 2'+0.08/C-0.08 h+6.93 > 2'+0.08/B+0.00 h+6.27 > h+2.60 > 2'+0.08/B-0.24 h+2.60 |
| **R119** | L-ARCH-B-2P-3-B | I11 | 8.21 | 3-0.08/C+0.00 h+5.92 > h+7.04 > 3-0.07/C-0.08 h+6.93 > 3-0.07/B+0.00 h+6.27 > h+2.60 > 3-0.07/B-0.24 h+2.60 |
| **R120** | L-ARCH-B-3-4-A | I11 | 8.21 | 3+0.07/C+0.00 h+5.92 > h+7.04 > 3+0.07/C-0.08 h+6.93 > 3+0.07/B+0.00 h+6.27 > h+2.60 > 3+0.07/B-0.24 h+2.60 |
| **R121** | L-ARCH-B-3-4-B | I11 | 8.21 | 4-0.08/C+0.00 h+5.92 > h+7.04 > 4-0.07/C-0.08 h+6.93 > 4-0.07/B+0.00 h+6.27 > h+2.60 > 4-0.07/B-0.24 h+2.60 |
| **R122** | L-ARCH-B-4-5-A | I11 | 8.21 | 4+0.07/C+0.00 h+5.92 > h+7.04 > 4+0.07/C-0.08 h+6.93 > 4+0.07/B+0.00 h+6.27 > h+2.60 > 4+0.07/B-0.24 h+2.60 |
| **R123** | L-ARCH-B-4-5-B | I11 | 8.21 | 5-0.07/C+0.00 h+5.92 > h+7.04 > 5-0.07/C-0.08 h+6.93 > 5-0.07/B+0.00 h+6.27 > h+2.60 > 5-0.07/B-0.24 h+2.60 |
| **R124** | L-ARCH-B-5-6-A | I11 | 8.21 | 5+0.07/C+0.00 h+5.92 > h+7.04 > 5+0.07/C-0.08 h+6.93 > 5+0.07/B+0.00 h+6.27 > h+2.60 > 5+0.07/B-0.24 h+2.60 |
| **R125** | L-ARCH-B-5-6-B | I11 | 8.21 | 6-0.07/C+0.00 h+5.92 > h+7.04 > 6-0.07/C-0.08 h+6.93 > 6-0.07/B+0.00 h+6.27 > h+2.60 > 6-0.07/B-0.24 h+2.60 |
| **R126** | L-ARCH-B-6-7-A | I11 | 8.21 | 6+0.07/C+0.00 h+5.92 > h+7.04 > 6+0.07/C-0.08 h+6.93 > 6+0.07/B+0.00 h+6.27 > h+2.60 > 6+0.07/B-0.24 h+2.60 |
| **R127** | L-ARCH-B-6-7-B | I11 | 8.21 | 7-0.07/C+0.00 h+5.92 > h+7.04 > 7-0.07/C-0.08 h+6.93 > 7-0.07/B+0.00 h+6.27 > h+2.60 > 7-0.07/B-0.24 h+2.60 |
| **R128** | L-ARCH-B-7-8-A | I11 | 8.21 | 7+0.07/C+0.00 h+5.92 > h+7.04 > 7+0.07/C-0.08 h+6.93 > 7+0.07/B+0.00 h+6.27 > h+2.60 > 7+0.07/B-0.24 h+2.60 |
| **R129** | L-ARCH-B-7-8-B | I11 | 8.21 | 8-0.08/C+0.00 h+5.92 > h+7.04 > 8-0.08/C-0.08 h+6.93 > 8-0.08/B+0.00 h+6.27 > h+2.60 > 8-0.08/B-0.24 h+2.60 |
| **R130** | L-ARCH-B-8-9-A | I11 | 8.21 | 8+0.08/C+0.00 h+5.92 > h+7.04 > 8+0.08/C-0.08 h+6.93 > 8+0.08/B+0.00 h+6.27 > h+2.60 > 8+0.08/B-0.24 h+2.60 |
| **R131** | L-ARCH-B-8-9-B | I11 | 8.24 | 9-0.08/C+0.00 h+5.92 > h+7.04 > 9-0.08/C-0.08 h+6.93 > 9-0.08/B+0.23 h+6.32 > 9-0.08/B+0.16 h+6.31 > 9-0.08/B+0.00 h+6.31 > h+2.60 > 9-0.08/B-0.24 h+2.60 |
| **R132** | L-ARCH-B-10-11-A | I11 | 8.24 | 10+0.08/C+0.00 h+5.92 > h+7.04 > 10+0.08/C-0.08 h+6.93 > 10+0.08/B+0.23 h+6.32 > 10+0.08/B+0.16 h+6.31 > 10+0.08/B+0.00 h+6.31 > h+2.60 > 10+0.08/B-0.24 h+2.60 |
| **R133** | L-ARCH-B-10-11-B | I11 | 8.21 | 11-0.08/C+0.00 h+5.92 > h+7.04 > 11-0.08/C-0.08 h+6.93 > 11-0.08/B+0.00 h+6.27 > h+2.60 > 11-0.08/B-0.24 h+2.60 |
| **R134** | L-ARCH-B-11-12-A | I11 | 8.21 | 11+0.08/C+0.00 h+5.92 > h+7.04 > 11+0.08/C-0.08 h+6.93 > 11+0.08/B+0.00 h+6.27 > h+2.60 > 11+0.08/B-0.24 h+2.60 |
| **R135** | L-ARCH-B-11-12-B | I17 | 6.77 | 12-0.08/C+0.00 h+5.92 > 12+0.00/C+0.00 h+5.92 > 12+0.00/B-0.24 h+5.92 > h+2.60 > 12-0.08/B-0.24 h+2.60 |
| **R136** | Shared context L4 | I25 | 73.34 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.92 > 12+0.00/G+0.00 h+5.92 > 10+0.00/G+0.00 h+5.92 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.92 > 2'+0.08/G+0.00 h+5.92 |
| **R137** | L128 | I10 | 2.93 | 3-0.43/G+0.00 h+5.92 > h+3.10 > 3-0.43/G+0.11 h+3.10 |

# Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R138** | L129 | I10 | 2.93 | 4-0.43/G+0.00 h+5.92 > h+3.10 > 4-0.43/G+0.11 h+3.10 |
| **R139** | L130 | I10 | 2.93 | 5-0.43/G+0.00 h+5.92 > h+3.10 > 5-0.43/G+0.11 h+3.10 |
| **R140** | L131 | I10 | 2.93 | 6-0.43/G+0.00 h+5.92 > h+3.10 > 6-0.43/G+0.11 h+3.10 |
| **R141** | L132 | I10 | 2.93 | 7-0.43/G+0.00 h+5.92 > h+3.10 > 7-0.43/G+0.11 h+3.10 |
| **R142** | L133 | I10 | 2.93 | 8-0.43/G+0.00 h+5.92 > h+3.10 > 8-0.43/G+0.11 h+3.10 |
| **R143** | L134 | I10 | 2.93 | 9-0.43/G+0.00 h+5.92 > h+3.10 > 9-0.43/G+0.11 h+3.10 |
| **R144** | L135 | I10 | 2.93 | 11-0.43/G+0.00 h+5.92 > h+3.10 > 11-0.43/G+0.11 h+3.10 |
| **R145** | L136 | I10 | 2.93 | 12-0.43/G+0.00 h+5.92 > h+3.10 > 12-0.43/G+0.11 h+3.10 |
| **R146** | L-ARCH-H-2P-3-A | I11 | 8.21 | 2'+0.08/G+0.00 h+5.92 > h+7.04 > 2'+0.08/G+0.08 h+6.93 > 2'+0.08/H+0.00 h+6.27 > h+2.60 > 2'+0.08/H+0.24 h+2.60 |
| **R147** | L-ARCH-H-2P-3-B | I11 | 8.21 | 3-0.08/G+0.00 h+5.92 > h+7.04 > 3-0.07/G+0.08 h+6.93 > 3-0.07/H+0.00 h+6.27 > h+2.60 > 3-0.07/H+0.24 h+2.60 |
| **R148** | L-ARCH-H-3-4-A | I11 | 8.21 | 3+0.07/G+0.00 h+5.92 > h+7.04 > 3+0.07/G+0.08 h+6.93 > 3+0.07/H+0.00 h+6.27 > h+2.60 > 3+0.07/H+0.24 h+2.60 |
| **R149** | L-ARCH-H-3-4-B | I11 | 8.21 | 4-0.08/G+0.00 h+5.92 > h+7.04 > 4-0.07/G+0.08 h+6.93 > 4-0.07/H+0.00 h+6.27 > h+2.60 > 4-0.07/H+0.24 h+2.60 |
| **R150** | L-ARCH-H-4-5-A | I11 | 8.21 | 4+0.07/G+0.00 h+5.92 > h+7.04 > 4+0.07/G+0.08 h+6.93 > 4+0.07/H+0.00 h+6.27 > h+2.60 > 4+0.07/H+0.24 h+2.60 |
| **R151** | L-ARCH-H-4-5-B | I11 | 8.21 | 5-0.07/G+0.00 h+5.92 > h+7.04 > 5-0.07/G+0.08 h+6.93 > 5-0.07/H+0.00 h+6.27 > h+2.60 > 5-0.07/H+0.24 h+2.60 |
| **R152** | L-ARCH-H-5-6-A | I11 | 8.21 | 5+0.07/G+0.00 h+5.92 > h+7.04 > 5+0.07/G+0.08 h+6.93 > 5+0.07/H+0.00 h+6.27 > h+2.60 > 5+0.07/H+0.24 h+2.60 |
| **R153** | L-ARCH-H-5-6-B | I11 | 8.21 | 6-0.07/G+0.00 h+5.92 > h+7.04 > 6-0.07/G+0.08 h+6.93 > 6-0.07/H+0.00 h+6.27 > h+2.60 > 6-0.07/H+0.24 h+2.60 |
| **R154** | L-ARCH-H-6-7-A | I11 | 8.21 | 6+0.07/G+0.00 h+5.92 > h+7.04 > 6+0.07/G+0.08 h+6.93 > 6+0.07/H+0.00 h+6.27 > h+2.60 > 6+0.07/H+0.24 h+2.60 |
| **R155** | L-ARCH-H-6-7-B | I11 | 8.21 | 7-0.07/G+0.00 h+5.92 > h+7.04 > 7-0.07/G+0.08 h+6.93 > 7-0.07/H+0.00 h+6.27 > h+2.60 > 7-0.07/H+0.24 h+2.60 |
| **R156** | L-ARCH-H-7-8-A | I11 | 8.21 | 7+0.07/G+0.00 h+5.92 > h+7.04 > 7+0.07/G+0.08 h+6.93 > 7+0.07/H+0.00 h+6.27 > h+2.60 > 7+0.07/H+0.24 h+2.60 |
| **R157** | L-ARCH-H-7-8-B | I11 | 8.21 | 8-0.08/G+0.00 h+5.92 > h+7.04 > 8-0.08/G+0.08 h+6.93 > 8-0.08/H+0.00 h+6.27 > h+2.60 > 8-0.08/H+0.24 h+2.60 |
| **R158** | L-ARCH-H-8-9-A | I11 | 8.21 | 8+0.08/G+0.00 h+5.92 > h+7.04 > 8+0.08/G+0.08 h+6.93 > 8+0.08/H+0.00 h+6.27 > h+2.60 > 8+0.08/H+0.24 h+2.60 |
| **R159** | L-ARCH-H-8-9-B | I11 | 8.24 | 9-0.08/G+0.00 h+5.92 > h+7.04 > 9-0.08/G+0.08 h+6.93 > 9-0.08/H-0.23 h+6.32 > 9-0.08/H-0.16 h+6.31 > 9-0.08/H+0.00 h+6.31 > h+2.60 > 9-0.08/H+0.24 h+2.60 |
| **R160** | L-ARCH-H-10-11-A | I11 | 8.24 | 10+0.08/G+0.00 h+5.92 > h+7.04 > 10+0.08/G+0.08 h+6.93 > 10+0.08/H-0.23 h+6.32 > 10+0.08/H-0.16 h+6.31 > 10+0.08/H+0.00 h+6.31 > h+2.60 > 10+0.08/H+0.24 h+2.60 |
| **R161** | L-ARCH-H-10-11-B | I11 | 8.21 | 11-0.08/G+0.00 h+5.92 > h+7.04 > 11-0.08/G+0.08 h+6.93 > 11-0.08/H+0.00 h+6.27 > h+2.60 > 11-0.08/H+0.24 h+2.60 |
| **R162** | L-ARCH-H-11-12-A | I11 | 8.21 | 11+0.08/G+0.00 h+5.92 > h+7.04 > 11+0.08/G+0.08 h+6.93 > 11+0.08/H+0.00 h+6.27 > h+2.60 > 11+0.08/H+0.24 h+2.60 |
| **R163** | L-ARCH-H-11-12-B | I17 | 6.77 | 12-0.08/G+0.00 h+5.92 > 12+0.00/G+0.00 h+5.92 > 12+0.00/H+0.24 h+5.92 > h+2.60 > 12-0.08/H+0.24 h+2.60 |
| **R164** | Shared context L9 | I25 | 26.55 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+5.97 |
| **R165** | L137 | I08 | 11.54 | 1+2.35/C+0.00 h+5.97 > h+7.65 > 1+2.35/D+1.30 h+7.65 > h+3.00 > 1+2.20/D+1.30 h+3.00 |
| **R166** | L182 | I22 | 10.78 | 1+2.35/C+0.00 h+5.97 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/A+1.40 h+8.39 > 1-0.30/A+1.40 h+8.39 |
| **R167** | L183 | I22 | 6.36 | 1+2.35/C+0.00 h+5.97 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+8.39 > 1+0.09/C-1.09 h+8.39 > 1-0.30/C-1.09 h+8.39 |
| **R168** | Shared context L9 | I25 | 11.83 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+5.97 |
| **R169** | L138 | I08 | 11.54 | 1+2.35/G+0.00 h+5.97 > h+7.65 > 1+2.35/E-1.30 h+7.65 > h+3.00 > 1+2.20/E-1.30 h+3.00 |
| **R170** | L189 | I22 | 6.36 | 1+2.35/G+0.00 h+5.97 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+8.39 > 1+0.09/G+1.09 h+8.39 > 1-0.30/G+1.09 h+8.39 |
| **R171** | L190 | I22 | 10.78 | 1+2.35/G+0.00 h+5.97 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/I-1.40 h+8.39 > 1-0.30/I-1.40 h+8.39 |
| **R172** | Shared context L5 | I25 | 57.79 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.95 > 12+0.00/C+0.00 h+5.95 > 10+0.00/C+0.00 h+5.95 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.95 > 4+0.00/C+0.00 h+5.95 |
| **R173** | L139 | I10 | 3.51 | 4+0.83/C+0.00 h+5.95 > h+2.60 > 4+0.83/C-0.16 h+2.60 |
| **R174** | L140 | I10 | 3.51 | 5-0.82/C+0.00 h+5.95 > h+2.60 > 5-0.82/C-0.16 h+2.60 |
| **R175** | L141 | I10 | 3.51 | 8+0.83/C+0.00 h+5.95 > h+2.60 > 8+0.83/C-0.16 h+2.60 |
| **R176** | L142 | I10 | 3.51 | 9-0.83/C+0.00 h+5.95 > h+2.60 > 9-0.83/C-0.16 h+2.60 |
| **R177** | L184 | I11 | 4.98 | 4+0.00/C+0.00 h+5.95 > h+7.04 > 4+0.00/C-0.08 h+6.93 > 4+0.00/B+0.00 h+6.27 > h+5.90 > 4+0.00/B-0.34 h+5.90 |
| **R178** | L185 | I11 | 4.98 | 6+0.00/C+0.00 h+5.95 > h+7.04 > 6+0.00/C-0.08 h+6.93 > 6+0.00/B+0.00 h+6.27 > h+5.90 > 6+0.00/B-0.34 h+5.90 |
| **R179** | L186 | I11 | 4.98 | 11+0.00/C+0.00 h+5.95 > h+7.04 > 11+0.00/C-0.08 h+6.93 > 11+0.00/B+0.00 h+6.27 > h+5.90 > 11+0.00/B-0.34 h+5.90 |
| **R180** | L187 | I11 | 9.08 | 9+3.60/C+0.00 h+9.27 > 9+3.60/A+0.00 h+9.27 > h+6.20 > 9+3.60/A+0.12 h+6.20 |
| **R181** | L188 | I17 | 3.79 | 12+0.00/C+0.00 h+5.95 > 12+0.00/D-0.90 h+5.95 > h+5.20 > 12+0.18/D-0.90 h+5.20 |
| **R182** | Shared context L5 | I25 | 64.39 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.95 > 12+0.00/G+0.00 h+5.95 > 10+0.00/G+0.00 h+5.95 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.95 > 4+0.00/G+0.00 h+5.95 |
| **R183** | L145 | I10 | 3.51 | 4+0.83/G+0.00 h+5.95 > h+2.60 > 4+0.83/G+0.16 h+2.60 |
| **R184** | L146 | I10 | 3.51 | 5-0.82/G+0.00 h+5.95 > h+2.60 > 5-0.82/G+0.16 h+2.60 |

THACH BI CHURCH

RS-05

# Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R185** | L147 | I10 | 3.51 | 8+0.83/G+0.00 h+5.95 > h+2.60 > 8+0.83/G+0.16 h+2.60 |
| **R186** | L148 | I10 | 3.51 | 9-0.83/G+0.00 h+5.95 > h+2.60 > 9-0.83/G+0.16 h+2.60 |
| **R187** | L191 | I11 | 4.98 | 4+0.00/G+0.00 h+5.95 > h+7.04 > 4+0.00/G+0.08 h+6.93 > 4+0.00/H+0.00 h+6.27 > h+5.90 > 4+0.00/H+0.34 h+5.90 |
| **R188** | L192 | I11 | 4.98 | 6+0.00/G+0.00 h+5.95 > h+7.04 > 6+0.00/G+0.08 h+6.93 > 6+0.00/H+0.00 h+6.27 > h+5.90 > 6+0.00/H+0.34 h+5.90 |
| **R189** | L193 | I11 | 4.98 | 11+0.00/G+0.00 h+5.95 > h+7.04 > 11+0.00/G+0.08 h+6.93 > 11+0.00/H+0.00 h+6.27 > h+5.90 > 11+0.00/H+0.34 h+5.90 |
| **R190** | L194 | I11 | 9.08 | 9+3.60/G+0.00 h+9.27 > 9+3.60/I+0.00 h+9.27 > h+6.20 > 9+3.60/I-0.12 h+6.20 |
| **R191** | L195 | I17 | 3.79 | 12+0.00/G+0.00 h+5.95 > 12+0.00/E+0.90 h+5.95 > h+5.20 > 12+0.18/E+0.90 h+5.20 |
| **R192** | Shared context E1 | I25 | 65.77 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.99 > 12+0.00/C+0.00 h+5.99 > 10+0.00/C+0.00 h+5.99 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.99 > 2'+0.08/C+0.00 h+5.99 |
| **R193** | L155 | I13 | 12.65 | 2'+0.08/C+0.00 h+5.99 > 2'-0.25/C+0.00 h+5.99 > 2'-0.25/E-1.90 h+5.99 > h+4.90 > 2'-0.25/D+3.60 h+4.90 > 2'+0.08/D+3.60 h+4.90 > h+4.76 |
| **R194** | L156 | I24 | 6.97 | 5-0.96/C+0.00 h+5.99 > 4+0.98/C+0.00 h+5.99 > h+3.06 > 4+0.98/C-0.14 h+3.06 > 4+2.25/C-0.14 h+3.06 > 4+2.25/C-0.08 h+3.06 |
| **R195** | L158 | I24 | 6.97 | 9-0.95/C+0.00 h+5.99 > 8+0.98/C+0.00 h+5.99 > h+3.06 > 8+0.98/C-0.14 h+3.06 > 8+2.25/C-0.14 h+3.06 > 8+2.25/C-0.08 h+3.06 |
| **R196** | Shared context E1 | I25 | 59.91 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.99 > 12+0.00/G+0.00 h+5.99 > 10+0.00/G+0.00 h+5.99 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.99 > 5-0.96/G+0.00 h+5.99 |
| **R197** | L157 | I24 | 6.97 | 5-0.96/G+0.00 h+5.99 > 4+0.98/G+0.00 h+5.99 > h+3.06 > 4+0.98/G+0.14 h+3.06 > 4+2.25/G+0.14 h+3.06 > 4+2.25/G+0.08 h+3.06 |
| **R198** | L159 | I24 | 6.97 | 9-0.95/G+0.00 h+5.99 > 8+0.98/G+0.00 h+5.99 > h+3.06 > 8+0.98/G+0.14 h+3.06 > 8+2.25/G+0.14 h+3.06 > 8+2.25/G+0.08 h+3.06 |
| **R199** | Shared context L6 | I25 | 27.96 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+5.96 > 2-1.15/C+0.00 h+5.96 |
| **R200** | L160 | I22 | 11.23 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/B-1.04 h+8.39 > 1-0.34/B-1.04 h+8.39 |
| **R201** | L161 | I22 | 12.53 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/B+0.26 h+8.39 > 1-0.34/B+0.26 h+8.39 |
| **R202** | L162 | I22 | 20.09 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+15.84 > 1+0.19/B+0.26 h+15.84 > 1-0.25/B+0.26 h+15.84 |
| **R203** | L163 | I22 | 27.86 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+23.14 > 1+0.47/B+0.26 h+23.14 > 1-0.15/B+0.26 h+23.14 |
| **R204** | L164 | I23 | 33.50 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+29.03 > 1+0.47/B+0.26 h+29.03 > 1+0.14/B+0.26 h+29.03 > h+29.09 |
| **R205** | L165 | I23 | 29.39 | 1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+23.08 > 1+2.45/A+1.39 h+23.08 > 1+2.45/B+0.26 h+23.08 > h+23.20 |
| **R206** | L166 | I22 | 14.88 | 2-1.15/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/A+0.77 h+8.39 > 2-1.15/A+0.77 h+8.39 > 2-1.15/A+0.31 h+8.39 |
| **R207** | L167 | I22 | 13.08 | 1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+8.39 > 1+0.09/A+0.77 h+8.39 > 1+2.45/A+0.77 h+8.39 > 1+2.45/A+0.31 h+8.39 |
| **R208** | L168 | I22 | 20.61 | 1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+15.84 > 1+0.19/A+0.87 h+15.84 > 1+2.45/A+0.87 h+15.84 > 1+2.45/A+0.43 h+15.84 |
| **R209** | L169 | I22 | 28.36 | 1+2.45/C+0.00 h+5.96 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+23.15 > 1+0.47/A+1.11 h+23.15 > 1+0.47/A+1.39 h+23.15 > h+23.14 > 1+0.47/A+1.15 h+23.14 > 1+2.45/A+1.15 h+23.14 > 1+2.45/A+0.53 h+23.14 |
| **R210** | L170 | I08 | 4.97 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.04 h+7.65 > h+8.39 > 1-0.15/C-0.04 h+8.39 |
| **R211** | L222 | I22 | 6.20 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+8.39 > 1+0.09/C-0.34 h+8.39 > 1-0.15/C-0.34 h+8.39 |
| **R212** | L223 | I22 | 14.00 | 1+2.35/C+0.00 h+5.96 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+15.85 > 1+0.19/C-0.71 h+15.85 > 1+0.19/C-0.81 h+15.85 > h+15.84 > 1+0.19/C-0.34 h+15.84 > 1-0.10/C-0.34 h+15.84 |
| **R213** | Shared context L6 | I25 | 13.24 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+5.96 > 2-1.15/G+0.00 h+5.96 |
| **R214** | L171 | I22 | 11.23 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/H+1.04 h+8.39 > 1-0.34/H+1.04 h+8.39 |
| **R215** | L172 | I22 | 12.53 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/H-0.26 h+8.39 > 1-0.34/H-0.26 h+8.39 |
| **R216** | L173 | I22 | 20.09 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+15.84 > 1+0.19/H-0.26 h+15.84 > 1-0.25/H-0.26 h+15.84 |
| **R217** | L174 | I22 | 27.86 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+23.14 > 1+0.47/H-0.26 h+23.14 > 1-0.15/H-0.26 h+23.14 |
| **R218** | L175 | I23 | 33.50 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+29.03 > 1+0.47/H-0.26 h+29.03 > 1+0.14/H-0.26 h+29.03 > h+29.09 |
| **R219** | L176 | I23 | 29.39 | 1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+23.08 > 1+2.45/I-1.39 h+23.08 > 1+2.45/H-0.26 h+23.08 > h+23.20 |
| **R220** | L177 | I22 | 14.88 | 2-1.15/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/I-0.77 h+8.39 > 2-1.15/I-0.77 h+8.39 > 2-1.15/I-0.31 h+8.39 |
| **R221** | L178 | I22 | 13.08 | 1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+8.39 > 1+0.09/I-0.77 h+8.39 > 1+2.45/I-0.77 h+8.39 > 1+2.45/I-0.31 h+8.39 |
| **R222** | L179 | I22 | 20.61 | 1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+15.84 > 1+0.19/I-0.87 h+15.84 > 1+2.45/I-0.87 h+15.84 > 1+2.45/I-0.43 h+15.84 |
| **R223** | L180 | I22 | 28.36 | 1+2.45/G+0.00 h+5.96 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+23.15 > 1+0.47/I-1.11 h+23.15 > 1+0.47/I-1.39 h+23.15 > h+23.14 > 1+0.47/I-1.15 h+23.14 > 1+2.45/I-1.15 h+23.14 > 1+2.45/I-0.53 h+23.14 |

THACH BI CHURCH

RS-06

# Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R224** | L181 | I08 | 4.97 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.04 h+7.65 > h+8.39 > 1-0.15/G+0.04 h+8.39 |
| **R225** | L224 | I22 | 6.20 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+8.39 > 1+0.09/G+0.34 h+8.39 > 1-0.15/G+0.34 h+8.39 |
| **R226** | L225 | I22 | 14.00 | 1+2.35/G+0.00 h+5.96 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+15.85 > 1+0.19/G+0.71 h+15.85 > 1+0.19/G+0.81 h+15.85 > h+15.84 > 1+0.19/G+0.34 h+15.84 > 1-0.10/G+0.34 h+15.84 |
| **R227** | Shared context L7 | I25 | 82.54 | 1+0.24/H+0.34 h+1.50 > 1+2.35/H+0.34 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+5.98 > 2'+0.00/C+0.00 h+5.98 > 9+0.00/C+0.00 h+5.98 > h+7.04 > 9+0.64/C+0.00 h+7.04 > 9+0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 10-0.72/C+0.00 h+6.95 > 10-0.64/C+0.00 h+7.04 > 10+0.00/C+0.00 h+7.04 > h+5.98 > 12+0.00/C+0.00 h+5.98 |
| **R228** | L196 | I09 | 10.46 | 7+1.19/C+0.00 h+5.98 > h+7.04 > 7+1.18/D+3.60 h+12.38 > h+12.69 |
| **R229** | L197 | I09 | 1.37 | 6-2.12/C+0.00 h+5.98 > h+7.04 > 6-2.12/C+0.06 h+7.08 > h+7.32 |
| **R230** | L198 | I09 | 1.37 | 11-0.27/C+0.00 h+5.98 > h+7.04 > 11-0.27/C+0.06 h+7.08 > h+7.32 |
| **R231** | L199 | I09 | 4.83 | 6-2.12/C+0.00 h+5.98 > h+7.04 > 6-2.12/C-0.08 h+6.93 > 6-2.12/B-0.37 h+6.19 > h+6.40 |
| **R232** | L200 | I09 | 4.83 | 11-0.27/C+0.00 h+5.98 > h+7.04 > 11-0.27/C-0.08 h+6.93 > 11-0.27/B-0.37 h+6.19 > h+6.40 |
| **R233** | L201 | I17 | 5.61 | 12+0.00/C+0.00 h+5.98 > 12+0.00/D-1.87 h+5.98 > h+9.00 > 12+0.70/D-1.87 h+9.00 |
| **R234** | L202 | I22 | 9.18 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+4.20 > 1+0.00/C-0.23 h+4.20 > 1-0.77/C-0.23 h+4.20 |
| **R235** | L203 | I22 | 13.60 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+4.20 > 1+0.00/A+0.54 h+4.20 > 1-0.77/A+0.54 h+4.20 |
| **R236** | L204 | I22 | 10.41 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+12.12 > 1+0.09/C-0.30 h+12.12 > 1-0.64/C-0.30 h+12.12 |
| **R237** | L205 | I22 | 14.83 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+12.12 > 1+0.09/A+0.61 h+12.12 > 1-0.64/A+0.61 h+12.12 |
| **R238** | L206 | I22 | 18.01 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+8.40 > 1+0.09/C-0.58 h+8.40 > 1+0.09/C-0.71 h+8.40 > h+15.85 > 1+0.19/C-0.71 h+15.85 > 1+0.19/C-0.81 h+15.85 > h+19.49 > 1+0.19/C-0.37 h+19.49 > 1-0.53/C-0.37 h+19.49 |
| **R239** | L207 | I22 | 22.43 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+8.40 > 1+0.09/A+0.89 h+8.40 > 1+0.09/A+1.01 h+8.40 > h+15.85 > 1+0.19/A+1.01 h+15.85 > 1+0.19/A+1.11 h+15.85 > h+19.49 > 1+0.19/A+0.68 h+19.49 > 1-0.53/A+0.68 h+19.49 |
| **R240** | L219 | I08 | 10.08 | 1+2.35/C+0.00 h+5.98 > h+7.65 > 1+2.35/D+3.60 h+7.65 > h+8.50 > 1+2.15/D+3.60 h+8.50 |
| **R241** | L220 | I09 | 3.75 | 12-0.42/C+0.00 h+5.98 > h+7.04 > 12-0.42/C-0.08 h+6.93 > 12-0.42/B+0.61 h+6.41 > h+6.55 |
| **R242** | Shared context L7 | I25 | 67.82 | 1+0.24/H+0.34 h+1.50 > 1+2.35/H+0.34 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+5.98 > 2'+0.00/G+0.00 h+5.98 > 9+0.00/G+0.00 h+5.98 > h+7.04 > 9+0.64/G+0.00 h+7.04 > 9+0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 10-0.72/G+0.00 h+6.95 > 10-0.64/G+0.00 h+7.04 > 10+0.00/G+0.00 h+7.04 > h+5.98 > 12+0.00/G+0.00 h+5.98 |
| **R243** | L208 | I09 | 1.37 | 6-2.12/G+0.00 h+5.98 > h+7.04 > 6-2.12/G-0.06 h+7.08 > h+7.32 |
| **R244** | L209 | I09 | 1.37 | 11-0.27/G+0.00 h+5.98 > h+7.04 > 11-0.27/G-0.06 h+7.08 > h+7.32 |
| **R245** | L210 | I09 | 4.83 | 6-2.12/G+0.00 h+5.98 > h+7.04 > 6-2.12/G+0.08 h+6.93 > 6-2.12/H+0.37 h+6.19 > h+6.40 |
| **R246** | L211 | I09 | 4.83 | 11-0.27/G+0.00 h+5.98 > h+7.04 > 11-0.27/G+0.08 h+6.93 > 11-0.27/H+0.37 h+6.19 > h+6.40 |
| **R247** | L212 | I17 | 5.61 | 12+0.00/G+0.00 h+5.98 > 12+0.00/E+1.87 h+5.98 > h+9.00 > 12+0.70/E+1.87 h+9.00 |
| **R248** | L213 | I22 | 9.18 | 1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+4.20 > 1+0.00/G+0.23 h+4.20 > 1-0.77/G+0.23 h+4.20 |
| **R249** | L214 | I22 | 13.60 | 1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+4.20 > 1+0.00/I-0.54 h+4.20 > 1-0.77/I-0.54 h+4.20 |
| **R250** | L215 | I22 | 10.41 | 1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+12.12 > 1+0.09/G+0.30 h+12.12 > 1-0.64/G+0.30 h+12.12 |
| **R251** | L216 | I22 | 14.83 | 1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+12.12 > 1+0.09/I-0.61 h+12.12 > 1-0.64/I-0.61 h+12.12 |
| **R252** | L217 | I22 | 18.01 | 1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+8.40 > 1+0.09/G+0.58 h+8.40 > 1+0.09/G+0.71 h+8.40 > h+15.85 > 1+0.19/G+0.71 h+15.85 > 1+0.19/G+0.81 h+15.85 > h+19.49 > 1+0.19/G+0.37 h+19.49 > 1-0.53/G+0.37 h+19.49 |
| **R253** | L218 | I22 | 22.43 | 1+2.35/G+0.00 h+5.98 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+8.40 > 1+0.09/I-0.89 h+8.40 > 1+0.09/I-1.01 h+8.40 > h+15.85 > 1+0.19/I-1.01 h+15.85 > 1+0.19/I-1.11 h+15.85 > h+19.49 > 1+0.19/I-0.68 h+19.49 > 1-0.53/I-0.68 h+19.49 |
| **R254** | L221 | I09 | 3.75 | 12-0.42/G+0.00 h+5.98 > h+7.04 > 12-0.42/G+0.08 h+6.93 > 12-0.42/H-0.61 h+6.41 > h+6.55 |
| **R255** | Shared context F1 | I25 | 64.03 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.00 > 12+0.00/C+0.00 h+6.00 > 10+0.00/C+0.00 h+6.00 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.00 > 3-0.94/C+0.00 h+6.00 |
| **R256** | F226 | I03 | 10.99 | 3-0.94/C+0.00 h+6.00 > h+7.04 > 2'+2.25/C+0.00 h+7.04 > 2'+2.25/D-0.80 h+9.19 > h+9.03 > h+4.20 |
| **R257** | F228 | I04 | 12.39 | 4-0.94/C+0.00 h+6.00 > h+7.04 > 4-1.30/C+0.00 h+7.04 > 4-1.30/D-0.17 h+9.64 > h+8.68 > 4-1.30/D+0.00 h+8.68 > 3+2.25/D+0.00 h+8.68 > h+4.20 |
| **R258** | F230 | I04 | 12.38 | 5-0.96/C+0.00 h+6.00 > h+7.04 > 5-1.30/C+0.00 h+7.04 > 5-1.30/D-0.17 h+9.64 > h+8.68 > 5-1.30/D+0.00 h+8.68 > 4+2.25/D+0.00 h+8.68 > h+4.20 |
| **R259** | F232 | I04 | 12.39 | 6-0.95/C+0.00 h+6.00 > h+7.04 > 6-1.30/C+0.00 h+7.04 > 6-1.30/D-0.17 h+9.64 > h+8.68 > 6-1.30/D+0.00 h+8.68 > 5+2.25/D+0.00 h+8.68 > h+4.20 |
| **R260** | F234 | I04 | 12.39 | 7-0.95/C+0.00 h+6.00 > h+7.04 > 7-1.30/C+0.00 h+7.04 > 7-1.30/D-0.17 h+9.64 > h+8.68 > 7-1.30/D+0.00 h+8.68 > 6+2.25/D+0.00 h+8.68 > h+4.20 |
| **R261** | F236 | I04 | 12.39 | 8-0.95/C+0.00 h+6.00 > h+7.04 > 8-1.30/C+0.00 h+7.04 > 8-1.30/D-0.17 h+9.64 > h+8.68 > 8-1.30/D+0.00 h+8.68 > 7+2.25/D+0.00 h+8.68 > h+4.20 |
| **R262** | F238 | I04 | 12.38 | 9-0.95/C+0.00 h+6.00 > h+7.04 > 9-1.30/C+0.00 h+7.04 > 9-1.30/D-0.17 h+9.64 > h+8.68 > 9-1.30/D+0.00 h+8.68 > 8+2.25/D+0.00 h+8.68 > h+4.20 |
| **R263** | Shared context F1 | I25 | 70.63 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.00 > 12+0.00/G+0.00 h+6.00 > 10+0.00/G+0.00 h+6.00 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.00 > 3-0.94/G+0.00 h+6.00 |
| **R264** | F227 | I03 | 10.99 | 3-0.94/G+0.00 h+6.00 > h+7.04 > 2'+2.25/G+0.00 h+7.04 > 2'+2.25/E+0.80 h+9.19 > h+9.03 > h+4.20 |
| **R265** | F229 | I04 | 12.39 | 4-0.94/G+0.00 h+6.00 > h+7.04 > 4-1.30/G+0.00 h+7.04 > 4-1.30/E+0.17 h+9.64 > h+8.68 > 4-1.30/E+0.00 h+8.68 > 3+2.25/E+0.00 h+8.68 > h+4.20 |
| **R266** | F231 | I04 | 12.38 | 5-0.96/G+0.00 h+6.00 > h+7.04 > 5-1.30/G+0.00 h+7.04 > 5-1.30/E+0.17 h+9.64 > h+8.68 > 5-1.30/E+0.00 h+8.68 > 4+2.25/E+0.00 h+8.68 > h+4.20 |
| **R267** | F233 | I04 | 12.39 | 6-0.95/G+0.00 h+6.00 > h+7.04 > 6-1.30/G+0.00 h+7.04 > 6-1.30/E+0.17 h+9.64 > h+8.68 > 6-1.30/E+0.00 h+8.68 > 5+2.25/E+0.00 h+8.68 > h+4.20 |
| **R268** | F235 | I04 | 12.39 | 7-0.95/G+0.00 h+6.00 > h+7.04 > 7-1.30/G+0.00 h+7.04 > 7-1.30/E+0.17 h+9.64 > h+8.68 > 7-1.30/E+0.00 h+8.68 > 6+2.25/E+0.00 h+8.68 > h+4.20 |

# Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R269** | F237 | I04 | 12.39 | 8-0.95/G+0.00 h+6.00 > h+7.04 > 8-1.30/G+0.00 h+7.04 > 8-1.30/E+0.17 h+9.64 > h+8.68 > 8-1.30/E+0.00 h+8.68 > 7+2.25/E+0.00 h+8.68 > h+4.20 |
| **R270** | F239 | I04 | 12.38 | 9-0.95/G+0.00 h+6.00 > h+7.04 > 9-1.30/G+0.00 h+7.04 > 9-1.30/E+0.17 h+9.64 > h+8.68 > 9-1.30/E+0.00 h+8.68 > 8+2.25/E+0.00 h+8.68 > h+4.20 |
| **R271** | Shared context F5 | I25 | 33.83 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.10 > 12+0.00/C+0.00 h+6.10 > 10+0.00/C+0.00 h+6.10 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+1.07/C+0.00 h+7.24 |
| **R272** | F240 | I11 | 9.26 | 9+1.07/C+0.00 h+7.24 > 9+1.07/A+0.00 h+7.24 > h+4.05 > 9+1.07/A+0.19 h+4.05 |
| **R273** | F241 | I11 | 9.26 | 10-1.07/C+0.00 h+7.24 > 10-1.07/A+0.00 h+7.24 > h+4.05 > 10-1.07/A+0.19 h+4.05 |
| **R274** | Shared context F5 | I25 | 40.43 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.10 > 12+0.00/G+0.00 h+6.10 > 10+0.00/G+0.00 h+6.10 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+1.07/G+0.00 h+7.24 |
| **R275** | F242 | I11 | 9.26 | 9+1.07/G+0.00 h+7.24 > 9+1.07/I+0.00 h+7.24 > h+4.05 > 9+1.07/I-0.19 h+4.05 |
| **R276** | F243 | I11 | 9.26 | 10-1.07/G+0.00 h+7.24 > 10-1.07/I+0.00 h+7.24 > h+4.05 > 10-1.07/I-0.19 h+4.05 |
| **R277** | Shared context F2 | I25 | 66.96 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.01 > 12+0.00/C+0.00 h+6.01 > 10+0.00/C+0.00 h+6.01 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.01 > 2'+0.62/C+0.00 h+6.01 |
| **R278** | F244 | I10 | 2.20 | 4+0.00/C+0.00 h+6.01 > h+4.10 > 4+0.00/C+0.29 h+4.10 |
| **R279** | F246 | I10 | 2.20 | 6+0.00/C+0.00 h+6.01 > h+4.10 > 6+0.00/C+0.29 h+4.10 |
| **R280** | F248 | I10 | 2.20 | 8+0.00/C+0.00 h+6.01 > h+4.10 > 8+0.00/C+0.29 h+4.10 |
| **R281** | F-NAVE-B-2P | I10 | 2.20 | 2'+0.62/C+0.00 h+6.01 > h+4.10 > 2'+0.62/C+0.29 h+4.10 |
| **R282** | F-NAVE-B-3 | I10 | 2.20 | 3+0.00/C+0.00 h+6.01 > h+4.10 > 3+0.00/C+0.29 h+4.10 |
| **R283** | F-NAVE-B-5 | I10 | 2.20 | 5+0.00/C+0.00 h+6.01 > h+4.10 > 5+0.00/C+0.29 h+4.10 |
| **R284** | F-NAVE-B-7 | I10 | 2.20 | 7+0.00/C+0.00 h+6.01 > h+4.10 > 7+0.00/C+0.29 h+4.10 |
| **R285** | F-NAVE-B-9 | I10 | 2.20 | 9+0.00/C+0.00 h+6.01 > h+4.10 > 9+0.00/C+0.29 h+4.10 |
| **R286** | Shared context F2 | I25 | 73.56 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.01 > 12+0.00/G+0.00 h+6.01 > 10+0.00/G+0.00 h+6.01 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.01 > 2'+0.62/G+0.00 h+6.01 |
| **R287** | F245 | I10 | 2.20 | 4+0.00/G+0.00 h+6.01 > h+4.10 > 4+0.00/G-0.29 h+4.10 |
| **R288** | F247 | I10 | 2.20 | 6+0.00/G+0.00 h+6.01 > h+4.10 > 6+0.00/G-0.29 h+4.10 |
| **R289** | F249 | I10 | 2.20 | 8+0.00/G+0.00 h+6.01 > h+4.10 > 8+0.00/G-0.29 h+4.10 |
| **R290** | F-NAVE-H-2P | I10 | 2.20 | 2'+0.62/G+0.00 h+6.01 > h+4.10 > 2'+0.62/G-0.29 h+4.10 |
| **R291** | F-NAVE-H-3 | I10 | 2.20 | 3+0.00/G+0.00 h+6.01 > h+4.10 > 3+0.00/G-0.29 h+4.10 |
| **R292** | F-NAVE-H-5 | I10 | 2.20 | 5+0.00/G+0.00 h+6.01 > h+4.10 > 5+0.00/G-0.29 h+4.10 |
| **R293** | F-NAVE-H-7 | I10 | 2.20 | 7+0.00/G+0.00 h+6.01 > h+4.10 > 7+0.00/G-0.29 h+4.10 |
| **R294** | F-NAVE-H-9 | I10 | 2.20 | 9+0.00/G+0.00 h+6.01 > h+4.10 > 9+0.00/G-0.29 h+4.10 |
| **R295** | Shared context F4 | I25 | 29.62 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+6.03 > 2'+0.00/C+0.00 h+6.03 > h+6.03 |
| **R296** | F250 | I16 | 17.22 | 2'+0.00/C+0.00 h+6.03 > h-0.44 > 2'+0.00/D+0.55 h-0.44 > h+6.00 |
| **R297** | Shared context F4 | I25 | 14.90 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+6.03 > 2'+0.00/G+0.00 h+6.03 > h+6.03 |
| **R298** | F251 | I16 | 17.22 | 2'+0.00/G+0.00 h+6.03 > h-0.44 > 2'+0.00/E-0.55 h-0.44 > h+6.00 |
| **R299** | Shared context V1 | I25 | 67.55 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.04 > 12+0.00/C+0.00 h+6.04 > 10+0.00/C+0.00 h+6.04 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.04 > 2'+0.01/C+0.00 h+6.04 |
| **R300** | F252 | I05 | 8.69 | 2'+0.01/C+0.00 h+6.04 > h+7.04 > 2'-0.15/C+0.00 h+7.04 > 2'-0.15/D+1.20 h+10.64 > h+9.40 > 2'+0.01/D+1.20 h+9.40 |
| **R301** | F253 | I05 | 11.83 | 2'+0.01/C+0.00 h+6.04 > h+7.04 > 2'-0.15/C+0.00 h+7.04 > 2'-0.15/D+2.80 h+11.80 > h+9.40 > 2'+0.01/D+2.80 h+9.40 |
| **R302** | Shared context V1 | I25 | 74.15 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.04 > 12+0.00/G+0.00 h+6.04 > 10+0.00/G+0.00 h+6.04 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.04 > 2'+0.01/G+0.00 h+6.04 |
| **R303** | F254 | I05 | 11.83 | 2'+0.01/G+0.00 h+6.04 > h+7.04 > 2'-0.15/G+0.00 h+7.04 > 2'-0.15/E-2.80 h+11.80 > h+9.40 > 2'+0.01/E-2.80 h+9.40 |
| **R304** | F255 | I05 | 8.69 | 2'+0.01/G+0.00 h+6.04 > h+7.04 > 2'-0.15/G+0.00 h+7.04 > 2'-0.15/E-1.20 h+10.64 > h+9.40 > 2'+0.01/E-1.20 h+9.40 |
| **R305** | Shared context V2 | I25 | 31.71 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.15 > 12+0.00/C+0.00 h+6.15 > 10+0.00/C+0.00 h+6.15 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+2.73/C+0.00 h+8.57 |
| **R306** | F256 | I11 | 6.97 | 9+2.73/C+0.00 h+8.57 > 9+2.73/A+0.00 h+8.57 > h+7.60 > 9+2.73/A+0.12 h+7.60 |
| **R307** | F257 | I11 | 6.97 | 10-2.72/C+0.00 h+8.57 > 10-2.72/A+0.00 h+8.57 > h+7.60 > 10-2.72/A+0.12 h+7.60 |
| **R308** | Shared context V2 | I25 | 38.31 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.15 > 12+0.00/G+0.00 h+6.15 > 10+0.00/G+0.00 h+6.15 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+2.73/G+0.00 h+8.57 |
| **R309** | F258 | I11 | 6.97 | 9+2.73/G+0.00 h+8.57 > 9+2.73/I+0.00 h+8.57 > h+7.60 > 9+2.73/I-0.12 h+7.60 |
| **R310** | F259 | I11 | 6.97 | 10-2.72/G+0.00 h+8.57 > 10-2.72/I+0.00 h+8.57 > h+7.60 > 10-2.72/I-0.12 h+7.60 |

# Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R311** | Shared context V3 | I25 | 16.41 | 11+0.22/E-3.20 h+1.95 > 11+0.06/E-3.20 h+1.95 > 11+0.06/D+1.36 h+1.95 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.16 > 12+0.00/C+0.00 h+6.16 |
| **R312** | F260 | I17 | 10.32 | 12+0.00/C+0.00 h+6.16 > 12+0.00/D+3.60 h+6.16 > h+3.30 > 12+0.10/D+3.60 h+3.30 |
| **R313** | Shared context A1 | I25 | 65.65 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.55 > 12+0.00/C+0.00 h+5.55 > 10+0.00/C+0.00 h+5.55 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.55 > 4-0.43/C+0.00 h+5.55 |
| **R314** | S261 | I10 | 3.16 | 4-0.43/C+0.00 h+5.55 > h+2.50 > 4-0.43/C+0.11 h+2.50 |
| **R315** | S263 | I10 | 3.16 | 5-0.43/C+0.00 h+5.55 > h+2.50 > 5-0.43/C+0.11 h+2.50 |
| **R316** | S265 | I10 | 3.16 | 6-0.43/C+0.00 h+5.55 > h+2.50 > 6-0.43/C+0.11 h+2.50 |
| **R317** | S267 | I10 | 3.16 | 7-0.43/C+0.00 h+5.55 > h+2.50 > 7-0.43/C+0.11 h+2.50 |
| **R318** | S269 | I10 | 3.16 | 8-0.43/C+0.00 h+5.55 > h+2.50 > 8-0.43/C+0.11 h+2.50 |
| **R319** | S271 | I10 | 3.16 | 9-0.43/C+0.00 h+5.55 > h+2.50 > 9-0.43/C+0.11 h+2.50 |
| **R320** | S276 | I11 | 8.04 | 10-0.45/C+0.00 h+7.04 > 10-0.45/C-0.08 h+6.93 > 10-0.45/C-0.95 h+6.74 > 10-0.45/C-1.03 h+6.74 > 10-0.45/A+0.00 h+6.74 > h+4.85 > 10-0.45/A+0.19 h+4.85 |
| **R321** | Shared context A1 | I25 | 59.05 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.55 > 12+0.00/G+0.00 h+5.55 > 10+0.00/G+0.00 h+5.55 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.55 > 4-0.43/G+0.00 h+5.55 |
| **R322** | S262 | I10 | 3.16 | 4-0.43/G+0.00 h+5.55 > h+2.50 > 4-0.43/G-0.11 h+2.50 |
| **R323** | S264 | I10 | 3.16 | 5-0.43/G+0.00 h+5.55 > h+2.50 > 5-0.43/G-0.11 h+2.50 |
| **R324** | S266 | I10 | 3.16 | 6-0.43/G+0.00 h+5.55 > h+2.50 > 6-0.43/G-0.11 h+2.50 |
| **R325** | S268 | I10 | 3.16 | 7-0.43/G+0.00 h+5.55 > h+2.50 > 7-0.43/G-0.11 h+2.50 |
| **R326** | S270 | I10 | 3.16 | 8-0.43/G+0.00 h+5.55 > h+2.50 > 8-0.43/G-0.11 h+2.50 |
| **R327** | S272 | I10 | 3.16 | 9-0.43/G+0.00 h+5.55 > h+2.50 > 9-0.43/G-0.11 h+2.50 |
| **R328** | S278 | I11 | 8.04 | 10-0.45/G+0.00 h+7.04 > 10-0.45/G+0.08 h+6.93 > 10-0.45/G+0.95 h+6.74 > 10-0.45/G+1.03 h+6.74 > 10-0.45/I+0.00 h+6.74 > h+4.85 > 10-0.45/I-0.19 h+4.85 |
| **R329** | Shared context A5 | I25 | 74.25 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.52 > 12+0.00/C+0.00 h+5.52 > 10+0.00/C+0.00 h+5.52 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.52 > 2'+0.01/C+0.00 h+5.52 |
| **R330** | S273 | I16 | 13.21 | 2'+0.01/C+0.00 h+5.52 > h-0.44 > 2'+0.00/D+0.55 h-0.44 > h+2.50 |
| **R331** | Shared context A5 | I25 | 67.65 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.52 > 12+0.00/G+0.00 h+5.52 > 10+0.00/G+0.00 h+5.52 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.52 > 2'+0.01/G+0.00 h+5.52 |
| **R332** | S274 | I16 | 13.21 | 2'+0.01/G+0.00 h+5.52 > h-0.44 > 2'+0.00/E-0.55 h-0.44 > h+2.50 |
| **R333** | Shared context A2 | I25 | 70.16 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.54 > 12+0.00/C+0.00 h+5.54 > 10+0.00/C+0.00 h+5.54 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.54 > 3-0.43/C+0.00 h+5.54 |
| **R334** | S279 | I10 | 2.95 | 4-0.43/C+0.00 h+5.54 > h+2.70 > 4-0.43/C-0.11 h+2.70 |
| **R335** | S280 | I10 | 2.95 | 7-0.43/C+0.00 h+5.54 > h+2.70 > 7-0.43/C-0.11 h+2.70 |
| **R336** | S-PORCH-B-2P-3 | I10 | 2.95 | 3-0.43/C+0.00 h+5.54 > h+2.70 > 3-0.43/C-0.11 h+2.70 |
| **R337** | S-PORCH-B-4-5 | I10 | 2.95 | 5-0.43/C+0.00 h+5.54 > h+2.70 > 5-0.43/C-0.11 h+2.70 |
| **R338** | S-PORCH-B-5-6 | I10 | 2.95 | 6-0.43/C+0.00 h+5.54 > h+2.70 > 6-0.43/C-0.11 h+2.70 |
| **R339** | S-PORCH-B-7-8 | I10 | 2.95 | 8-0.43/C+0.00 h+5.54 > h+2.70 > 8-0.43/C-0.11 h+2.70 |
| **R340** | S-PORCH-B-8-9 | I10 | 2.95 | 9-0.43/C+0.00 h+5.54 > h+2.70 > 9-0.43/C-0.11 h+2.70 |
| **R341** | S-PORCH-B-10-11 | I10 | 2.95 | 11-0.43/C+0.00 h+5.54 > h+2.70 > 11-0.43/C-0.11 h+2.70 |
| **R342** | S-PORCH-B-11-12 | I10 | 2.95 | 12-0.43/C+0.00 h+5.54 > h+2.70 > 12-0.43/C-0.11 h+2.70 |
| **R343** | Shared context A2 | I25 | 63.56 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.54 > 12+0.00/G+0.00 h+5.54 > 10+0.00/G+0.00 h+5.54 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.54 > 3-0.43/G+0.00 h+5.54 |
| **R344** | S281 | I10 | 2.95 | 4-0.43/G+0.00 h+5.54 > h+2.70 > 4-0.43/G+0.11 h+2.70 |
| **R345** | S282 | I10 | 2.95 | 7-0.43/G+0.00 h+5.54 > h+2.70 > 7-0.43/G+0.11 h+2.70 |
| **R346** | S-PORCH-H-2P-3 | I10 | 2.95 | 3-0.43/G+0.00 h+5.54 > h+2.70 > 3-0.43/G+0.11 h+2.70 |
| **R347** | S-PORCH-H-4-5 | I10 | 2.95 | 5-0.43/G+0.00 h+5.54 > h+2.70 > 5-0.43/G+0.11 h+2.70 |
| **R348** | S-PORCH-H-5-6 | I10 | 2.95 | 6-0.43/G+0.00 h+5.54 > h+2.70 > 6-0.43/G+0.11 h+2.70 |
| **R349** | S-PORCH-H-7-8 | I10 | 2.95 | 8-0.43/G+0.00 h+5.54 > h+2.70 > 8-0.43/G+0.11 h+2.70 |
| **R350** | S-PORCH-H-8-9 | I10 | 2.95 | 9-0.43/G+0.00 h+5.54 > h+2.70 > 9-0.43/G+0.11 h+2.70 |
| **R351** | S-PORCH-H-10-11 | I10 | 2.95 | 11-0.43/G+0.00 h+5.54 > h+2.70 > 11-0.43/G+0.11 h+2.70 |
| **R352** | S-PORCH-H-11-12 | I10 | 2.95 | 12-0.43/G+0.00 h+5.54 > h+2.70 > 12-0.43/G+0.11 h+2.70 |
| **R353** | Shared context A3 | I25 | 77.36 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.53 > 12+0.00/C+0.00 h+5.53 > 10+0.00/C+0.00 h+5.53 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.53 > 2'+0.00/C+0.00 h+5.53 > 1+2.35/C+0.00 h+5.53 |

# Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R354** | S283 | I22 | 7.00 | 1+2.35/C+0.00 h+5.53 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/C-0.58 h+7.65 > h+6.20 > 1+0.00/C-0.94 h+6.20 > 1-0.14/C-0.94 h+6.20 |
| **R355** | S284 | I22 | 11.52 | 1+2.35/C+0.00 h+5.53 > h+7.65 > 1+2.35/C-0.34 h+7.65 > 1+0.00/C-0.34 h+7.65 > 1+0.00/A+0.89 h+7.65 > h+6.20 > 1+0.00/A+1.35 h+6.20 > 1-0.14/A+1.35 h+6.20 |
| **R356** | S285 | I11 | 5.69 | 5+0.00/C+0.00 h+5.53 > h+7.04 > 5+0.00/C-0.08 h+6.93 > 5+0.00/B+0.00 h+6.27 > h+5.60 > 5+0.00/B-0.34 h+5.60 |
| **R357** | S286 | I11 | 5.69 | 8+0.00/C+0.00 h+5.53 > h+7.04 > 8+0.00/C-0.08 h+6.93 > 8+0.00/B+0.00 h+6.27 > h+5.60 > 8+0.00/B-0.34 h+5.60 |
| **R358** | Shared context A3 | I25 | 70.76 | 11+0.60/E-2.20 h+0.95 > 11+0.06/E-2.20 h+0.95 > 11+0.06/E-1.36 h+0.95 > h+4.33 > 11+0.06/E-0.30 h+4.33 > 12+0.00/E-0.30 h+4.33 > h+5.53 > 12+0.00/G+0.00 h+5.53 > 10+0.00/G+0.00 h+5.53 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.53 > 2'+0.00/G+0.00 h+5.53 > 1+2.35/G+0.00 h+5.53 |
| **R359** | S287 | I22 | 7.00 | 1+2.35/G+0.00 h+5.53 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/G+0.58 h+7.65 > h+6.20 > 1+0.00/G+0.94 h+6.20 > 1-0.14/G+0.94 h+6.20 |
| **R360** | S288 | I22 | 11.52 | 1+2.35/G+0.00 h+5.53 > h+7.65 > 1+2.35/G+0.34 h+7.65 > 1+0.00/G+0.34 h+7.65 > 1+0.00/I-0.89 h+7.65 > h+6.20 > 1+0.00/I-1.35 h+6.20 > 1-0.14/I-1.35 h+6.20 |
| **R361** | S289 | I11 | 5.69 | 5+0.00/G+0.00 h+5.53 > h+7.04 > 5+0.00/G+0.08 h+6.93 > 5+0.00/H+0.00 h+6.27 > h+5.60 > 5+0.00/H+0.34 h+5.60 |
| **R362** | S290 | I11 | 5.69 | 8+0.00/G+0.00 h+5.53 > h+7.04 > 8+0.00/G+0.08 h+6.93 > 8+0.00/H+0.00 h+6.27 > h+5.60 > 8+0.00/H+0.34 h+5.60 |
| **R363** | Shared context MIC | I20 | 11.91 | 11+0.60/E-2.20 h+0.95 > h+0.03 > 11+0.60/D+2.20 h+0.03 > 10-3.09/D+2.20 h+0.03 |
| **R364** | S291 | I18 | 3.63 | 10-3.09/D+2.20 h+0.03 > 10-3.09/D+0.98 h+0.03 > 10-2.88/D+0.98 h+0.03 > h+1.86 > 10-3.09/D+0.98 h+1.82 > h+1.95 |
| **R365** | Shared context MIC | I20 | 5.74 | 11+0.60/E-2.20 h+0.95 > h+0.03 > 10+0.28/E-2.20 h+0.03 |
| **R366** | S292 | I19 | 2.85 | 10+0.28/E-2.20 h+0.03 > 10+0.28/E-3.15 h+0.03 > h+1.93 |
| **R367** | Shared context P1 | I25 | 48.38 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.11 > 12+0.00/C+0.00 h+6.11 > 10+0.00/C+0.00 h+6.11 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.11 > 6-0.65/C+0.00 h+6.11 |
| **R368** | P-SANCT-B | I10 | 5.65 | 10+0.00/C+0.00 h+6.11 > h+0.85 > 10-0.28/C+0.00 h+0.85 > 10-0.28/C+0.11 h+0.85 |
| **R369** | P-NAVE-B | I10 | 5.77 | 6-0.65/C+0.00 h+6.11 > h+0.45 > 6-0.65/C+0.11 h+0.45 |
| **R370** | Shared context P3 | I12 | 20.28 | 1+0.24/H+0.34 h+1.50 > h-0.12 > 1+0.24/C-0.34 h-0.12 > 1+0.45/C-0.34 h-0.12 |
| **R371** | P-TOWER-B | I07 | 1.57 | 1+0.45/C-0.34 h-0.12 > h+1.30 > 1+0.45/C-0.49 h+1.30 |
| **R372** | Shared context P2 | I25 | 54.97 | 11+0.22/D+2.05 h+1.75 > 11+0.06/D+2.05 h+1.75 > 11+0.06/D+1.36 h+1.75 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.12 > 12+0.00/G+0.00 h+6.12 > 10+0.00/G+0.00 h+6.12 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.12 > 6-0.65/G+0.00 h+6.12 |
| **R373** | P-SANCT-H | I10 | 5.66 | 10+0.00/G+0.00 h+6.12 > h+0.85 > 10-0.28/G+0.00 h+0.85 > 10-0.28/G-0.11 h+0.85 |
| **R374** | P-NAVE-H | I10 | 5.78 | 6-0.65/G+0.00 h+6.12 > h+0.45 > 6-0.65/G-0.11 h+0.45 |
| **R375** | Shared context P4 | I12 | 4.88 | 1+0.24/H+0.34 h+1.50 > h-0.12 > 1+0.24/G+0.34 h-0.12 > 1+0.45/G+0.34 h-0.12 |
| **R376** | P-TOWER-H | I07 | 1.57 | 1+0.45/G+0.34 h-0.12 > h+1.30 > 1+0.45/G+0.49 h+1.30 |
| **R377** | Shared context L10 | I25 | 28.08 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/C+0.00 h+7.65 > h+6.14 > 2-0.85/C+0.00 h+6.14 |
| **R378** | L-STATUE-C-ARCH | I08 | 23.12 | 2-0.95/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D+3.60 h+7.65 > h+19.61 > 2-0.95/D+3.60 h+19.61 |
| **R379** | L-STATUE-C-JAMB-1 | I08 | 20.61 | 2-0.95/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D+2.91 h+7.65 > h+17.79 > 2-0.95/D+2.91 h+17.79 |
| **R380** | L-STATUE-C-CANDLE-1 | I08 | 19.50 | 2-1.18/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D+3.30 h+7.65 > h+16.68 > 2-1.18/D+3.30 h+16.68 |
| **R381** | L-STATUE-B-ARCH | I08 | 11.25 | 2-0.85/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D-1.75 h+7.65 > h+12.92 > 2-0.85/D-1.75 h+12.92 |
| **R382** | L-STATUE-B-JAMB-1 | I08 | 9.10 | 2-0.85/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C+1.43 h+7.65 > h+11.35 > 2-0.85/C+1.43 h+11.35 |
| **R383** | L-STATUE-B-CANDLE-1 | I08 | 8.26 | 2-0.94/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/C+1.70 h+7.65 > h+10.39 > 2-0.94/C+1.70 h+10.39 |
| **R384** | L-STATUE-B-JAMB-2 | I08 | 10.26 | 2-0.85/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D-1.17 h+7.65 > h+11.35 > 2-0.85/D-1.17 h+11.35 |
| **R385** | L-STATUE-B-CANDLE-2 | I08 | 8.88 | 2-0.94/C+0.00 h+6.14 > 1+2.35/C+0.00 h+7.65 > 1+2.35/D-1.44 h+7.65 > h+10.39 > 2-0.94/D-1.44 h+10.39 |
| **R386** | Shared context L10 | I25 | 13.36 | 1+0.24/H-1.16 h+1.50 > 1+2.35/H-1.16 h+1.50 > h+7.65 > 1+2.35/G+0.00 h+7.65 > h+6.14 > 2-0.85/G+0.00 h+6.14 |
| **R387** | L-STATUE-C-JAMB-2 | I08 | 20.61 | 2-0.95/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E-2.91 h+7.65 > h+17.79 > 2-0.95/E-2.91 h+17.79 |
| **R388** | L-STATUE-C-CANDLE-2 | I08 | 19.50 | 2-1.18/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E-3.30 h+7.65 > h+16.68 > 2-1.18/E-3.30 h+16.68 |
| **R389** | L-STATUE-H-ARCH | I08 | 11.25 | 2-0.85/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E+1.75 h+7.65 > h+12.92 > 2-0.85/E+1.75 h+12.92 |
| **R390** | L-STATUE-H-JAMB-1 | I08 | 10.26 | 2-0.85/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E+1.17 h+7.65 > h+11.35 > 2-0.85/E+1.17 h+11.35 |
| **R391** | L-STATUE-H-CANDLE-1 | I08 | 8.88 | 2-0.94/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/E+1.44 h+7.65 > h+10.39 > 2-0.94/E+1.44 h+10.39 |
| **R392** | L-STATUE-H-JAMB-2 | I08 | 9.10 | 2-0.85/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G-1.43 h+7.65 > h+11.35 > 2-0.85/G-1.43 h+11.35 |
| **R393** | L-STATUE-H-CANDLE-2 | I08 | 8.26 | 2-0.94/G+0.00 h+6.14 > 1+2.35/G+0.00 h+7.65 > 1+2.35/G-1.70 h+7.65 > h+10.39 > 2-0.94/G-1.70 h+10.39 |
| **R394** | Shared context LS | I25 | 71.24 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.16 > 12+0.00/G+0.00 h+6.16 > 10+0.00/G+0.00 h+6.16 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+6.16 > 2'+1.93/G+0.00 h+6.16 |
| **R395** | L-STATION-1-A | I10 | 1.57 | 8+1.93/G+0.00 h+6.16 > h+4.72 > 8+1.93/G-0.13 h+4.72 |
| **R396** | L-STATION-1-B | I10 | 1.57 | 9-1.93/G+0.00 h+6.16 > h+4.72 > 9-1.93/G-0.13 h+4.72 |
| **R397** | L-STATION-2-A | I10 | 1.57 | 7+1.93/G+0.00 h+6.16 > h+4.72 > 7+1.93/G-0.13 h+4.72 |
| **R398** | L-STATION-2-B | I10 | 1.57 | 8-1.93/G+0.00 h+6.16 > h+4.72 > 8-1.93/G-0.13 h+4.72 |

# Route set-out schedule

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R399** | L-STATION-3-A | I10 | 1.57 | 6+1.93/G+0.00 h+6.16 > h+4.72 > 6+1.93/G-0.13 h+4.72 |
| **R400** | L-STATION-3-B | I10 | 1.57 | 7-1.93/G+0.00 h+6.16 > h+4.72 > 7-1.93/G-0.13 h+4.72 |
| **R401** | L-STATION-4-A | I10 | 1.57 | 5+1.93/G+0.00 h+6.16 > h+4.72 > 5+1.93/G-0.13 h+4.72 |
| **R402** | L-STATION-4-B | I10 | 1.57 | 6-1.93/G+0.00 h+6.16 > h+4.72 > 6-1.93/G-0.13 h+4.72 |
| **R403** | L-STATION-5-A | I10 | 1.57 | 4+1.93/G+0.00 h+6.16 > h+4.72 > 4+1.93/G-0.13 h+4.72 |
| **R404** | L-STATION-5-B | I10 | 1.57 | 5-1.93/G+0.00 h+6.16 > h+4.72 > 5-1.93/G-0.13 h+4.72 |
| **R405** | L-STATION-6-A | I10 | 1.57 | 3+1.93/G+0.00 h+6.16 > h+4.72 > 3+1.93/G-0.13 h+4.72 |
| **R406** | L-STATION-6-B | I10 | 1.57 | 4-1.93/G+0.00 h+6.16 > h+4.72 > 4-1.93/G-0.13 h+4.72 |
| **R407** | L-STATION-7-A | I10 | 1.57 | 2'+1.93/G+0.00 h+6.16 > h+4.72 > 2'+1.93/G-0.13 h+4.72 |
| **R408** | L-STATION-7-B | I10 | 1.57 | 3-1.93/G+0.00 h+6.16 > h+4.72 > 3-1.93/G-0.13 h+4.72 |
| **R409** | Shared context LS | I25 | 64.64 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+6.16 > 12+0.00/C+0.00 h+6.16 > 10+0.00/C+0.00 h+6.16 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+6.16 > 2'+1.93/C+0.00 h+6.16 |
| **R410** | L-STATION-8-A | I10 | 1.57 | 2'+1.93/C+0.00 h+6.16 > h+4.72 > 2'+1.93/C+0.13 h+4.72 |
| **R411** | L-STATION-8-B | I10 | 1.57 | 3-1.93/C+0.00 h+6.16 > h+4.72 > 3-1.93/C+0.13 h+4.72 |
| **R412** | L-STATION-9-A | I10 | 1.57 | 3+1.93/C+0.00 h+6.16 > h+4.72 > 3+1.93/C+0.13 h+4.72 |
| **R413** | L-STATION-9-B | I10 | 1.57 | 4-1.93/C+0.00 h+6.16 > h+4.72 > 4-1.93/C+0.13 h+4.72 |
| **R414** | L-STATION-10-A | I10 | 1.57 | 4+1.93/C+0.00 h+6.16 > h+4.72 > 4+1.93/C+0.13 h+4.72 |
| **R415** | L-STATION-10-B | I10 | 1.57 | 5-1.93/C+0.00 h+6.16 > h+4.72 > 5-1.93/C+0.13 h+4.72 |
| **R416** | L-STATION-11-A | I10 | 1.57 | 5+1.93/C+0.00 h+6.16 > h+4.72 > 5+1.93/C+0.13 h+4.72 |
| **R417** | L-STATION-11-B | I10 | 1.57 | 6-1.93/C+0.00 h+6.16 > h+4.72 > 6-1.93/C+0.13 h+4.72 |
| **R418** | L-STATION-12-A | I10 | 1.57 | 6+1.93/C+0.00 h+6.16 > h+4.72 > 6+1.93/C+0.13 h+4.72 |
| **R419** | L-STATION-12-B | I10 | 1.57 | 7-1.93/C+0.00 h+6.16 > h+4.72 > 7-1.93/C+0.13 h+4.72 |
| **R420** | L-STATION-13-A | I10 | 1.57 | 7+1.93/C+0.00 h+6.16 > h+4.72 > 7+1.93/C+0.13 h+4.72 |
| **R421** | L-STATION-13-B | I10 | 1.57 | 8-1.93/C+0.00 h+6.16 > h+4.72 > 8-1.93/C+0.13 h+4.72 |
| **R422** | L-STATION-14-A | I10 | 1.57 | 8+1.93/C+0.00 h+6.16 > h+4.72 > 8+1.93/C+0.13 h+4.72 |
| **R423** | L-STATION-14-B | I10 | 1.57 | 9-1.93/C+0.00 h+6.16 > h+4.72 > 9-1.93/C+0.13 h+4.72 |
| **R424** | Shared context L8 | I25 | 31.84 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.96 > 12+0.00/C+0.00 h+5.96 > 10+0.00/C+0.00 h+5.96 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+1.96/C+0.00 h+7.95 |
| **R425** | L-WING-B-FI | I03 | 1.76 | 9+1.96/C+0.00 h+7.95 > 9+1.96/C-1.44 h+7.95 > h+7.66 > h+7.64 |
| **R426** | L-WING-B-FO | I03 | 4.36 | 9+1.96/C+0.00 h+7.95 > 9+1.96/B-0.99 h+7.95 > h+7.66 > h+7.64 |
| **R427** | L-WING-B-RI | I03 | 1.76 | 10-1.96/C+0.00 h+7.95 > 10-1.96/C-1.44 h+7.95 > h+7.66 > h+7.64 |
| **R428** | L-WING-B-RO | I03 | 4.36 | 10-1.96/C+0.00 h+7.95 > 10-1.96/B-0.99 h+7.95 > h+7.66 > h+7.64 |
| **R429** | Shared context L8 | I25 | 38.44 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.96 > 12+0.00/G+0.00 h+5.96 > 10+0.00/G+0.00 h+5.96 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+1.96/G+0.00 h+7.95 |
| **R430** | L-WING-H-FI | I03 | 1.76 | 9+1.96/G+0.00 h+7.95 > 9+1.96/G+1.44 h+7.95 > h+7.66 > h+7.64 |
| **R431** | L-WING-H-FO | I03 | 4.36 | 9+1.96/G+0.00 h+7.95 > 9+1.96/H+0.99 h+7.95 > h+7.66 > h+7.64 |
| **R432** | L-WING-H-RI | I03 | 1.76 | 10-1.96/G+0.00 h+7.95 > 10-1.96/G+1.44 h+7.95 > h+7.66 > h+7.64 |
| **R433** | L-WING-H-RO | I03 | 4.36 | 10-1.96/G+0.00 h+7.95 > 10-1.96/H+0.99 h+7.95 > h+7.66 > h+7.64 |
| **R434** | Shared context LD | I25 | 62.30 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.94 > 12+0.00/C+0.00 h+5.94 > 10+0.00/C+0.00 h+5.94 > h+7.04 > 10-0.64/C+0.00 h+7.04 > 10-0.72/C+0.00 h+6.95 > 9+3.60/C+0.00 h+9.27 > 9+0.72/C+0.00 h+6.95 > 9+0.64/C+0.00 h+7.04 > 9+0.00/C+0.00 h+7.04 > h+5.94 > 3+0.00/C+0.00 h+5.94 |
| **R435** | L-COLUMN-3-B | I15 | 16.39 | 3+0.00/C+0.00 h+5.94 > h-0.44 > 3+0.00/D+0.31 h-0.44 > h+5.50 |
| **R436** | L-COLUMN-4-B | I15 | 16.39 | 4+0.00/C+0.00 h+5.94 > h-0.44 > 4+0.00/D+0.31 h-0.44 > h+5.50 |
| **R437** | L-COLUMN-5-B | I15 | 16.39 | 5+0.00/C+0.00 h+5.94 > h-0.44 > 5+0.00/D+0.31 h-0.44 > h+5.50 |
| **R438** | L-COLUMN-6-B | I15 | 16.39 | 6+0.00/C+0.00 h+5.94 > h-0.44 > 6+0.00/D+0.31 h-0.44 > h+5.50 |
| **R439** | L-COLUMN-7-B | I15 | 16.39 | 7+0.00/C+0.00 h+5.94 > h-0.44 > 7+0.00/D+0.31 h-0.44 > h+5.50 |
| **R440** | L-COLUMN-8-B | I15 | 16.39 | 8+0.00/C+0.00 h+5.94 > h-0.44 > 8+0.00/D+0.31 h-0.44 > h+5.50 |
| **R441** | L-COLUMN-9-B | I15 | 16.39 | 9+0.00/C+0.00 h+5.94 > h-0.44 > 9+0.00/D+0.31 h-0.44 > h+5.50 |
| **R442** | Shared context LD | I25 | 68.90 | 11+0.22/D+3.05 h+1.85 > 11+0.06/D+3.05 h+1.85 > 11+0.06/D+1.36 h+1.85 > h+4.33 > 11+0.06/D+0.30 h+4.33 > 12+0.00/D+0.30 h+4.33 > h+5.94 > 12+0.00/G+0.00 h+5.94 > 10+0.00/G+0.00 h+5.94 > h+7.04 > 10-0.64/G+0.00 h+7.04 > 10-0.72/G+0.00 h+6.95 > 9+3.60/G+0.00 h+9.27 > 9+0.72/G+0.00 h+6.95 > 9+0.64/G+0.00 h+7.04 > 9+0.00/G+0.00 h+7.04 > h+5.94 > 3+0.00/G+0.00 h+5.94 |

# Route set-out schedule

DESIGN DEVELOPMENT

NOT FOR CONSTRUCTION

Each route once / vertices in order from the board / grid axis + offset (m) / h = height above nave floor +0.000

| Ref | Equipment / context | Note | Drawn m | Vertex set-out from the source end |
|---|---|---|---|---|
| **R443** | L-COLUMN-3-H | I15 | 16.39 | 3+0.00/G+0.00 h+5.94 > h-0.44 > 3+0.00/E-0.31 h-0.44 > h+5.50 |
| **R444** | L-COLUMN-4-H | I15 | 16.39 | 4+0.00/G+0.00 h+5.94 > h-0.44 > 4+0.00/E-0.31 h-0.44 > h+5.50 |
| **R445** | L-COLUMN-5-H | I15 | 16.39 | 5+0.00/G+0.00 h+5.94 > h-0.44 > 5+0.00/E-0.31 h-0.44 > h+5.50 |
| **R446** | L-COLUMN-6-H | I15 | 16.39 | 6+0.00/G+0.00 h+5.94 > h-0.44 > 6+0.00/E-0.31 h-0.44 > h+5.50 |
| **R447** | L-COLUMN-7-H | I15 | 16.39 | 7+0.00/G+0.00 h+5.94 > h-0.44 > 7+0.00/E-0.31 h-0.44 > h+5.50 |
| **R448** | L-COLUMN-8-H | I15 | 16.39 | 8+0.00/G+0.00 h+5.94 > h-0.44 > 8+0.00/E-0.31 h-0.44 > h+5.50 |
| **R449** | L-COLUMN-9-H | I15 | 16.39 | 9+0.00/G+0.00 h+5.94 > h-0.44 > 9+0.00/E-0.31 h-0.44 > h+5.50 |

# 3D installation planning sequence

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

## 01 / Survey and coordinate

3D layer: all / building

Check grid, floor datum, equipment positions and all concealed routes against the measured building. Use the circuit sheets to record corrections.

**HOLD / responsible specialist release required**

Survey and coordinated light, sound, air, access and concealment review must precede physical setting-out. This default layout still has unmet targets.

## 02 / Boards and feeder paths

3D layer: distribution / systems

Review DB-1 to DB-2, LC-1, FC-1 and AV-1 paths. Confirm enclosure access and the proposed supply/control separation.

**HOLD / responsible specialist release required**

Electrical designer: supply, phases, earthing, fault level, protection, cable sizes, board capacity and final single-line diagram are pending. Do not energize from this model.

## 03 / Coordinate concealed containment

3D layer: all / systems

Review all shared corridors and individual branches together. Select each run for its vertices and height; compare with structure and finished surfaces before closing any cover.

**HOLD / responsible specialist release required**

Containment size, power/signal separation, fixings, fire stopping, access panels and penetrations require coordinated approval. Coloured routes are enlarged display lines, not cable diameters.

# 3D installation planning sequence

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

## 04 / Lighting routes and fittings

3D layer: lighting / systems

Review each light circuit and its LC-1 or DB-2 supply. Check chandelier support, aim, driver access, fan-blade interaction and labels against the matching paper sheet.

**HOLD / responsible specialist release required**

Selected-product photometry, support design, control channels, dimming compatibility and installation details remain pending. Review current per-seat lighting failures in the matching calculation report.

## 05 / Sound and microphone connections

3D layer: sound / systems

Trace speaker and microphone lines to AV-1 separately from rack mains. Review polarity, intended zones, furniture/floor interfaces and service access.

**HOLD / responsible specialist release required**

Amplifier topology, impedance/line voltage, connectors, shielding and separation are pending. Passive speaker ratings are not mains loads; feedback and wing clarity targets remain unmet.

## 06 / Fans and ventilation

3D layer: air / systems

Review FC-1 and DB-2 routes, motor control compatibility and air paths with the lighting and sound systems. Keep the central processional view clear of visible fans and supports.

**HOLD / responsible specialist release required**

Current geometry is a study, not an accepted fan installation. Mounting, guards/clearance, duty points, make-up air, noise, concealment and maintenance access need specialist approval.

# 3D installation planning sequence

Same stage text as the local viewer / proposed coordination order / no work or approval recorded

## 07 / Exit signs and required safety functions

3D layer: exit / systems

Identify E1 separately from discretionary light scenes. Coordinate the required emergency system, operating labels and test access with the responsible designer.

**HOLD / responsible specialist release required**

Emergency supply, duration, coverage and failure behavior are not established by the simulator. No scene or walkthrough step authorizes isolation of required safety functions.

## 08 / Powered decoration and interfaces

3D layer: decoration / systems

Review decorative loads and concealed feeds, heat dissipation, isolation and replacement access without obstructing worship or other systems.

**HOLD / responsible specialist release required**

Final products, loads, supports, material/fire compatibility and control interfaces need approval. Empty stages may occur in edited layouts.

## 09 / Inspect, test and hand over

3D layer: all / building

After approved installation, the responsible team must record electrical verification, manual/scene and failure tests, light/sound/air measurements, as-built IDs and maintenance instructions.

**HOLD / responsible specialist release required**

No commissioning or construction approval is recorded here. Progress through these review steps does not release a hold or mark any work installed.