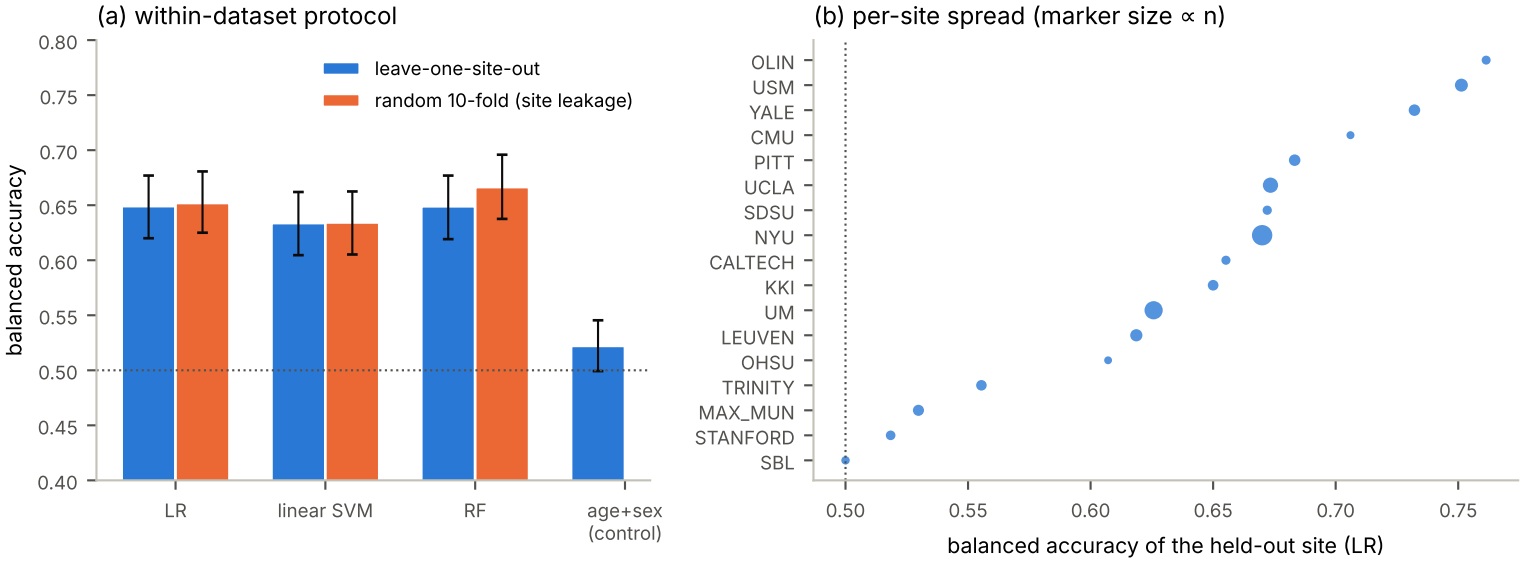
(a) within-dataset protocol
leave-one-site-out
random 10-fold (site leakage)
balanced accuracy
0.80
0.75
0.70
0.65
0.60
0.55
0.50
0.45
0.40
LR
linear SVM
RF
age+sex (control)
(b) per-site spread (marker size ∝ n)
OLIN
USM
YALE
CMU
PITT
UCLA
SDSU
NYU
CALTECH
KKI
UM
LEUVEN
OHSU
TRINITY
MAX_MUN
STANFORD
SBL
0.50
0.55
0.60
0.65
0.70
0.75
balanced accuracy of the held-out site (LR)