


Meter readings received (daily)



Daily volume extracted in m3



Volume extracted (m3) - 30 day moving average (21 days required)

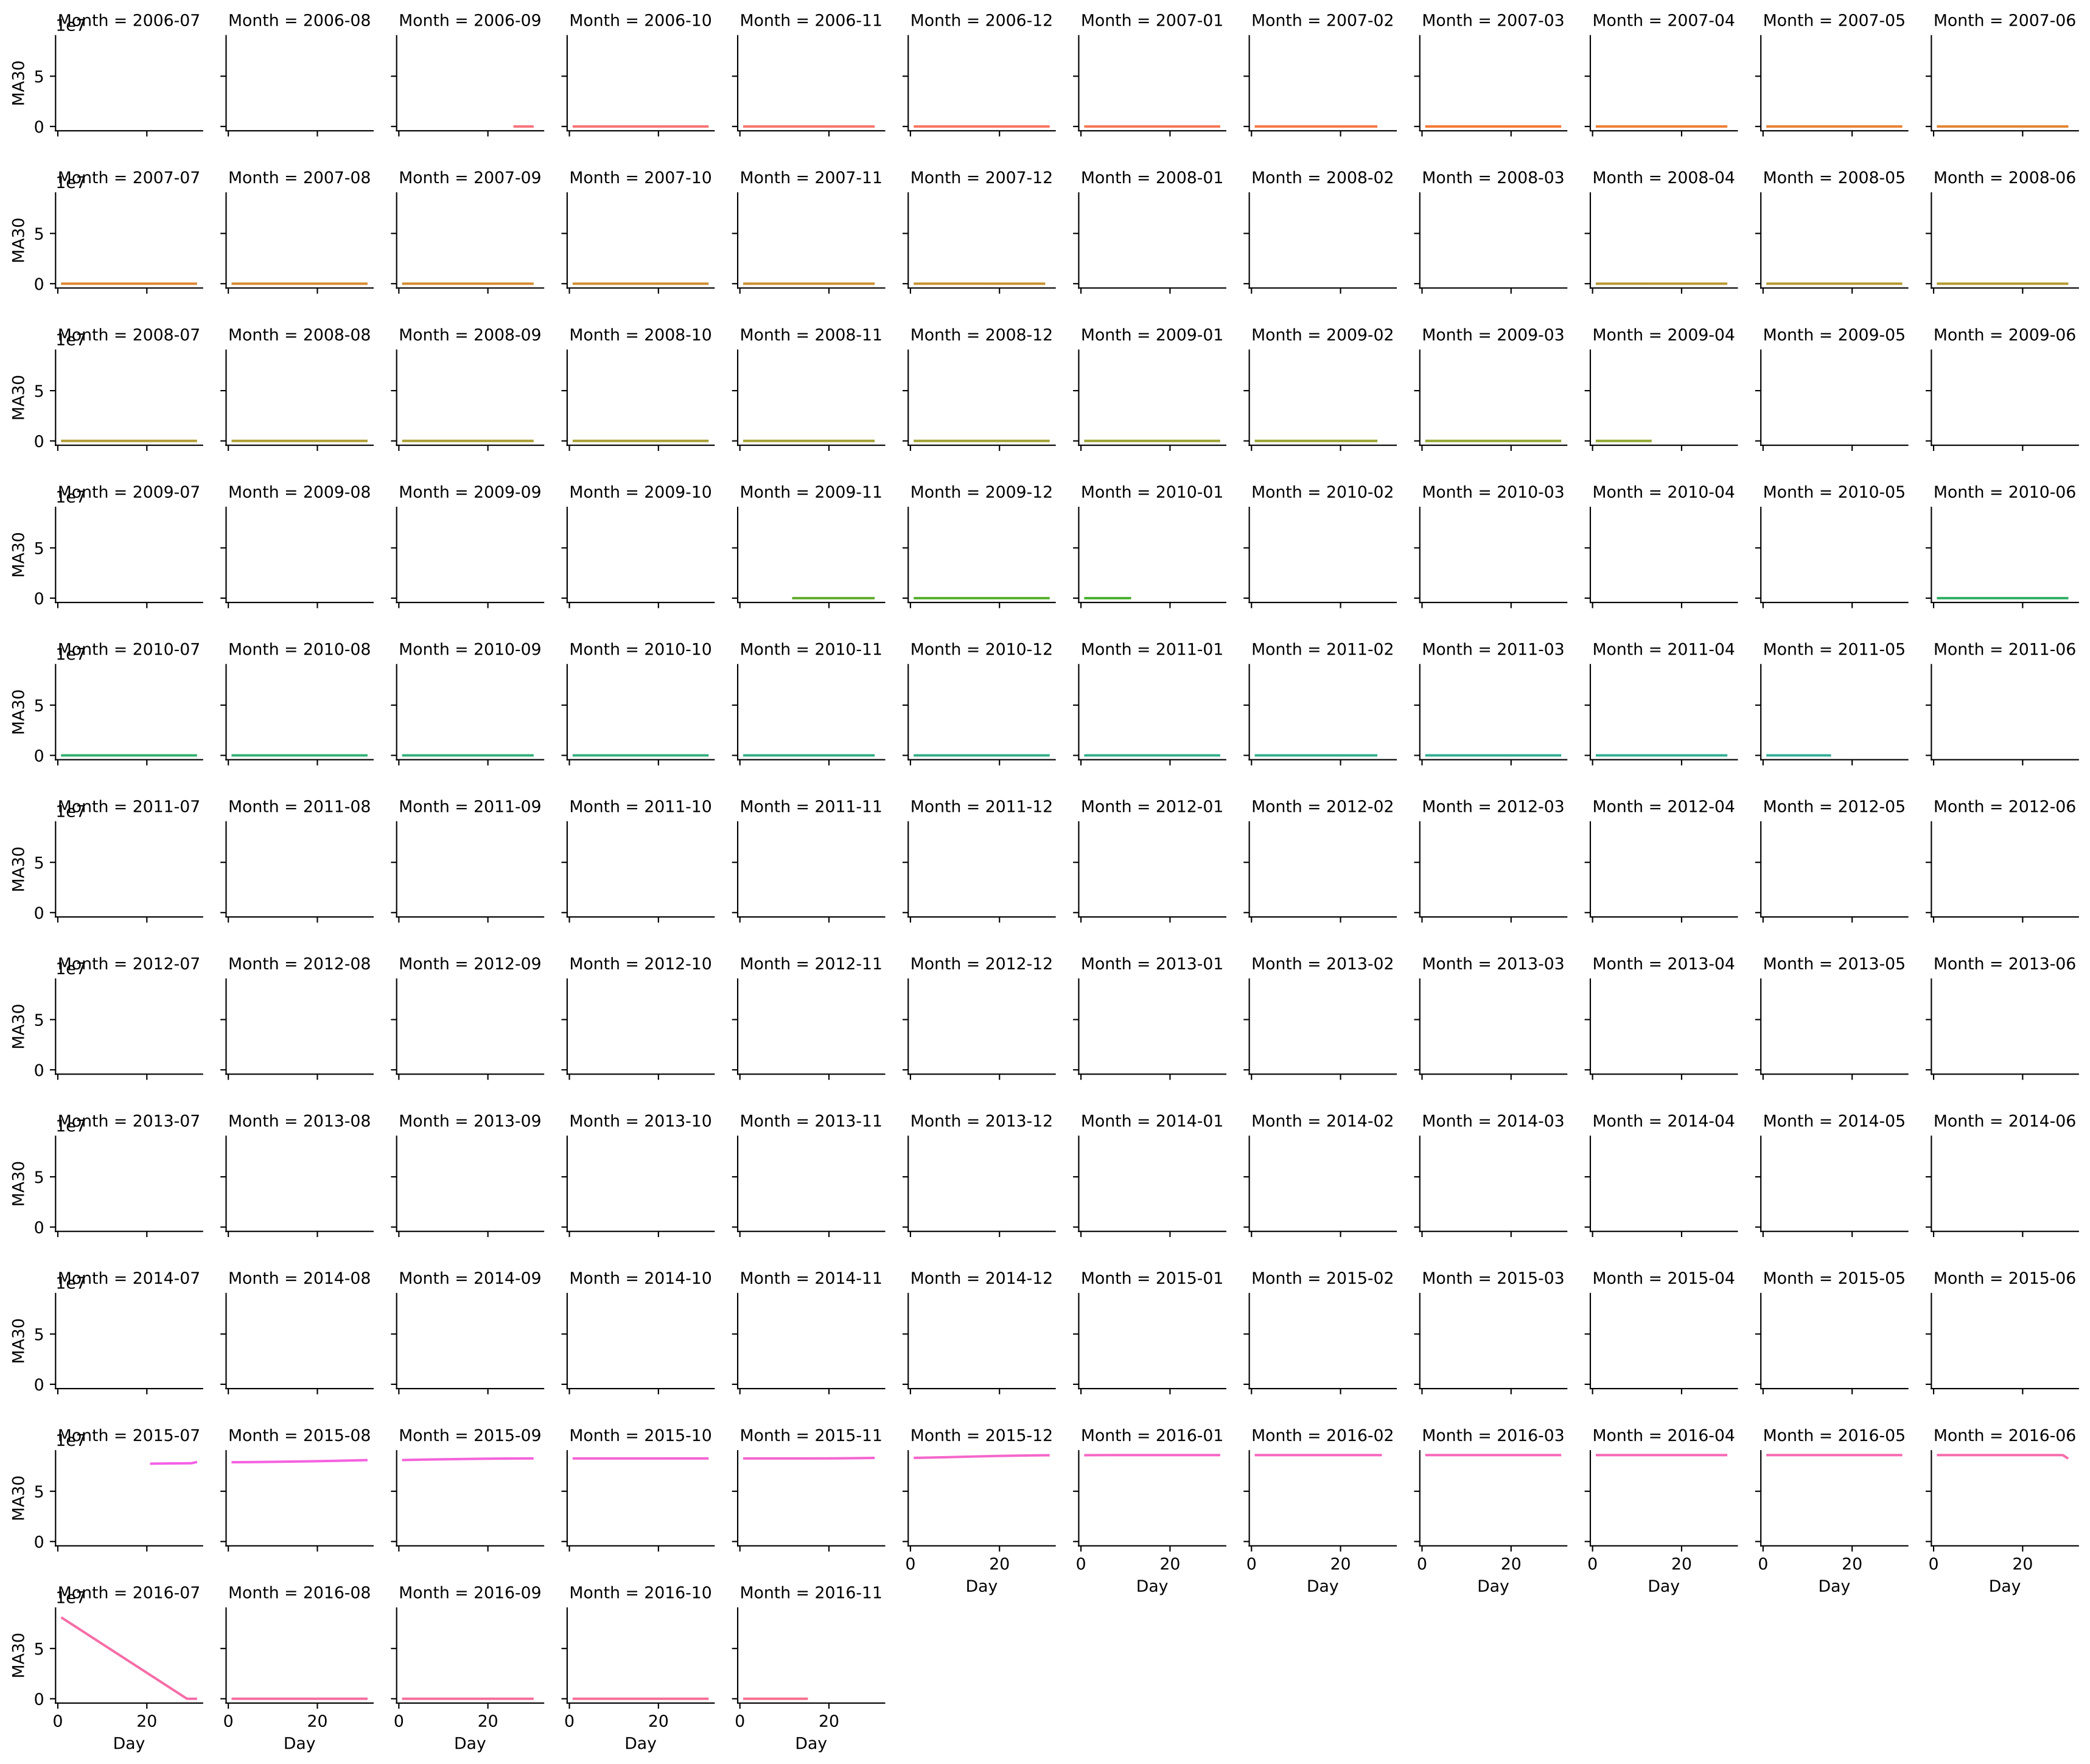

Average daily extraction rate in L/s

